

SERIES 'TITAN 85' ALUMINUM SLIDING GLASS DOOR

DESIGN LOAD RATING FOR DOORS TO BE AS PER CHART SHOWN ON SHEET 2.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2017 (6TH EDITION)/2020 (7TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.


MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2017/2020 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

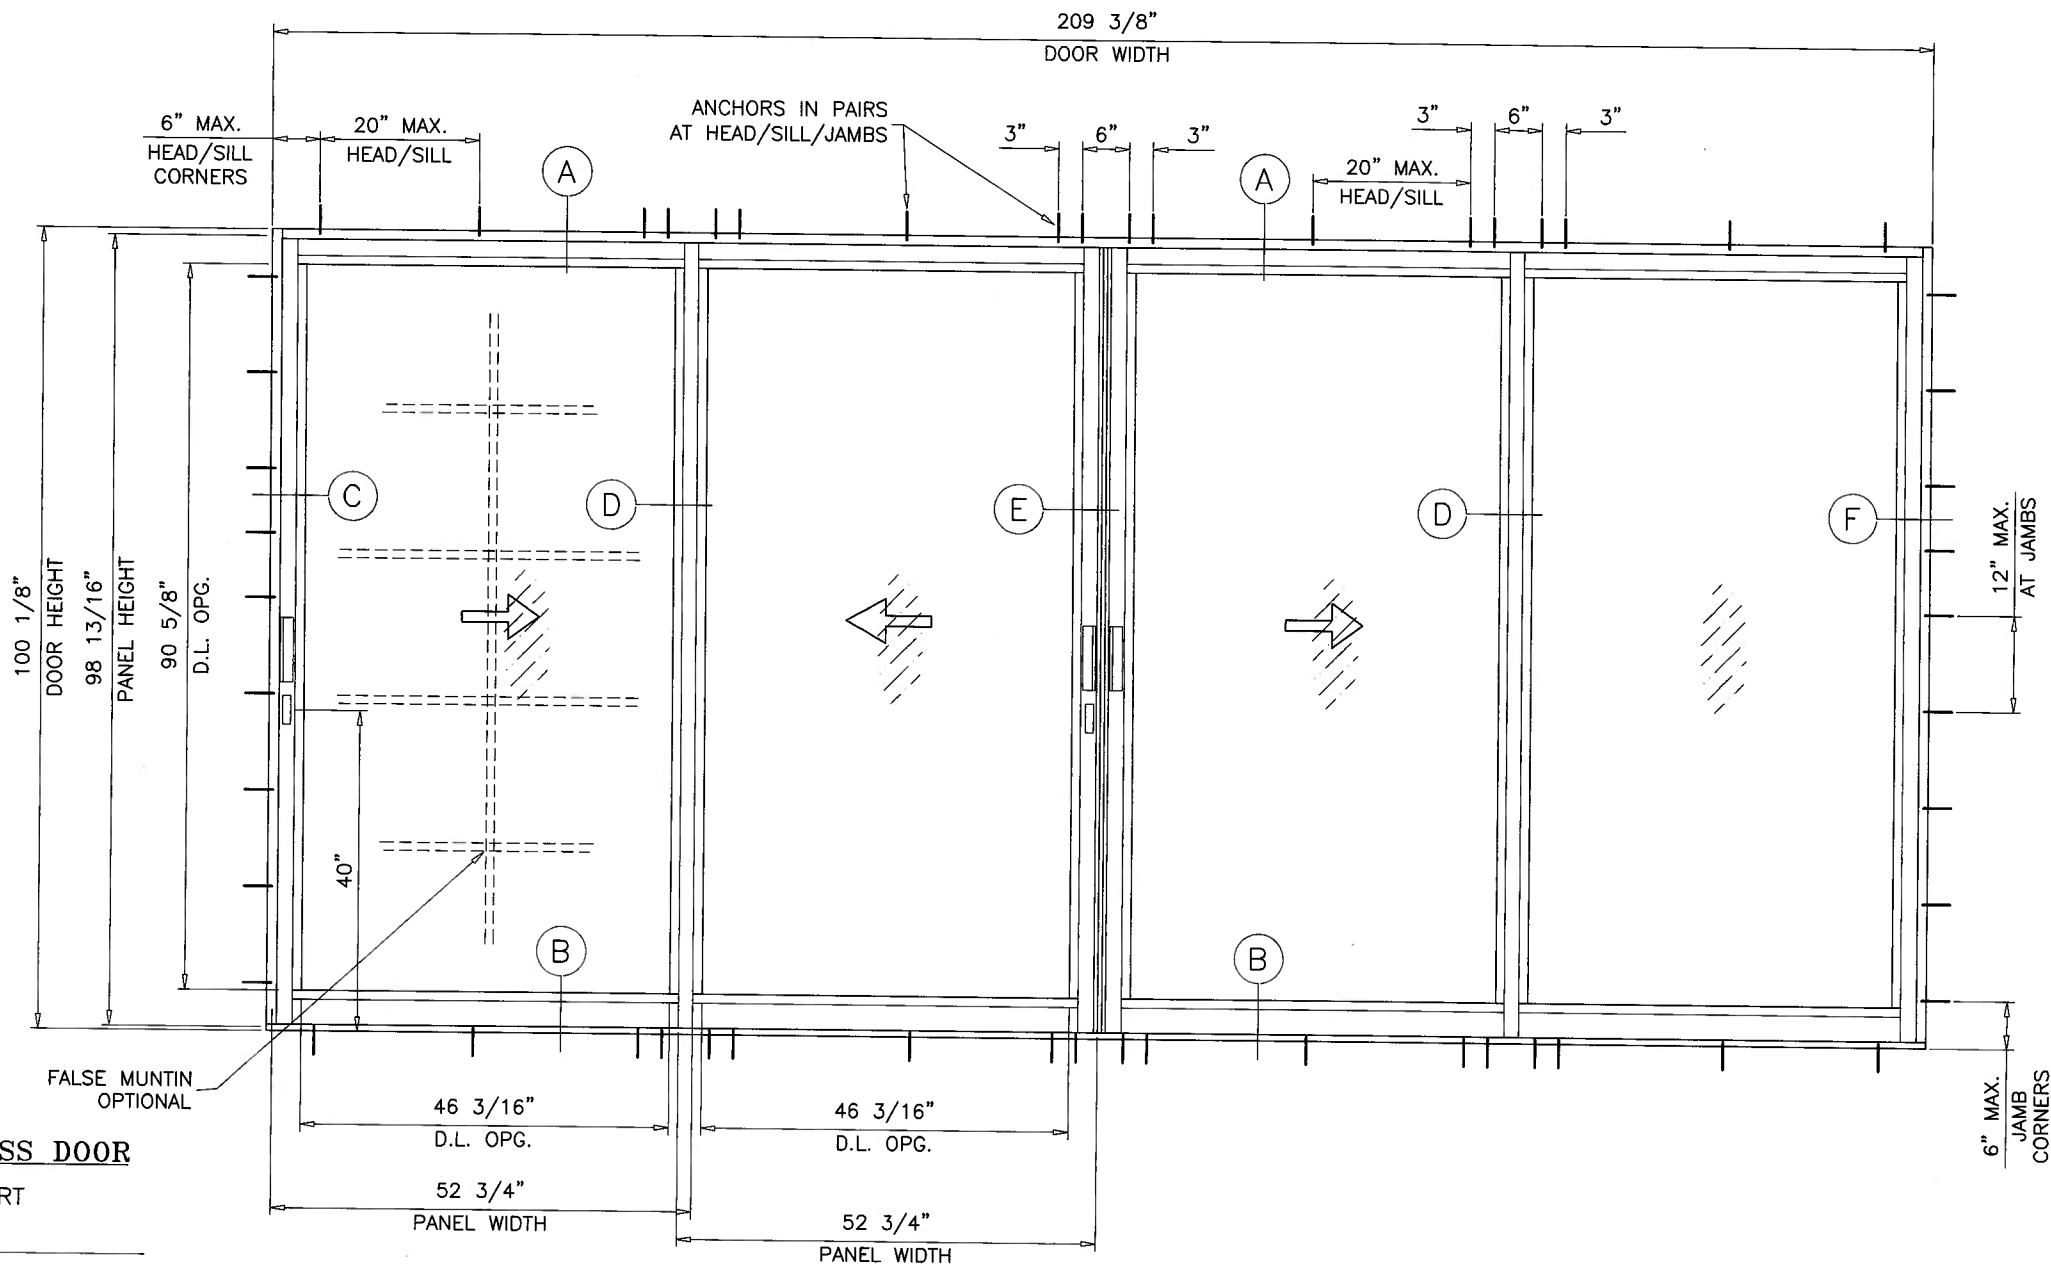

TYPICAL ELEVATION


THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

**LAMINATED GLASS
LARGE MISSILE IMPACT**

Sealed: 12/7/2020 FL #15944

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

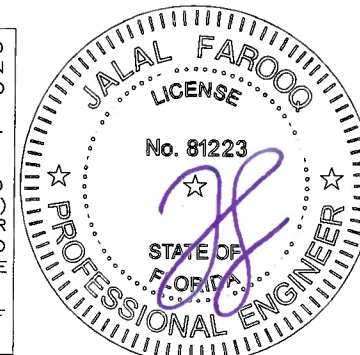

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978






SERIES 'TITAN 85' ALUM SLIDING GLASS DOOR (L.M.I.)
INTERNATIONAL IMPACT BUILDING PRODUCTS, LLC
d/b/a PLAZA DOOR
5900 AUSTRALIAN AVE. SUITE #3
WEST PALM BEACH, FL 33407
TEL. (561) 578-5450 FAX. (561) 578-5460

no	date	by	description
A	12.07.17		UPDATED TO 2017 FBC
B	11.30.20		UPDATED TO 2020 FBC

date:	08-10-12
scale:	1/2"=1'-0"
dr. by:	TARIQ
chk. by:	

drawing no.
W12-47
sheet 1 of 7


COMP-ANL\W12-47IIBP

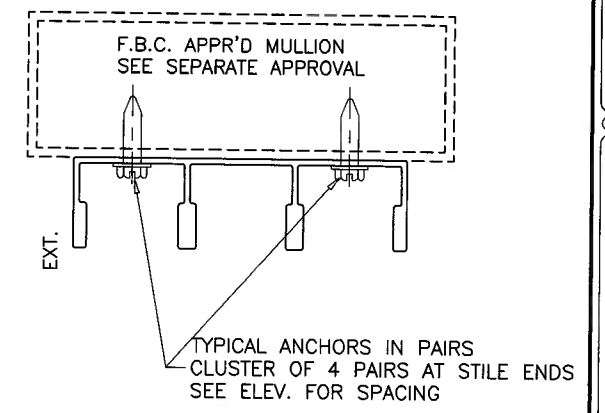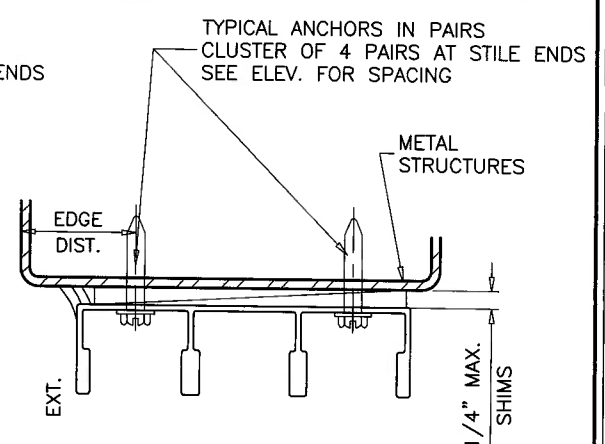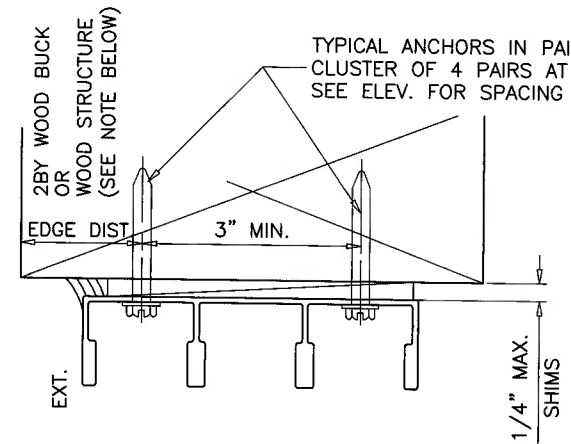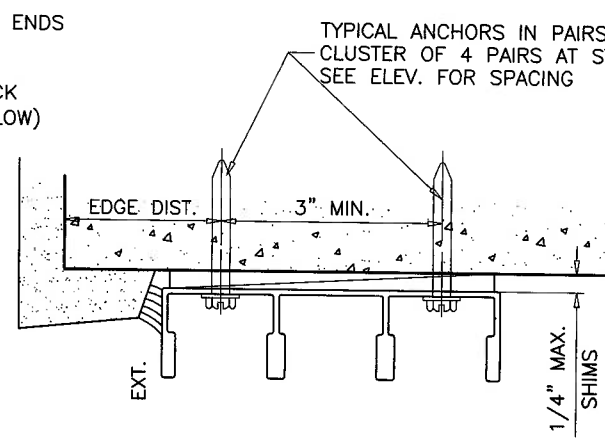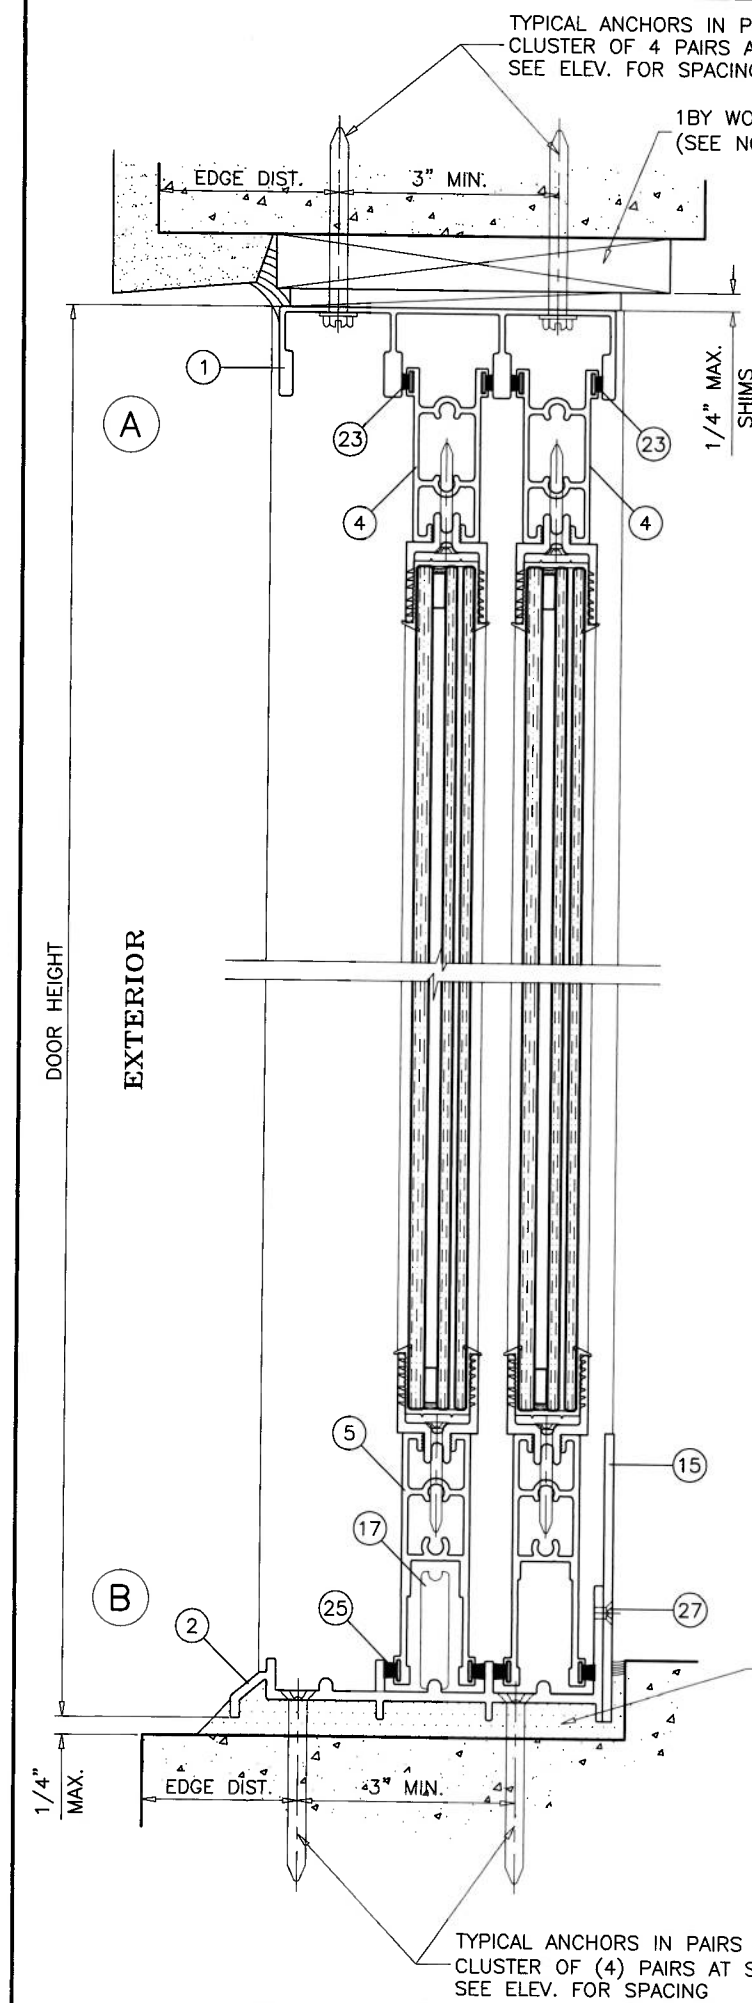

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'PLAZA DOOR' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)
 THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)
 DIRECTLY INTO CONCRETE OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)
1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO F.B.C. APPROVED MULLIONS
 OR
 INTO METAL STRUCTURES (HEAD/JAMBS)
 (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND BLOCKS = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.
 WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

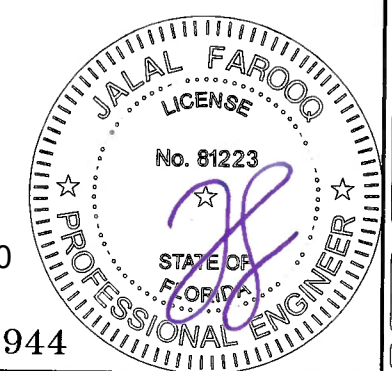

Sealed: 12/7/2020

FL #15944

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

COMP - ANL W12-47IBP

SERIES 'TITAN 85' ALUM SLIDING GLASS DOOR (L.M.I.)
 INTERNATIONAL IMPACT BUILDING PRODUCTS, LLC
 d/b/a PLAZA DOOR
 5900 AUSTRALIAN AVE. SUITE #3
 WEST PALM BEACH, FL 33407
 TEL. (561) 578-5450 FAX. (561) 578-5460

revisions:

no	date	by	description

date: 08-10-12 scale: 3/8" = 1" dr. by: TARIQ ch. by:
 drawing no. **W12-47** sheet 3 of 7




FL #15944

drawing no.
W12-47


sheet 5 of 7

COMP-ANL\W12-47IBP

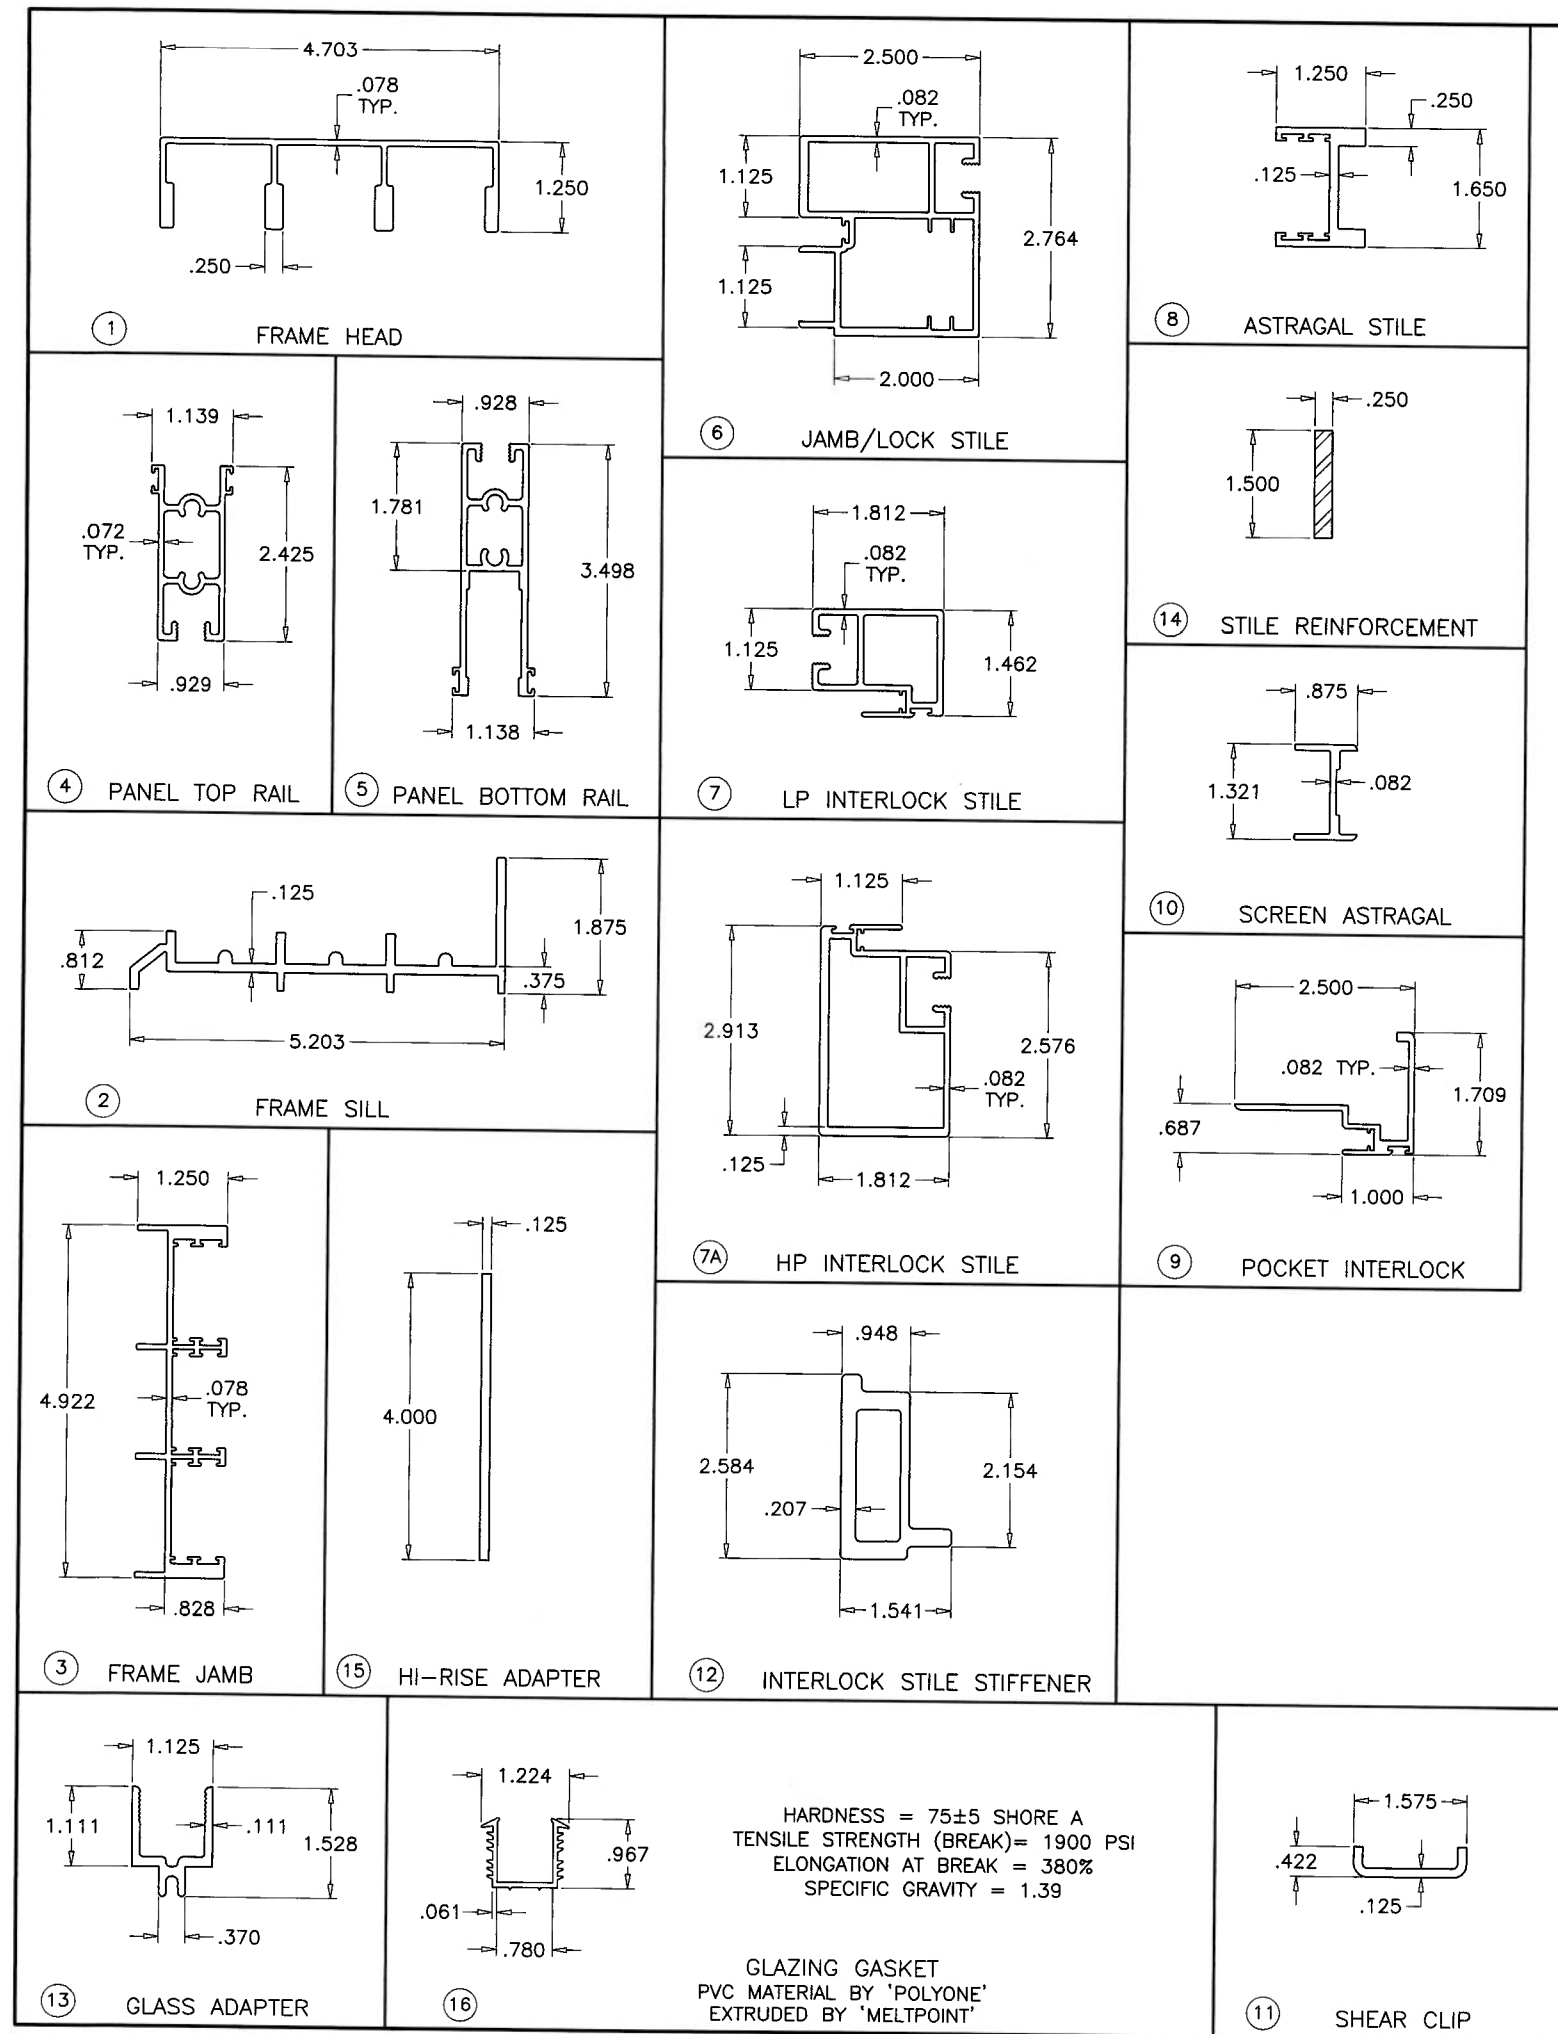

Sealed: 12/7/2020

FL #15944

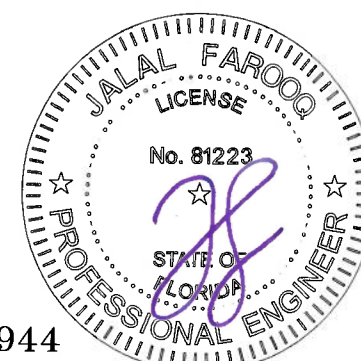

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W12-47\IBP


SERIES 'TITAN 85' ALUM SLIDING GLASS DOOR (L.M.I.)
INTERNATIONAL IMPACT BUILDING PRODUCTS, LLC
d/b/a PLAZA DOOR
5900 AUSTRALIAN AVE. SUITE #3
WEST PALM BEACH, FL 33407
TEL. (561) 578-5450 FAX. (561) 578-5460

revisions:
no date by description


date: 08-10-12
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W12-47


sheet 6 of 7

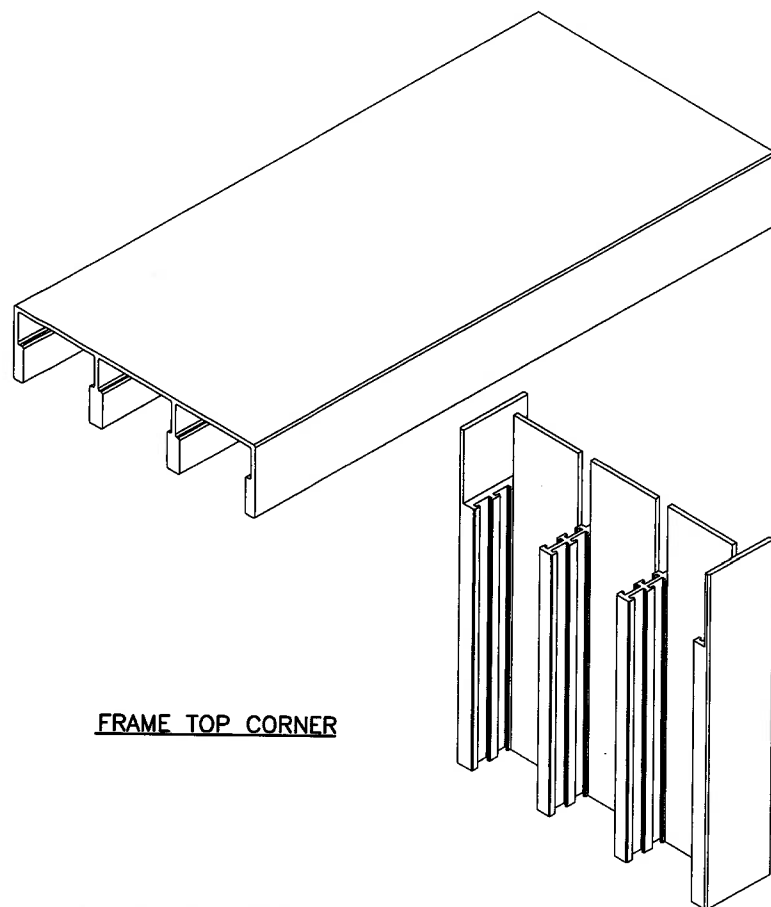

JAMB NOTCHED TO RECIEVE HEADER AND SILL RIBS
APPLY BEAD OF SONNEBORN NP1 SEALANT
AT TOP AND BOTTOM JOINTS

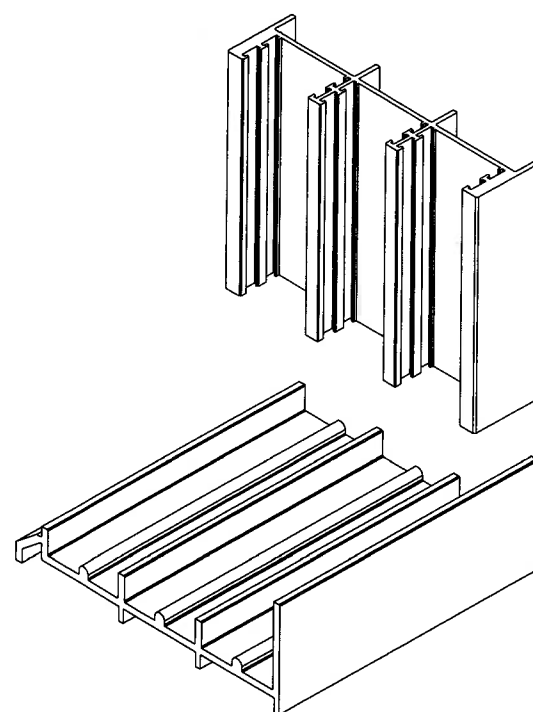


FRAME BOTTOM CORNER

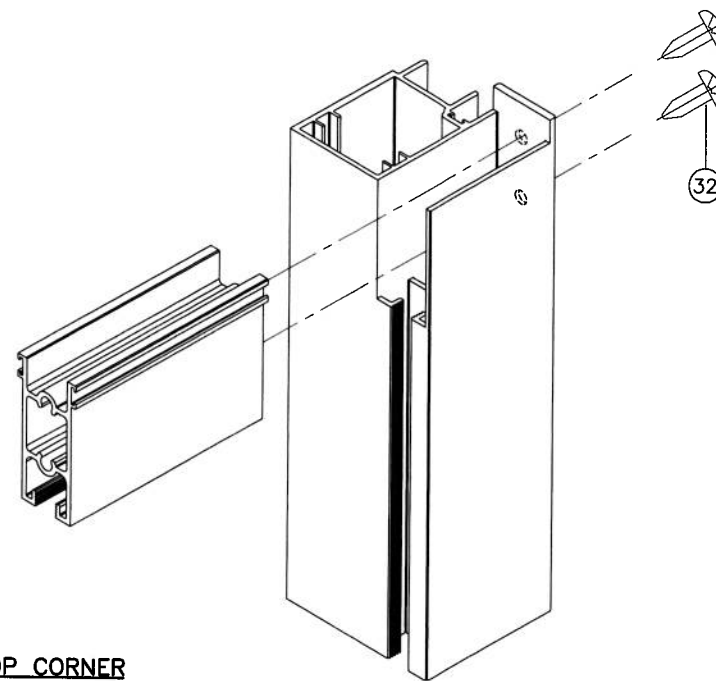


PANEL TOP CORNER


APPLY BEAD OF SONNEBORN NP1 SEALANT
AT TOP AND BOTTOM JOINTS

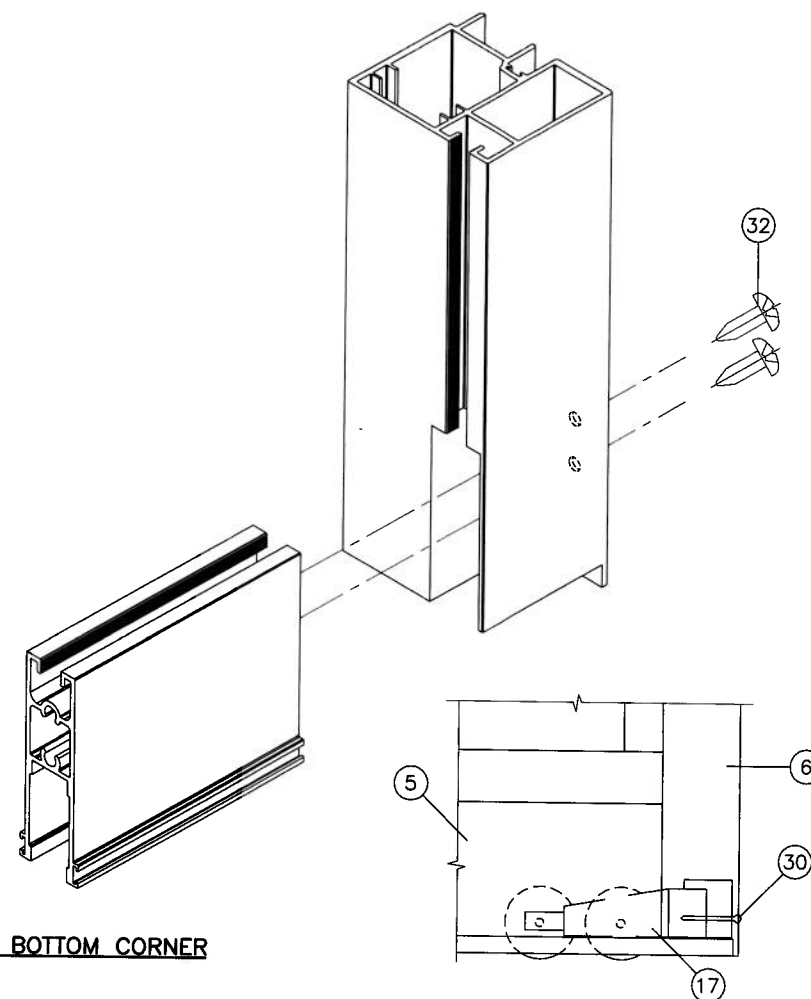

PANEL BOTTOM CORNER

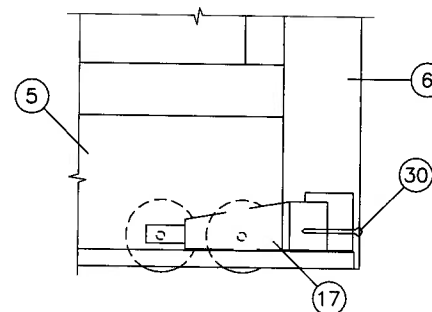


ROLLER FASTENER DETAIL

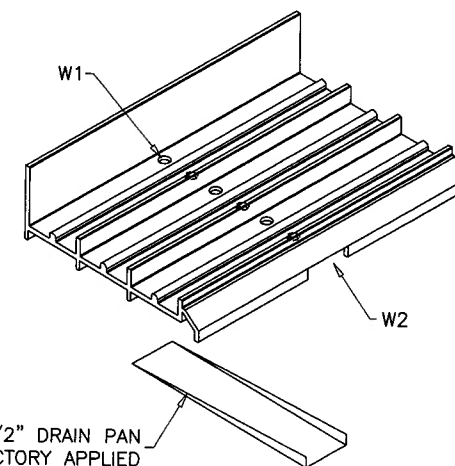

WEEPHOLES:

W1 = CLUSTER OF SIX 3/8" WEEP HOLES AT 17" FROM EACH END AND 21" O.C.

W2 = 1/4" X 1-1/2" OPENING FOR DRAIN PAN AT 17" FROM EACH END AND 21" O.C.

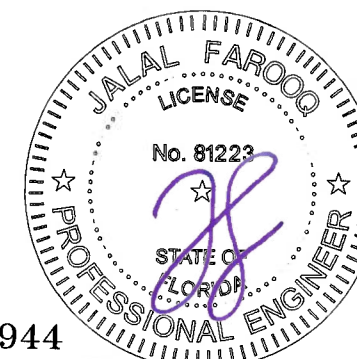

Sealed: 12/7/2020

FL #15944

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 'TITAN 85' ALUM SLIDING GLASS DOOR (L.M.I.)

INTERNATIONAL IMPACT BUILDING PRODUCTS, LLC
d/b/a PLAZA DOOR
5900 AUSTRALIAN AVE., SUITE #3
WEST PALM BEACH, FL 33407
TEL. (561) 578-5450 FAX (561) 578-5460

date: 08-10-12

scale: 3/8" = 1"

dr. by: TARIQ

revisions:

no	date	by	description

drawing no

W12-47

sheet 7

of 7