




5200 W. CENTURY BLVD.
LOS ANGELES, CA 90045



OPAQUE FIBERGLASS DOUBLE DOOR
w/ or w/out SIDELITES
Outswing
"IMPACT"

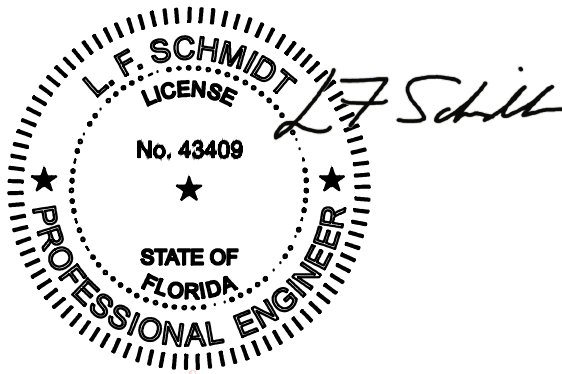

Digitally signed by Lyndon F Schmidt
Date: 2026.08.04 08:47:04 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

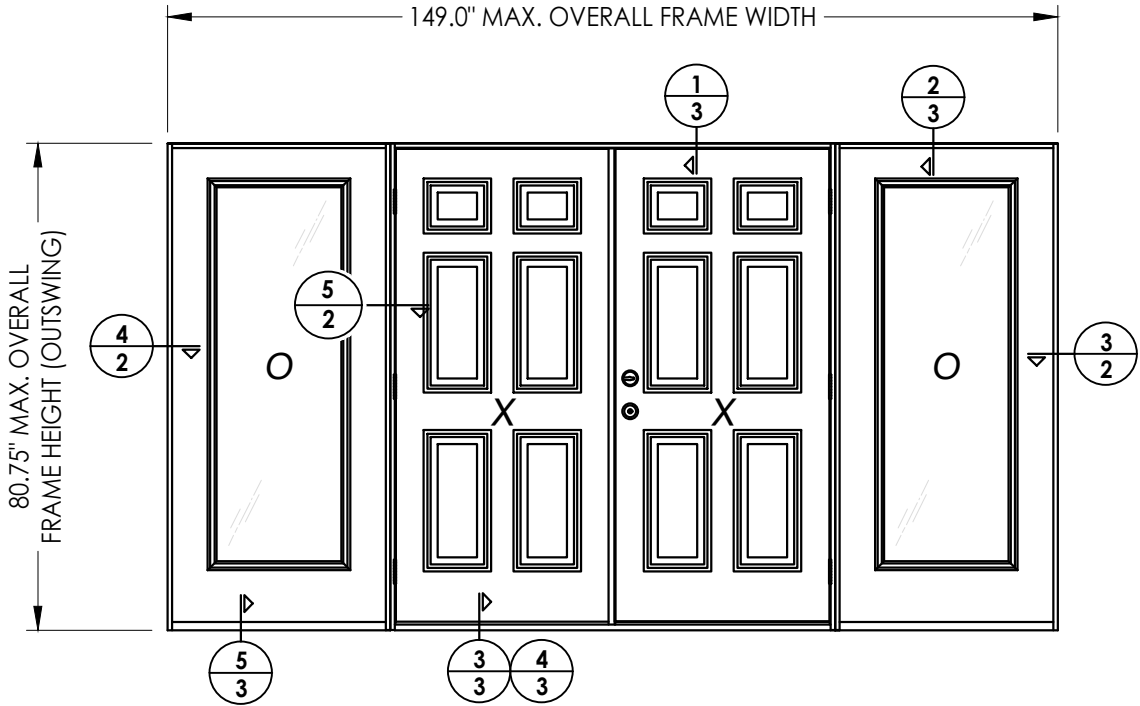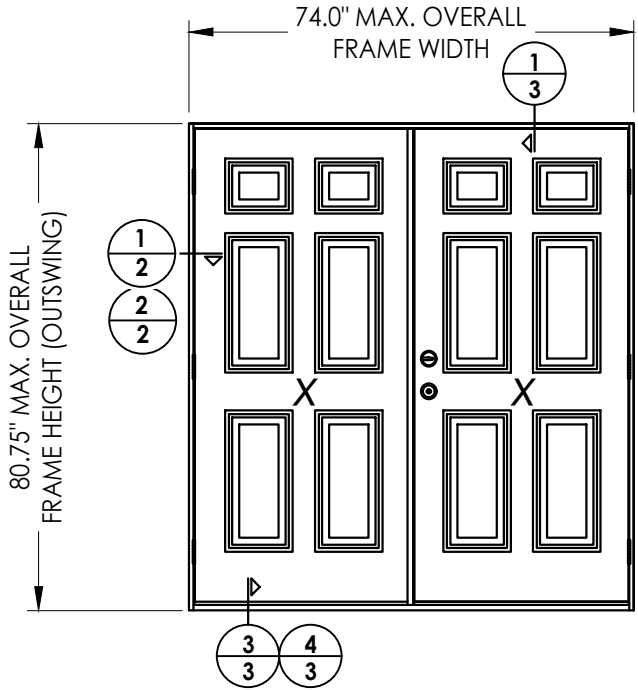

GENERAL NOTES

1. This product anchoring drawing has been developed and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ). See the Certification Agency Certificate for sizes, specifications and rating.
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996.
5. For 2x stud construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. Outswing configurations utilizing the high dam sill (see Section 4/3), meet water infiltration requirements for "HVHZ". All other configurations do not meet the water infiltration requirements for the "HVHZ" and must be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Horizontal cross sections
3	Vertical cross sections
4	Buck anchoring & bill of materials
5	Frame anchoring & glazing details

CONFIGURATION	MAX. FRAME DIMENSION	DESIGN PRESSURE (PSF)	
		POSITIVE	NEGATIVE
XX	74.0" x 80.75"	+50.0	-50.0
OXXO	149.0" x 80.75"	+50.0	-50.0

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PLASTPRO
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
4	8/14/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
3	7/23/20	UPDATE TO 7TH ED. (2020)	FBC	LFS
2	10/14/17	UPDATE TO 6TH ED. (2017)	FBC	LFS
1	09/02/15	UPDATE TO 5TH ED. (2014)	FBC	LFS
NO.	DATE			BY

REVISIONS

DATE: 8/06/14

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-16094.6


SHEET 1 OF 5

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-16094 R10\FL-16094.5-8.dwg

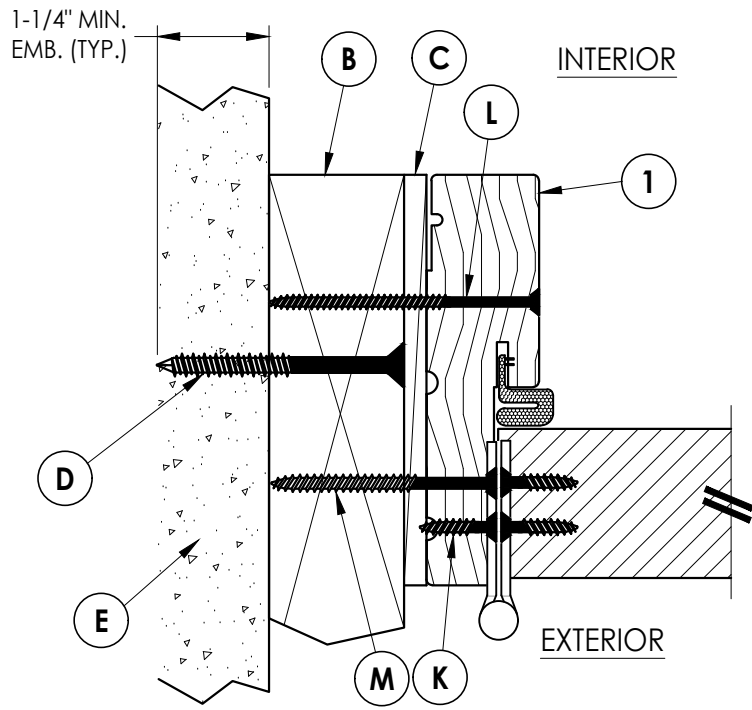


1 **HORIZONTAL CROSS SECTION**
2 Outswing
2X Buck Construction

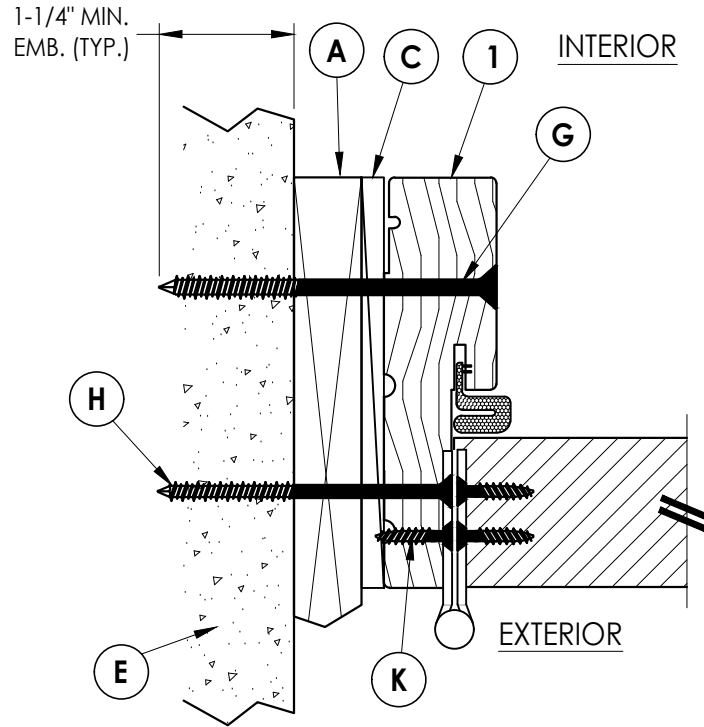


2 **HORIZONTAL CROSS SECTION**
2 Outswing
1X Buck Construction

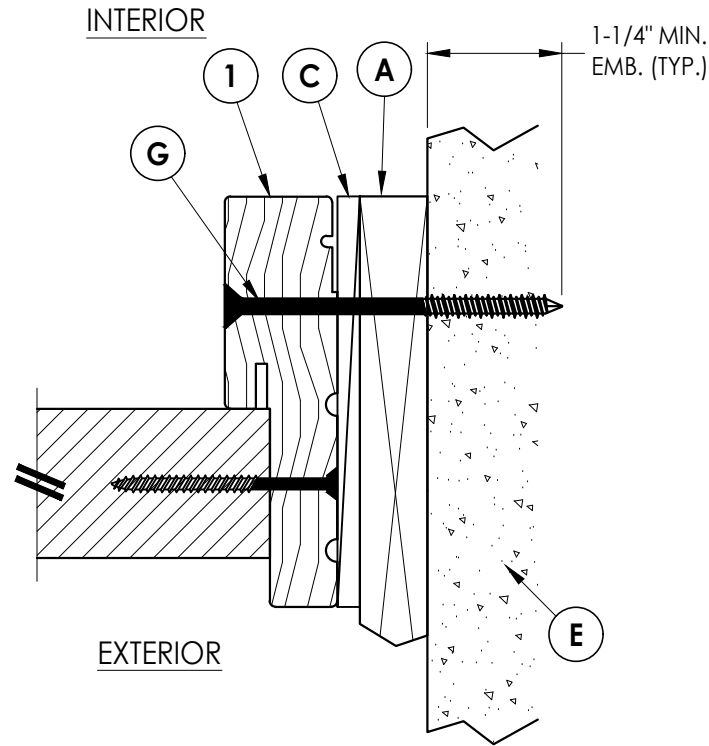

3 **HORIZONTAL CROSS SECTION**
2 Outswing
1X Buck Construction

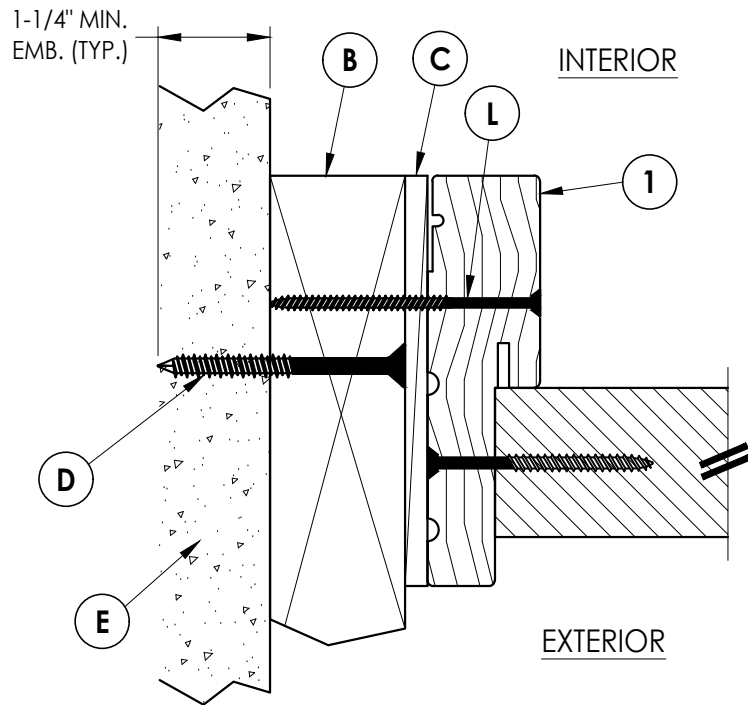

4 **HORIZONTAL CROSS SECTION**
2 Outswing
1X Buck Construction

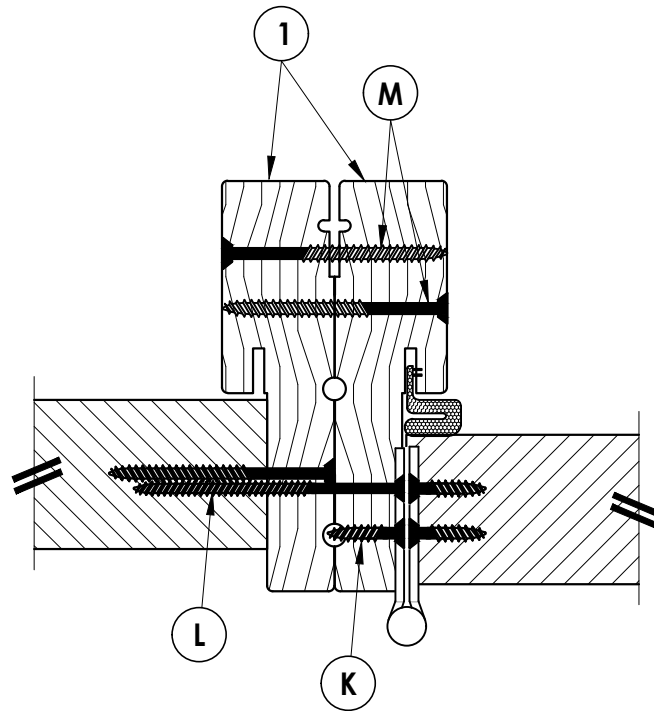

5 **HORIZONTAL CROSS SECTION**
2 @ BACK-TO-BACK JAMBS

Documents Prepared By:

Lyndon F. Schmidt

P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:

PLASTPRO INC.
FIBERGLASS DOOR

PART OR ASSEMBLY:

HORIZONTAL
CROSS SECTIONS

NO.	DATE	REVISIONS
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	8/14/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	7/23/20	UPDATE TO 7TH ED. (2020) FBC LFS
2	10/14/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	09/02/15	UPDATE TO 5TH ED. (2014) FBC LFS
		BY

DATE: 8/06/14

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-16094.6

SHEET 2 OF 5


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-16094 R10\FL-16094.5--8.dwg

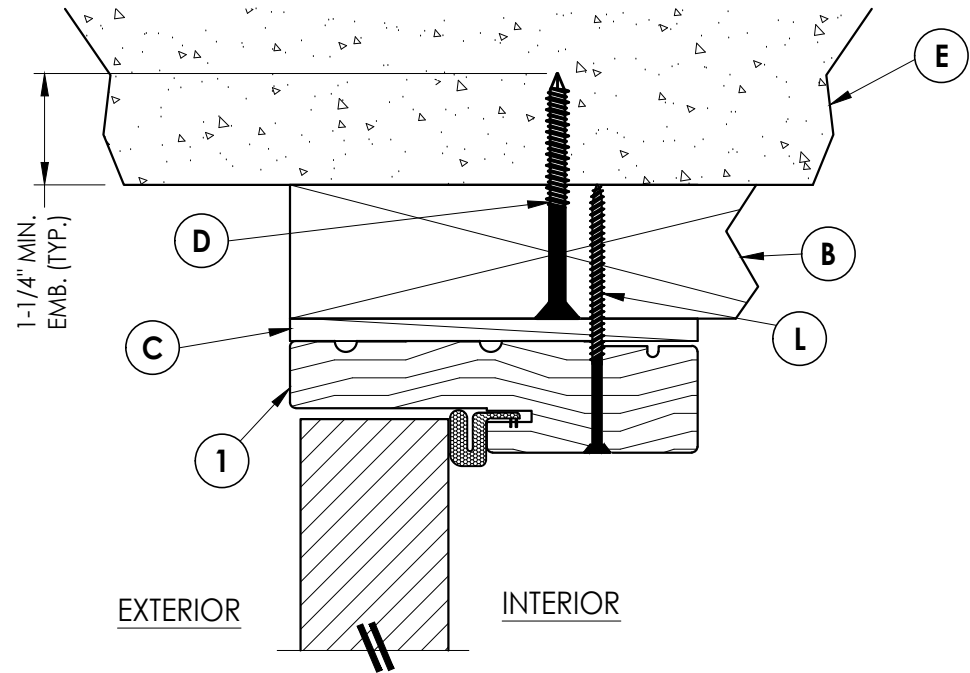


1
3 **VERTICAL CROSS SECTION**
Outswing
2X Buck Construction

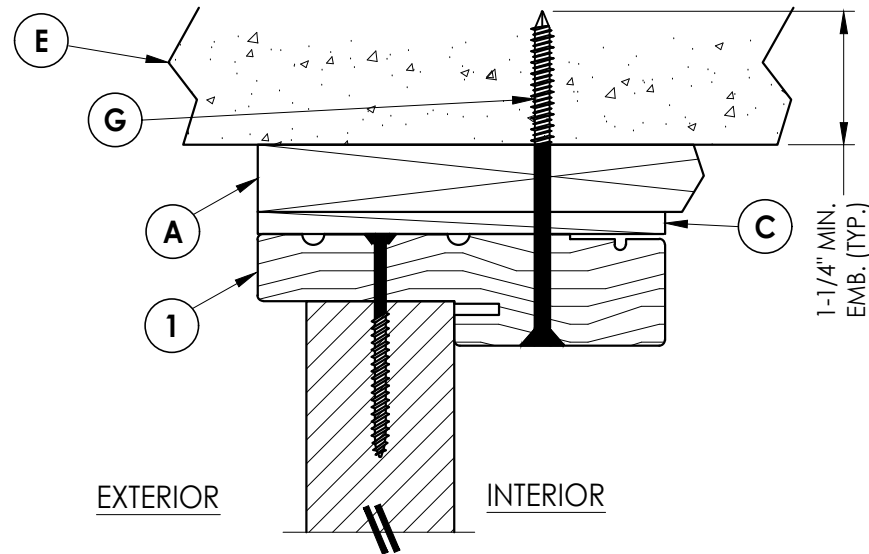


2
3 **VERTICAL CROSS SECTION**
Outswing
1X Buck Construction

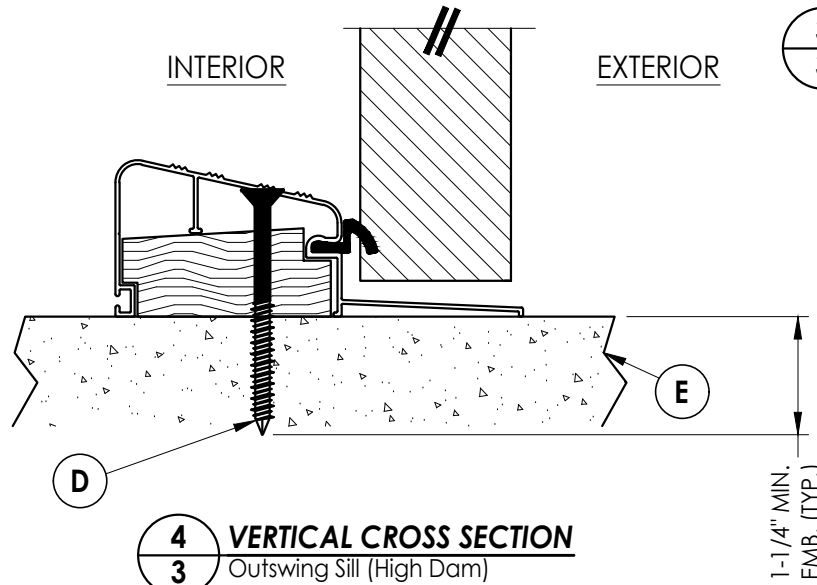

4
3 **VERTICAL CROSS SECTION**
Outswing Sill (High Dam)

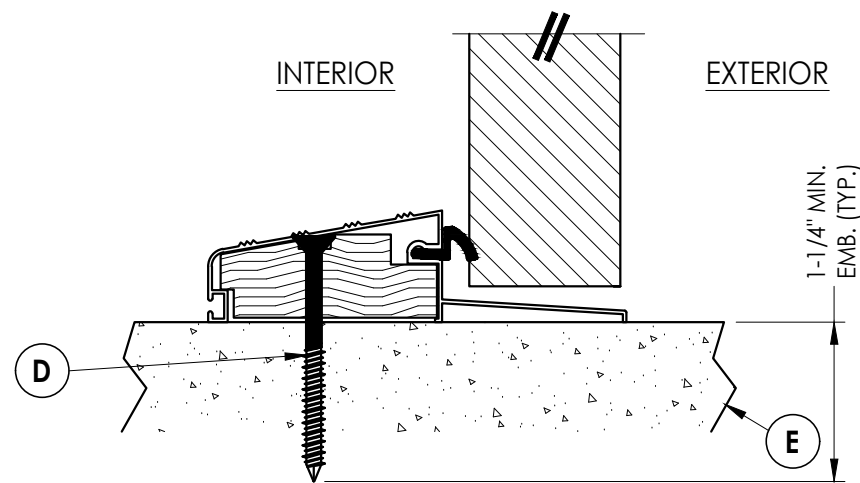

3
3 **VERTICAL CROSS SECTION**
Outswing Sill

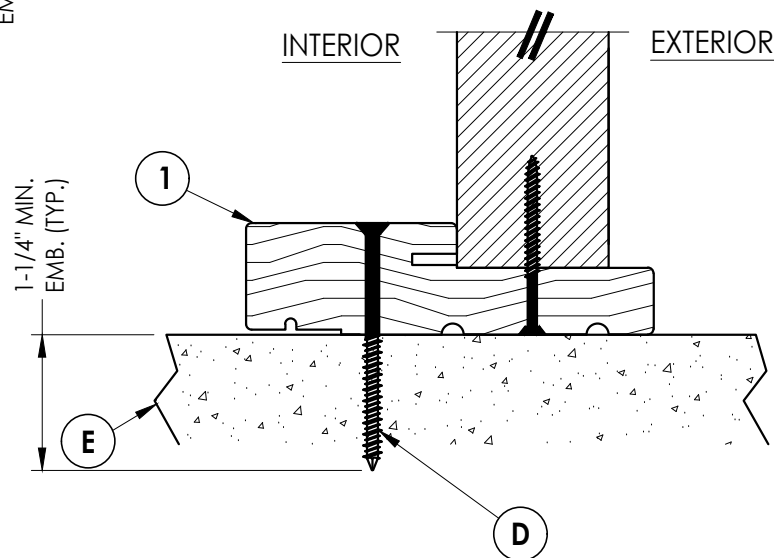

5
3 **VERTICAL CROSS SECTION**
Outswing Sill

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
PLASTPRO INC.
FIBERGLASS DOOR

PART OR ASSEMBLY:

VERTICAL
CROSS SECTIONS

NO.	DATE	REVISIONS				
						BY
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS		
4	8/14/23	UPDATE TO 8TH ED. (2023)	FBC	LFS		
3	7/23/20	UPDATE TO 7TH ED. (2020)	FBC	LFS		
2	10/14/17	UPDATE TO 6TH ED. (2017)	FBC	LFS		
1	09/02/15	UPDATE TO 5TH ED. (2014)	FBC	LFS		

DATE: 8/06/14

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-16094.6

SHEET 3 OF 5

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

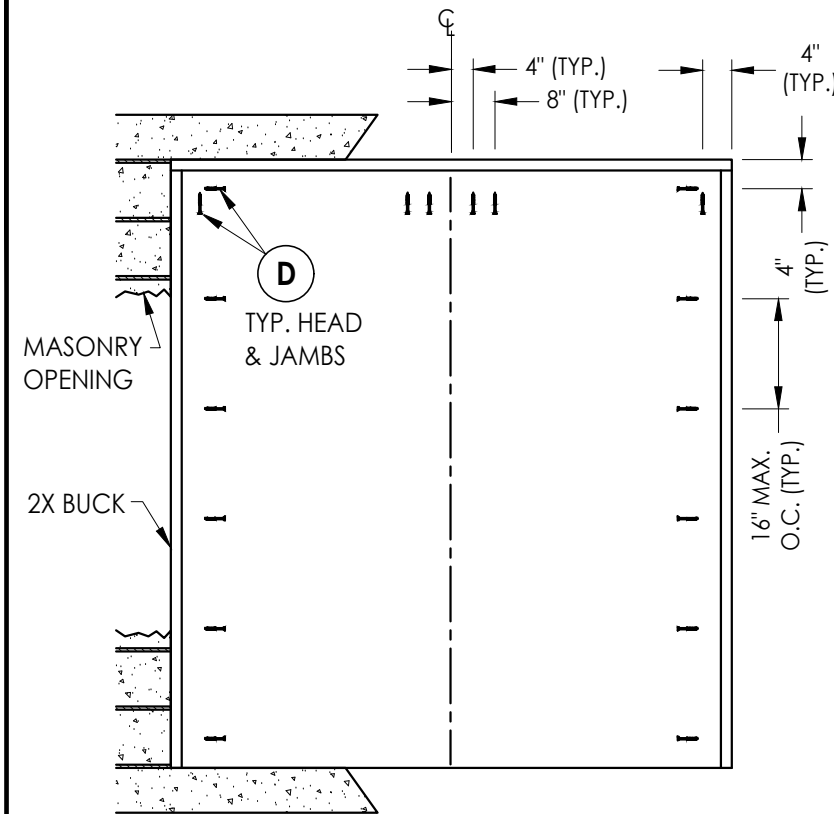

BUCK ANCHORING
XX

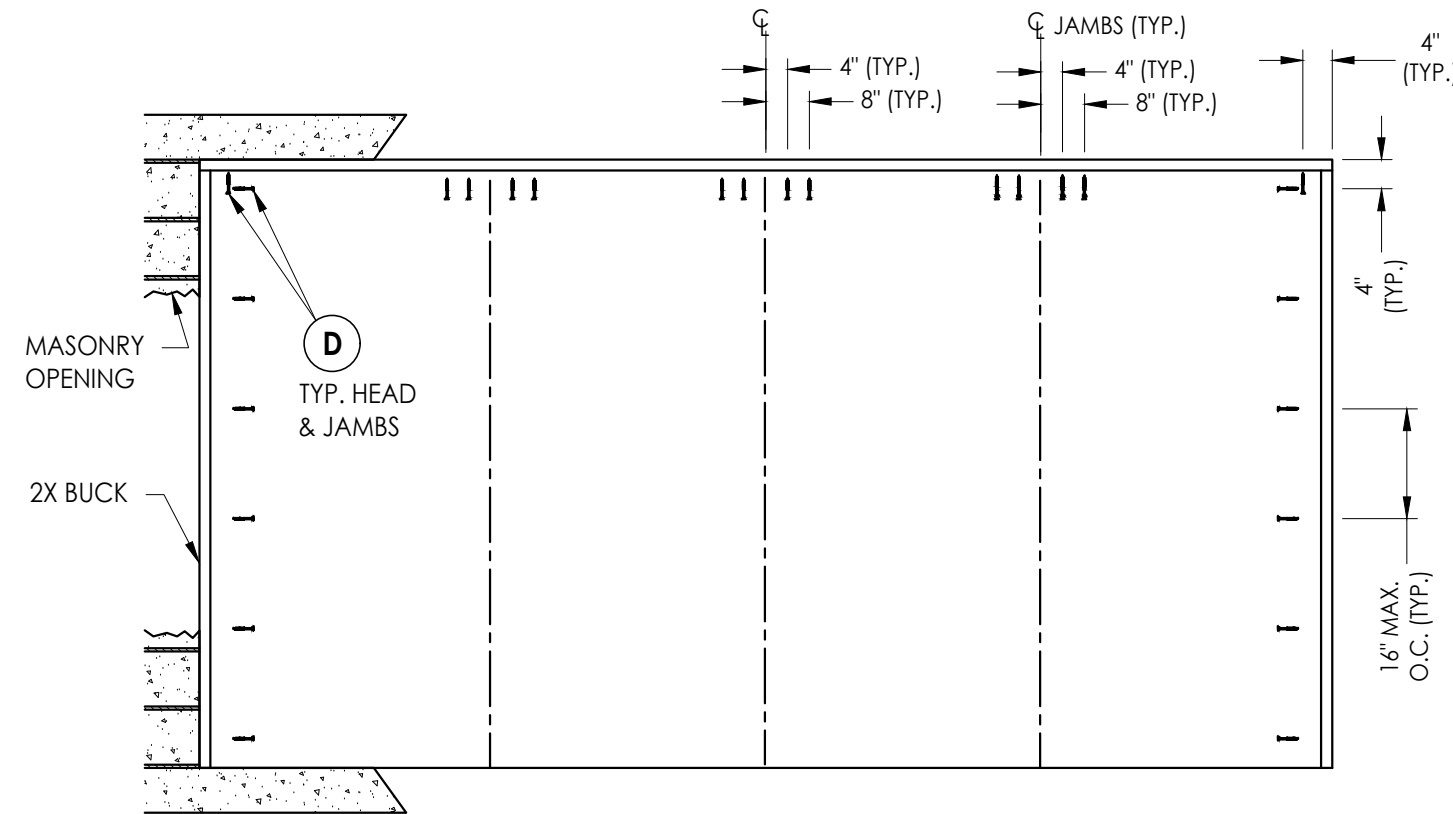

BUCK ANCHORING
OXXO

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.55)	WOOD
B	2X BUCK (SG >= 0.55)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	1/4" X 3-3/4" PFH ITW CONCRETE SCREW	STEEL
H	3/16" x 3-1/4" PFH ITW CONCRETE SCREW	STEEL
I	3/16" x 2-3/4" PFH ITW CONCRETE SCREW	STEEL
J	3/16" x 1-3/4" PFH ITW CONCRETE SCREW	STEEL
K	#9 X 3/4" PFH WOOD SCREW	STEEL
L	#8 X 3" PFH WOOD SCREW (1-1/2" MIN. EMBEDMENT)	STEEL
M	#10 X 2-1/2" PFH WOOD SCREW	STEEL
1	FINGER JOINTED PINE HEAD & JAMB (SG >= 0.42)	WOOD




CONCRETE ANCHOR NOTES:

1. Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.
2. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints. Concrete anchor locations noted as "MAX. O.C. (TYP.," must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. O.C. (TYP.," dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"

DATE: 8/06/14		PRODUCT:		Documents Prepared By:	
SCALE: N.T.S.		PLASTPRO INC.		Lyndon F. Schmidt	
DWG. BY: JK		FIBERGLASS DOOR		P.E. No. 43409	
CHK. BY: LFS		PART OR ASSEMBLY:		BUILDING CONSULTANTS, INC.	
DRAWING NO.: FL-16094.6		BUCK ANCHORING & BILL OF MATERIALS		P.O. Box 230, Valrico, FL 33595	
SHEET 4 OF 5		REVISIONS		Phone No.: 813.659.9197	
				FBPE Registry No. 9813	
NO.	DATE				
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC		
4	8/14/23	UPDATE TO 8TH ED. (2023)	FBC		
3	7/23/20	UPDATE TO 7TH ED (2020)	FBC		
2	10/14/17	UPDATE TO 6TH ED. (2017)	FBC		
1	09/02/15	UPDATE TO 5TH ED. (2014)	FBC		
			BY		

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-16094 R10\FL-16094.5--8.dwg

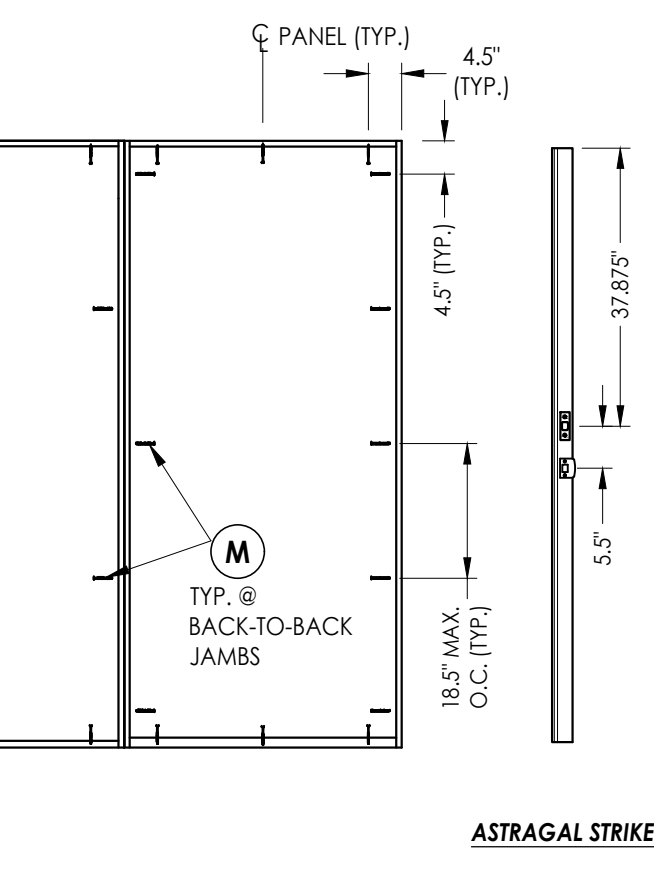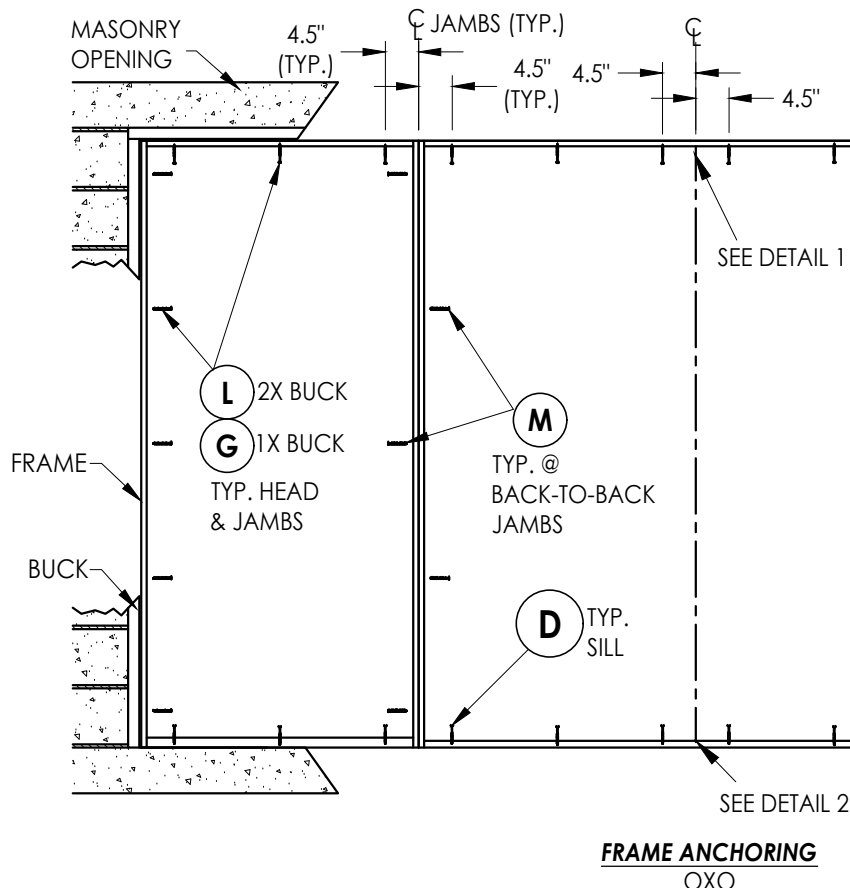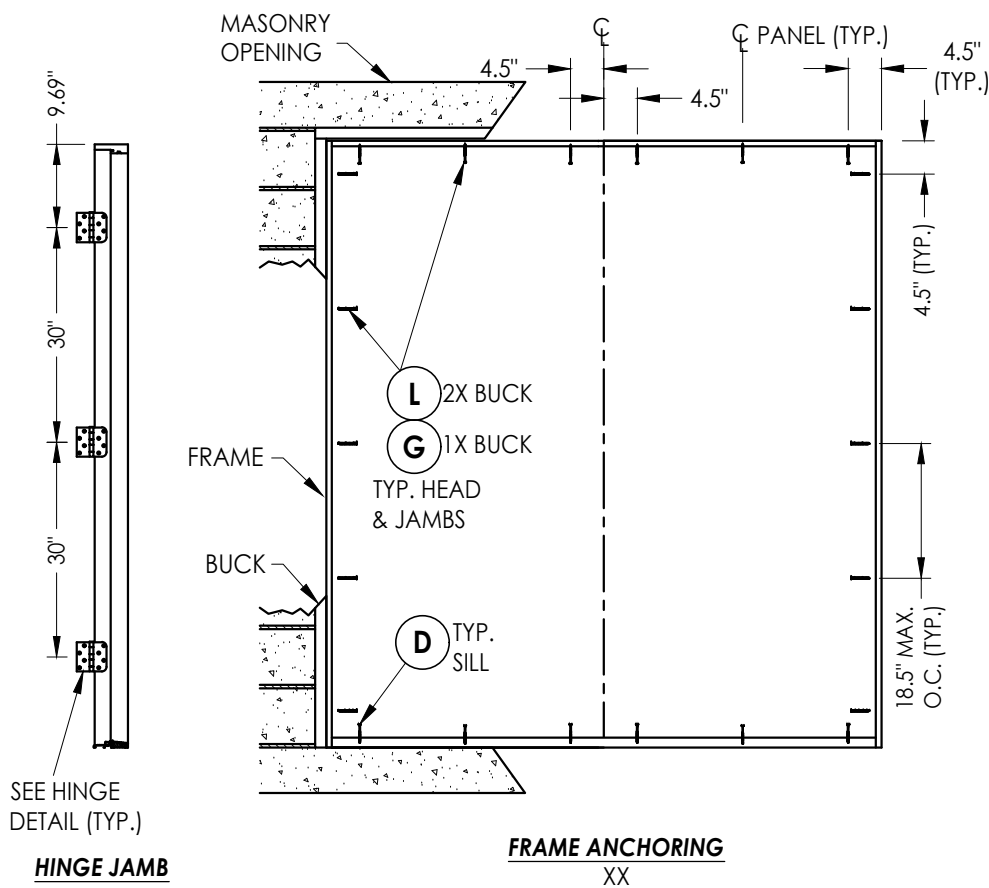

HARDWARE TABLE		
MANUFACTURER	MODEL	
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)

CONCRETE ANCHOR NOTES:





- Substitution of equal concrete anchors from a different supplier may have different edge distance and center distance requirements.
- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints. Concrete anchor locations noted as "MAX. O.C. (TYP.)" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. O.C. (TYP.)" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

CORROSION RESISTANCE - SALTWATER ENVIRONMENT
Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

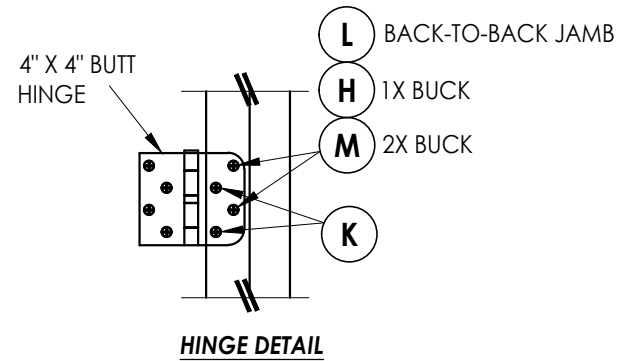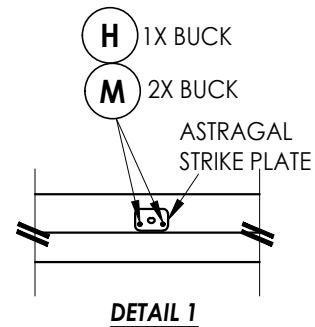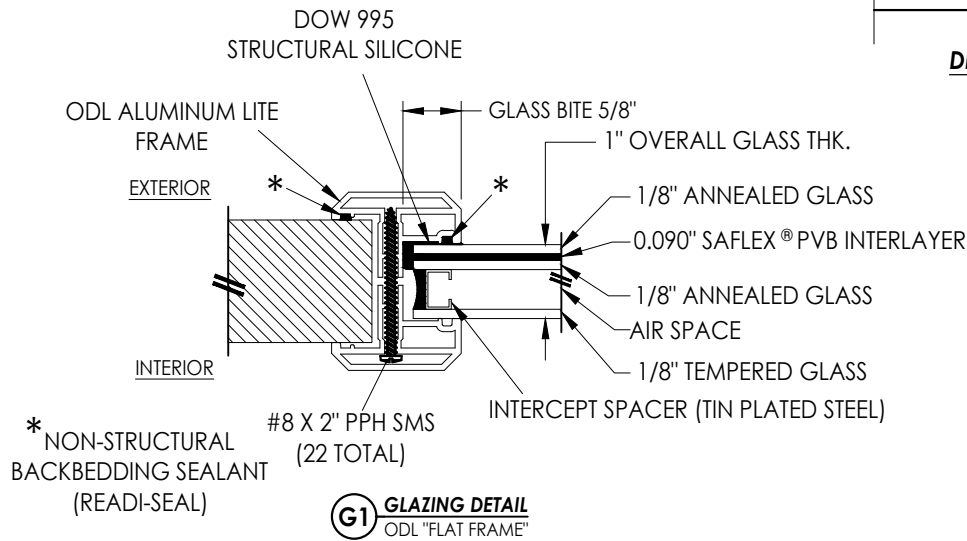

Documents Prepared By:

Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:

PLASTPRO
FIBERGLASS DOOR

PART OR ASSEMBLY:

FRAME ANCHORING &
GLAZING DETAILS

NO.	DATE	REVISIONS	BY
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
4	8/14/23	UPDATE TO 8TH ED. (2023) FBC	LFS
3	7/23/20	UPDATE TO 7TH ED. (2020) FBC	LFS
2	10/14/17	UPDATE TO 6TH ED. (2017) FBC	LFS
1	09/02/15	UPDATE TO 5TH ED. (2014) FBC	LFS

DATE: 8/06/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-16094.6

SHEET 5 OF 5

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813