

CURRIES

DIVISION OF ASSA ABLOY DOOR GROUP, INC

CURRIES FLUSH PAIRS OF DOORS

LARGE MISSILE IMPACT (LMI) - LEVEL "D"

HVHZ


NON-SITE-SPECIFIC STRUCTURAL PERFORMANCE EVALUATION. A DESIGN PROFESSIONAL SHALL BE RESPONSIBLE FOR CERTIFYING THE APPLICATION OF THIS INFORMATION TO ANY SITE-SPECIFIC LOCATION.

MAXIMUM ALLOWABLE
DESIGN PRESSURES (ASD):

AS NOTED IN DESIGN
TABLE


GENERAL NOTES:

1. THE SYSTEM DESCRIBED HEREIN COMPLY AND HAVE BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 9TH EDITION (2026)
2. FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
3. DESIGN PRESSURES NOTED HEREIN ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY 1.5 SAFETY FACTOR
4. WIND LOAD DURATION FACTOR Cd = 1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
5. THE ARCHITECT/ENGINEER OF RECORD FOR THE PROJECT SUPERSTRUCTURE WITH WHICH THIS DESIGN IS USED SHALL BE RESPONSIBLE FOR THE INTEGRITY OF ALL SUPPORTING SURFACES TO THIS DESIGN WHICH SHALL BE COORDINATED BY THE PERMITTING CONTRACTOR. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO EXISTING STRUCTURE
6. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
7. THE CONTRACTOR IS RESPONSIBLE TO INSULATE ALL MEMBERS FROM DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS.
8. FOR PERMANENT OUTDOOR INSTALLATIONS, ALL EXPOSED ANCHORS, FASTENERS, CONNECTORS, AND METAL PLATES SHALL BE CORROSION RESISTANT. CORROSION RESISTANCE MAY BE PROVIDED BY INHERENT MATERIAL COMPOSITION OR, WHERE PERMITTED BY CODE, BY AN APPROVED PROTECTIVE COATING OR GALVANIZATION. WHERE APPLICABLE NEAR A SALTWATER COASTLINE, SUCH COMPONENTS SHALL COMPLY WITH FBC SECTION 1711, INCLUDING APPLICABLE REQUIREMENTS FOR EXPOSED, PROTECTED, OR ENCLOSED CONDITIONS. MATERIALS, COATINGS, AND FINISHES SHALL BE COMPATIBLE WITH CONNECTED MATERIALS, AND PROTECTIVE COATINGS SHALL BE CONTINUOUS OVER EXPOSED SURFACES. FASTENERS USED WITH ALUMINUM MEMBERS SHALL ALSO COMPLY WITH SECTION J.3.7.2 OF THE ALUMINUM DESIGN MANUAL, "SPECIFICATION FOR ALUMINUM STRUCTURES." SUBSTITUTION OF COMPONENTS FROM ALTERNATE MANUFACTURERS, OR WITH DIFFERENT MATERIALS, COATINGS, OR FINISHES, SHALL NOT BE ASSUMED EQUIVALENT AND MAY REQUIRE ADDITIONAL ENGINEERING REVIEW OR SITE-SPECIFIC ANALYSIS.
9. REFER TO FASTENER MANUFACTURER'S PUBLISHED DATA SHEETS AND RECOMMENDATIONS FOR FASTENER INSTALLATION INSTRUCTIONS.
10. ENGINEER SEAL AFFIXED HERETO VALIDATE STRUCTURAL DESIGN AS SHOWN ONLY. USE OF THIS SPECIFICATION BY CONTRACTOR, et. al. INDEMNIFIES & SAVES HARMLESS THIS ENGINEER FOR ALL COST & DAMAGES INCLUDING LEGAL FEES & APPELATE FEES RESULTING FROM MATERIAL FABRICATION, SYSTEM ERECTION, & CONSTRUCTION PRACTICES BEYOND THAT WHICH IS CALLED FOR BY LOCAL, STATE & FEDERAL CODES & FROM DEVIATIONS OF THIS PLAN.
11. PRESSURE VALUES IN THIS APPROVAL ARE (ASD) ALLOWABLE DESIGN PRESSURES U.N.O.
13. PRODUCTS SHALL BE LABELED IN ACCORDANCE WITH THE FLORIDA BUILDING COMMISSION AND THE FLORIDA DEPARTMENT OF BUSINESS & PROFESSIONAL REGULATION SPECIFICATION AS IS APPLICABLE. (SEE FBC SECTION 1709 FOR REQUIREMENTS).
14. ALTERATIONS ADDITIONS OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE THIS CERTIFICATION.
15. EXCEPT AS EXPRESSLY PROVIDED HEREIN, NO ADDITIONAL CERTIFICATIONS OR AFFIRMATIONS ARE INTENDED.

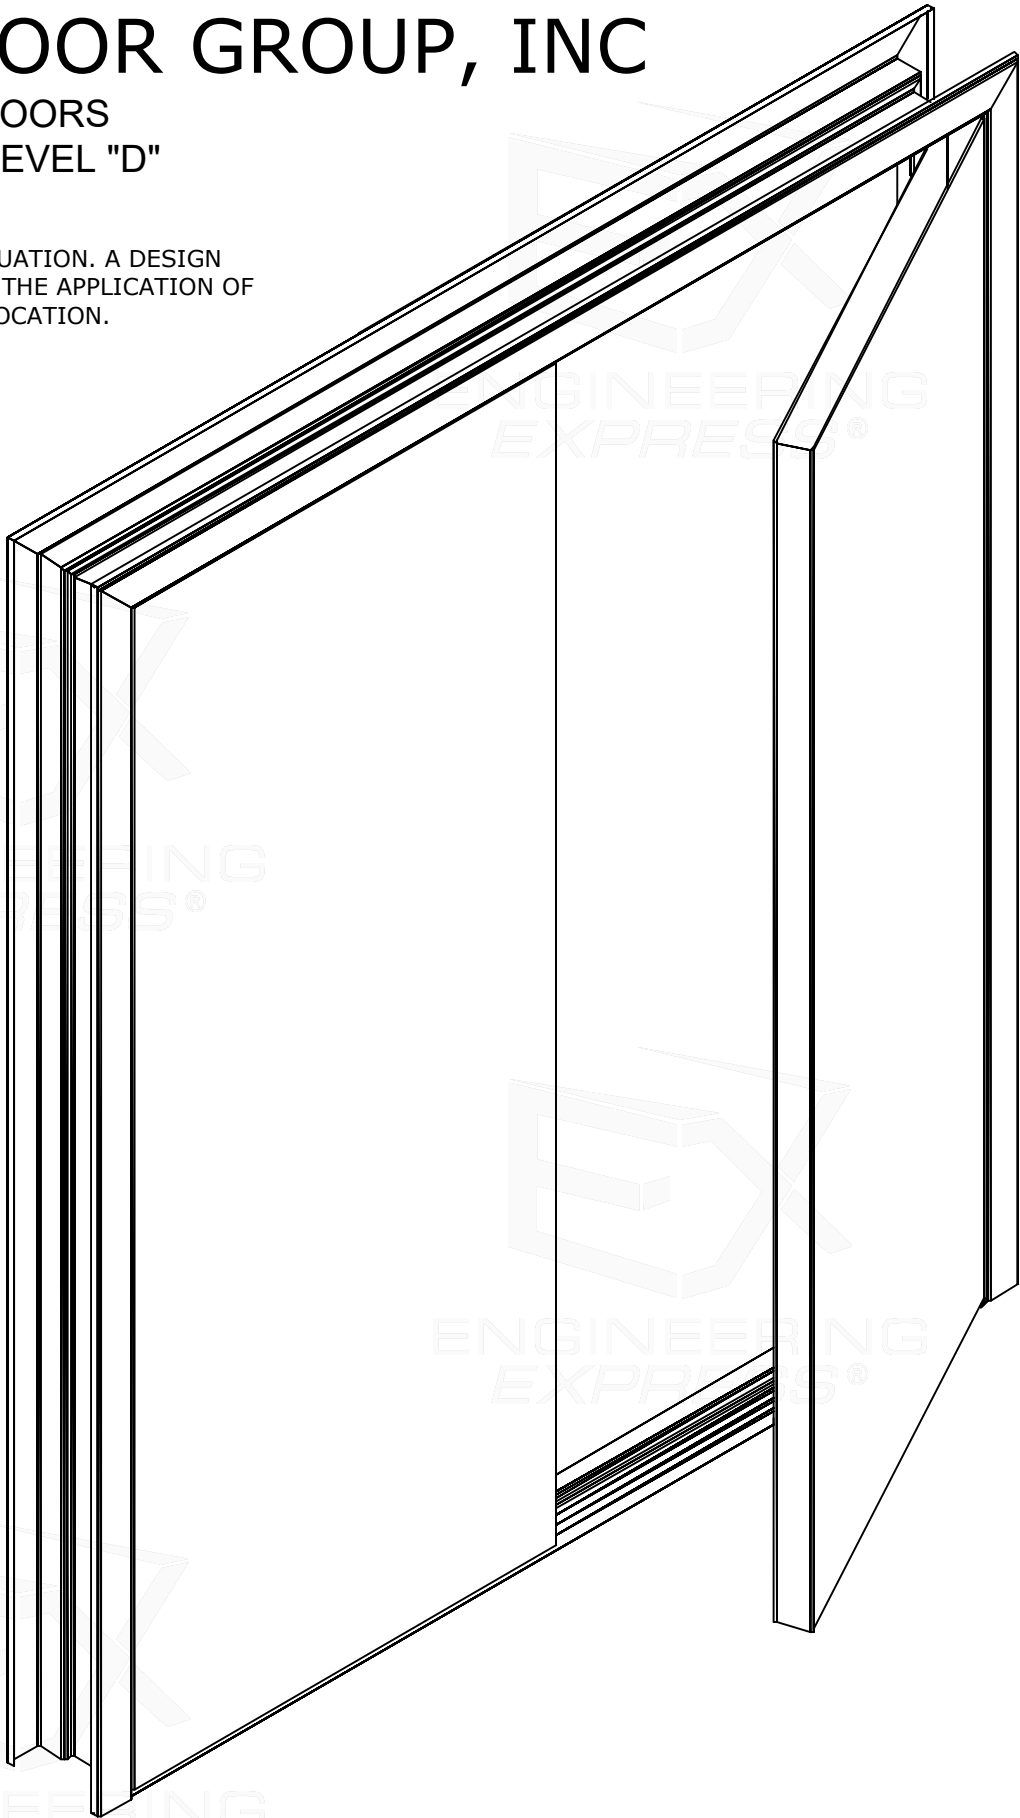

FRANK BENNARDO, PE
PE# 0046549 CA# 9885

AUGUST 19, 2026



Digitally signed by
Frank Bennardo
Date: 2026.08.20
15:23:10 -04'00'

NOTE REGARDING USE OF THIS DOCUMENT &
USE OUTSIDE FLORIDA:

THIS IS A NON-SITE-SPECIFIC STRUCTURAL PERFORMANCE EVALUATION. THIS PRODUCT EVALUATION IS VALID FOR USE IN **FLORIDA ONLY**. USE OF THIS EVALUATION REQUIRES A REVIEW & CERTIFICATION BY A LOCAL DESIGN PROFESSIONAL WHO SHALL BE RESPONSIBLE FOR THE PROPER ADAPTATION OF THIS GENERAL PERFORMANCE EVALUATION TO ANY SITE-SPECIFIC PROJECT. CONTACT THIS OFFICE AT **ENGINEERINGEXPRESS.COM/QUOTE** FOR ASSISTANCE WITH YOUR PROJECT-SPECIFIC NEEDS & FOR ADAPTATION & CERTIFICATION OF THIS DOCUMENT OUTSIDE OF FLORIDA.

ENGINEER SIGNATURE & SEAL NOTICE:

*PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED & SEALED. SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.
***FOR FLORIDA STATEWIDE PRODUCT APPROVALS (FSAs) REGISTERED & APPROVED WITH THE STATE OF FLORIDA:** ORIGINAL, SEALED COPIES OF APPROVED FLORIDA PRODUCT APPROVALS ARE NOT REQUIRED FOR PERMIT. SEE **ECALC.IO/SEAL** TO LEARN MORE.

INSTRUCTIONS FOR USING THIS APPROVAL

- STEP 1:** USE THE DOOR ELEVATIONS PROVIDED ON PAGES 2 THROUGH 5 TO DETERMINE THE APPLICABLE ASSEMBLY NUMBER
- STEP 2:** MOVE TO THE CHART BELOW THE DOOR ELEVATIONS, ALSO ON PAGES 2 THROUGH 5, AND LOCATE YOUR ASSEMBLY NUMBER. BY SCANNING HORIZONTALLY THROUGH THE SAME ROW OF YOUR ASSEMBLY NUMBER, YOU WILL BE ABLE TO DETERMINE THE APPROVED **DOOR SERIES, MIN DOOR THICKNESS, MAX DESIGN PRESSURE, MAX DOOR OPENINGS, SWINGING OPTIONS, LATCHING HARDWARE FOR BOTH ACTIVE AND IN ACTIVE PANELS.**
- STEP 3:** USE PAGE 6 TO DETERMINE YOUR FRAMING PROFILES AND FRAMING CONSTRUCTION OPTIONS
- STEP 4:** USE THE TABLES ON PAGE 7 AND 8 TO DETERMINE THE ANCHOR TYPE AND SPACING, BASED ON THE YOUR PRESSURE AND SUBSTRATE CRITERIA
- STEP 5:** USE THE DETAILS PROVIDED ON PAGE 9 AND 10 TO DETERMINE YOUR WEATHERSTRIPPING OPTIONS

SHEET INDEX

# SHEET	DESCRIPTION
1	COVER SHEET
2-5	ASSEMBLY OPTIONS
6	DOOR FRAME DETAILS
7-8	DOOR FRAME ANCHORING INFORMATION
9-10	DOOR FRAME WEATHER STRIPPING INFORMATION
11	MANUFACTURERS AND ENGINEERING NOTES
11	TOTAL

VISIT **ECALC.IO/ASSAABLOY**

FOR SITE-SPECIFIC DEVIATIONS
& MORE INFORMATION ABOUT THIS DOCUMENT
OR SCAN THIS QR CODE

VISIT **ENGINEERINGEXPRESS.COM/STORE**
FOR ADDITIONAL PLANS, REPORTS & RESOURCES



FL# 16353.1

**ENGINEERING
EXPRESS®**

POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

CURRIES
DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401

ASSA ABLOY

COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMI) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1)

REMARKS	DATE	DRWN	CHKD
INIT ISSUE (12-CUI-03G-01)	06/28/13	KL	FLB
FBC UPDATE	06/12/15	RWN	CSL
2017 FBC UPDATE	10/03/17	JEM	FLB
2020 FBC UPDATE	12/17/20	TAE	FLB
2023 FBC (REV 20-34815)	10/18/23	AMZ	RS
2026 FBC UPDATE	08/18/26	ABF	RS

COPYRIGHT ENGINEERING EXPRESS®

26-102749

SCALE: NTS UNLESS NOTED

01 OF 11


ASSA ABLOY, the global leader in door opening solutions.

CURRIES FLUSH PAIRS OF DOORS


PRODUCTS ILLUSTRATED IN THIS DOCUMENT ARE QUALIFIED FOR LARGE AND SMALL MISSILE IMPACT. LARGE MISSILE IMPACT IS 9 LB 2 X 4 AT 50 FEET PER SECOND OR 350 FT-LBS. PRODUCT MEETS REQUIREMENTS OF HIGH VELOCITY HURRICANE ZONE.

FRANK BENNARDO, PE
PE# 0046549 CA# 9885


AUGUST 19, 2026

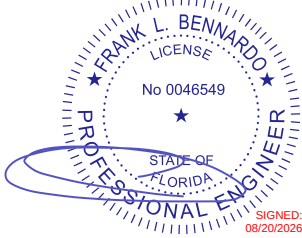


FL

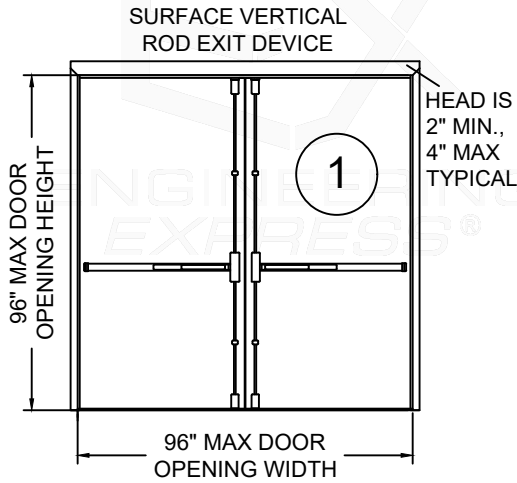


ASSEMBLY 1	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-150 PSF	+/-60 PSF

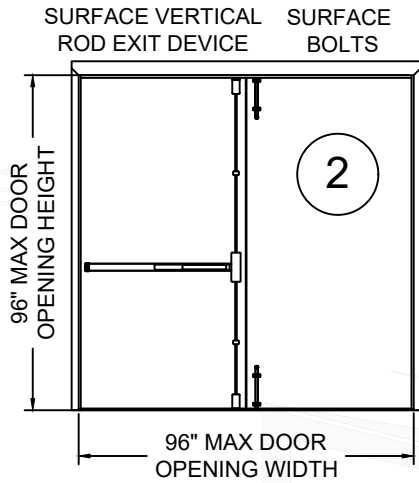


ASSEMBLY 2	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-150 PSF	+/-60 PSF

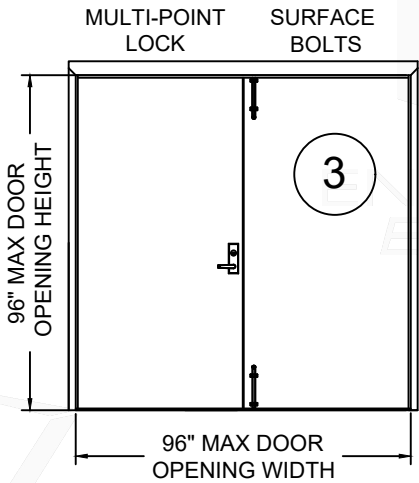

ASSEMBLY 3	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-150 PSF	+/-60 PSF

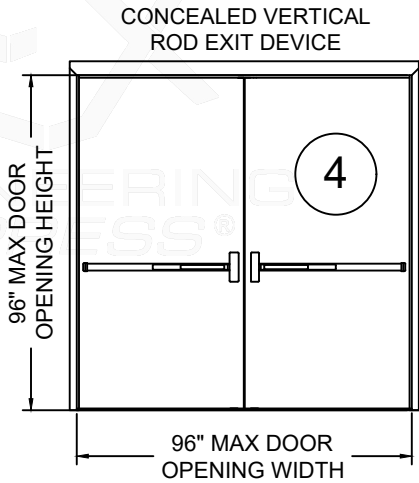

ASSEMBLY 4	
Design Pressure Where Water Infiltration Is NOT Needed	Design Pressure Where Water Infiltration IS Needed
+/-70 PSF	+/-60 PSF

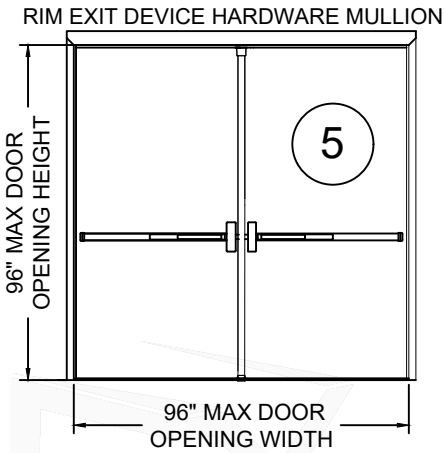

ASSEMBLY 5	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-70PSF	+/-60 PSF

Assembly	Door Series	Minimum Door Gauge	Maximum Design Pressure (psf)		Maximum Door Opening (inches)		Door Swing	Latching Hardware Description Active			Latching Hardware Description In-Active		
			Positive	Negative	Width	Height		Type	Brand	Model	Type	Brand	Model
①	707, 747	14	150	150	96	96	Out Swing	Surface Vertical Rod	Sargent	HC4-8700, 12-HC4-8700	Surface Vertical Rod	Sargent	HC4-8700, 12-HC4-8700
②	707, 747	14	150	150	96	96	Out Swing	Surface Vertical Rod	Sargent	HC4-8700, 12-HC4-8700	Surface Bolt	Sargent	988
③	707, 747	14	150	150	96	96	Out Swing or In Swing	Multi-Point Lock	Corbin Russwin	6600	Surface Bolt	Corbin Russwin	988CR
									Sargent	7300		Sargent	988
④	707, 747, 777	16 777 -18	70	70	96	96	Out Swing	Concealed Vertical Rod	Sargent	HC-MD-8600, HC-12-8600, HC-MD-12-8600, WS-MD-8600, WS-12-8600, WS-MD-12-8600	Concealed Vertical Rod	Sargent	HC-MD-8600, HC-MD-12-8600, WS-MD-8600, WS-MD-12-8600
⑤	707, 727, 747, 777, 777 847	16 777 -18	70	70	96	96	Out Swing	Rim Exit Device	Corbin Russwin	ED5200S(A) x M107	Rim Exit Device	Corbin Russwin	ED5200S(A) x M107
									Sargent	HC8800, 12-HC8800		Sargent	HC8800, 12-HC8800
									ASSA ABLOY ACCENTRA	7150(F)WS/7250M(F)WS		ASSA ABLOY ACCENTRA	7150(F)WS/7250M(F)WS
Hinges **	Butt	McKinney 4-1/2" x 4-1/2" 0.134" thick minimum steel hinges or any FBC approved butt hinges may be used. Any SDI member hinge locations may be used.											
	Continuous	Markar FM100, FM200, FM300, FM3500, FM100, FM1111, or HG305; Pemko CFMSLF-HD continuous hinges or any FBC approved continuous hinge may be used											
	Pivots	Rixson 195 Pivot set with M19 intermediate pivots may be used. Any FBC approved pivot may be used.											
Auxiliary Hardware		1" diameter and smaller preparations for door position switches, Door position switches that fit in a cutout measuring 1.25" x 4.875"; Securitron EPT, SEPT, and CEPT may be used. Maglocks may be used in addition to the hardware listed above. Viewers with 1" and smaller hole preparation may be used.											

*In-Swing Configurations not approved for water infiltration.
See Hardware notes for additional Hardware options.

** SUBSTITUTIONS, WITH FBC COMPONENT APPROVALS, MAY BE USED AS LONG AS THE SUBSTITUTIONS ARE WITHIN THE LIMITING DESIGN PARAMETERS OF THIS APPROVAL AND THE COMPONENT APPROVAL.

FL# 16353.1

ENGINEERING EXPRESS®
POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

CURRIES
DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401
ASSA ABLOY
COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMT) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE (12-CUI-03G-01)	KL	FLB	06/28/13
FBC UPDATE	RWN	CSL	06/12/15
2017 FBC UPDATE	JEM	FLB	10/03/17
2020 FBC UPDATE	TAE	FLB	12/17/20
2023 FBC (PREV 20-34815)	AMZ	RS	10/18/23
2026 FBC UPDATE	ABF	RS	08/18/26

COPYRIGHT ENGINEERING EXPRESS®

26-102749

SCALE: NTS UNLESS NOTED

02 OF 11

CURRIES FLUSH PAIRS OF DOORS

PRODUCTS ILLUSTRATED IN THIS DOCUMENT ARE QUALIFIED FOR LARGE AND SMALL MISSILE IMPACT. LARGE MISSILE IMPACT IS 9 LB 2 X 4 AT 50 FEET PER SECOND OR 350 FT-LBS. PRODUCT MEETS REQUIREMENTS OF HIGH VELOCITY HURRICANE ZONE.

FRANK BENNARDO, PE
PE# 0046549 CA# 9885

AUGUST 19, 2026

FRANK L. BENNARDO
LICENSE
No 0046549
STATE OF FLORIDA
PROFESSIONAL ENGINEER

SIGNED: 08/20/2026

FL

SURFACE VERTICAL
ROD EXIT DEVICE

ASSEMBLY 6

Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-70 PSF	+/-60 PSF

CONCEALED TWO
POINT LOCK

ASSEMBLY 7

Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Needed
+/-70 PSF	+/-60 PSF

CYLINDRICAL LOCK &
CYLINDRICAL
DEAD BOLT

FLUSH
BOLTS

ASSEMBLY 8

Design Pressure Where Water Infiltration Is NOT Needed	Design Pressure Where Water Infiltration IS Required
+/-70 PSF	+/-60 PSF

CYLINDRICAL LOCK &
CYLINDRICAL
DEAD BOLT

SURFACE
BOLTS

ASSEMBLY 9

Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-70 PSF	+/-60 PSF

MORTISE LOCK
LATCH BOLT
& DEAD BOLT

FLUSH
BOLTS

ASSEMBLY 10

Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-70 PSF	+/-60 PSF

Assembly	Door Series	Minimum Door Gauge	Maximum Design Pressure (psf)		Maximum Door Opening (inches)		Door Swing	Latching Hardware Description Active			Latching Hardware Description In-Active																							
			Positive	Negative	Width	Height		Type	Brand	Model	Type	Brand	Model																					
6	707, 727, 747, 777, 847	16 777 -18	70	70	96	96	Out Swing	Surface Vertical Rod	Corbin Russwin	ED5470(B) x M107	Surface Vertical Rod	Corbin Russwin	ED5470(B) x M107																					
									Sargent	HC4-8700, 12-HC4-8700		Sargent	HC4-8700, 12-HC4-8700																					
									ASSA ABLOY ACCENTRA	7170(F)WS		ASSA ABLOY ACCENTRA	7170(F)WS																					
7	707, 727, 747, 777, 847	16 777 -18	70	70	96	96	Out Swing	Concealed Two Point Lock	Sargent	WS-12-7000, HC-12-7000	Concealed Two Point Lock	Sargent	WS-12-7000, HC-12-7000																					
									Corbin Russwin	MP9800 (A/B) x M107		Corbin Russwin	MP9800 (A/B) x M107																					
8	777	18	70	70	96	96	In Swing or Out Swing	Cylindrical Lock & Cylindrical Dead Bolt	Corbin Russwin	CL3100 DL3200 Dead Bolt	Flush Bolt	Rockwood	556WS																					
									Sargent	11 Line 480 Dead Bolt																								
9	777	18	70	70	96	96	In Swing or Out Swing	Cylindrical Lock & Cylindrical Dead Bolt	Corbin Russwin	CL3100 DL3200 Dead Bolt	Surface Bolt	Corbin Russwin	988CR																					
									Sargent	11 Line 480 Dead Bolt		Sargent	988																					
10	777	18	70	70	96	96	In Swing or Out Swing	Mortise Lock Latch Bolt & Dead Bolt	Corbin Russwin	ML2000	Flush Bolt	Rockwood	556WS																					
									Sargent	7800, 8200, R8200																								
									ASSA ABLOY ACCENTRA	8800																								
Hinges	Butt	McKinney 4-1/2" x 4-1/2" 0.134" thick minimum steel hinges or any FBC approved butt hinges may be used. Any SDI member hinge locations may be used.																																
	Continuous	Markar FM100, FM200, FM300, FM3500, FM100, FM1111, or HG305; Pemko CFMSLF-HD continuous hinges or any FBC approved continuous hinge may be used																																
	Pivots	Rixson 195 Pivot set with M19 intermediate pivots may be used																																
Auxiliary Hardware	1" diameter and smaller preparations for door position switches, Door position switches that fit in a cutout measuring 1.25" x 4.875"; Securitron EPT, SEPT, and CEPT may be used.																																	
	Maglocks may be used in addition to the hardware listed above. Viewers with 1" and smaller hole preparation may be used.																																	

*In-Swing Configurations not approved for water infiltration. See Hardware notes for additional Hardware options.

** SUBSTITUTIONS, WITH FBC COMPONENT APPROVALS, MAY BE USED AS LONG AS THE SUBSTITUTIONS ARE WITHIN THE LIMITING DESIGN PARAMETERS OF THIS APPROVAL AND THE COMPONENT APPROVAL.

FL# 16353.1

ENGINEERING
EXPRESS

POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

CURRIES

DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401

CURRIES

ASSA ABLOY

COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMI) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL# 16353.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE (12-CUI03G-01)	KL	FLB	06/28/13
FBC UPDATE	RWN	CSL	06/12/15
2017 FBC UPDATE	JEM	FLB	10/03/17
2020 FBC UPDATE	TAE	FLB	12/17/20
2023 FBC (PREV 20-3481g)	AMZ	RS	10/18/23
2026 FBC UPDATE	ABF	RS	08/18/26

26-102749

SCALE: NTS UNLESS NOTED

03


OF 11

CURRIES FLUSH PAIRS OF DOORS


PRODUCTS ILLUSTRATED IN THIS DOCUMENT ARE QUALIFIED FOR LARGE AND SMALL MISSILE IMPACT. LARGE MISSILE IMPACT IS 9 LB 2 X 4 AT 50 FEET PER SECOND OR 350 FT-LBS. PRODUCT MEETS REQUIREMENTS OF HIGH VELOCITY HURRICANE ZONE.

FRANK BENNARDO, PE
PE# 0046549 CA# 9885


AUGUST 19, 2026

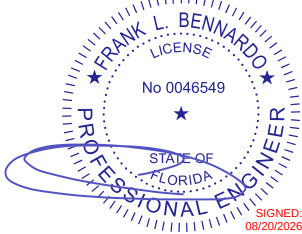


FL

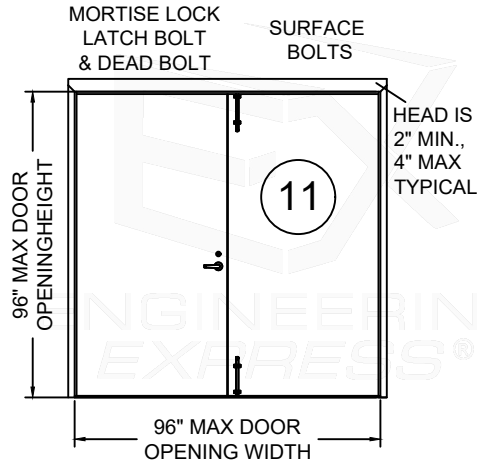


ASSEMBLY 11	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-70 PSF	+/-60 PSF

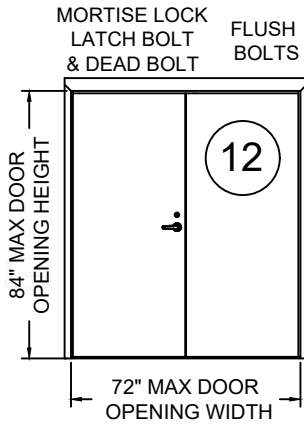


ASSEMBLY 12	
Design Pressure Where Water Infiltration Is NOT Needed	Design Pressure Where Water Infiltration IS Needed
+/-70 PSF	+/-60 PSF

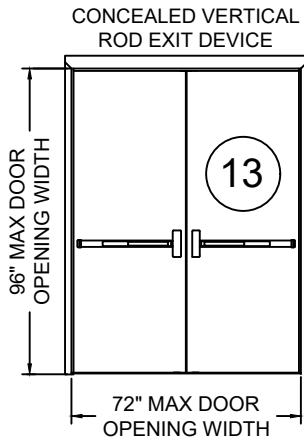

ASSEMBLY 13	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-70 PSF	+/-70 PSF

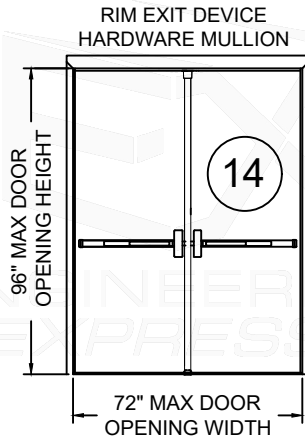

ASSEMBLY 14	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-60PSF	+/-60 PSF

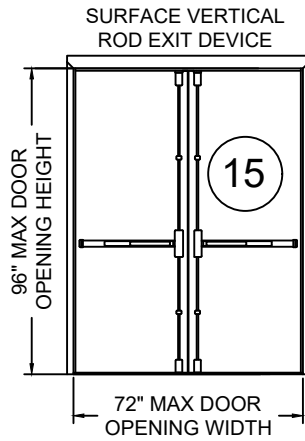

ASSEMBLY 15	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-60 PSF	+/-60 PSF

FL# 16353.1

ENGINEERING EXPRESS
POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

Assembly	Door Series	Minimum Door Gauge	Maximum Design Pressure (psf)		Maximum Door Opening (inches)		Door Swing	Latching Hardware Description Active			Latching Hardware Description In-Active		
			Positive	Negative	Width	Height		Type	Brand	Model	Type	Brand	Model
11	707, 727, 747, 777, 847	16 777 -18	70	70	96	96	In Swing or Out Swing	Mortise Lock Latch Bolt & Dead Bolt	Corbin Russwin	ML2000	Surface Bolt	Corbin Russwin	988CR
									Sargent	7800, 8200, R8200		Sargent	988
									ASSA ABLOY ACCENTRA	8800		ASSA ABLOY ACCENTRA	988Y
12	707, 727, 747, 777, 847	16 777 -18	70	70	72	84	In Swing or Out Swing	Mortise Lock Latch Bolt & Dead Bolt	Corbin Russwin	ML2000	Flush Bolt	Rockwood	556WS
									Sargent	7800, 8200, R8200			
									ASSA ABLOY ACCENTRA	8800			
13	707, 727, 747, 847	16	60	60	72	96	Out Swing	Concealed Vertical Rod	Sargent	HC-MD-8600, HC-12-8600, HC-MD-12-8600, WS-MD-8600, WS-12-8600, WS-MD-12-8600	Concealed Vertical Rod	Sargent	HC-MD-8600, HC-12-8600, HC-MD-12-8600, WS-MD-8600, WS-12-8600, WS-MD-12-8600
14	707, 727, 747, 847	16	60	60	72	96	Out Swing	Rim Exit Device	Corbin Russwin	ED5200S(A) x M107	Rim Exit Device	Corbin Russwin	ED5200S(A) x M107
									Sargent	HC8800, 12-HC8800		Sargent	HC8800, 12-HC8800
									ASSA ABLOY ACCENTRA	7150(F)WS/7250M(F)WS		ASSA ABLOY ACCENTRA	7150(F)WS/7250M(F)WS
15	707, 727, 747, 847	16	60	60	72	96	Out Swing	Surface Vertical Rod	Corbin Russwin	ED5470 x M107	Surface Vertical Rod	Corbin Russwin	ED5470 x M107
									Sargent	HC8700, 12-HC8700		Sargent	HC8700, 12-HC8700
									ASSA ABLOY ACCENTRA	7170(F)WS		ASSA ABLOY ACCENTRA	7170(F)WS
Hinges	Butt	McKinney 4-1/2" x 4-1/2" 0.134" thick minimum steel hinges or any FBC approved butt hinges may be used. Any SDI member hinge locations may be used.											
	Continuous	Markar FM100, FM200, FM300, FM3500, FM100, FM1111, or HG305; Pemko CFMSLF-HD continuous hinges or any FBC approved continuous hinge may be used											
	Pivots	Rixson 195 Pivot set with M19 intermediate pivots may be used											
Auxiliary Hardware		1" diameter and smaller preparations for door position switches, Door position switches that fit in a cutout measuring 1.25" x 4.875"; Securitron EPT, SEPT, and CEPT may be used.											
		Maglocks may be used in addition to the hardware listed above. Viewers with 1" and smaller hole preparation may be used.											

*In-Swing Configurations not approved for water infiltration. See Hardware notes for additional Hardware options.

** SUBSTITUTIONS, WITH FBC COMPONENT APPROVALS, MAY BE USED AS LONG AS THE SUBSTITUTIONS ARE WITHIN THE LIMITING DESIGN PARAMETERS OF THIS APPROVAL AND THE COMPONENT APPROVAL.

CURRIES
DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401
ASSA ABLOY
COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMT) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE (12-CUI-03G-01)	KL	FLB	06/28/13
FBC UPDATE	RWN	CSL	06/12/15
2017 FBC UPDATE	JEM	FLB	10/03/17
2020 FBC UPDATE	TAE	FLB	12/17/20
2023 FBC (PREV 20-34815)	AMZ	RS	10/18/23
2026 FBC UPDATE	ABF	RS	08/19/26

COPYRIGHT ENGINEERING EXPRESS®

26-102749

SCALE: NTS UNLESS NOTED


04 OF 11

CURRIES FLUSH PAIRS OF DOORS


PRODUCTS ILLUSTRATED IN THIS DOCUMENT ARE QUALIFIED FOR LARGE AND SMALL MISSILE IMPACT. LARGE MISSILE IMPACT IS 9 LB 2 X 4 AT 50 FEET PER SECOND OR 350 FT-LBS. PRODUCT MEETS REQUIREMENTS OF HIGH VELOCITY HURRICANE ZONE.

FRANK BENNARDO, PE
PE# 0046549 CA# 9885

AUGUST 19, 2026

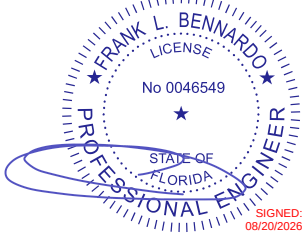

FL

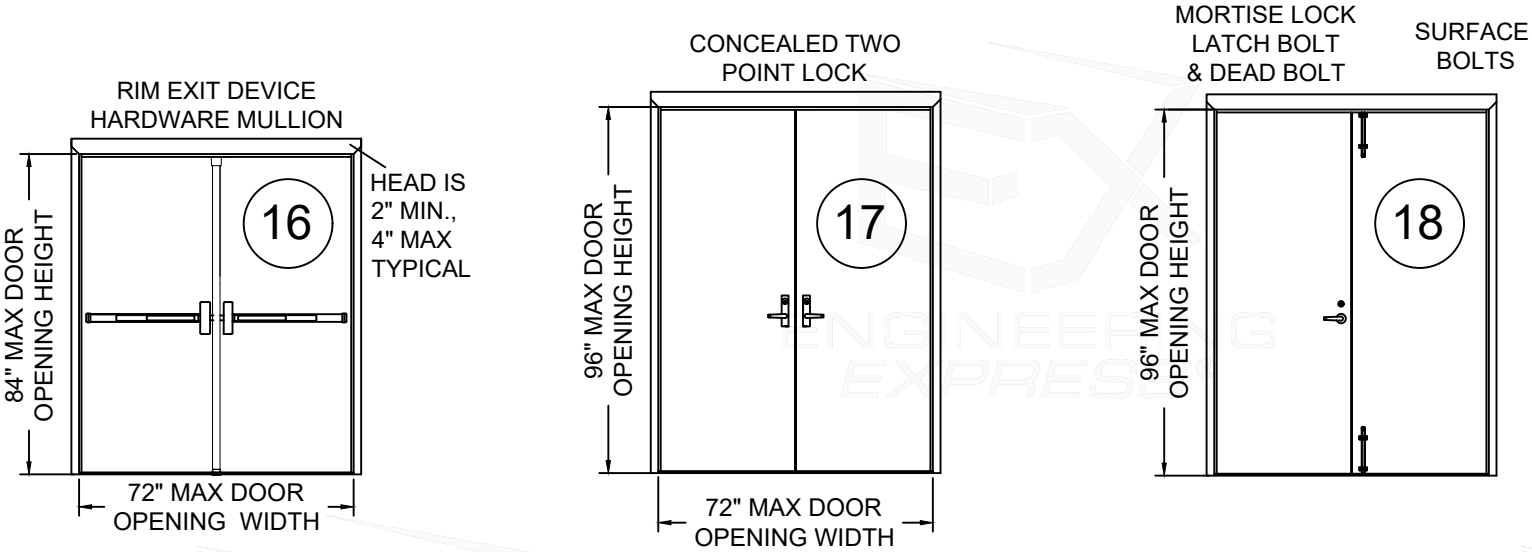

ASSEMBLY 16	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-60PSF	+/-60 PSF

ASSEMBLY 17	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-60 PSF	+/-60 PSF

ASSEMBLY 18	
Design Pressure Where Water Infiltration Is NOT Required	Design Pressure Where Water Infiltration IS Required
+/-60 PSF	+/-60 PSF

Assembly	Door Series	Minimum Door Gauge	Maximum Design Pressure (psf)		Maximum Door Opening (inches)		Door Swing	Latching Hardware Description Active			Latching Hardware Description In-Active		
			Positive	Negative	Width	Height		Type	Brand	Model	Type	Brand	Model
16	607, 707, 727, 747, 847	18	60	60	72	84	Out Swing	Rim Exit Device	Corbin Russwin	ED5200S(A) x M107	Rim Exit Device	Corbin Russwin	ED5200S(A) x M107
									Sargent	12-HC8800, HC8800		Sargent	12-HC8800, HC8800
									ASSA ABLOY ACCENTRA	7150(F)WS/7250M(F)WS		ASSA ABLOY ACCENTRA	7150(F)WS/7250M(F)WS
17	707, 727, 747, 847	16	60	60	72	96	Out Swing	Concealed Two Point Lock	Sargent	WS-12-7000, HC-12-7000	Concealed Two Point Lock	Sargent	WS-12-7000, HC-12-7000
									Corbin Russwin	MP9800 (A/B) x M107		Corbin Russwin	MP9800 (A/B) x M107
18	707, 727, 747, 847	16	60	60	72	96	In Swing or Out Swing	Mortise Lock Latch Bolt & Dead Bolt	Corbin Russwin	ML2000	Surface Bolt	Corbin Russwin	988CR
									Sargent	7800, 8200, R8200		Sargent	988
									ASSA ABLOY ACCENTRA	8800		ASSA ABLOY ACCENTRA	988Y
Hinges	Butt	McKinney 4-1/2" x 4-1/2" 0.134" thick minimum steel hinges or any FBC approved butt hinges may be used. Any SDI member hinge locations may be used.											
	Continuous	Markar FM100, FM200, FM300, FM3500, FM100, FM1111, or HG305; Pemko CFMSLF-HD continuous hinges or any FBC approved continuous hinge may be used											
	Pivots	Rixson 195 Pivot set with M19 intermediate pivots may be used											
Auxiliary Hardware		1" diameter and smaller preparations for door position switches, Door position switches that fit in a cutout measuring 1.25" x 4.875"; Securitron EPT, SEPT, and CEPT may be used.											
		Maglocks may be used in addition to the hardware listed above. Viewers with 1" and smaller hole preparation may be used.											

*In-Swing Configurations not approved for water infiltration. See Hardware notes for additional Hardware options.

** SUBSTITUTIONS, WITH FBC COMPONENT APPROVALS, MAY BE USED AS LONG AS THE SUBSTITUTIONS ARE WITHIN THE LIMITING DESIGN PARAMETERS OF THIS APPROVAL AND THE COMPONENT APPROVAL.

FL# 16353.1

ENGINEERING EXPRESS®
POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

CURRIES
DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401
ASSA ABLOY
COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMT) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1)

REMARKS	DATE	DRWN	CHKD
INIT ISSUE (12-CUI-03G-01)	06/28/13	KL	FLB
FBC UPDATE	06/12/15	RWN	CSL
2017 FBC UPDATE	10/03/17	JEM	FLB
2020 FBC UPDATE	12/17/20	TAE	FLB
2023 FBC (REV/20-34815)	10/18/23	AMZ	RS
2026 FBC UPDATE	08/18/26	ABF	RS

COPYRIGHT ENGINEERING EXPRESS®

26-102749

SCALE: NTS UNLESS NOTED


05 OF 11

CURRIES DOOR FRAME INFORMATION


PRODUCTS ILLUSTRATED IN THIS DOCUMENT ARE QUALIFIED FOR LARGE AND SMALL MISSILE IMPACT. LARGE MISSILE IMPACT IS 9 LB 2 X 4 AT 50 FEET PER SECOND OR 350 FT-LBS. PRODUCT MEETS REQUIREMENTS OF HIGH VELOCITY HURRICANE ZONE.

FRANK BENNARDO, PE
PE# 0046549 CA# 9885


AUGUST 19, 2026

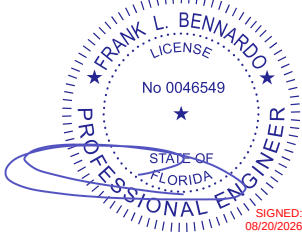


FL

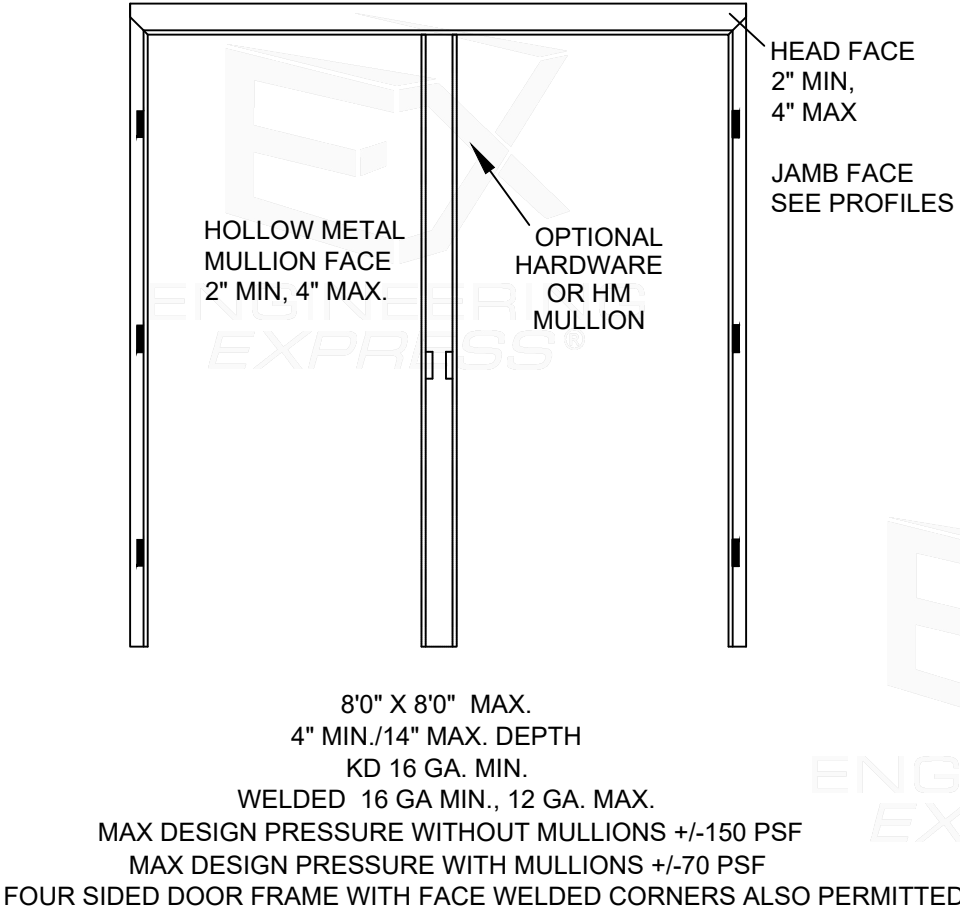

FRAME PROFILES

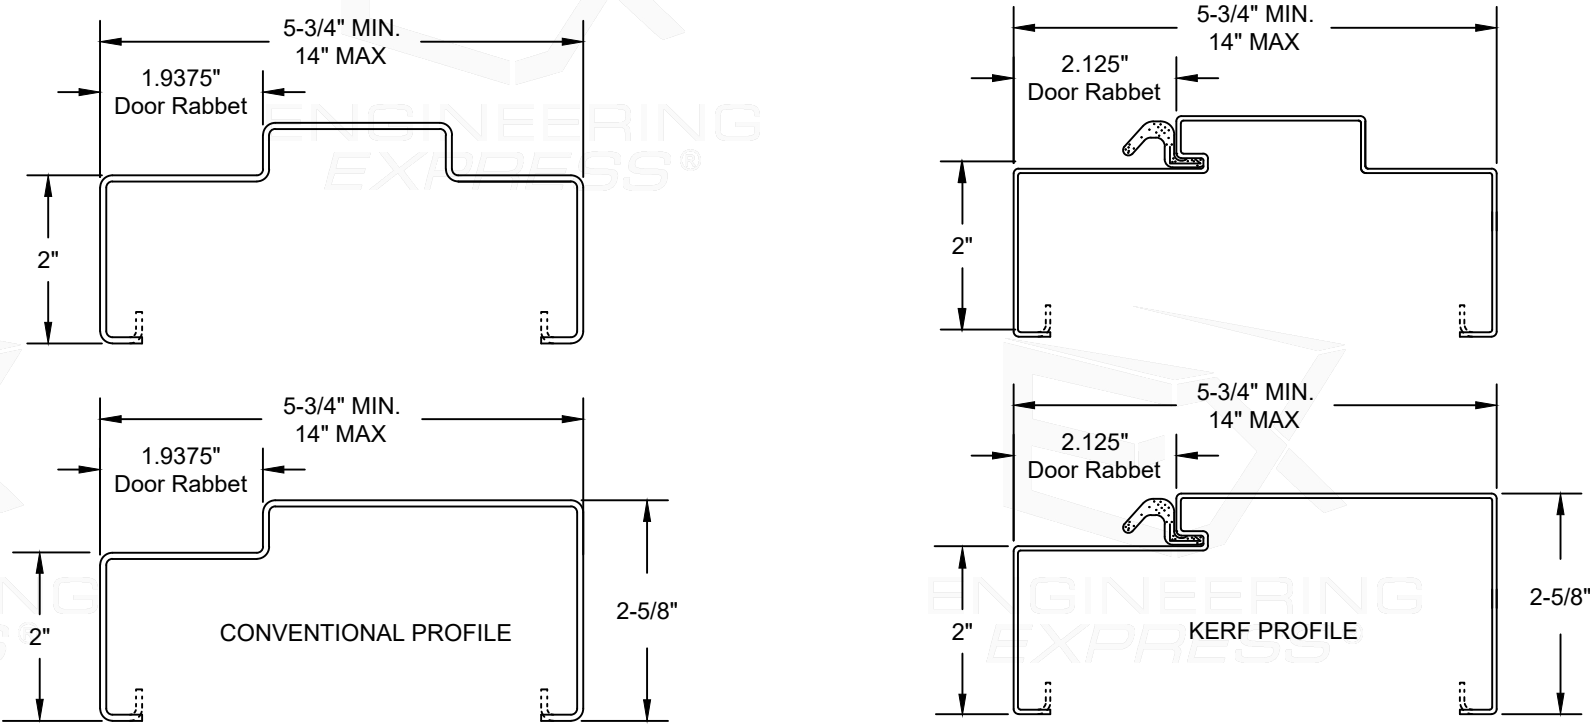

FRAME CONSTRUCTION OPTIONS

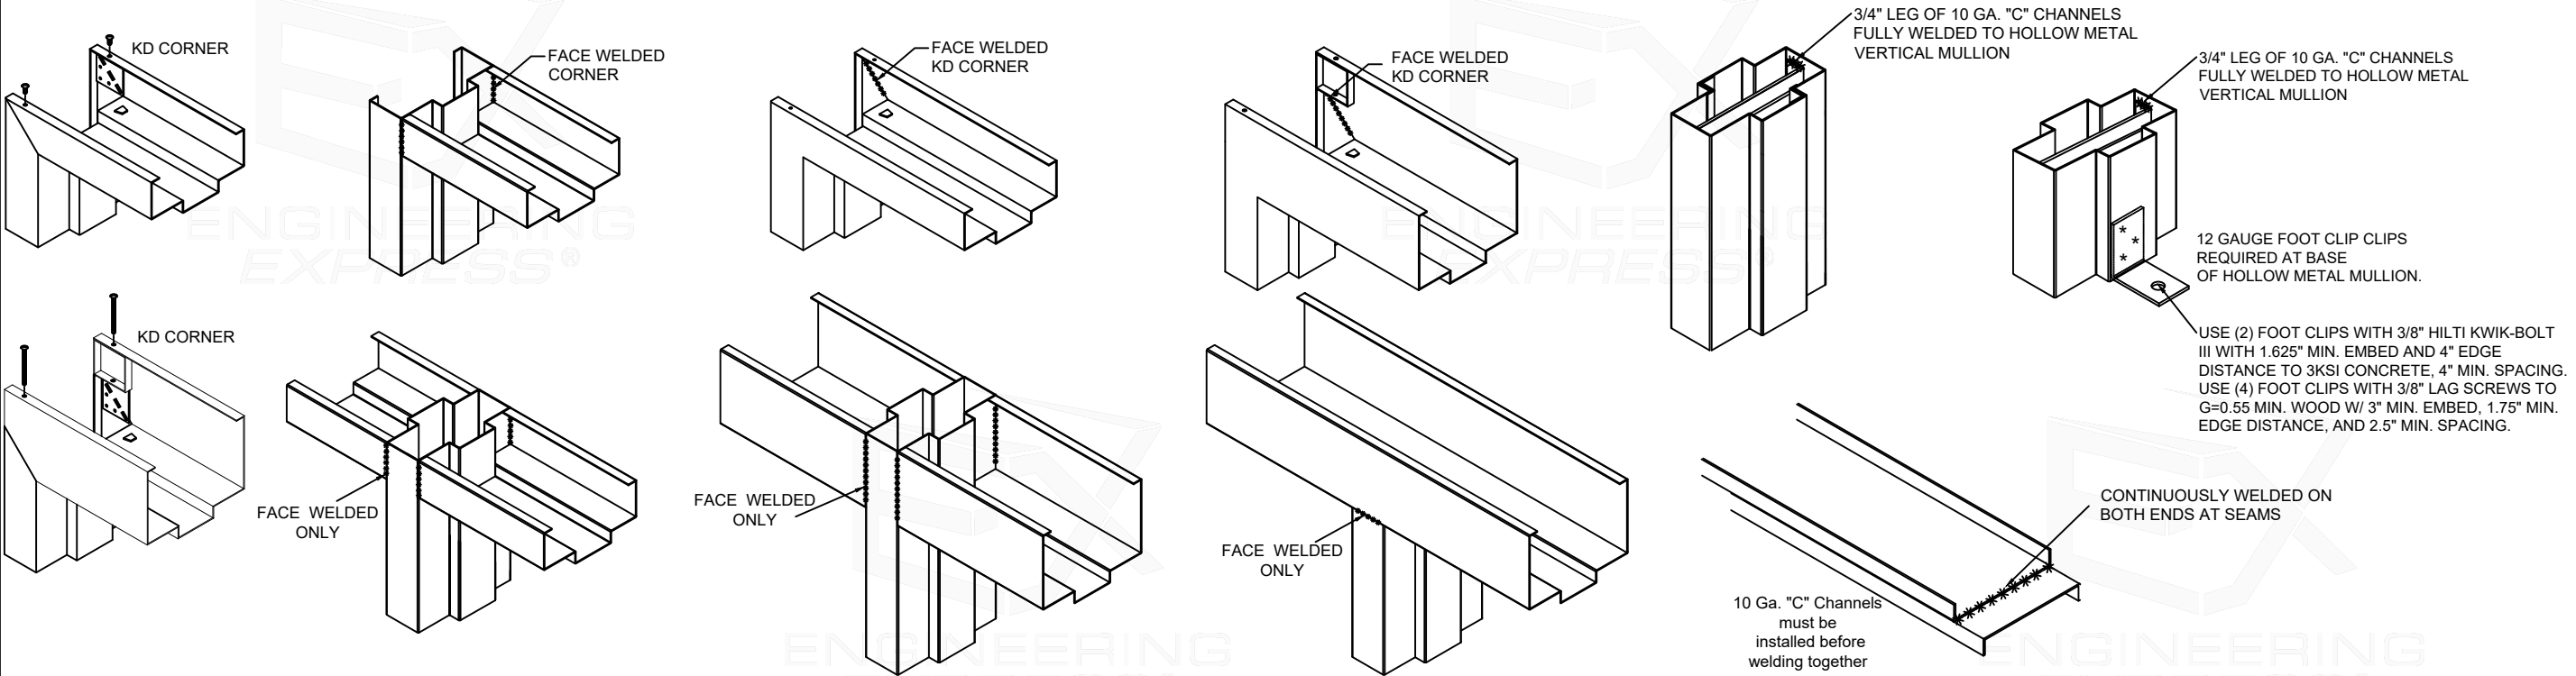

FL# 16353.1

ENGINEERING EXPRESS
POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

CURRIES
DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401
ASSA ABLOY
COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMT) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE (12-CUI-03G-01)	KL	FLB	06/28/13
FBC UPDATE	RWN	CSL	06/12/15
2017 FBC UPDATE	JEM	FLB	10/03/17
2020 FBC UPDATE	TAE	FLB	12/17/20
2023 FBC (REV 20-34815)	AMZ	RS	10/18/23
2026 FBC UPDATE	ABF	RS	08/18/26

COPYRIGHT ENGINEERING EXPRESS®

26-102749

SCALE: NTS UNLESS NOTED

06 OF 11

PRODUCTS ILLUSTRATED IN THIS DOCUMENT ARE QUALIFIED FOR LARGE AND SMALL MISSILE IMPACT. LARGE MISSILE IMPACT IS 9 LB 2 X 4 AT 50 FEET PER SECOND OR 350 FT-LBS. PRODUCT MEETS REQUIREMENTS OF THE HIGH VELOCITY HURRICANE ZONE.

EXISTING MASONRY OR POURED CONCRETE, 3000 psi MIN.
WELDED PIPE SPACER OR EWA ANCHOR WITH 3/8"
EXPANSION ANCHOR BOLTS USING 3/8" GRADE 5 BOLT
MINIMUM EDGE DISTANCE = 4.0" FOR CONCRETE
MINIMUM EDGE DISTANCE = 3 3/4" FOR C.M.U
MAXIMUM SHIM THICKNESS = 0.25"

HILTI KWIK BOLT 3 OR
POWERS LOK-BOLT

1.625" MIN.-

16 GA (0.053" MIN)
PIPE SPACER ANCHOR

TO SUIT
JAMB DEPTH

16 GA (0.053" MIN)
EWA ANCHOR

TO SUIT
JAMB DEPTH

STEEL SHIMS WELDED
TO BUILDING STRUCTURE

WELD HOLLOW METAL FRAME
TO SHIM WITH 3/16" WELD, —
1" LONG BOTH SIDES OF FRAME

2" X 7" STEEL SHIM
PLATE(S), OR TO SUIT
FRAME JAMB DEPTH

MAXIMUM SHIM SPACE 1/4"

1/4" MAX. THICK A-36 STEEL SHIMS
WELDED TO STRUCTURAL BUILDING
MEMBER WITH FILLET WELDS
MEASURING 2" LONG AND SIZED AS
FOLLOWS USING E6018 ELECTRODES.
FILLET WELD SIZE SAME AS SHIM
THICKNESS FOR 0.053" TO 0.125" SHIM
THICKNESS. WELD SIZE 1/8" FOR >
0.125" TO 1/4" SHIM THICKNESS.

MAXIMUM SHIM THICKNESS 0.25
CMU BLOCK AND THROAT OF FRAME
FILLED WITH 3000 PSI MORTAR

MASONRY WIRE ANCHOR
0.165" DIA. MIN.7

16 GA (0.053" MIN)
MASONRY T ANCHOR

OPERATING
RANGE 3" - 8 3/4"

Available on
special order
only

YOKE AND STRAP MASONRY ANCHOR

CAST IN PLACE FRAME

Expansion Shell Anchors Into 3000 psi Concrete Requirements for Jambs						
	Up to an including 70 psf			150 psf		
Opening Height (inches)	Max. Distance From End of Jamb	Min. Anchor Quantity	Maximum Spacing (inches)	Max. Distance From End of Jamb	Min. Anchor Quantity	Maximum Spacing (inches)
Up to 84"	12	5	19	12	5	19
90	12	5	19	12	5	19
96	12	6	19	12	6	19
Expansion Shell Anchor Requirements for Heads of Paired Frames						
70 psf	2 anchors in the head		150 psf	4 anchors in the head		

Masonry Strap, Masonry T, Masonry Wire, and Welded to the Building Structure Anchor Requirements for Jambs of Paired Frames						
	Up to an including 70 psf			150 psf		
Opening Height (inches)	Max. Distance From End of Jamb	Min. Anchor Quantity	Maximum Spacing (inches)	Max. Distance From End of Jamb	Min. Anchor Quantity	Maximum Spacing (inches)
Up to 88"	12	4	24	12	4	24
90"	12	5	24	12	5	24
92"-96"	12	5	24	12	5	24
Expansion Shell Anchor Requirements for Heads of Paired Frames						
70 psf	2 anchors in the head		150 psf	4 anchors in the head		
Welded to the Building Structure Anchor Requirements for Heads of Paired Frames						
70 psf	2 anchors in the head		150 psf	2 anchors in the head		

FRANK BENNARDO, PE
PE# 0046549 CA# 9885

AUGUST 19, 2026

FRANK L. BENNARDO
LICENSE
No 0046549
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
SIGNED
08/20/2026

FL

FL# 16353.1



POSTAL ADDRESS:
22234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

CURRIES

CURRIES
DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW

CURRIES

ASSA ABLOY

COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LM1) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1.)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE (12-CU-03G-01)	KL	FLB	06/28/13
FBC UPDATE	RWN	CSL	06/12/15
2017 FBC UPDATE	JEM	FLB	10/03/17
2020 FBC UPDATE	TAE	FLB	12/17/20
2023 FBC (PREV 20-34815)	ANZ	RS	10/18/23
2026 FBC UPDATE	ABF	RS	08/18/26

26-102749

SCALE: NTS UNLESS NOTED


07 OF 11

CURRIES FRAME ANCHOR INFORMATION

PRODUCTS ILLUSTRATED IN THIS DOCUMENT ARE QUALIFIED FOR LARGE AND SMALL MISSILE IMPACT. LARGE MISSILE IMPACT IS 9 LB 2 X 4 AT 50 FEET PER SECOND OR 350 FT-LBS. PRODUCT MEETS REQUIREMENTS OF THE HIGH VELOCITY HURRICANE ZONE.

FRANK BENNARDO, PE
PE# 0046549 CA# 9885

AUGUST 19, 2026

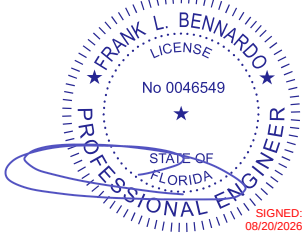

FL

FL# 16353.1

ENGINEERING EXPRESS®
POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

CURRIES
DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401
ASSA ABLOY
COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMT) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE (12-CUI-03G-01)	KL	FLB	06/28/13
FBC UPDATE	RWN	CSL	06/12/15
2017 FBC UPDATE	JEM	FLB	10/03/17
2020 FBC UPDATE	TAE	FLB	12/17/20
2023 FBC (REV 20-34815)	AMZ	RS	10/18/23
2026 FBC UPDATE	ABF	RS	08/18/26


COPYRIGHT ENGINEERING EXPRESS®

26-102749



SCALE: NTS UNLESS NOTED

08 OF 11

18 ga. (0.041" MIN.)
SLIP-IN STUD ANCHORS


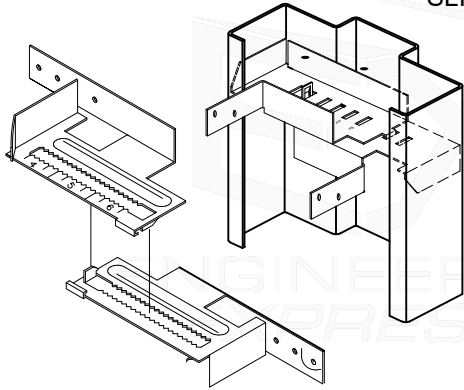


SLIP-IN STUD ANCHOR WELDEED TO
FRAME CONNECT TO STEEL
WITH #8 X 1" GRADE 5 SHEET METAL SCREW;
4 SCREWS REQUIRED PER ANCHOR;
MIN EDGE DISTANCE - 0.328"

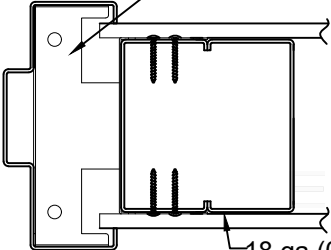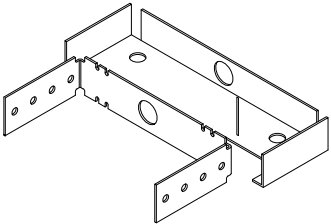



18 ga (0.041" min.)
STEEL STUDS

#14 x 1" GRADE 5 SHEET METAL SCREW;
2 SCREWS REQUIRED
PER ANCHOR LOCATION;

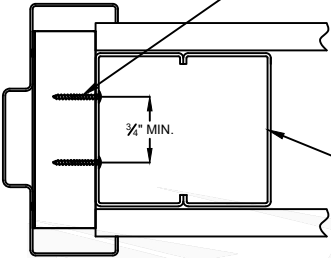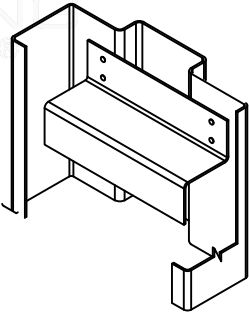


18 ga (0.041" min.)
STEEL STUDS

WELDED WOOD STUD ANCHOR
WITH #8 X 1" GRADE 5 SHEET METAL SCREW;
4 SCREWS REQUIRED PER ANCHOR;
MIN EMBEDMENT = 1" MIN EDGE DISTANCE = 0.524"

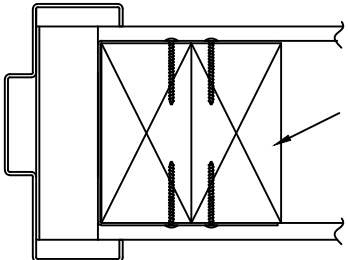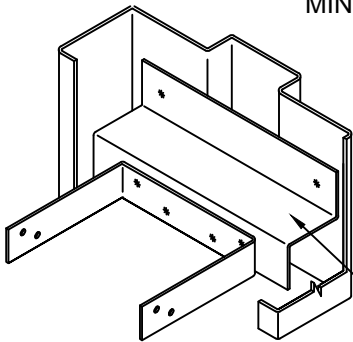


16 ga (0.053" MIN.)
WOOD STUD ANCHOR

WOOD STUD

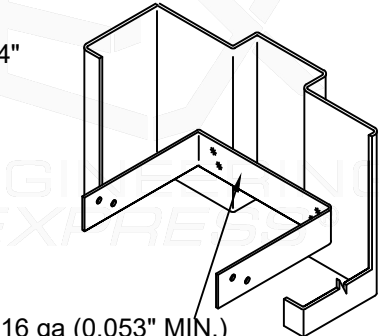


16 ga (0.053" MIN.)
WOOD STUD ANCHOR

WELED WOOD STUD ANCHOR
WITH #8 X 1" GRADE 5 SHEET METAL SCREW;
4 SCREWS REQUIRED PER ANCHOR;
MIN EMBEDMENT = 1" MIN EDGE DISTANCE = 0.524

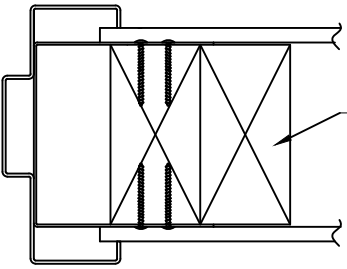


WOOD STUD


16 GA (0.053" MIN)
PIPE SPACER ANCHOR



16 GA (0.053" MIN)
EWA ANCHOR




WELDED PIPE SPACER OR EWA ANCHOR
WITH 3/8" WOOD SCREW OR LAG BOLT
MINIMUM EDGE DISTANCE = 1.75"
MAXIMUM SHIM THICKNESS = 0.25"

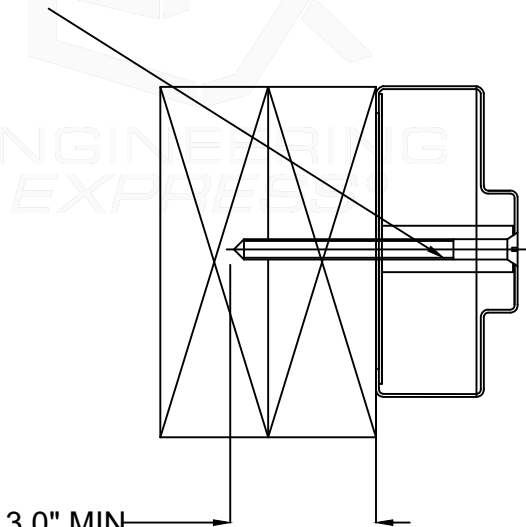

3.0" MIN

WELDED PIPE SPACER OR EWA ANCHOR
WITH 3/8" (GRADE 2 MIN.) TAP-IN BOLT
WITH 3 PINCHES PASSED THE THREAD
PLANE. MINIMUM EDGE DISTANCE = 1.75"
MAXIMUM SHIM THICKNESS = 0.25"

1/4" THK. MIN. A36 MIN.
STEEL SUBSTRATE

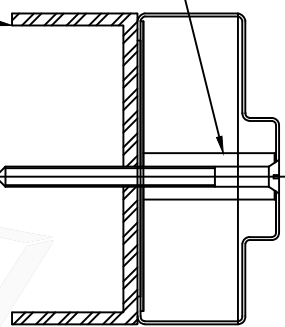


Stud Anchor Requirements for Paired Frame Jambs						
Opening Height (inches)	Up to an including 70 psf			150 psf		
	Max. Distance From End of Jamb	Min. Anchor Quantity	Maximum Spacing (inches)	Max. Distance From End of Jamb	Min. Anchor Quantity	Maximum Spacing (inches)
Up to 88"	12	4	22	12	6	12
90"	12	5	22	12	7	12
92"-96"	12	5	22	12	7	12
Stud Anchor Requirements for Heads of Paired Frames						
70 psf	4 anchors in the head		150 psf	8 anchors in the head		

CURRIES WEATHERSTRIP INFORMATION

PRODUCTS ILLUSTRATED IN THIS DOCUMENT ARE QUALIFIED FOR LARGE AND SMALL MISSILE IMPACT. LARGE MISSILE IMPACT IS 9 LB 2 X 4 AT 50 FEET PER SECOND OR 350 FT-LB. PRODUCT MEETS REQUIREMENTS OF THE HIGH VELOCITY HURRICANE ZONE.

PEMKO WEATHERSTRIP USED ON CURRIES DOORS AND FRAMES WHERE WATER INFILTRATION IS NOT REQUIRED.

FRANK BENNARDO, PE
PE# 0046549 CA# 9885




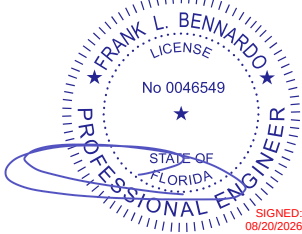


FL


FL# 16353.1

ENGINEERING
EXPRESS®


POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

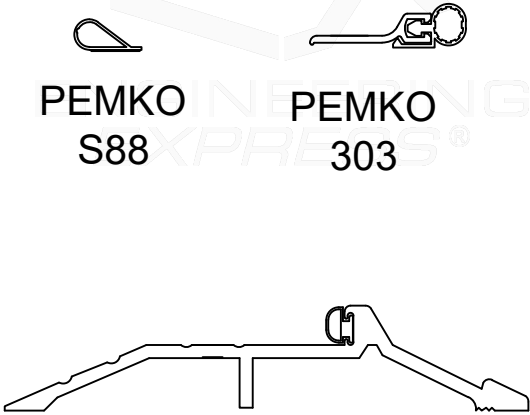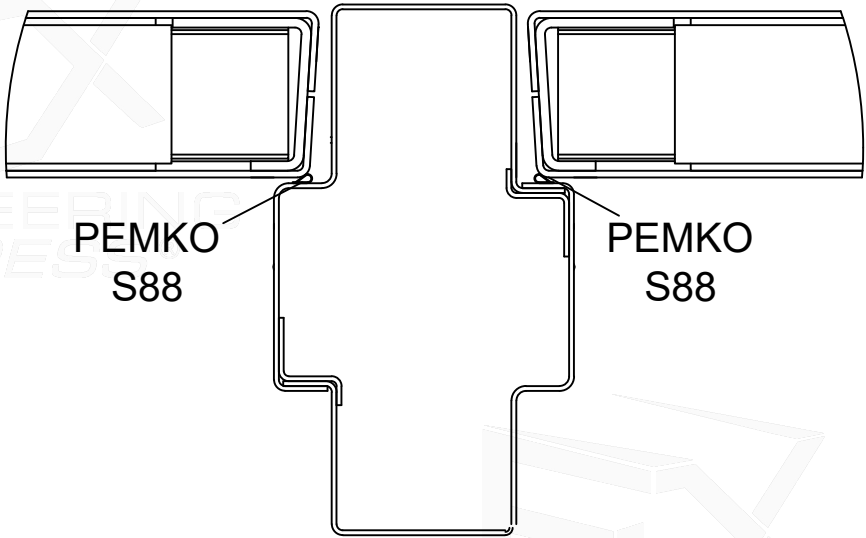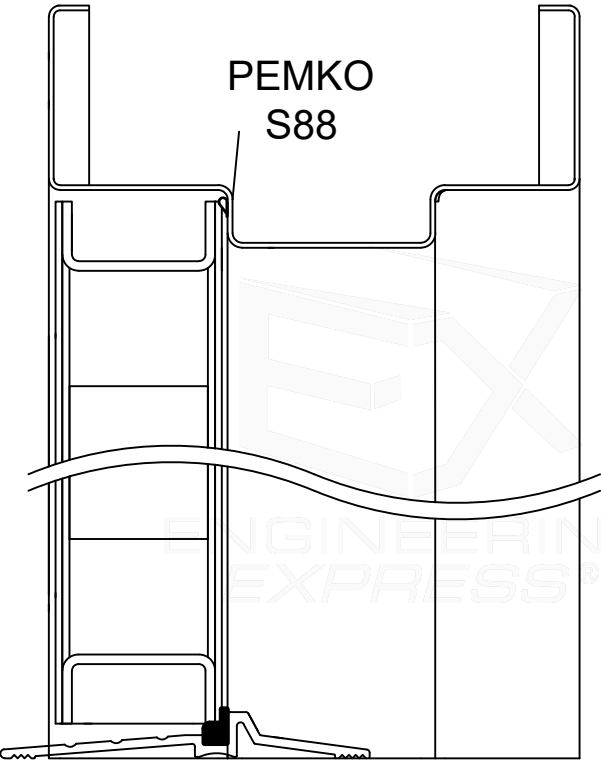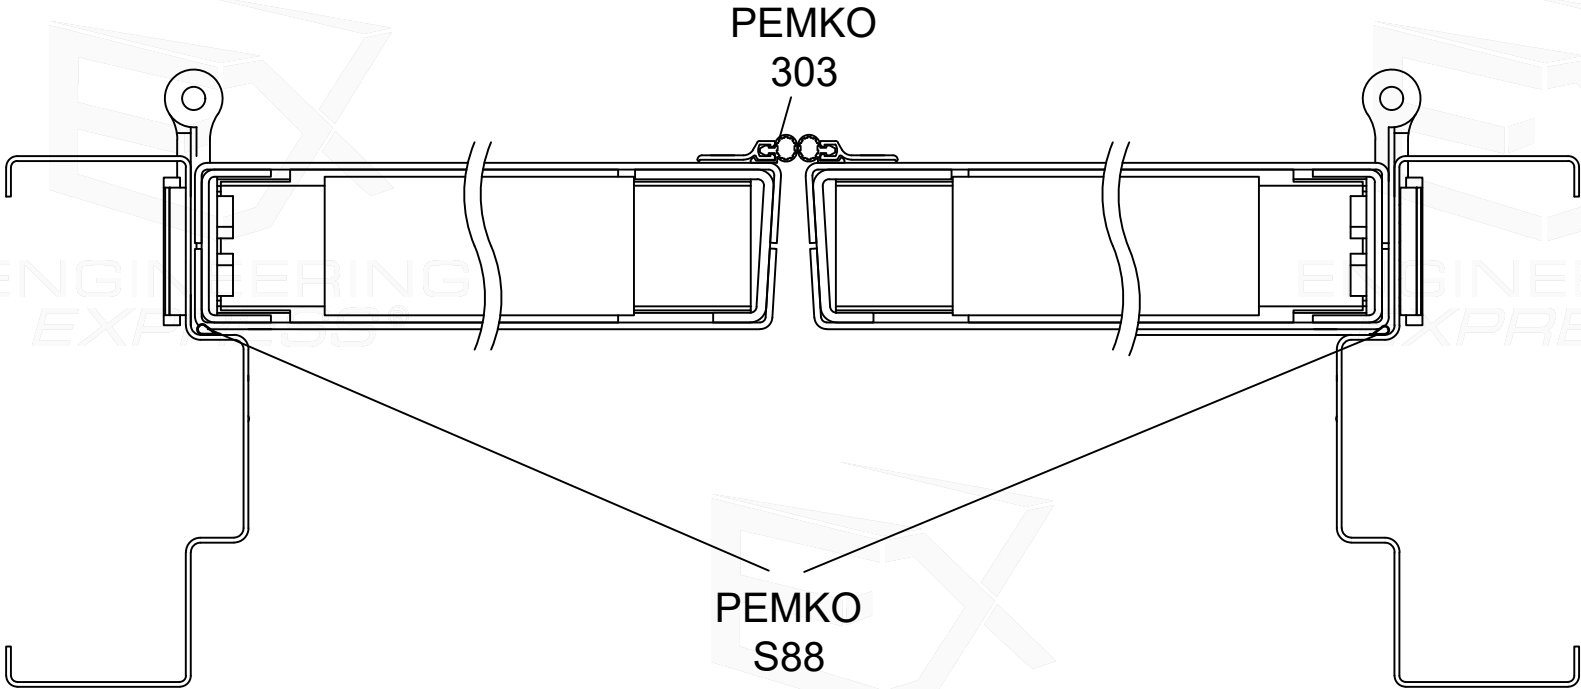


PEMKO
2005



PEMKO
2005



PEMKO 181



PEMKO 177

CURRIES®
DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401

ENGINEERING
EXPRESS®

POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMI) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE (12-CUI-03G-01)	KL	FLB	06/28/13
FBC UPDATE	RWN	CSL	06/12/15
2017 FBC UPDATE	JEM	FLB	10/03/17
2020 FBC UPDATE	TAE	FLB	12/17/20
2023 FBC (REV 20-34815)	AMZ	RS	10/18/23
2026 FBC UPDATE	ABF	RS	08/18/26

COPYRIGHT ENGINEERING EXPRESS®

26-102749

SCALE: NTS UNLESS NOTED

09 OF 11

CURRIES WEATHERSTRIP INFORMATION

PRODUCTS ILLUSTRATED IN THIS DOCUMENT ARE QUALIFIED FOR LARGE AND SMALL MISSILE IMPACT. LARGE MISSILE IMPACT IS 9 LB 2 X 4 AT 50 FEET PER SECOND OR 350 FT-LB. PRODUCT MEETS REQUIREMENTS OF THE HIGH VELOCITY HURRICANE ZONE.

PEMKO WEATHERSTRIP USED ON CURRIES DOORS AND FRAMES WHERE WATER INFILTRATION IS REQUIRED.


FRANK BENNARDO, PE
PE# 0046549 CA# 9885

FL

FL# 16353.1

ENGINEERING
EXPRESS®

POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

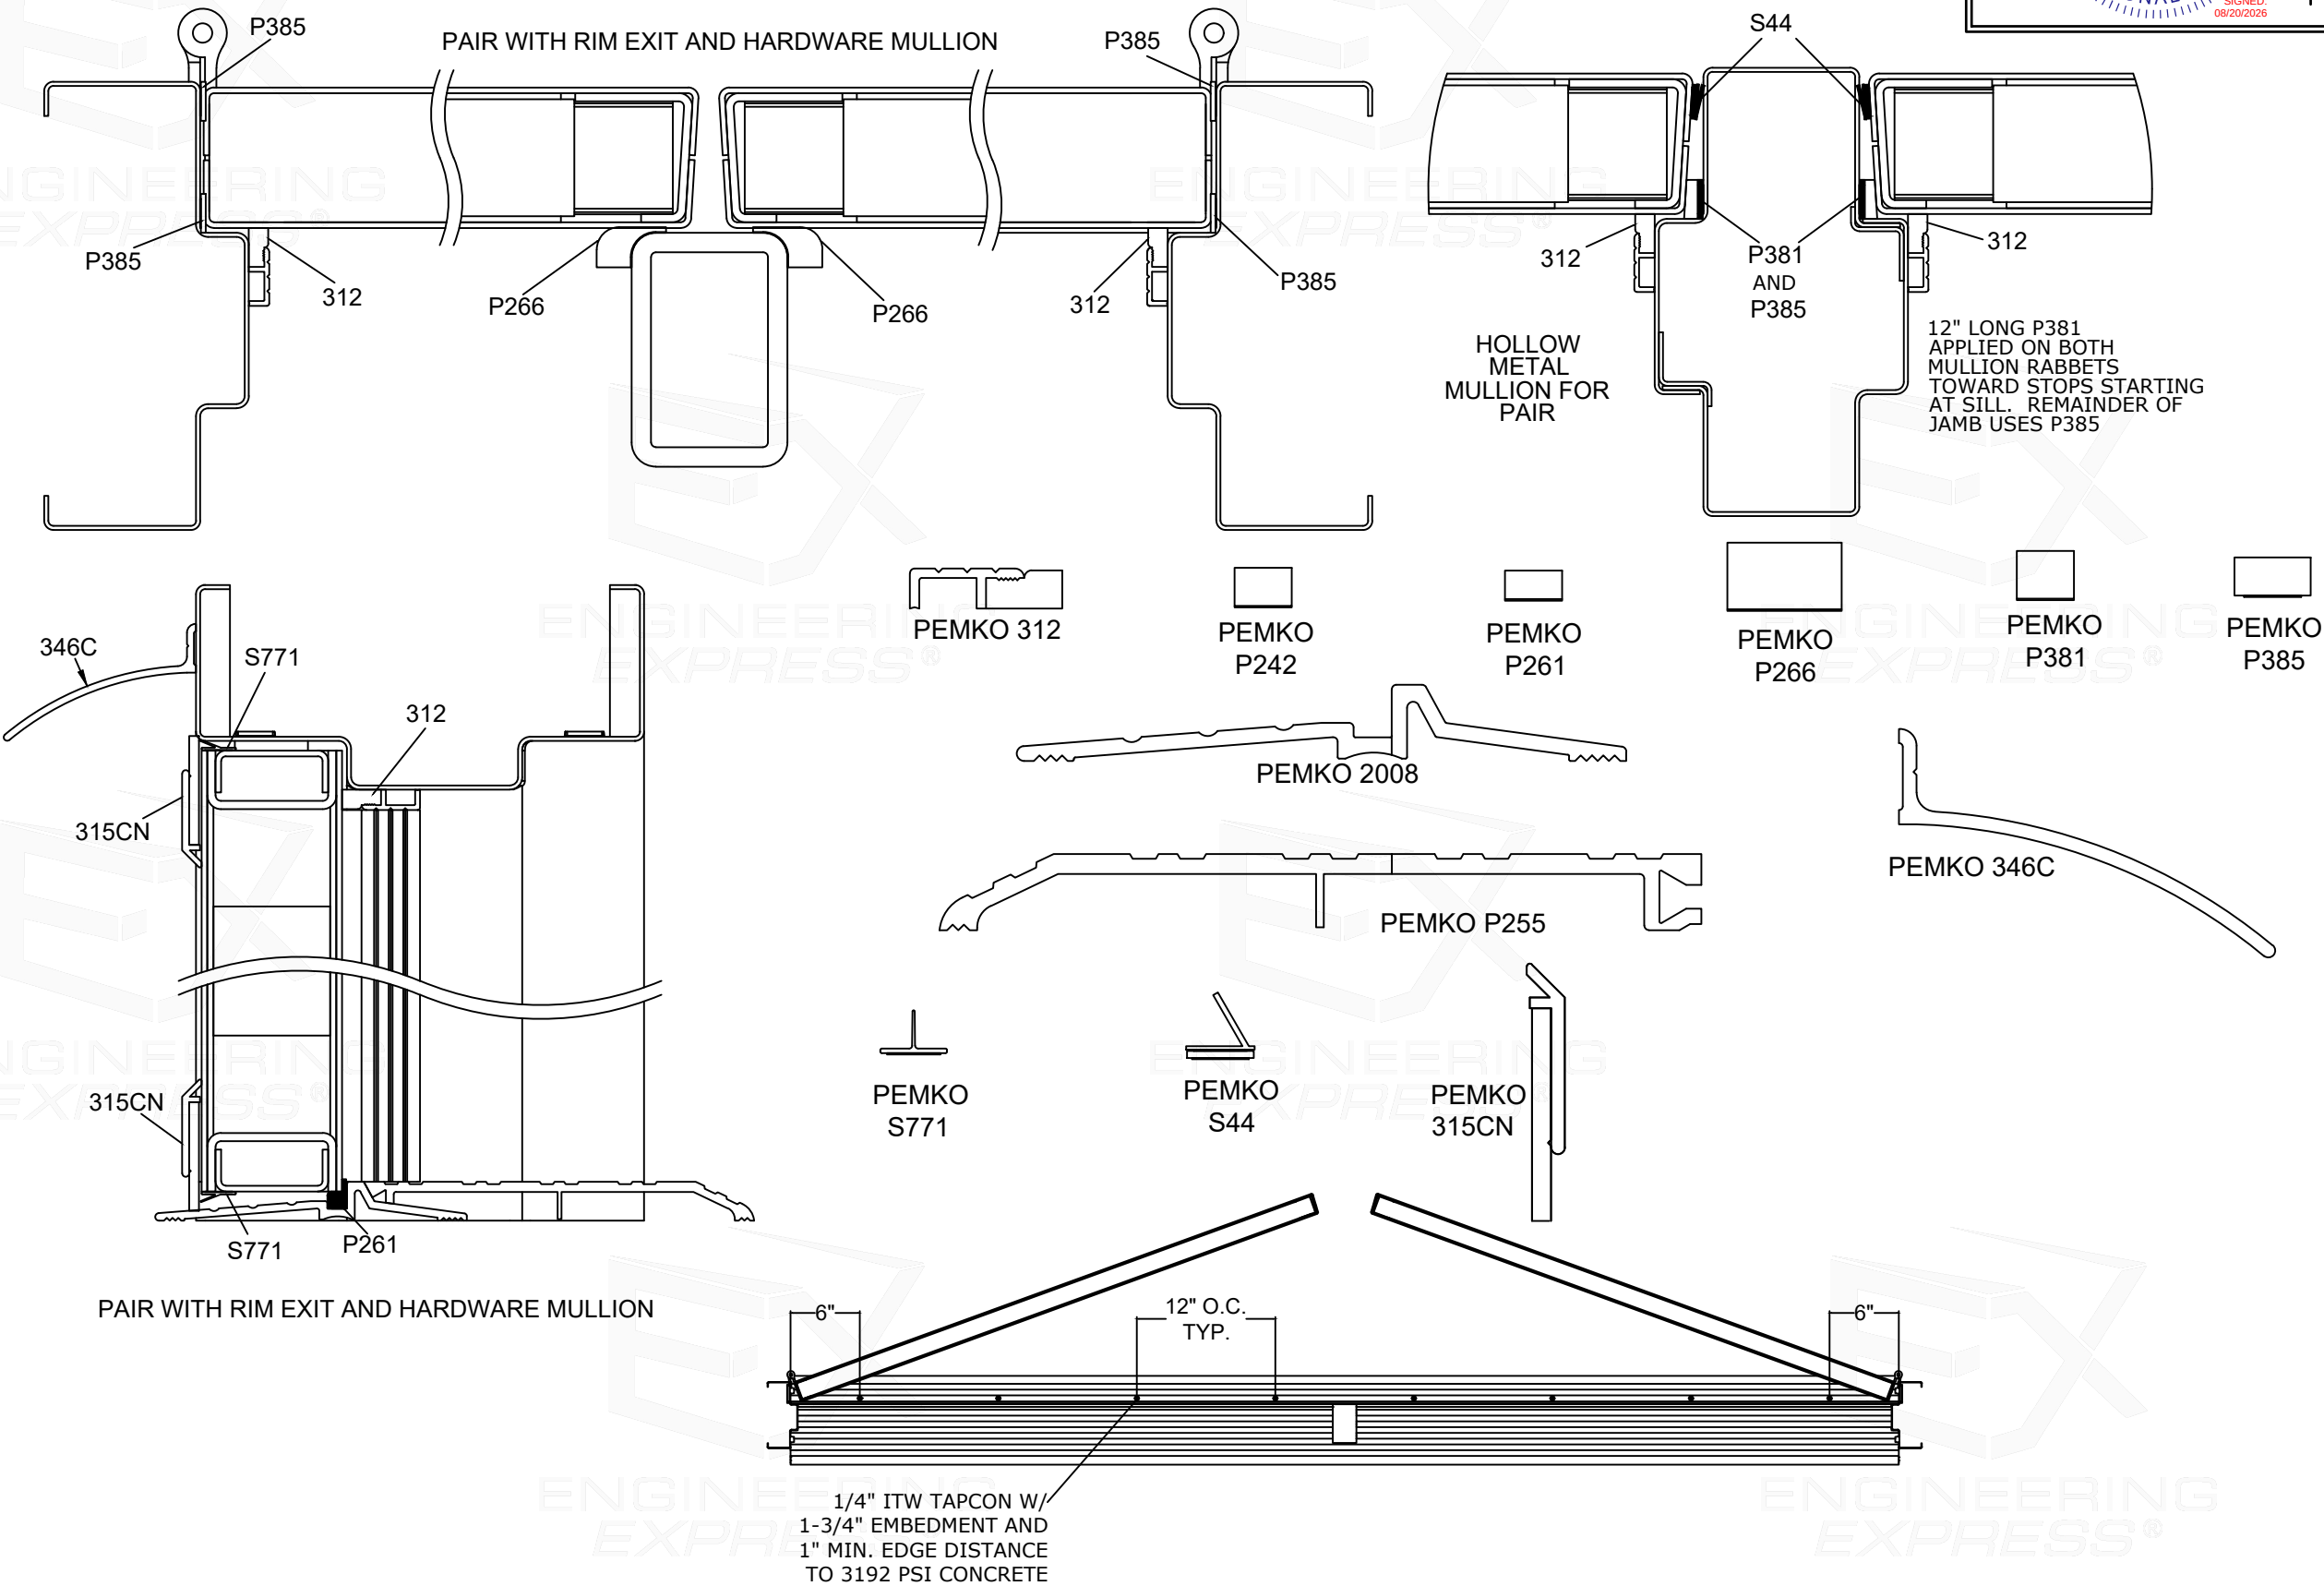

CURRIES

DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401

ASSA ABLOY

COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMT) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE (12-CU-03G-01)	KL	FLB	06/28/13
FBC UPDATE	RWN	CSL	06/12/15
2017 FBC UPDATE	JEM	FLB	10/03/17
2020 FBC UPDATE	TAE	FLB	12/17/20
2023 FBC (REV 20-34815)	AMZ	RS	10/18/23
2026 FBC UPDATE	ABF	RS	08/18/26

26-102749

SCALE: NTS UNLESS NOTED

10 OF 11

HARDWARE NOTES

CORBIN RUSSWIN

THE ED5200(S)A RIM EXIT AND THE ED5470(B) X M107 SURFACE VERTICAL ROD MAYBE SUFFIXED BY MER. MAY USE M94 WITH ANY COMBINATION OF THE M61, M92, M93, OR M1 SUFFIXES.

THE ED5200(S)A X M107 RIM EXIT AND THE ED5470(B) X M107 SURFACE VERTICAL ROD MAY INCLUDE 900 SERIES TRIMS 9600, 9700, 9800 SERIES ACCESS CONTROL TRIMS OR THE 9900 SERIES ELECTRIFIED TRIMS.

THE MP9800 (A/B) X M107 SERIES CONCEALED MULTI-POINT LOCK MAY INCLUDE THE OPTIONS: M91, M92, M93, 903, 904, IN, INB, SE.

USE CRFE772A, CRFE708A OR CRWS700AKM HARDWARE MULLION WITH THE ED5200(S)A / ED4200(S)A X M107 RIM EXIT

ON PAIRS OF DOORS, ONE LEAF OF THE PAIR UTILIZING WITH THE ED5470(B) X M107 SURFACE VERTICAL ROD OR MP9800 (A/B) X M107 SERIES CONCEALED MULTI-POINT LOCK MAY BE REPLACED WITH TWO 988CR SURFACE BOLTS. THE LOCAL BUILDING OFFICIAL MUST APPROVE THIS CONFIGURATION OF HARDWARE FOR USE IN A MEANS OF EGRESS.

THE ML2000 SERIES MORTISE LOCKS, SERIES CLX3300 SERIES CYLINDRICAL LOCKS, ED5200(S)A X M107 RIM EXIT, AND ED5470(B) X M107 SURFACE VERTICAL ROD MAY BE PREFIXED IN-IP, IN-IPS, IN-CP, IN-IP-MB, IN-IP-MW, IN-IPS-MB, IN-IPS-MW, IN-CP-MP, AND IN-CP-MW.

THE ML2000 SERIES MORTISE LOCKS, SERIES CLX3300 SERIES CYLINDRICAL LOCKS, ED5200(S)A X M107 RIM EXIT MAY BE PREFIXED PIP1-IPSKM, PWI1-IPSKM, PIP1-CPKM, PWI1-CPKM, PIP1-IPSM, PWI1-IPSM, PIP1-CPM, AND PWI1-CPM.

THE IN 120 ACCESS CONTROL MAY BE USED WITH CL3300 CYLINDRICAL LOCK OR ML2000 MORTISE LOCK.

HES

THE 1006 SERIES ELECTRIC STRIKE MAYBE USED ON 4'0" X 8'0" AND SMALLER SINGLE OR 8'0" X 8'0" AND SMALLER PAIRS OUT SWINGING DOORS OF 70 PSF OR LESS.

THE 9600 SERIES ELECTRIC STRIKE MAY BE USED WITH THE SARGENT HC8800 SERIES RIM EXIT AT DESIGN PRESSURES OF 70 PSF OR LESS.

THE 9700 SERIES ELECTRIC STRIKE MAY BE USED WITH THE CORBIN RUSSWIN ED5200(S)A AND THE YALE 7150(F)WS / 7250M(F)WS RIM EXITS AT DESIGN PRESSURES OF 70 PSF OR LESS.

SECURITRON 1500 / 1500E STRIKE MAY BE USED ON 3'0" X 7'0" AND SMALLER SINGLE OUT SWINGING ASSEMBLIES WITH MORTISE LOCKS AND LATCH BOLT ONLY AT DESIGN PRESSURES OF 60 PSF OR LESS.

SECURITRON 1600 / 1600E STRIKE MAY BE USED ON 4'0" X 8'0" AND SMALLER SINGLE OUT SWINGING ASSEMBLIES WITH MORTISE LOCKS WITH LATCH BOLT AND DEAD BOLT OF 70 PSF AND LESS.

SARGENT

THE HC8800 SERIES RIM EXIT, WS 8800 SERIES RIM EXIT, AND WS-8900 SERIES MORTISE EXIT MAYBE PREFIXED 53, 55, 55-56, 56, 57, 58, AWE, B, BT, ET, KP, LK, LU, M1, N1, N2, PA, PK, P1, P2, IPSKM, CPKM, IPSM, CPM, IM, IKM, PRX, S1, S2, S3, IA, IK, IN, TK, TL, TP AND TU.

USE HC980, 12-HC980, HCL980, 12-HCL980 HARDWARE MULLION WITH THE HC8800 SERIES RIM EXIT.

SERIES HT-56- CAN BE USED SAME AS THE 53-56- ON THE 80 SERIES DEVICES. EXCEPTIONS INCLUDE THE FOLLOWING PREFIXES EITHER USED ALONE OR IN COMBINATION: 53-, 55-, 57-, 58-, 59- AND AL. ALL 80 SERIES EMPLOYING HIO TECHNOLOGY AND THE 55 OPTION ARE DESIGNATED HT-55-.

THE MD8600 SERIES CONCEALED VERTICAL ROD EXIT AND 7000 SERIES CONCEALED MULTI-POINT LOCK MAY BE PREFIXED 53, 55, 56, 58, 59, BT, AND ET

ON PAIRS OF DOORS, ONE LEAF OF THE PAIR UTILIZING WITH THE MD8600 SERIES CONCEALED VERTICAL ROD EXIT, 7000 CONCEALED MULTI-POINT LOCK OR HC4-8700 / HC-8700 SURFACE VERTICAL ROD MAY BE REPLACED WITH TWO 988CR SURFACE BOLTS. THE LOCAL BUILDING OFFICIAL MUST APPROVE THIS CONFIGURATION OF HARDWARE FOR USE IN A MEANS OF EGRESS.

THE IN 10 ACCESS CONTROL MAY BE USED WITH THE 10X CYLINDRICAL LOCK AND THE 8200 AND THE R8200 MORTISE LOCKS

BUTT HINGES

- 2 HINGES ARE REQUIRED FOR DOORS UP TO AND INCLUDING 60 INCHES IN HEIGHT
- 3 HINGES ARE REQUIRED FOR DOORS OVER 60 INCHES IN HEIGHT AND UP TO AND INCLUDING 90" IN HEIGHT
- 4 HINGES ARE REQUIRED FOR DOORS OVER 90 INCHES IN HEIGHT AND UP TO AND INCLUDING 96" IN HEIGHT

ASSA ABLOY ACCENTRA

7150(F)WS / 7250M(F)WS RIM EXIT AND 7170(F)WS SURFACE VERTICAL ROD MAY BE SUFFIXED WITH ANY COMBINATION OF A, B, O, OR S.

USE M200FWS OR KRM200FWS MULLION WITH THE 7150(F)WS / 7250M(F)WS RIM EXIT.

ON PAIRS OF DOORS, ONE LEAF OF THE PAIR UTILIZING WITH THE 7170(F)WS SURFACE VERTICAL ROD MAY BE REPLACED WITH TWO 988CR SURFACE BOLTS. THE LOCAL BUILDING OFFICIAL MUST APPROVE THIS CONFIGURATION OF HARDWARE FOR USE IN A MEANS OF EGRESS

ACCESS CONTROL MAY BE USED.


SECURITRON

THE MUNL MAY BE USED ON 60 PSF RATED SINGLE 3'0" X 7'0" ASSEMBLIES WITH A MORTISE CORBIN RUSSWIN ML2000, SARGENT 7800/8200/R8200, OR ASSA ABLOY ACCENTRA 8800 MORTISE LOCK. THE UNL MAY BE USED ON 60 PSF RATED SINGLE 3'0" X 7'0" ASSEMBLIES WITH A CORBIN RUSSWIN CL3100 / CLX3300 / CL3800, SARGENT 6500 / 7 /10X, OR ASSA ABLOY ACCENTRA / 5300LN / 5400CK / 5400LN CYLINDRICAL LOCKS.

THE HARDWARE MODELS BELOW MAY ALSO BE USED FOR THE SIZES AND DESIGN PRESSURES INDICATED. CONCEALED VERTICAL RODS AND SURFACE VERTICAL RODS MAY BE USED IN A PAIRED CONFIGURATION. RIM EXITS MAY BE USED IN PAIRED CONFIGURATION WITH A HURRICANE RATED MULLION					
DESIGN PRESSURE	SIZE	HARDWARE TYPE	MIN, GAUGE	CORBIN RUSSWIN	SARGENT
60	3'-0" x 7'-0"	MORTISE EXIT	18	PED5600 M107 PED5600 A M107*	WS-PE8900 WS-12-PE8900*
60	3'-0" x 7'-0"	RIM EXIT	18	PED5200 HC PED5200 A HC* PED5200 M107 PED5200 A M107*	HC-PE8800 12-HC-PE8800* WS-PE8800 WS-12-PE8800*
60	3'-0" x 8'-0" SINGLE 6'-0" x 8'-0" PAIR	CONCEALED VERTICAL ROD	16	PED5800 MD 107 PED5800 MD HC	HC-MD-PE8600 WS-MD-PE8600
60	3'-0" x 8'-0" SINGLE 6'-0" x 8'-0" PAIR	RIM EXIT	16	PED5200 HC PED5200 A HC*	HC-PE8800 12-HC-PE8800*
60	3'-0" x 8'-0" SINGLE 6'-0" x 8'-0" PAIR	SURFACE VERTICAL ROD	16	PED5400 HC	HC-PE8700
70	4'-0" x 8'-0" SINGLE 8'-0" x 8'-0" PAIR	CONCEALED VERTICAL ROD	16	PED5800 MD 107 PED5800 MD HC	HC-MD-PE8600 WS-ME-PE860
70	4'-0" x 8'-0" SINGLE 8'-0" x 8'-0" PAIR	RIM EXIT	16	PED5200 HC PED5200A HC*	HC-PE8800
65	4'-0" x 8'-0" SINGLE 8'-0" x 8'-0" PAIR	SURFACE VERTICAL ROD	16	PED5400 HC	HC-PE8700
150	4'-0" x 8'-0" SINGLE 8'-0" x 8'-0" PAIR	SURFACE VERTICAL ROD	14	PED5400 HC4 PED5400 A HC4*	HC4-8700 12-HC4-PE8700*
*INDICATED A FIRE RATED EXIT HARDWARE MAY BE USED ON A SINGLE DOOR					

ASSA ABLOY, the global leader in door opening solutions.

FRANK BENNARDO, PE
PE# 0046549 CA# 9885

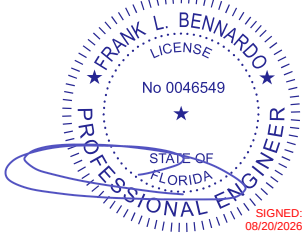

AUGUST 19, 2026

FL

FL# 16353.1

ENGINEERING
EXPRESS®

POSTAL ADDRESS:
2234 NORTH FEDERAL HWY #7664
BOCA RATON, FL 33431
ENGINEERINGEXPRESS.COM

CURRIES

DIVISION OF ASSA ABLOY DOOR GROUP, INC.
1502 12TH STREET NW
MASON CITY, IA 50401

CURRIES
ASSA ABLOY

COMMERCIAL STEEL EXTERIOR DOORS
FLUSH PAIRS OF DOORS (LMT) - FBC 9TH ED. (2026)
FLORIDA STATEWIDE APPROVAL (FSA FL#16353.1)

REMARKS	DRWN	CHKD	DATE
INIT ISSUE (12-CU-03G-01)	KL	FLB	06/28/13
FBC UPDATE	RWN	CSL	06/12/15
2017 FBC UPDATE	JEM	FLB	10/03/17
2020 FBC UPDATE	TAE	FLB	12/17/20
2023 FBC (REV 20-34815)	AMZ	RS	10/18/23
2026 FBC UPDATE	ABF	RS	08/18/26

COPYRIGHT ENGINEERING EXPRESS®

26-102749

SCALE: NTS UNLESS NOTED

11 OF 11