

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING, METAL STRUCTURE AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
5. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
6. FRAME MATERIAL: WOOD WITH G=.46 MINIMUM SPECIFIC GRAVITY, OR COMPOSITE, OR FRAMESAVER, OR FUSION FRAME.
DOOR SKIN MATERIAL: STEEL .033” THICK (MINIMUM)
7. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 7 FOR GLASS DETAILS.
8. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
9. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.

10. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
11. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16” TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
12. FOR ANCHORING INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
13. ALL FASTENERS TO BE CORROSION RESISTANT.
14. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
14.A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42
14.B. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
14.C. MASONRY – GROUT FILLED STRENGTH CONFORMANCE TO ASTM C–90, GRADE N, TYPE 1 (OR GREATER).
14.D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063–T5 .048” THICK MINIMUM

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS
3 – 6	INSTALLATION DETAILS
7	GLAZING DETAILS
8 – 11	COMPONENTS

PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL INSWING GLAZED DOOR – SINGLE & DOUBLE
IMPACT
NOTES

DRAWN:
V.L.

DWG NO.
08-01957

REV
L


SCALE NTS

DATE 03/05/13


SHEET 1 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 09/10/2026

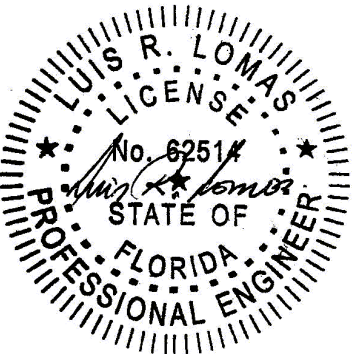


Luis R. Lomas P.E.
FL No.: 62514

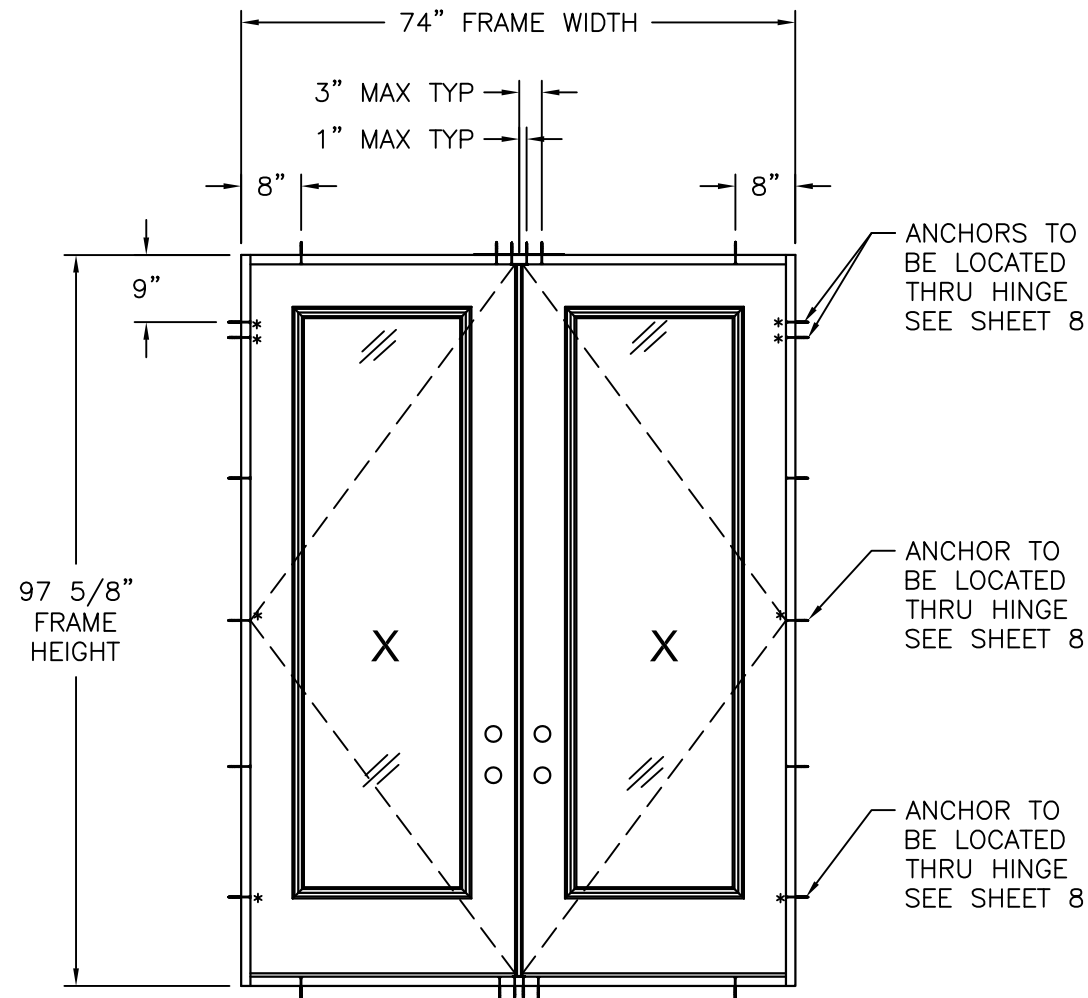

DOUBLE DOOR

DESIGN PRESSURE RATING	IMPACT RATING
±55.0PSF	LARGE MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 3

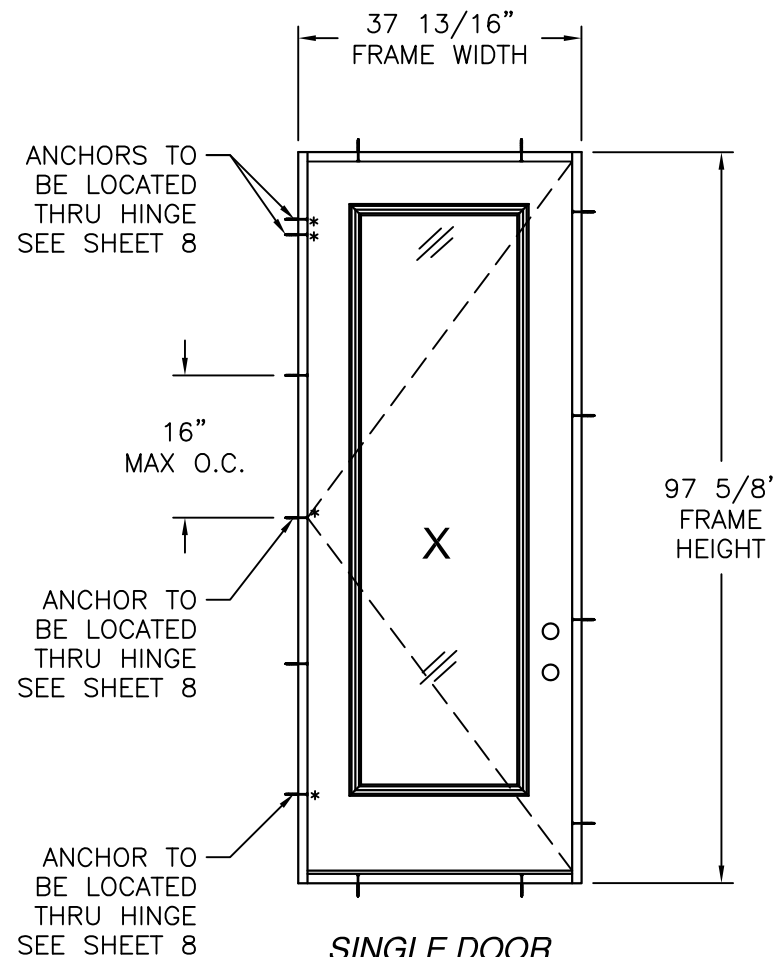


SINGLE DOOR

WITH PANOLOCK MULTI-POINT	
DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	LARGE MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 3

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

APPROVED LITE CONFIGURATIONS

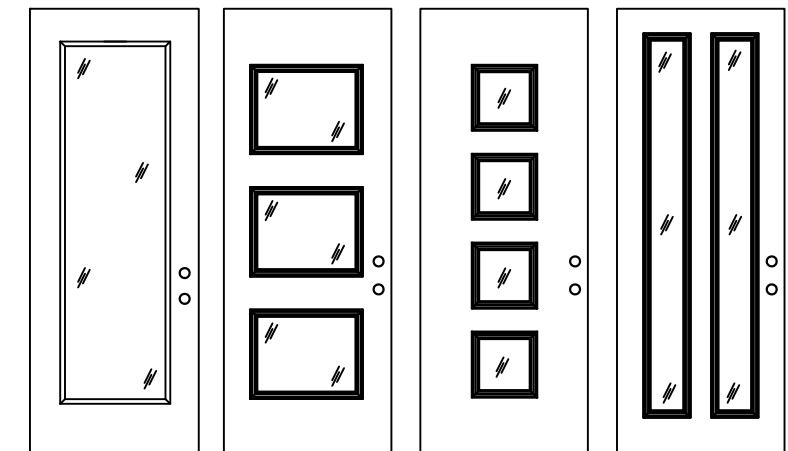

FULL LITE

3 LITE

4 LITE

2 LITE

LITE CONFIGURATIONS SHOWN ARE FOR REFERENCE ONLY. MULTIPLE LITE CONFIGURATIONS ARE APPROVED AS LONG AS LITE SIZE DOES NOT EXCEED 11.1 FT²

ANCHORS AND ANCHOR CONNECTORS CORROSION RESISTANCE CHART

Exposure	Distance from coastal shoreline	
	0' up to 300'	>300' up to 3000'
Exterior - partially sheltered	304 or A305 or 306 Stainless steel per ASTM A240	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Exterior - open exposed	304 or A305 or 306 Stainless steel per ASTM A240	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Unconditioned interior-vented enclosed	Galvanized per ASTM A153 class D or ASTM A641 class 3S	Galvanized per ASTM A153 class D or ASTM A641 class 3S
Unconditioned interior-unvented enclosed	Galvanized per ASTM A153 class D or ASTM A641 class 3S	Galvanized per ASTM A153 class D or ASTM A641 class 3S

HARDWARE SCHEDULE	
A.	F-SERIES & FC-SERIES LOCK ASSEMBLY DOOR KNOB BY SCHLAGE
B.	B-SERIES DEADBOLT ASSEMBLY BY SCHLAGE
C.	F-SERIES & FC-SERIES DEADBOLT ASSEMBLY BY SCHLAGE
D.	RESIDENTIAL GRADE DOOR HANDLE ASSEMBLY BY EMTEK (ALTERNATE)
E.	MULTI-POINT HANDLE ASSEMBLY BY TRILENNIUM (ALTERNATE)
F.	PANOLOCK MULTI-POINT LOCK ASSEMBLY (ALTERNATE)
G.	OUTSWING HURRICANE ASTRAGAL BY ENDURA
H.	(3) 4" X 4" BALL BEARING HINGES BY PENROD
I.	(3) 4" X 4" SPRING BOMMER HINGES BY PENROD (ALTERNATE)

- NOTES;
- HINGES ARE LOCATED AT 10", 50" AND 89" FROM TOP CORNER.
 - APPROVED CONFIGURATIONS MAY BE RIGHT OR LEFT HAND.
 - PANEL SIZE 35 3/4" X 95".
 - D.L.O. 20 3/8" X 78 1/2".
 - JAMBS ARE ASSEMBLED TO HEAD FRAME WITH (3) #8X3" WOOD SCREWS AT EACH JAMB.
 - JAMBS ARE ASSEMBLED TO THRESHOLD WITH (3) #6X1-1/2" WOOD SCREWS AT EACH JAMB.

PROVIA, LLC.


2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681

STEEL INSWING GLAZED DOOR – SINGLE & DOUBLE
IMPACT
ELEVATIONS


DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 2 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 09/10/2026

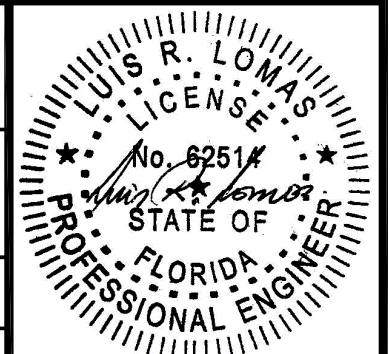

Luis R. Lomas P.E.
FL No.: 62514

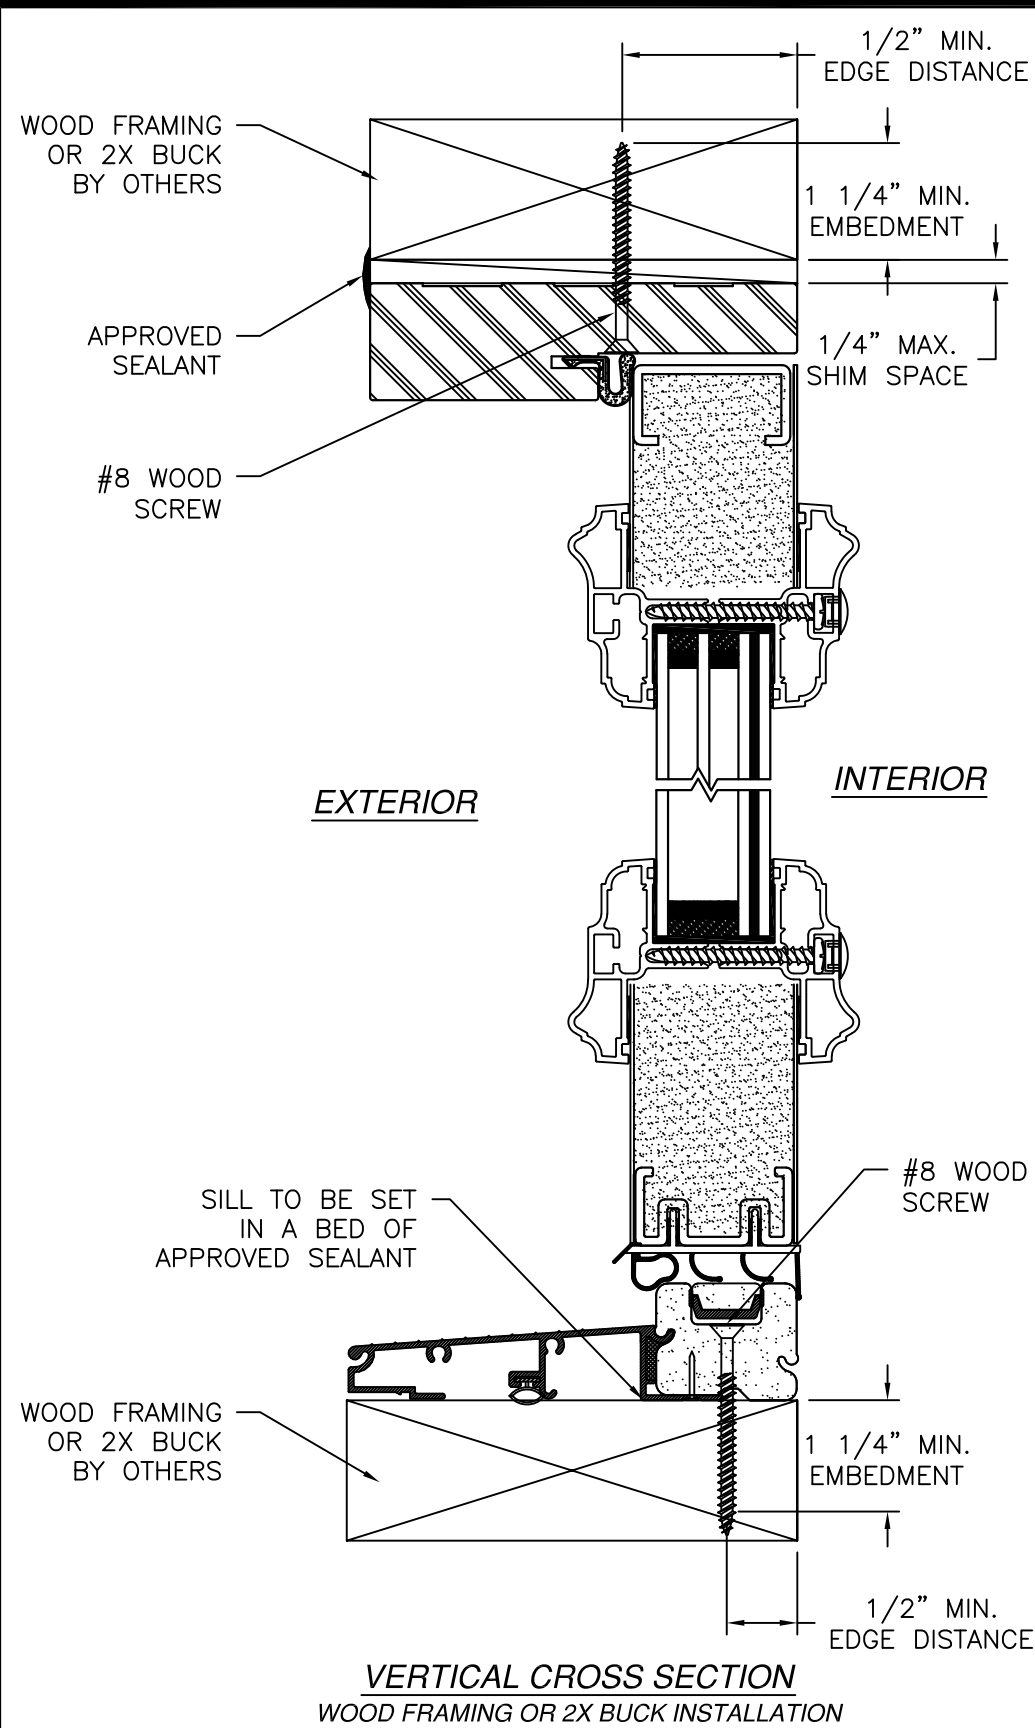


VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

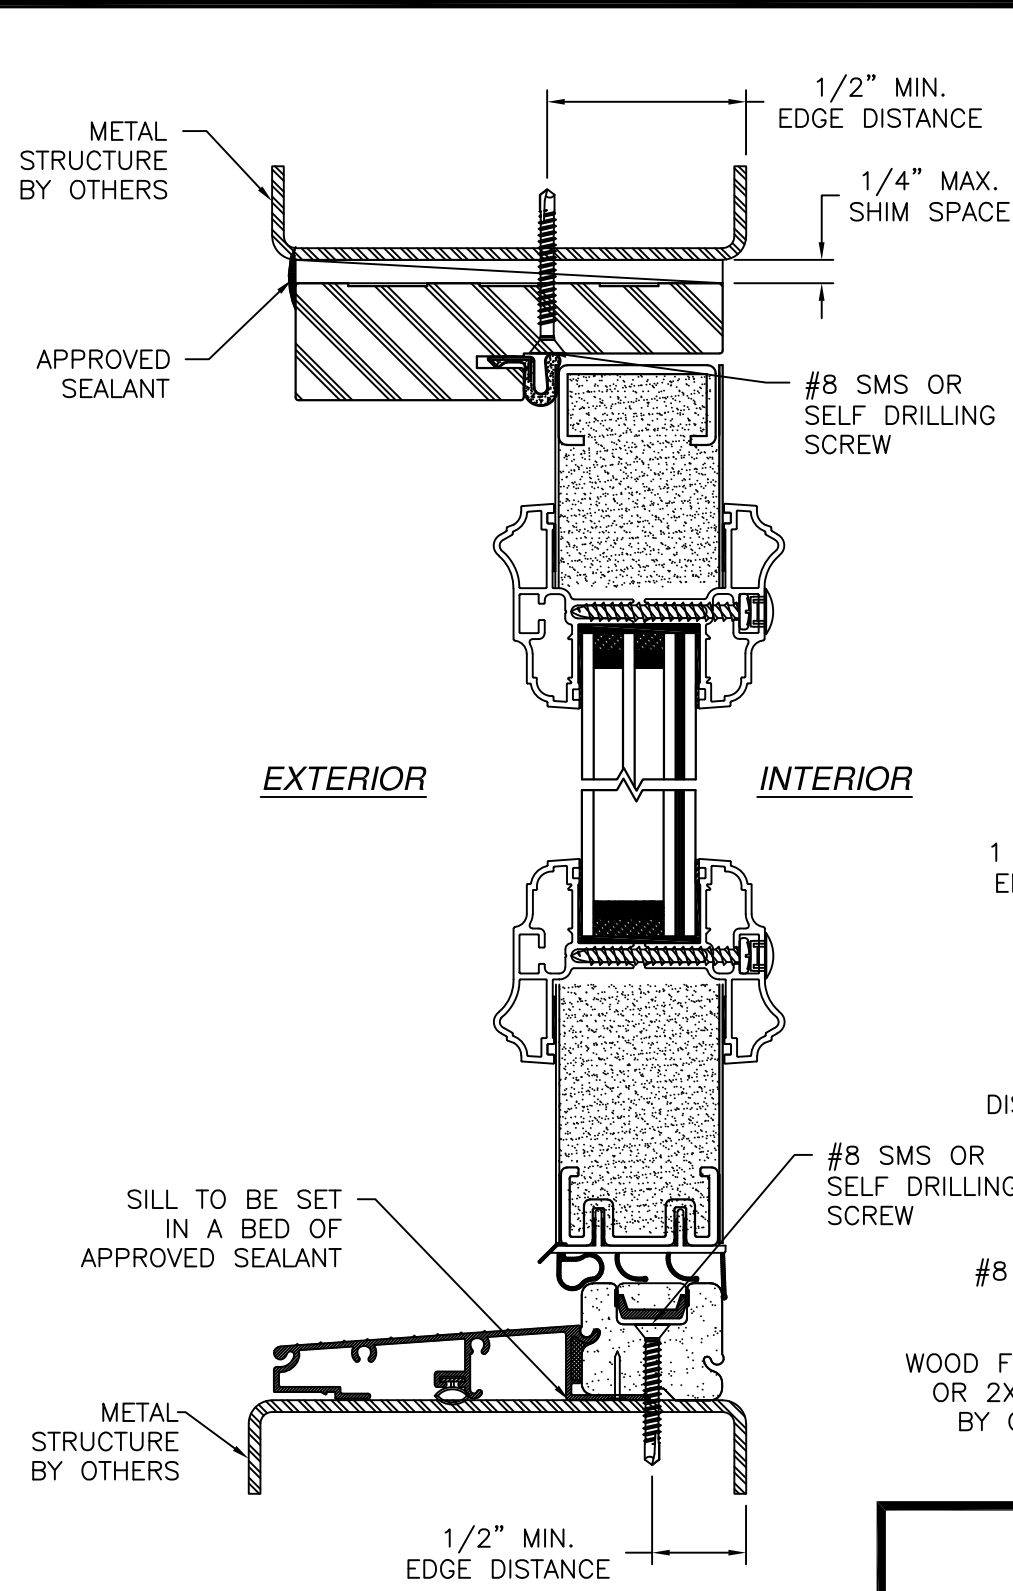


VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

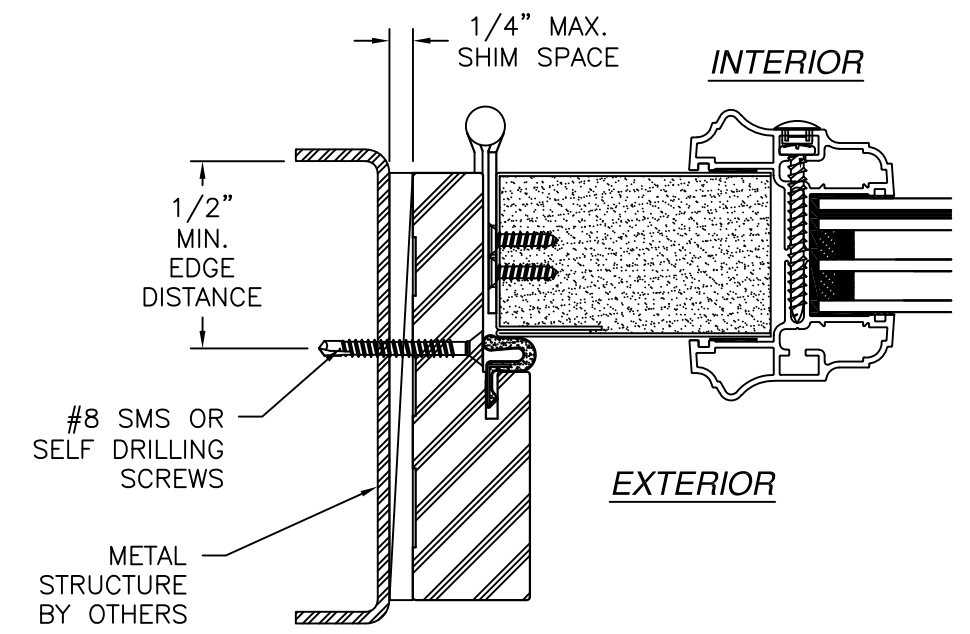

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

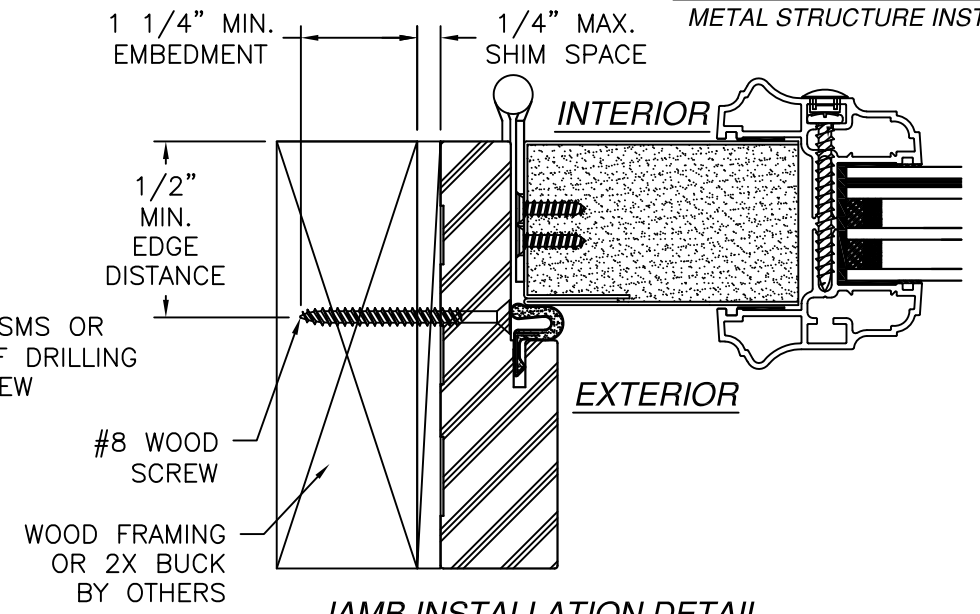

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

PROVIA, LLC.
2150 STATE ROUTE 39 WEST
SUGARCREEK, OH 44681


STEEL INSWING GLAZED DOOR – SINGLE & DOUBLE IMPACT INSTALLATION DETAILS

DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 3 OF 11


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

PROFESSIONAL ENGINEER
L. ROBERTO LOMAS P.E.
No. 62514
STATE OF FLORIDA
FL No.: 62514

SIGNED: 09/10/2026

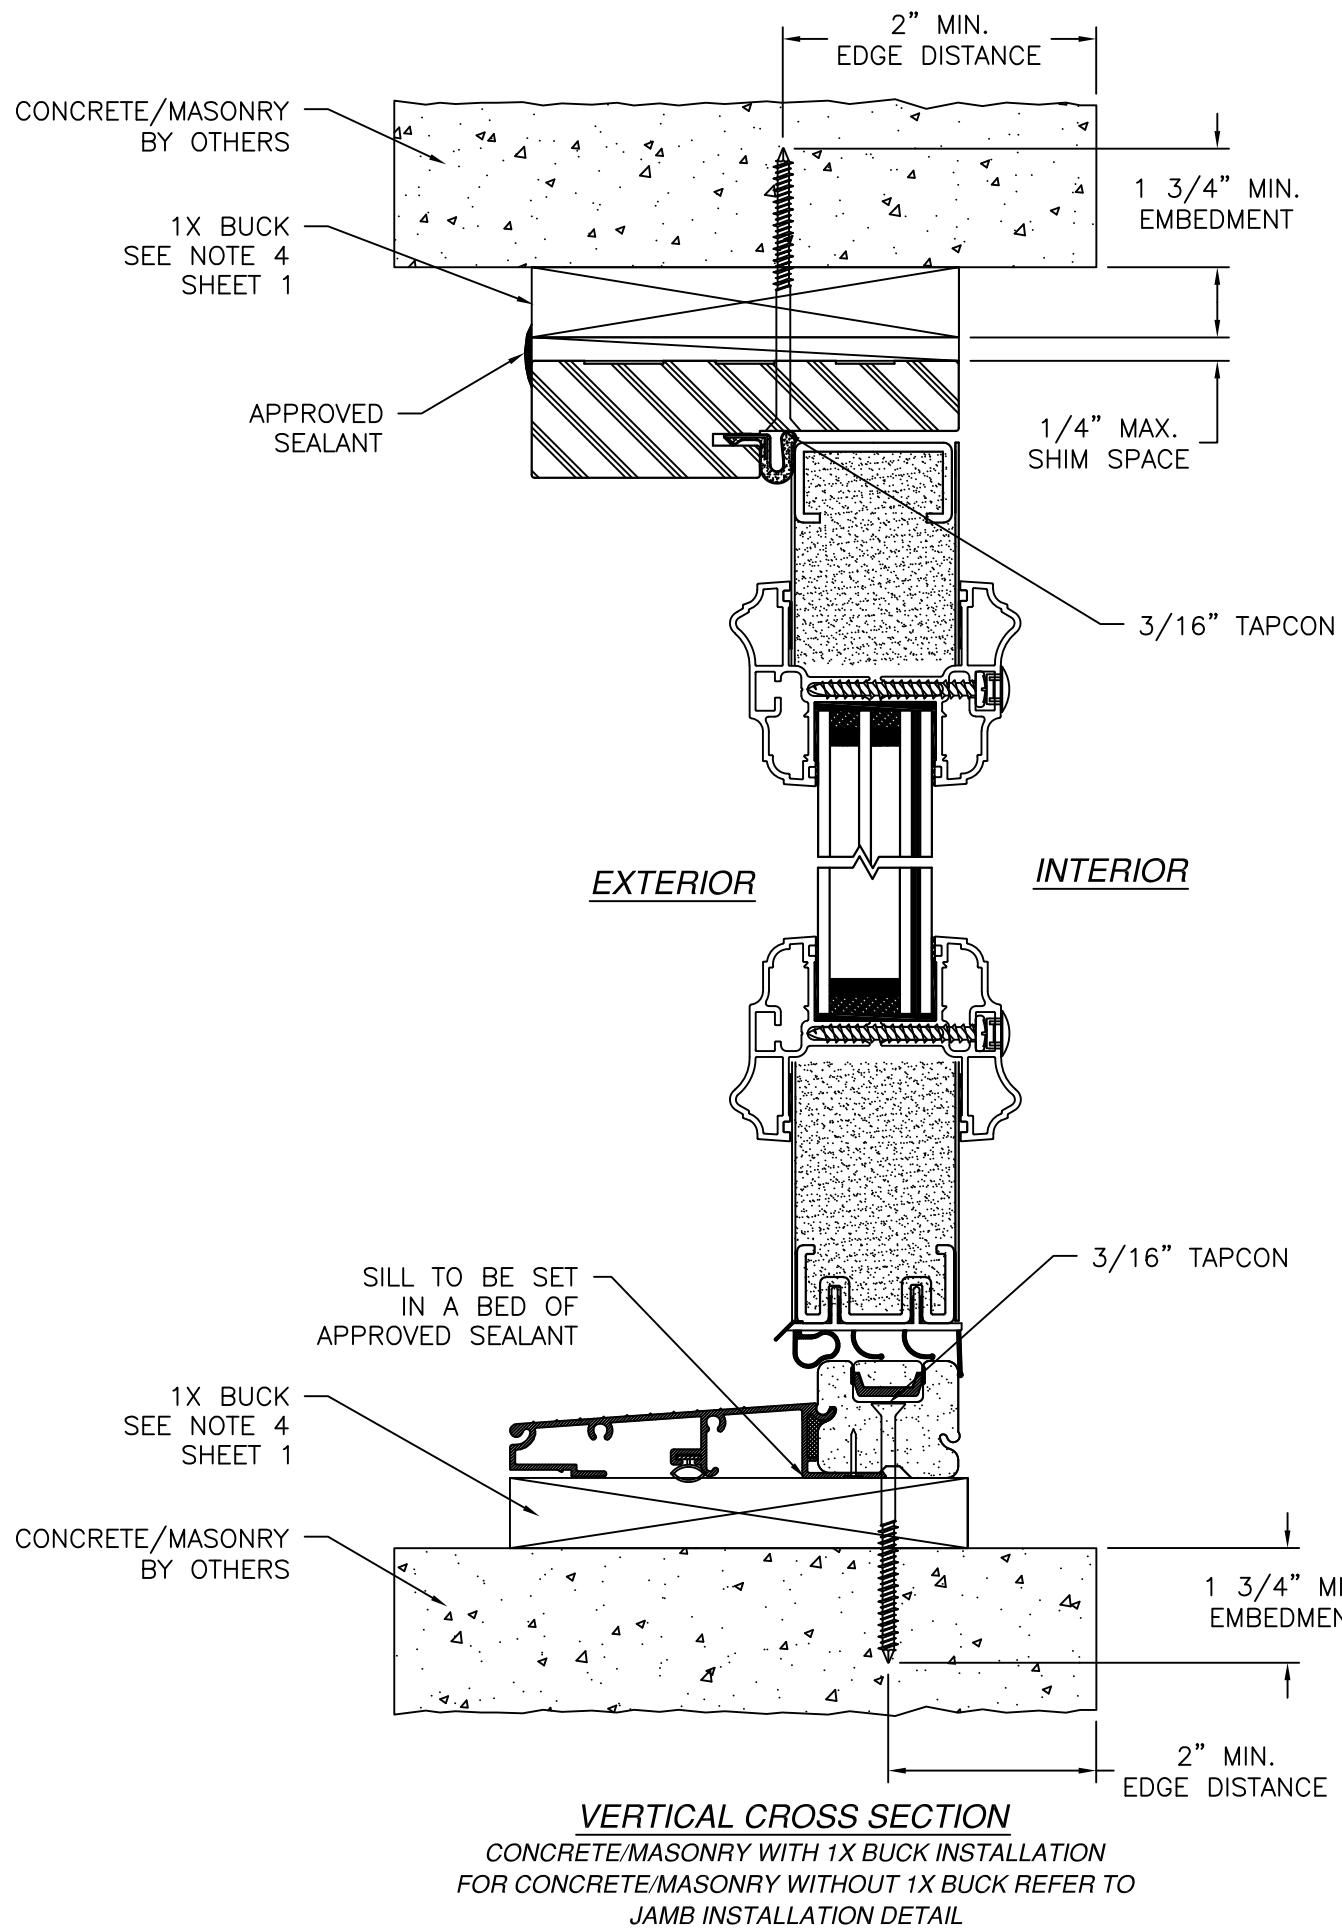

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

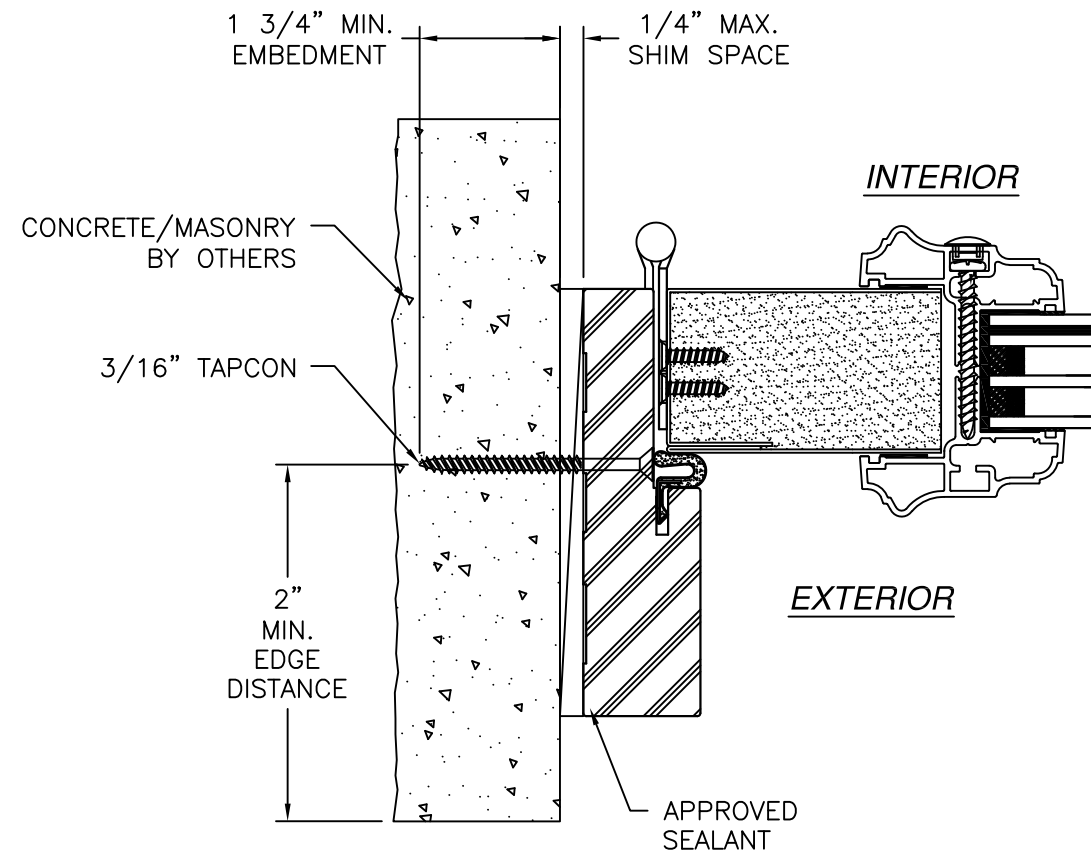


JAMB INSTALLATION DETAIL
 CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION
 FOR CONCRETE/MASONRY WITH 1X BUCK REFER TO
 HEAD AND SILL INSTALLATION DETAILS


- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 09/10/2026


PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL INSWING GLAZED DOOR – SINGLE & DOUBLE IMPACT INSTALLATION DETAILS		
DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 4 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

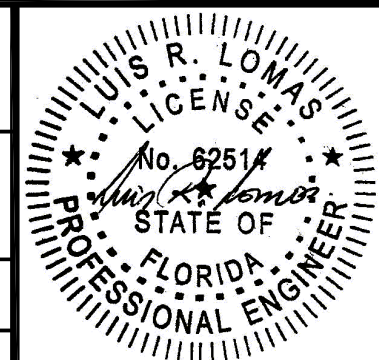

Luis R. Lomas P.E.
 FL No.: 62514

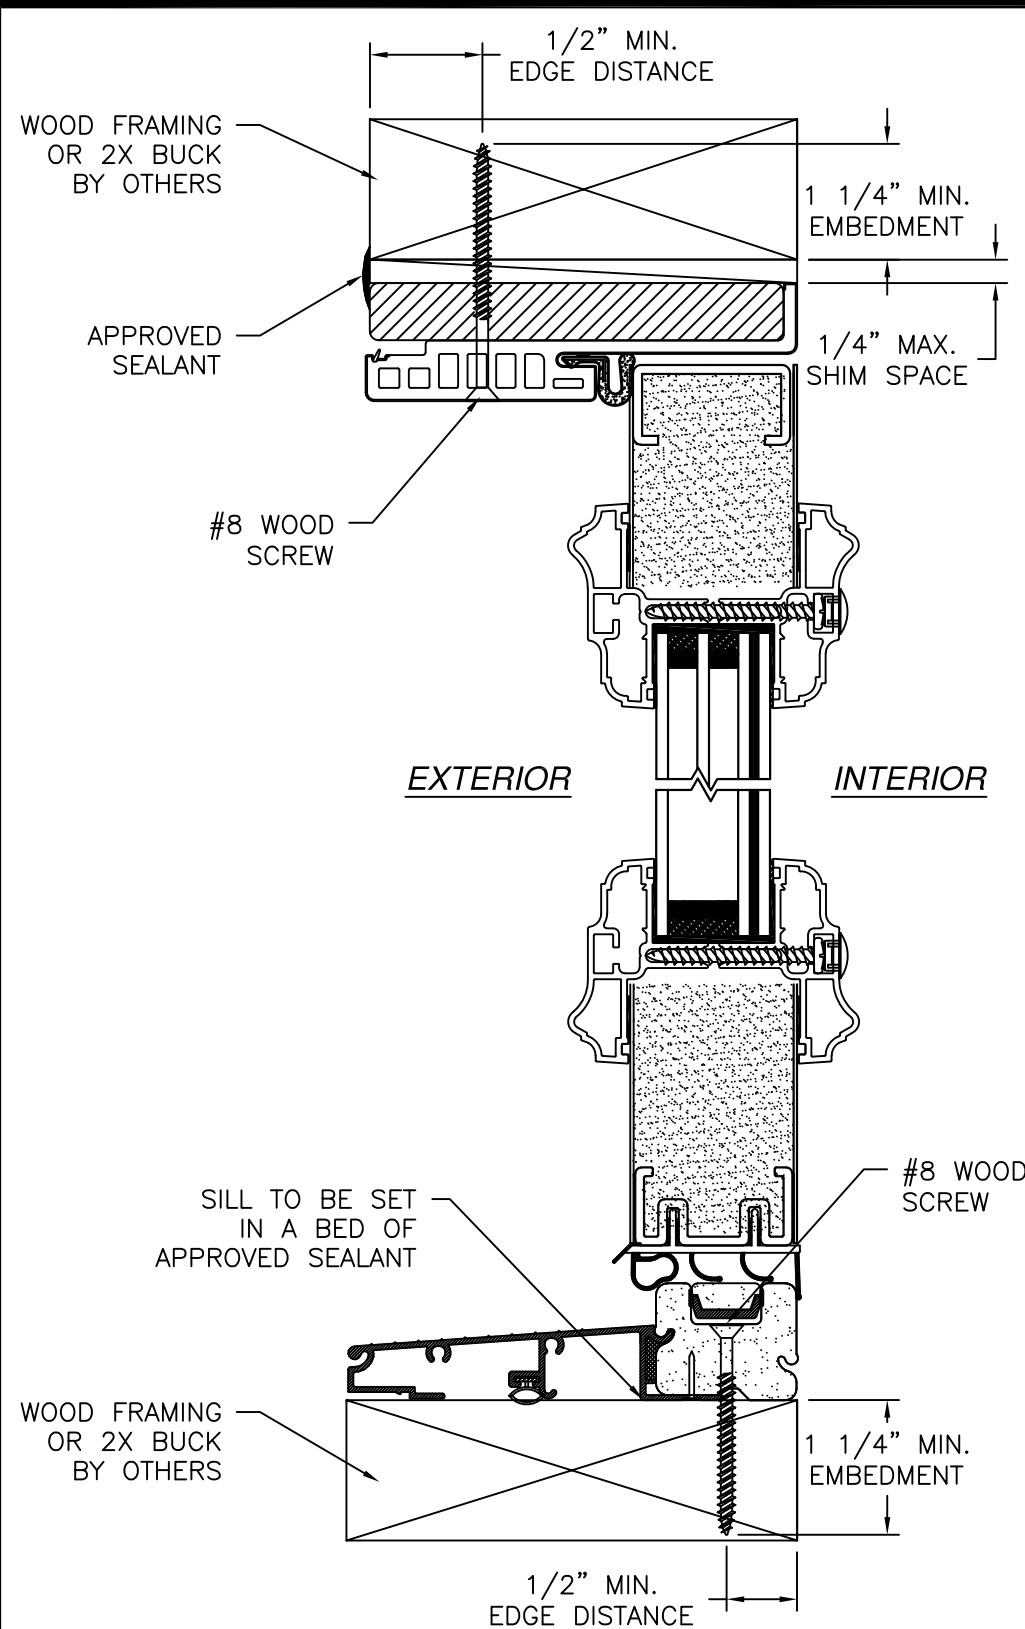


VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

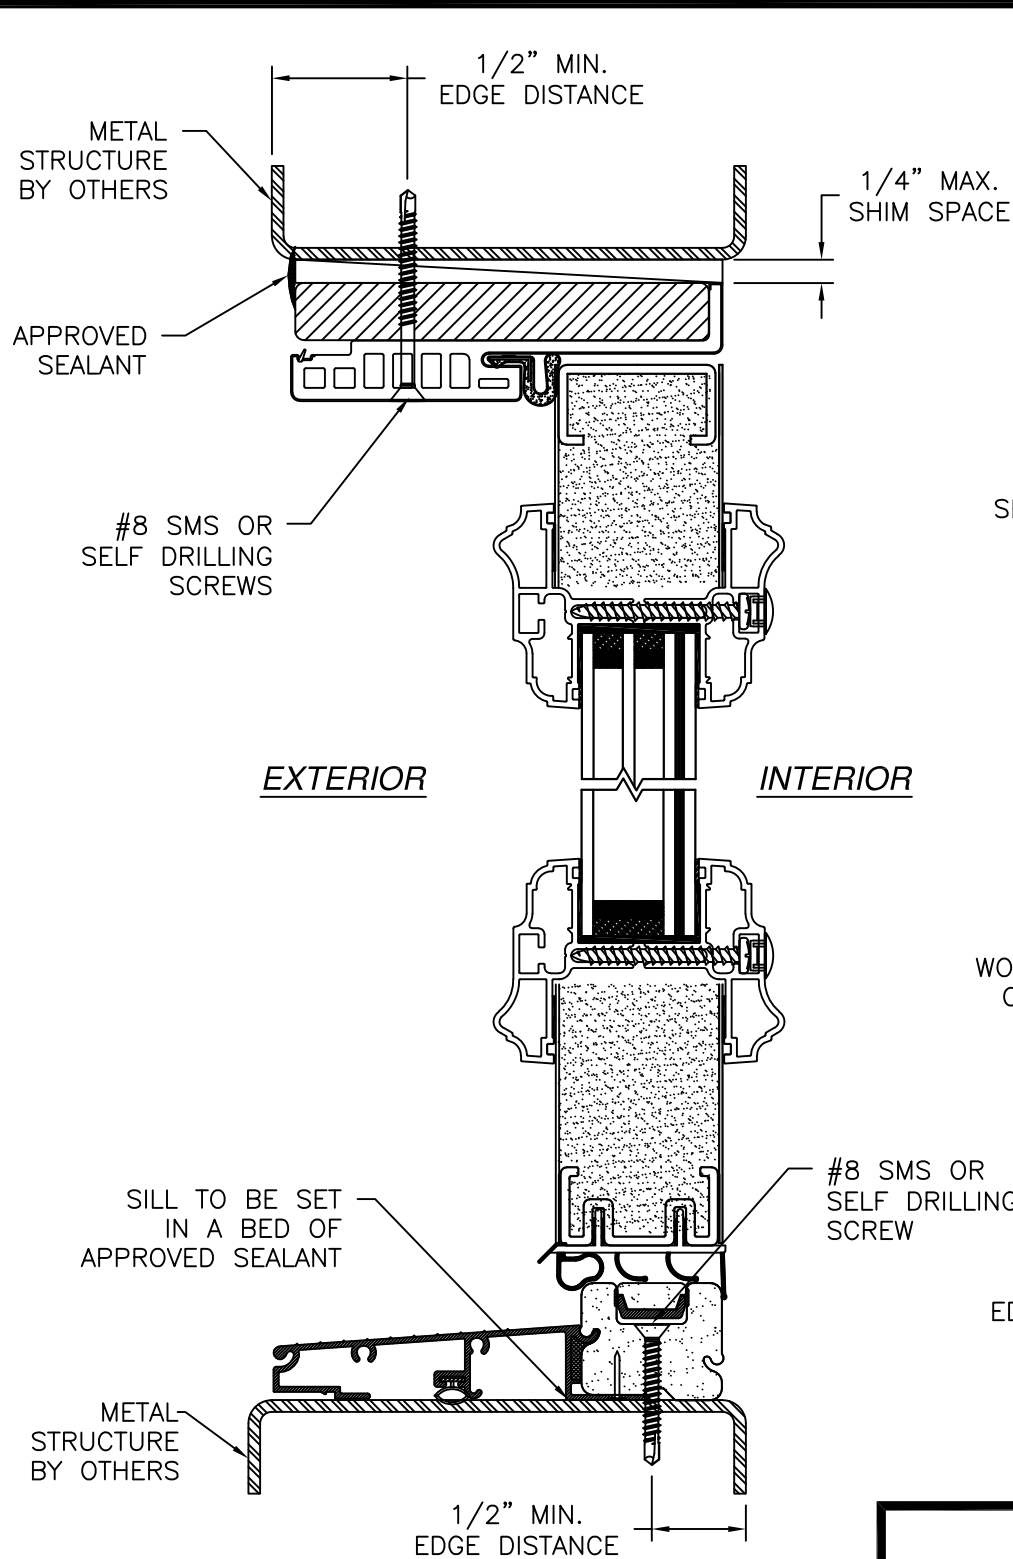


VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

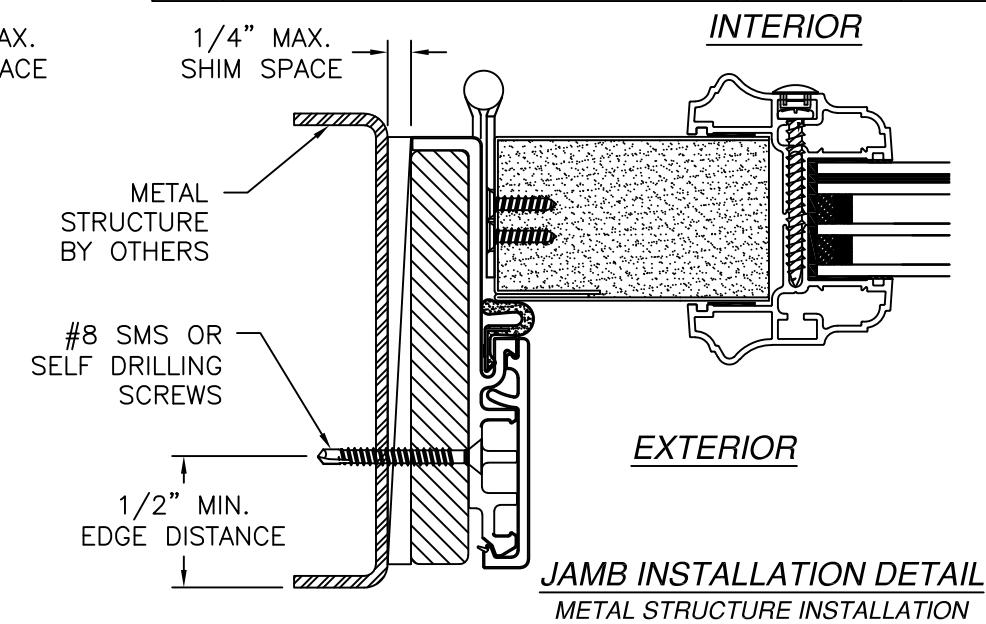


JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

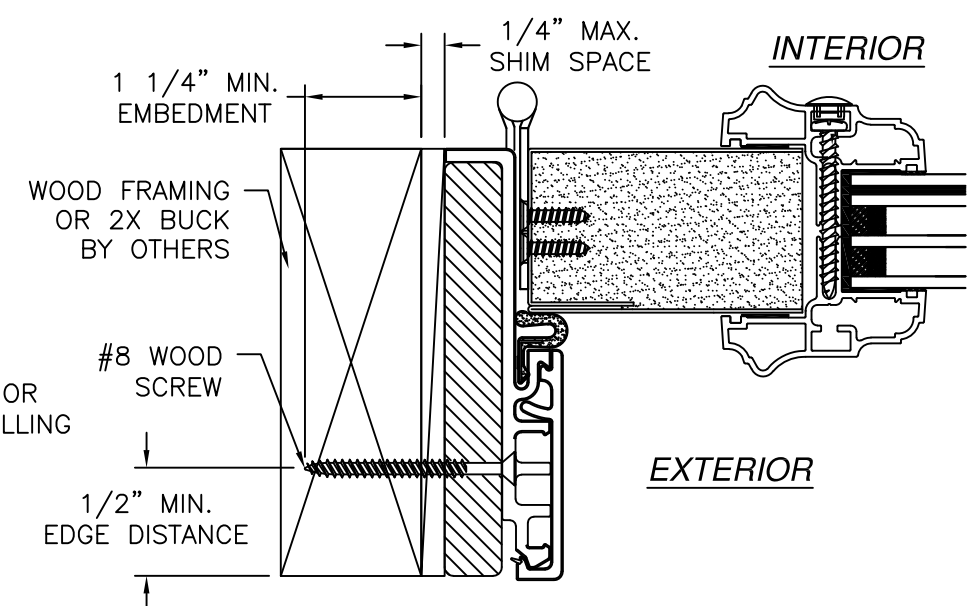



JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

SIGNED: 09/10/2026

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL INSWING GLAZED DOOR – SINGLE & DOUBLE IMPACT INSTALLATION DETAILS W/FUSION FRAME		
DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 5 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

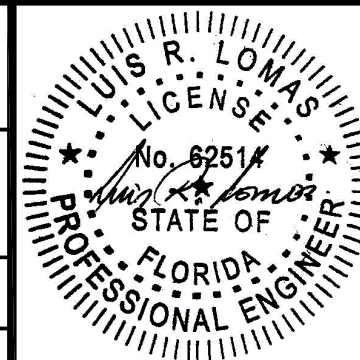


Luis R. Lomas P.E.
FL No.: 62514

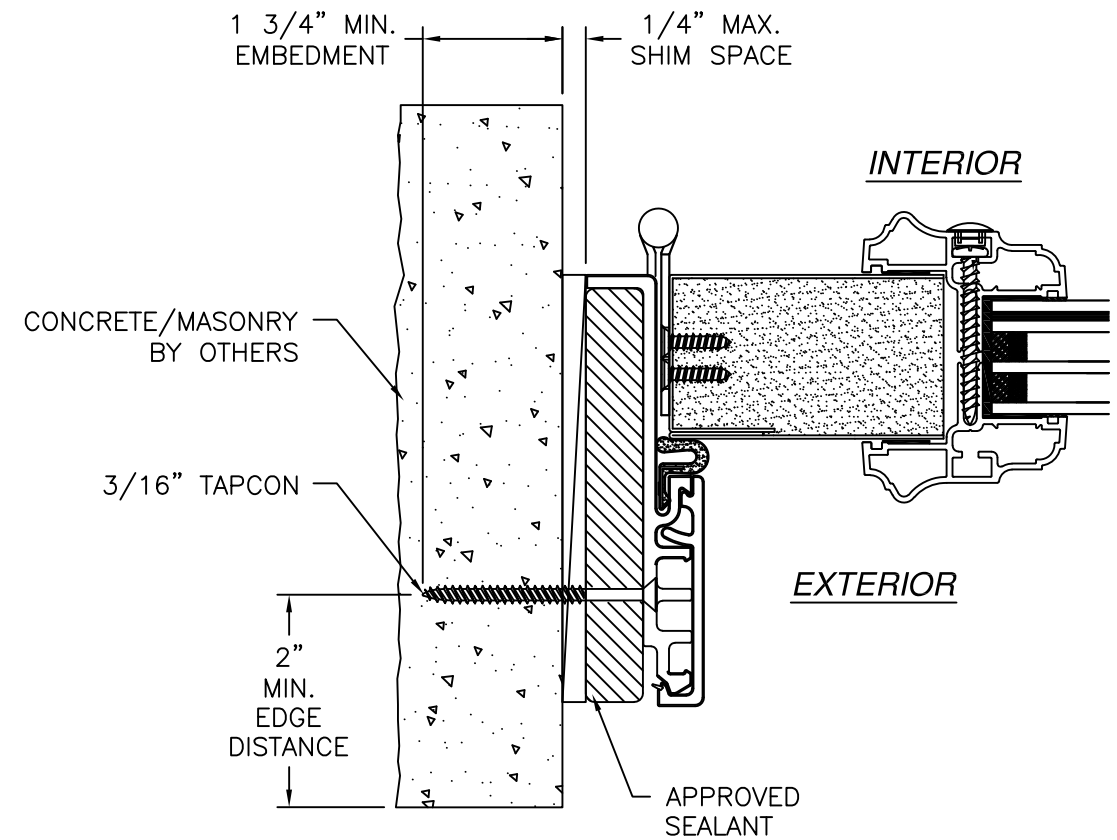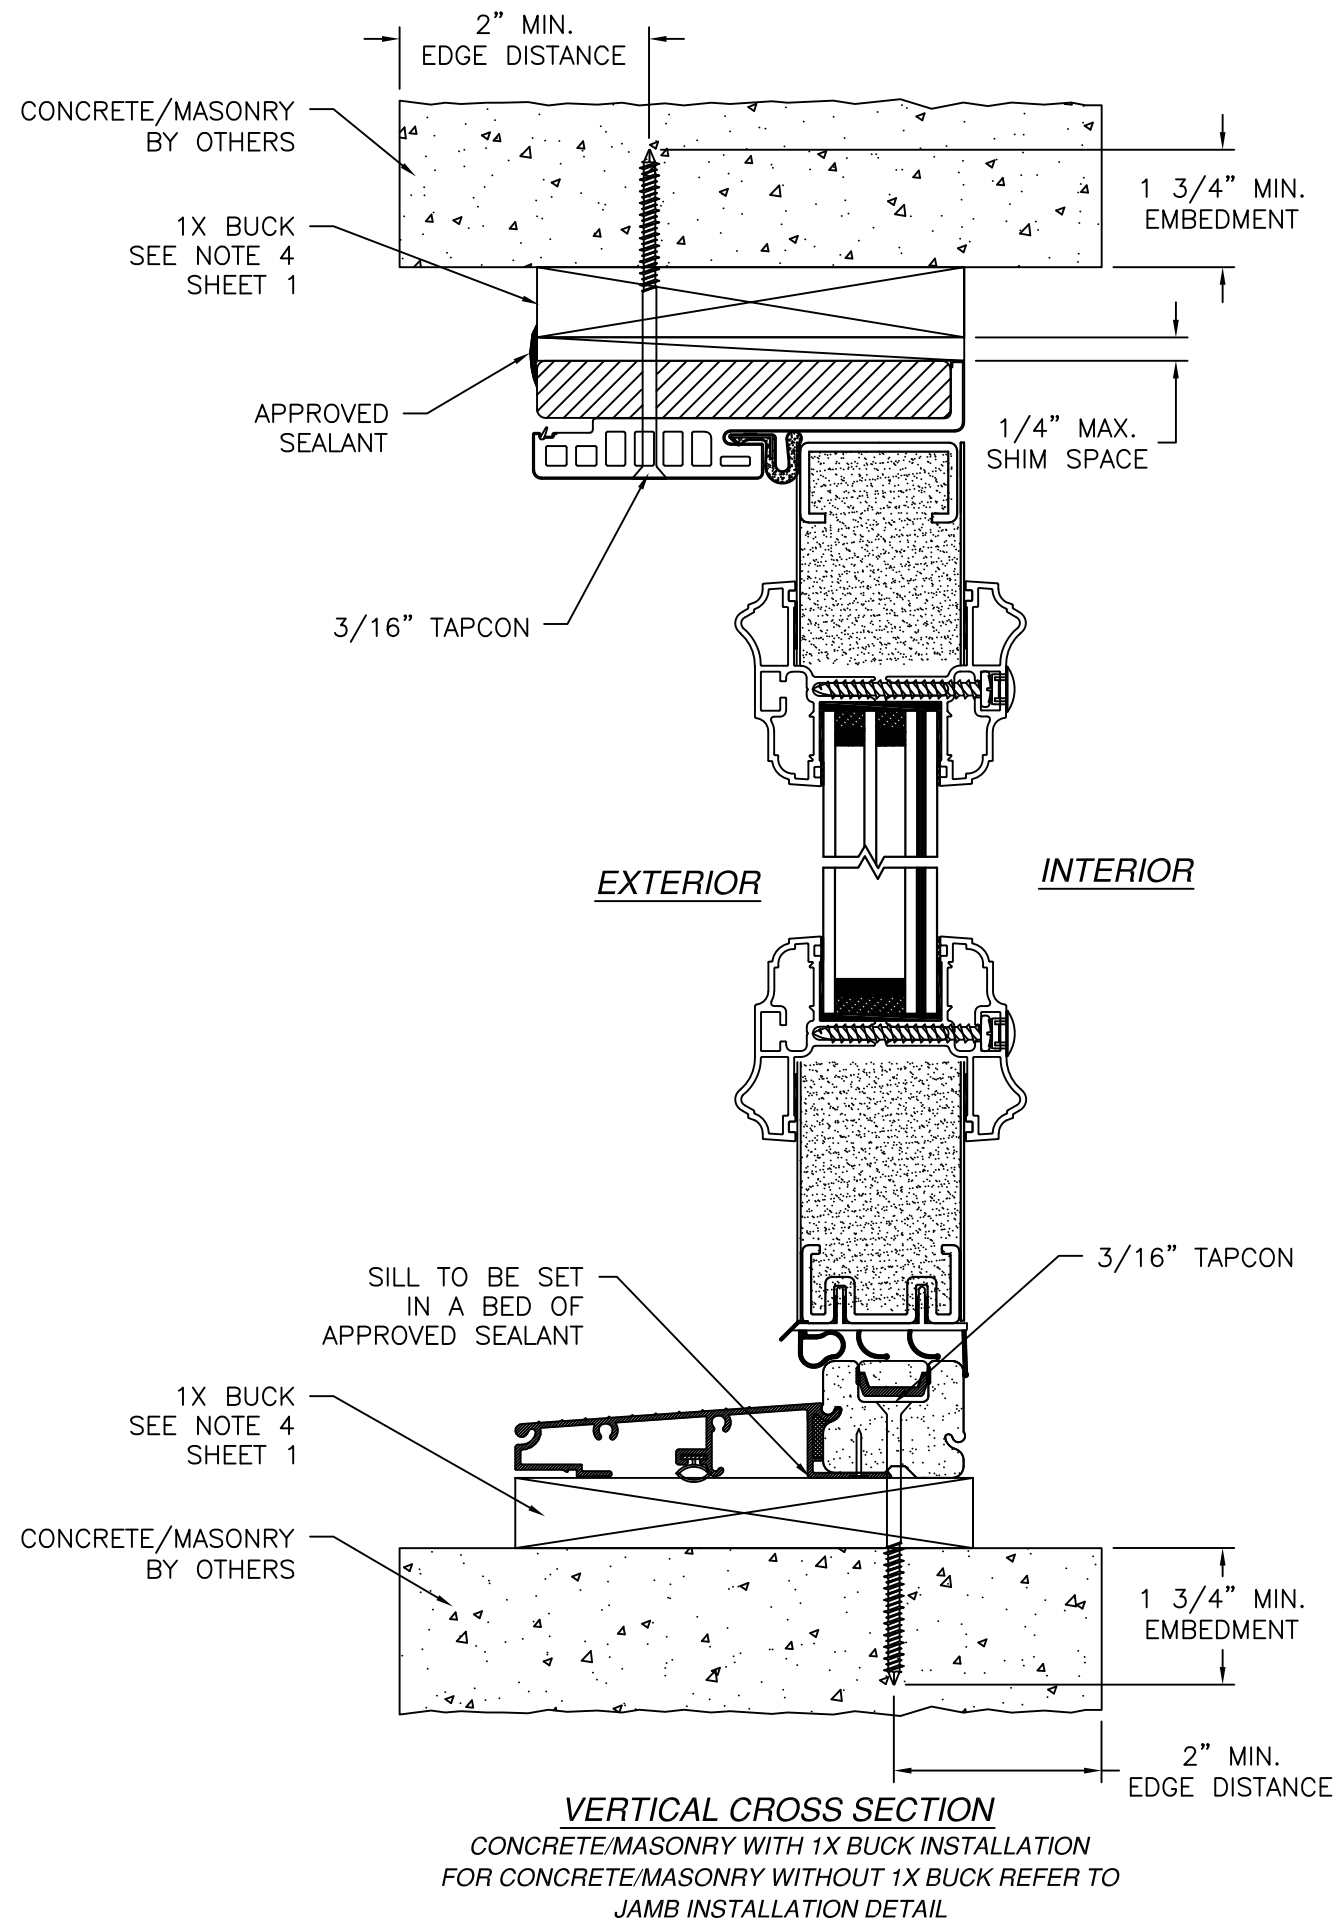





- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL INSWING GLAZED DOOR – SINGLE & DOUBLE IMPACT INSTALLATION DETAILS W/FUSION FRAME		
DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 6 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

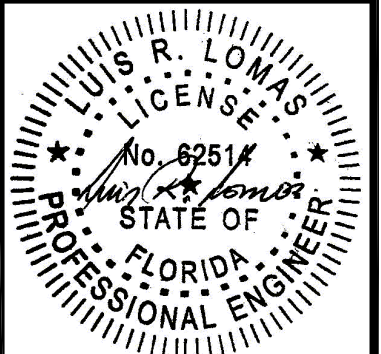

Luis R. Lomas P.E.
 FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

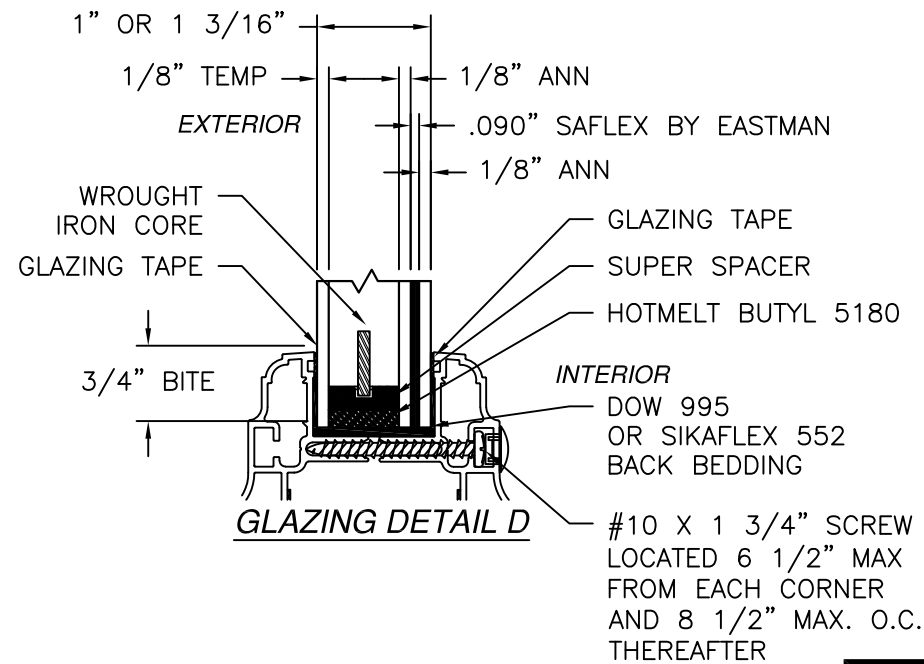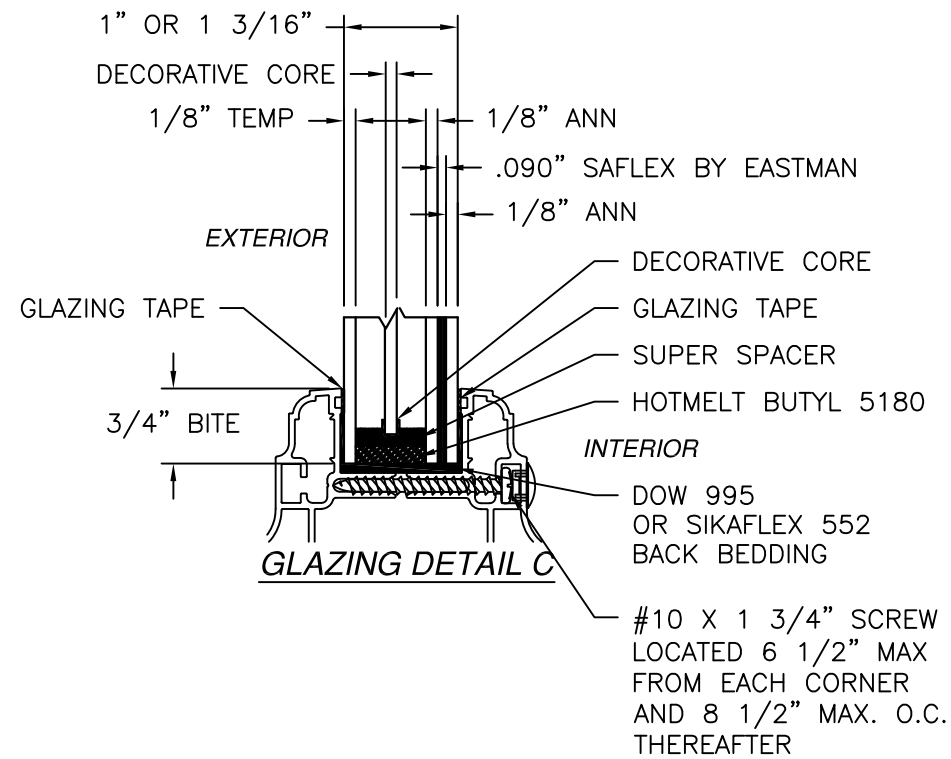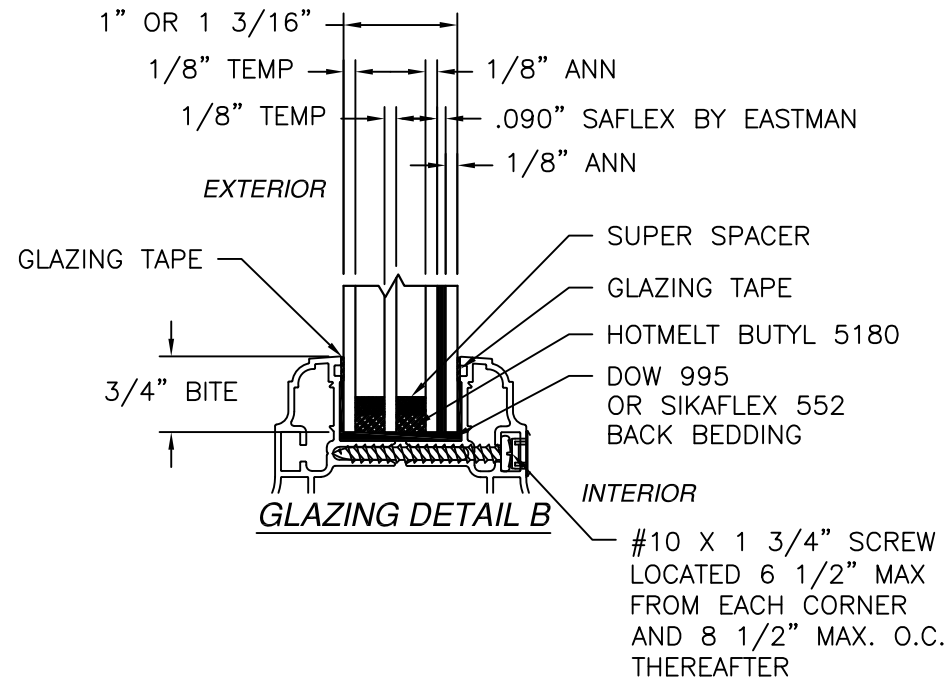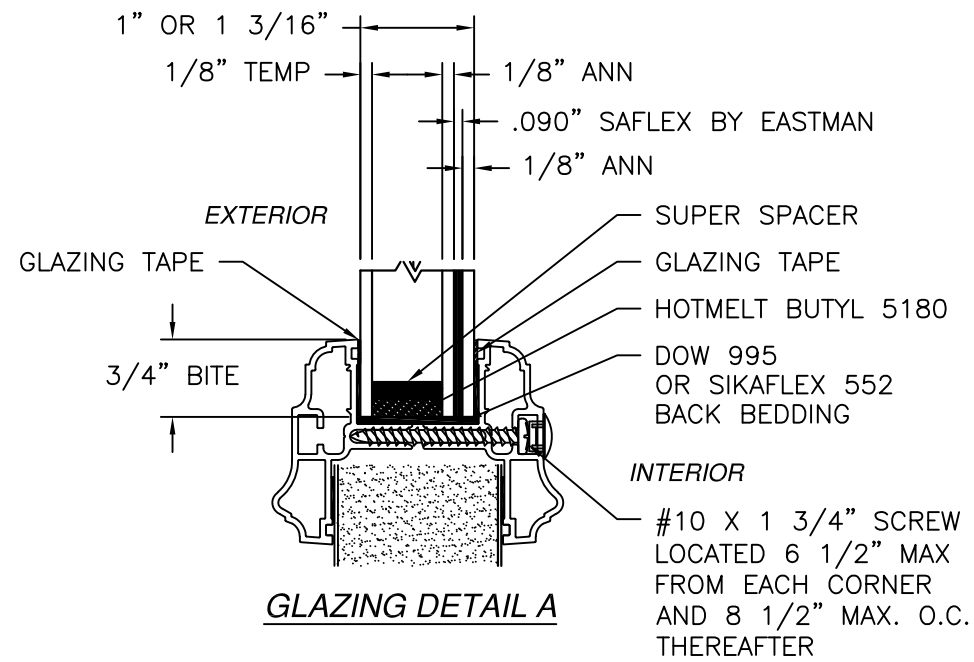

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.




SIGNED: 09/10/2026

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL INSWING GLAZED DOOR – SINGLE & DOUBLE IMPACT GLAZING DETAILS		
DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 7 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		


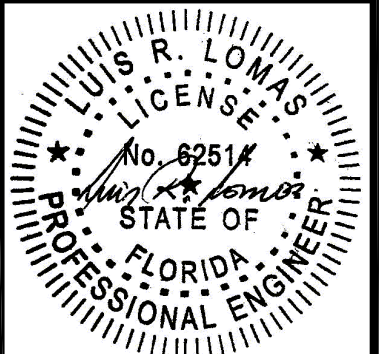


Luis R. Lomas P.E.
FL No.: 62514



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

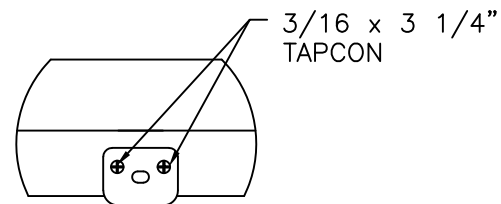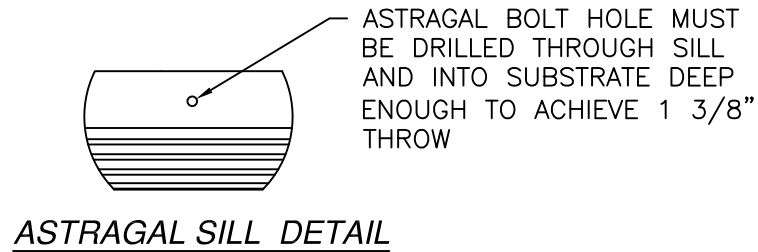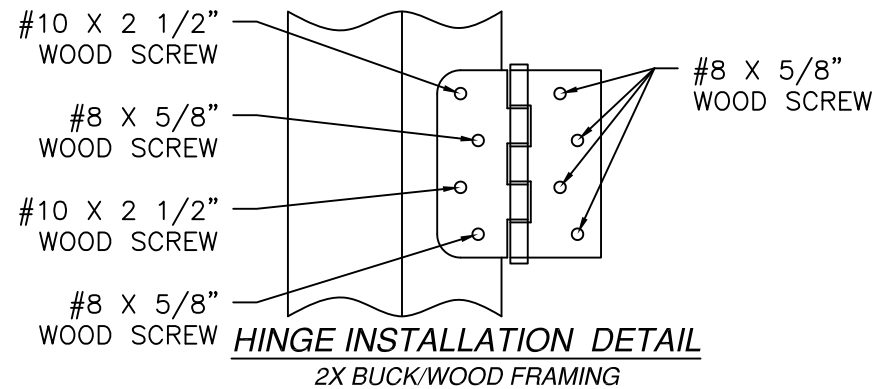

ASTRAGAL HEAD STRIKE DETAIL
MASONRY/CONCRETE

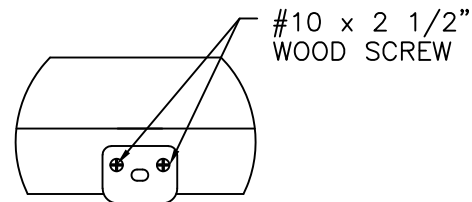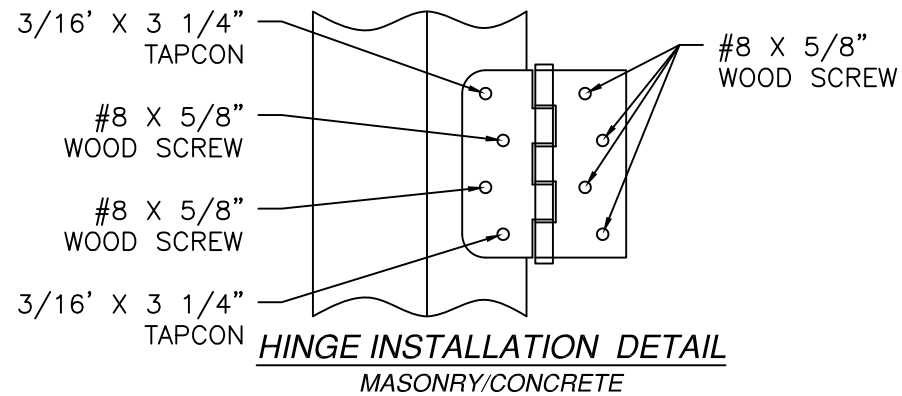


ASTRAGAL HEAD STRIKE DETAIL
2X BUCK/WOOD FRAMING

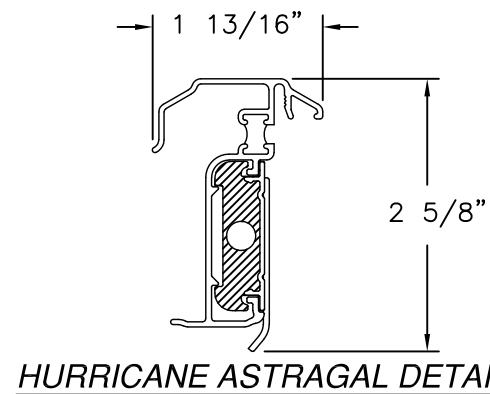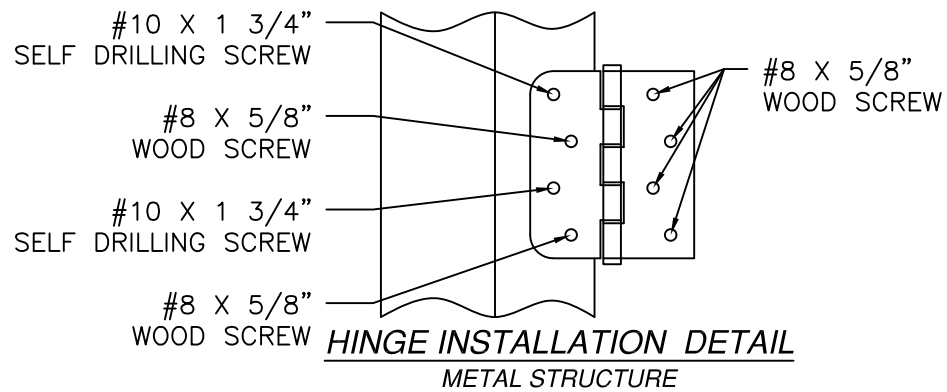

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL INSWING GLAZED DOOR – SINGLE & DOUBLE IMPACT COMPONENTS DETAILS		
DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 8 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		


SIGNED: 09/10/2026

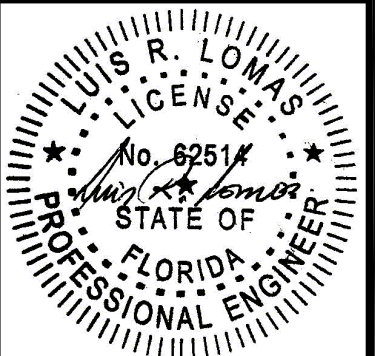


Luis R. Lomas P.E.
FL No.: 62514

APPROVED SLABS AND TRIMS


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

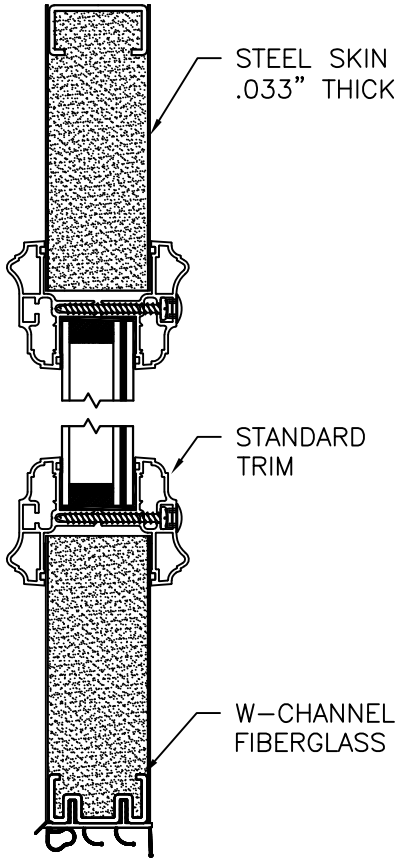


PANEL OPTION 1

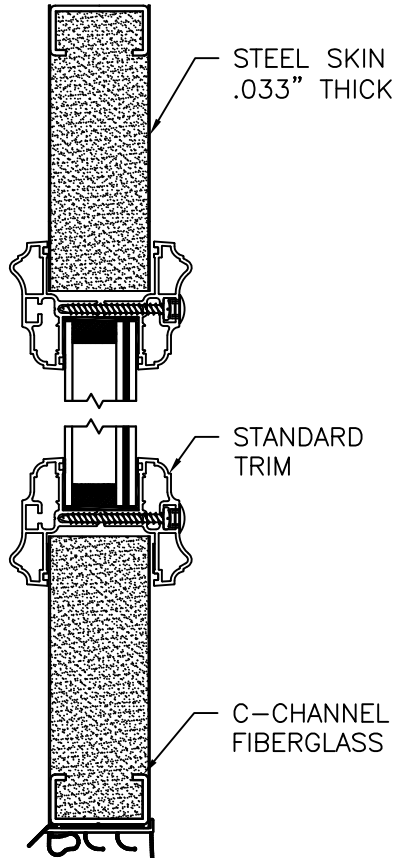


PANEL OPTION 2

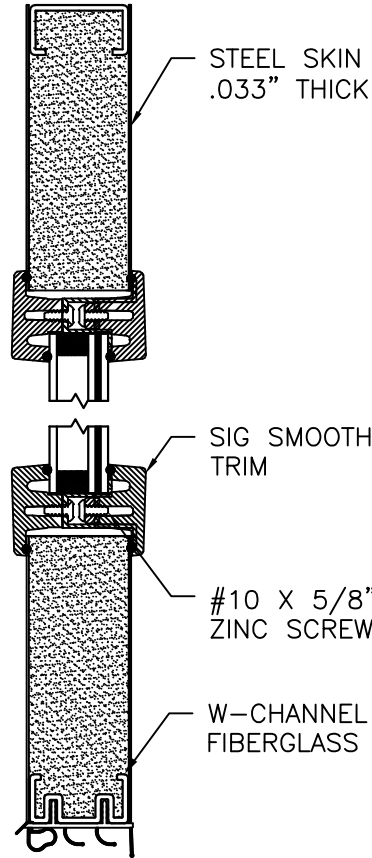


PANEL OPTION 3

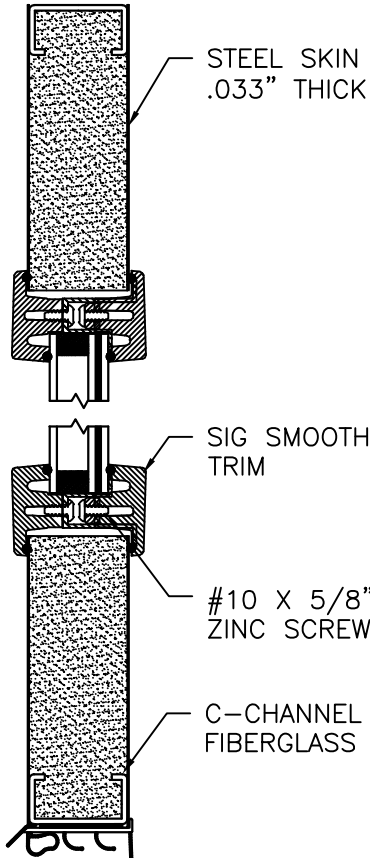


PANEL OPTION 4

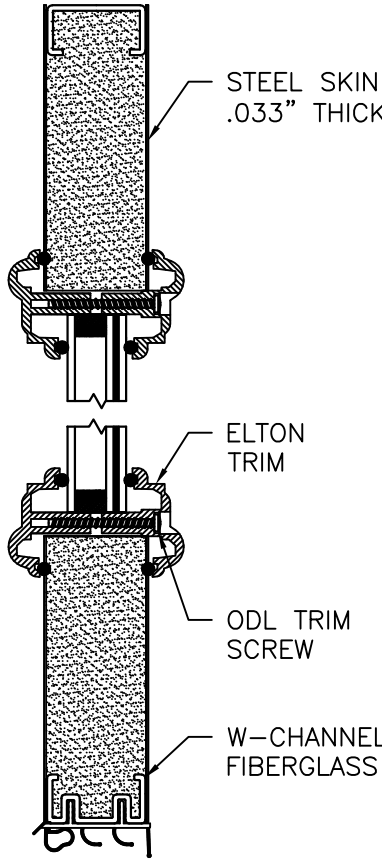


PANEL OPTION 9

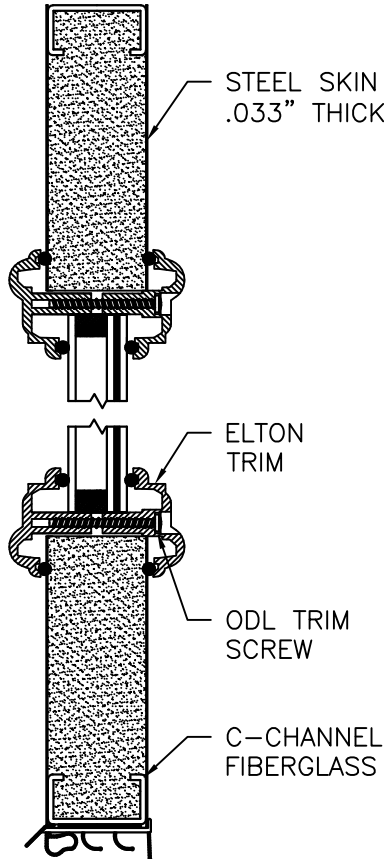


PANEL OPTION 10

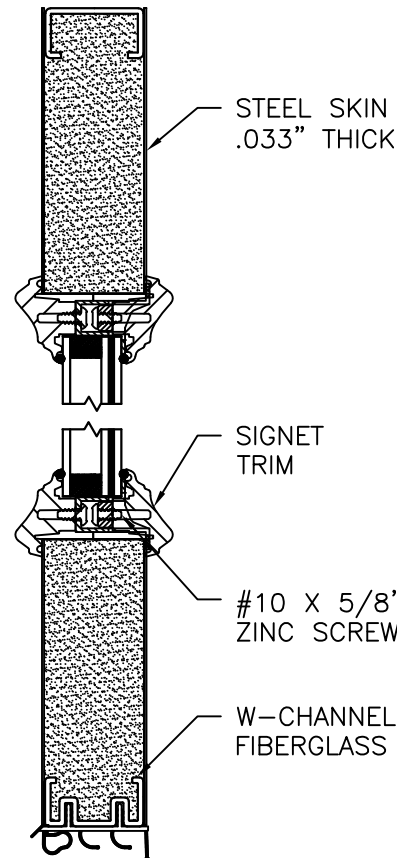


PANEL OPTION 5

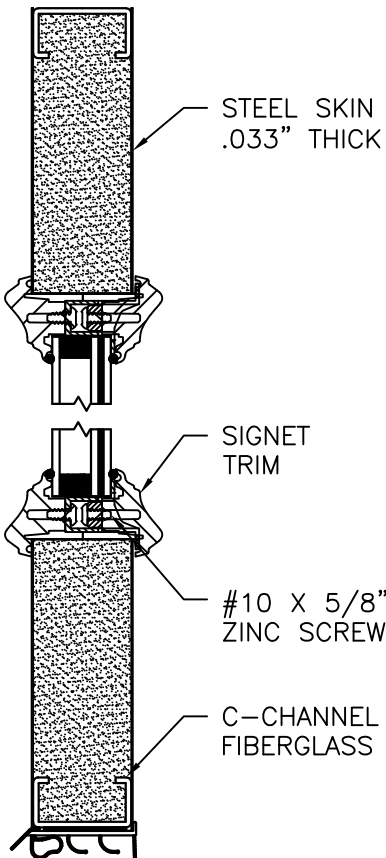

PANEL OPTION 6

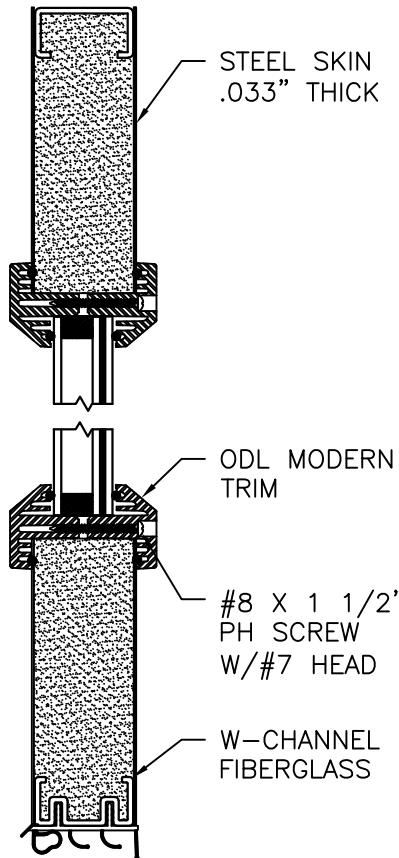


PANEL OPTION 7

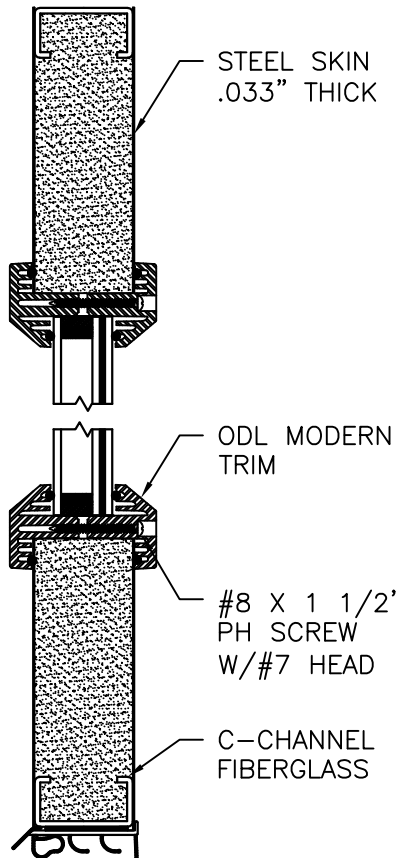

PANEL OPTION 8

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL INSWING GLAZED DOOR - SINGLE & DOUBLE IMPACT APPROVED SLABS		
DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 9 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		


SIGNED: 09/10/2026

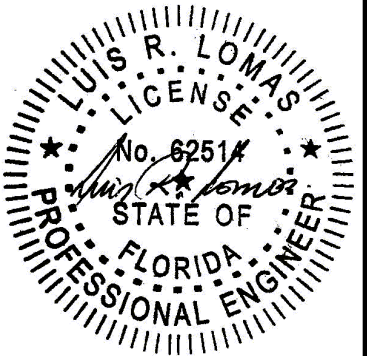


Luis R. Lomas P.E.
FL No.: 62514

APPROVED SLABS AND TRIMS


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

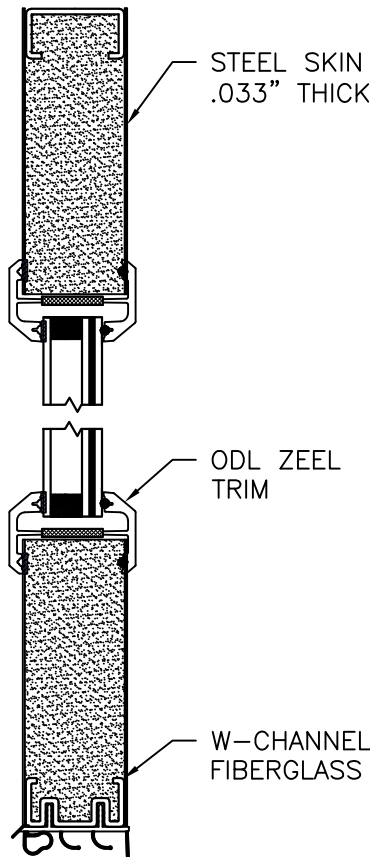


PANEL OPTION 11

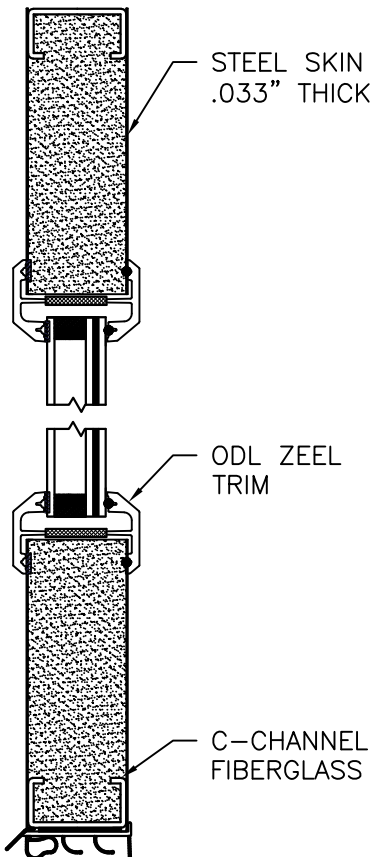


PANEL OPTION 12

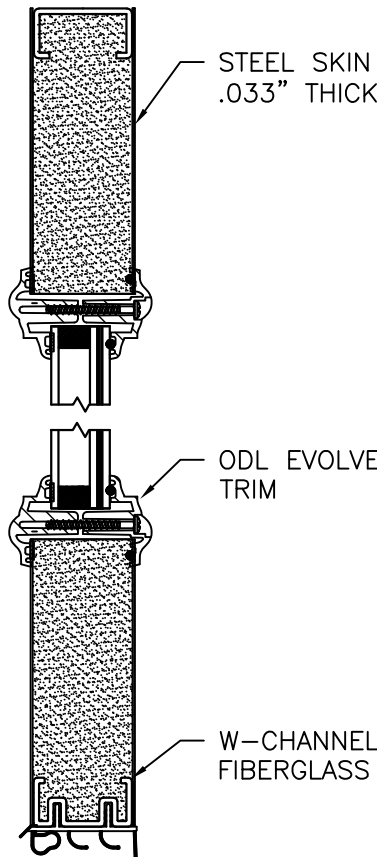


PANEL OPTION 13

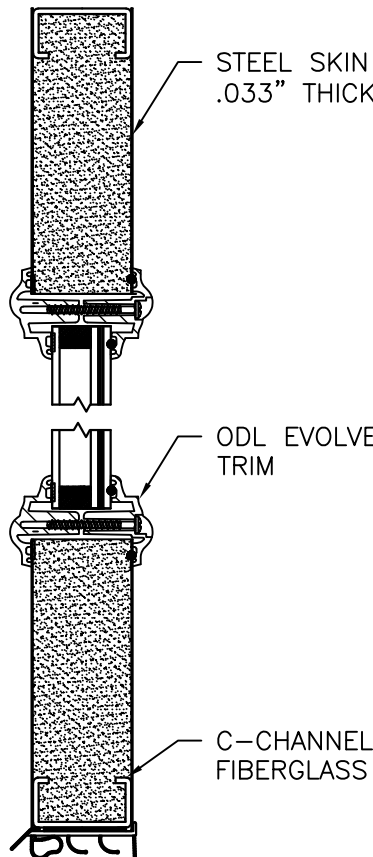


PANEL OPTION 14

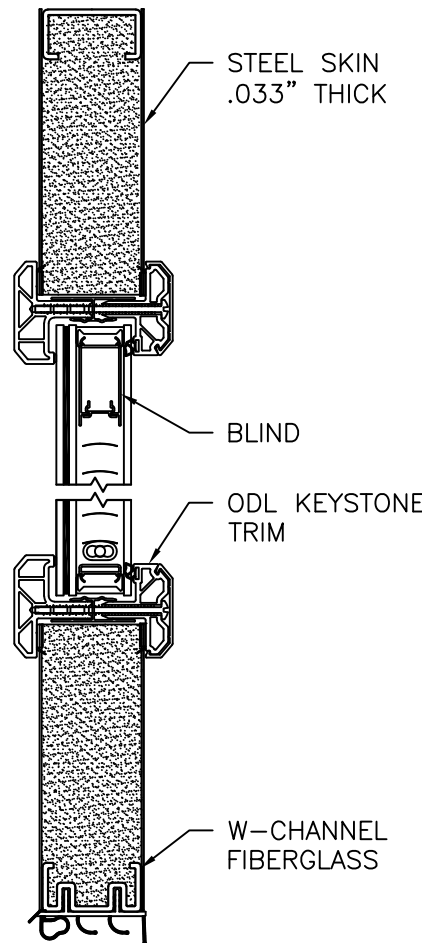


PANEL OPTION 15

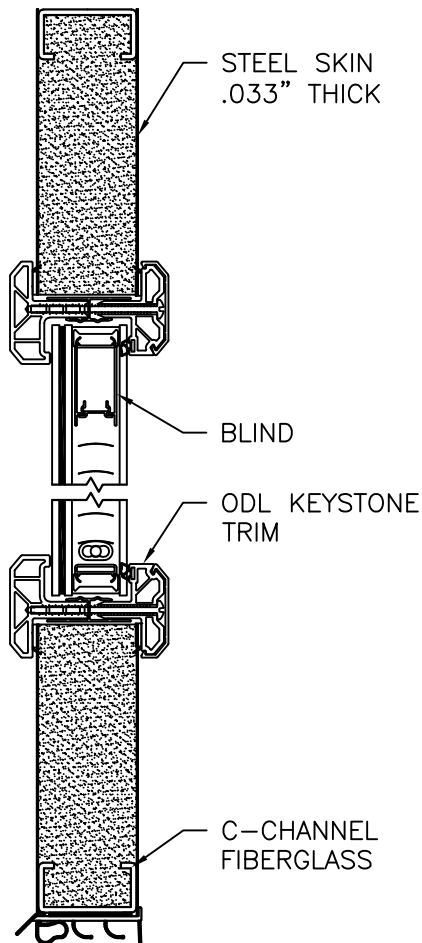

PANEL OPTION 16

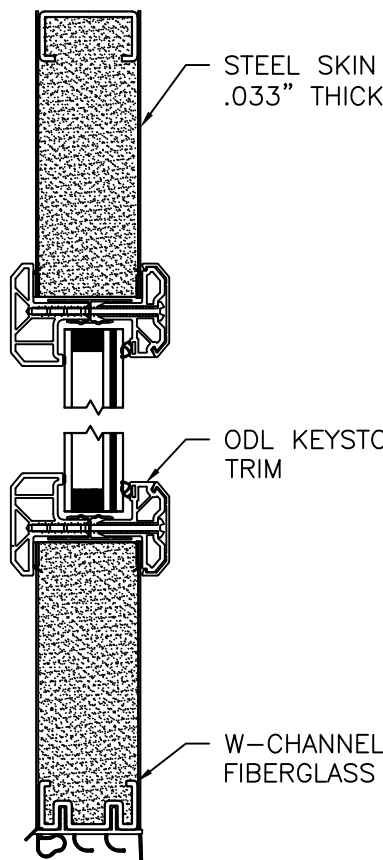


PANEL OPTION 17

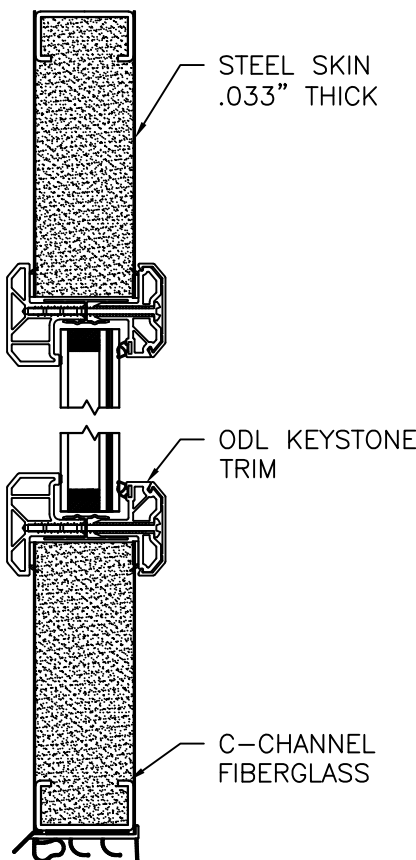


PANEL OPTION 18

SIGNED: 09/10/2026


PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL INSWING GLAZED DOOR - SINGLE & DOUBLE IMPACT APPROVED SLABS		
DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 10 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

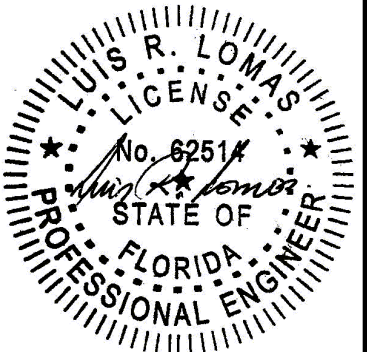


Luis R. Lomas P.E.
FL No.: 62514

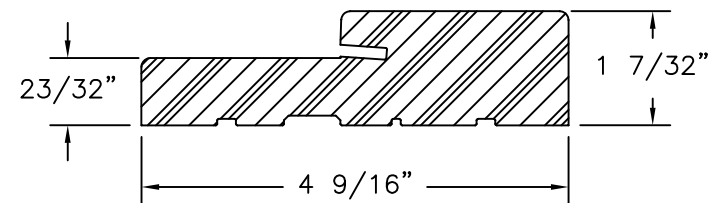


FRAMESAVER
COMPOSITE

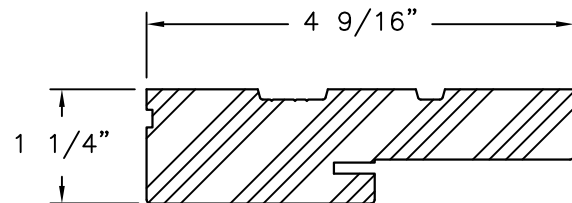


WOOD FRAME PROFILE

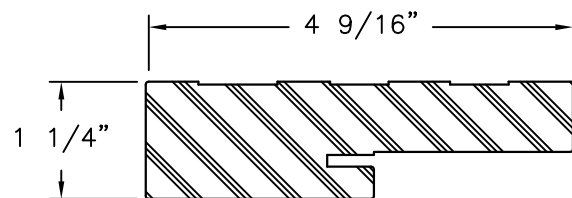


COMPOSITE FRAME PROFILE

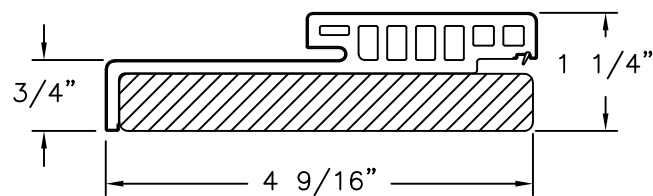


HYBRID HEAD
WOOD/COMPOSITE

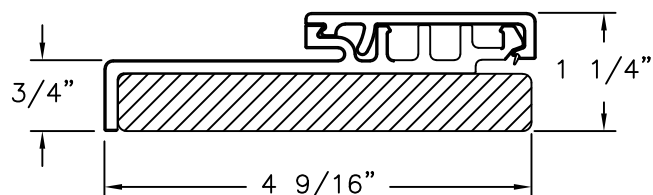


HYBRID JAMB
WOOD/COMPOSITE

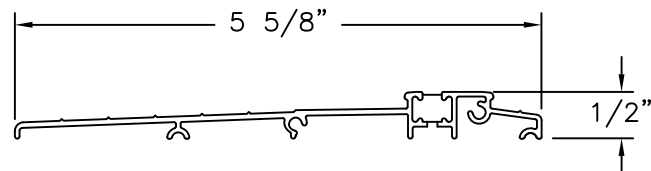


ADA THRESHOLD

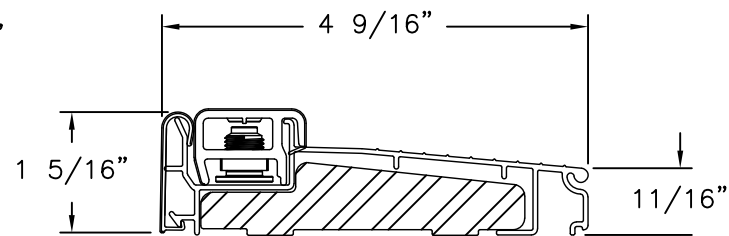


INSWING SILL ZAIL4565

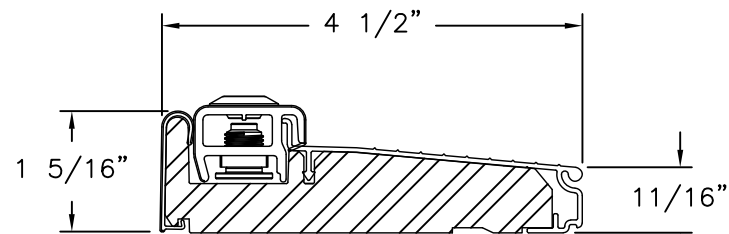


INSWING SILL ZAI4565F

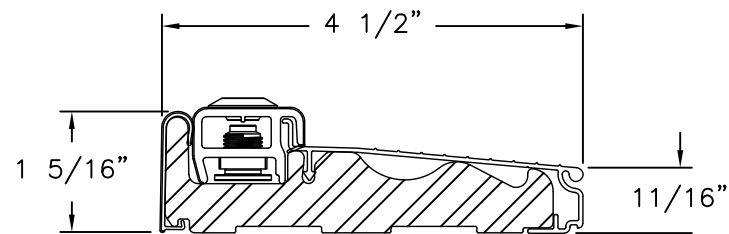


INSWING SILL ZAILH4565

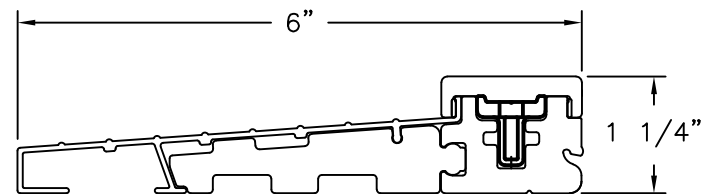


STANDARD INSWING THRESHOLD

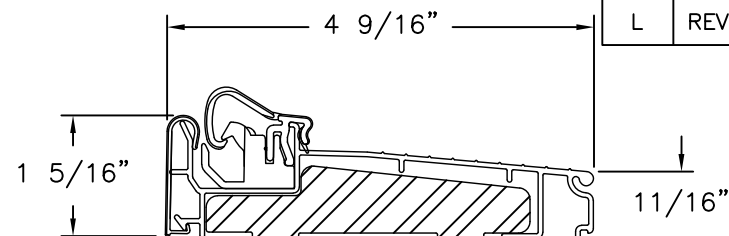


INSWING SILL ZACL4565

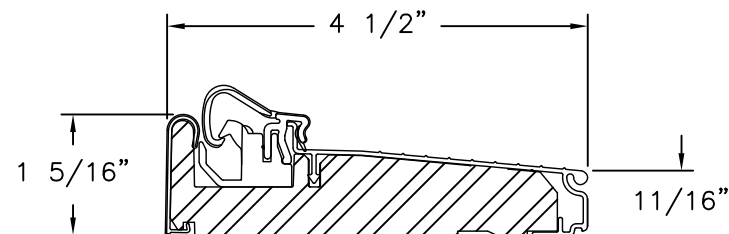

INSWING SILL ZAC4565F

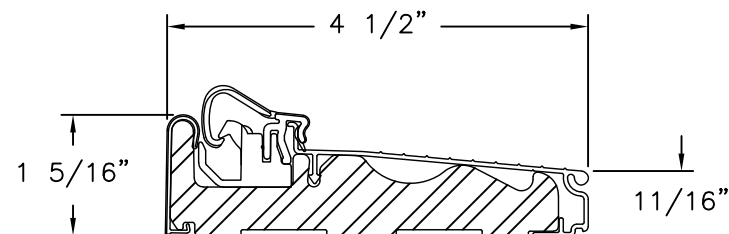

INSWING SILL ZACLH4565

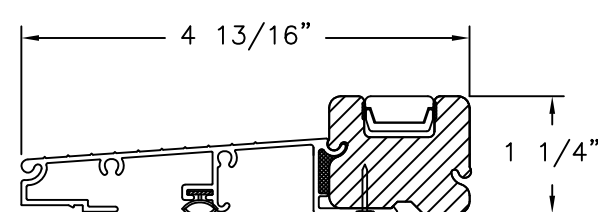


SAHARA INSWING THRESHOLD

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
L	REVISED HARDWARE SCHEDULE	09/10/26	R.L.

SIGNED: 09/10/2026

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681		
STEEL INSWING GLAZED DOOR – SINGLE & DOUBLE IMPACT COMPONENTS		
DRAWN: V.L.	DWG NO. 08-01957	REV L
SCALE NTS	DATE 03/05/13	SHEET 11 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

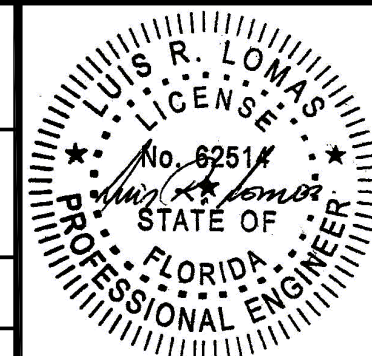

Luis R. Lomas P.E.
FL No.: 62514