

| REVISIONS |                      |            |          |
|-----------|----------------------|------------|----------|
| REV       | DESCRIPTION          | DATE       | APPROVED |
| B         | REVISED PER NEW CODE | 06/28/2021 | R.L.     |

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: WOOD AND COMPOSITE.
12. UNITS MUST BE GLAZED PER ASTM E1300.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING THROUGH BRICK MOULD INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1/2" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
  - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
  - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
  - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
  - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI 1/8" THICK MINIMUM

| TABLE OF CONTENTS |                      |
|-------------------|----------------------|
| SHEET NO.         | DESCRIPTION          |
| 1                 | NOTES                |
| 2                 | ELEVATIONS           |
| 3 - 6             | INSTALLATION DETAILS |
| 7                 | COMPONENTS           |


|                                                                                                      |                     |              |
|------------------------------------------------------------------------------------------------------|---------------------|--------------|
| TUCKER DOOR & TRIM CORPORATION                                                                       |                     |              |
| 650 HIGHWAY 83<br>MONROE, GA 30655                                                                   |                     |              |
| 2200 DOUBLE HUNG WINDOW 44" X 78"<br>NON-IMPACT<br>NOTES                                             |                     |              |
| DRAWN:<br>V.L.                                                                                       | DWG NO.<br>08-02027 | REV<br>B     |
| SCALE NTS                                                                                            | DATE 06/04/13       | SHEET 1 OF 7 |
| L. ROBERTO LOMAS P.E.<br>1432 WOODFORD RD LEWISVILLE, NC 27023<br>434-688-0609 rllomas@lrlomaspe.com |                     |              |

SIGNED: 06/29/2021




Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                      |            |          |
|-----------|----------------------|------------|----------|
| REV       | DESCRIPTION          | DATE       | APPROVED |
| B         | REVISED PER NEW CODE | 06/28/2021 | R.L.     |

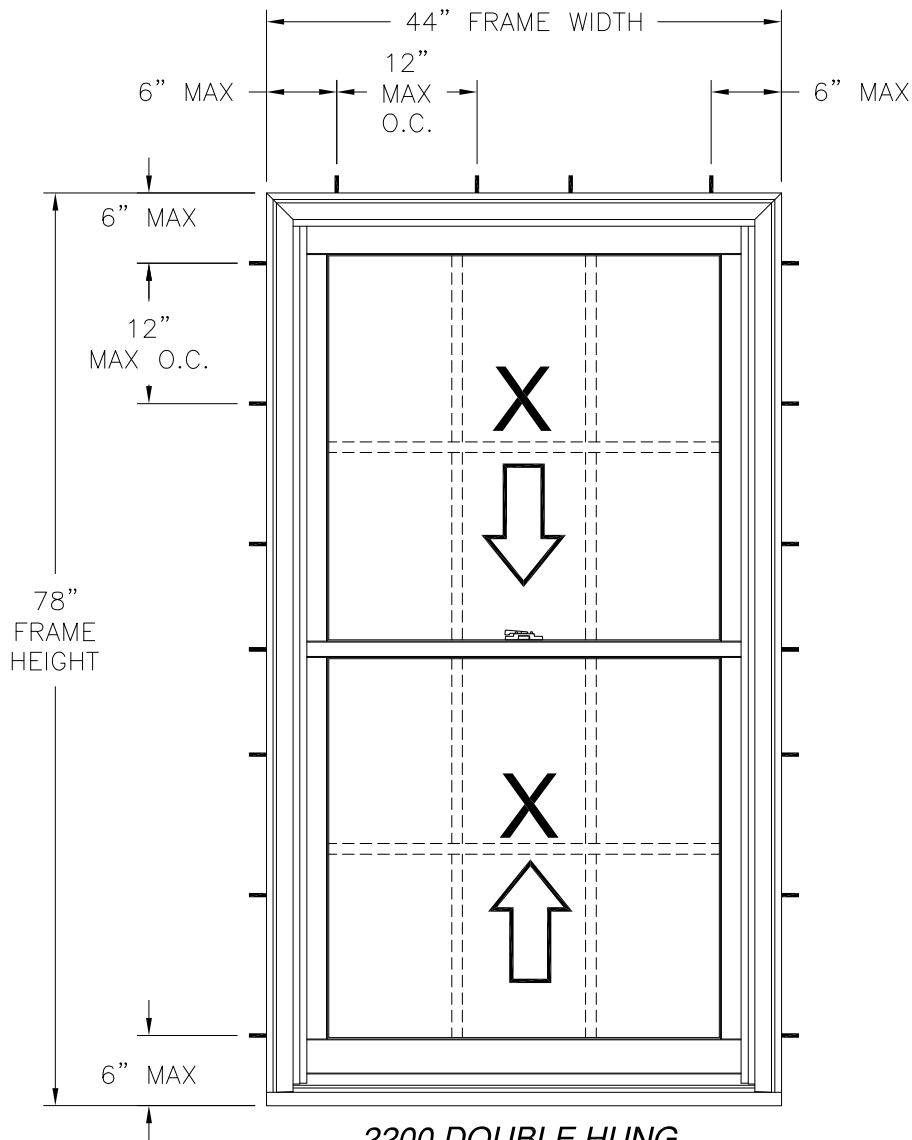

**2200 DOUBLE HUNG**  
EXTERIOR VIEW  
FRAME INSTALLATION

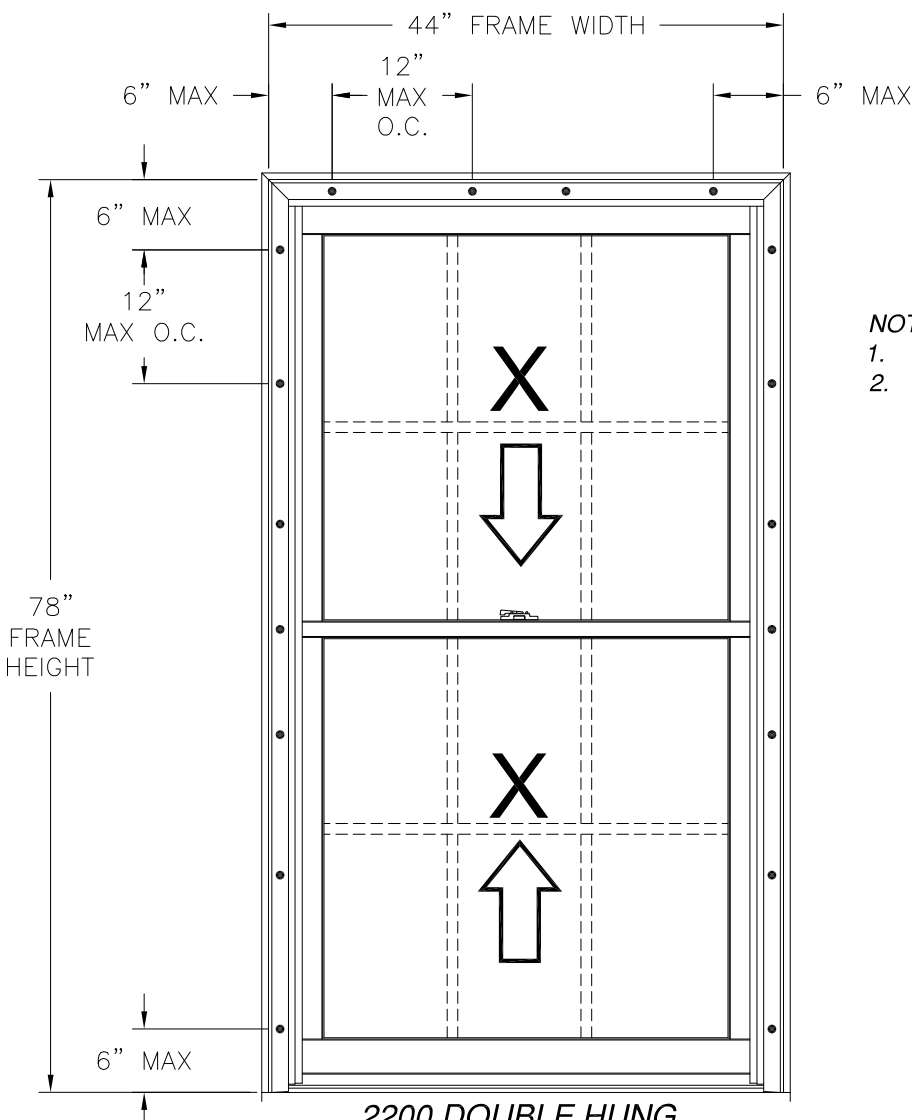

**2200 DOUBLE HUNG**  
EXTERIOR VIEW  
BRICK MOULD INSTALLATION

- NOTES:**
- SASH SIZE: 42 1/2" X 39 1/2"
  - D.L.O. SIZE: 38 9/16" X 35 3/8"

| DESIGN PRESSURE RATING | IMPACT RATING |
|------------------------|---------------|
| ±20.0PSF               | NONE          |

44" X 78" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS  
FRAME AREA DOES NOT EXCEED 23.83 FT<sup>2</sup>

| HARDWARE SCHEDULE |                                                                  |
|-------------------|------------------------------------------------------------------|
| A.                | (2) LOCK (2200-DH-25) ON LOWER SASH CHECK RAIL                   |
| B.                | (2) LOCK WITH KEEPER (2200-DH-26) ON THE UPPER SASH CHECK RAIL   |
| C.                | (2) PVC LT-100 BALANCES (2200-DH-12)                             |
| D.                | (2) ZINC PLATED TORX SHOULDER BOLT TILT PIN ( 2200-DH-23) AT SAH |

TUCKER DOOR & TRIM CORPORATION  
650 HIGHWAY 83  
MONROE, GA 30655

2200 DOUBLE HUNG WINDOW 44" X 78"  
NON-IMPACT  
ELEVATIONS

DRAWN:  
V.L.

DWG NO.  
08-02027

REV  
B


SCALE NTS

DATE 06/04/13


SHEET 2 OF 7

L. ROBERTO LOMAS P.E.  
1432 WOODFORD RD LEWISVILLE, NC 27023  
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 06/29/2021

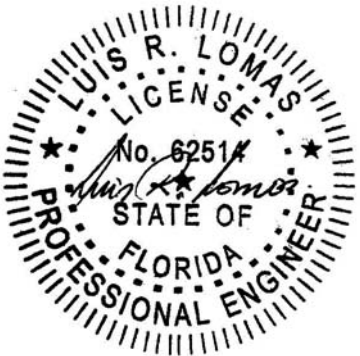


Luis R. Lomas P.E.  
FL No.: 62514

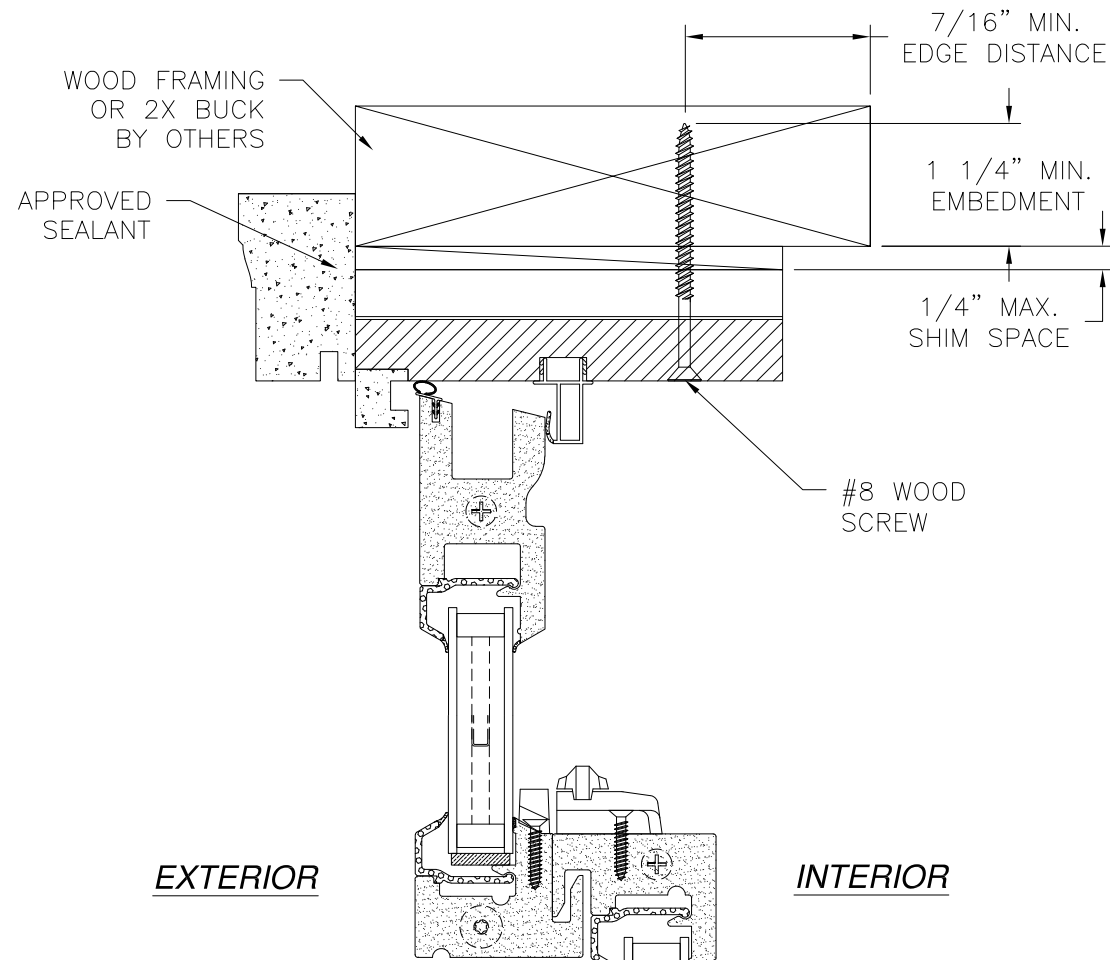


EXTERIOR

INTERIOR

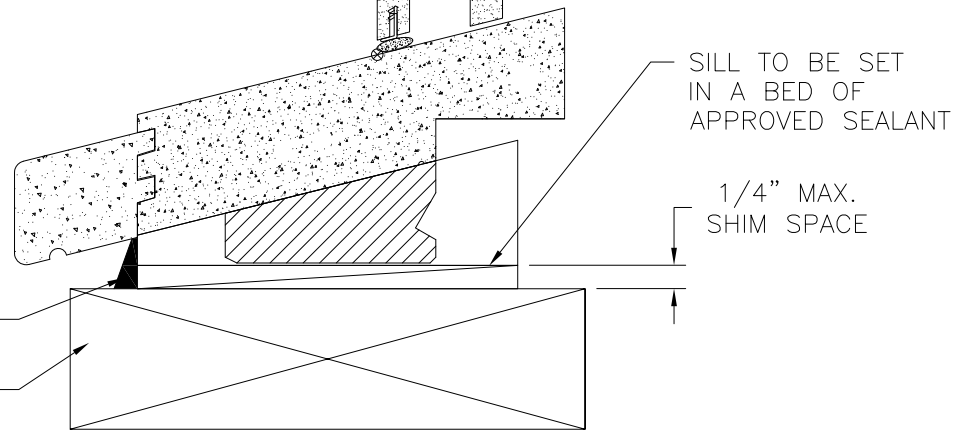

VERTICAL CROSS SECTION  
WOOD FRAMING OR 2X BUCK INSTALLATION

| REVISIONS |                      |            |          |
|-----------|----------------------|------------|----------|
| REV       | DESCRIPTION          | DATE       | APPROVED |
| B         | REVISED PER NEW CODE | 06/28/2021 | R.L.     |

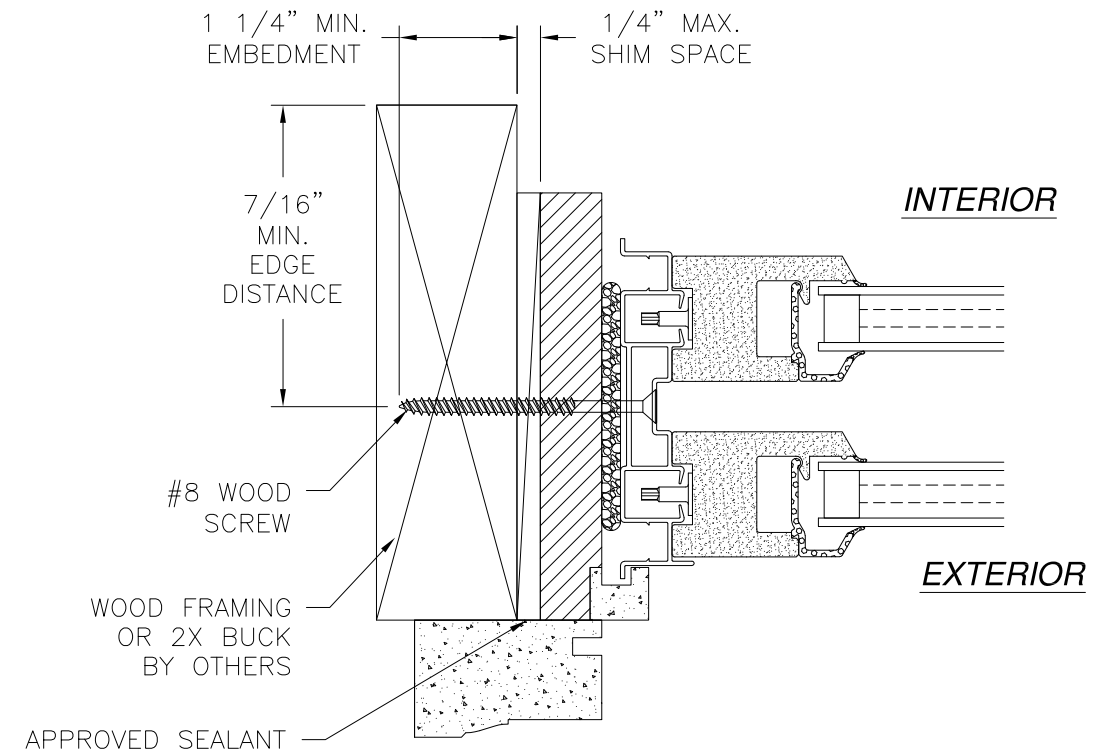


JAMB INSTALLATION DETAIL  
WOOD FRAMING OR 2X BUCK INSTALLATION


- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
  2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 06/29/2021


|                                                                                                      |                     |                 |
|------------------------------------------------------------------------------------------------------|---------------------|-----------------|
| TUCKER DOOR & TRIM CORPORATION<br>650 HIGHWAY 83<br>MONROE, GA 30655                                 |                     |                 |
| 2200 DOUBLE HUNG WINDOW 44" X 78"<br>NON-IMPACT<br>FRAME INSTALLATION DETAILS                        |                     |                 |
| DRAWN:<br>V.L.                                                                                       | DWG NO.<br>08-02027 | REV<br>B        |
| SCALE<br>NTS                                                                                         | DATE<br>06/04/13    | SHEET<br>3 OF 7 |
| L. ROBERTO LOMAS P.E.<br>1432 WOODFORD RD LEWISVILLE, NC 27023<br>434-688-0609 rllomas@lrlomaspe.com |                     |                 |

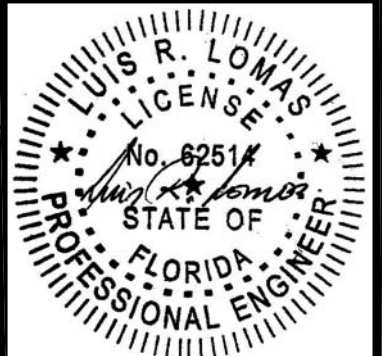

Luis R. Lomas P.E.  
FL No.: 62514

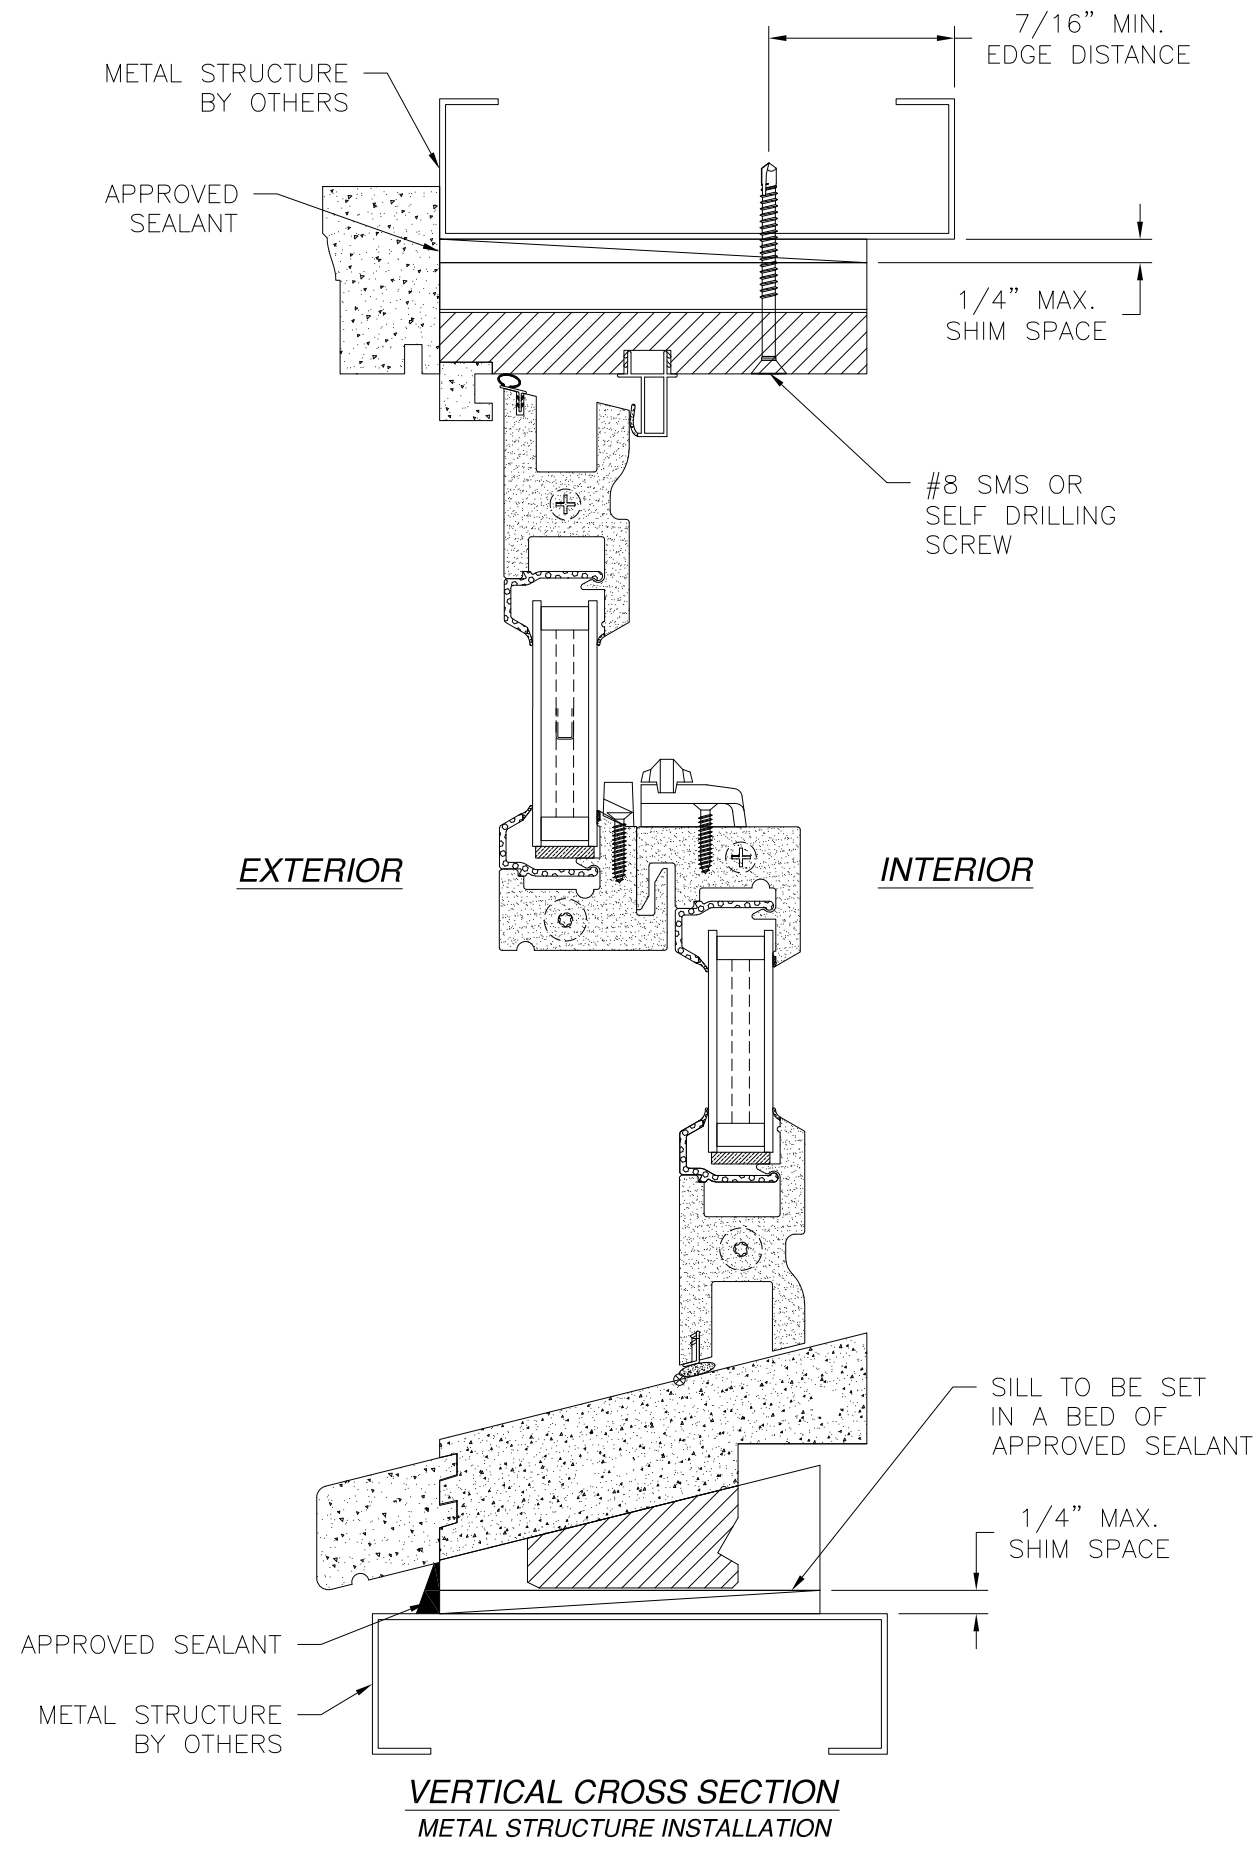

| REVISIONS |                      |            |          |
|-----------|----------------------|------------|----------|
| REV       | DESCRIPTION          | DATE       | APPROVED |
| B         | REVISED PER NEW CODE | 06/28/2021 | R.L.     |

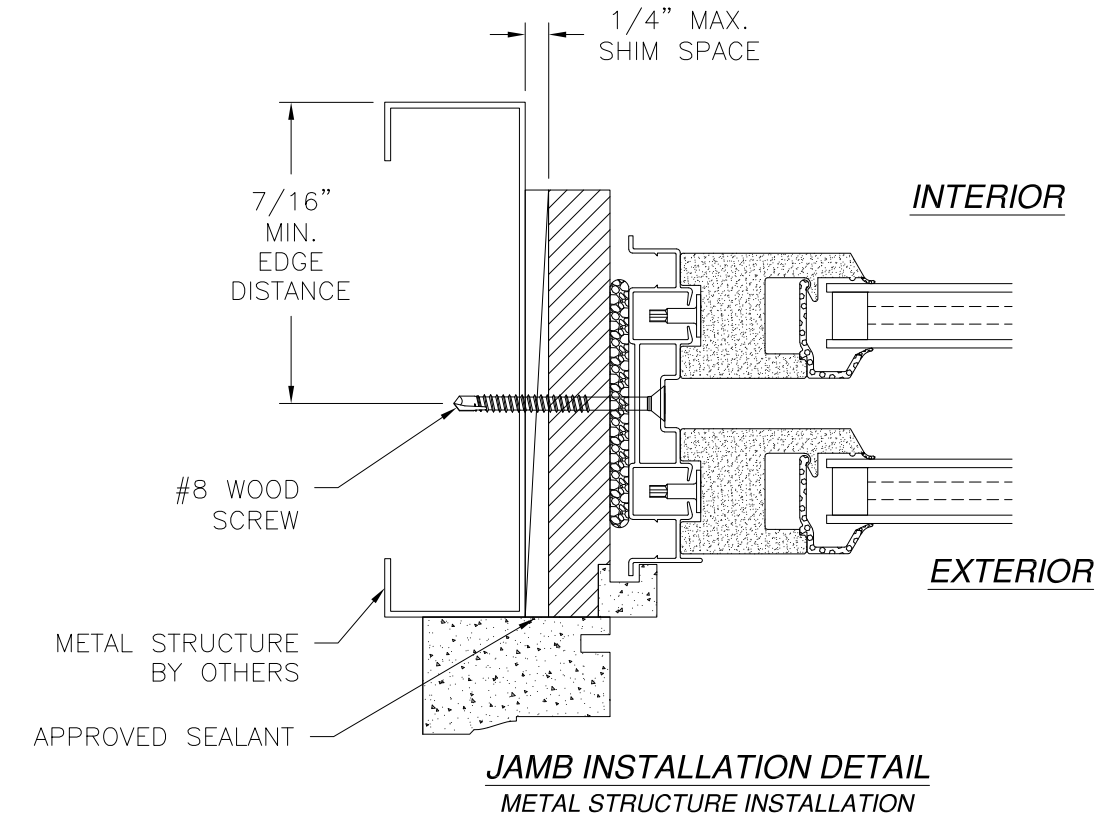

NOTES:  
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.  
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 06/29/2021

TUCKER DOOR & TRIM CORPORATION  
650 HIGHWAY 83  
MONROE, GA 30655



2200 DOUBLE HUNG WINDOW 44" X 78"  
NON-IMPACT  
FRAME INSTALLATION DETAILS

|                |                     |                 |
|----------------|---------------------|-----------------|
| DRAWN:<br>V.L. | DWG NO.<br>08-02027 | REV<br>B        |
| SCALE<br>NTS   | DATE<br>06/04/13    | SHEET<br>4 OF 7 |

L. ROBERTO LOMAS P.E.  
1432 WOODFORD RD LEWISVILLE, NC 27023  
434-688-0609 rllomas@lrlomaspe.com

Luis R. Lomas P.E.  
FL No.: 62514

| REVISIONS |                      |            |          |
|-----------|----------------------|------------|----------|
| REV       | DESCRIPTION          | DATE       | APPROVED |
| B         | REVISED PER NEW CODE | 06/28/2021 | R.L.     |

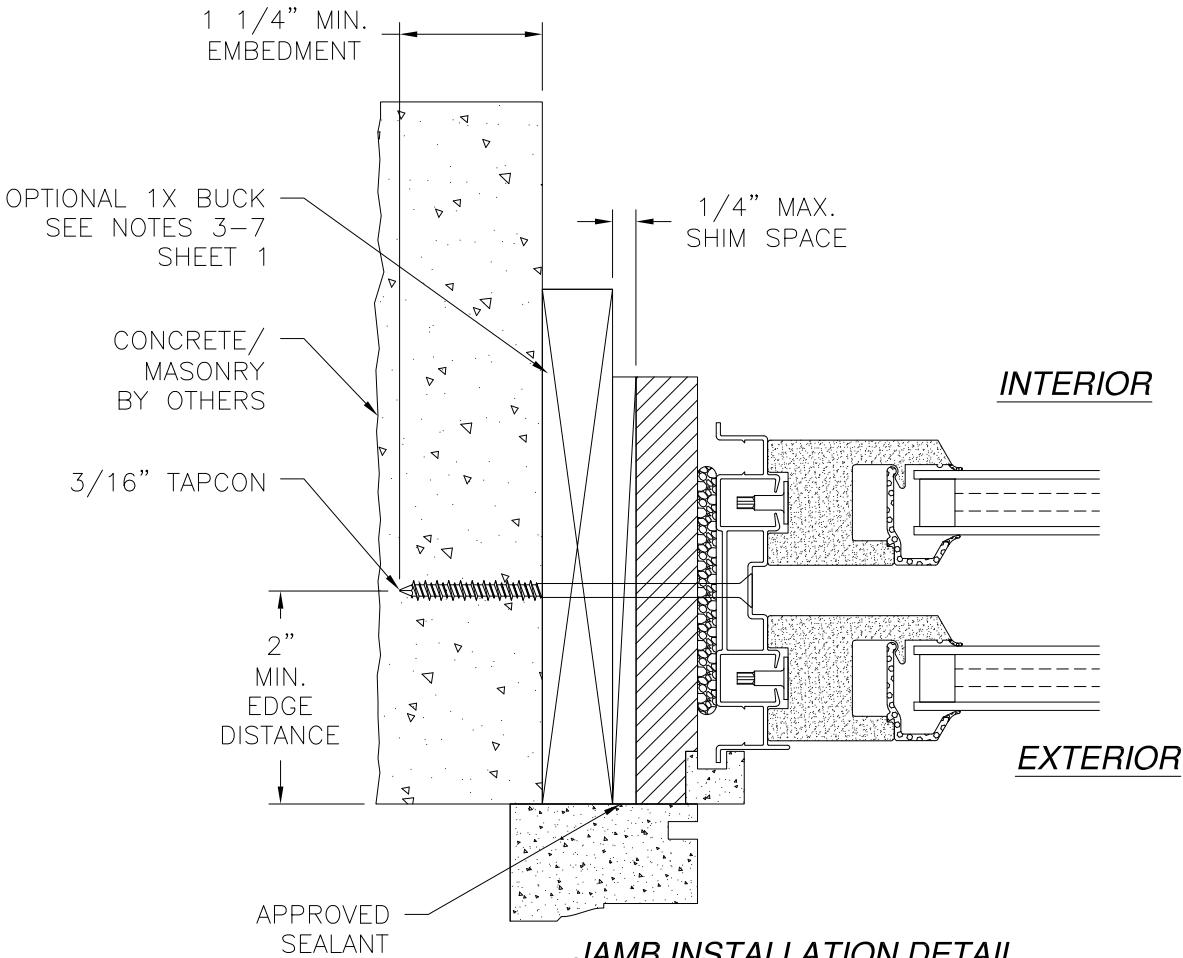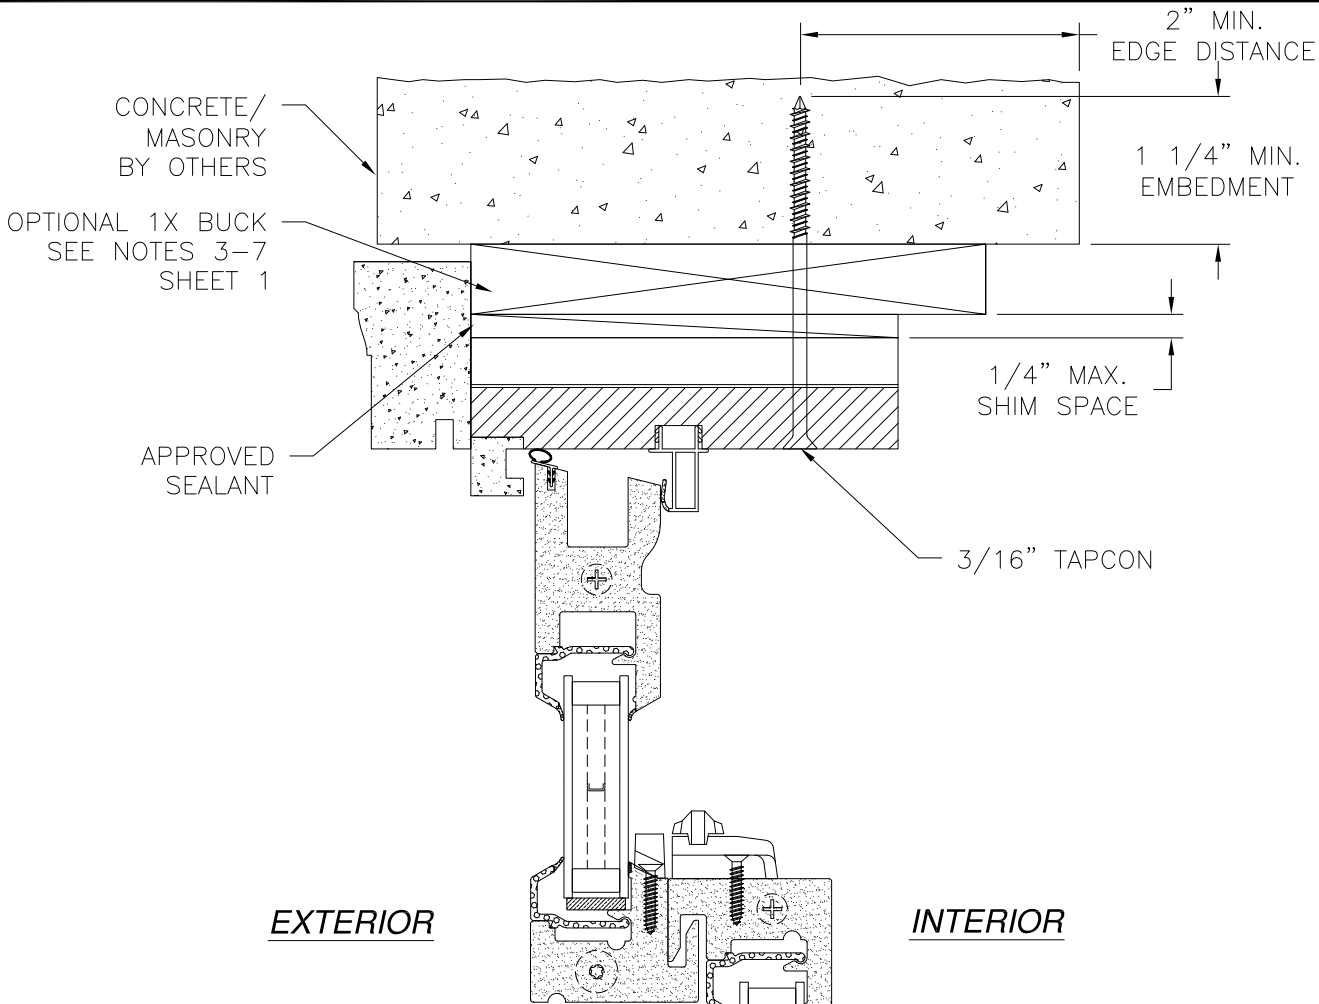

**JAMB INSTALLATION DETAIL**  
CONCRETE/MASONRY INSTALLATION

- NOTES:**
- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
  - 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

TUCKER DOOR & TRIM CORPORATION  
650 HIGHWAY 83  
MONROE, GA 30655

2200 DOUBLE HUNG WINDOW 44" X 78"  
NON-IMPACT  
FRAME INSTALLATION DETAILS


|                |                     |                 |
|----------------|---------------------|-----------------|
| DRAWN:<br>V.L. | DWG NO.<br>08-02027 | REV<br>B        |
| SCALE<br>NTS   | DATE<br>06/04/13    | SHEET<br>5 OF 7 |

L. ROBERTO LOMAS P.E.  
1432 WOODFORD RD LEWISVILLE, NC 27023  
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 06/29/2021



Luis R. Lomas P.E.  
FL No.: 62514

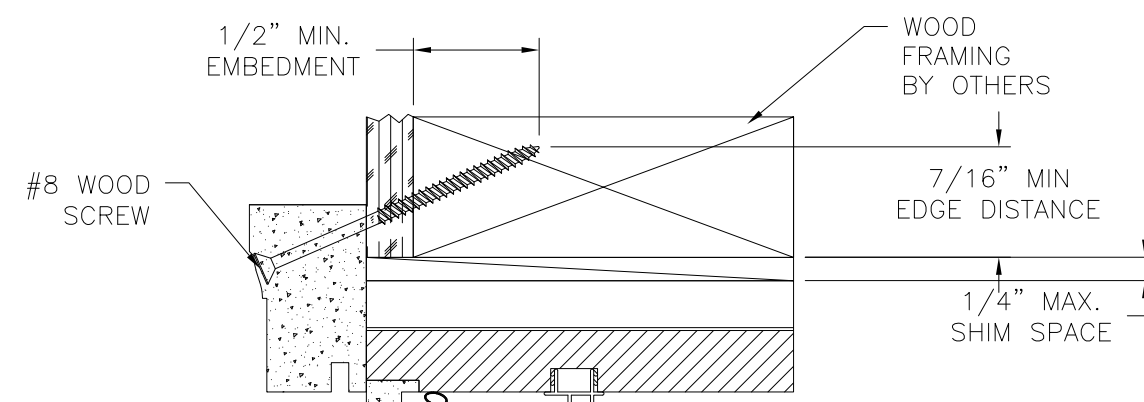


EXTERIOR INTERIOR

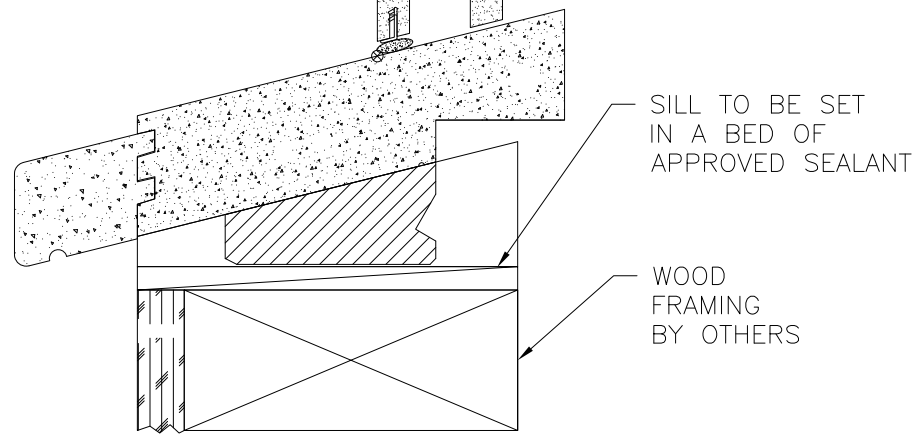

VERTICAL CROSS SECTION  
WOOD FRAMING OR 2X BUCK INSTALLATION

| REVISIONS |                      |            |          |
|-----------|----------------------|------------|----------|
| REV       | DESCRIPTION          | DATE       | APPROVED |
| B         | REVISED PER NEW CODE | 06/28/2021 | R.L.     |

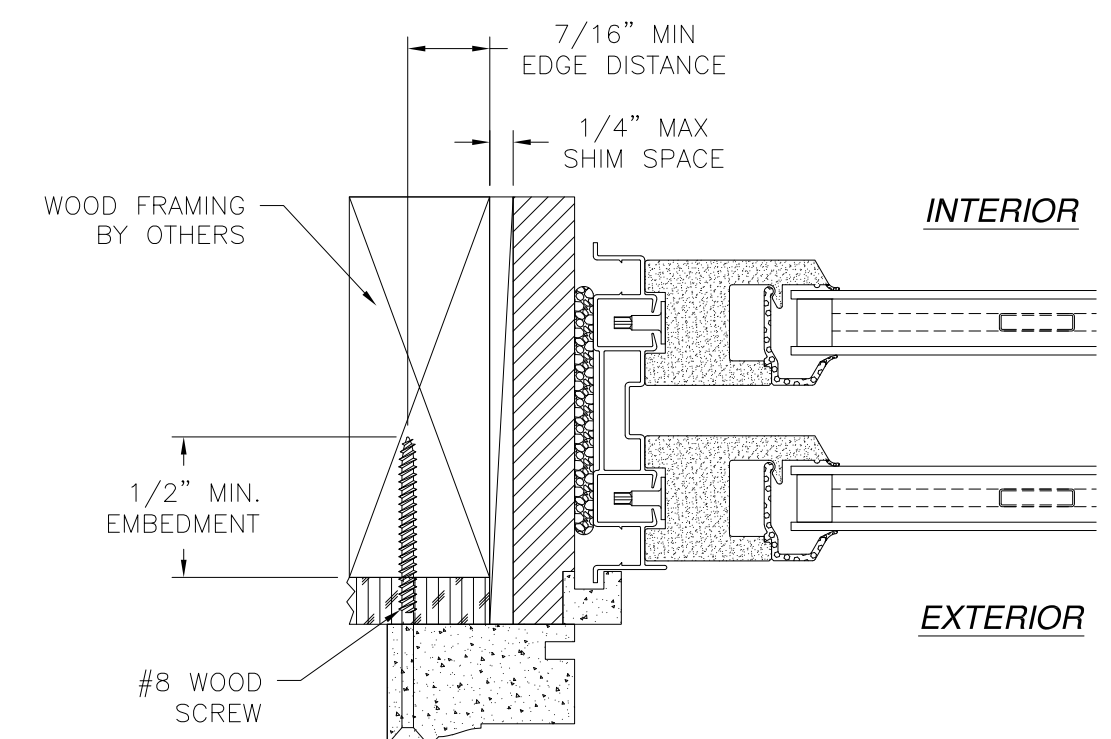

INTERIOR

EXTERIOR

JAMB INSTALLATION DETAIL  
WOOD FRAMING OR 2X BUCK INSTALLATION


- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
  2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 06/29/2021


|                                                                                                      |                     |                 |
|------------------------------------------------------------------------------------------------------|---------------------|-----------------|
| TUCKER DOOR & TRIM CORPORATION                                                                       |                     |                 |
| 650 HIGHWAY 83<br>MONROE, GA 30655                                                                   |                     |                 |
| 2200 DOUBLE HUNG WINDOW 44" X 78"<br>NON-IMPACT<br>BRICK MOULD INSTALLATION DETAILS                  |                     |                 |
| DRAWN:<br>V.L.                                                                                       | DWG NO.<br>08-02027 | REV<br>B        |
| SCALE<br>NTS                                                                                         | DATE<br>06/04/13    | SHEET<br>6 OF 7 |
| L. ROBERTO LOMAS P.E.<br>1432 WOODFORD RD LEWISVILLE, NC 27023<br>434-688-0609 rllomas@lrlomaspe.com |                     |                 |

Professional Engineer Seal for Luis R. Lomas, State of Florida, License No. 62514.


| REVISIONS |                      |            |          |
|-----------|----------------------|------------|----------|
| REV       | DESCRIPTION          | DATE       | APPROVED |
| B         | REVISED PER NEW CODE | 06/28/2021 | R.L.     |

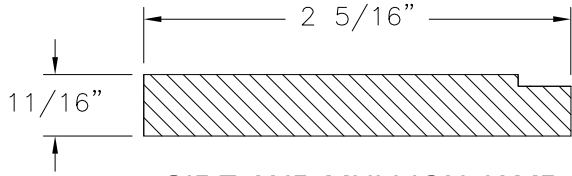


**SIDE AND MULLION JAMB**  
WOOD (2200-DH-06)

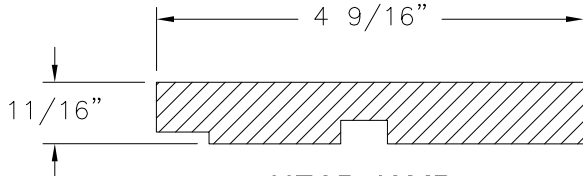


**HEAD JAMB**  
WOOD (2200-DH-07)

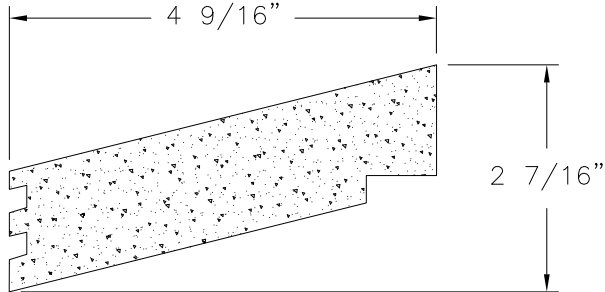


**WINDOW SILL**  
COMPOSITE (2200-DH-04)

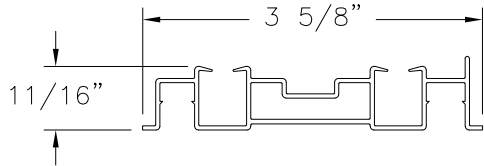


**STANDARD LT-100 BALANCE**  
PVC (2200-DH-12)

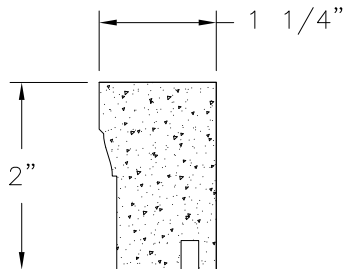


**BRICK MOULDING**  
COMPOSITE (2200-SS-12)

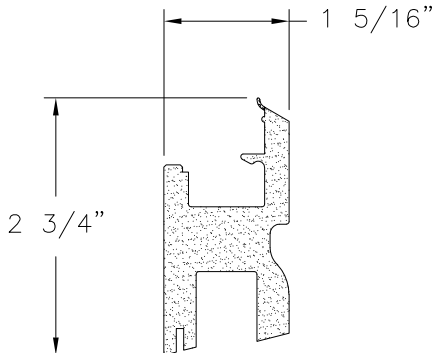


**MAIN SASH**  
CPVC (2200-DH-14)

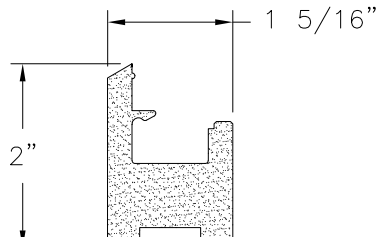


**SASH STILE**  
CPVC (2200-DH-17)

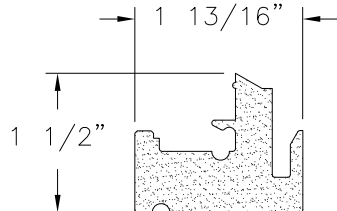


**TOP CHECK RAIL**  
CPVC (2200-DH-15)

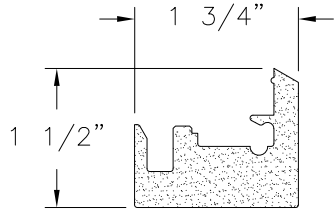


**BOTTOM CHECK RAIL**  
CPVC (2200-DH-16)

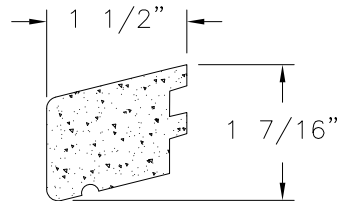


**WINDOW SILL NOSE**  
COMPOSITE (2200-DH-05)

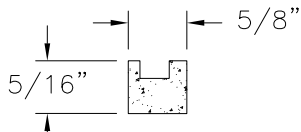

**BLIND STOP**  
COMPOSITE (2200-DH-08)

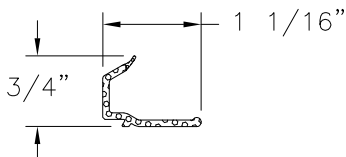

**GLAZING BEAD**  
CPVC (2200-DH-18)

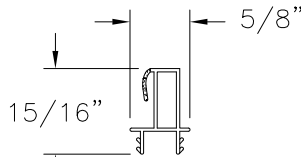

**PARTING STOP**  
PVC (2200-DH-13)

SIGNED: 06/29/2021

TUCKER DOOR & TRIM CORPORATION  
650 HIGHWAY 83  
MONROE, GA 30655

2200 DOUBLE HUNG WINDOW 44" X 78"  
NON-IMPACT  
COMPONENTS

DRAWN:  
V.L.

DWG NO.  
08-02027


REV  
B

SCALE  
NTS

DATE  
06/04/13

SHEET  
7 OF 7

L. ROBERTO LOMAS P.E.  
1432 WOODFORD RD LEWISVILLE, NC 27023  
434-688-0609 rllomas@lrlomaspe.com

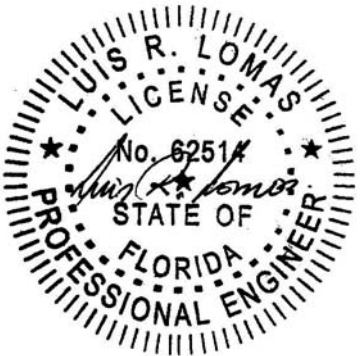

Luis R. Lomas P.E.  
FL No.: 62514