


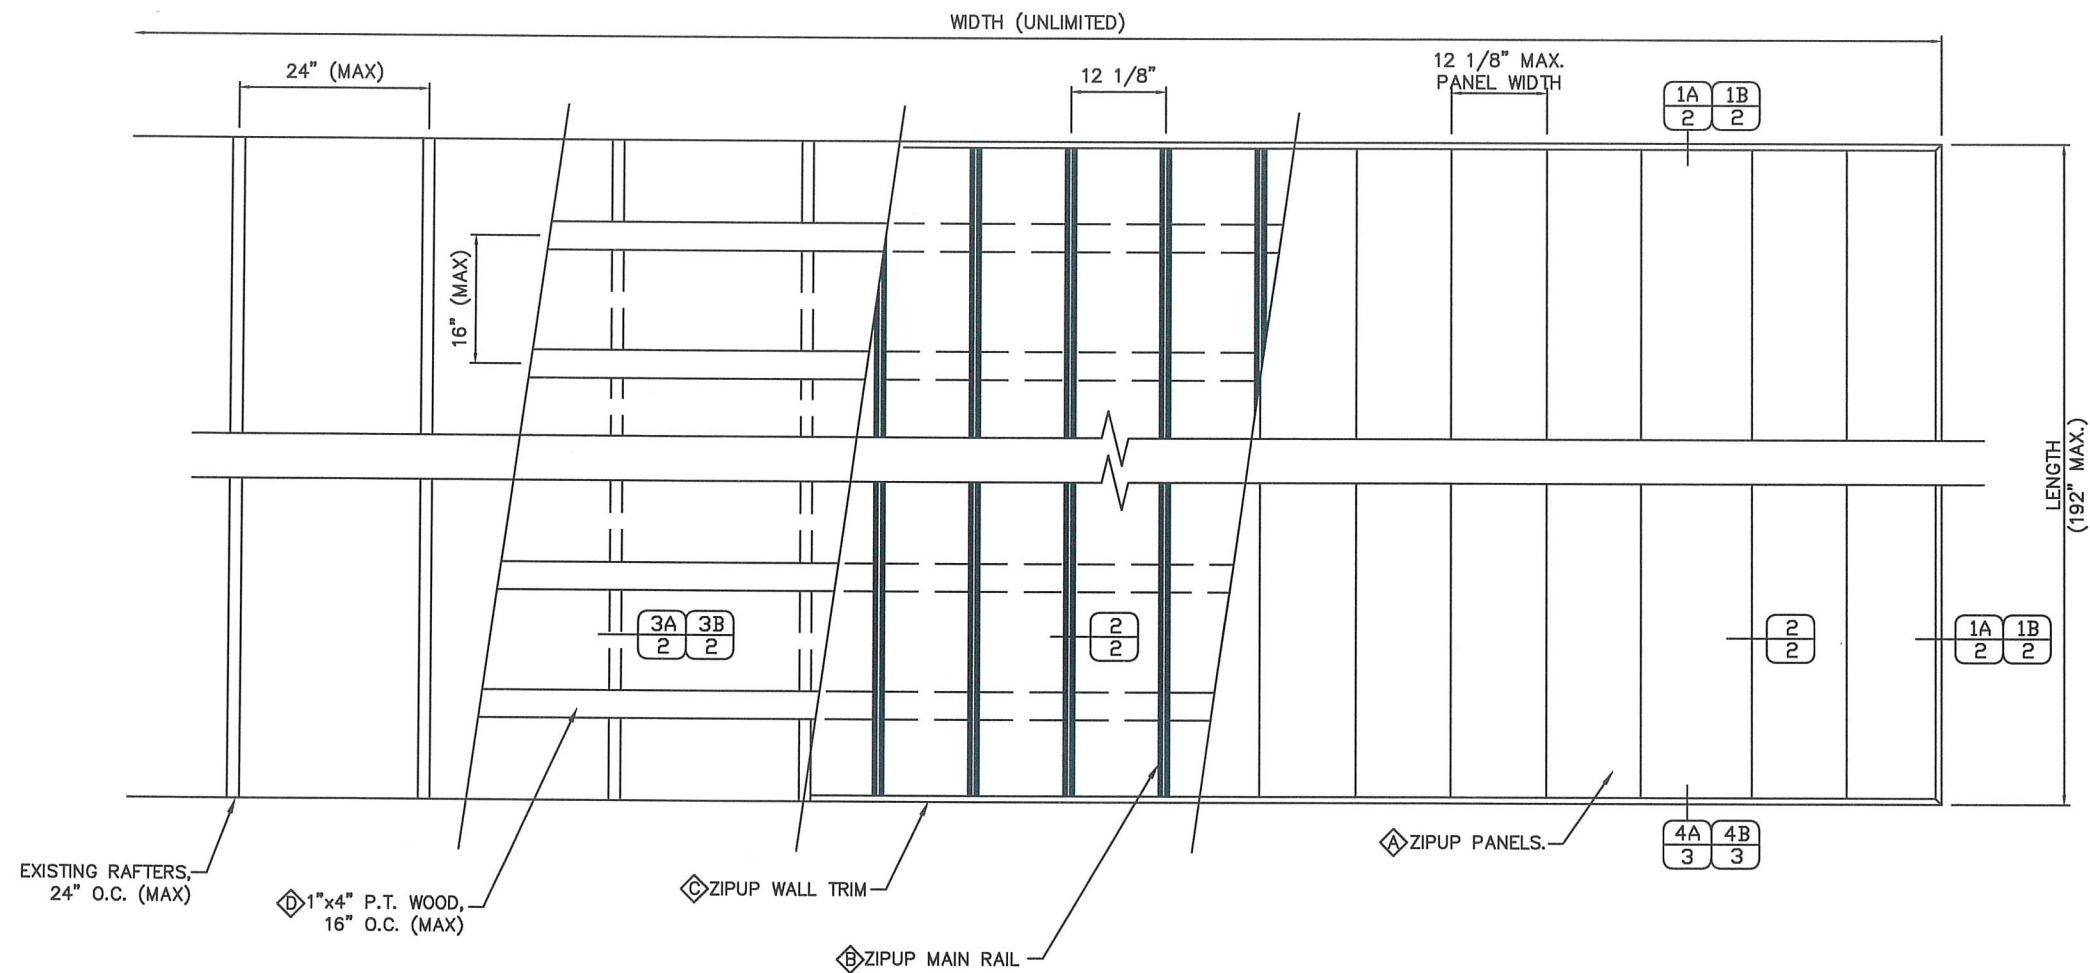


UNDERSIDE ELEVATION VIEW

DESIGN PRESSURE
+/- 29.12 PSF

GENERAL NOTES:


1. THIS SYSTEM HAS BEEN TESTED PER TAS 202 (STRUCTURAL ONLY) AND TAS 203. IT MEETS ALL OF THE REQUIREMENTS OF THE 8TH EDITION (2023) FLORIDA BUILDING CODE FOR USE OUTSIDE THE HVHZ IN SOFFITS, AWNINGS, AND CANOPIES WHICH ARE NOT A PART OF THE BUILDING ENVELOPE.
2. DESIGN LOADS MUST BE CALCULATED BY A PROFESSIONAL ENGINEER OR ARCHITECT FOR EACH PROJECT. THE PROJECT PRESSURE (ASD) CANNOT EXCEED THE DESIGN PRESSURE LISTED ABOVE.
3. INSTALLER SHALL VERIFY WITH ARCHITECT OR ENGINEER OF RECORD THE ADEQUACY OF THE EXISTING STRUCTURE TO RESIST SUPERIMPOSED LOADS.
4. ALL ANCHORS SECURING THE UNDER-DECKING SYSTEM TO PRESSURE TREATED WOOD SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE CHEMICALS IN THE WOOD.
5. MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, CHAPTER 20.
6. NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. Cd=1.6 WAS USED FOR WOOD SCREWS ONLY.




Digitally signed by
Scott Wolters
Date: 2025.12.10
00:21:04 -05'00'

ZIPUP UNDERDECK SYSTEM		MP GLOBAL PRODUCTS, LLC 34020 JAMES J POMPO FRASER, MI 48026	
www.zipupceiling.com PH: (888) 379-9695 FAX: (402) 379-9737			
2023 CODE UPDATE	12/10/25	REV. #	DATE
2020 CODE UPDATE	2/12/20		
2017 CODE UPDATE	6/17/19		
2014 CODE UPDATE	7/2/15		
1ST SUBMITTAL	8/19/13		
PRINTS ISSUED FOR			

DWG: ZIP1
SHEET: 1/3

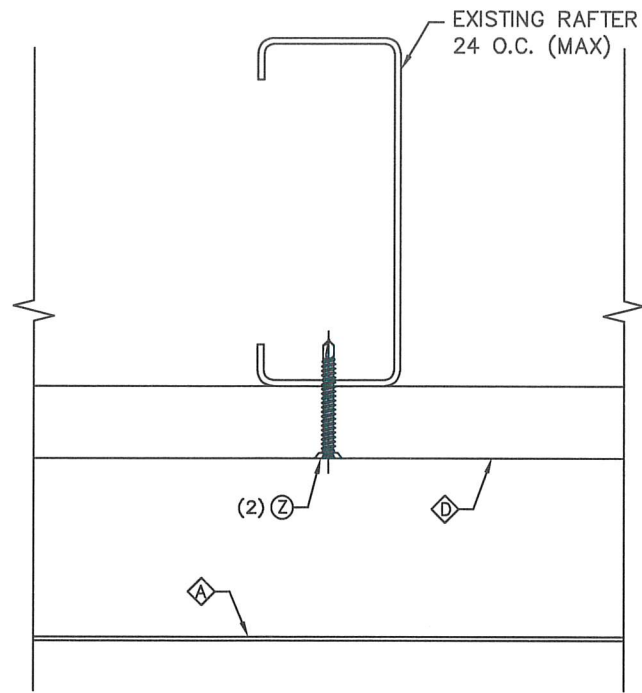


3B
2

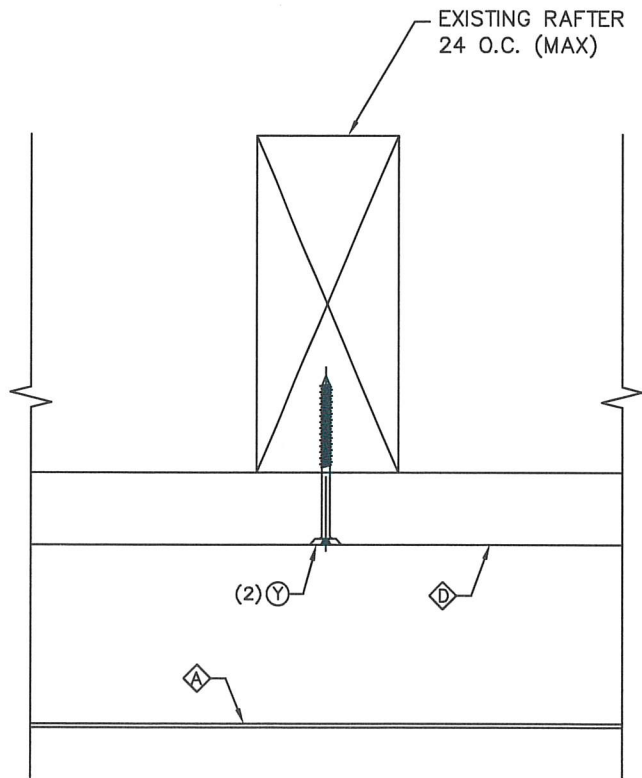


3A
2

ANCHOR REQUIREMENTS TABLE					
MARK	FASTENER TYPE	LOCATION	SPACING (MIN)	EMBEDMENT (MIN)	EDGE DISTANCE (MIN)
X	(2) 1/8" x 1 1/4" FH EXTERIOR GRADE DECK SCREWS	MAIN RAIL TO 1x P.T. WOOD PURLINS	7/8"	3/4"	3/4"
X	1/8" x 1 1/4" FH EXTERIOR GRADE DECK SCREW	WALL TRIM TO 1x P.T. WOOD PURLINS		3/4"	3/4"
Y	(2) 1/8" x 1 3/4" FH EXTERIOR GRADE DECK SCREW	1x P.T. WOOD PURLIN TO P.T. WOOD RAFTER (2x MIN.)	2"	1"	3/4"
Z	(2) #10 x 1 1/2" FH TEKS TYPE SELF DRILLING SCREW	1x P.T. WOOD PURLIN TO METAL STUD RAFTER (33 ksi-16 Ga. Min)	2"	FULL	1/2"

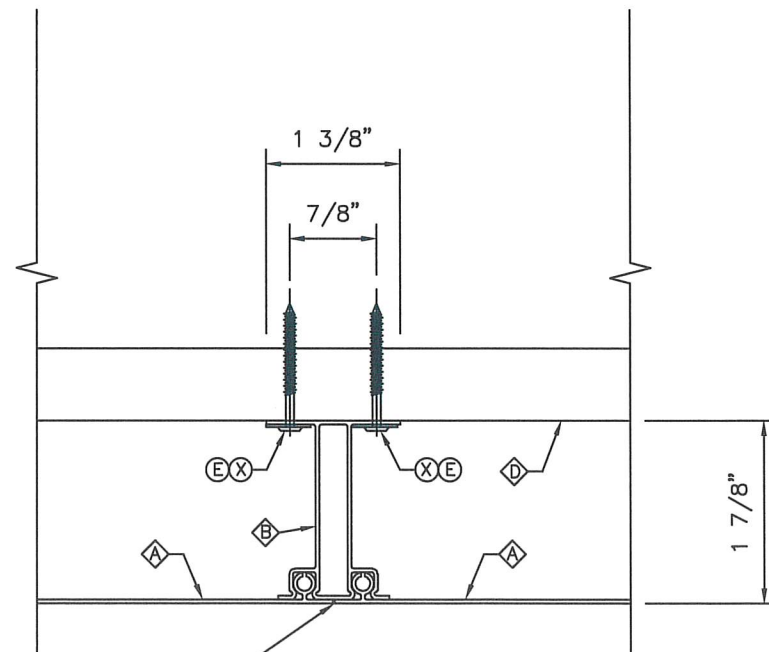


SEAL WITH DAP 100% SILICONE.

2
2

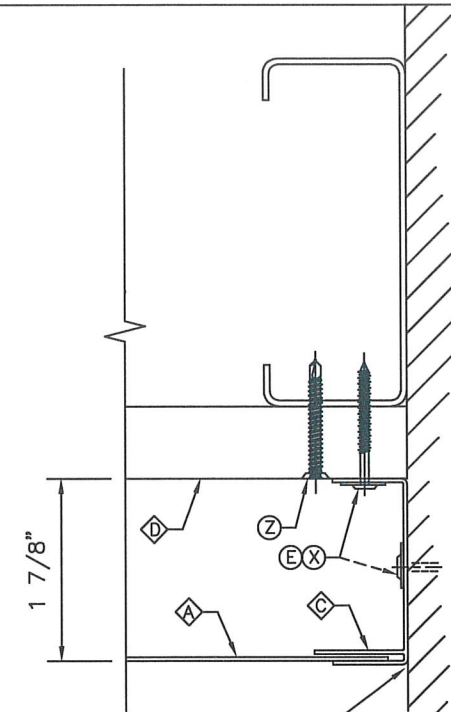

SEAL WITH DAP 100% SILICONE.

1B
2

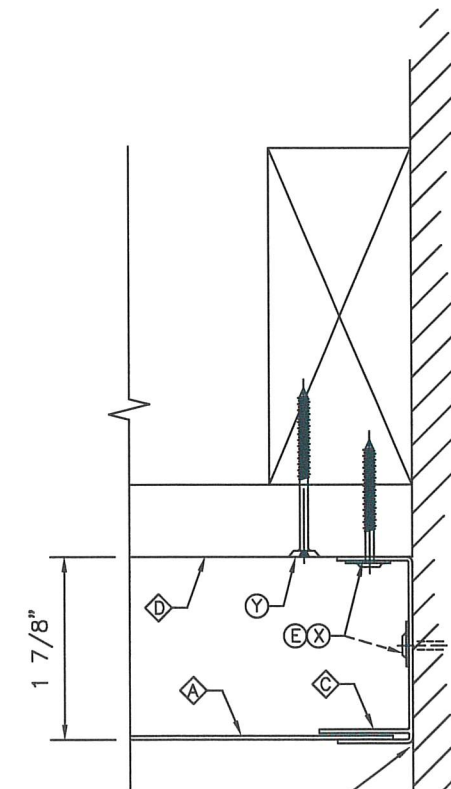

SEAL WITH DAP 100% SILICONE.

1A
2

WALL TRIM CAN BE ANCHORED TO EITHER THE RAFTER OR THE SIDE WALL.

WALL TRIM CAN BE ANCHORED TO EITHER THE RAFTER OR THE SIDE WALL.

ZIPUP UNDERDECK SYSTEM


www.zipupceiling.com
PH: (888) 379-9695
FAX: (402) 379-9737

EMP GLOBAL PRODUCTS, LLC
34020 JAMES J POMPO
FRASER, MI 48026



SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982


DWG: ZIP1
SHEET: 2/3

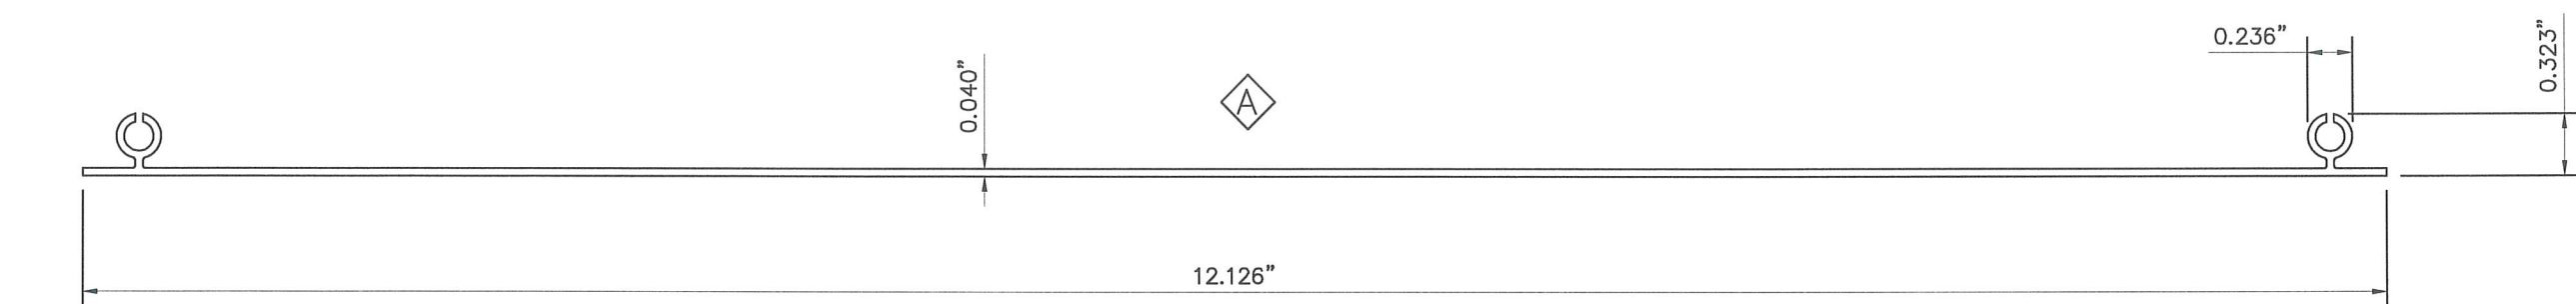

Technical drawing of a C-channel profile. The drawing shows the profile with the following dimensions:

- Overall height: 2.087"
- Overall width: 0.984"
- Flange width: 0.752"
- Web thickness: 0.040"
- Distance from top flange to centerline: 1.900"

A diamond symbol with the letter 'C' is located to the left of the profile, indicating the C-channel shape.

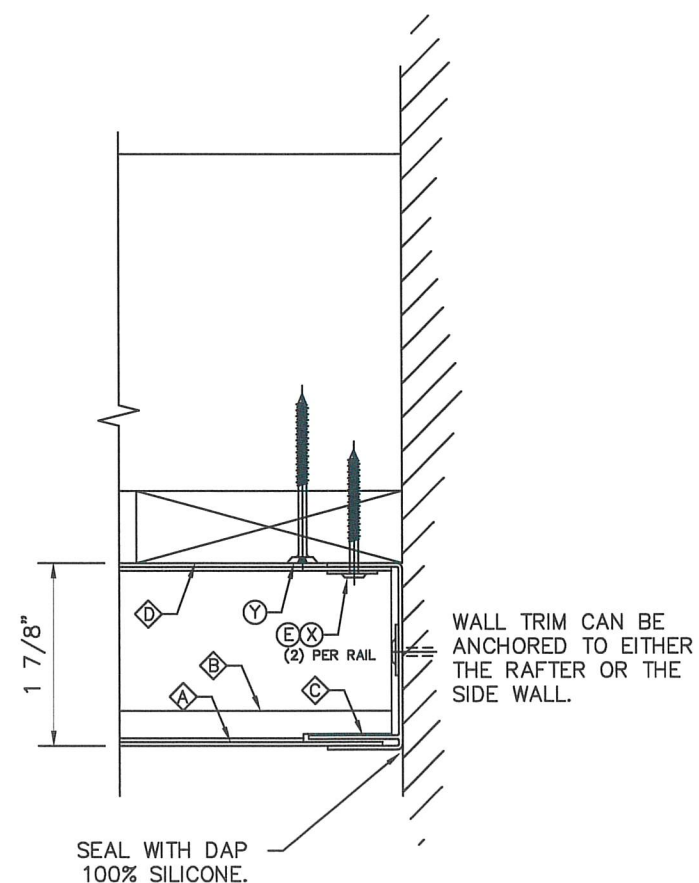
$$\frac{4A}{3}$$

ZIPUP UNDERDECK SYSTEM

www.zipupceiling.com
PH: (888) 379-9695
FAX: (402) 379-9737

MP GLOBAL PRODUCTS, LLC
34020 JAMES J POMPO
FRASER, MI 48026

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX:(561) 225-1982

DWG:	ZIP 1
SHEET:	3/3

1ST SUBMITTAL	REV #	DATE
	-	8/19/13
	-	-