

c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg 7/31/2026 9:50 AM

YKK AP AMERICA, Inc.

SERIES 50H ALUMINUM OUTSWING ENTRANCE DOOR

(HVHZ) (IMPACT)

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR INSTALLATION INTO WOOD FRAMING USE #14 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 1/4 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
7. FOR INSTALLATION THROUGH METAL FRAME USE 1/4 INCH DIAMETER SELF-TAPPING SCREW OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND METAL FRAME SUBSTRATE.
8. FOR INSTALLATION THROUGH ALUMINUM MULLION USE 1/4 INCH DIAMETER SELF-TAPPING SCREW OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND ALUMINUM FRAME SUBSTRATE.
9. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- 10.INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- 11.FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- 12.INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- 13.INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.

STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.

ALUMINUM - MINIMUM 1/16 INCH 6063-T5 ALUMINUM.

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

TAS 201-94

TAS 202-94

TAS 203-94

ASTM E330-14

ASTM E1886-19

ASTM E1996-23
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. DOOR FRAME MATERIAL: ALUMINUM 6063-T5
7. ALL STRUCTURAL MATERIALS & DISSIMILIAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
8. GLASS SHALL MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 14, 14.1, & 15 FOR GLAZING DETAILS.
9. DOOR CONFIGURATIONS MAY UTILIZE BUTT HINGES AS DESCRIBED HEREIN OR CONTINUOUS HINGES INTERCHANGEABLY.
10. ALLOWABLE CONFIGURATIONS: X (SINGLE DOOR) OR XX (DOUBLE DOOR) WITH OR WITHOUT TRANSOMS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATIONS 1
3	ELEVATIONS 2
3.1	ELEVATIONS 3
3.2	ELEVATIONS 4
4	ANCHOR LAYOUTS & QUALIFIED HINGE ASSEMBLIES
5	VERTICAL SECTIONS 1
6	VERTICAL SECTIONS 2
7	VERTICAL SECTIONS 3
8	HORIZONTAL SECTIONS 1
9	HORIZONTAL SECTIONS 2
10	HORIZONTAL/VERTICAL SECTIONS
11	SILL DETAIL WITH RAMP
12	CURTAINWALL INSTALLATION & DOOR CORNER DETAILS
13	FRAME CORNER DETAILS
14	GLAZING DETAILS 1
14.1	GLAZING DETAILS 1 CONTINUED
15	GLAZING DETAILS 2
16	COMPONENTS & BILL OF MATERIALS
17	COMPONENTS (1)
18	COMPONENTS (2)

DESIGN PRESSURE TABLE			
GLAZING TYPES	MAX. DOOR D.L.O. SIZE	MAX. DP	IMPACT RATING
A, B, C	36.19" X 82.38"	+90/-90 PSF	LMI & SMI
A1, B1, C1	35.81" X 81.31"	+90/-90 PSF	LMI & SMI
C, C1	30.19" X 100.38"	+90/-90 PSF	LMI & SMI
B1, C1	32.44" X 106.81"	+75/-75 PSF	LMI
D, E	30.19" X 82.38"	+60/-60 PSF	LMI & SMI
D1, E1	29.81" X 81.31"	+50/-50 PSF	LMI & SMI
K, L, M	36.19" X 82.38"	+90/-90 PSF	SMI
K1, L1	35.81" X 81.31"	+90/-90 PSF	SMI

NOTE:

LMI - LARGE MISSILE IMPACT RATED

SMI - SMALL MISSILE IMPACT RATED

SEE SHEETS 14, 14.1, & 15 FOR GLAZING DETAILS

SEE SHEETS 2, 3, 3.1, 3.2, AND 4 FOR LIMITATIONS ON DESIGN PRESSURE BASED ON SIZE AND LOCKING HARDWARE

YKK

ap

Quality
inspires™

YKK AP America Inc.

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)

INSTALLATION &
GENERAL NOTES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BD

BUILDING DROPS

REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.14 09:21:02 -04'00'

HERMES F. NORERO

LICENSE

No. 73778

STATE OF FLORIDA

PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL16554

DATE:

09.14.18

DWG. BY:

HR

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

YKK021


SHEET:

1

REV.

D

c:\users\sebastianherrerros\desktop\ykk\2026 ca\116554\ykk021.dwg 7/31/2026 9:50 AM

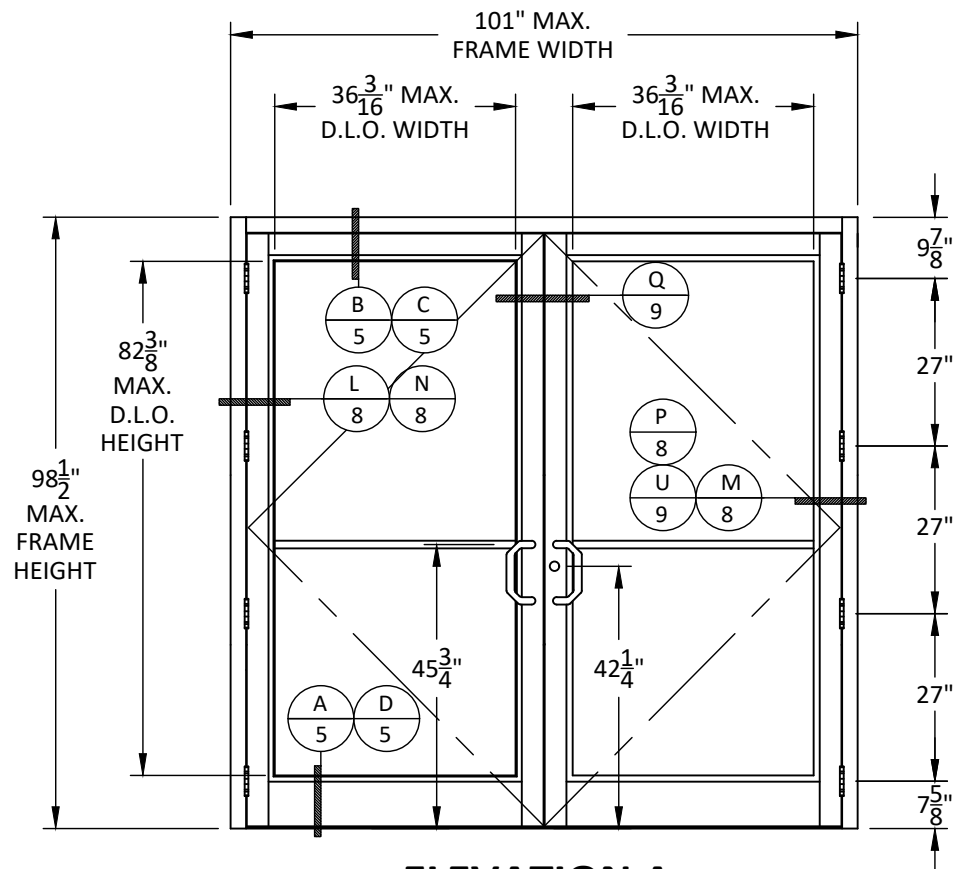

ELEVATION A
STANDARD 5-POINT LOCK

ELEVATION A	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
ADAMS RITE MS 1850 WITH MS 4015 AND MS 4016 TOP AND BOTTOM BOLTS	+90/- 90 PSF
ADAMS RITE MS 1880	
ADAMS RITE MS 1850 WITH MS 4015 AND MS 4016 TOP AND BOTTOM BOLTS	+70/-90 PSF
ADAMS RITE MS 2180	

ELEVATION B	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
VON DUPRIN 98/99 SERIES RIM PANIC WITH REMOVABLE MULLION	+50/-50 PSF
VON DUPRIN 33A/35A SERIES RIM PANIC WITH REMOVABLE MULLION	
CORBIN RUSSWIN ED4200 RIM EXIT DEVICE WITH REMOVABLE MULLION	+60/-60 PSF
YALE 7250M EXIT DEVICE WITH REMOVABLE MULLION	
SARGENT 8500 RIM PANIC WITH REMOVABLE MULLION	
SARGENT 8800 RIM PANIC WITH REMOVABLE MULLION	


NOTE: RIM PANIC EXIT DEVICES WITH REMOVABLE MULLION ARE NOT FOR USE WITH AIR/WATER RATER THRESHOLD.

- NOTES:
- 1) WHEN AIR/WATER THRESHOLD IS UTILIZED, MAX. DOOR FRAME HEIGHT MAY INCREASE TO 99'-7/8". SEE DETAIL D, SHEET 5 AND DETAIL K, SHEET 7.
 - 2) SINGLE AND DOUBLE DOORS ARE QUALIFIED SUCH THAT SINGLE DOOR UTILIZES HARDWARE FROM ACTIVE DOOR PANEL.
 - 3) ADDITIONAL QUALIFIED PANEL CONFIGURATIONS CAN BE FOUND ON SHEET 4.
 - 4) SEE SHEET 7 DESIGN PRESSURE LIMITATIONS BASED ON WATER INFILTRATION REQUIREMENTS.


NOTE:
MONOLITHIC D.L.O. SHOWN, INSULATING SIMILAR. SEE SHEET 1 FOR MAXIMUM D.L.O. SIZES PER GLASS TYPE.

ELEVATION C	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
SINGLE POINT MS 1850 ON ACTIVE WITH FLUSHBOLTS INACTIVE	+50/- 50 PSF


ELEVATION D	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
VON DUPRIN 9947F CVR EXIT DEVICE W/ 3/16" SHIM BETWEEN DOOR & DEVICE	+50/- 50 PSF

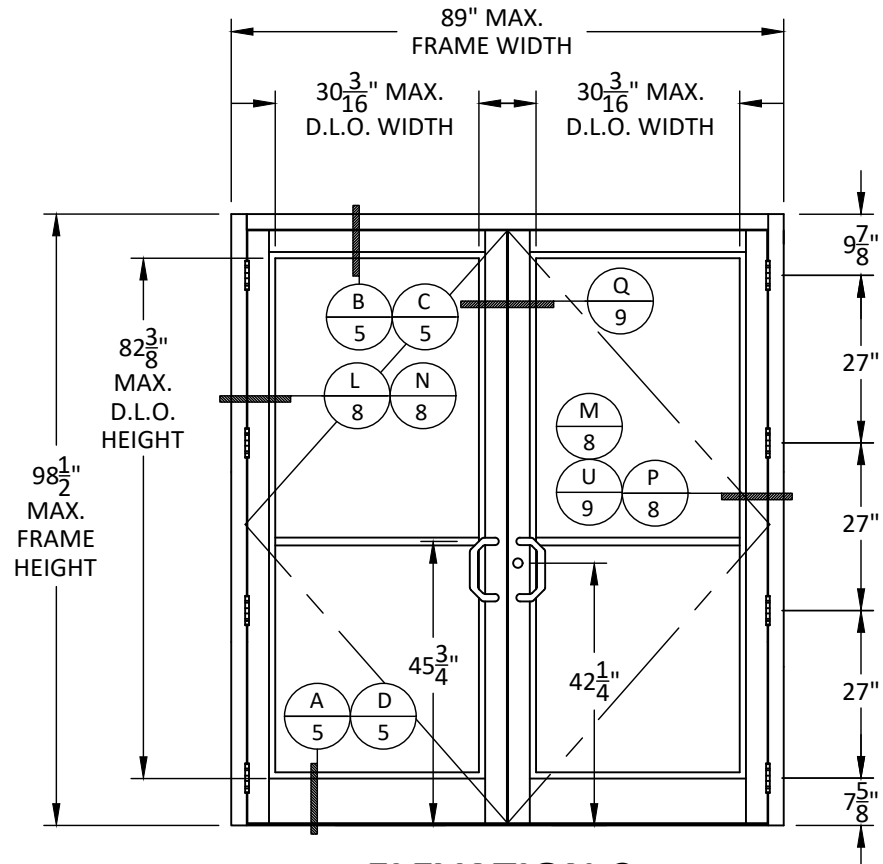

ELEVATION C
SINGLE POINT WITH FLUSHBOLTS

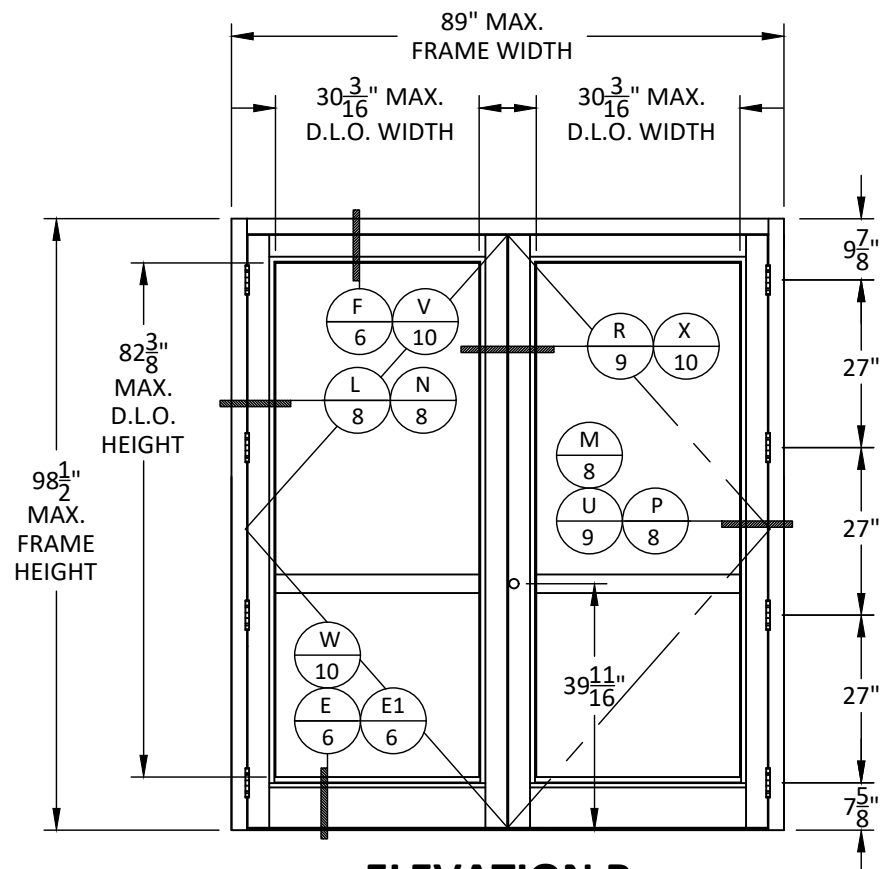

ELEVATION B
**RIM PANIC WITH
REMOVABLE MULLION**

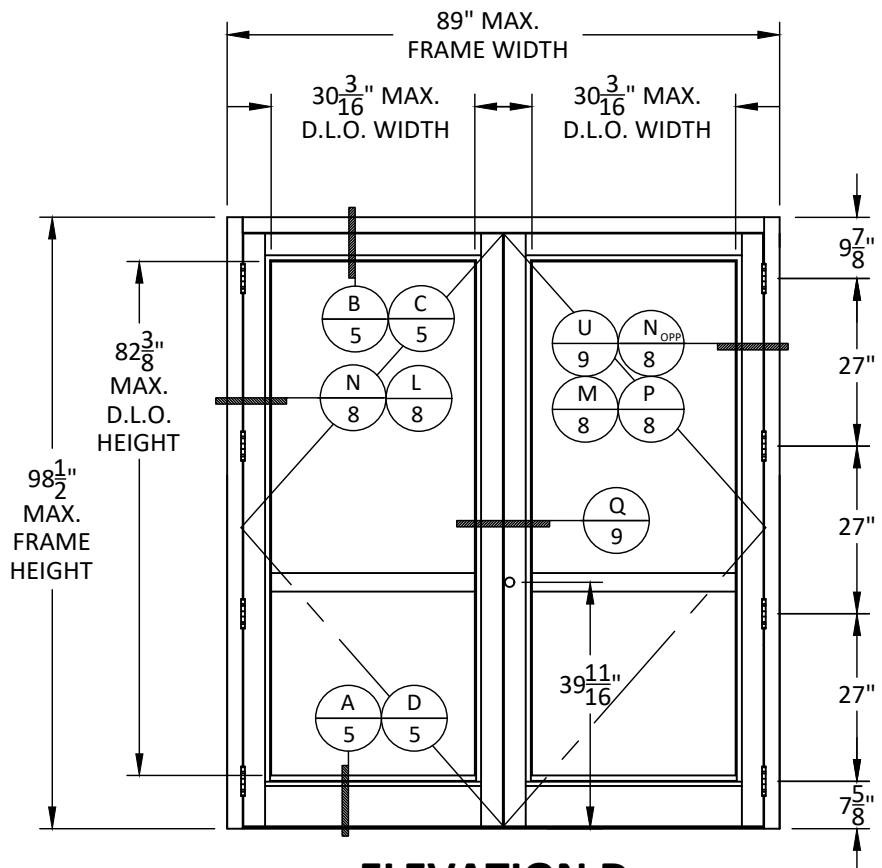

ELEVATION D
CONCEALED VERTICAL ROD



YKK AP America Inc.

1229 HWY 441 BYPASS

DUBLIN, GEORGIA 31021

PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING

ENTRANCE DOOR
(HVHZ) (IMPACT)

ELEVATIONS 1

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com




REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

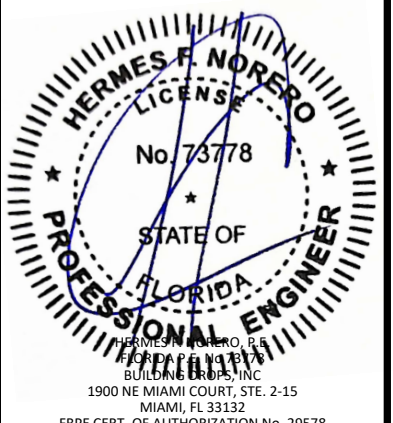


FL #:	FL16554
DATE:	09.14.18
DWG. BY:	HR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK021
SHEET:	2
REV.	D

7/31/2026 9:50 AM

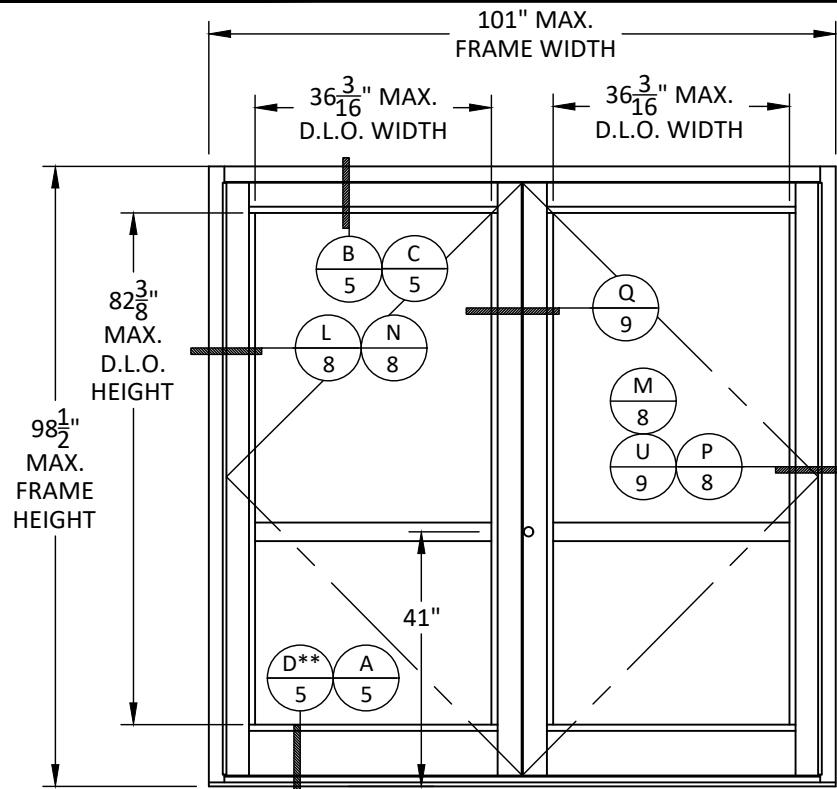

ELEVATION E
CVR EXIT DEVICE

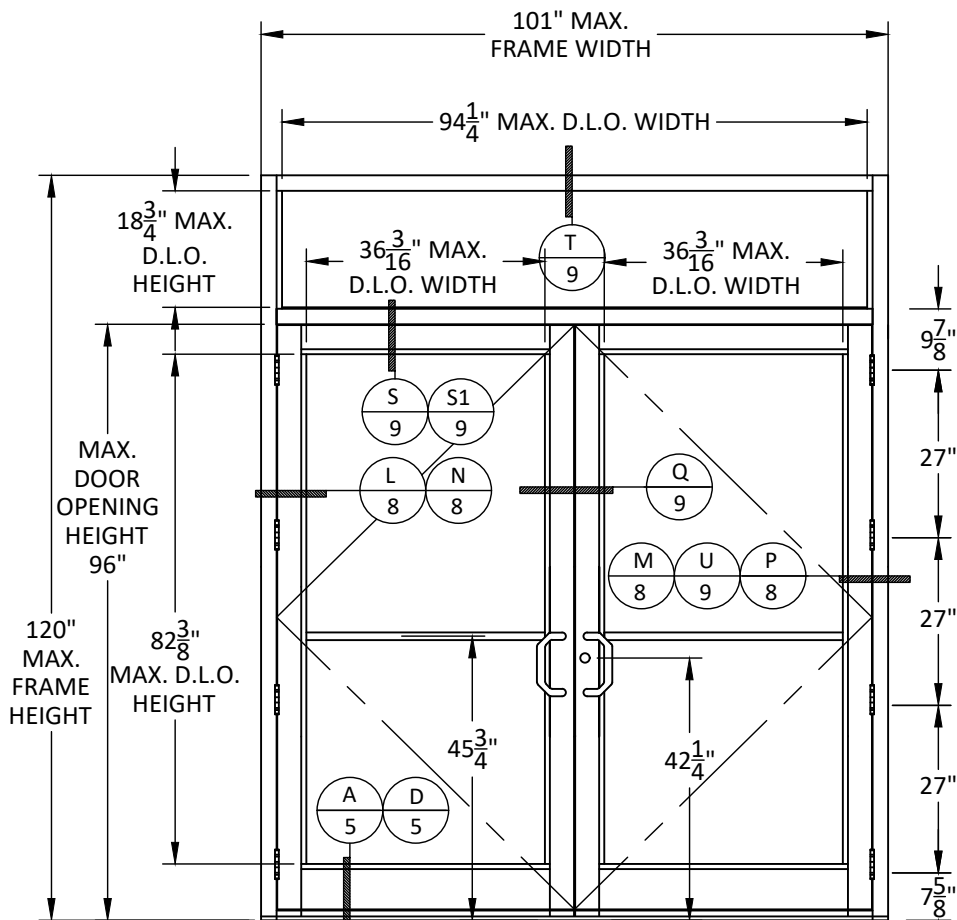

ELEVATION G
DOUBLE DOOR WITH TRANSOM

ELEVATION E	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
SARGENT 8400 CVR EXIT DEVICE	+90/- 90 PSF
SARGENT 8600 CVR EXIT DEVICE	
FIRST CHOICE FL8660 CVR EXIT DEVICE	
FIRST CHOICE FL3690 CVR EXIT DEVICE	
FALCON DOR-O-MATIC 1490 CVR EXIT DEVICE	+70/- 90 PSF
FALCON DOR-O-MATIC 1690 CVR EXIT DEVICE	

NOTES:

- 1) WHEN AIR/WATER THRESHOLD IS UTILIZED, MAX. DOOR FRAME HEIGHT MAY INCREASE TO 99-7/8". SEE DETAIL D, SHEET 5 AND DETAIL K, SHEET 7.
- 2) SINGLE AND DOUBLE DOORS ARE QUALIFIED SUCH THAT SINGLE DOOR UTILIZES HARDWARE FROM ACTIVE DOOR PANEL.
- 3) ADDITIONAL QUALIFIED PANEL CONFIGURATIONS CAN BE FOUND ON SHEET 4.
- 4) SEE SHEET 7 DESIGN PRESSURE LIMITATIONS BASED ON WATER INFILTRATION REQUIREMENTS.

****NOTE:** AIR TIGHT THRESHOLD (ITEM #13) MAY BE USED IN LIEU OF AIR/WATER THRESHOLD WHEN UTILIZED WITH CONCEALED VERTICAL ROD DEVICES


NOTE:

MONOLITHIC D.L.O. SHOWN, INSULATING SIMILAR. SEE SHEET 1 FOR MAXIMUM D.L.O. SIZES PER GLASS TYPE.

ELEVATION G	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
SEE ELEVATIONS A-E & I FOR ALLOWABLE LOCKING HARDWARE SYSTEMS.	*NOT TO EXCEED +70/-90 PSF

***ELEVATION G NOTES:**

1. FOR TRANSOM MULLION DETAIL S/9.
 - A. MAX. DESIGN PRESSURE NOT TO EXCEED +70/-65 PSF WHEN MONO-LAMI GLAZINGS ARE UTILIZED (MULL ITEM# 51).
 - B. DESIGN PRESSURE NOT TO EXCEED +70/-70 PSF WHEN INSULATED LAMINATED GLAZINGS ARE UTILIZED (MULL ITEM# 52).
 - C. LESSER DESIGN PRESSURE OF THOSE STATED ABOVE (1.A & 1.B) OR THOSE FOUND ON SHEET 1 SHALL GOVERN.
2. FOR TRANSOM MULLION DETAIL S1/9.
 - A. MAX. DESIGN PRESSURE NOT TO EXCEED +70/-70 PSF WHEN MONO-LAMI GLAZINGS ARE UTILIZED (MULL ITEM# 61).
 - B. DESIGN PRESSURE NOT TO EXCEED +70/-90 PSF WHEN INSULATED LAMINATED GLAZINGS ARE UTILIZED (MULL ITEM# 62).
 - C. LESSER DESIGN PRESSURE OF THOSE STATED ABOVE (2.A & 2.B) OR THOSE FOUND ON SHEET 1 SHALL GOVERN.
3. LESSER DESIGN PRESSURE OF THAT SHOWN IN TABLE ABOVE, OR THAT INDICATED IN CORRESPONDING TABLE FOR HARDWARE SHALL GOVERN.
4. MAX. DOOR SIZES FOR A GIVEN HARDWARE AS INDICATED IN ELEVATIONS A-E & I SHALL GOVERN MAX. SIZE OF ASSEMBLY. ASSEMBLY IS TO NOT EXCEED DIMENSIONS AS SHOWN IN ELEVATION G.

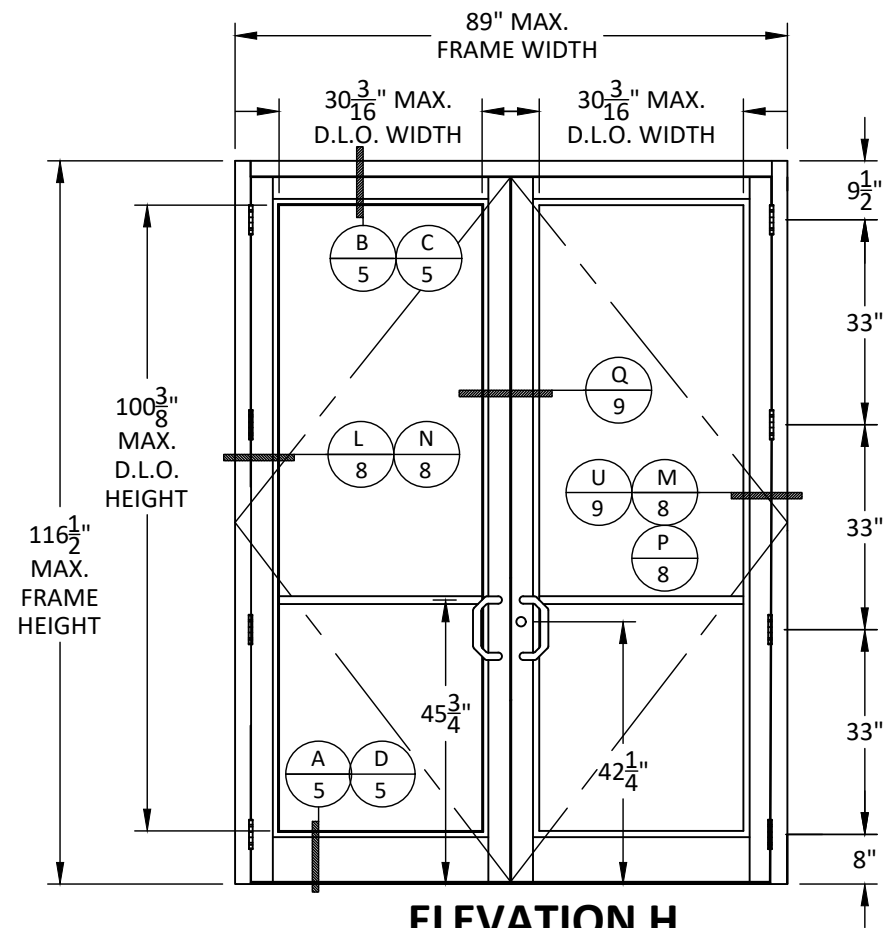

ELEVATION H
STANDARD 5-POINT LOCK

ELEVATION H	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
ADAMS RITE MS 1850 WITH MS 4015 AND MS 4016 TOP AND BOTTOM BOLTS.	+90/-90 PSF
ADAMS RITE MS 1880.	+90/-90 PSF



YKK AP America Inc.

1229 HWY 441 BYPASS

DUBLIN, GEORGIA 31021

PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)


ELEVATIONS 2

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

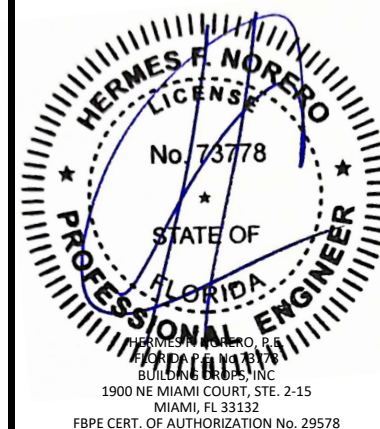

FL #:

FL16554

DATE: **09.14.18**

DWG. BY:
HR

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **YKK021**

SHEET:


3

REV.


D

c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg

c:\users\sebastianherrerros\desktop\Ykk 2026 ca\116554\Ykk021.dwg 7/31/2026 9:50 AM

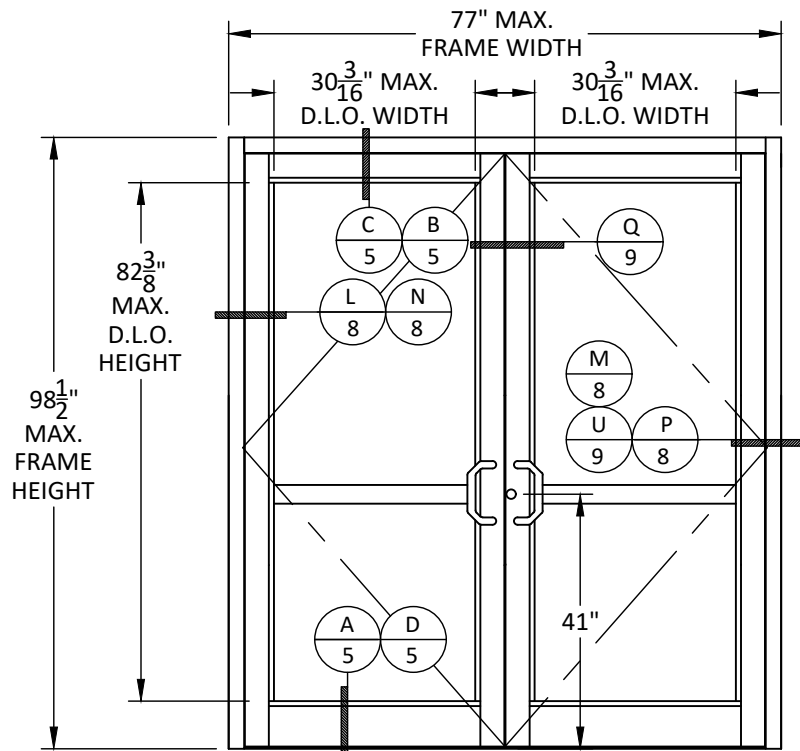

ELEVATION I
CVR EXIT DEVICE

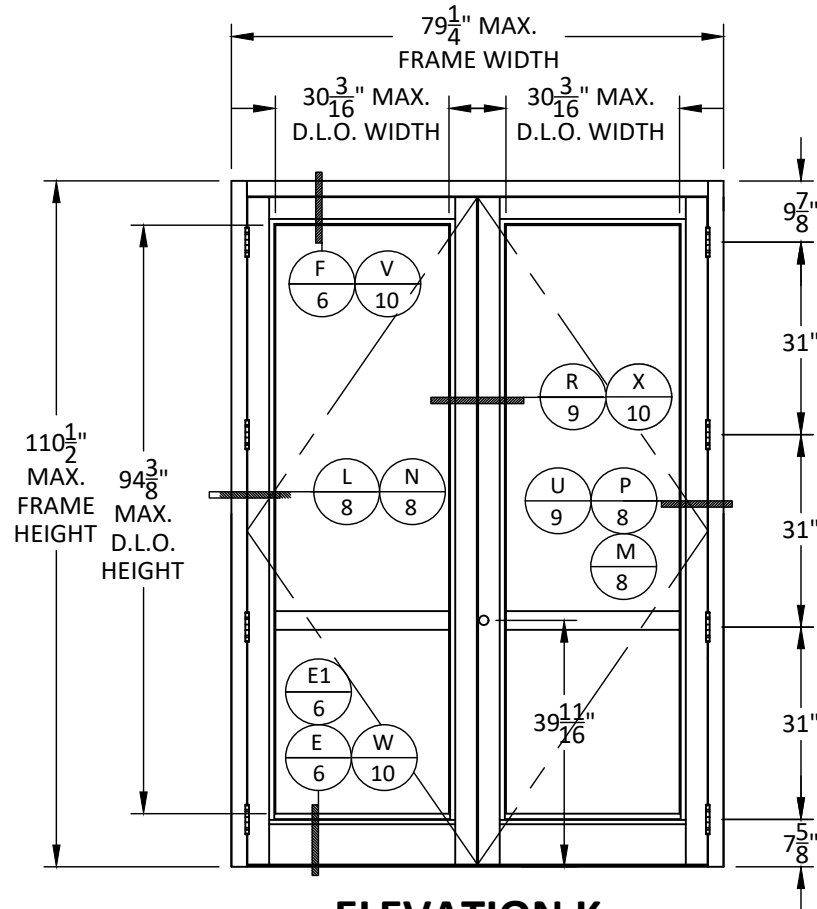

ELEVATION K
RIM PANIC WITH REMOVABLE MULLION

ELEVATION I	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
VON DUPRIN 3347 CONCEALED VERTICAL ROD	+70 / -48 PSF

ELEVATION J	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
SEE ELEVATIONS A-E & I FOR ALLOWABLE LOCKING HARDWARE SYSTEMS	NOT TO EXCEED +70/-90 PSF


ELEVATION K	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
VON DUPRIN 98 / 99 SERIES RIM PANIC WITH REMOVABLE MULLION	+39.7/- 39.7 PSF
VON DUPRIN 33A / 35A SERIES RIM PANIC WITH REMOVABLE MULLION	
SARGENT 8500 RIM PANIC WITH REMOVABLE MULLION	+47.7/- 47.7 PSF
SARGENT 8800 RIM PANIC WITH REMOVABLE MULLION	
CORBIN RUSSWIN ED4200 RIM EXIT DEVICE WITH REMOVABLE MULLION	
YALE 7250M EXIT DEVICE WITH REMOVABLE MULLION	

ELEVATION L	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
VON DUPRIN 98 / 99 SERIES RIM PANIC WITH REMOVABLE MULLION	+44.4/- 44.4 PSF
VON DUPRIN 33A / 35A SERIES RIM PANIC WITH REMOVABLE MULLION	
SARGENT 8500 RIM PANIC WITH REMOVABLE MULLION	+53.3/- 53.3 PSF
SARGENT 8800 RIM PANIC WITH REMOVABLE MULLION	
CORBIN RUSSWIN ED4200 RIM EXIT DEVICE WITH REMOVABLE MULLION	
YALE 7250M EXIT DEVICE WITH REMOVABLE MULLION	


- NOTES:
- 1) WHEN AIR/WATER THRESHOLD IS UTILIZED, MAX. DOOR FRAME HEIGHT MAY INCREASE TO 99-7/8". SEE DETAIL D, SHEET 5 AND DETAIL K, SHEET 7.
 - 2) SINGLE AND DOUBLE DOORS ARE QUALIFIED SUCH THAT SINGLE DOOR UTILIZES HARDWARE FROM ACTIVE DOOR PANEL.
 - 3) ADDITIONAL QUALIFIED PANEL CONFIGURATIONS CAN BE FOUND ON SHEET 4.
 - 4) SEE SHEET 7 DESIGN PRESSURE LIMITATIONS BASED ON WATER INFILTRATION REQUIREMENTS.

****NOTE:** AIR TIGHT THRESHOLD (ITEM #13) MAY BE USED IN LIEU OF AIR/WATER THRESHOLD WHEN UTILIZED WITH CONCEALED VERTICAL ROD DEVICES

NOTE: MONOLITHIC D.L.O. SHOWN, INSULATING SIMILAR. SEE SHEET 1 FOR MAXIMUM D.L.O. SIZES PER GLASS TYPE.

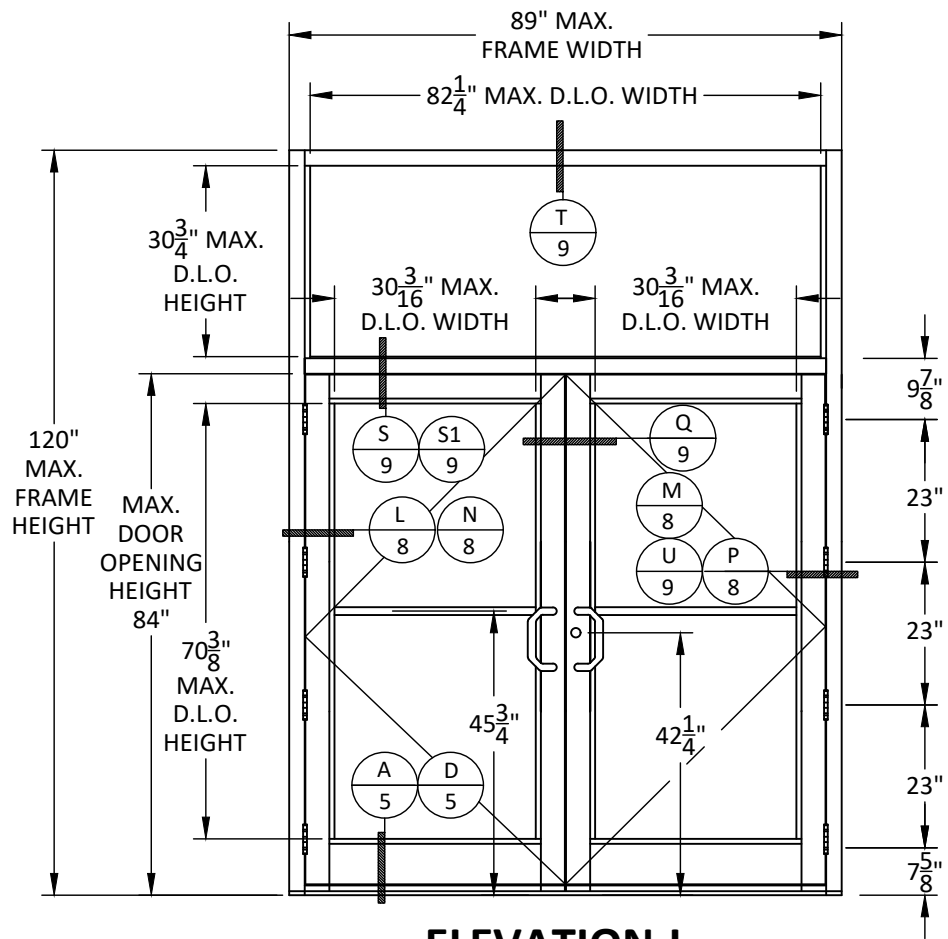

ELEVATION J
DOUBLE DOOR WITH TRANSOM

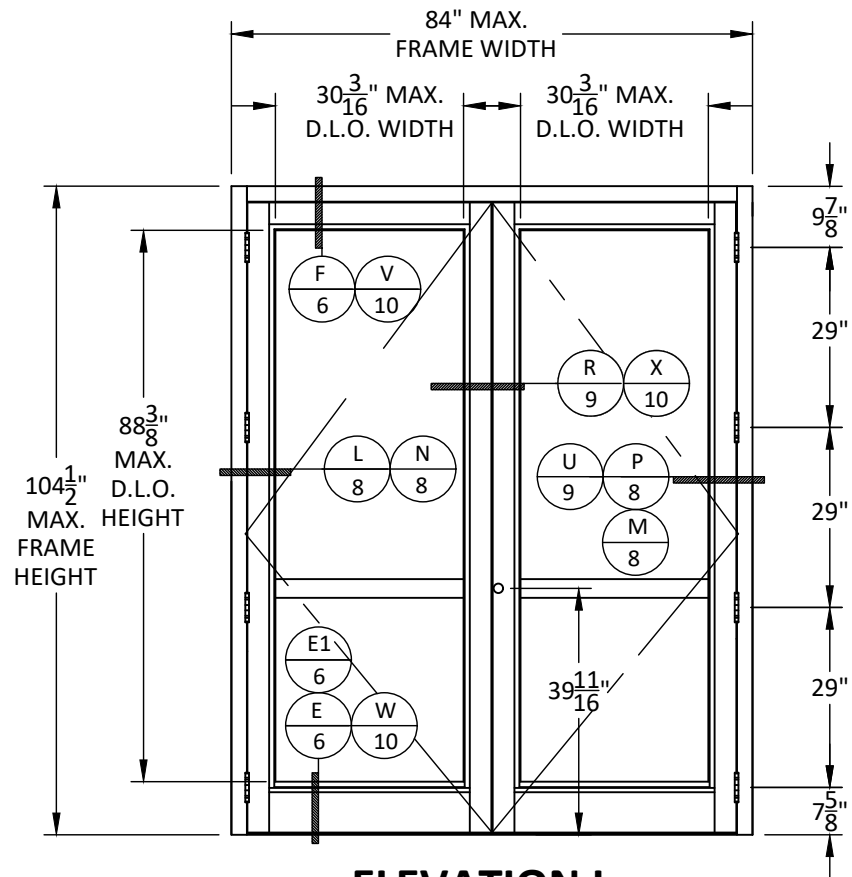

ELEVATION L
RIM PANIC WITH REMOVABLE MULLION



YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)

ELEVATIONS 3

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL16554
DATE:	09.14.18
DWG. BY:	HR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK021
SHEET:	3.1
REV.	D

c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg 7/31/2026 9:50 AM

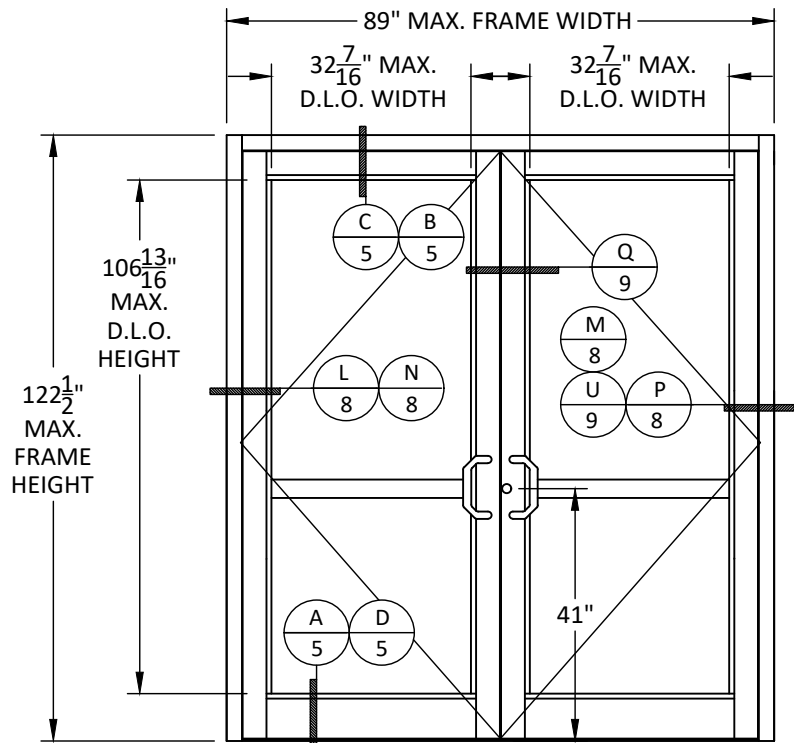

ELEVATION M
CVR EXIT DEVICE

ELEVATION M	
QUALIFIED LOCKING HARDWARE	DESIGN PRESSURE
FIRST CHOICE FLX8660 CVR EXIT DEVICE	+75/- 75 PSF
FIRST CHOICE FLX3690 CVR EXIT DEVICE	

NOTES:
1) SINGLE AND DOUBLE DOORS ARE QUALIFIED SUCH THAT SINGLE DOOR UTILIZES HARDWARE FROM ACTIVE DOOR PANEL.
2) ADDITIONAL QUALIFIED PANEL CONFIGURATIONS CAN BE FOUND ON SHEET 4.
3) SEE SHEET 7 DESIGN PRESSURE LIMITATIONS BASED ON WATER INFILTRATION REQUIREMENTS.

**NOTE: AIR TIGHT THRESHOLD (ITEM #13) MAY BE USED IN LIEU OF AIR/WATER THRESHOLD WHEN UTILIZED WITH CONCEALED VERTICAL ROD DEVICES

NOTE:
MONOLITHIC D.L.O. SHOWN, INSULATING SIMILAR. SEE SHEET 1 FOR MAXIMUM D.L.O. SIZES PER GLASS TYPE.



Quality
inspires™

YKK AP America Inc.

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)


ELEVATIONS 4

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

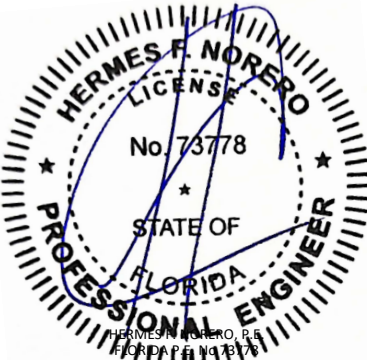

HERMES F. NORERO

LICENSE

No. 73778

STATE OF

FLORIDA

PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
YKK AP AMERICA, INC.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL16554

DATE: **09.14.18**

DWG. BY:
HR

CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **YKK021**

SHEET:
3.2


REV.
D

7/31/2026 9:50 AM

c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg

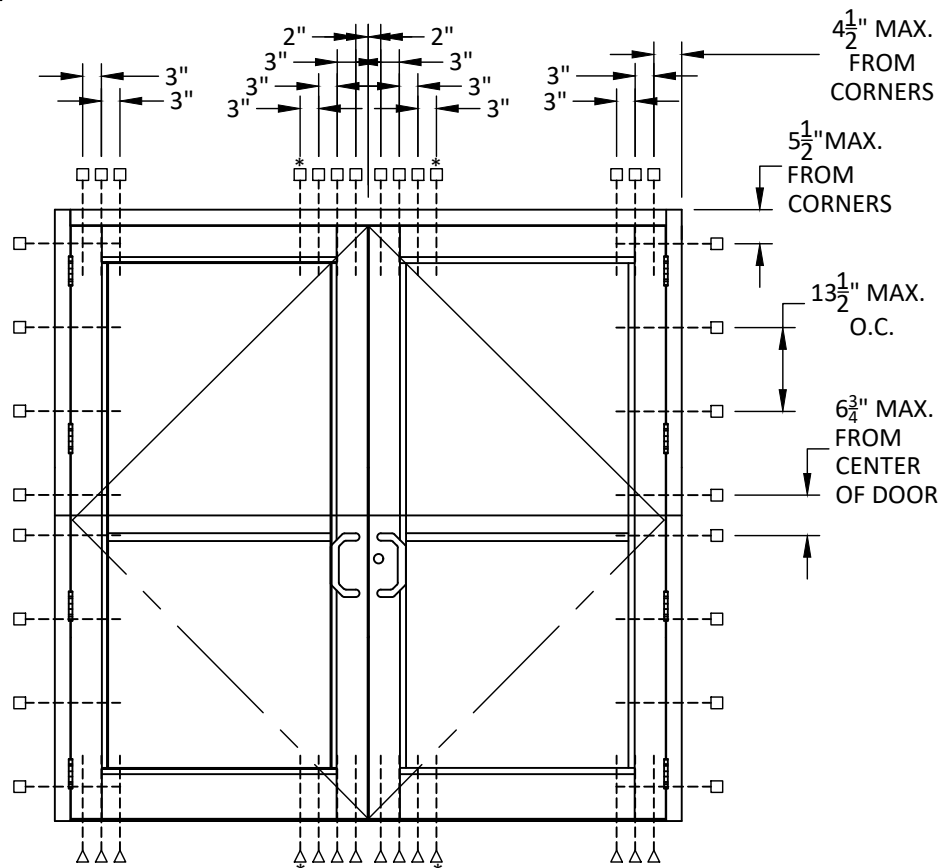

ANCHOR LAYOUT
FOR ELEVATIONS A-E, H, I, K, & L

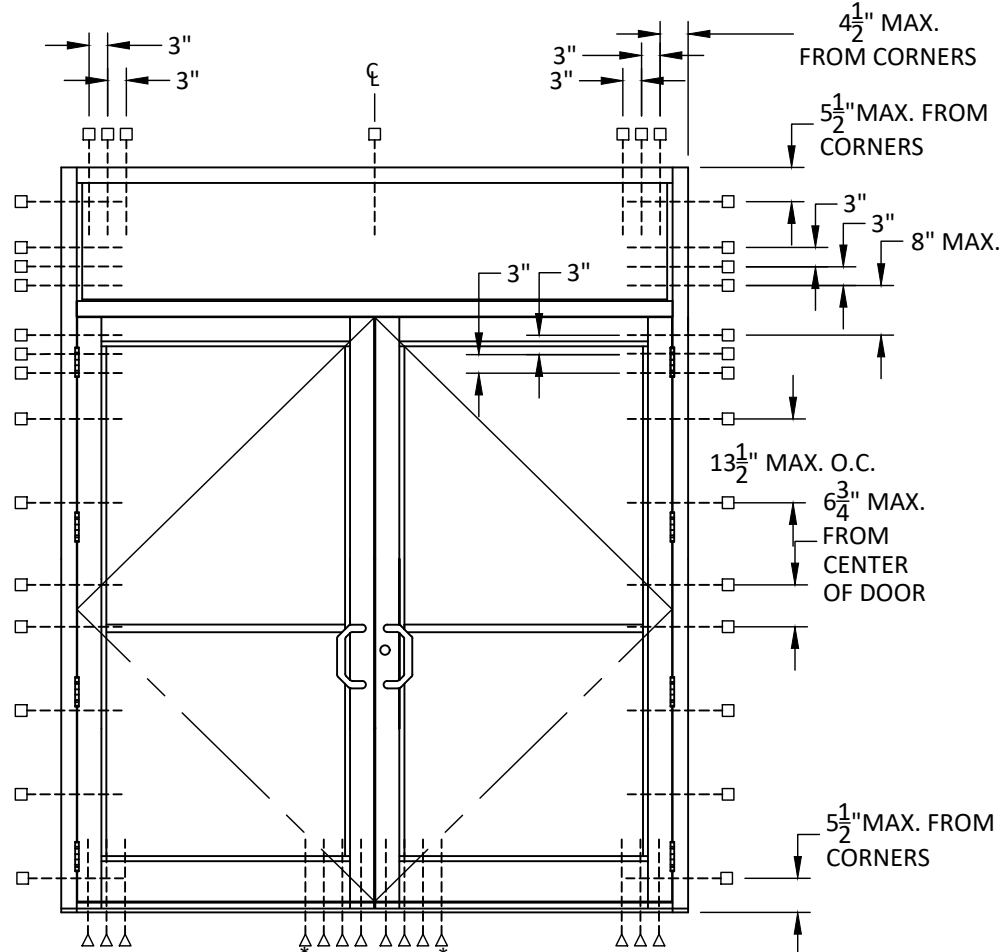

ANCHOR LAYOUT
FOR ELEVATION G & J

QUALIFIED HINGE ASSEMBLIES

HINGE TYPE	DESCRIPTION	MAX FRAME SIZE	DESIGN PRESSURE
BUTT HINGE	***FOUR (4) HAGER BB1191 BUTT HINGES PER DOOR LEAF	101" x 98 1/2"	+90/-90 PSF
BUTT HINGE	***FOUR (4) HAGER BB1191 BUTT HINGES PER DOOR LEAF	89" x 116 1/2"	+90/-90 PSF
BUTT HINGE	***FOUR (4) MCKINNEY TA2714 BUTT HINGES PER DOOR LEAF	101" x 98 1/2"	+90/-90 PSF
CONTINUOUS HINGE	ONE (1) ROTON 780-226HD CONTINUOUS GEARED HINGE PER DOOR LEAF	101" x 98 1/2"	+90/-90 PSF
CONTINUOUS HINGE	ONE (1) SELECT 27HD CONTINUOUS GEARED HINGE PER DOOR LEAF	101" x 98 1/2"	+90/-90 PSF
CONTINUOUS HINGE	ONE (1) PEMKO SLI HD CONTINUOUS GEARED HINGE PER DOOR LEAF	89" x 122 1/2"	+75/-75 PSF
PIVOT	RIXSON PIVOT HINGES 180 AT TOP, M-19 AT INTERMEDIATE, & 147 AT BOTTOM	101" x 98 1/2"	+90/-90 PSF

***NOTE: IF DOOR HEIGHT IS LESS THAN 90" AND DOOR WIDTH IS EQUAL TO OR LESS THAN 36", THEN ONE INTERMEDIATE BUTT HINGE AT MIDSPAN IS REQUIRED BETWEEN TOP & BOTTOM BUTT HINGES

*TWO (2) LESS ANCHORS ARE REQUIRED AT HEAD AND SILL FOR DESIGN PRESSURES OF +/- 60 PSF OR LESS.

QUALIFIED PANEL CONFIGURATIONS

MIDRAILS

CROSS RAILS

MIDRAILS WITH AIR/WATER THRESHOLD

YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING ENTRANCE DOOR (HVHZ) (IMPACT)
ANCHOR LAYOUTS & QUALIFIED HINGE ASSEMBLIES

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL16554

DATE: **09.14.18**

DWG. BY:	CHK. BY:
HR	HFN


SCALE: **NTS**

DWG. #: **YKK021**


SHEET:

4	REV. D
----------	---------------


c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg 7/31/2026 9:50 AM

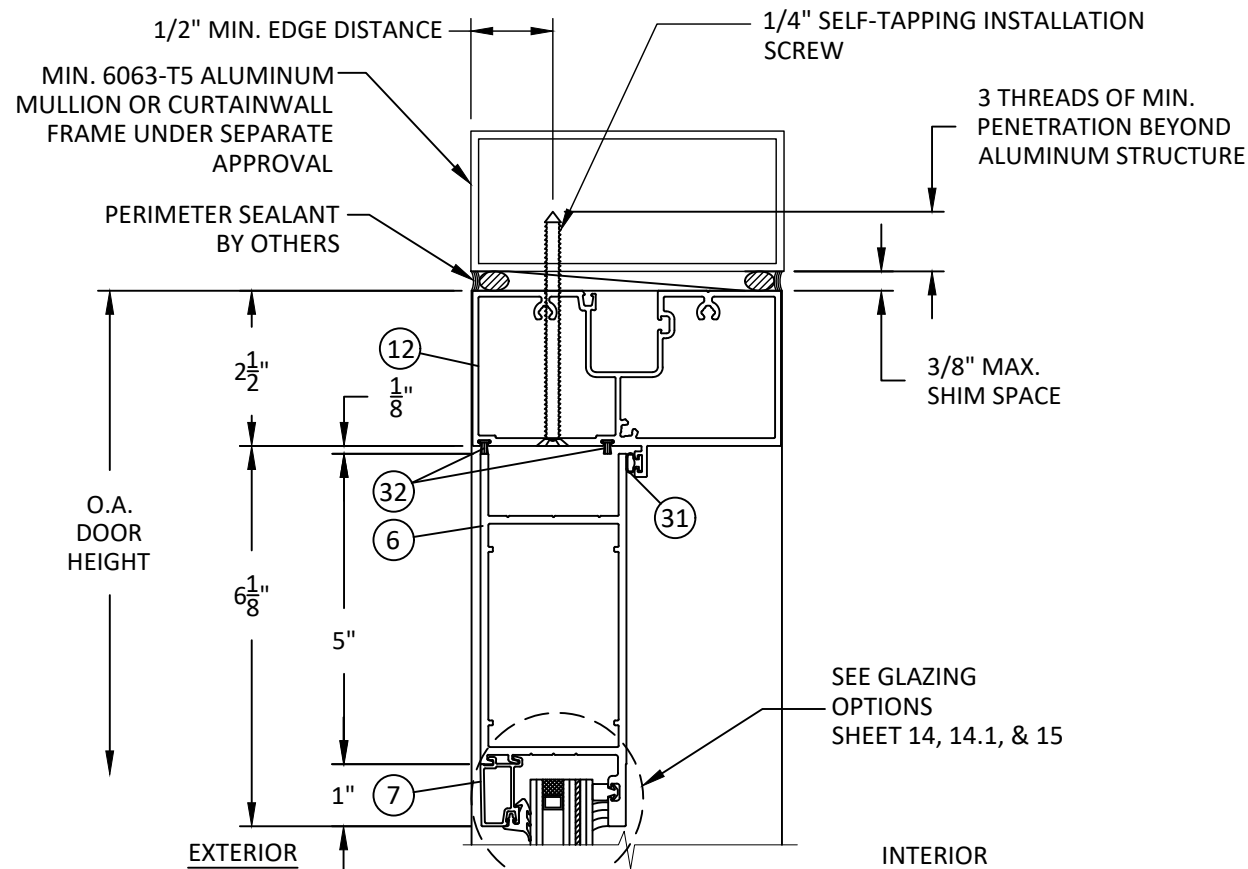


B
5
VERTICAL SECTION
HEAD - ALUMINUM MULLION

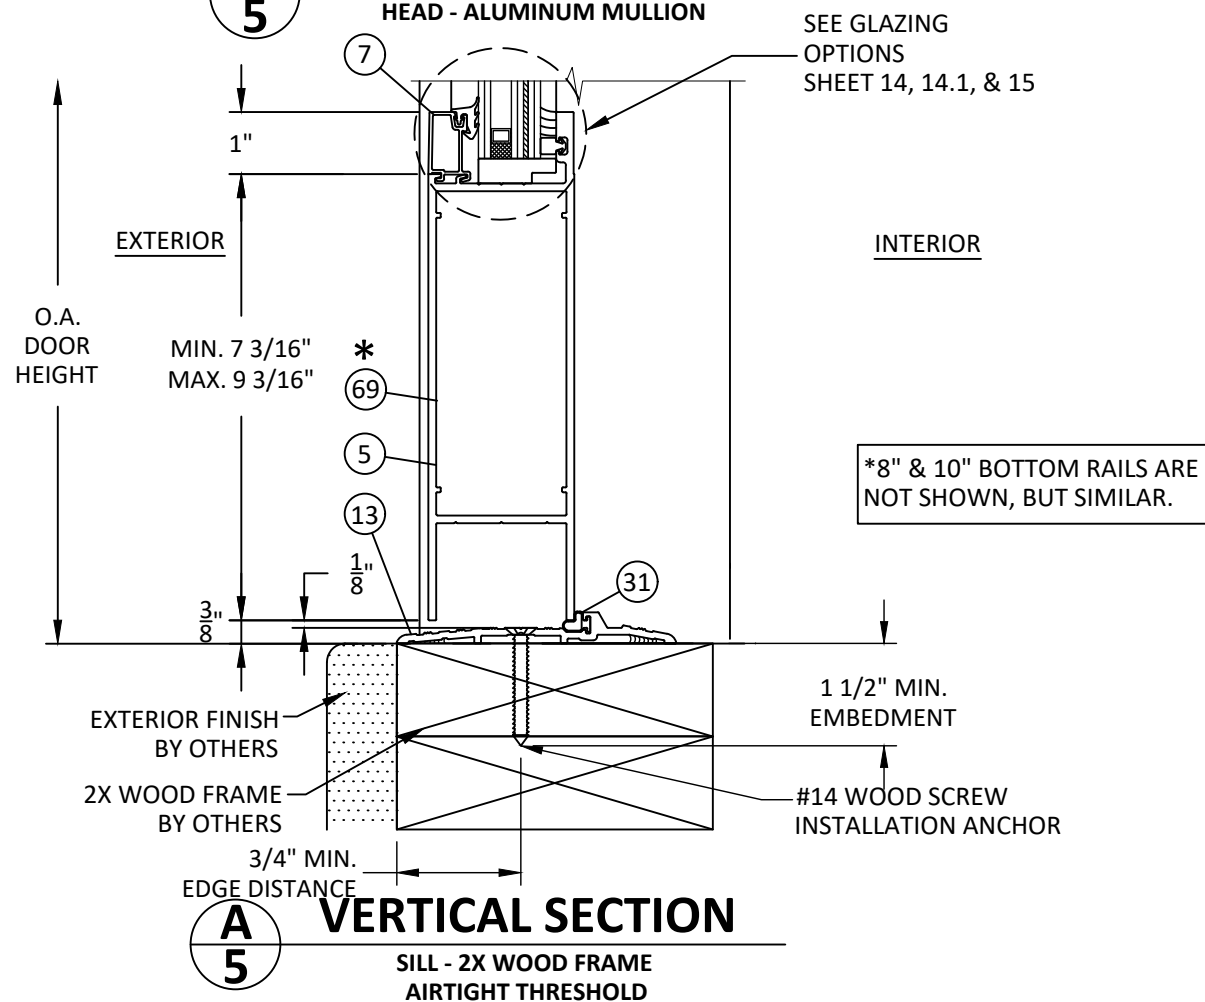

A
5
VERTICAL SECTION
SILL - 2X WOOD FRAME
AIRTIGHT THRESHOLD

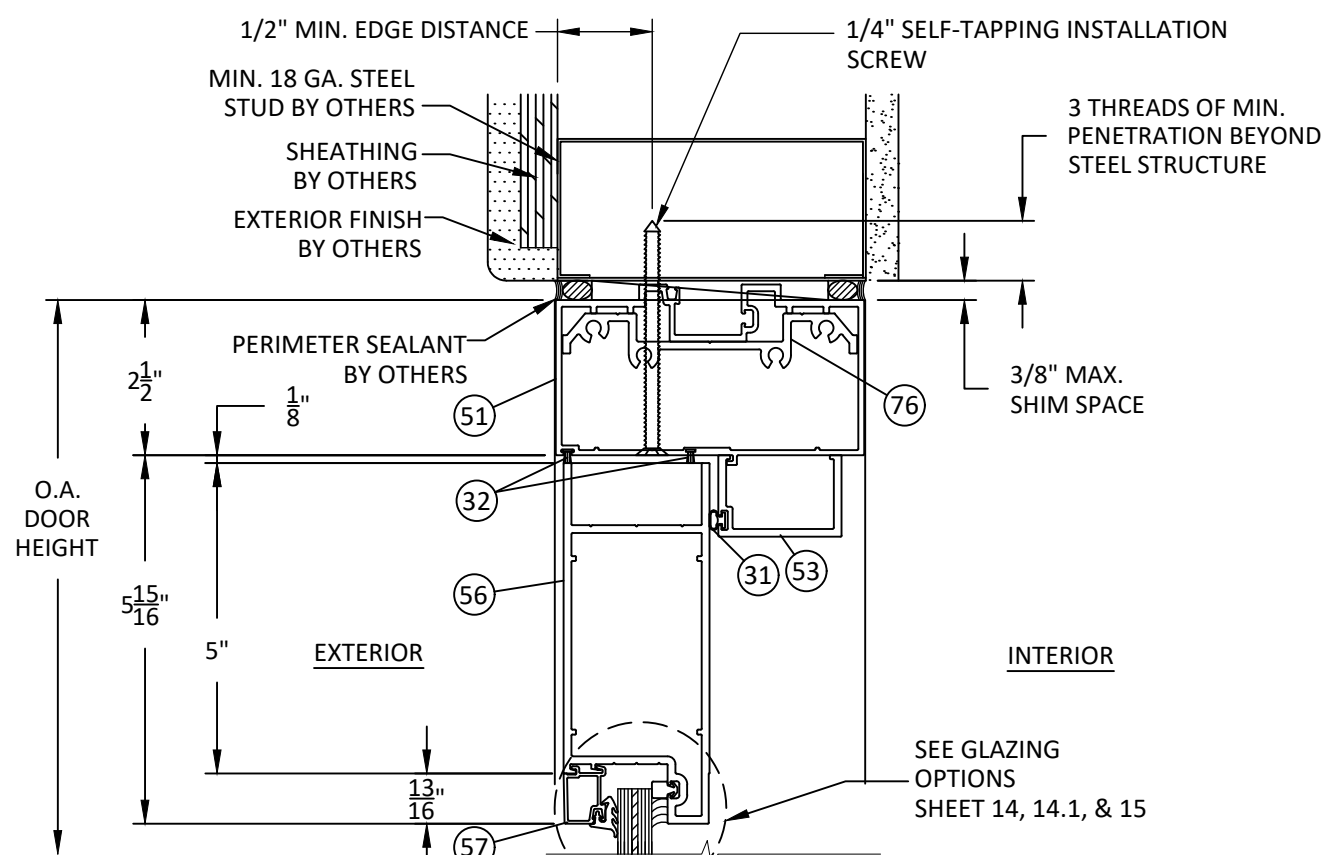

C
5
VERTICAL SECTION
OHCC HEAD (OPTIONAL) - STEEL STUD

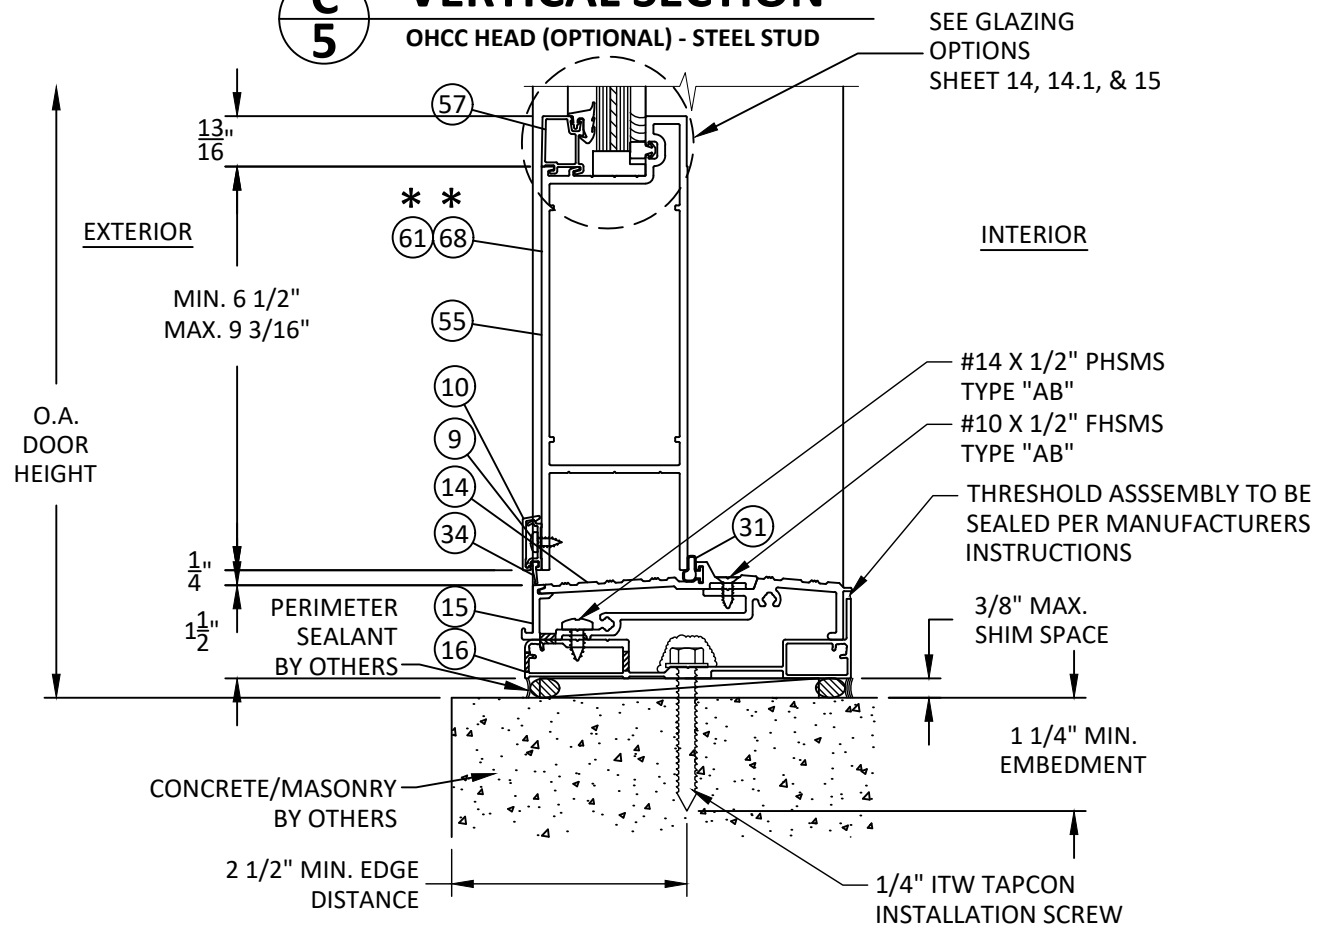

D
5
VERTICAL SECTION
SILL - CONCRETE/MASONRY
AIR & WATER RESISTANT THRESHOLD



YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)

VERTICAL SECTIONS 1

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

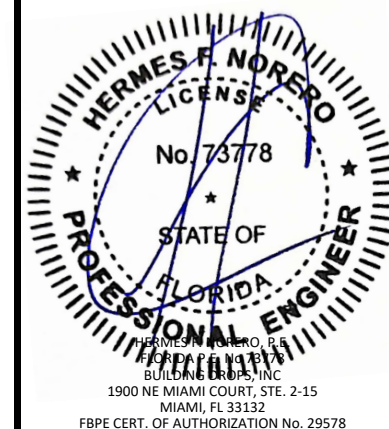

FL #:
FL16554

DATE: **09.14.18**

DWG. BY: **HR** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **YKK021**


SHEET: **5** REV. **D**

7/31/2026 9:51 AM


c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg

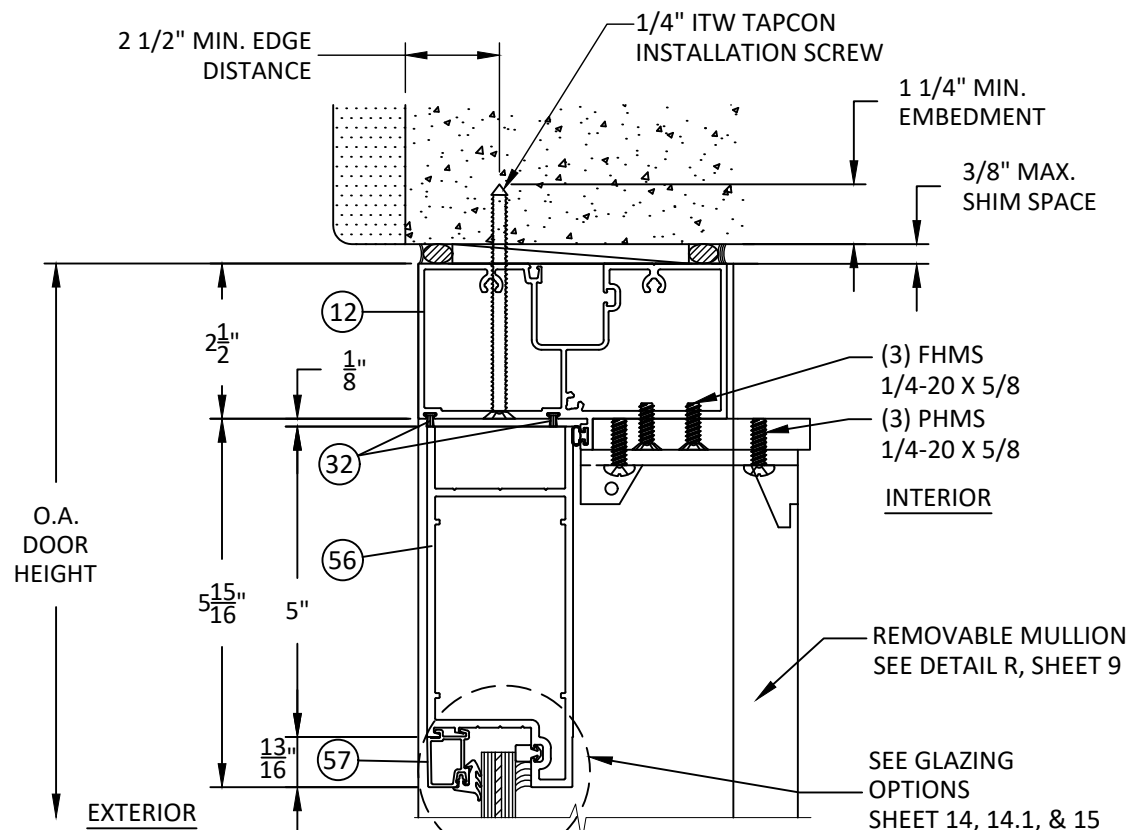


F
6 **VERTICAL SECTION**
HEAD - CONCRETE/MASONRY
REMOVABLE MULLION

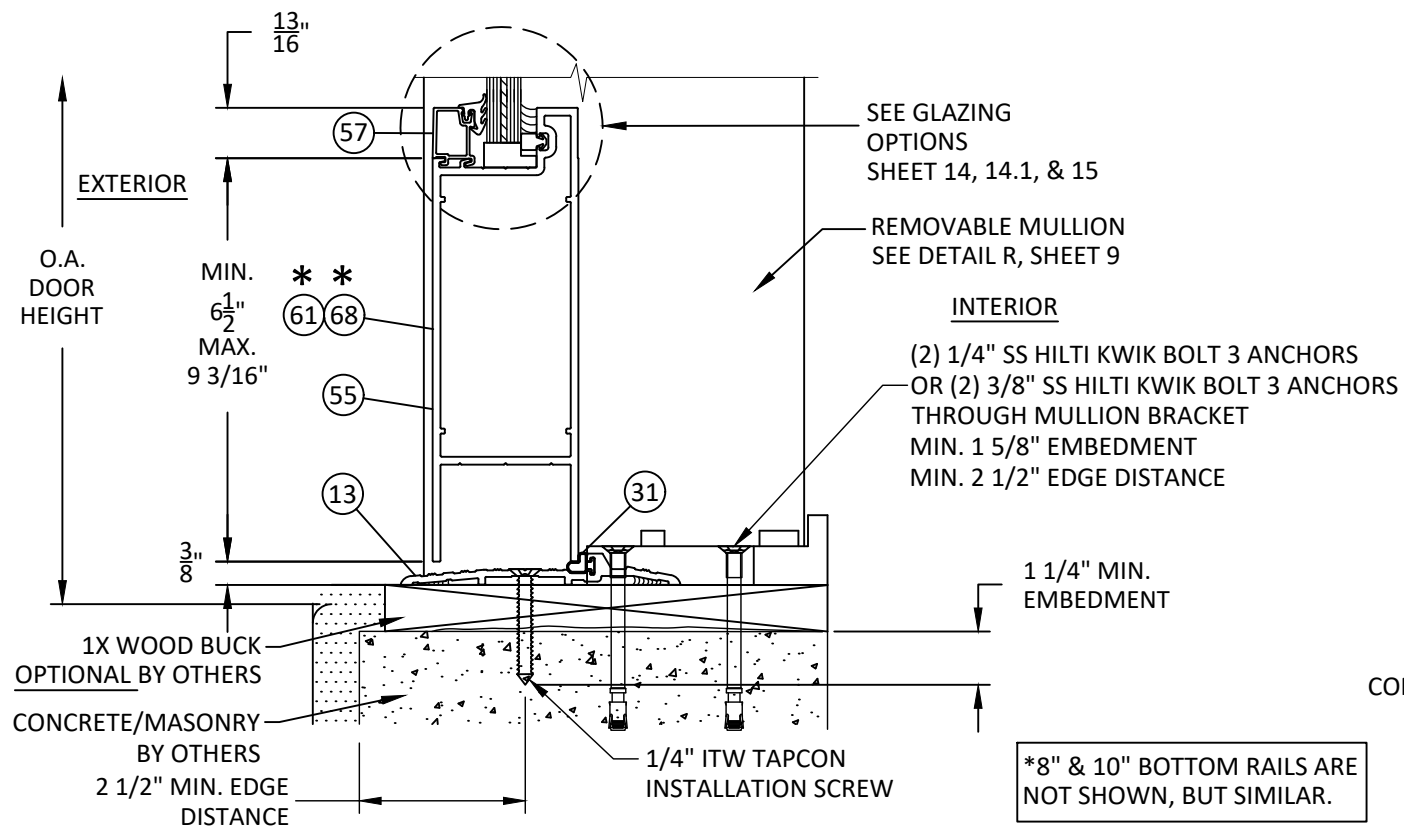

E
6 **VERTICAL SECTION**
SILL - CONCRETE/MASONRY
REMOVABLE MULLION

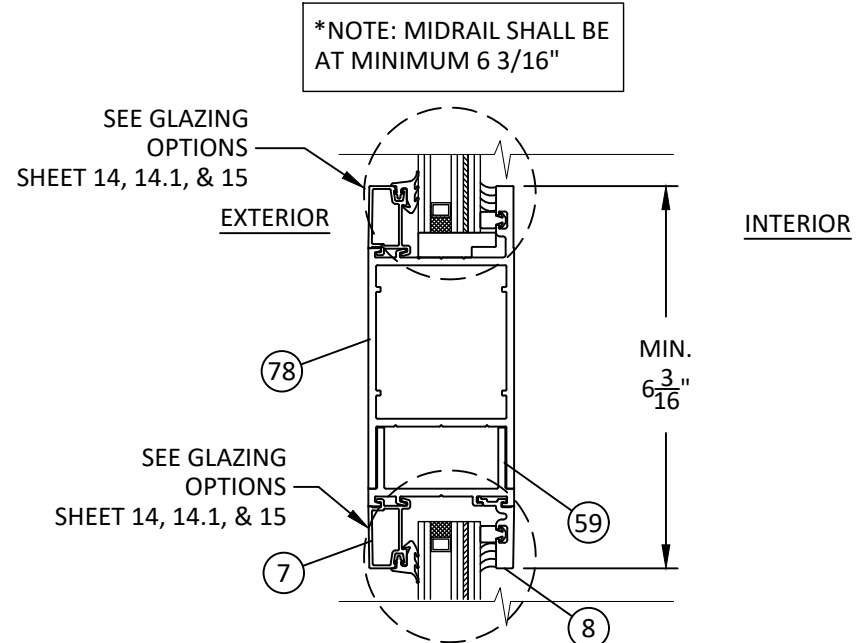

G
6 **VERTICAL SECTION**
6" MIDRAIL

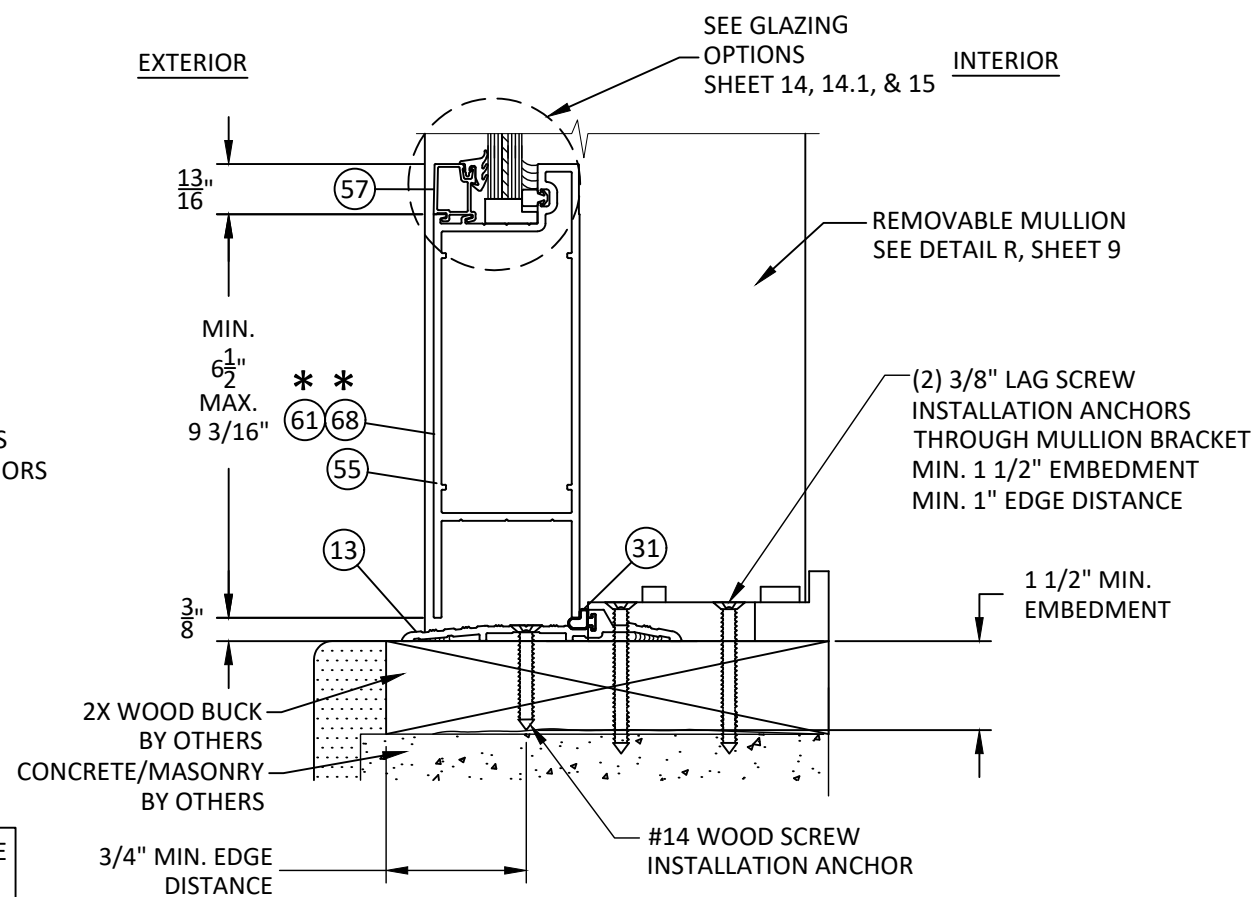

E1
6 **VERTICAL SECTION**
SILL - 2X WOOD BUCK
REMOVABLE MULLION



YKK AP America Inc.

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)

VERTICAL SECTIONS 2

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

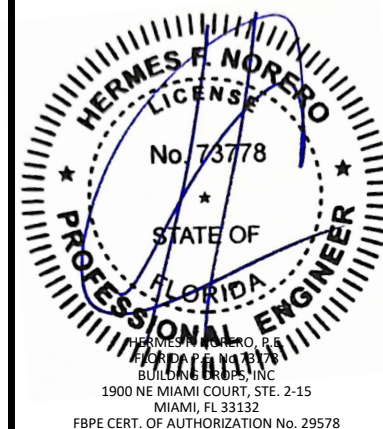

FL #:

FL16554

DATE: 09.14.18

DWG. BY:
HR

CHK. BY:
HFN

SCALE: NTS

DWG. #: YKK021

SHEET:


6

REV.



D

THRESHOLD WATER INFILTRATION AND DESIGN PRESSURE LIMITATIONS

THRESHOLD DESCRIPTION	ITEM #	TYP. DETAILS	WATER TEST PRESSURE	LIMITATIONS
4 1/2" AIR TIGHT THRESHOLD	ITEM # 13	"SEE TYP. DETAILS A/5, E/6, E1/6, J/7 & W/10"	0 PSF	THRESHOLD SHALL BE USED WHERE WATER INFILTRATION RATING IS NOT REQUIRED OR WHERE WATER INFILTRATION IS REQUIRED, A MINIMUM OVERHANG RATIO (OVERHANG PROJECTION:OVERHANG HEIGHT) SHALL BE EQUAL TO OR GREATER THAN 1. POSITIVE DESIGN LOAD NOT TO EXCEED +90 PSF.
AIR/WATER RESISTANT THRESHOLD	ITEMS #14, #15, & #16	"SEE TYP. DETAILS D/5, K/7, Y/11 & Z/11"	10.5 PSF	• WHERE WATER INFILTRATION IS REQUIRED, POSITIVE DESIGN LOAD SHALL NOT EXCEED +70 PSF. • WHERE WATER INFILTRATION IS REQUIRED, AND A MINIMUM OVERHANG RATIO (OVERHANG PROJECTION:OVERHANG HEIGHT) EQUAL TO OR GREATER THAN 1 IS PRESENT, POSITIVE DESIGN LOAD SHALL NOT EXCEED +90 PSF. • WHERE WATER INFILTRATION IS NOT REQUIRED, POSITIVE DESIGN LOAD NOT TO EXCEED +90 PSF."

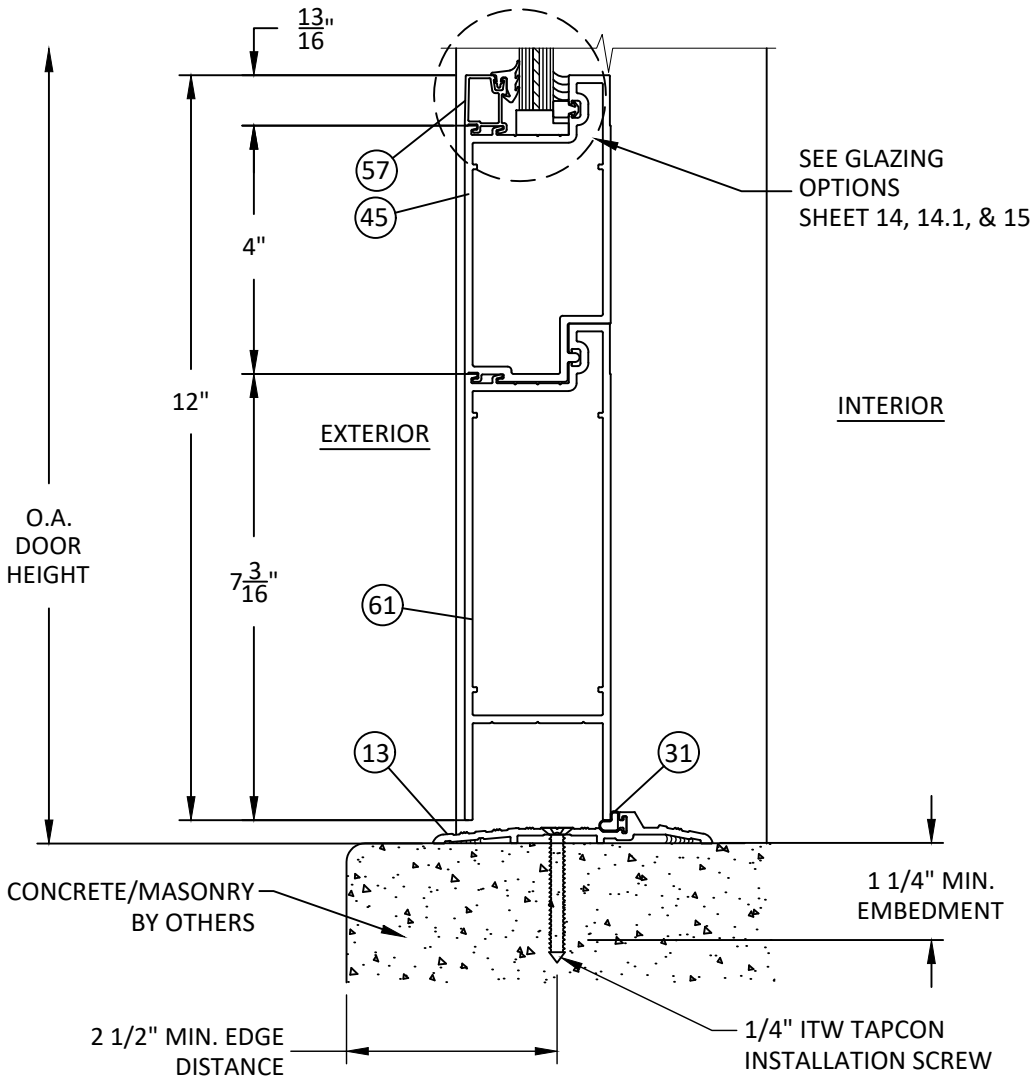

J
7 **VERTICAL SECTION**
SILL - CONCRETE/MASONRY
STACKED BOTTOM RAIL

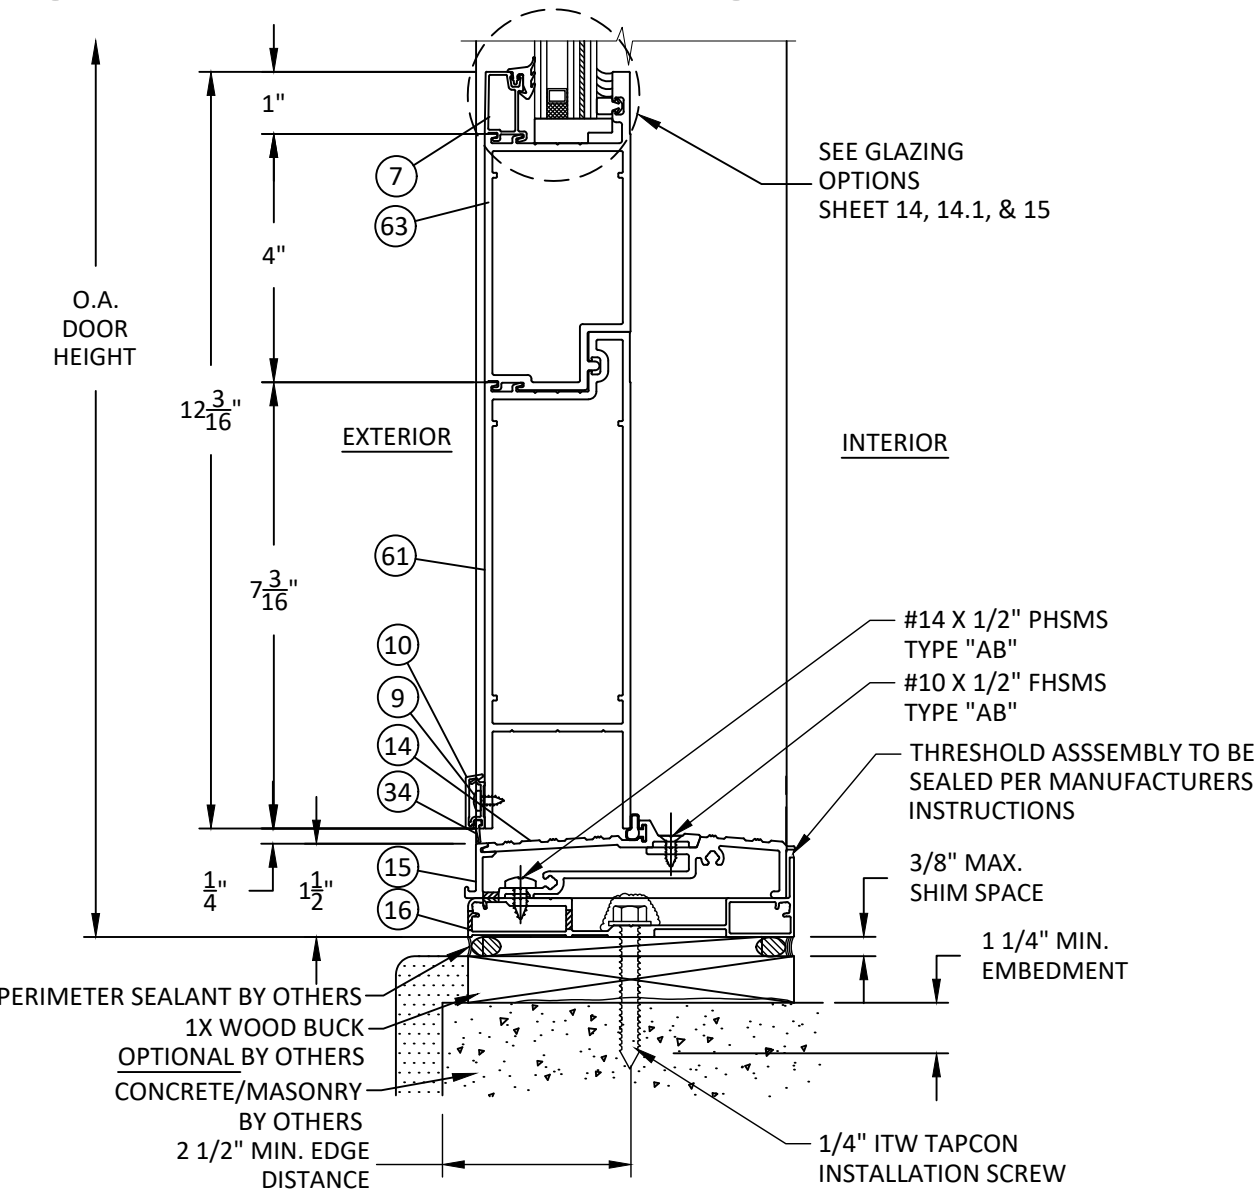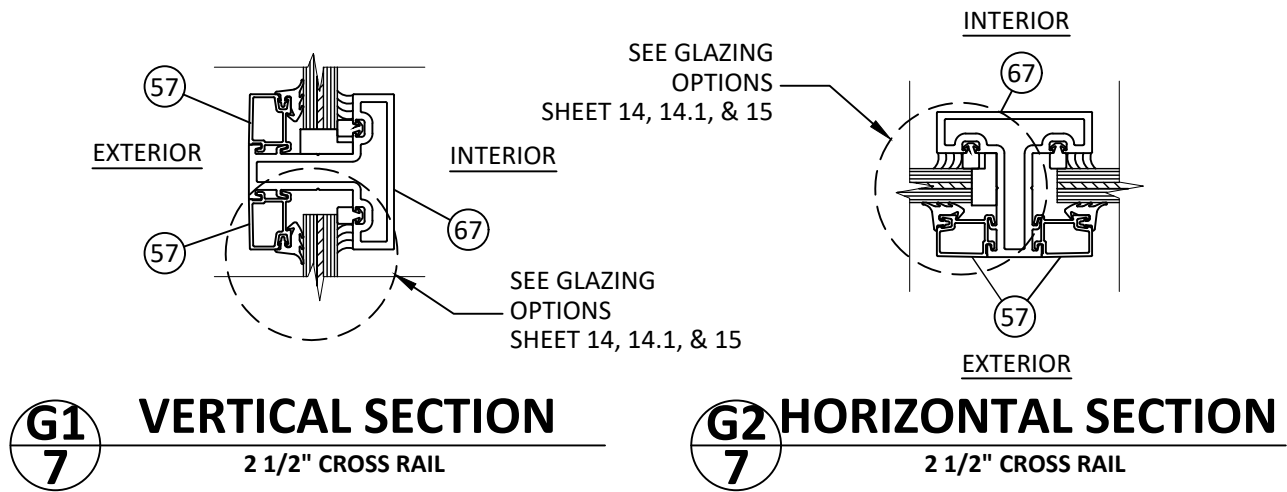

K
7 **VERTICAL SECTION**
SILL - 1X/CONCRETE/MASONRY
STACKED BOTTOM RAIL



YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)
VERTICAL SECTIONS 3
PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL16554
DATE:	09.14.18
DWG. BY:	HR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK021
SHEET:	7
REV.	D

7/31/2026 9:51 AM


c:\users\sebastianherrerros\desktop\Ykk 2026 ca\116554\Ykk021.dwg

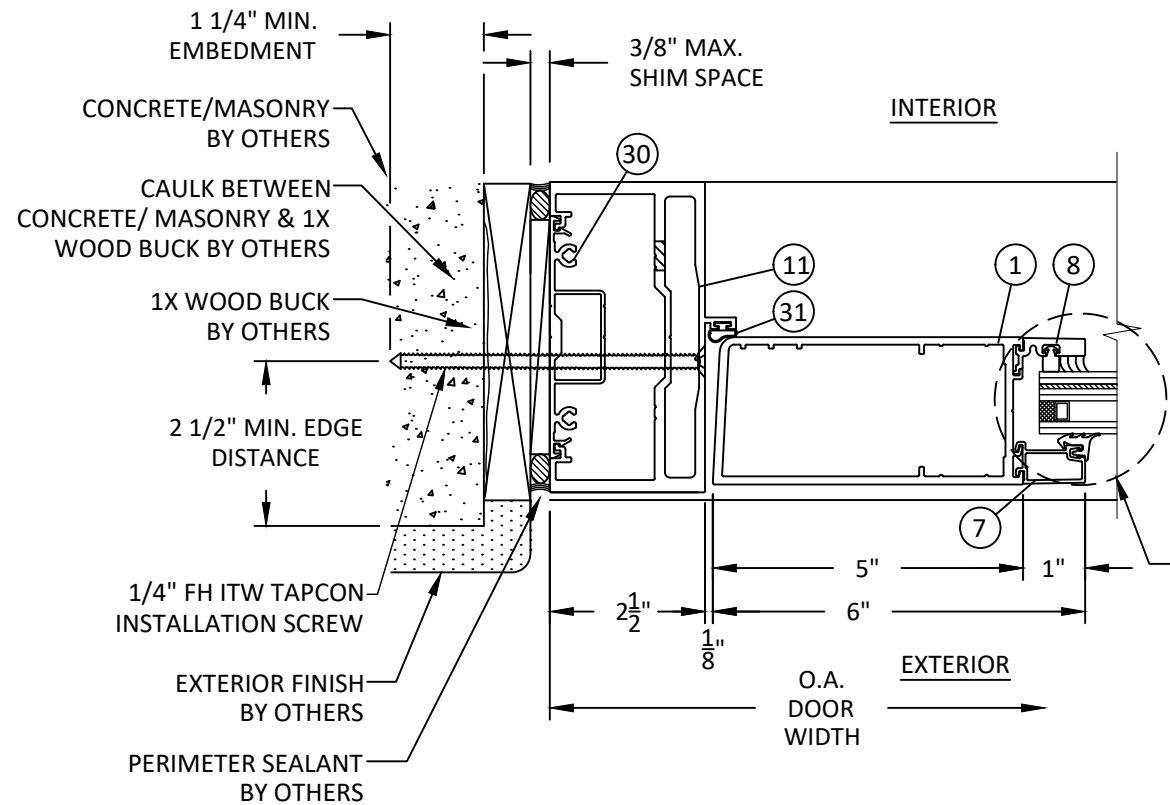


L HORIZONTAL SECTION
8 JAMB - CONCRETE/MASONRY

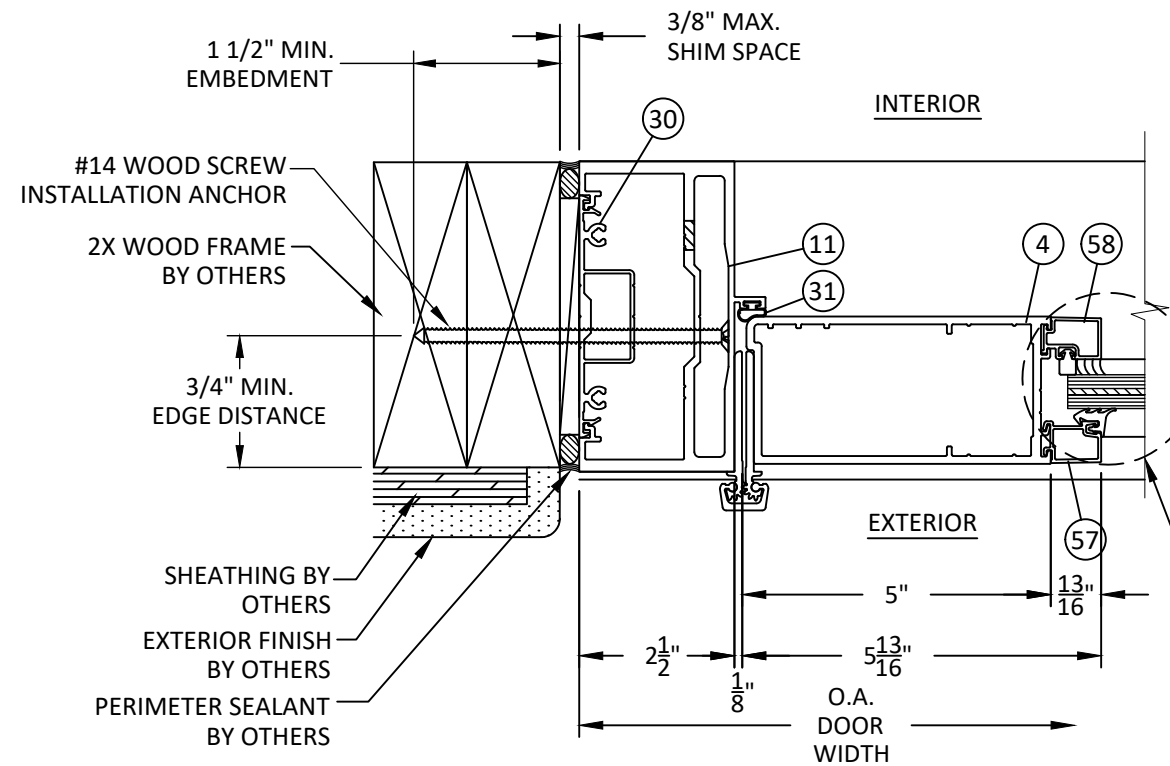

N HORIZONTAL SECTION
8 JAMB - 2XWOOD FRAME CONTINUOUS HINGE

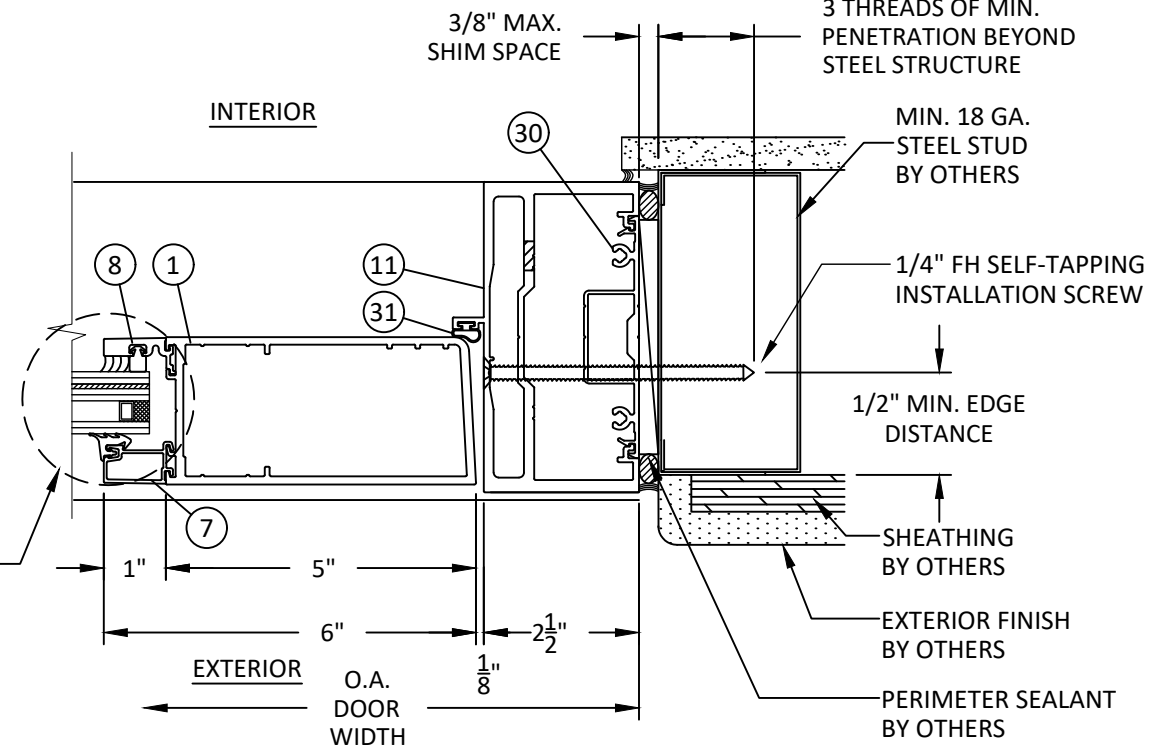

M HORIZONTAL SECTION
8 JAMB - STEEL STUD

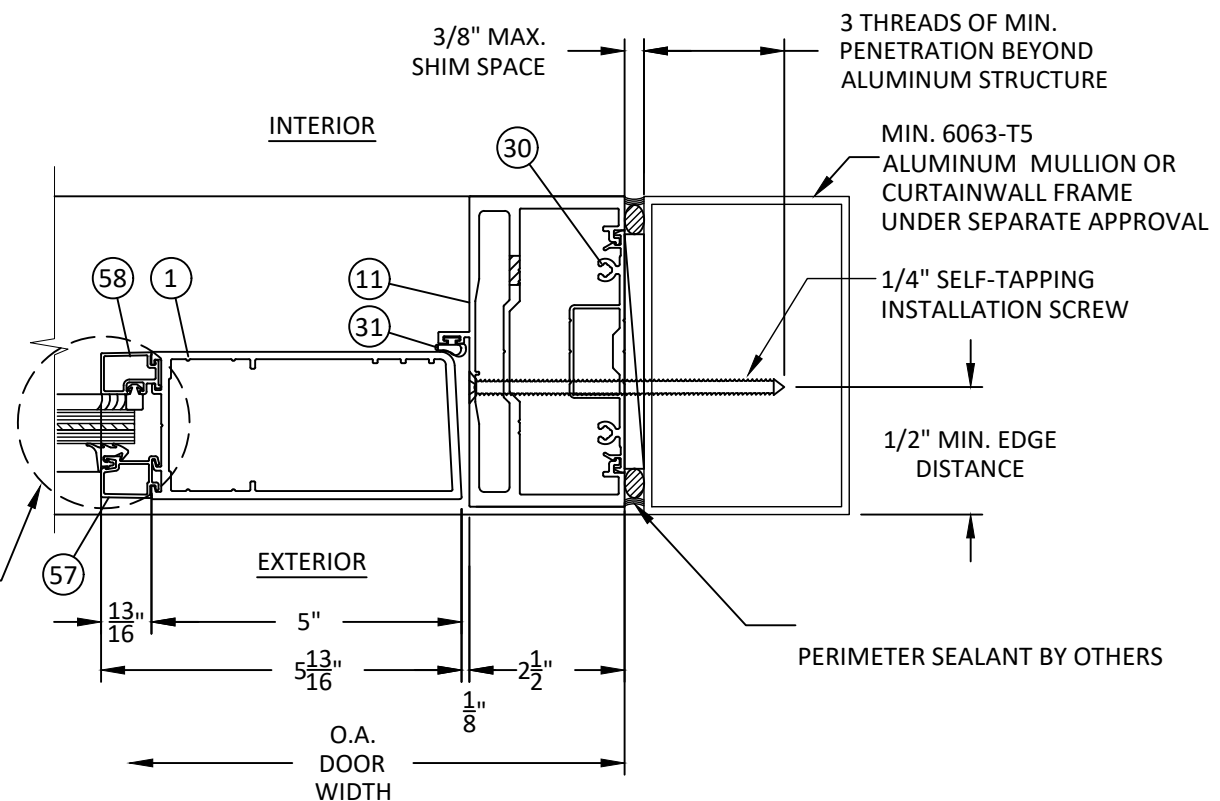

P HORIZONTAL SECTION
8 JAMB - ALUMINUM STUD



YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)

HORIZONTAL SECTIONS 1

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: FL16554


DATE: 09.14.18

DWG. BY: HR CHK. BY: HFN

SCALE: NTS


DWG. #: YKK021

SHEET: 8 REV. D

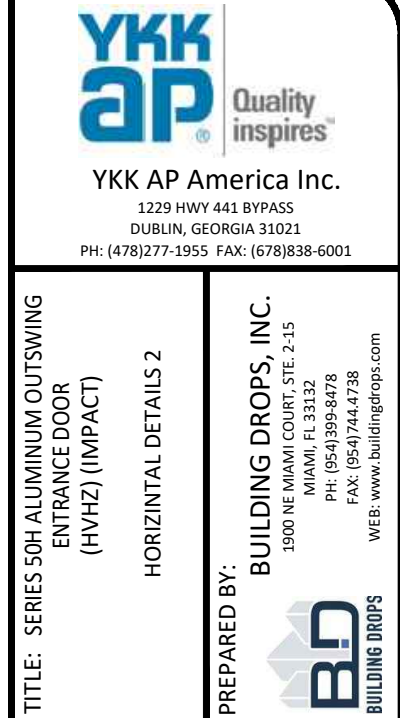

REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

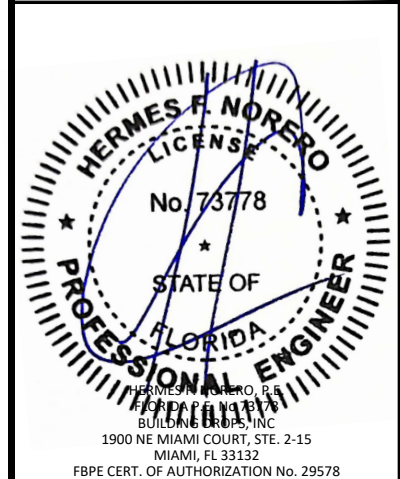


FL #:		FL16554	
DATE:		09.14.18	
DWG. BY:	HR	CHK. BY:	HFN
SCALE:		NTS	
DWG. #:		YKK021	
SHEET:		REV.	
9		D	

7/31/2026 9:51 AM


c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg

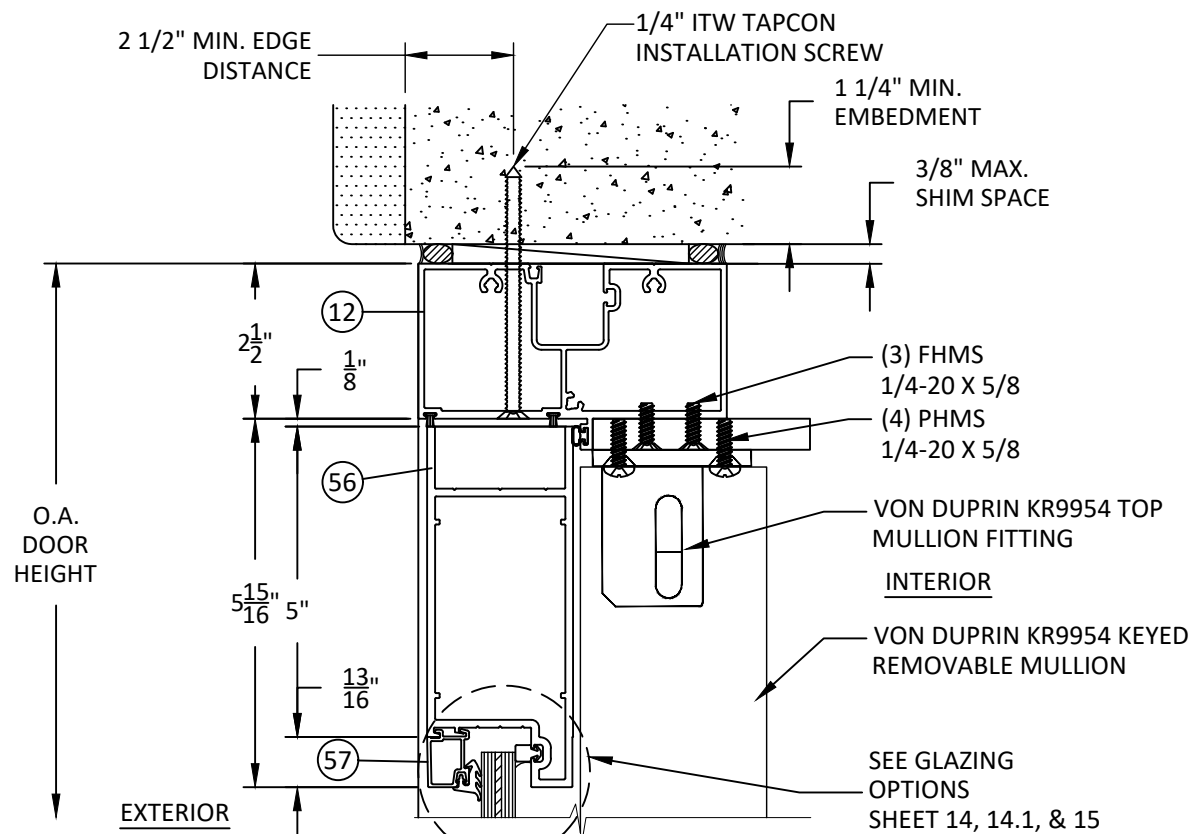

V
10
VERTICAL SECTION
HEAD - CONCRETE/MASONRY
REMOVABLE MULLION

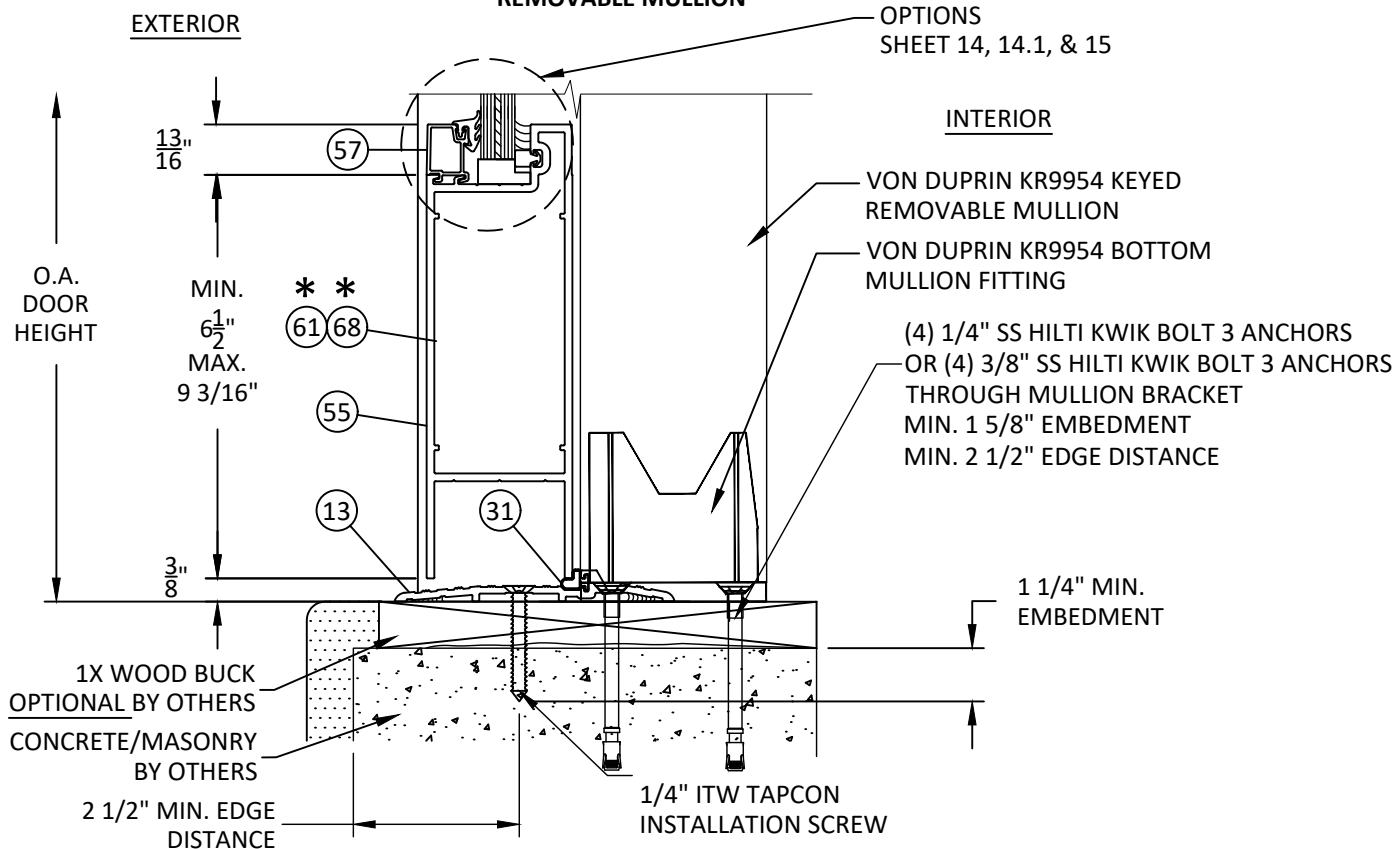


W
10
VERTICAL SECTION
SILL - CONCRETE/MASONRY
REMOVABLE MULLION

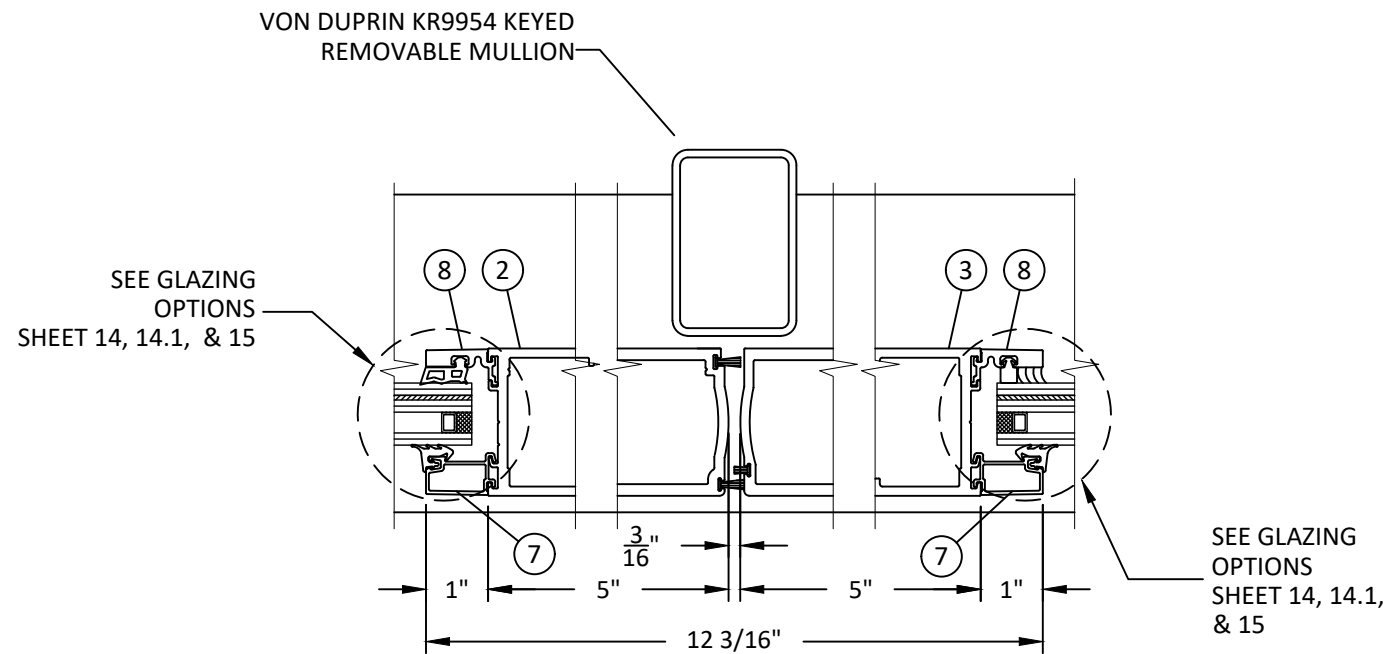

X
10
HORIZONTAL SECTION
MEETING STILE W/REMOVABLE MULLION

NOTE:
SEE ELEVATION B, SHEET 2 FOR DETAILS OF RIM
PANIC DEVICES. VON DUPRIN KR9954 KEYED
REMOVABLE MULLION TO BE USED WITH VON
DUPRIN HARDWARE ONLY.

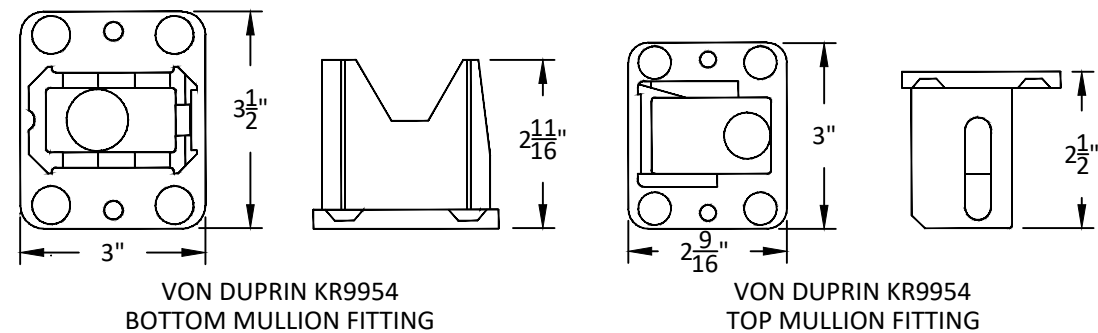

YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)

HORIZONTAL/VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

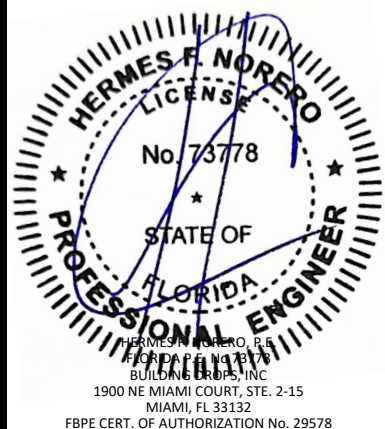

FL #:

FL16554

DATE: **09.14.18**

DWG. BY: **HR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **YKK021**



SHEET:

10

REV.
D

7/31/2026 9:51 AM

c:\users\sebastianhereros\desktop\ykk 2026 ca\116554\ykk021.dwg

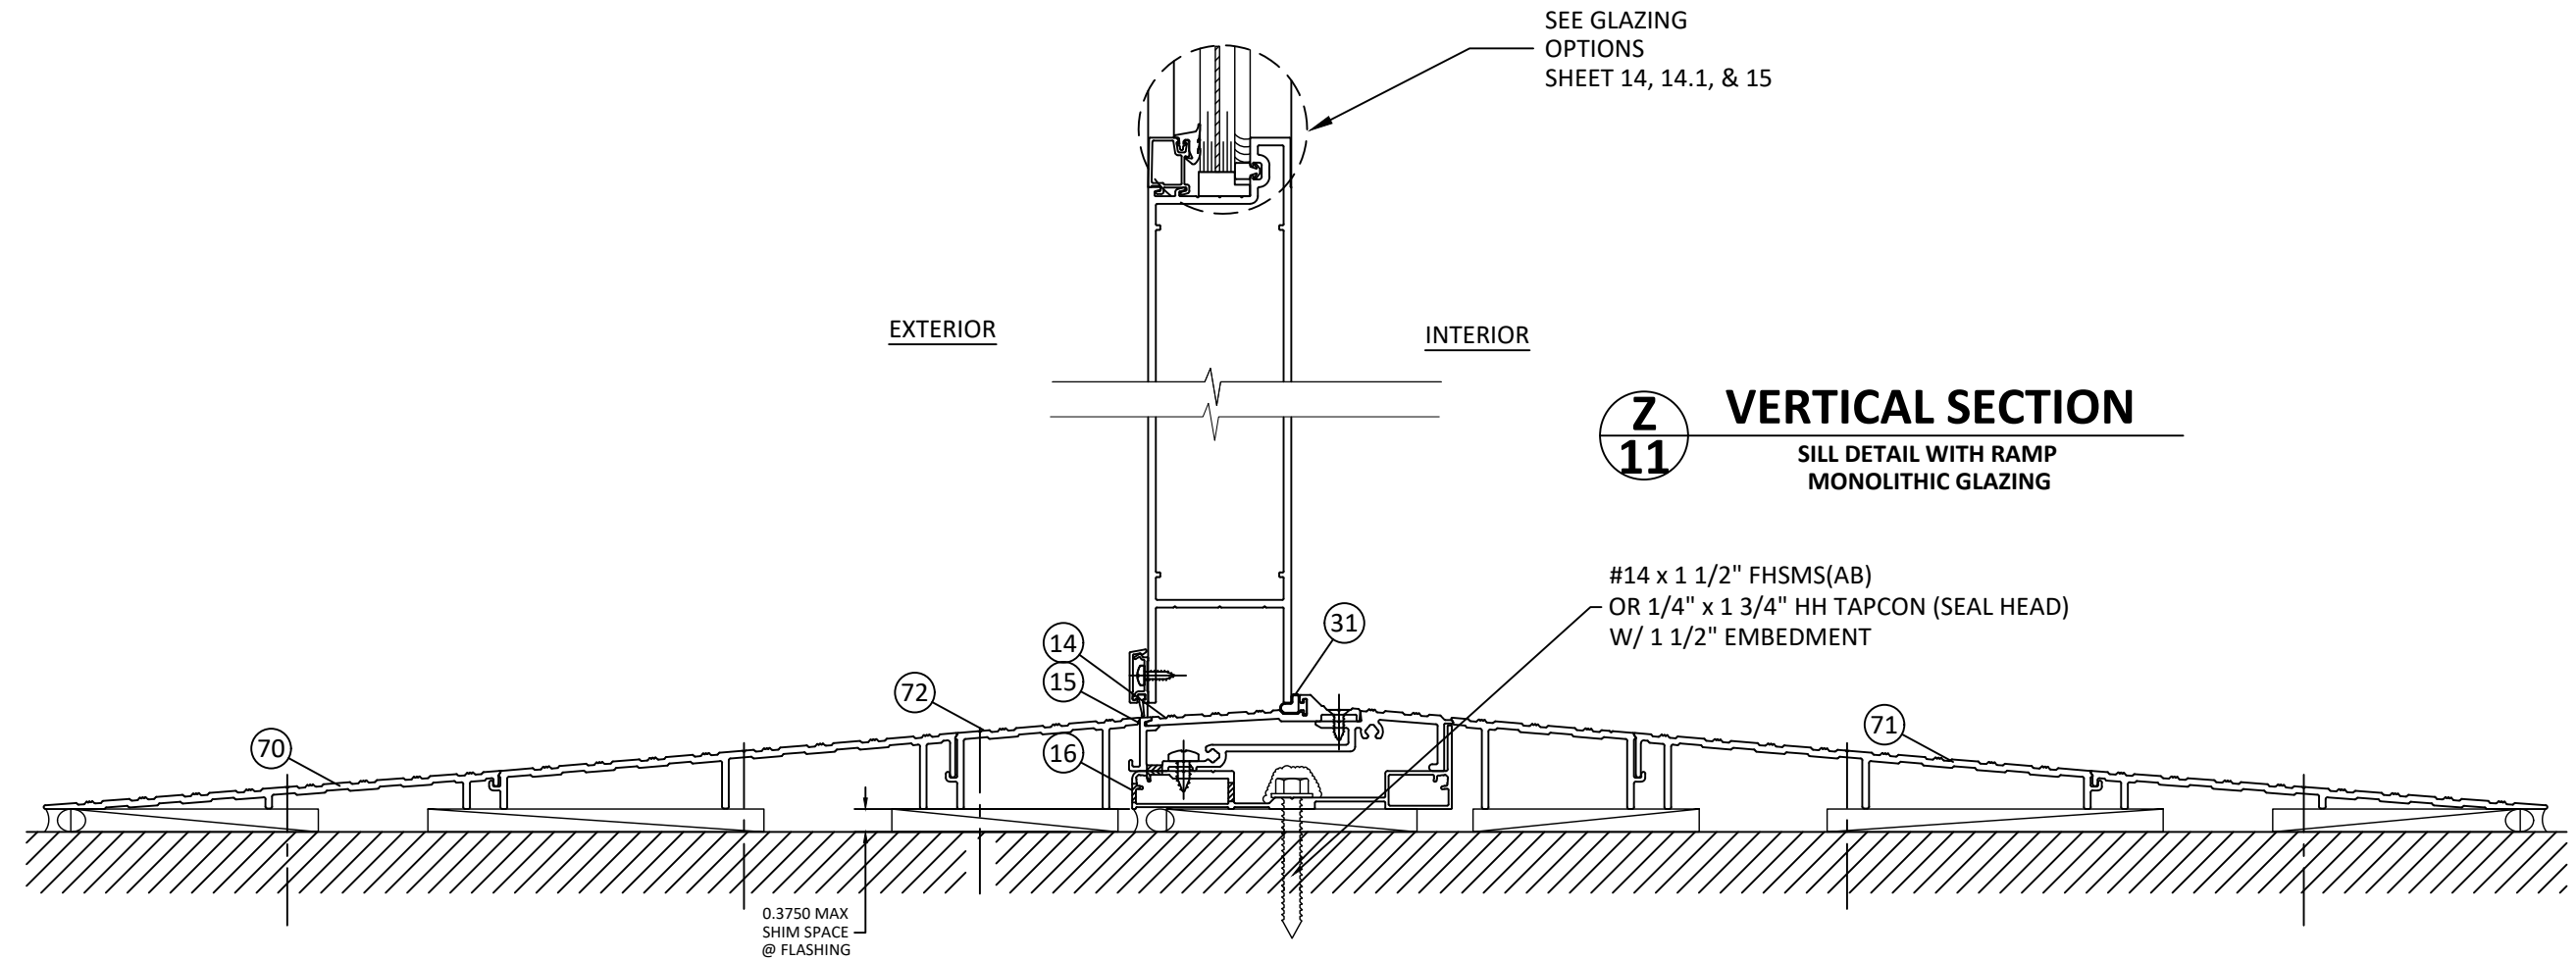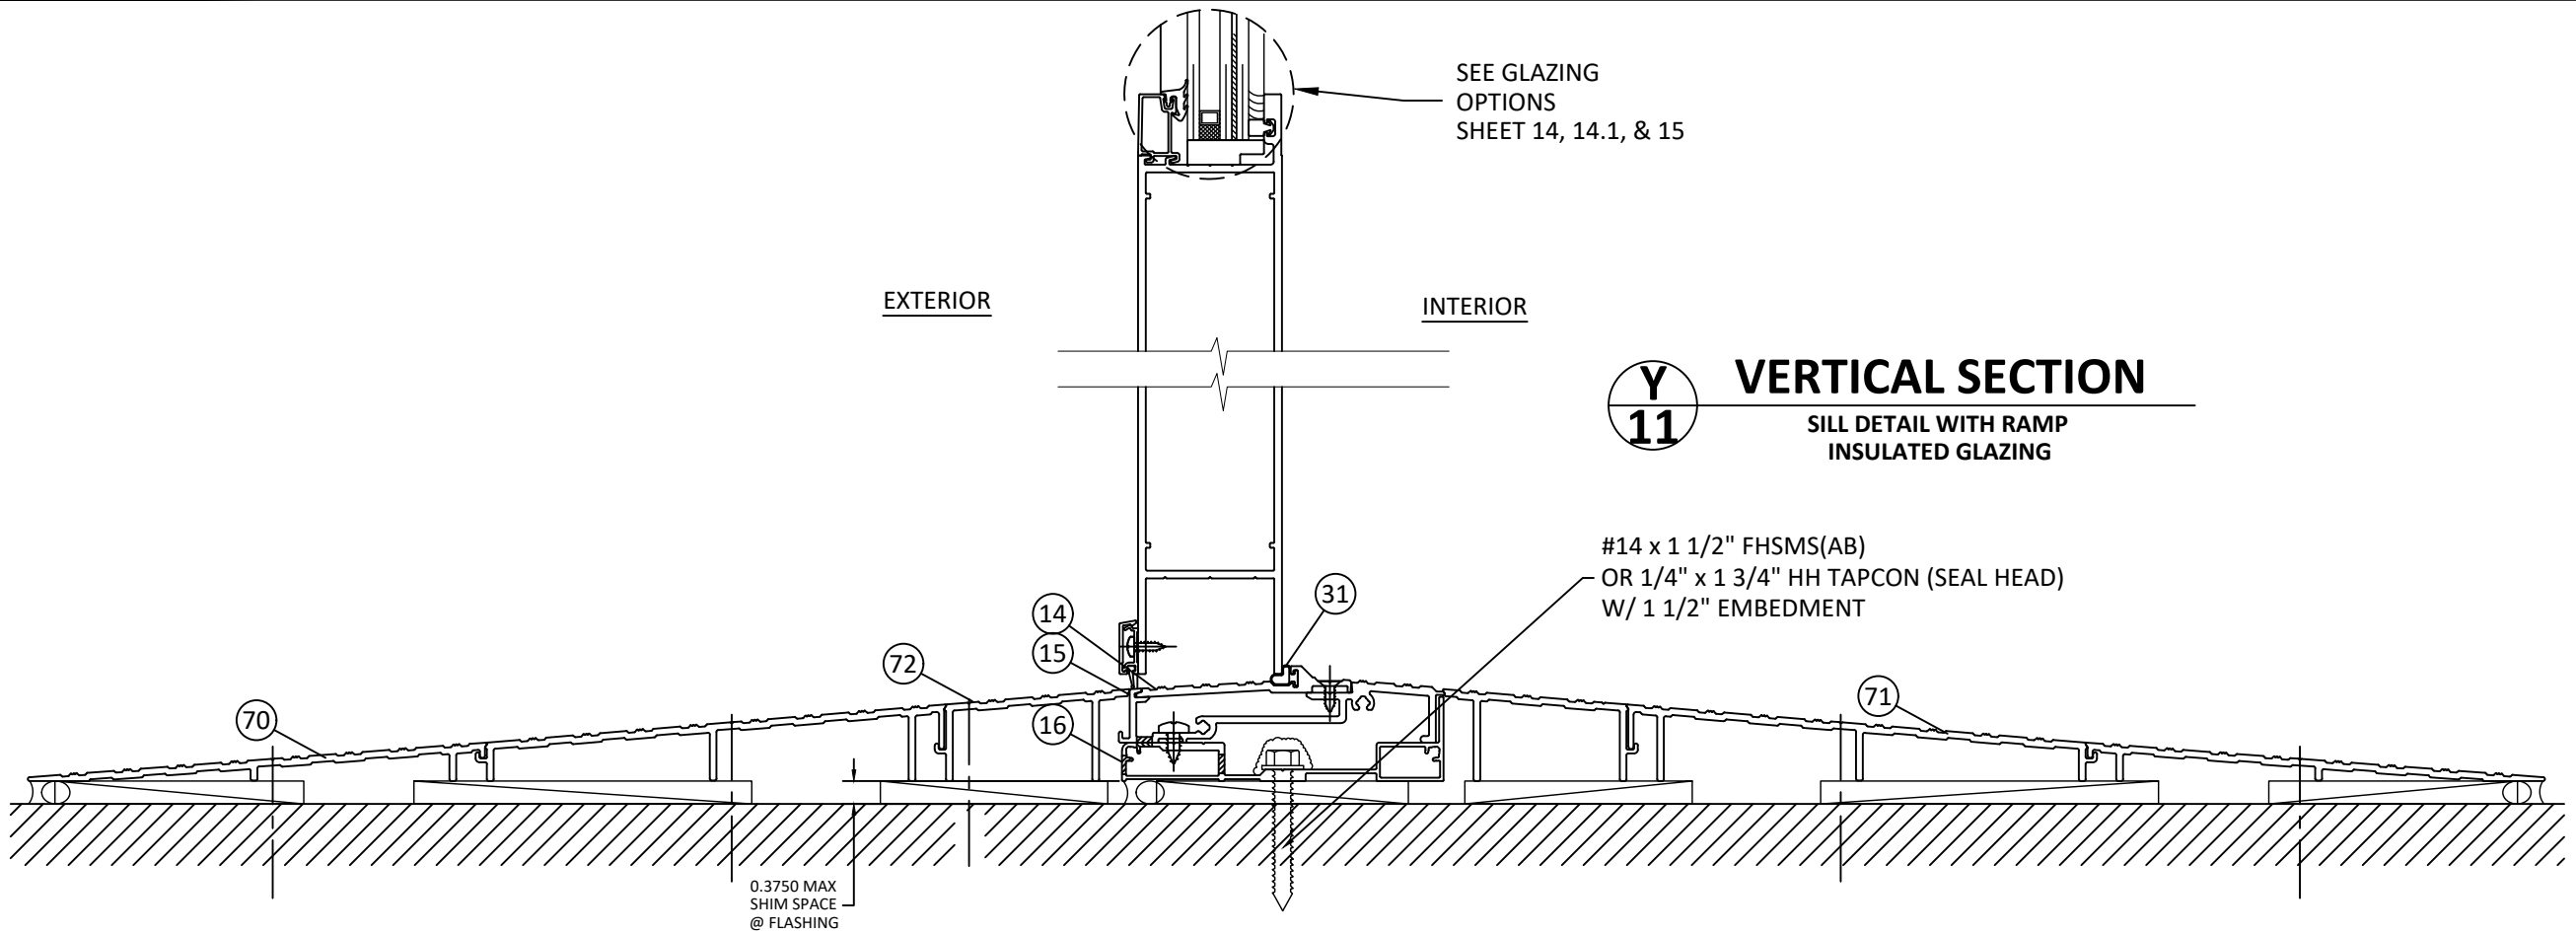

YKK AP America Inc.

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)

SILL DETAIL WITH RAMP

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL16554**

DATE: **09.14.18**

DWG. BY: **HR** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **YKK021**

SHEET: **11** REV. **D**


7/31/2026 9:51 AM

c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg

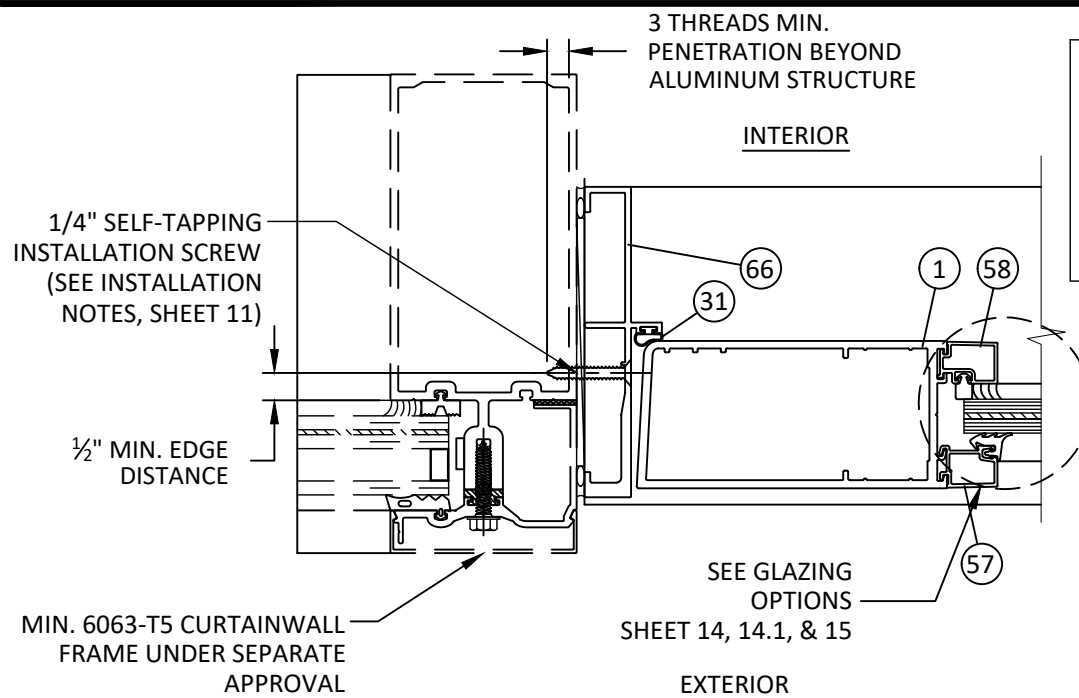


- NOTES:
- A. CURTAINWALL SUBFRAME IS LIMITED TO A MAXIMUM SIZE OF 78 1/2" X 98 1/2".
 - B. CURTAINWALL SUBFRAME MAY ONLY BE USED WITH APPLICABLE HARDWARE.
 - C. BUTT HINGE SHOWN, CONTINUOUS HINGES MAY ALSO BE USED.

- INSTALLATION NOTES:
- A. AT HEAD, USE CLUSTERS OF (3) ANCHORS AT EACH CORNER, SPACED 4 1/2" MAX. FROM CORNERS AND 3" O.C. THEREAFTER.
 - B. (DOUBLE DOORS ONLY) AT HEAD, USE CLUSTER OF (8) ANCHORS AT MIDSPAN, SPACED 2" FROM EITHER SIDE OF MIDSPAN AND 3" O.C. THEREAFTER.
 - C. AT JAMBS, USE ANCHORS SPACED 5 1/2" MAX. FROM CORNERS AND 9 3/4" MAX. O.C. THEREAFTER.

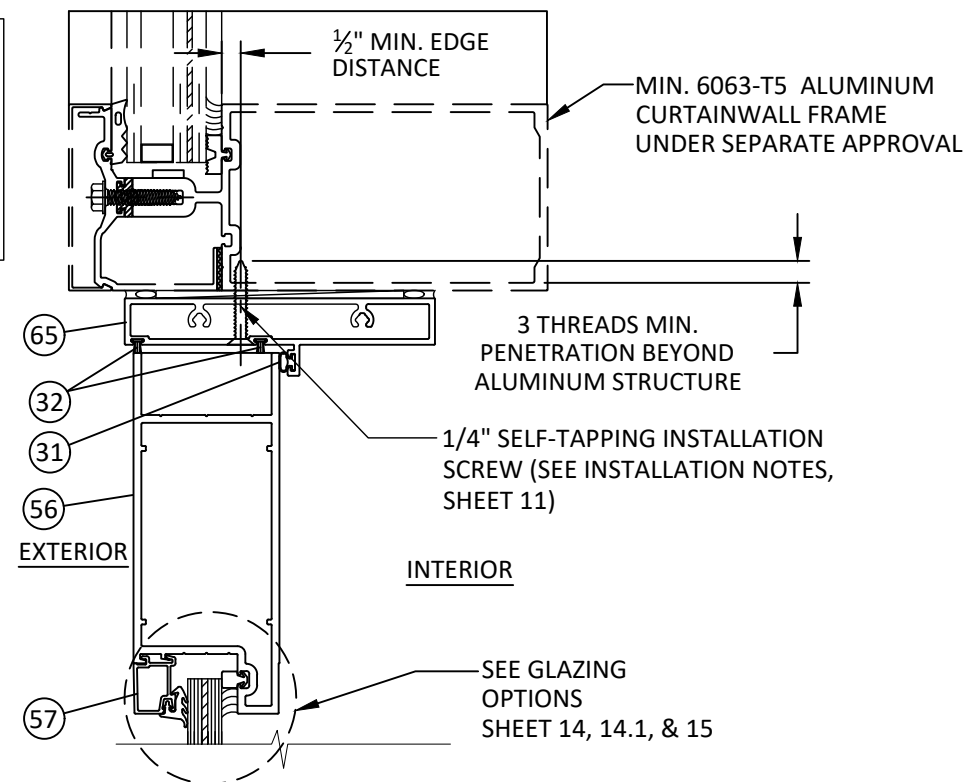


AA
12 **HORIZONTAL SECTION**
JAMB - SUBFRAME TO CURTAINWALL


AB
12 **VERTICAL SECTION**
HEAD - SUBFRAME TO CURTAINWALL
OPTIONAL
(STANDARD IN B/5)

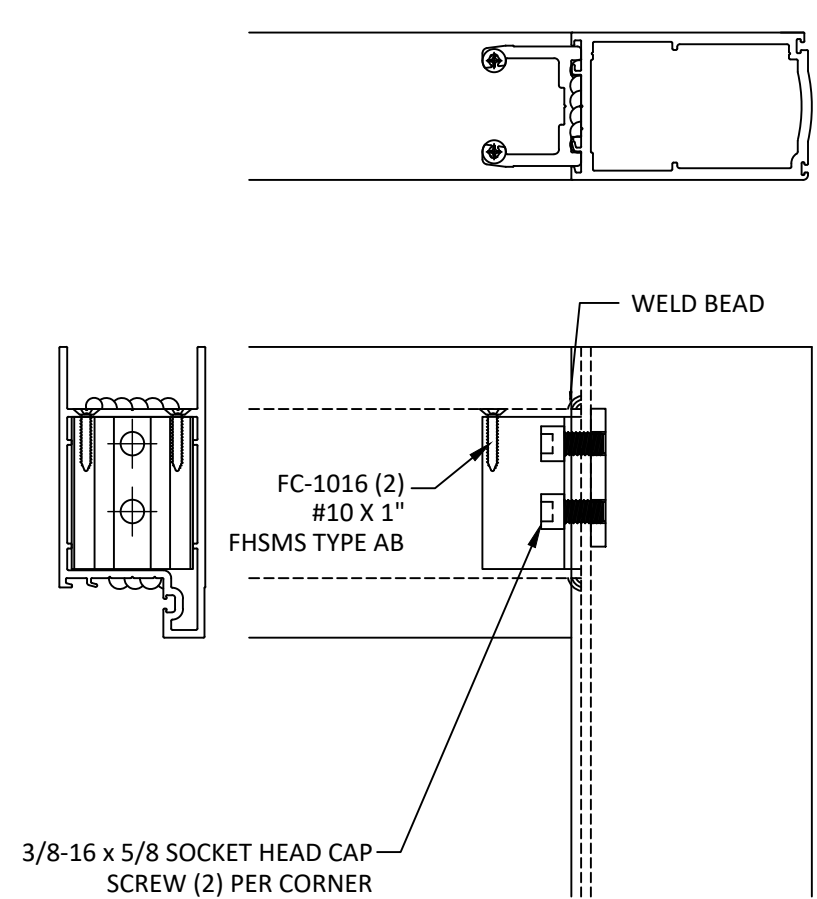

DOOR CORNER DETAIL 1
HEAD - TYPICAL

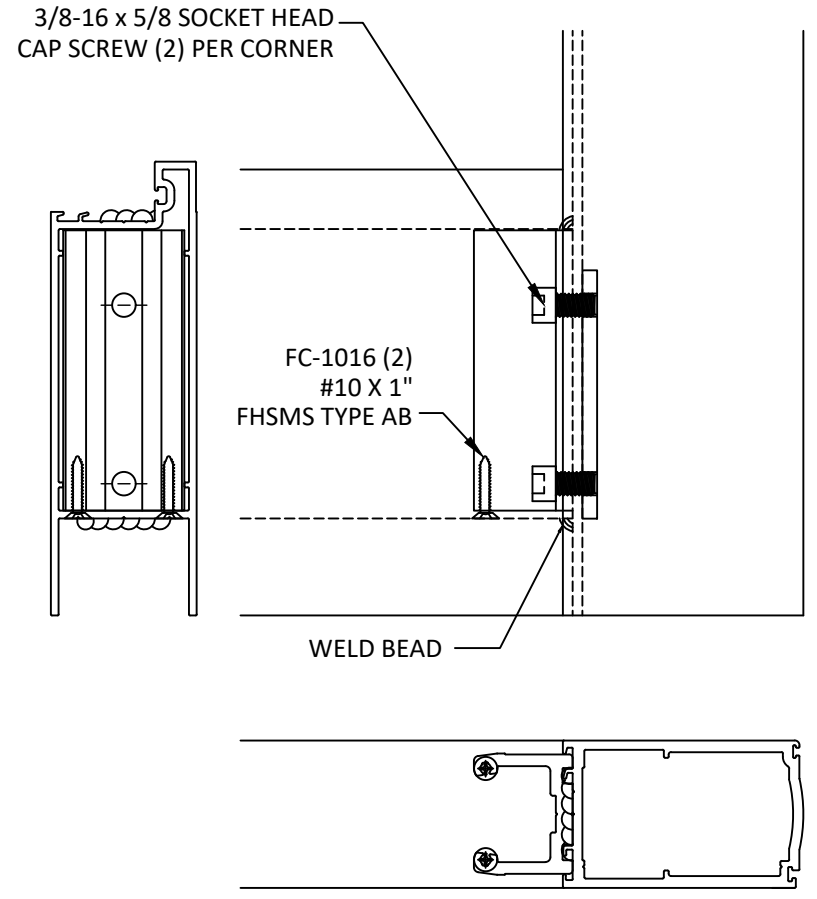

DOOR CORNER DETAIL 2
SILL - TYPICAL

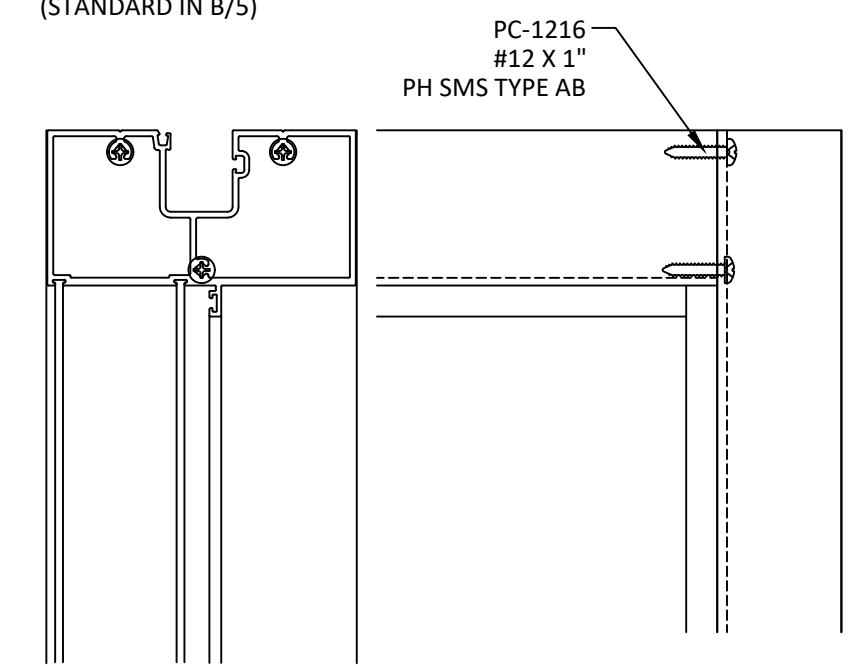

CW WITH STANDARD TRANSOM DETAIL 3

YKK AP Quality inspires™

YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING ENTRANCE DOOR (HVHZ) (IMPACT)

CURTAINWALL INSTALLATION & DOOR CORNER DETAILS

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

B.D. BUILDING DROPS

REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL16554**

DATE: **09.14.18**


DWG. BY: HR	CHK. BY: HFN
--------------------	---------------------

SCALE: **NTS**


DWG. #: **YKK021**

SHEET: 12	REV. D
------------------	---------------

c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg 7/31/2026 9:51 AM

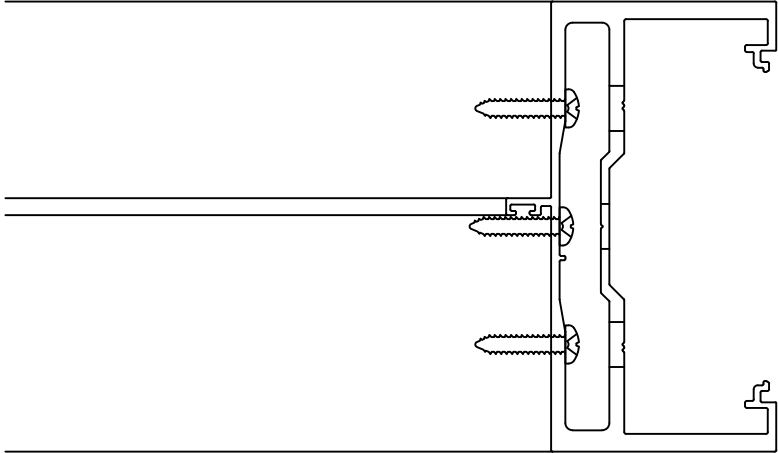


PC-1216 (3)
#12 x 1"
PH SMS AB TYPE

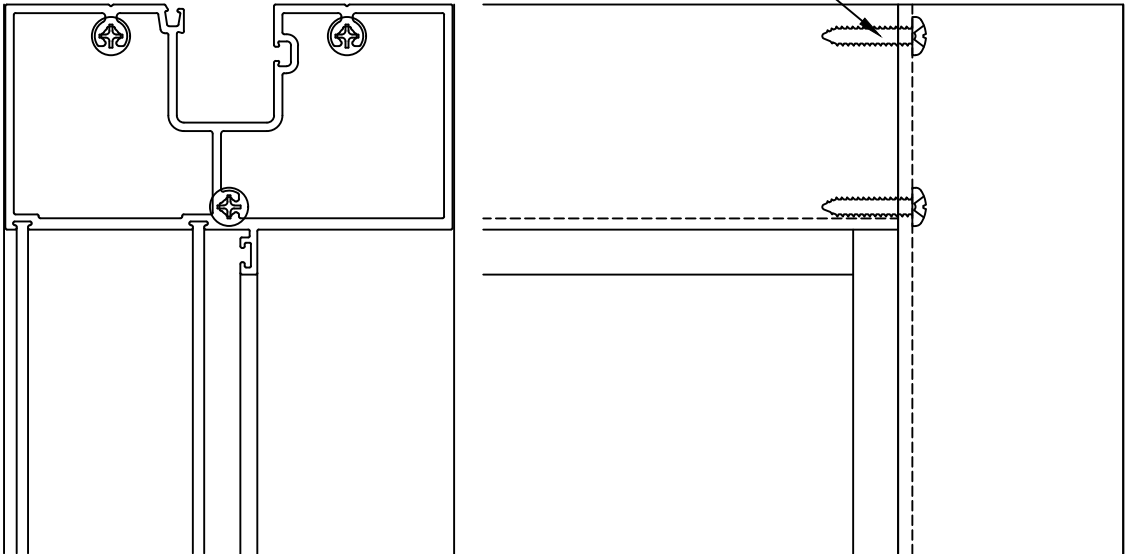


FRAME CORNER DETAIL 1

HEAD - TYPICAL

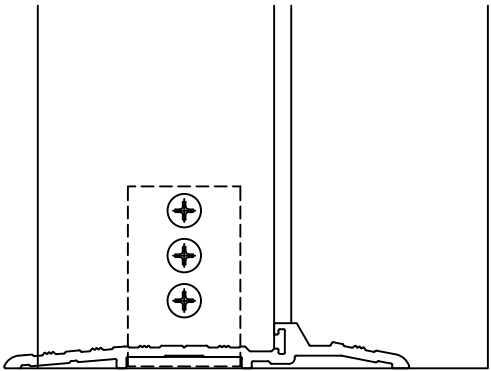


FM1006 (3)
#10-24 X 3/8"
FH MS

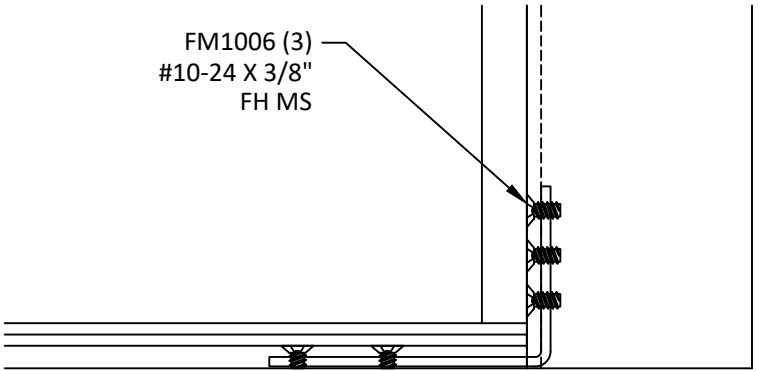


FRAME CORNER DETAIL 2

SILL - 4 1/2" AIR TIGHT THRESHOLD

THRESHOLD CLIP PART NO. 29 (E1-1056) IS NOT REQUIRED IN APPLICATIONS WITH RIXSON PIVOTS OR SINGLE DOORS WITH THE VON DUPRIN 9947 DEVICES.

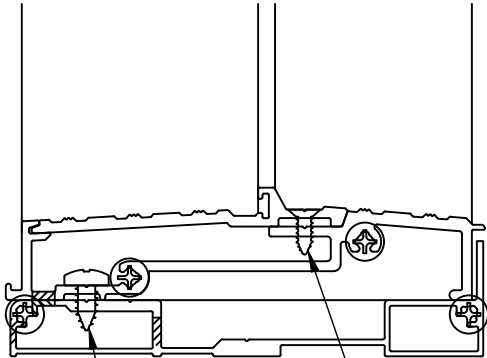

FM1004 (2)
#10-24 X 1/4"
FH MS

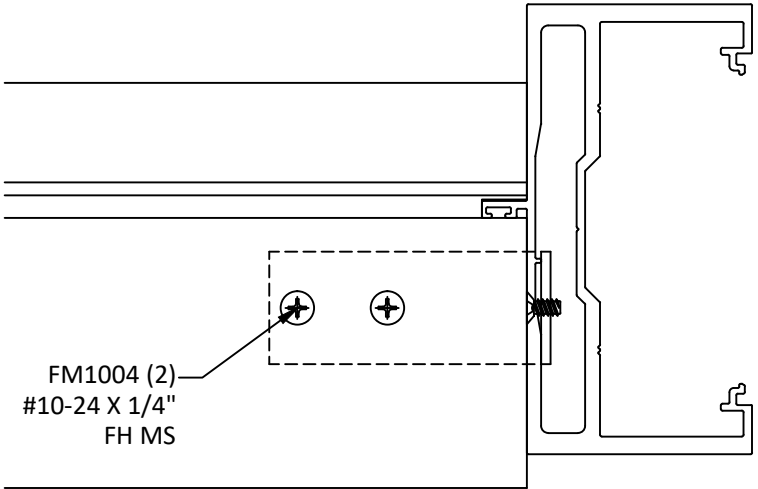


FRAME CORNER DETAIL 3

SILL - AIR AND WATER RESISTANT THRESHOLD


#14 X 1/2" PHSMS
TYPE "AB"

#10 X 1/2" FHSMS
TYPE "AB"

PC-1216 (2)
#12 x 1"
FH SMS AB TYPE

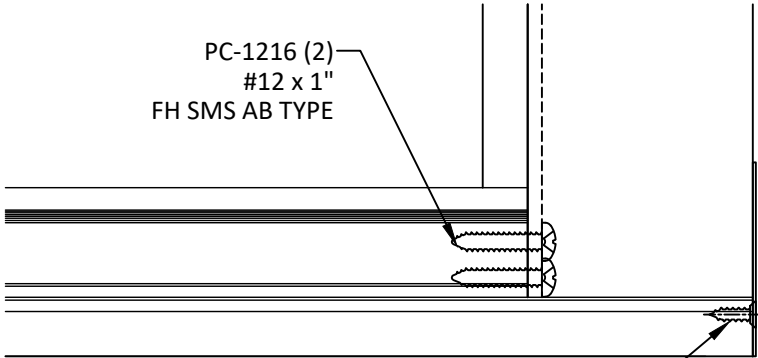

UA-1212 (2)
#12 x 3/4"
UFH SMS TYPE A

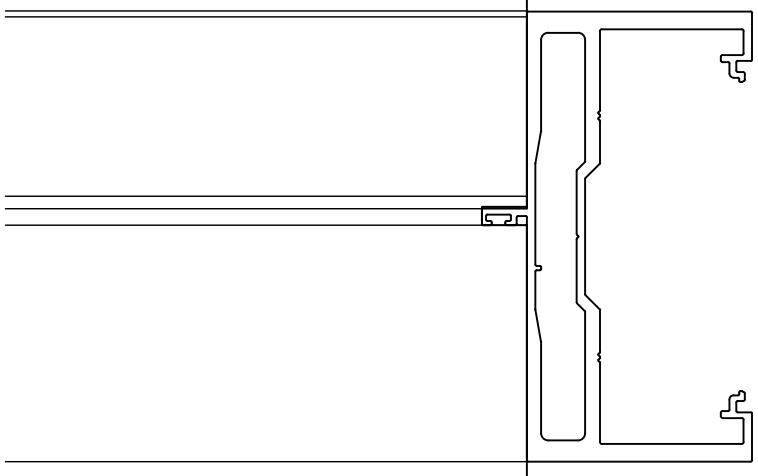

YKK AP America Inc.

1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)

FRAME CORNER DETAILS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: FL16554

DATE: 09.14.18


DWG. BY: HR CHK. BY: HFN

SCALE: NTS


DWG. #: YKK021

SHEET: 13 REV. D


LARGE & SMALL MISSILE IMPACT

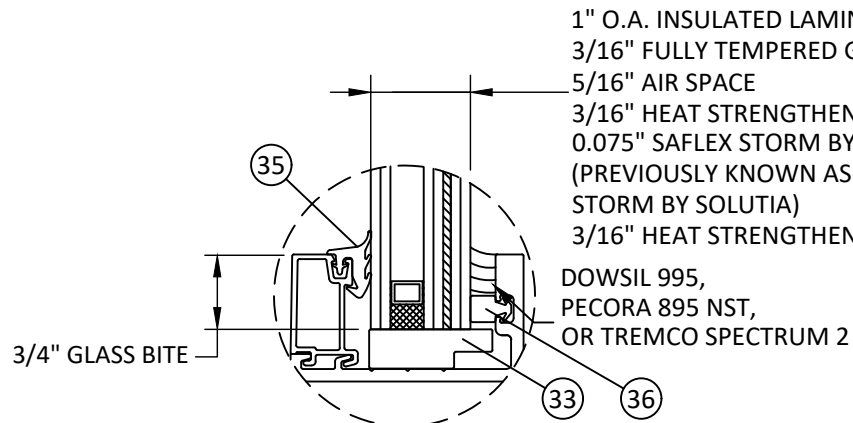


GLAZING DETAIL A

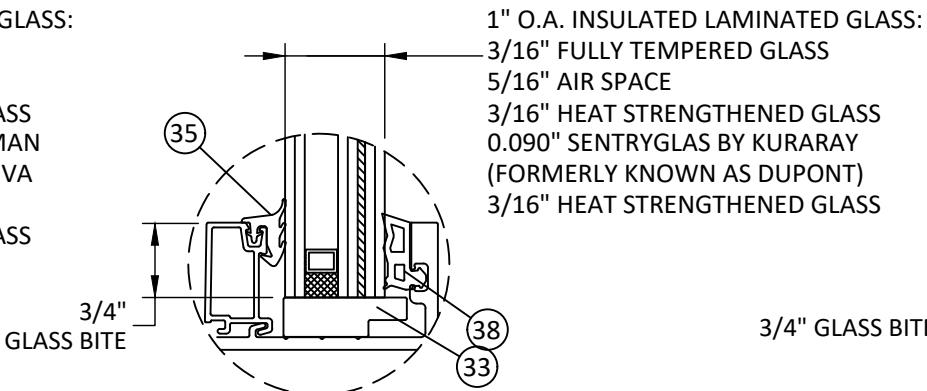


GLAZING DETAIL B
DRY GLAZED

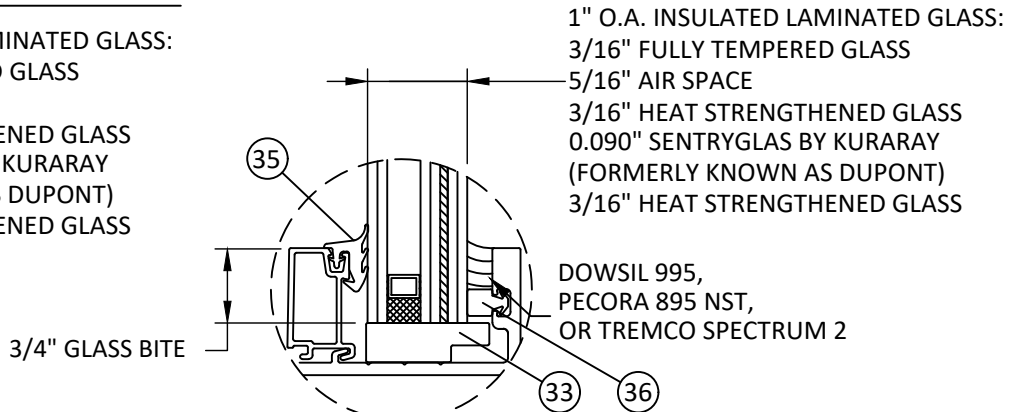


GLAZING DETAIL C

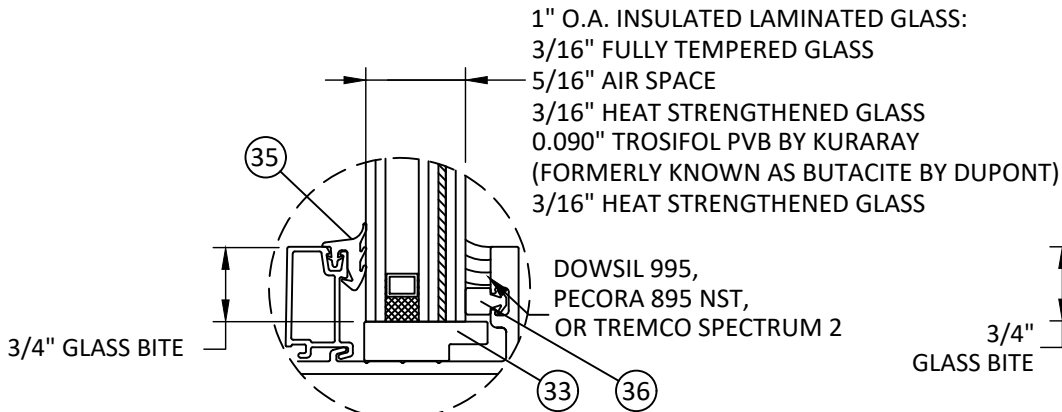


GLAZING DETAIL D

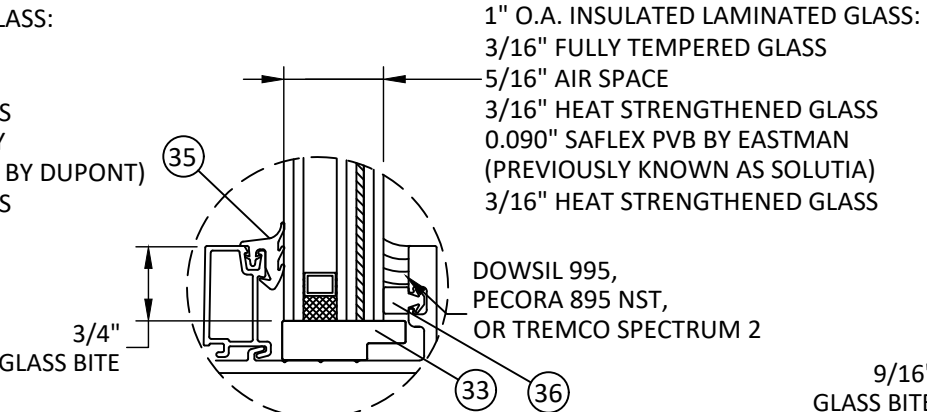


GLAZING DETAIL E

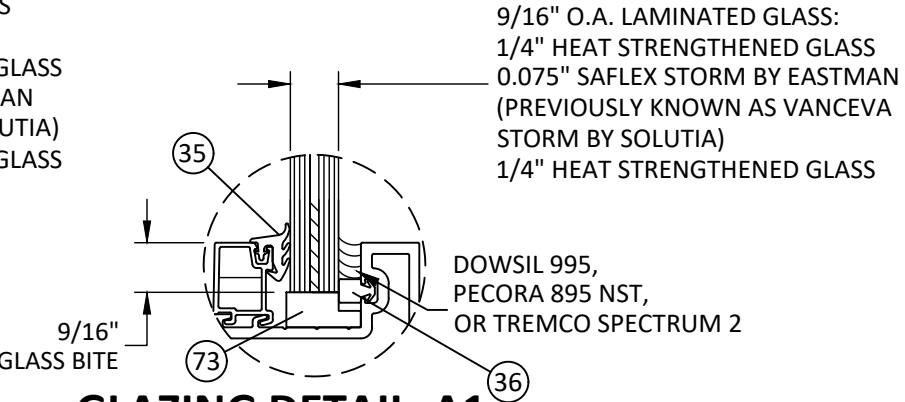


GLAZING DETAIL A1

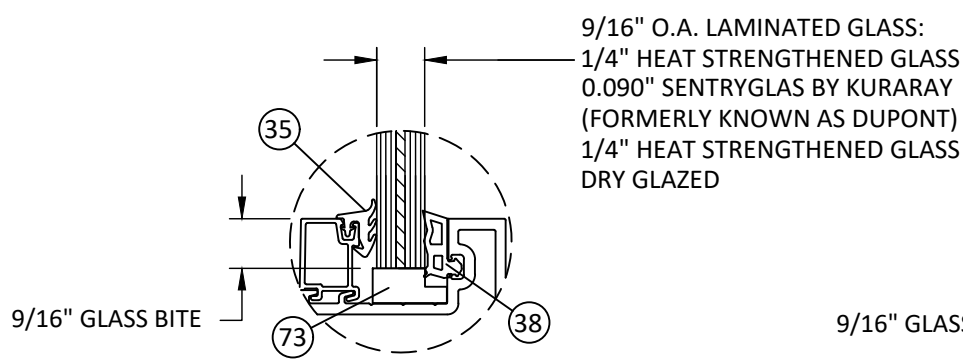


GLAZING DETAIL B1
DRY GLAZED

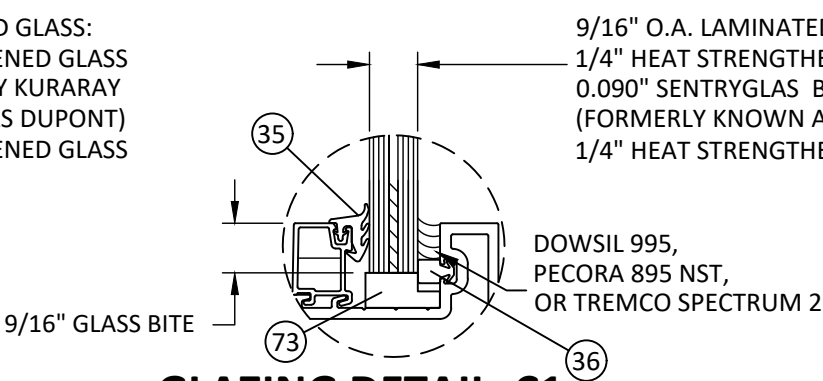

GLAZING DETAIL C1

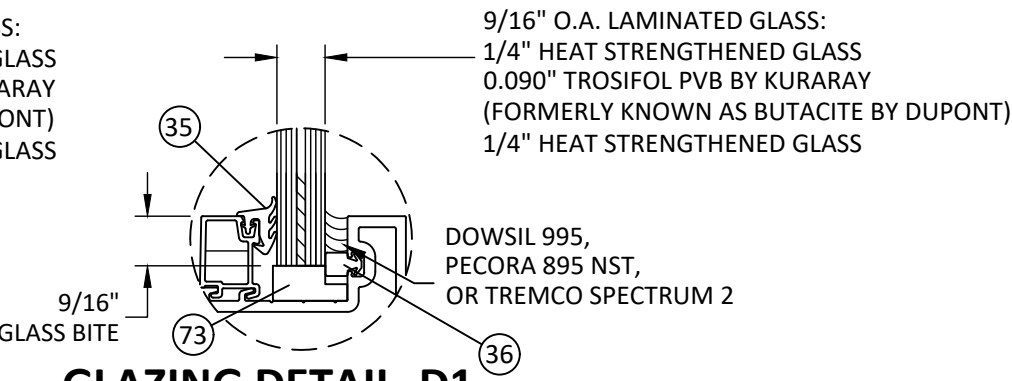

GLAZING DETAIL D1

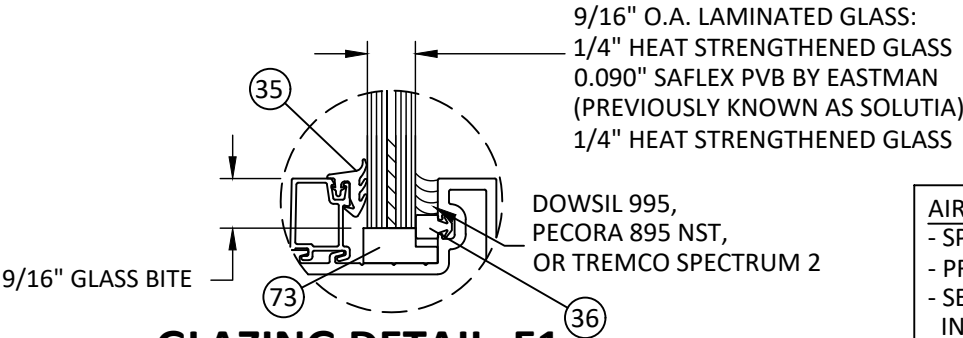

GLAZING DETAIL E1

AIR SPACE CONSISTING OF :
- SPACER: ALUMINUM BOX SPACER.
- PRIMARY SEALANT: POLYISOBUTYLENE (PIB).
- SECONDARY SEALANT: STRUCTURAL SILICONE
INTENDED FOR FABRICATION OF INSULATING
GLASS UNITS.

- GLAZING NOTES:
- GLASS TYPE AND THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - DOOR D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN ON SHEET 1. TRANSOM D.L.O. SHALL NOT EXCEED DIMENSIONS SHOWN ON SHEETS 2, 3, 3.1, & 3.2, AND DESIGN PRESSURES SHALL NOT EXCEED VALUES SHOWN ON SHEETS 1, 14.1 & AND 15.



YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)


GLAZING DETAILS 1

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

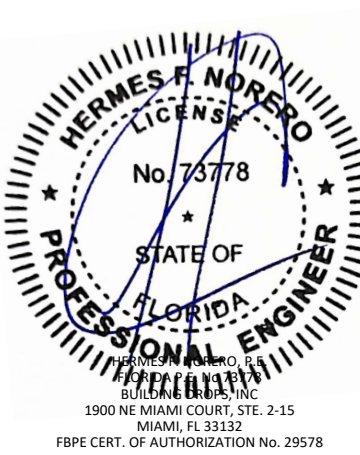

FL #:	FL16554
DATE:	09.14.18
DWG. BY:	HR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK021
SHEET:	14
REV.	D

LARGE & SMALL MISSILE IMPACT CONTINUED


1-5/16" O.A. INSULATED LAMINATED GLASS CONSISTING OF:
1/4" TEMPERED GLASS,
1/2" AIR SPACE,
1/4" HEAT STRENGTHENED GLASS,
0.090" TROSIFOL BY KURARAY,
(FORMERLY KNOWN AS BUTACITE BY DUPONT)
1/4" HEAT STRENGTHENED GLASS

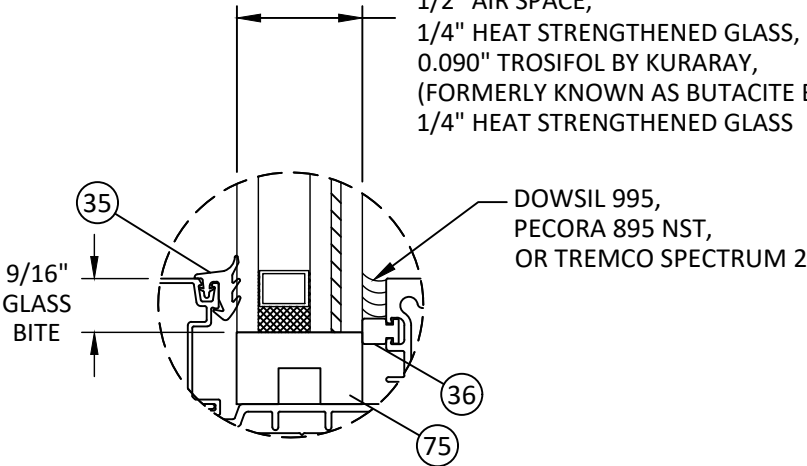

GLAZING DETAIL F
TRANSOM

DP LIMIT	
+50	-50


1-5/16" O.A. INSULATED LAMINATED GLASS CONSISTING OF:
1/4" TEMPERED GLASS,
1/2" AIR SPACE,
1/4" HEAT STRENGTHENED GLASS,
0.090" SAFLEX PVB BY EASTMAN
(PREVIOUSLY KNOWN AS SOLUTIA)
1/4" HEAT STRENGTHENED GLASS

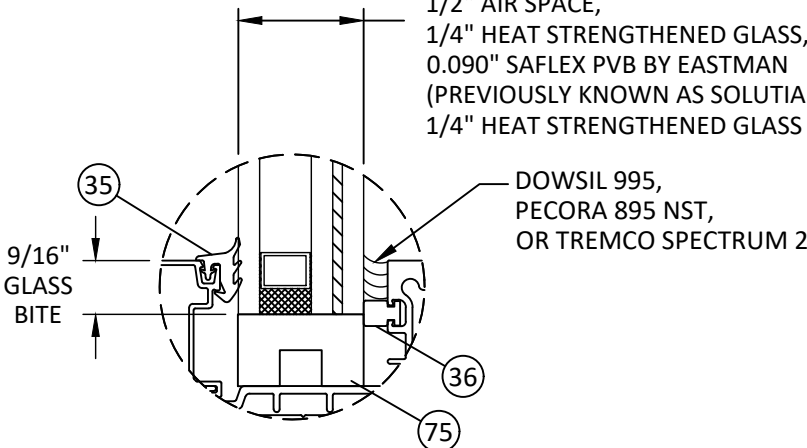

GLAZING DETAIL G
TRANSOM

DP LIMIT	
+50	-50


1-5/16" O.A. INSULATED LAMINATED GLASS CONSISTING OF:
1/4" TEMPERED GLASS,
1/2" AIR SPACE,
1/4" HEAT STRENGTHENED GLASS,
0.090" SENTRYGLAS BY KURARAY,
(FORMERLY KNOWN AS DUPONT)
1/4" HEAT STRENGTHENED GLASS

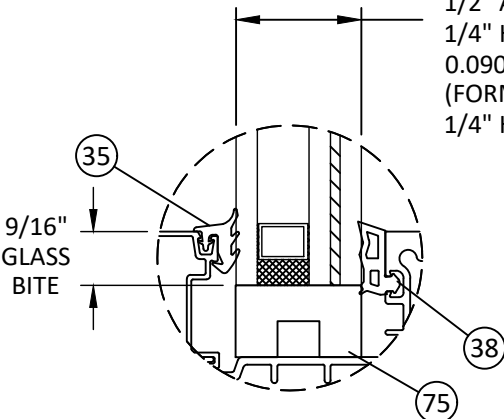

GLAZING DETAIL H
DRY GLAZED
TRANSOM

DP LIMIT	
+70	-90


1-5/16" O.A. INSULATED LAMINATED GLASS CONSISTING OF:
1/4" TEMPERED GLASS,
1/2" AIR SPACE,
1/4" HEAT STRENGTHENED GLASS,
0.075" SAFLEX STORM BY EASTMAN
(PREVIOUSLY KNOWN AS VANCEVA STROM
BY SOLUTIA)
1/4" HEAT STRENGTHENED GLASS

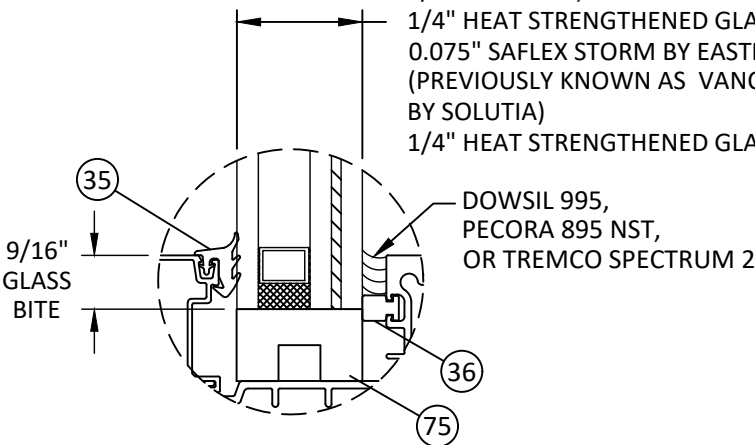

GLAZING DETAIL I
TRANSOM

DP LIMIT	
+70	-70

1-5/16" O.A. INSULATED LAMINATED GLASS CONSISTING OF:
1/4" TEMPERED GLASS,
1/2" AIR SPACE,
1/4" HEAT STRENGTHENED GLASS,
0.090" SENTRYGLAS BY KURARAY,
(FORMERLY KNOWN AS DUPONT)
1/4" HEAT STRENGTHENED GLASS

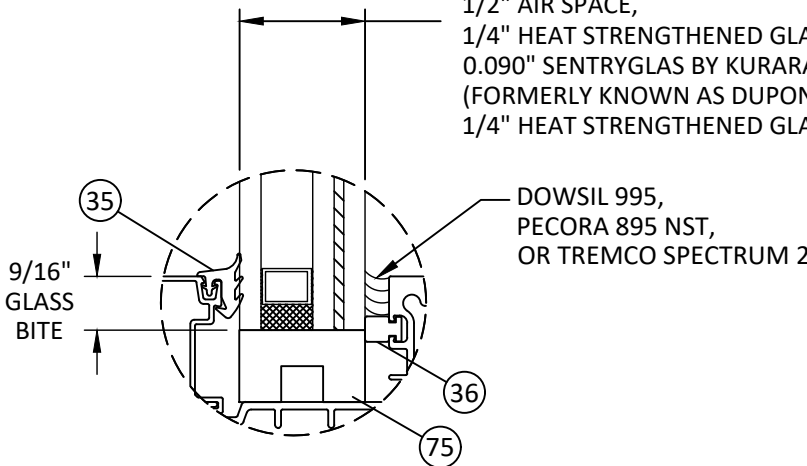

GLAZING DETAIL J
TRANSOM

DP LIMIT	
+70	-70

AIR SPACE CONSISTING OF :
- SPACER: ALUMINUM BOX SPACER.
- PRIMARY SEALANT: POLYISOBUTYLENE (PIB).
- SECONDARY SEALANT: STRUCTURAL SILICONE
INTENDED FOR FABRICATION OF INSULATING
GLASS UNITS.

- GLAZING NOTES:
- GLASS TYPE AND THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - DOOR D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN ON SHEET 1. TRANSOM D.L.O. SHALL NOT EXCEED DIMENSIONS SHOWN ON SHEETS 2, 3, 3.1, & 3.2, AND DESIGN PRESSURES SHALL NOT EXCEED VALUES SHOWN ON SHEETS 1, 14.1 & AND 15.



YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)
GLAZING DETAILS 1
CONTINUED

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL16554

DATE: **09.14.18**

DWG. BY: **HR** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **YKK021**


SHEET: **14.1** REV. **D**

c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg 7/31/2026 9:51 AM


SMALL MISSILE IMPACT ONLY

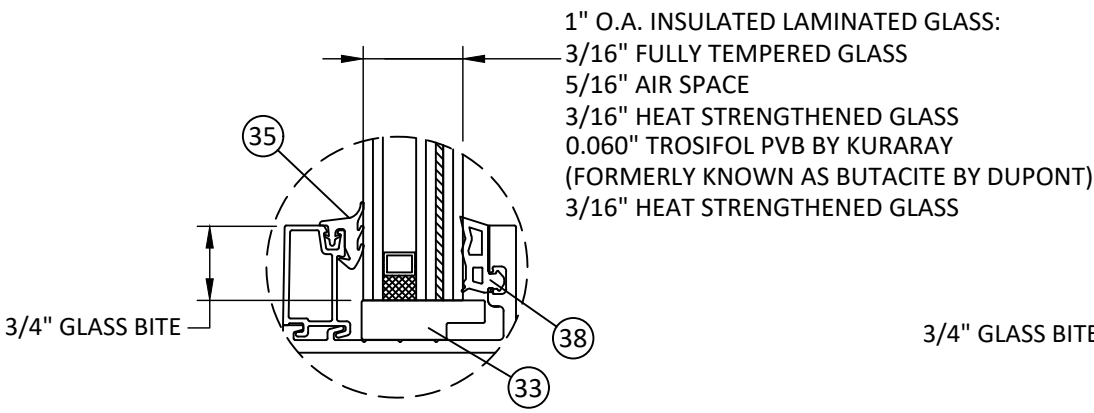


GLAZING DETAIL K
DRY GLAZED

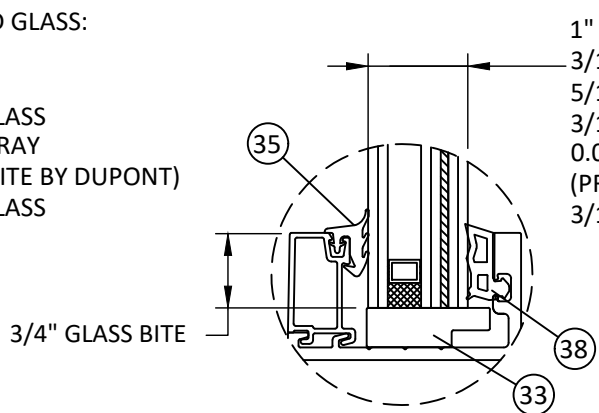


GLAZING DETAIL L
DRY GLAZED

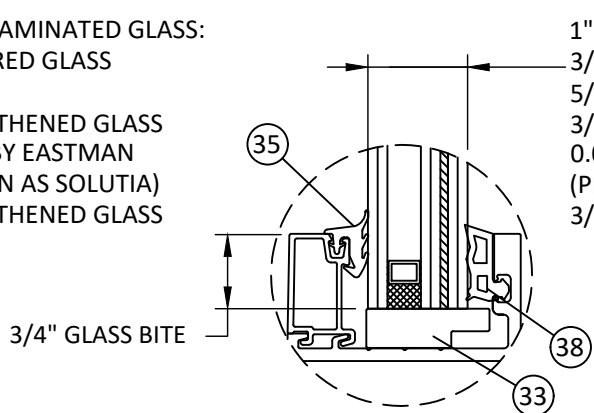


GLAZING DETAIL M
DRY GLAZED

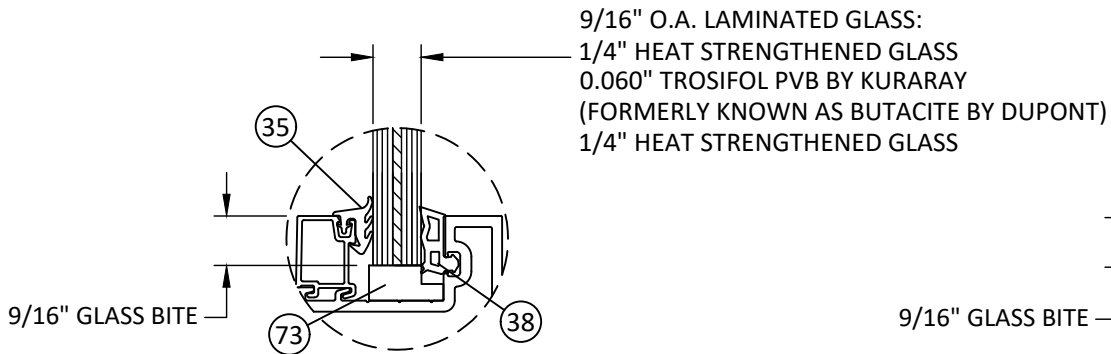

GLAZING DETAIL K1
DRY GLAZED

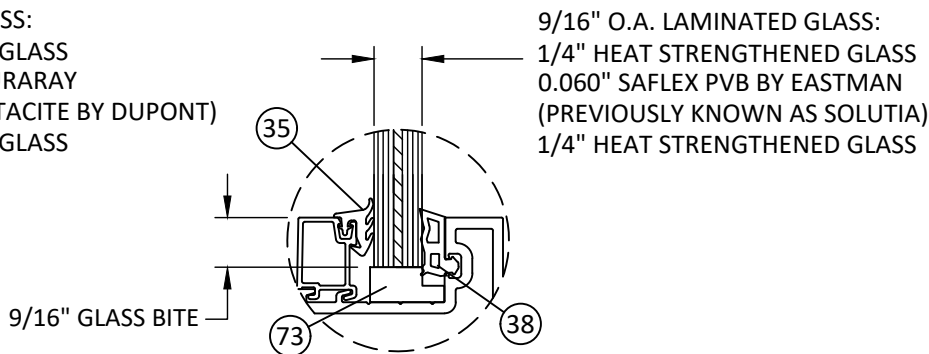


GLAZING DETAIL L1
DRY GLAZED

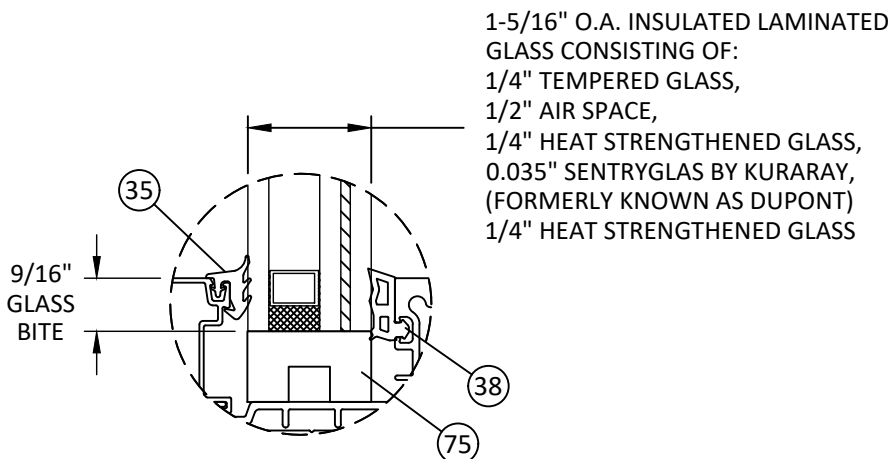


GLAZING DETAIL N
DRY GLAZED
TRANSOM

DP LIMIT	
+70	-90

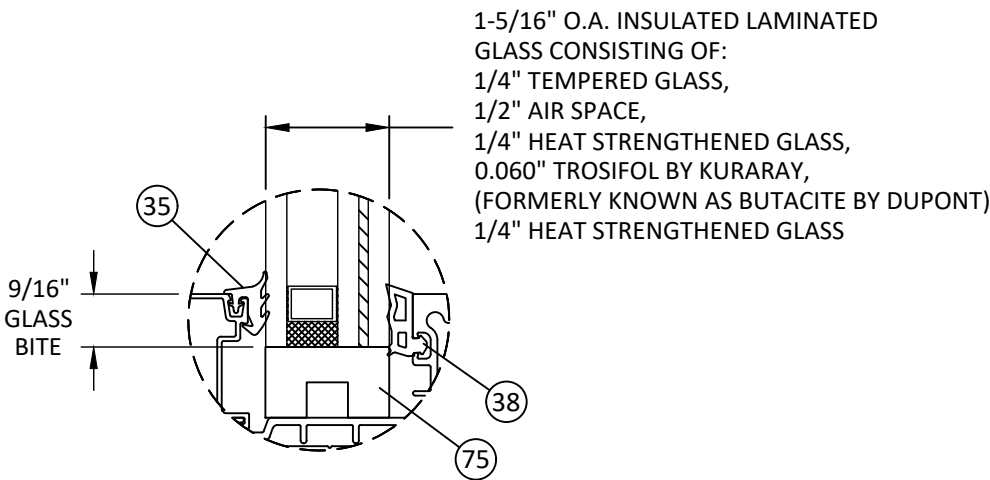

GLAZING DETAIL O
DRY GLAZED
TRANSOM

DP LIMIT	
+70	-90

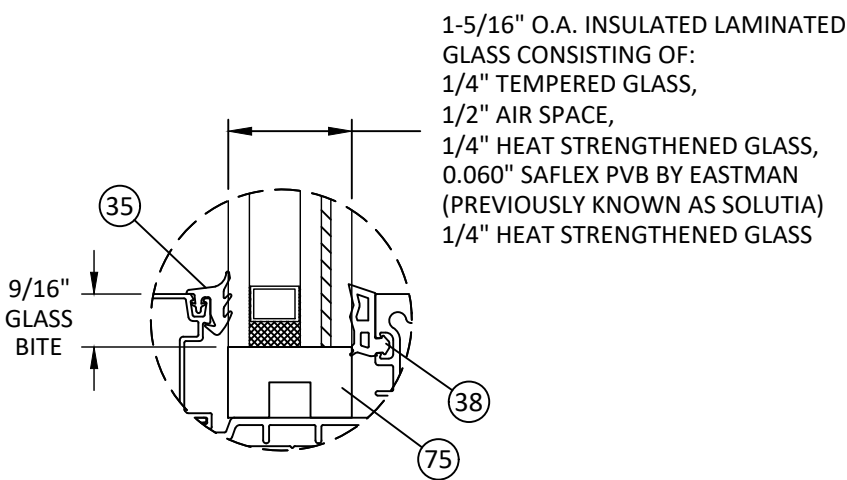

GLAZING DETAIL P
DRY GLAZED
TRANSOM

DP LIMIT	
+70	-70

- AIR SPACE CONSISTING OF :
- SPACER: ALUMINUM BOX SPACER.
 - PRIMARY SEALANT: POLYISOBUTYLENE (PIB).
 - SECONDARY SEALANT: STRUCTURAL SILICONE INTENDED FOR FABRICATION OF INSULATING GLASS UNITS.

- GLAZING NOTES:
- GLASS TYPE AND THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - DOOR D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN ON SHEET 1. TRANSOM D.L.O. SHALL NOT EXCEED DIMENSIONS SHOWN ON SHEETS 2, 3, 3.1, & 3.2, AND DESIGN PRESSURES SHALL NOT EXCEED VALUES SHOWN ON SHEETS 1, 14.1 & AND 15.



YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)

GLAZING DETAILS 2

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

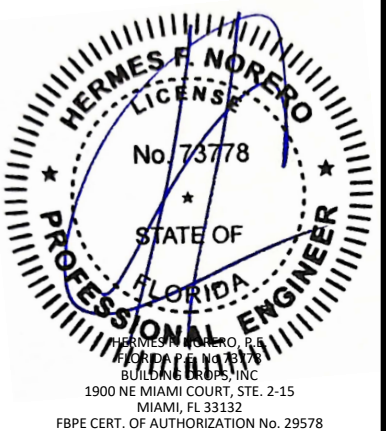

FL #: FL16554

DATE: 09.14.18

DWG. BY: HR
CHK. BY: HFN















SCALE: NTS

DWG. #: YKK021

SHEET: 15
REV. D

7/31/2026 9:51 AM

50H DOOR BILL OF MATERIAL				
ITEM #	PART #	DESCRIPTION	MATERIAL	MANUFACTURER
1	E9-0234	PIVOT STILE	6063-T5	YKK AP
2	E9-0241	MEETING STILE	6063-T5	YKK AP
3	E9-0240	MEETING STILE	6063-T5	YKK AP
4	E9-0242	CONTINUOUS HINGE STILE	6063-T5	YKK AP
5	E9-0251	8" BOTTOM RAIL INS.	6063-T5	YKK AP
6	E9-0244	TOP RAIL INS.	6063-T5	YKK AP
7	E9-0255	EXTERIOR GLASS STOP INS.	6063-T5	YKK AP
8	E9-0254	INTERIOR GLASS STOP INS.	6063-T5	YKK AP
9	E9-0347	DOOR SWEEP BASE	6063-T5	YKK AP
10	E9-0348	DOOR SWEEP COVER	6063-T5	YKK AP
11	E9-0504	DOOR JAMB	6063-T6	YKK AP
12	E9-0501	MONO. TRANSOM MULL	6063-T5	YKK AP
13	E9-0487	4 1/2" AIR TIGHT THRESHOLD	6063-T5	YKK AP
14	E9-0503	THRESHOLD ATTACHMENT	6063-T5	YKK AP
15	E9-0502	THRESHOLD	6063-T5	YKK AP
16	E9-0619	SILL FLASHING	6063-T5	YKK AP
17	E9-0522	REMOVABLE MULLION	6063-T5	YKK AP
18	E9-0227	SHEAR CLIP	6063-T5	YKK AP
19	E9-0231	LOCK BASE	6063-T5	YKK AP
20	E9-0510	HINGE BACKER	6063-T5	YKK AP
21	E9-0657	FLAT FILLER	6063-T5	YKK AP
22	E1-0311	BACKER PLATE	STEEL	
23	E1-0312	BACKER PLATE	STEEL	
24	E1-0351	JOINT CLIP	6063-T5	YKK AP
25	E1-0353	LOCK BASE	6063-T5	YKK AP
26	E1-0357	HINGE BACK PLATE	6063-T5	YKK AP
27	E1-0381	JOINT CLIP	6063-T5	YKK AP
28	E1-1050	END DAM	6063-T5	YKK AP
29	E1-1056	THRESHOLD CLIP	STEEL	
30	E1-1068	FLAT FILLER	6063-T5	YKK AP
31	E2-0051	AIRTIGHT GASKET	PVC	
32	E2-0062	WEATHERSTRIP	POLYPROPYLENE	
33	E2-0063	SETTING BLOCK	EPDM	
34	E2-0067	DOOR SWEEP GASKET	EPDM	
35	E2-0083	EXTERIOR GASKET	EPDM	
36	E2-0085	SPACER GASKET	PC EPDM	
37	E2-0087	WEATHERSTRIP	POLYPROPYLENE	
38	E2-0088	INTERIOR GASKET	EPDM	
39	E2-0093	ASTRAGAL GASKET	SILOCON	
40	E3-0005	ADJUSTABLE CAP	NYLON	
41	E4-0001	STANDARD LABEL	ALUMINUM	
42	E4-0028	IMPACT LABEL	ALUMINUM	
43	FC-1016	FH SMS	STEEL	
44	SM-3810	SH CAP SCREW	STEEL	
45	E9-0238	BOTTOM RAIL EXT. MONO.	6063-T5	YKK AP
46	27HD	CONTINUOUS HINGE		SELECT
47	780-226HD	CONTINUOUS HINGE		HAGAR-ROTON
48	BB1191	BUTT HINGES	STAINLESS STEEL	HAGAR
49	E9-0601	MONO TRANSOM HEADER	6063-T5	YKK AP
50	E9-0651	I.G. TRANSOM HEADER	6063-T5	YKK AP
51	E9-0520	MONO TRANSOM MULL	6063-T5	YKK AP
52	E9-0521	I.G. TRANSOM MULL	6063-T5	YKK AP
53	E9-0218	TRANSOM DOOR STOP	6063-T5	YKK AP
54	E1-1073	TRANSOM HEAD FILLER	6063-T5	YKK AP
55	E9-0221	7" BOTTOM RAIL MONO	6063-T5	YKK AP
56	E9-0239	TOP RAIL MONO	6063-T5	YKK AP
57	E9-0225	EXT. GLASS STOP MONO	6063-T5	YKK AP
58	E9-0226	INT. GLASS STOP MONO	6063-T5	YKK AP
59	E9-0217	MIDRAIL FILLER	6063-T5	YKK AP
60	-	-	-	-
61	E9-0235	8" BOTTOM RAIL MONO	6063-T5	YKK AP
62	E9-0517	I.G. TRANSOM MULL	6063-T5	YKK AP
63	E9-0245	I.G. BOTTOM RAIL EXT.	6063-T5	YKK AP
64	E1-0197	REM. MULL REINF.	STEEL (MIN. A36)	YKK AP
65	E9-3181	CW SUBFRAME - HEAD	6063-T5	YKK AP
66	E9-3180	CW SUBFRAME - JAMBS	6063-T5	YKK AP
67	E9-8344	2 1/2" CROSS RAIL	6063-T5	YKK AP
68	E9-0233	10" BOTTOM RAIL MONO.	6063-T5	YKK AP
69	E9-0252	10" BOTTOM RAIL INS.	6063-T5	YKK AP
70	E9-0511	THRESHOLD RAMP	6063-T5	YKK AP
71	E9-0512	THRESHOLD RAMP	6063-T5	YKK AP
72	E9-0513	THRESHOLD RAMP	6063-T5	YKK AP
73	E2-0086	SETTING BLOCK	EPDM	
74	E2-0737	SETTING BLOCK	EPDM	
75	E2-0095	SETTING BLOCK	EPDM	
76	E1-0370	SHEAR BLOCK	6063-T5	YKK AP
77	BB-1199	HAGER BUTT HINGE	STAINLESS STEEL	HAGER
78	E9-0253	TOP RAIL INS.	6063-T5	YKK AP

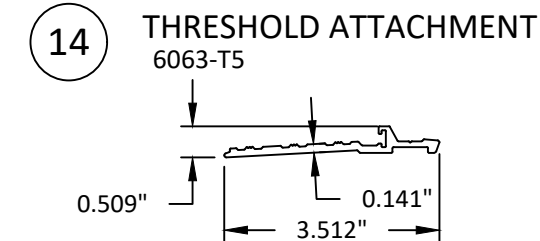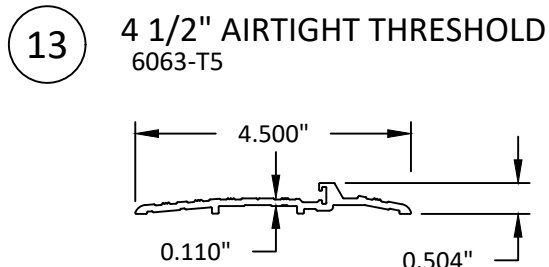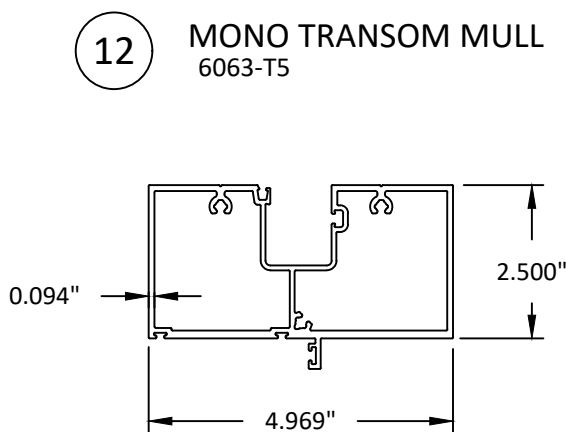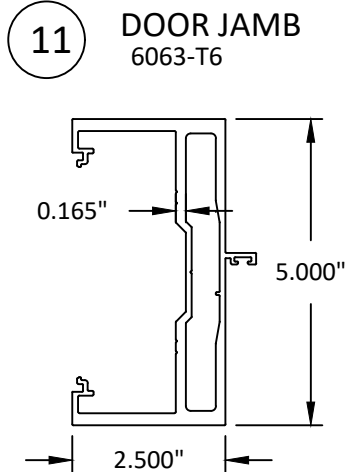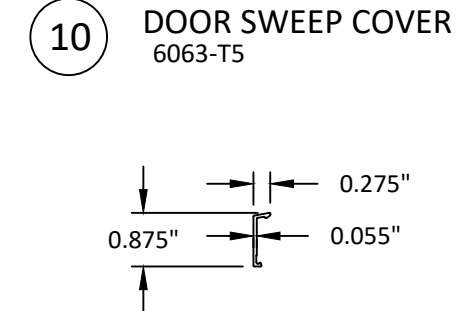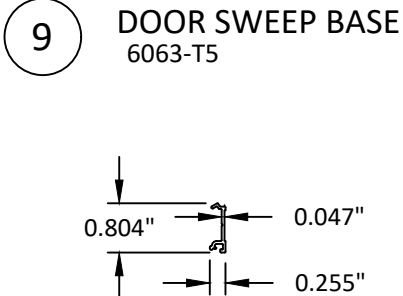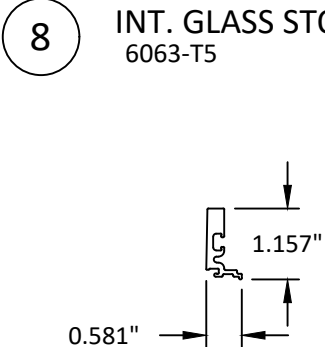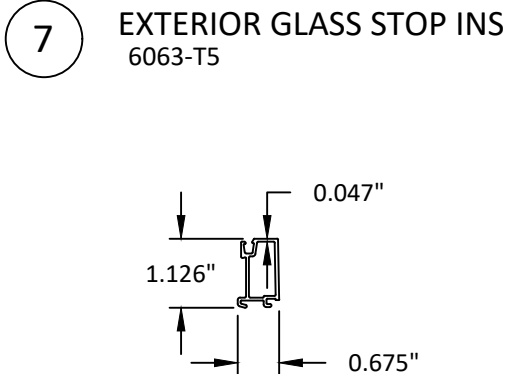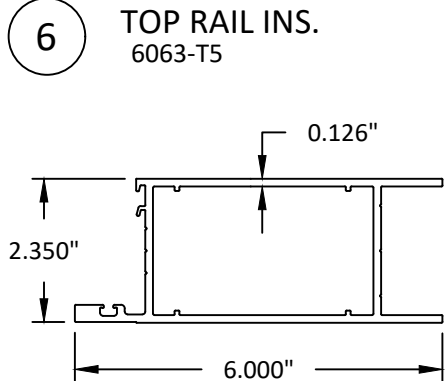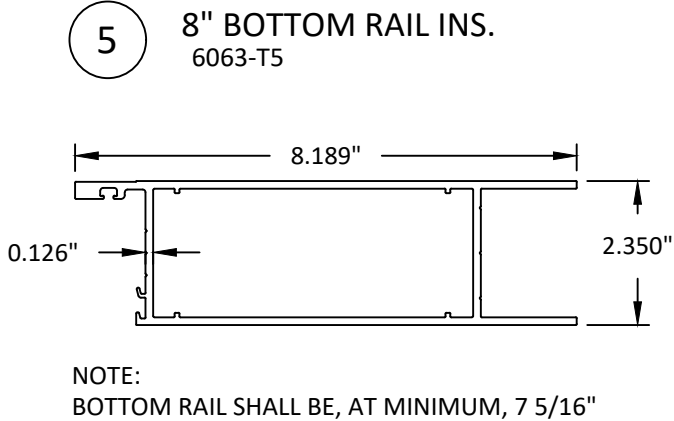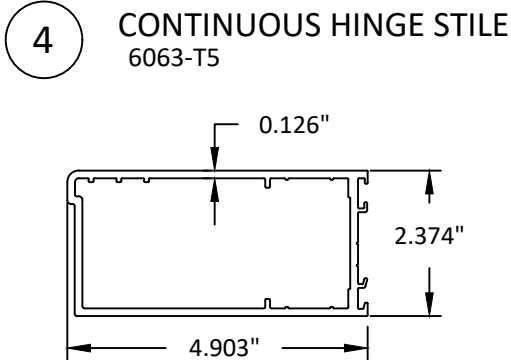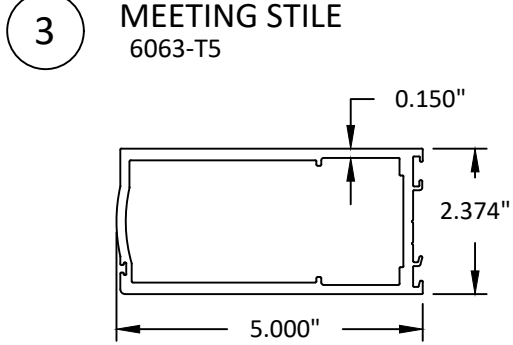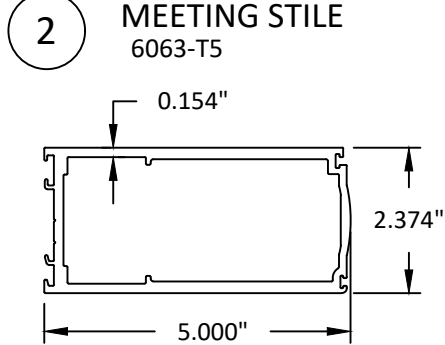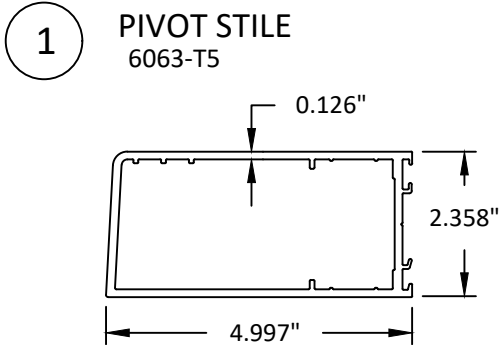

YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)
COMPONENTS &
BILL OF MATERIALS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com


















REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL16554
DATE:	09.14.18
DWG. BY:	HR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK021
SHEET:	16
REV.	D

c:\users\sebastianhereros\desktop\Ykk 2026 ca\116554\Ykk021.dwg

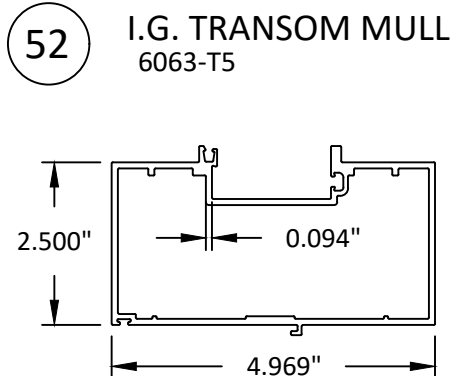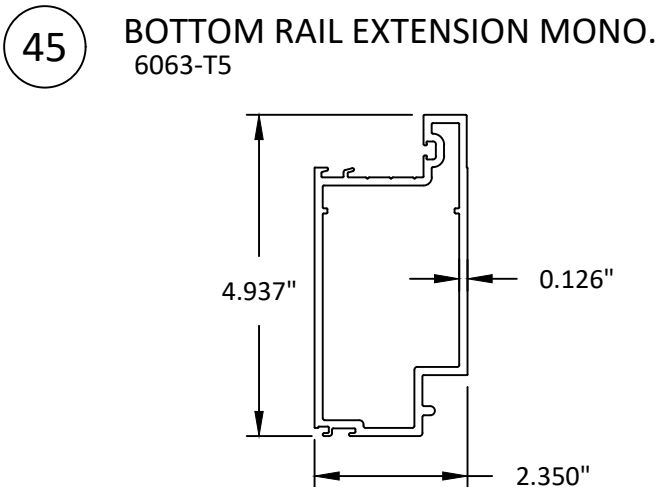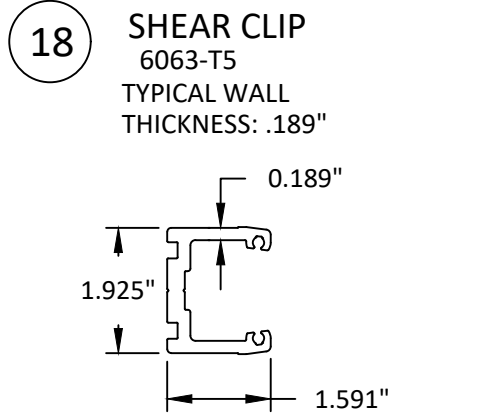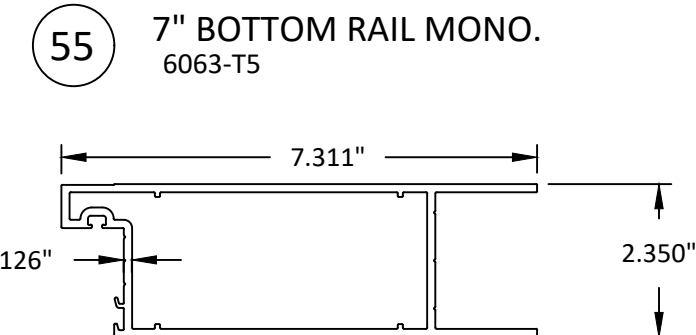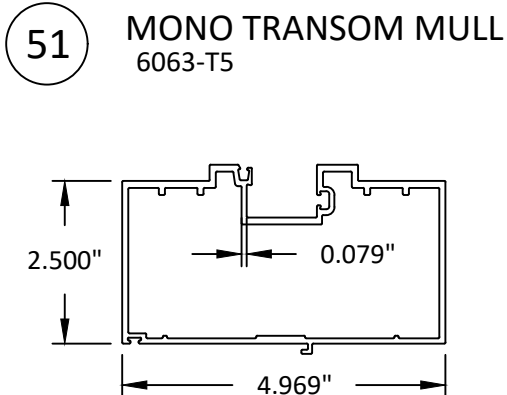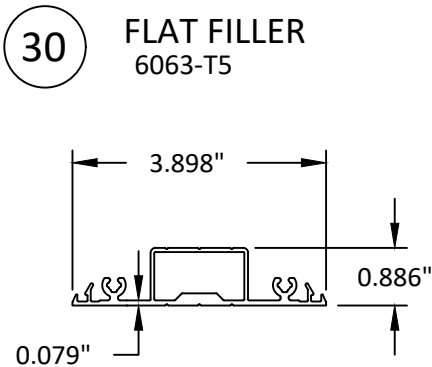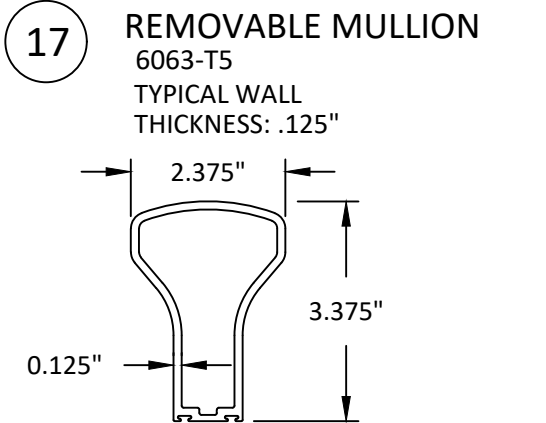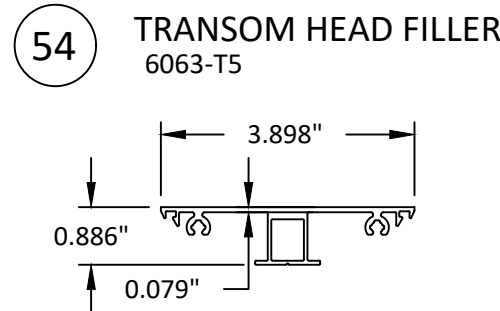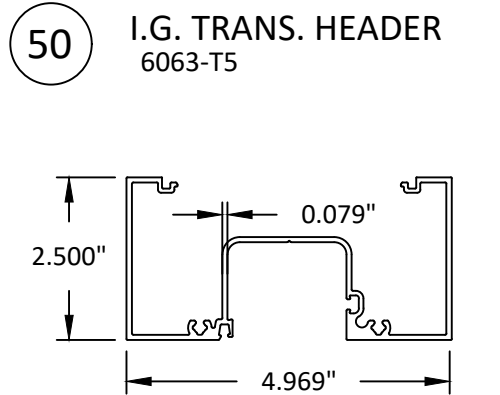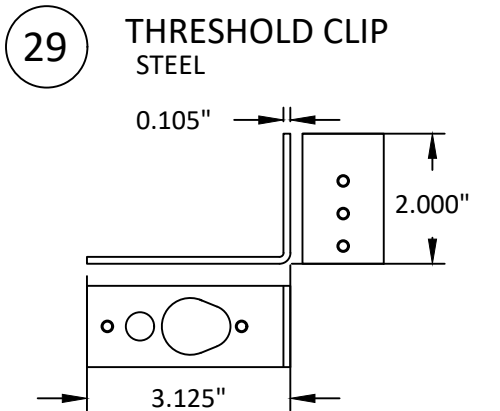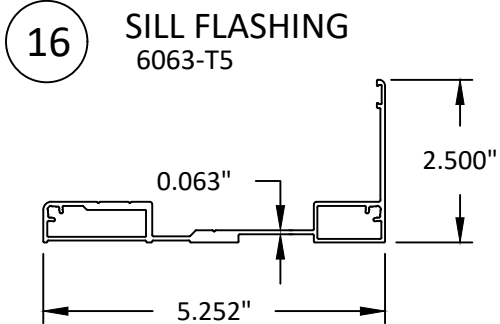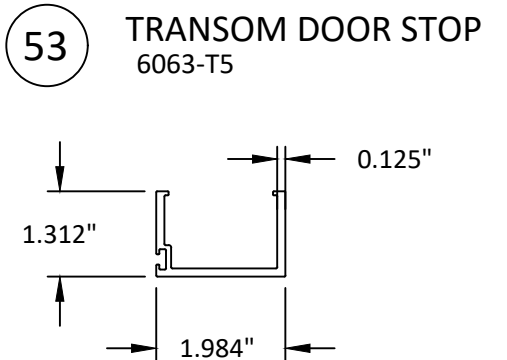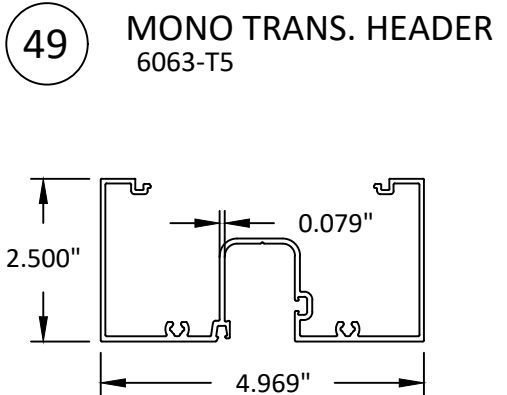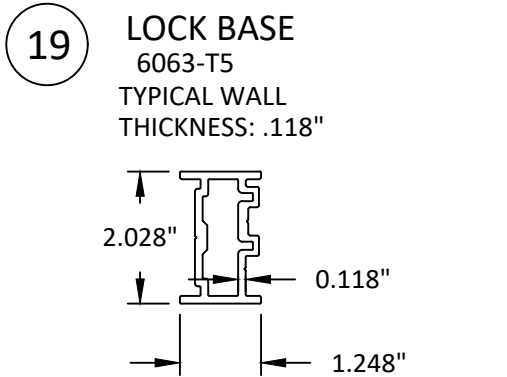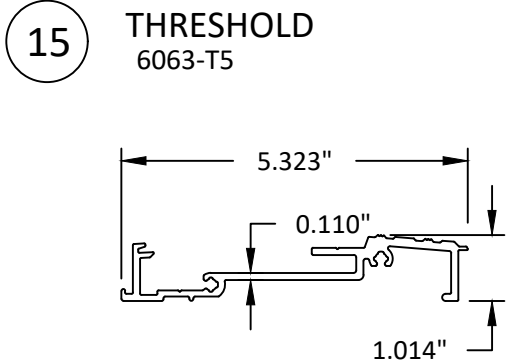


YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)
COMPONENTS (1)

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

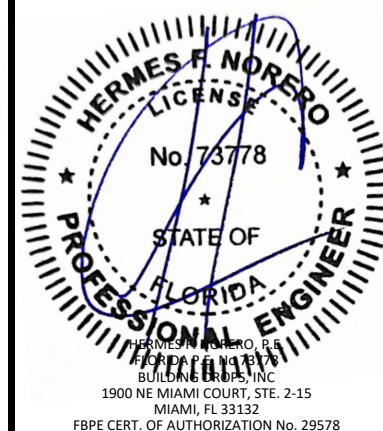


FL #:	FL16554
DATE:	09.14.18
DWG. BY:	HR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK021
SHEET:	17
REV.	D


7/31/2026 9:51 AM

c:\users\sebastianherrerros\desktop\ykk 2026 ca\116554\ykk021.dwg


56 TOP RAIL - MONO.
6063-T5

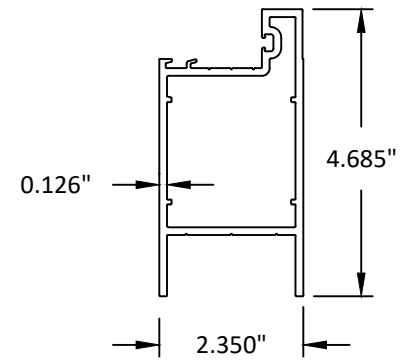


57 EXT. GLASS STOP-MONO.
6063-T5

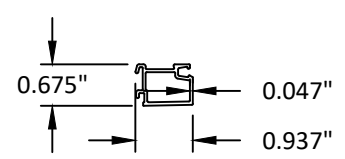


58 INT. GLASS STOP-MONO.
6063-T5

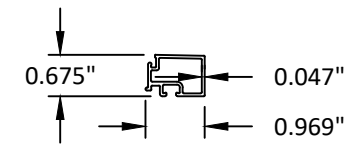


59 MIDRAIL FILLER
6063-T5

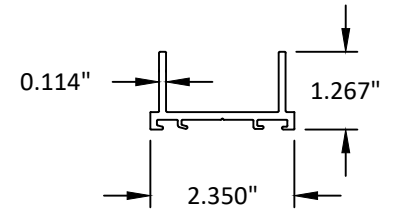


61 8" BOTTOM RAIL MONO.
6063-T5

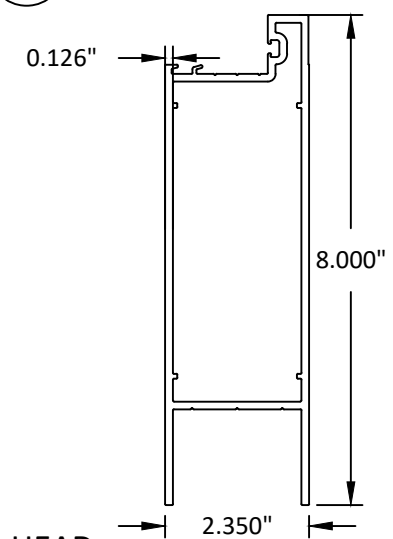


62 I.G. TRANSOM MULL
6063-T5

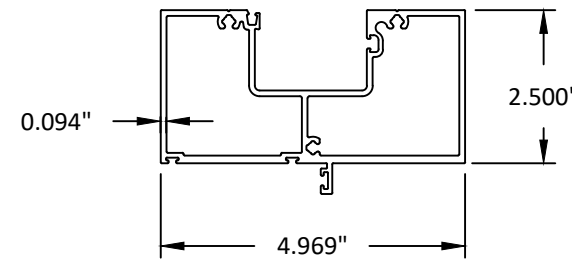


63 I.G. BOTTOM RAIL EXT.
6063-T5

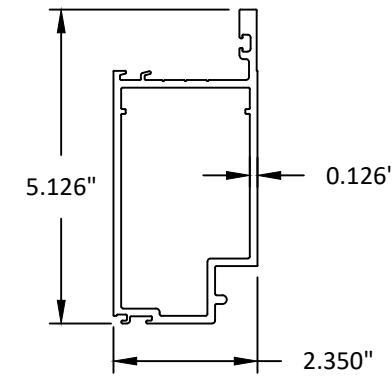


64 REMOVABLE MULL REINFORCEMENT
STEEL

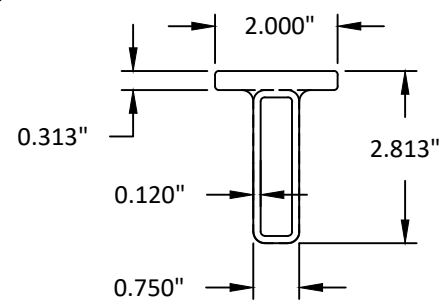


65 CW SUBFRAME - HEAD
6063-T5

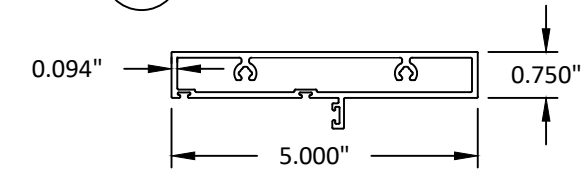


66 CW SUBFRAME - JAMBS
6063-T5

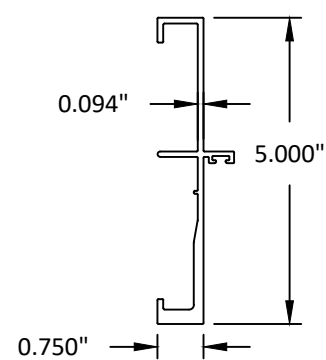


67 2 1/2" CROSS RAIL
6063-T5

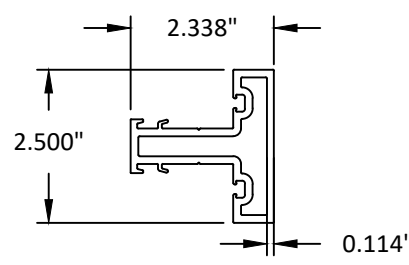


68 10" BOTTOM RAIL MONO.
6063-T5

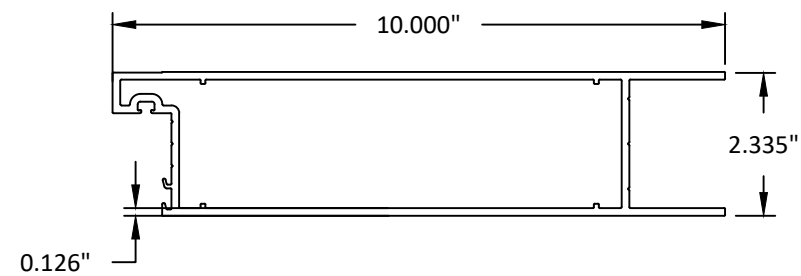


69 10" BOTTOM RAIL INS.
6063-T5

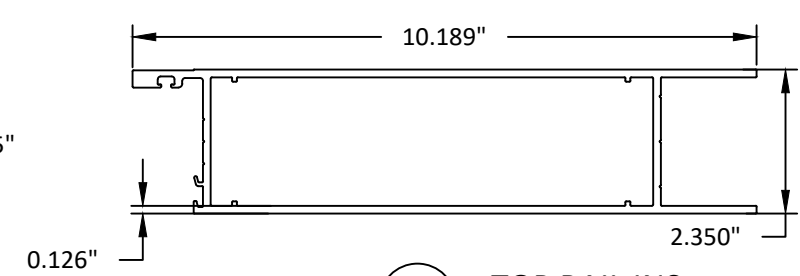


70 THRESHOLD RAMP
6063-T5

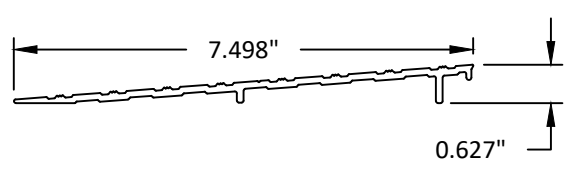


71 THRESHOLD RAMP
6063-T5

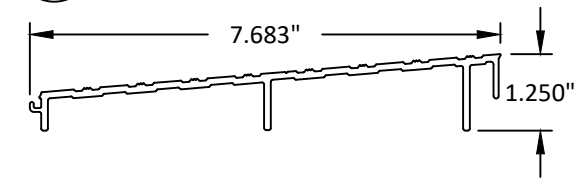

72 THRESHOLD RAMP
6063-T5

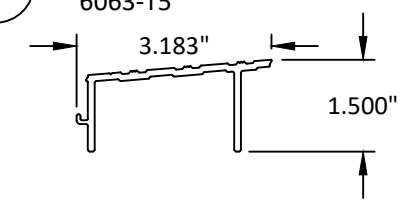

78 TOP RAIL INS.
6063-T5

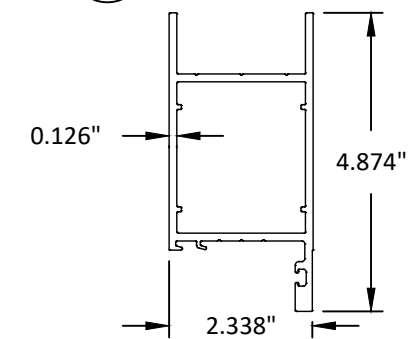

YKK AP Quality inspires™

YKK AP America Inc.
1229 HWY 441 BYPASS
DUBLIN, GEORGIA 31021
PH: (478)277-1955 FAX: (678)838-6001

TITLE: SERIES 50H ALUMINUM OUTSWING
ENTRANCE DOOR
(HVHZ) (IMPACT)
COMPONENTS (2)

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
HARDWARE UPDATE	SH	9/13/22
ELEVATION UPDATE	SH	12/14/22
HARDWARE ADDITION	SH	1/30/25
2026 CODE UPDATE	SH	7/31/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
YKK AP AMERICA, INC.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL16554

DATE: **09.14.18**

DWG. BY: HR	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **YKK021**

SHEET: 18	REV. D
---------------------	------------------