

YKK AP AMERICA RESIDENTIAL

STYLEGUARD "5400" SLIDING GLASS DOOR

(HVHZ) (IMPACT)

INSTALLATION NOTES:

- TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FOR INSTALLATION INTO METAL STUD USE #10 SELF-DRILLING SCREWS THROUGH THE FRAME OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
- FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16 INCH DIAMETER ITW TAPCON OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS. IN HVHZ AREAS, ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE RER.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
 - X: OPERABLE PANEL
 - O: FIXED PANEL
- GLAZING MEETS ASTM E1300 REQUIREMENTS, SEE SHEET 6 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION (OXXO)
3	ELEVATION (OXO)
4	ELEVATION (OX & XX)
5	ANCHOR LAYOUT & SCHEDULE
6	GLAZING DETAILS
7	VERTICAL SECTIONS (OXXO, OXO, OX)
8	VERTICAL SECTIONS (OXO)
9	VERTICAL SECTIONS (XX)
10	HORIZONTAL SECTIONS (OXXO)
11	HORIZONTAL SECTIONS (OXO)
12	HORIZONTAL SECTIONS (OX, XX)

UNIT DIMENSIONS			
CONFIGURATION	DESIGN PRESSURE	MAXIMUM SIZE	MISSILE IMPACT RATING
XX	+50 / -50 PSF	95.5" X 95.5"	LARGE MISSILE IMPACT RATED
OX	+50 / -50 PSF	95.5" X 95.5"	LARGE MISSILE IMPACT RATED
OXO	+50 / -50 PSF	145.81" X 95.5"	LARGE MISSILE IMPACT RATED
OXXO	+50 / -50 PSF	192" X 96"	LARGE MISSILE IMPACT RATED



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:
STYLEGUARD "5400"
SLIDING GLASS DOOR
(HVHZ)(IMPACT)


INSTALLATION & GENERAL NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	05.15.20
8TH FBC CODE CHANGE	FB	08.30.23
GLASS ADDITION	SH	11.18.24

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2024.11.19 14:30:00 -05'00'

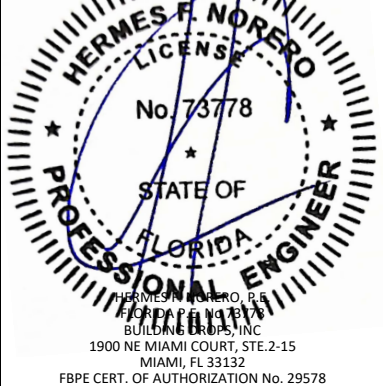

FL #:
FL16605

DATE:
07.29.15

DWG. BY:
BB


CHK. BY:
HFN

SCALE:
NTS

DWG. #:
YKK149

SHEET:
1
OF 12

c:\users\sebastianherrerero\building drops, inc\building drops, inc\projects\ykk ap america, inc\fbc-24-0930 - fbc submittal - ykk149 & ykk124 revision\dwgs\ykk149.dwg 11/19/2024 9:24 AM

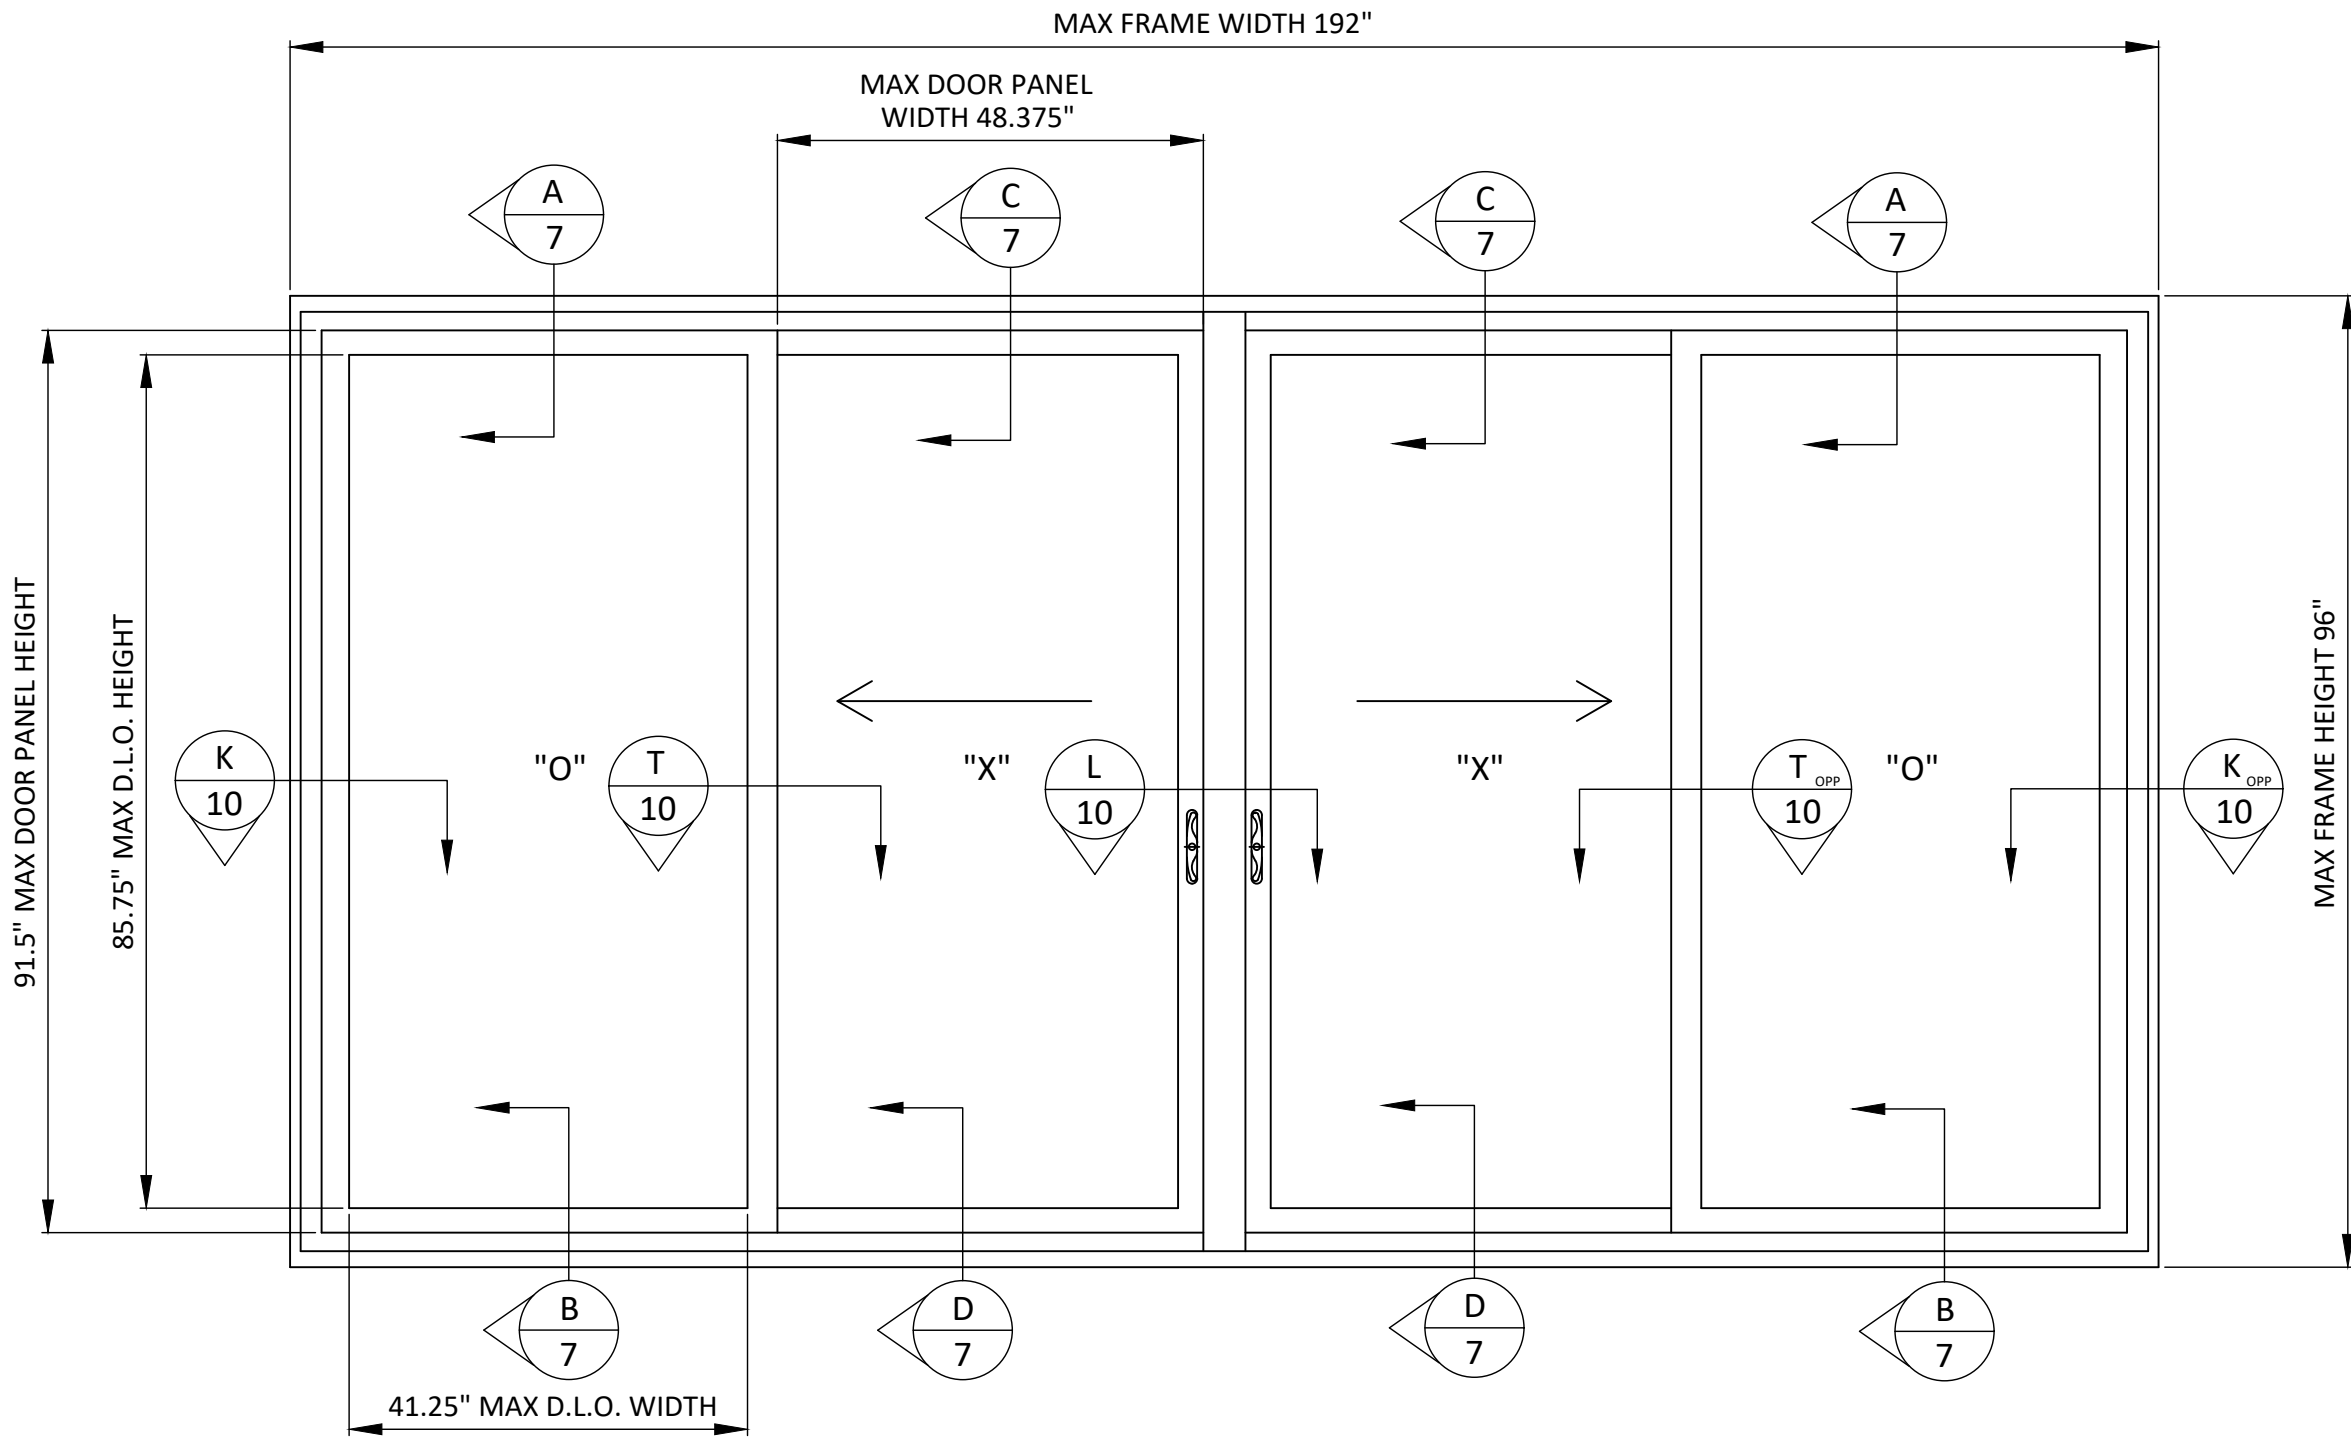

ELEVATION
OXXO




YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEGUARD "5400"
SLIDING GLASS DOOR
(HVHZ)(IMPACT)
ELEVATION (OXXO)

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	05.15.20
8TH FBC CODE CHANGE	FB	08.30.23
GLASS ADDITION	SH	11.18.24

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

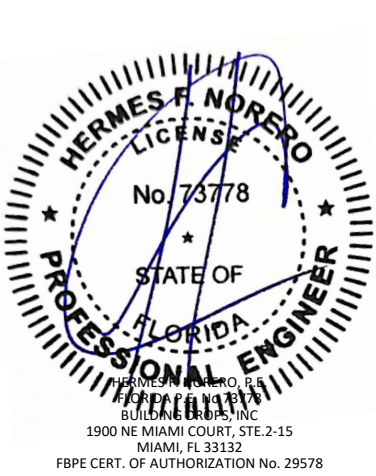

FL #: **FL16605**

DATE: **07.29.15**


DWG. BY: **BB** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **YKK149**

SHEET:

c:\Users\sebastianherrerros\building drops, inc\building drops, inc\projects\ykk ap america, inc\fbc-24-0930 - fbc submittal - ykk149 & ykk124 revision\dwgs\ykk149.dwg 11/19/2024 9:24 AM

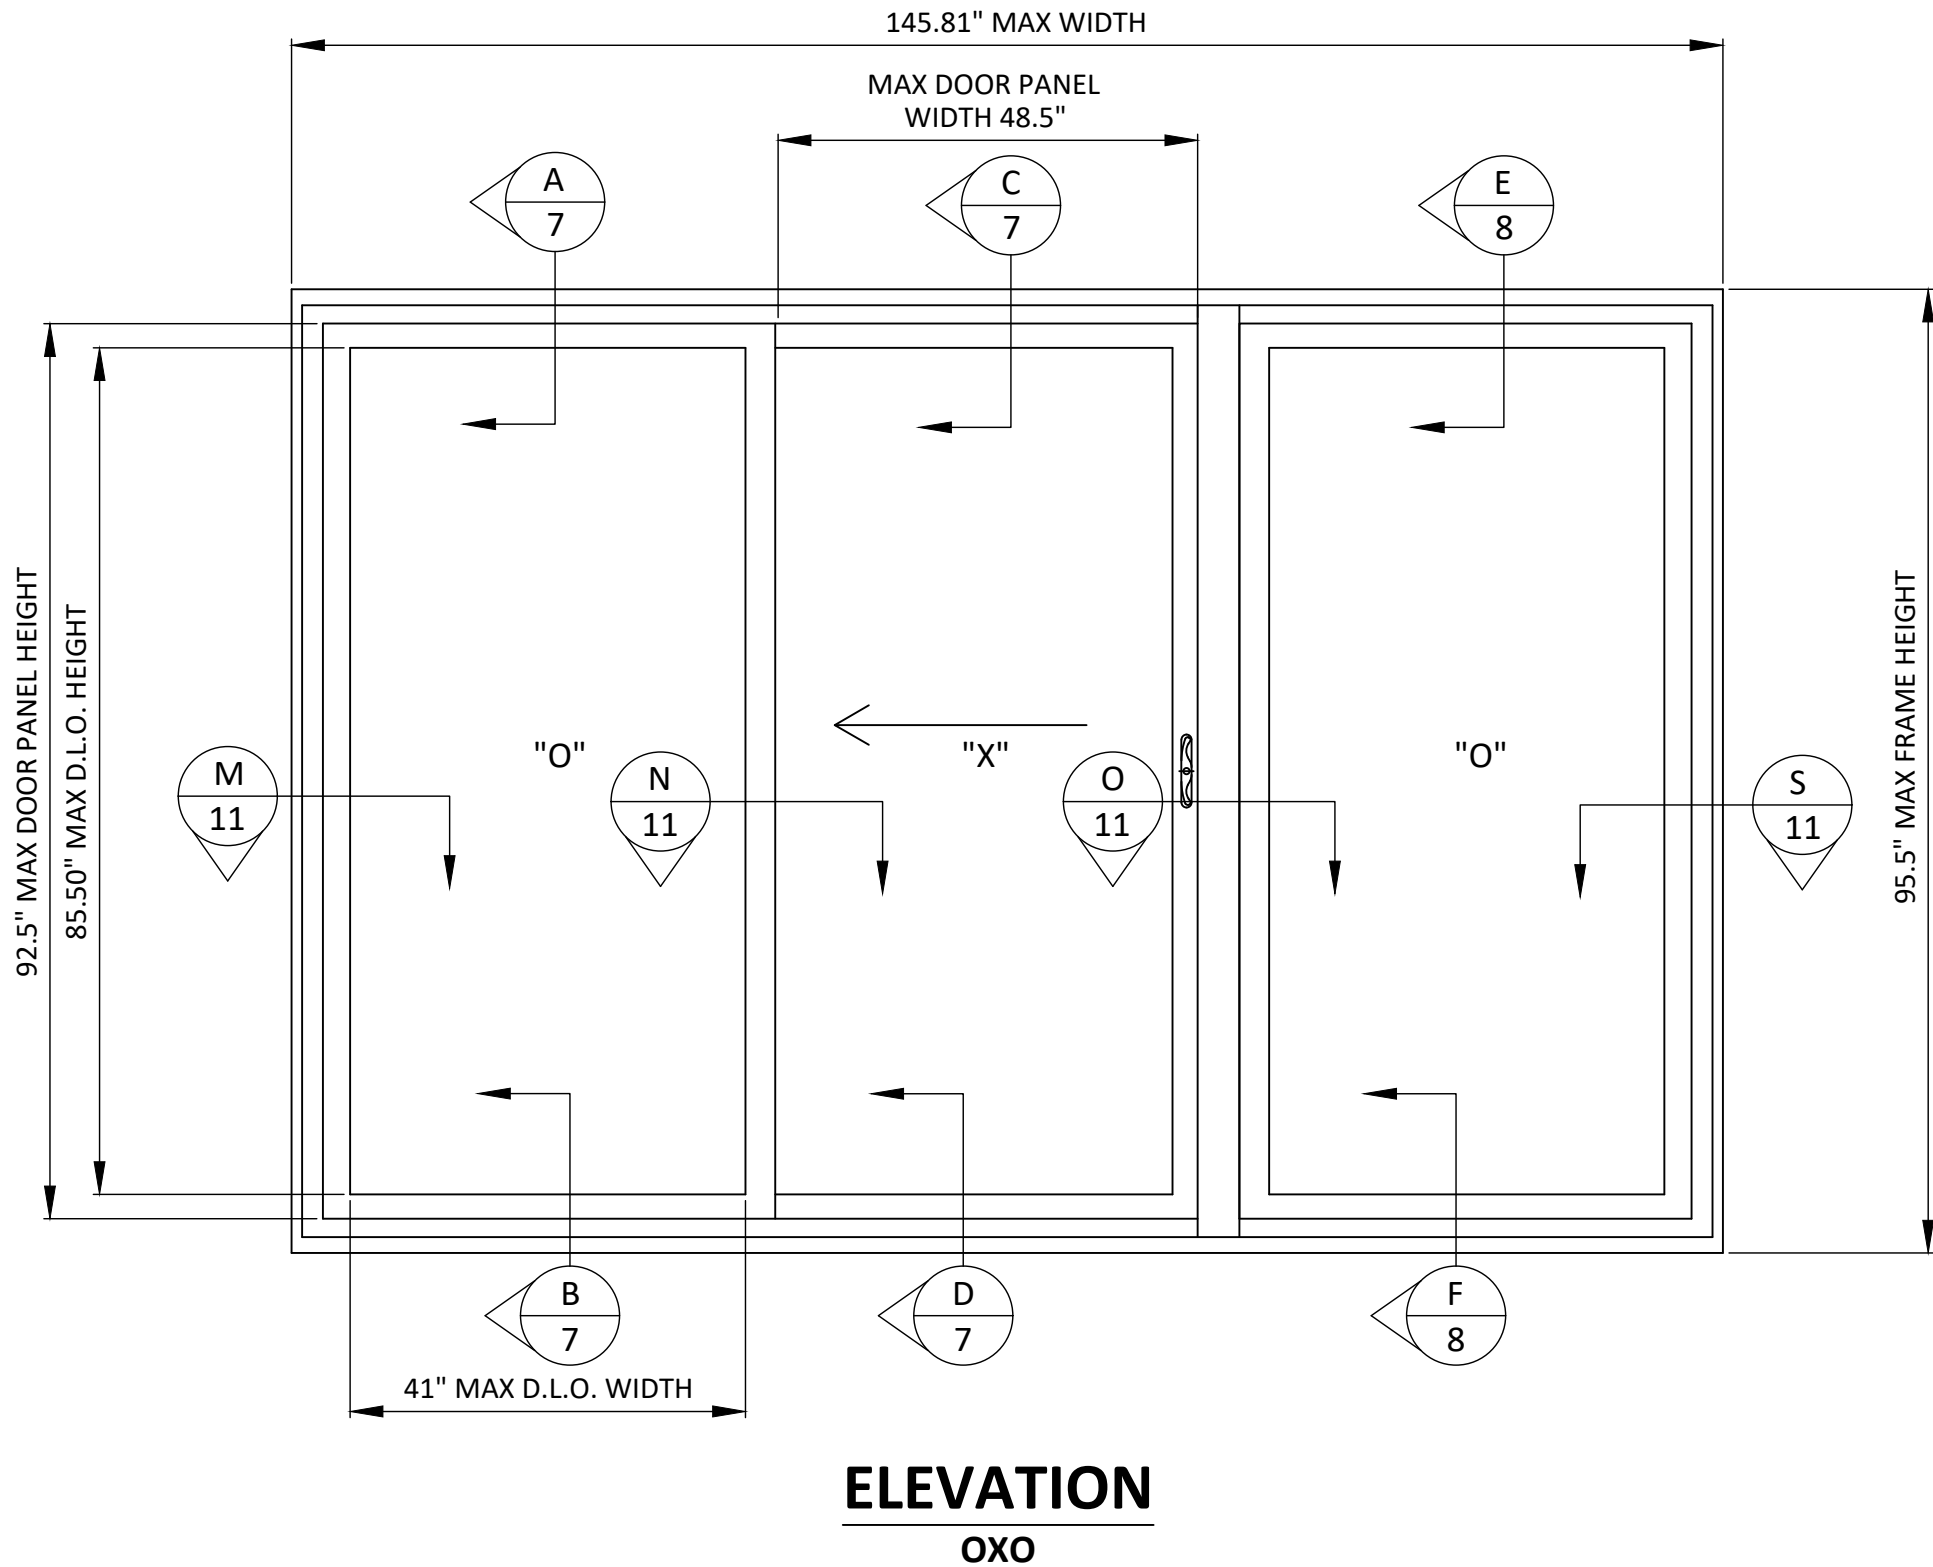

ELEVATION
OXO



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEGUARD "5400"
SLIDING GLASS DOOR
(HVHZ)/(IMPACT)

ELEVATION (OXO)

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	05.15.20
8TH FBC CODE CHANGE	FB	08.30.23
GLASS ADDITION	SH	11.18.24

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL16605**

DATE: **07.29.15**

DWG. BY: **BB**

CHK. BY: **HFN**

SCALE: **NTS**



DWG. #: **YKK149**

SHEET:

3

OF 12

c:\users\sebastianherrerros\building drops, inc\building drops, inc\projects\ykk ap america, inc\fbc-24-0930 - fbc submittal - ykk149 & ykk124 revision\dwgs\ykk149.dwg 11/19/2024 9:24 AM

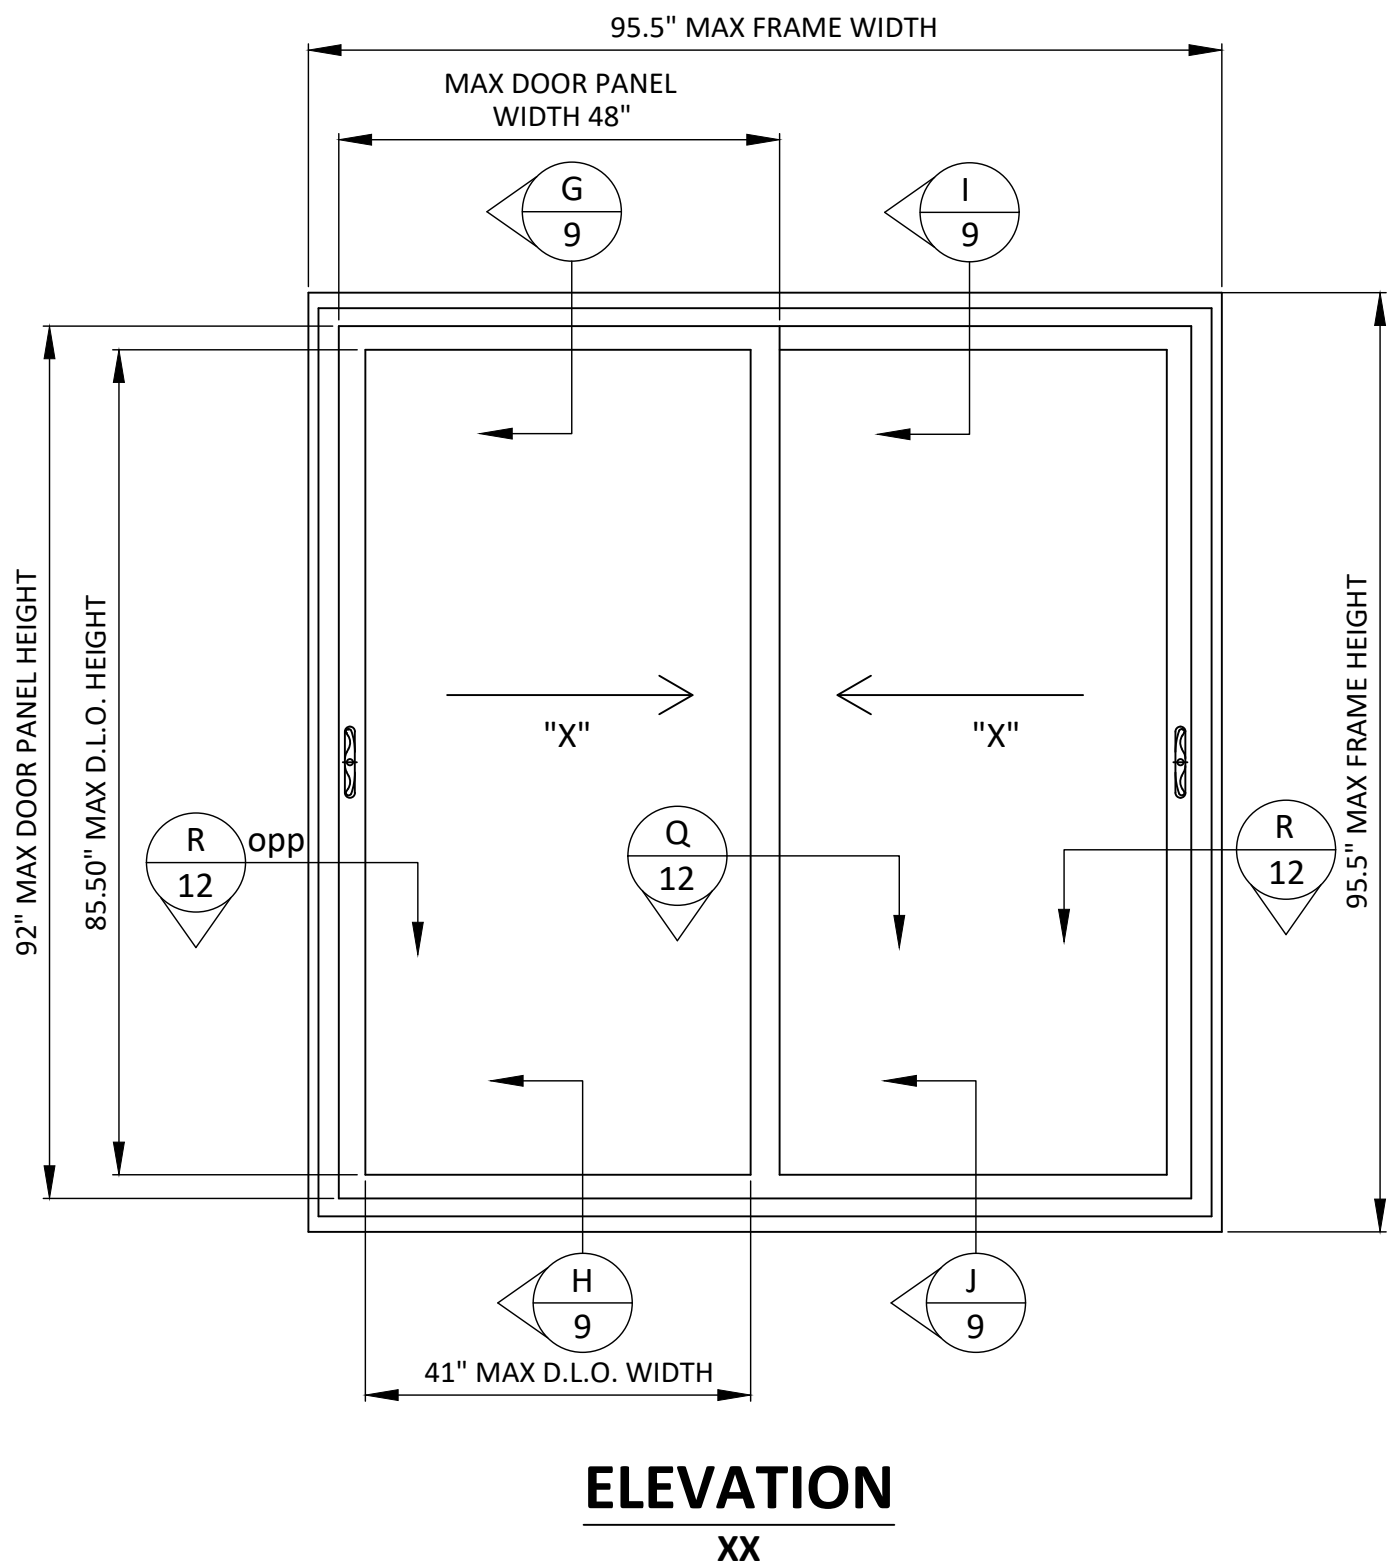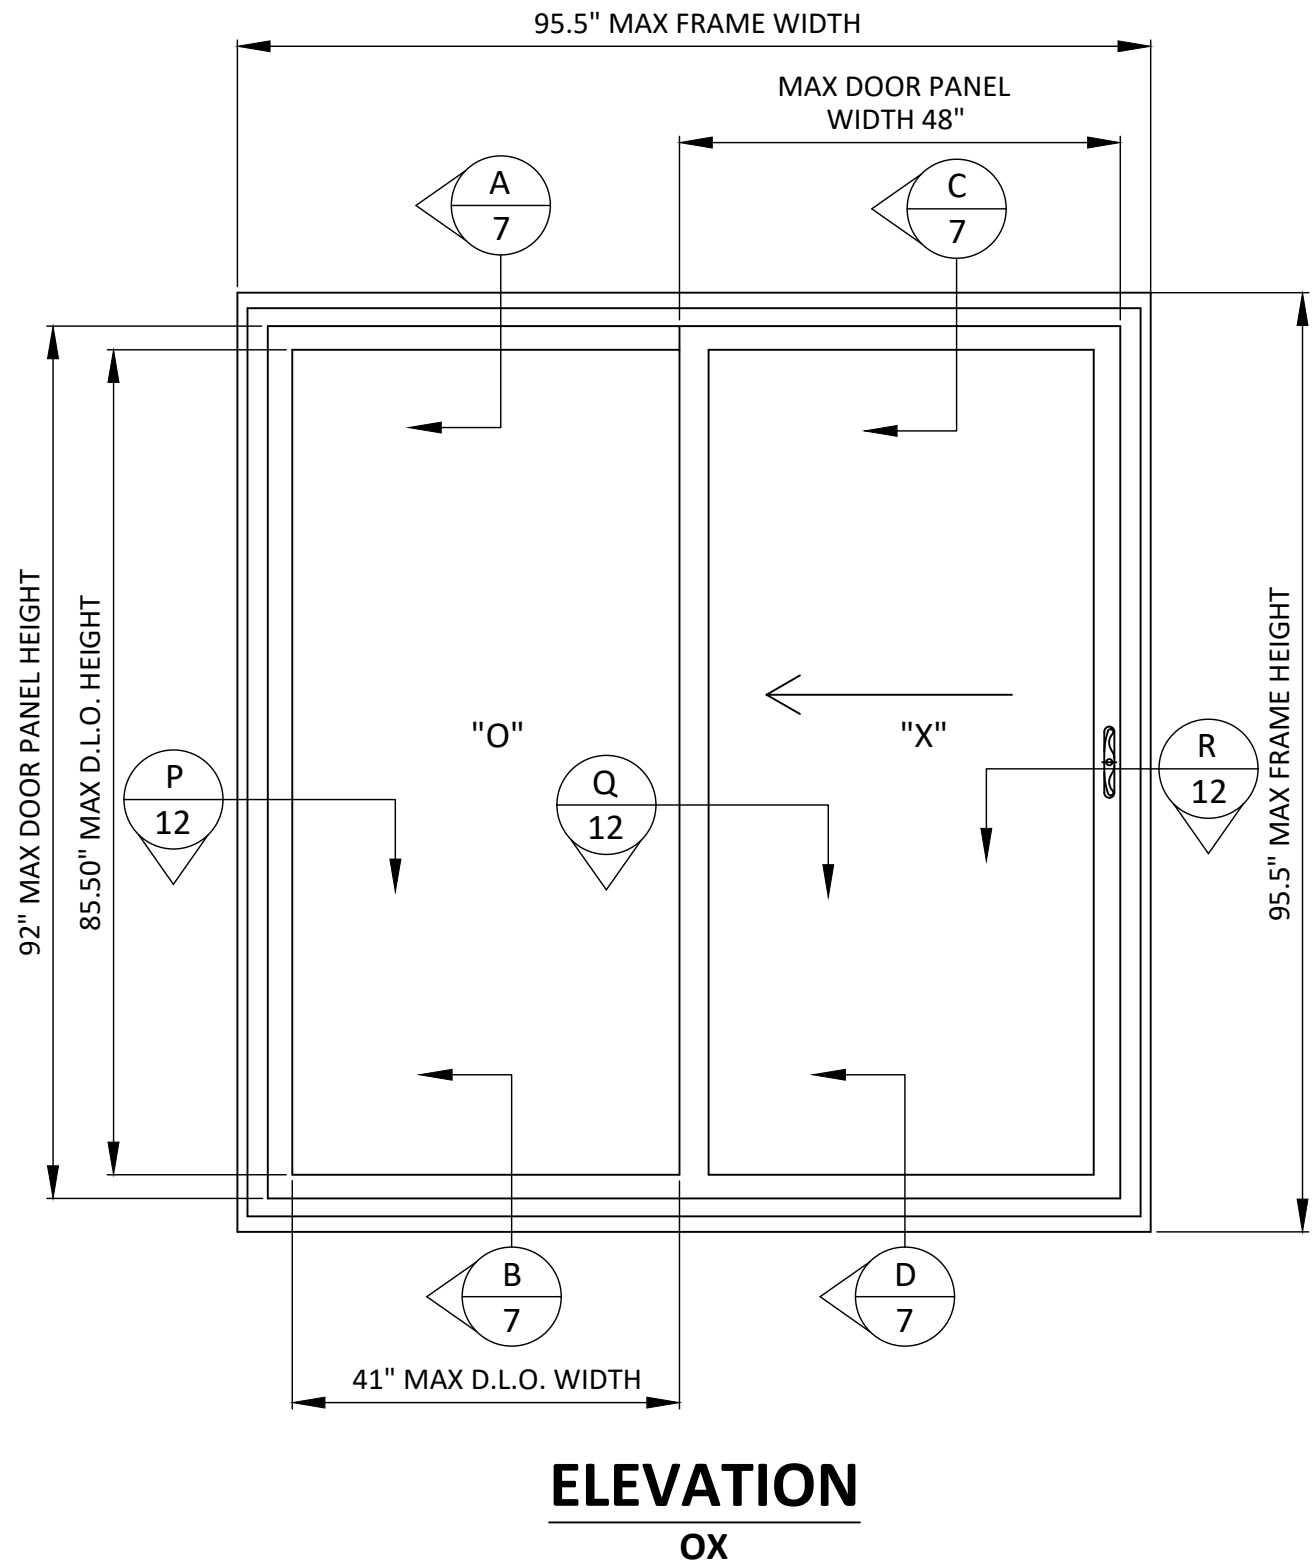

YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEGUARD "5400"
SLIDING GLASS DOOR
(HVHZ)/(IMPACT)
ELEVATIONS (OX & XX)

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	05.15.20
8TH FBC CODE CHANGE	FB	08.30.23
GLASS ADDITION	SH	11.18.24

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL16605

DATE: **07.29.15**

DWG. BY: **BB**
CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **YKK149**

SHEET:

4

OF 12

c:\users\sebastianherrerero\building drops, inc\building drops, inc\projects\ykk ap america, inc\fbc-24-0930 - fbc submittal - ykk149 & ykk124 revision\dwgs\ykk149.dwg 11/19/2024 9:24 AM

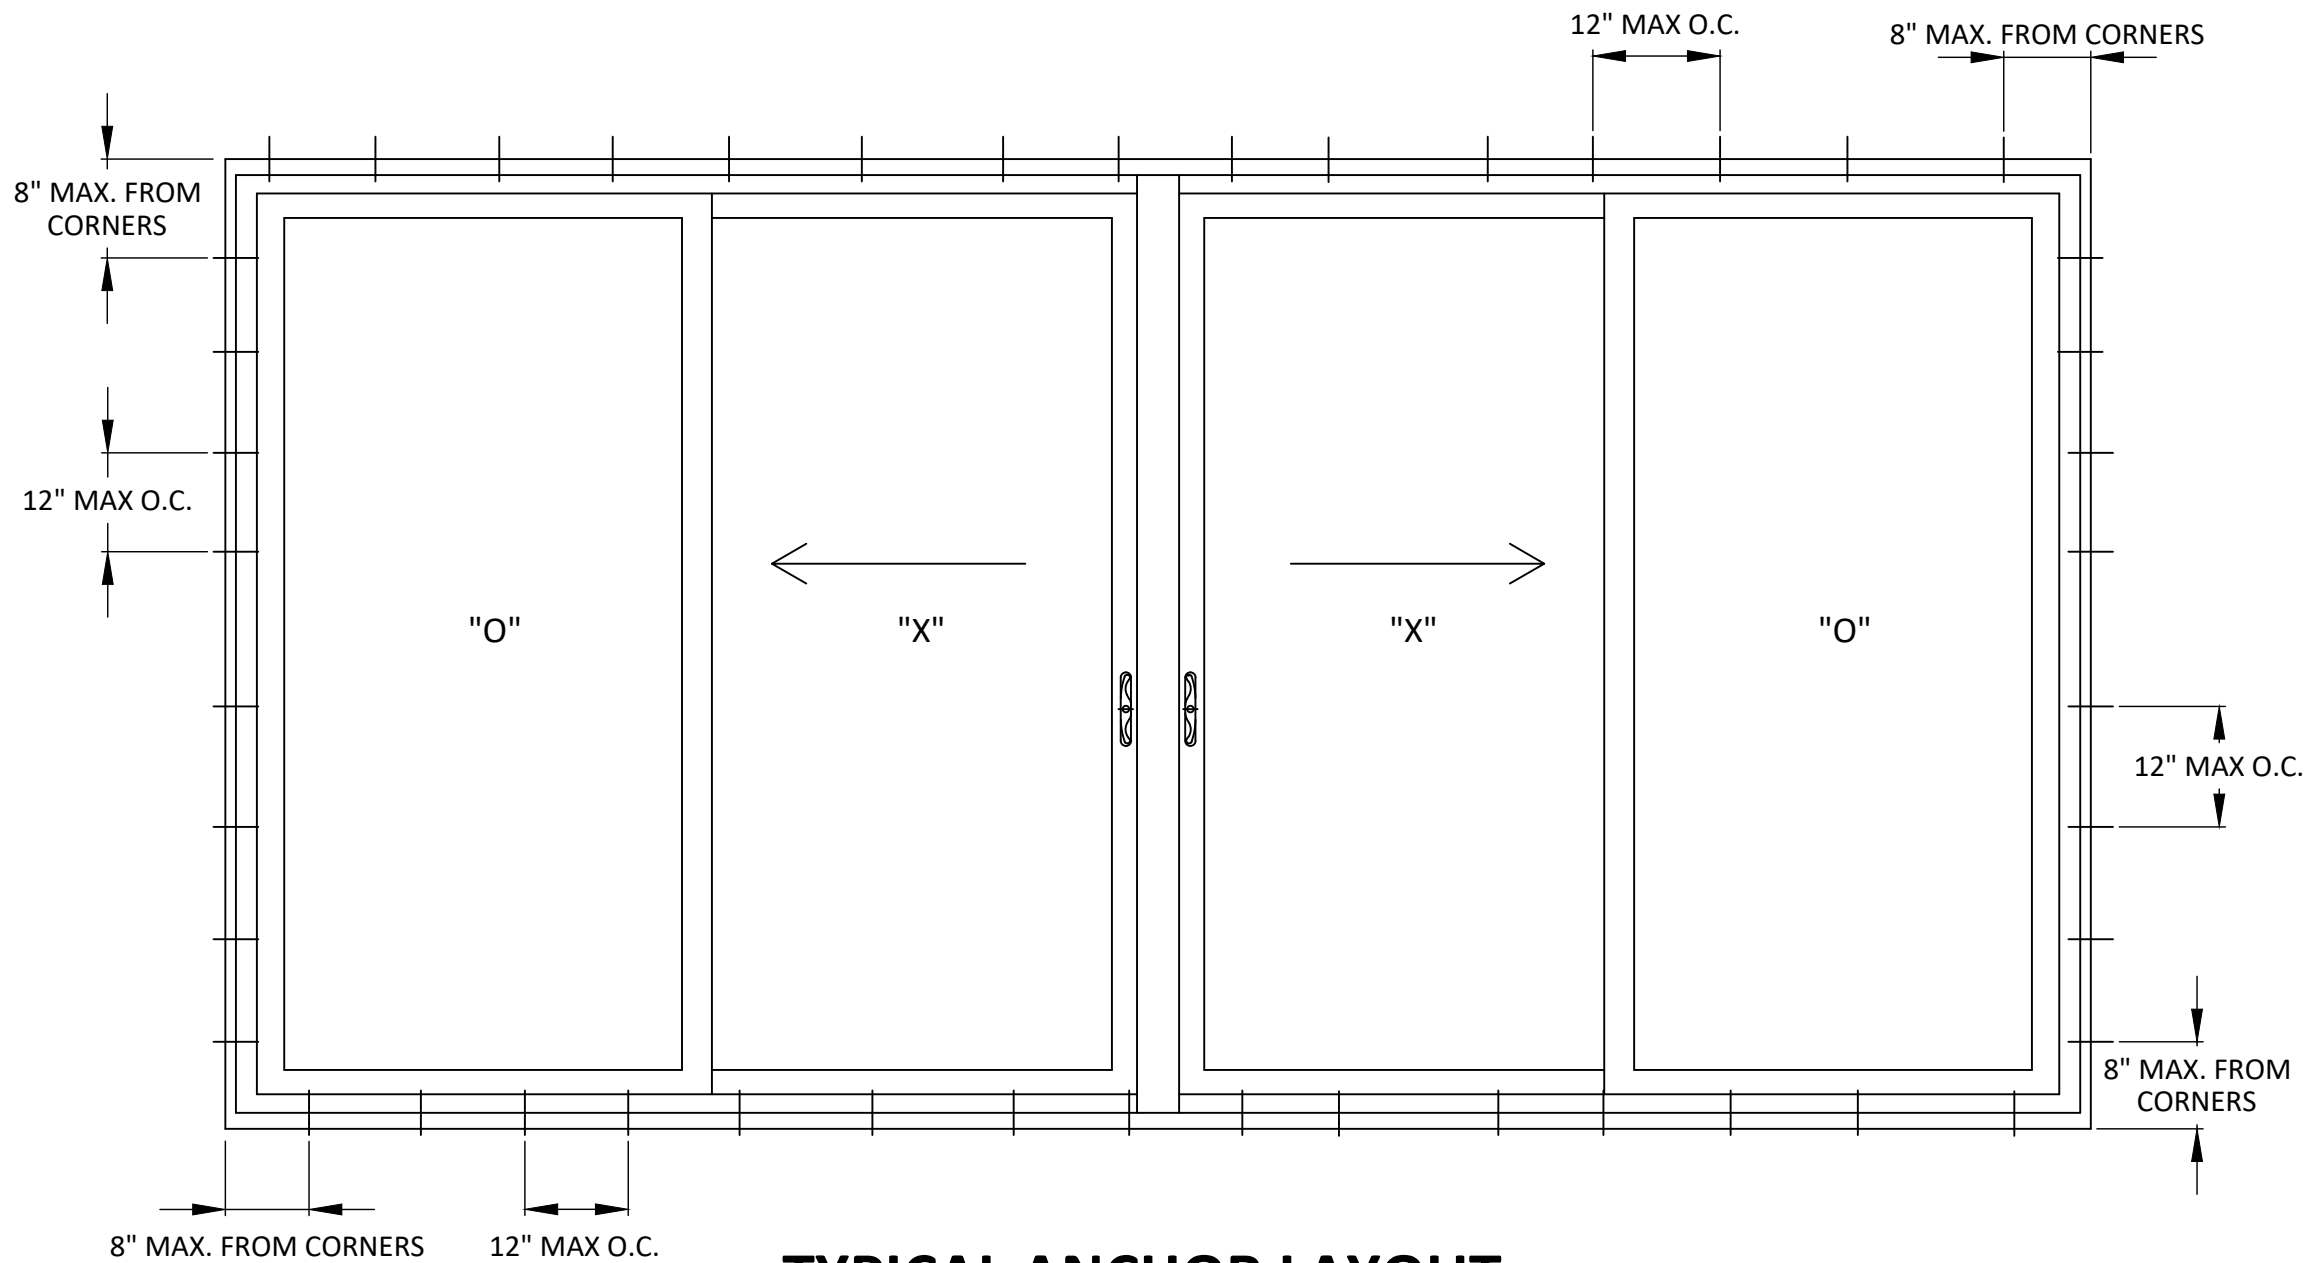

TYPICAL ANCHOR LAYOUT
2, 3, OR 4 PANEL DOOR

ANCHOR SCHEDULE				
	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	MIN. S.G. = 0.55 WOOD	#10 WOOD SCREW	1.50"	0.75"
	CMU PER ASTM C90	3/16" ITW TAPCON	1.25"	2.50"
	CONCRETE, MIN. COMPRESSIVE STRENGTH OF 3000 PSI	3/16" ITW TAPCON	1.25"	2.50"
	18 GAUGE STEEL, MIN fy = 33 ksi	#10 SELF-DRILLING SCREW	3 THREADS PENETRATION BEYOND METAL	0.75"



Quality
inspires™

YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE:STYLEGUARD "5400"
SLIDING GLASS DOOR
(HVHZ)(IMPACT)


ANCHOR LAYOUT & SCHEDULE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



BUILDING DROPS

REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	05.15.20
8TH FBC CODE CHANGE	FB	08.30.23
GLASS ADDITION	SH	11.18.24
THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.		

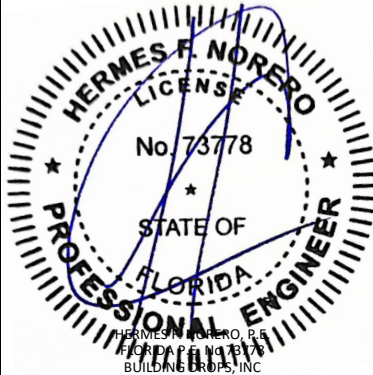

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL16605

DATE: **07.29.15**

DWG. BY:
BB

CHK. BY:
HFN


SCALE: **NTS**

DWG. #: **YKK149**


SHEET:
5

OF 12


c:\users\sebastianhereros\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-24-0930 - fbc submittal - ykk149 & ykk124 revision\dwgs\ykk149.dwg
11/19/2024 9:25 AM
c:\users\sebastianhereros\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-24-0930 - fbc submittal - ykk149 & ykk124 revision\dwgs\ykk149.dwg

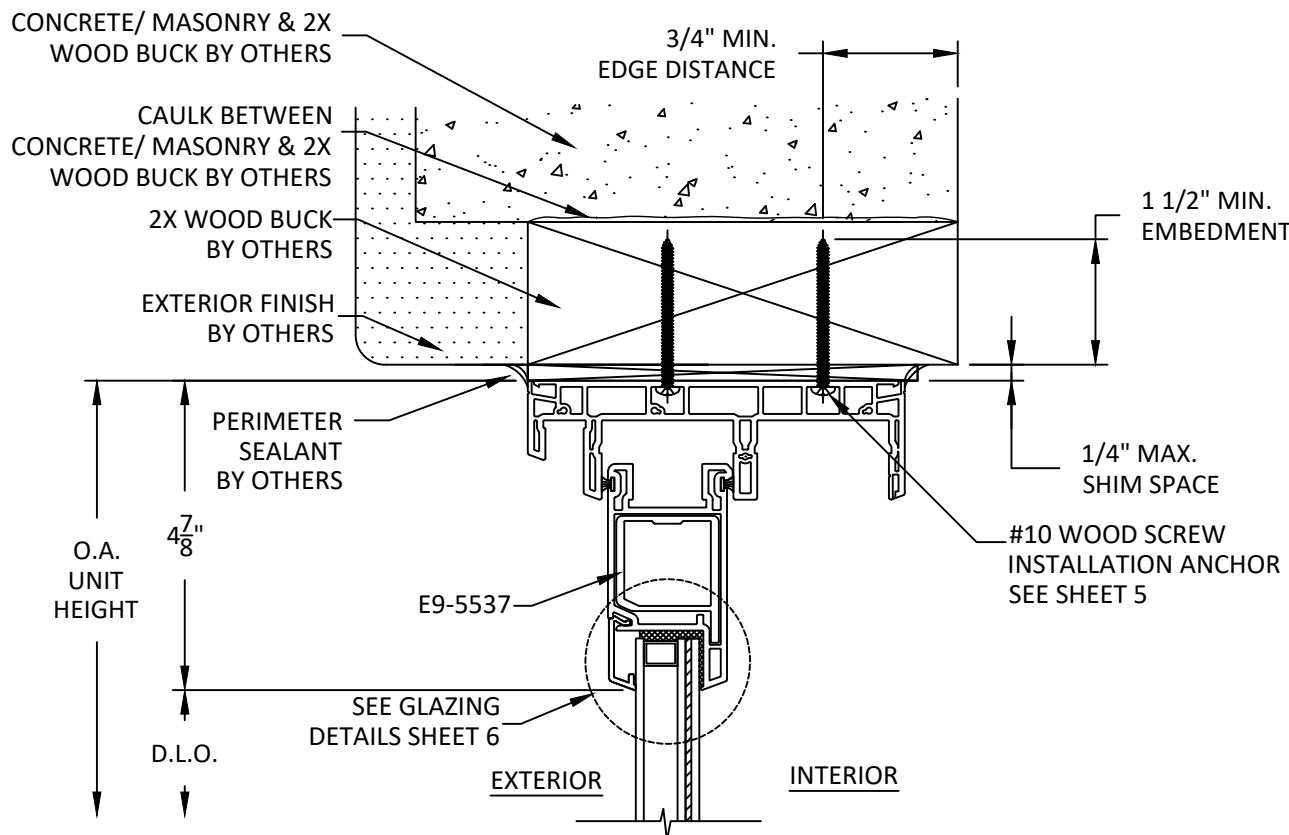


A
7 VERTICAL SECTION
FIXED HEAD

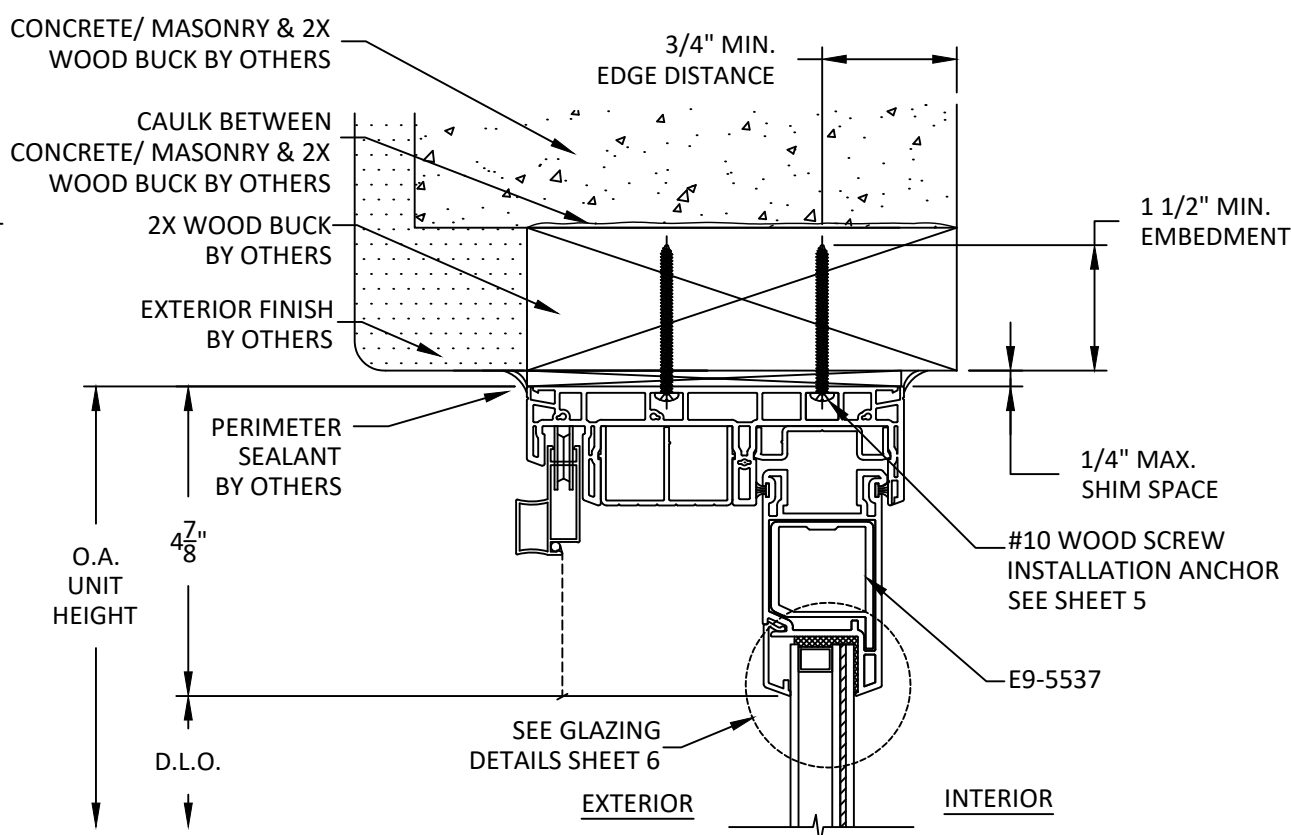

C
7 VERTICAL SECTION
OPERABLE HEAD

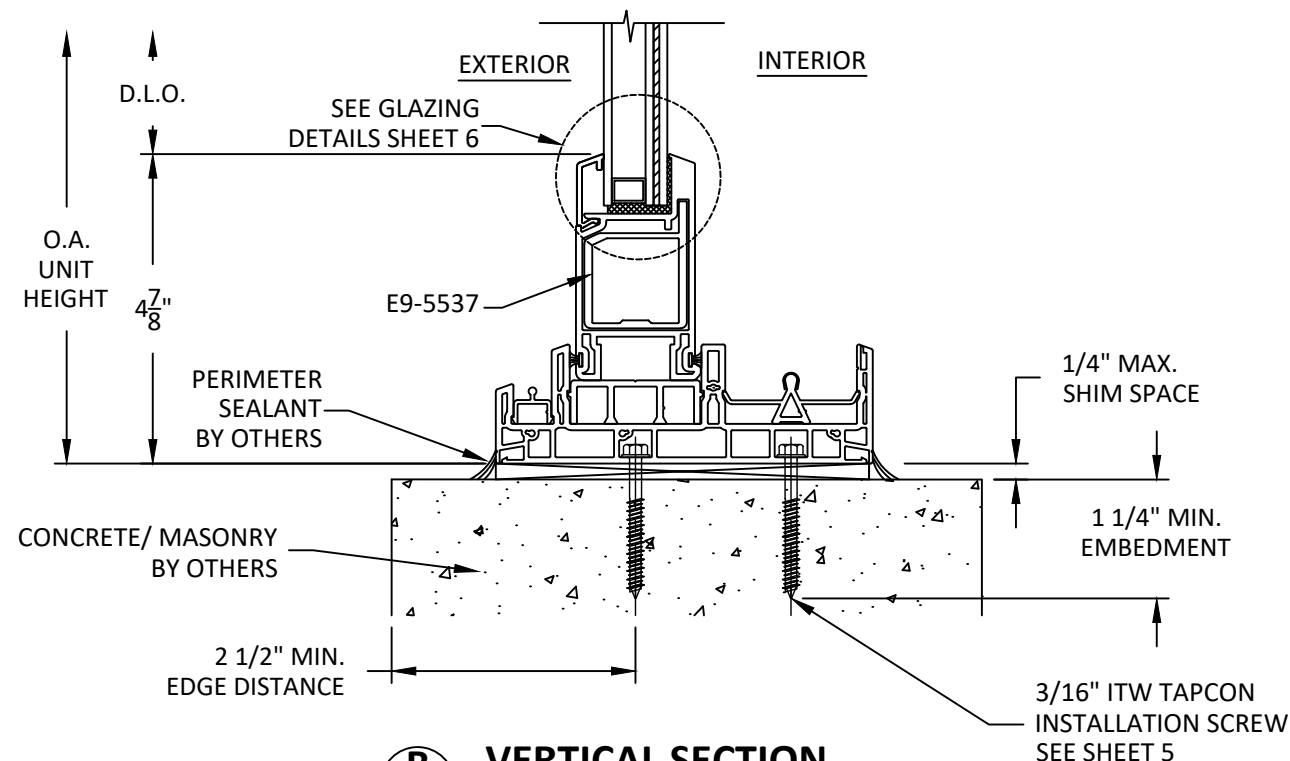

B
7 VERTICAL SECTION
FIXED SILL

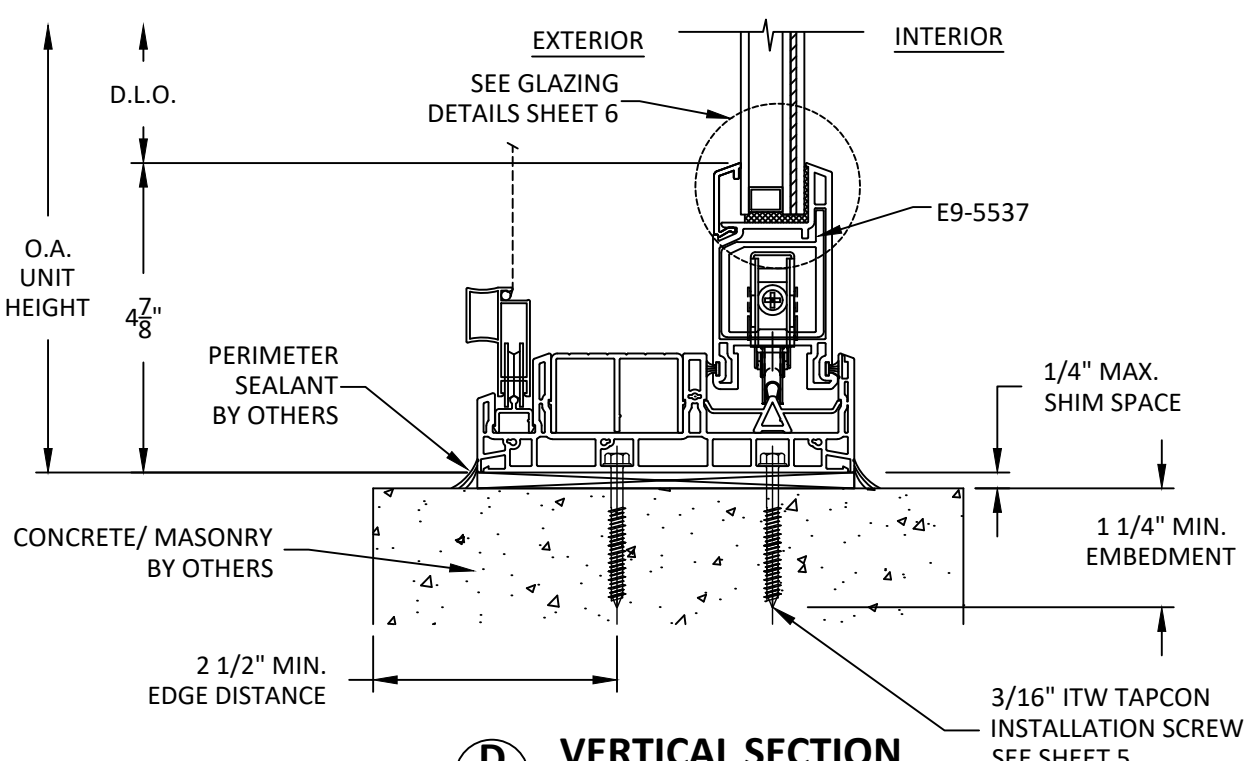

D
7 VERTICAL SECTION
OPERABLE SILL

OXXO, OXO, OX

YKK AP Quality inspires™
YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEGUARD "5400" SLIDING GLASS DOOR (HVHZ)(IMPACT)
VERTICAL SECTIONS (OXXO, OXO, OX)
PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com


REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	05.15.20
8TH FBC CODE CHANGE	FB	08.30.23
GLASS ADDITION	SH	11.18.24

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.


HERMES F. NORERO
LICENSE
No. 73778
STATE OF FLORIDA
PROFESSIONAL ENGINEER
HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL16605
DATE:	07.29.15
DWG. BY:	BB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK149
SHEET:	7

c:\users\sebastianherrerros\building drops, inc\building drops, inc\building drops, inc\projects\ykk ap america, inc\fbc-24-0930 - fbc submittal - ykk149 & ykk124 revision\dwgs\ykk149.dwg 11/19/2024 9:25 AM

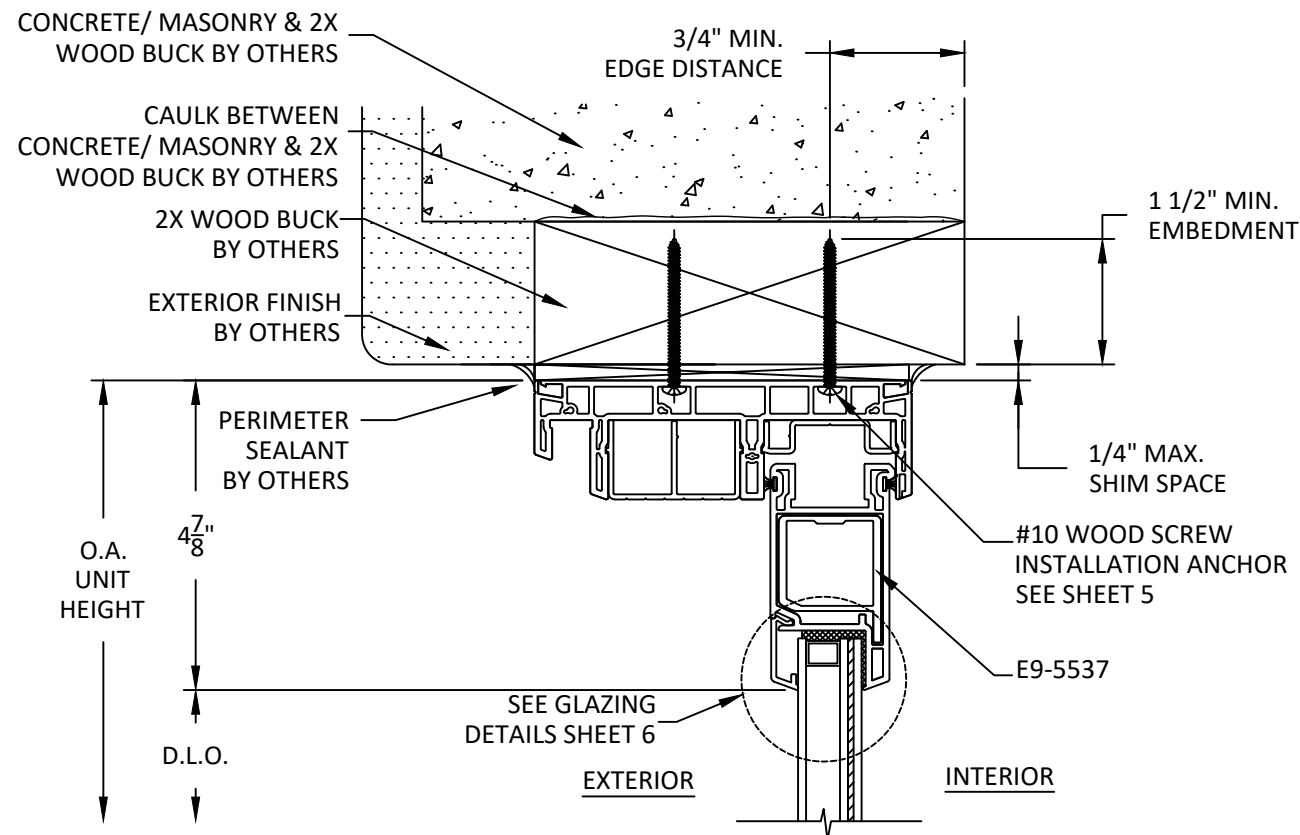

E
8 VERTICAL SECTION
FIXED HEAD

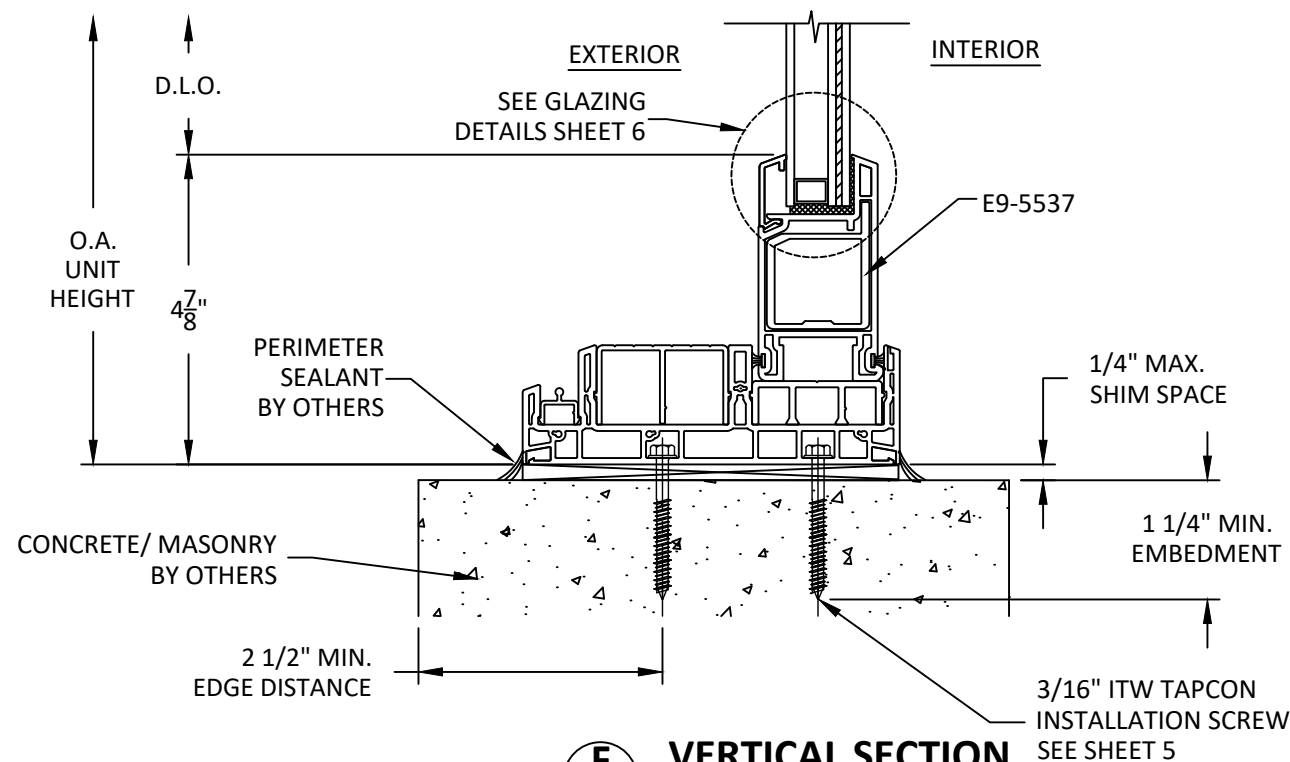

F
8 VERTICAL SECTION
FIXED SILL

OXO



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEGUARD "5400"
SLIDING GLASS DOOR
(HVHZ)/(IMPACT)


VERTICAL SECTIONS (OXO)

PREPARED BY: **BUILDING DROPS, INC.**
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

B.D.
BUILDING DROPS

REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	05.15.20
8TH FBC CODE CHANGE	FB	08.30.23
GLASS ADDITION	SH	11.18.24

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

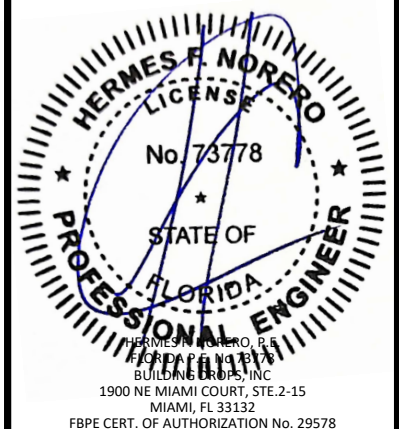

FL #: **FL16605**

DATE: **07.29.15**

DWG. BY: **BB** CHK. BY: **HFN**

SCALE: **NTS**





DWG. #: **YKK149**

SHEET:

8

11/19/2024 9:25 AM

c:\users\sebastianhereros\building drops, inc\building drops, inc\projects\ykk ap america, inc\fb-24-0930 - fbc submittal - ykk149 & ykk124 revision\dwgs\ykk149.dwg

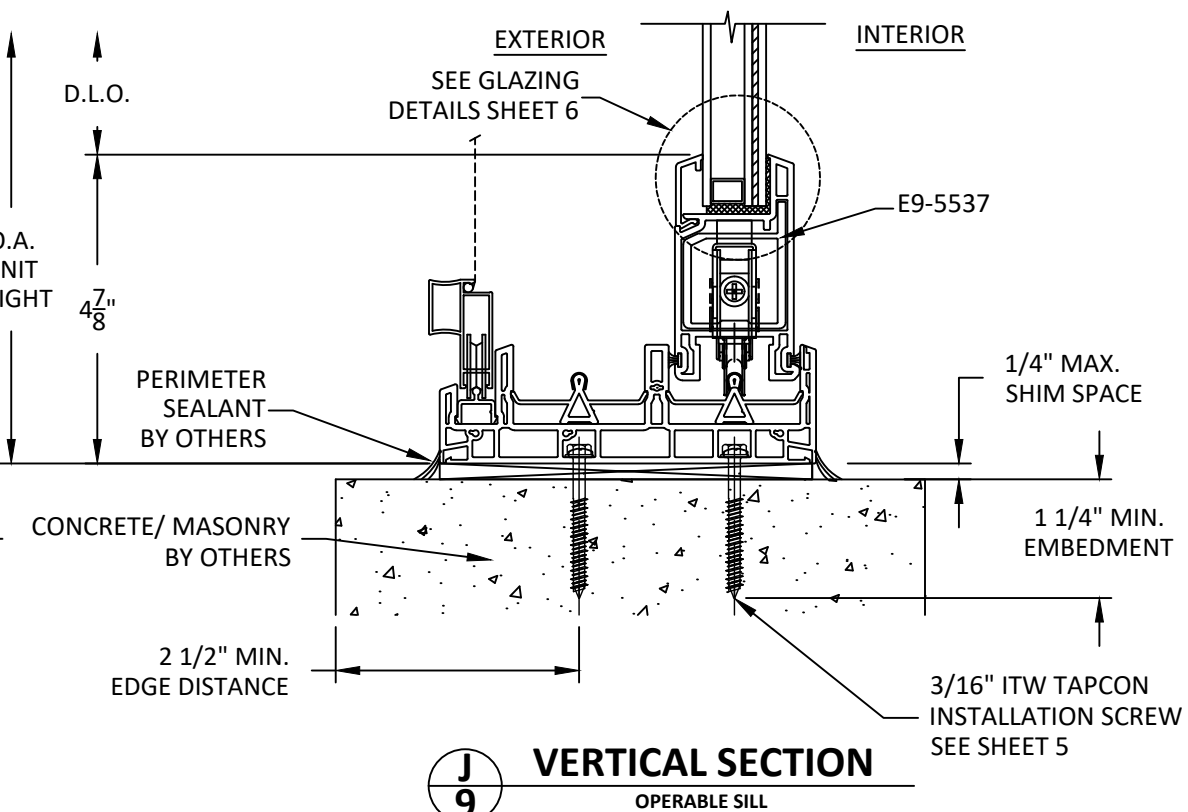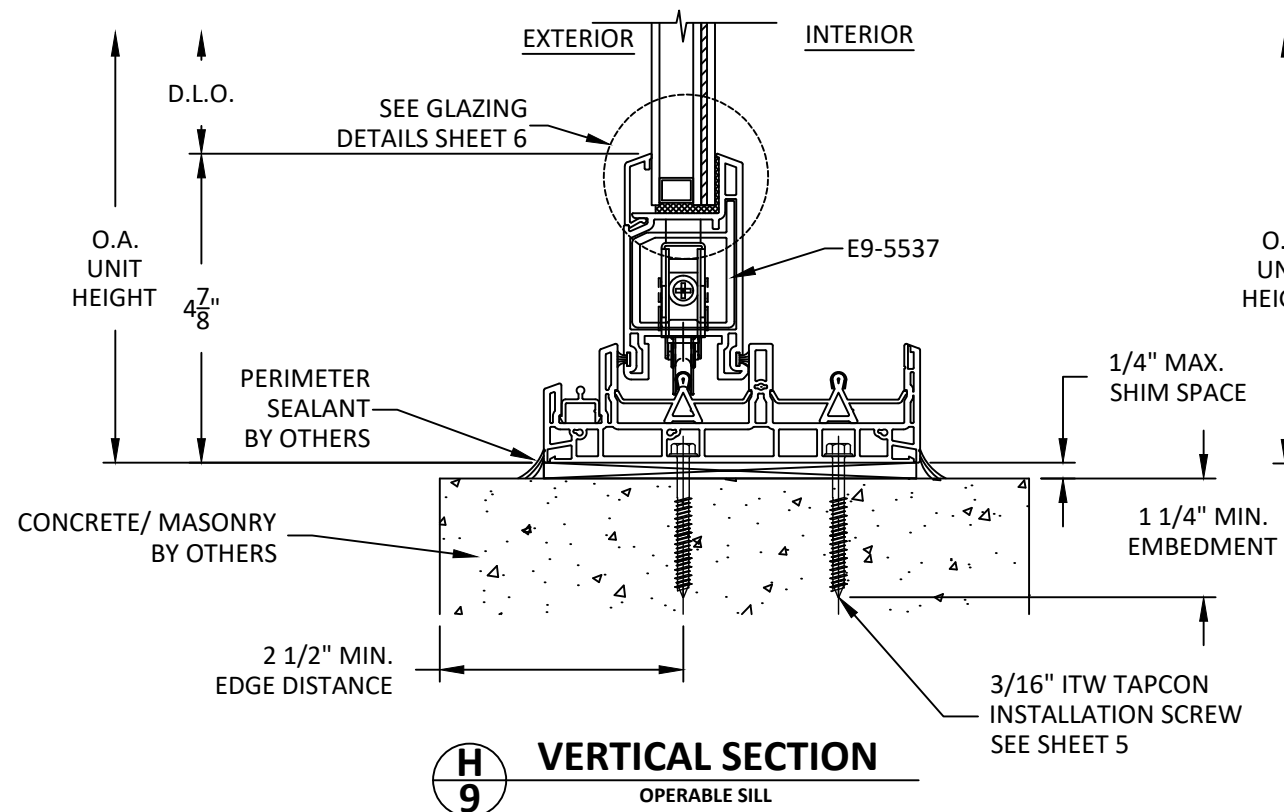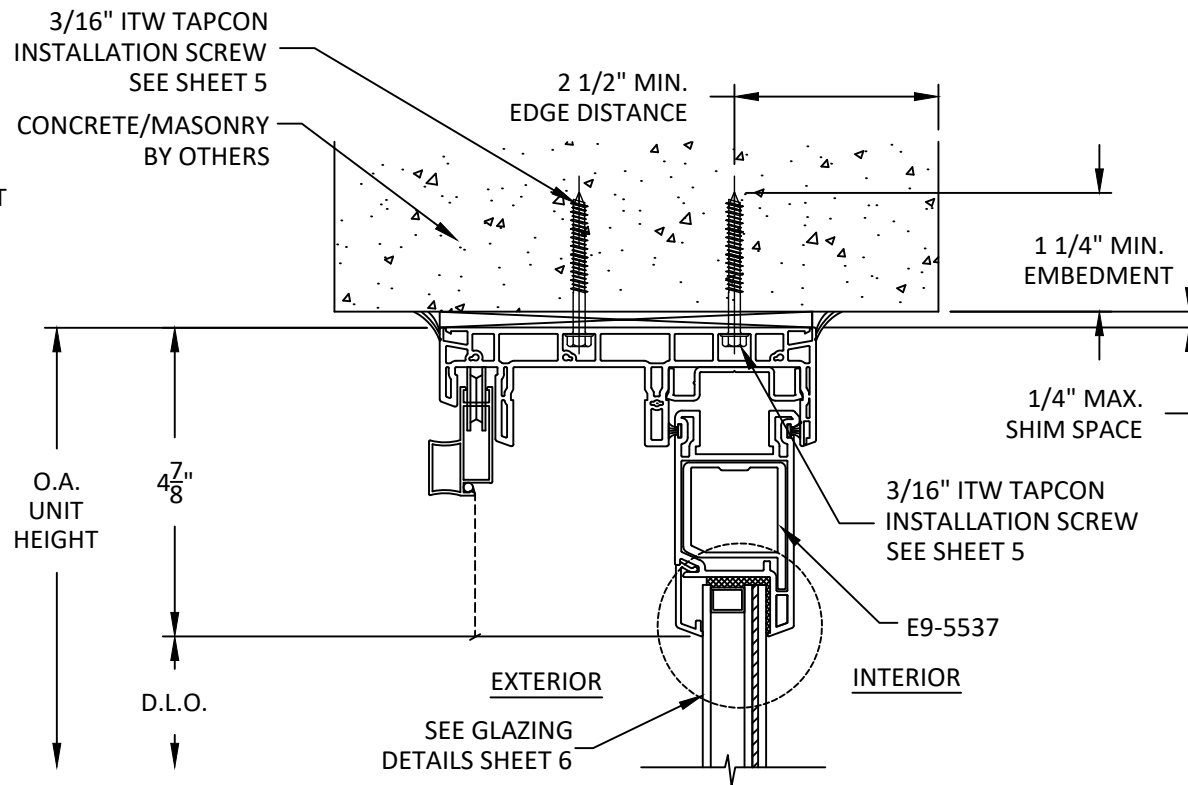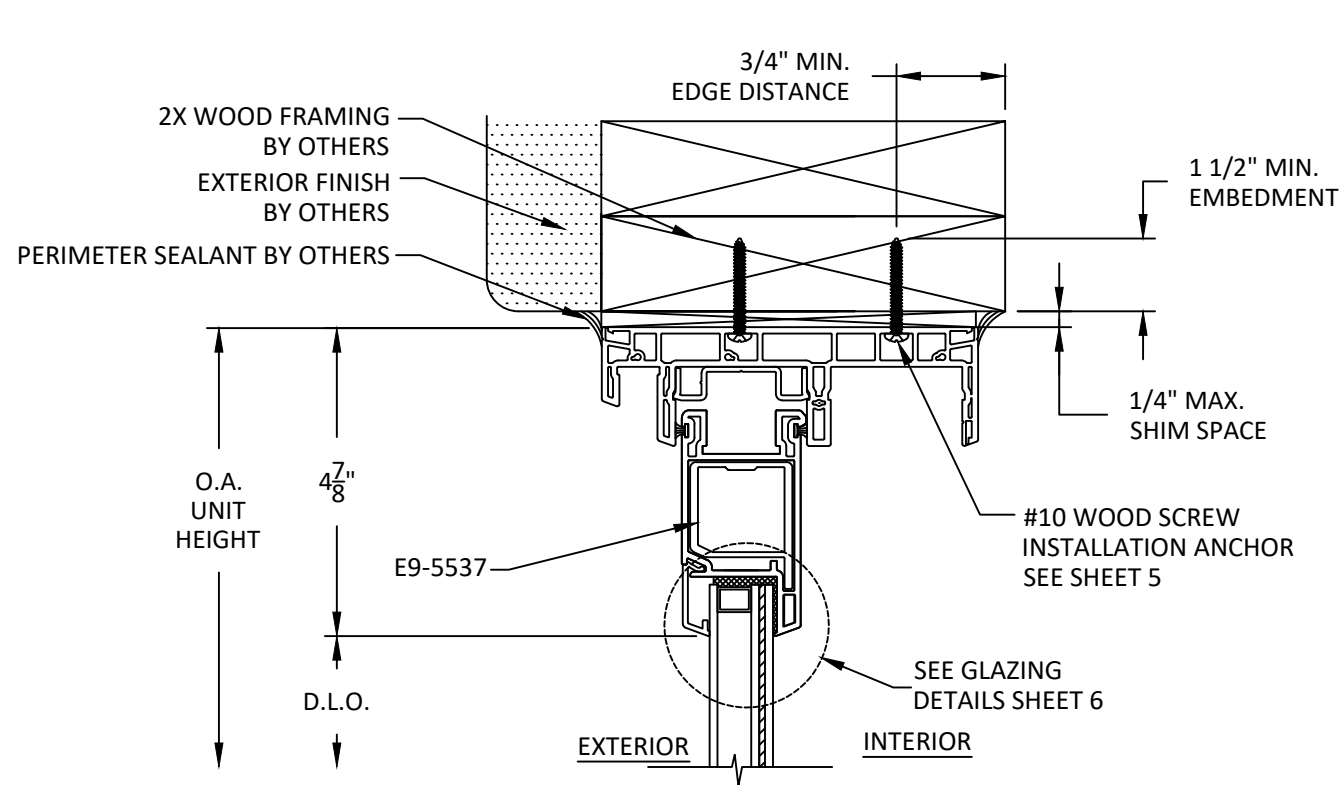

XX



YKK AP AMERICA RESIDENTIAL
101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

TITLE: STYLEGUARD "5400"
SLIDING GLASS DOOR
(HVHZ)(IMPACT)

VERTICAL SECTIONS (XX)


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
7TH FBC CODE CHANGE	MS	05.15.20
8TH FBC CODE CHANGE	FB	08.30.23
GLASS ADDITION	SH	11.18.24

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

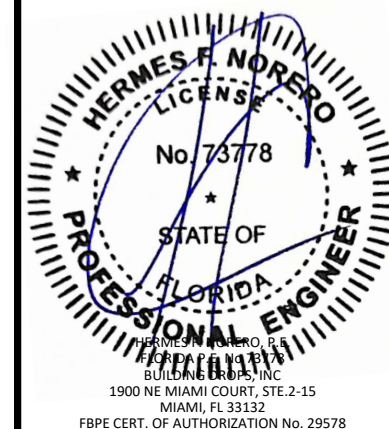

FL #:	FL16605
DATE:	07.29.15
DWG. BY:	BB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	YKK149
SHEET:	9

101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

HORIZONTAL SECTIONS (OXXO)

MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



SHEET:

OF 12



OXXO

101 MARIETTA STREET NW, SUITE 2100
ATLANTA, GA 30303
PH: (678) 838-6000

HORIZONTAL SECTIONS (OXO)

BUILDING DROPS, INC.
1000 NE MIAMI COURT, STE 215

MIAMI, FL 33132

WEB: www.buildingdrops.com



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



BUILDING DROPS, INC
1900 NE MIAMI COURT, STE.2-15

MIAMI, FL 33132

SPE CERT. OF AUTHORIZATION No. 21

FL16605

BY: <u>DD</u>	CHK. BY: <u>LIF</u>
---------------	---------------------

E: NTS

T:

11

OF 12



FIXED JAMB



INTERLOCK



MULLION
OPERABLE - FIXED



FIXED JAMB

OXO

TITLE: STYLEGUARD "5400"
SLIDING GLASS DOOR
(HVHZ)(IMPACT)

HORIZONTAL SECTIONS (OX & XX)

PREPARED BY: PHILIP DUNIC PRODUCTIONS INC

1900 NE MIAMI COURT, STE.2-15
MIAMI FL 33133


MIAMI, FL 33132
PH: (954)399-8478

FAX: (954) 744.4738



REMARKS	BY	DATE
77TH FBC CODE CHANGE	MS	05.15.20
8TH FBC CODE CHANGE	FB	08.30.23
GLASS ADDITION	SH	11.18.24

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

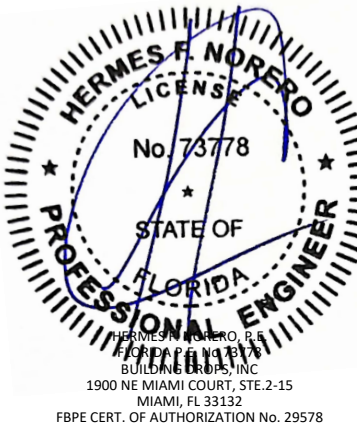

FL #: **FL16605**

DATE: 07.29.15

DWG. BY: BB	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: YKK149

SHEET:

12

DF 12

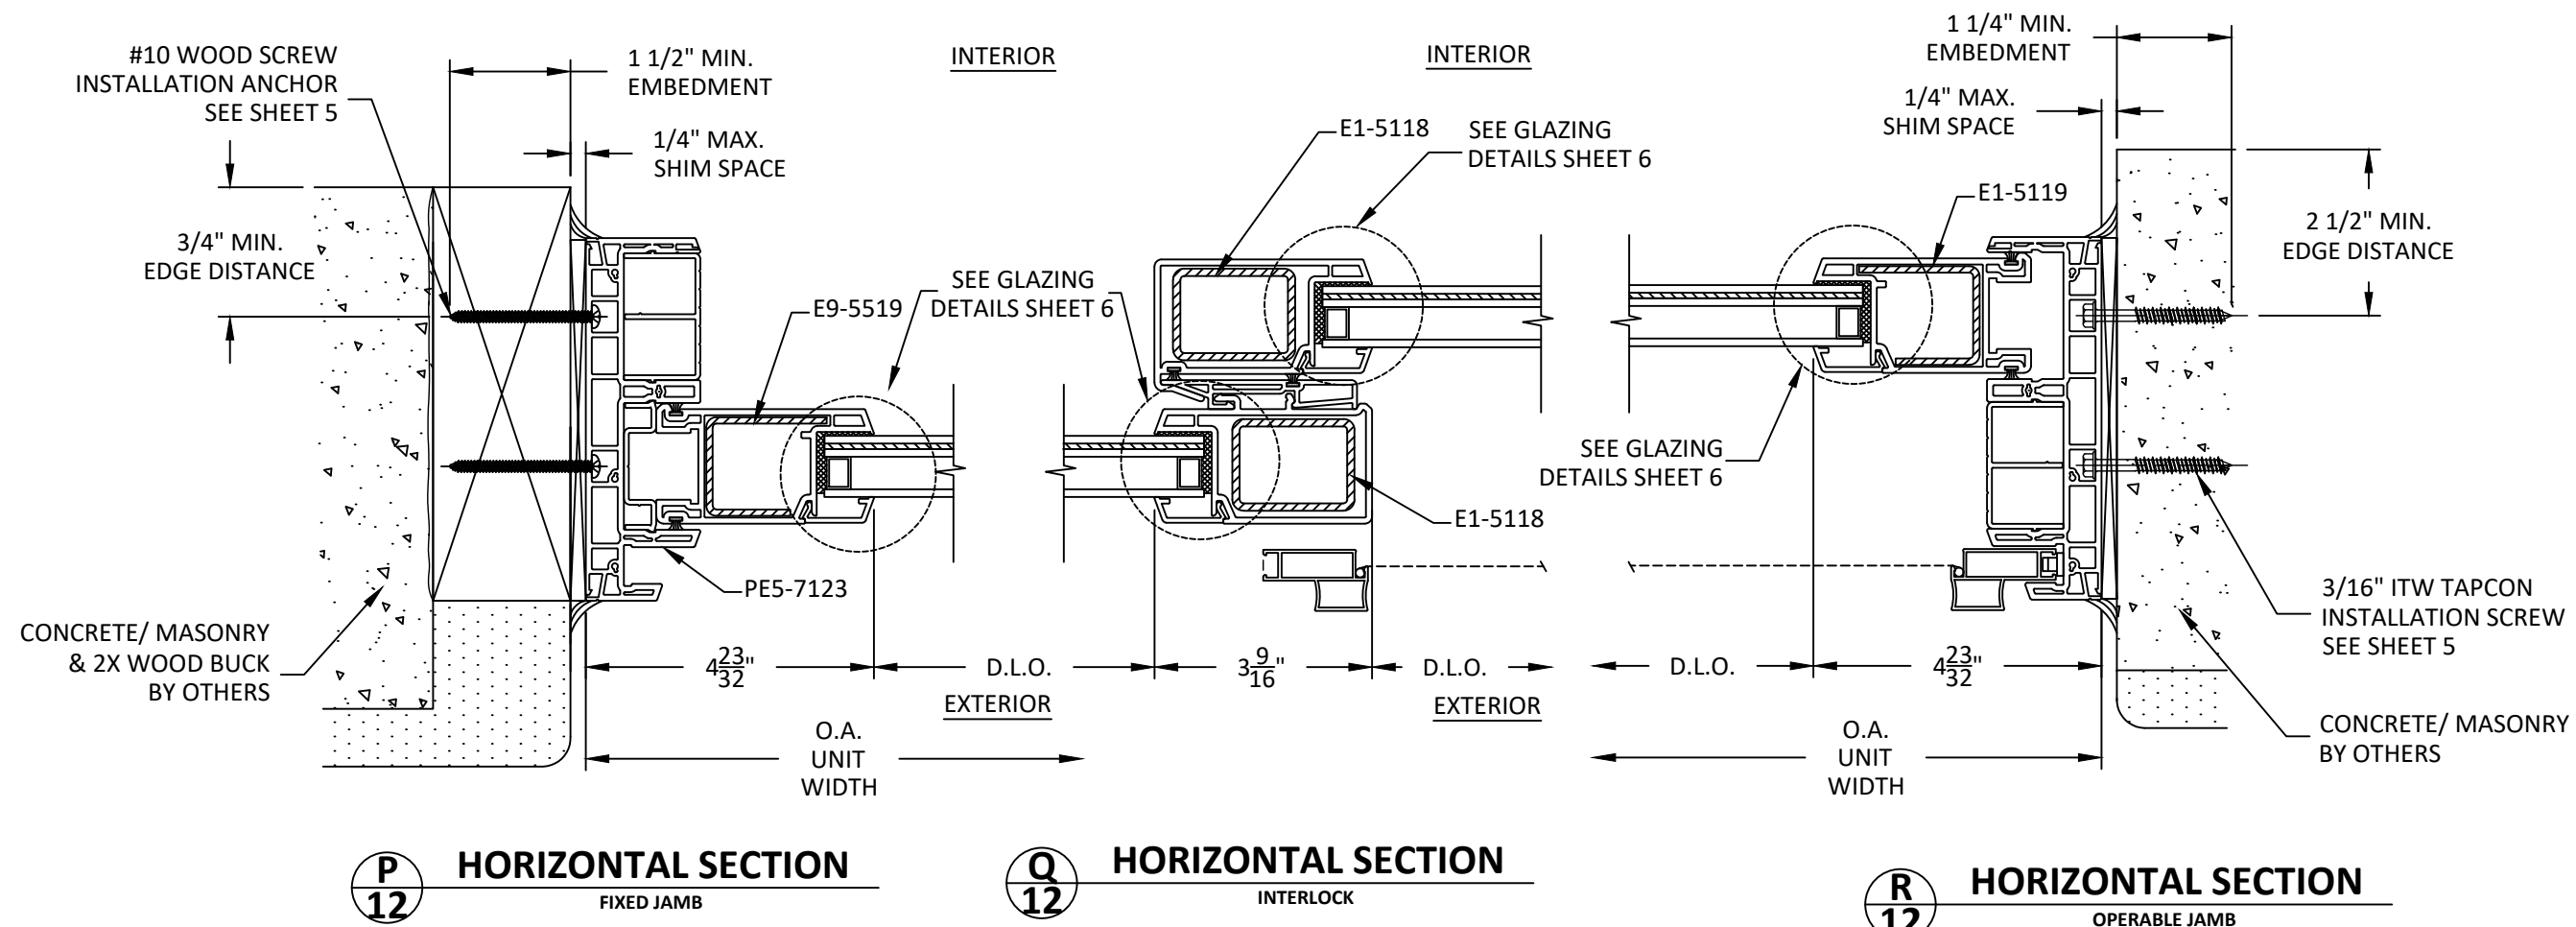

XX, OX