


SINGLE HUNG - NON-IMPACT



- GENERAL NOTES:
- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE FLORIDA BUILDING CODE (FBC), CURRENT EDITION.
 - 2. GLAZING OPTIONS: (SEE SHEET 2)
 - 3. CONFIGURATIONS: "O/X".
 - 4. DESIGN PRESSURE RATING:
 - NEGATIVE DESIGN LOADS BASED ON TESTED PRESSURE AND GLASS TABLES ASTM E-1300.
 - POSITIVE DESIGN LOADS BASED ON TESTED PRESSURE, WATER INFILTRATION TEST PRESSURE AND GLASS TABLES ASTM E-1300.
 - DESIGN LOADS ARE BASED ON ALLOWABLE STRESS DESIGN, ASD.
 - 5. ANCHORAGE: THE 33 1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. SEE SHEETS 5-6 FOR INSTALLATION DETAILS.
 - 6. NOT APPROVED FOR IMPACT RESISTANCE. IMPACT PROTECTIVE SYSTEM IS REQUIRED IN WIND BORNE DEBRIS REGION.
 - 7. ALL FRAMES SCREWED TOGETHER. SMALL JOINT SEAM SEALANT USE AT ALL FRAME JOINTS.
 - 8. SOLID CONCRETE STRUCTURE IS RESPONSIBILITY OF ARCHITECT OR ENGINEER OF RECORD.
 - 9. THE DESIGNATION X AND O STAND FOR THE FOLLOWING:
X = OPERABLE SASH, O = FIXED SASH.
 - 10. SECTION CALLOUTS APPLY TO ALL ELEVATIONS IN A SIMILAR LOCATION.
 - 11. WEEP SLOTS = 1/4" X 1 1/4" LOCATED 4" FROM BOTH ENDS.

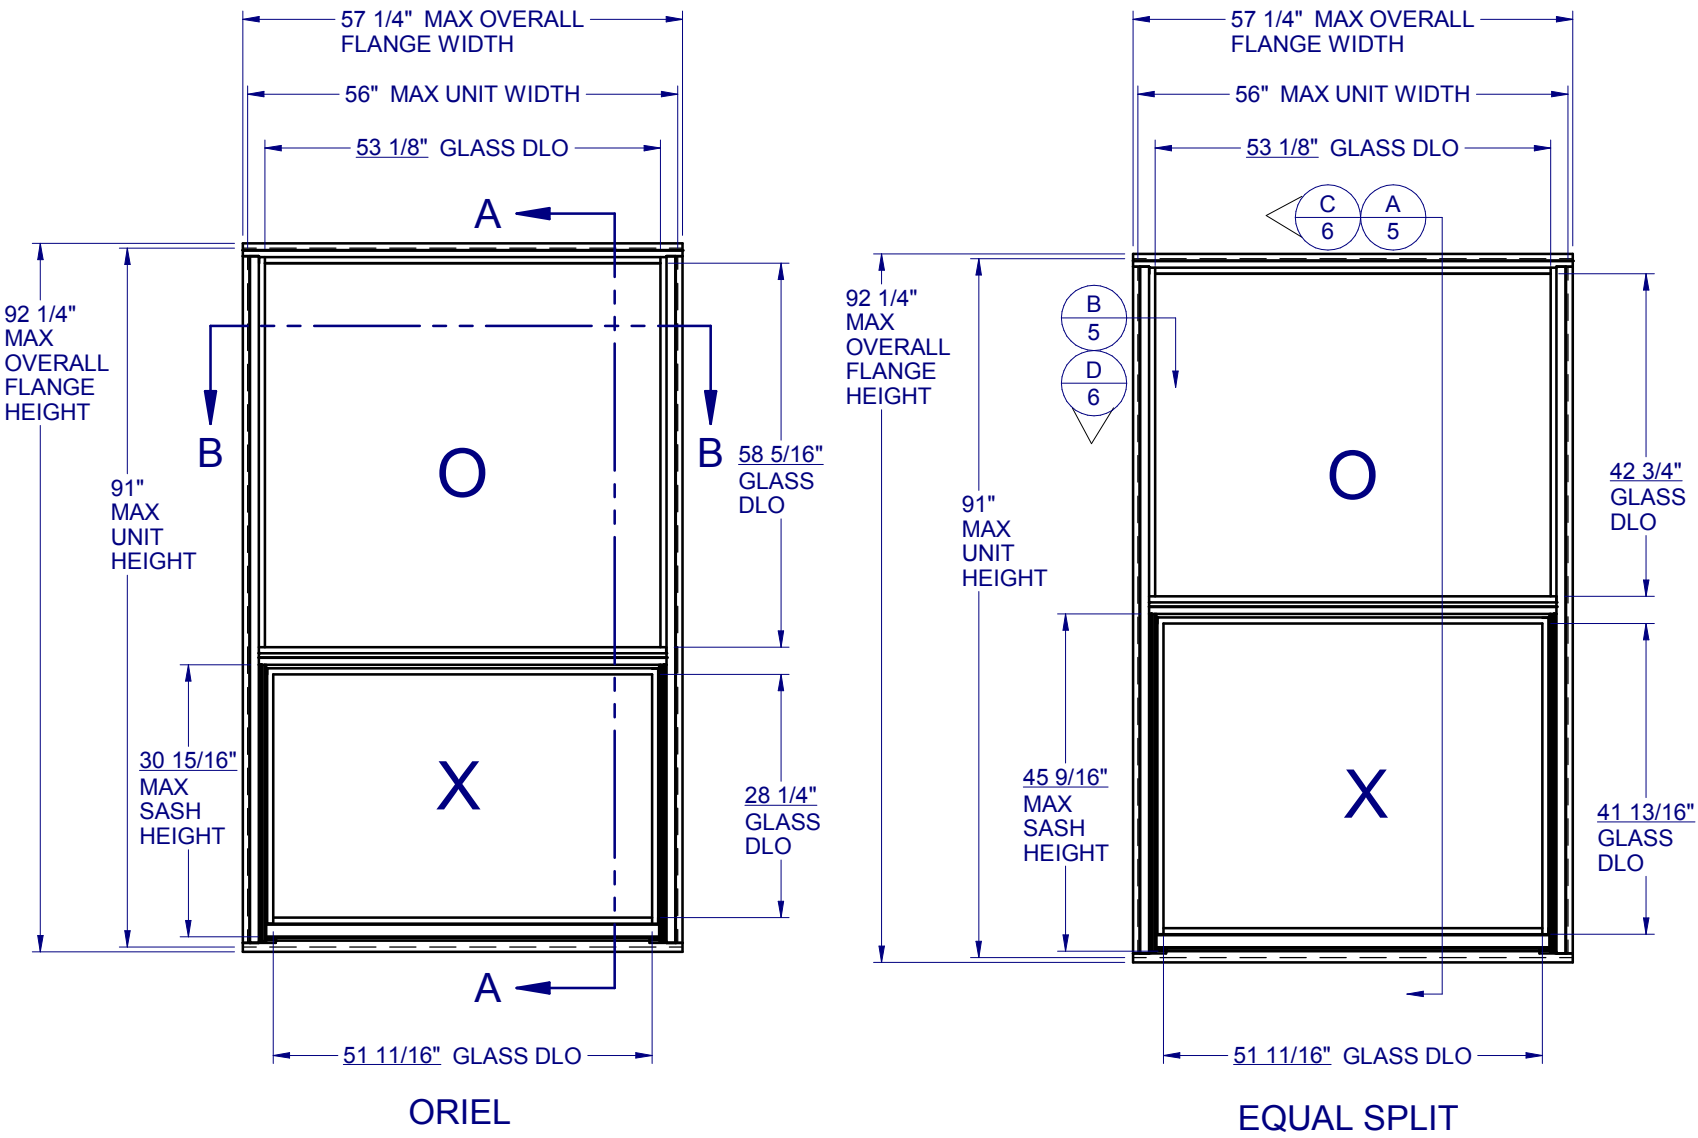

1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

ASH01

3500 ALUM.
SINGLE HUNG
NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
16778



9/16/2026

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:
GENERAL NOTES AND ELEVATIONS

DRAWN BY:	DATE:
MCS	8/20/2026
DWG #:	REV.:
CWS-880	D
SCALE:	SHEET
1:25	1 OF 6

TABLE OF CONTENTS

GENERAL NOTES & ELEVATIONS.....1

SECTION VIEWS & GLAZING DETAIL.....2

BOM & EXTRUSIONS.....3

ANCHOR SCHEDULE & NOTES.....4

INSTALLATION DETAIL.....5-6

CONFIG.	MAX. UNIT SIZE	DESIGN PRESSURE RATING	IMPACT RATING
EQUAL SPLIT	56" x 91"	+/-30 PSF	NONE
ORIEL			

Lucas Turner
2026.09.16
17:08:12
-05'00'



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

ASH01

3500 ALUM. SINGLE HUNG NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
16778



9/16/2026


LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

SECTION VIEWS AND GLAZING DETAILS



DRAWN BY:	DATE:
MCS	8/20/2026
DWG #:	REV.:
CWS-880	D
SCALE:	SHEET
1:2	2 OF 6

INTERIOR

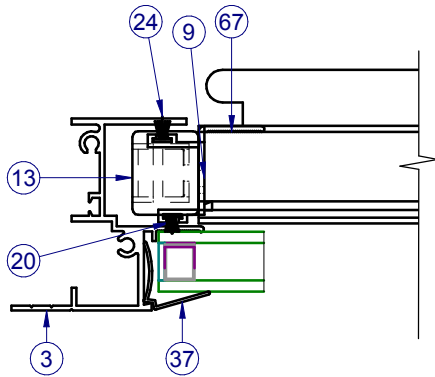


SECTION B-B

NOTE: LEFT SIDE SHOWS FIXED SECTION VIEW,
RIGHT SIDE SHOWS SASH SECTION VIEW

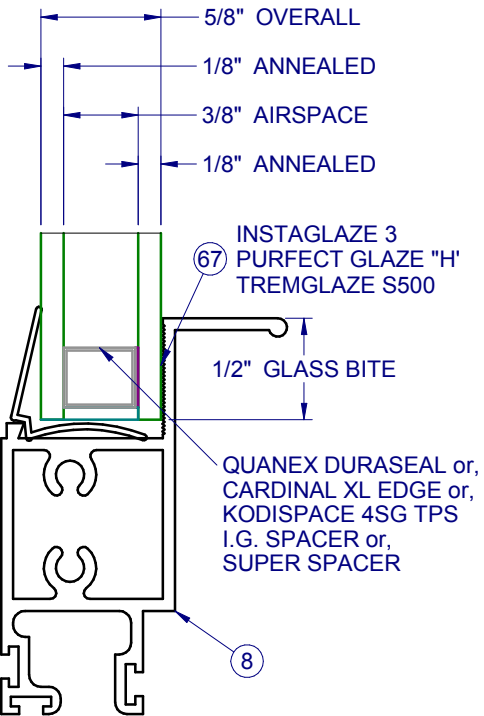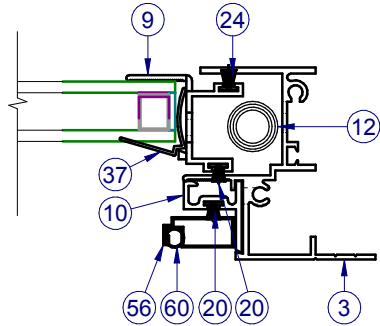




GLASS TYPE A
1:1

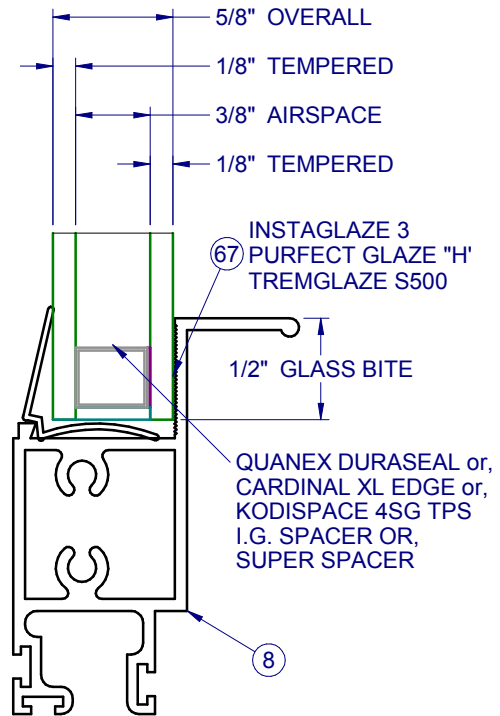

GLASS TYPE B
1:1

NOTES:

-GLASS TYPE B AS INDICATED IN THIS APPROVAL IS SGCC CERTIFIED TO ANSI Z97.1 AND CPSC 16 CFR 1201, TO BE FIELD VERIFIED BY PERMANENT ETCHING MARK ON EACH GLASS LITE.

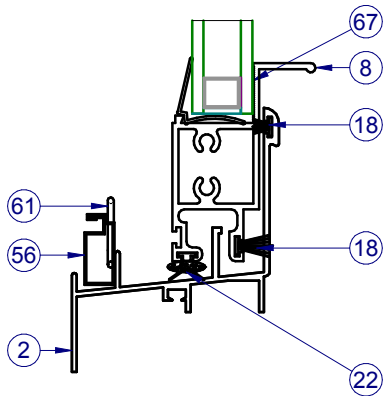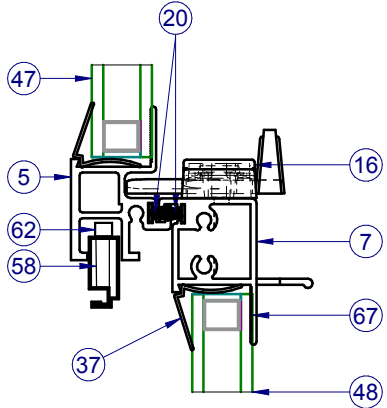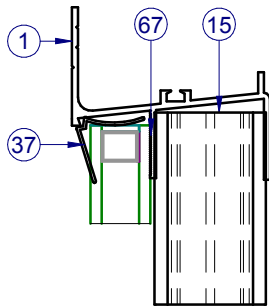

SECTION A-A



INTERIOR

NOTE: ITEMS NOT SHOWN FOR CLARITY:
11,14, 23, 26-32, 34, 35, 42, 43-46, 59, 63, 65, 66

PARTS LIST			
Item	Part #	Description	Material
1	S-1326	Fr. Head, Flg., Head	Aluminum
2	S-1182	Fr. Sill, Flg., Sill	Aluminum
3	S-1077	Fr. Jamb, Flg.	Aluminum
5	H-1563	Fxd. Mtg. Rail	Aluminum
7	H-1072	Sash Meet. Rail	Aluminum
8	H-1181	Sash Bot./Pull Rail	Aluminum
9	S-1073	Sash Side/Top Rail	Aluminum
10	S-1074	Scrn. Adapt., w/o leg, Vert.	Aluminum
11	S-2020	Install Clip	Aluminum
12		Sash Balance	
13	P-3040	Sash Cam	
14	P-3046	Take Out Clip	
15	P-3043	Sash Stop	
16	P-4707	SWEEP LOCK, AMBIDEXTROUS	Nylon
18	P-3305	Wstp., 0.270 x .187 back FinSeal, Black, SoftTouch	Nylon
20	P-3304	Wstp., .180 x .187 Back, Fin, UltraFin	Nylon
22	P-3011	Wstp., 0.350 x .187 back, foam filled bulb w/wands	Nylon
24	P-3309	Wstp., 0.210 x .187 back FinSeal, Black, SoftTouch	Nylon
26	P-4144	#8 X 1.000 W 1/4" lead Quad Type A SMS	Steel
28	P-3635	#8 x 0.750 Quad PH Type A SMS	Steel
29	P-3515	#8 x 0.625 Ph FH Type A SMS	Steel
30	P-3264	Gasket, Hd. & Sill at Jb.	Closed Cel
33		Seam Sealer, SM-5504	
34	P-3373	Pad, Sill	Open Cell
36	P-3431	GLAZING BEAD, SINGLE GLAZED	Metal
37	P-3020	Glazing Bead, Insulated glass	PVC
42	P-3352	Set. Blk., 85 Dur., 1/8" x 5/8" x 2" Lg.	
47		Glass, Fixed	
48		Glass, Sash	
56	P-3218	Screen Frame	Alum
58	P-4754	SCREEN CORNER KEY	Alum
59	P-4771	36"-BetterVue Insect Screen, 18x16	
60	P-5576	Screen Spline, .125" Black PE Ribbed	Nylon
61	P-4755	SCREEN CORNER KEY (Rollform Scrn 1" Offset "w/ safety tak	Steel
62	P-3195	SPRING, NO HOLE TENSION	SS
63	S-1465	Install Clip	Aluminum
66	S-1114	HEAD, SH ARCHTOP	Aluminum
67		SikaFlex 552, Purfect Glaze "H"	

LINE ITEMS NOT USED:
6,19, 25, 27, 31, 32, 35, 37-41, 44, 49-55, 57, 64, 65

NOTE: ALL ALUMINUM EXTRUSION ARE 6063-T6 UNLESS OTHERWISE NOTED.

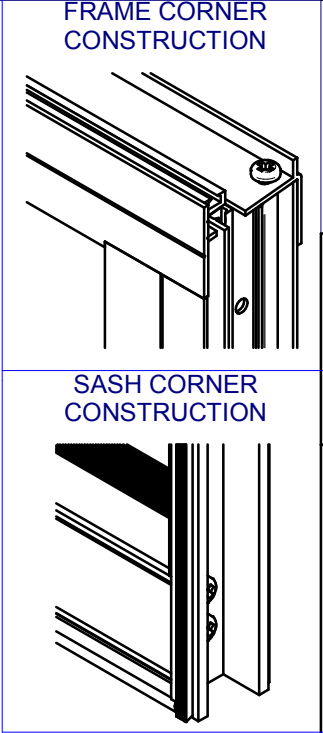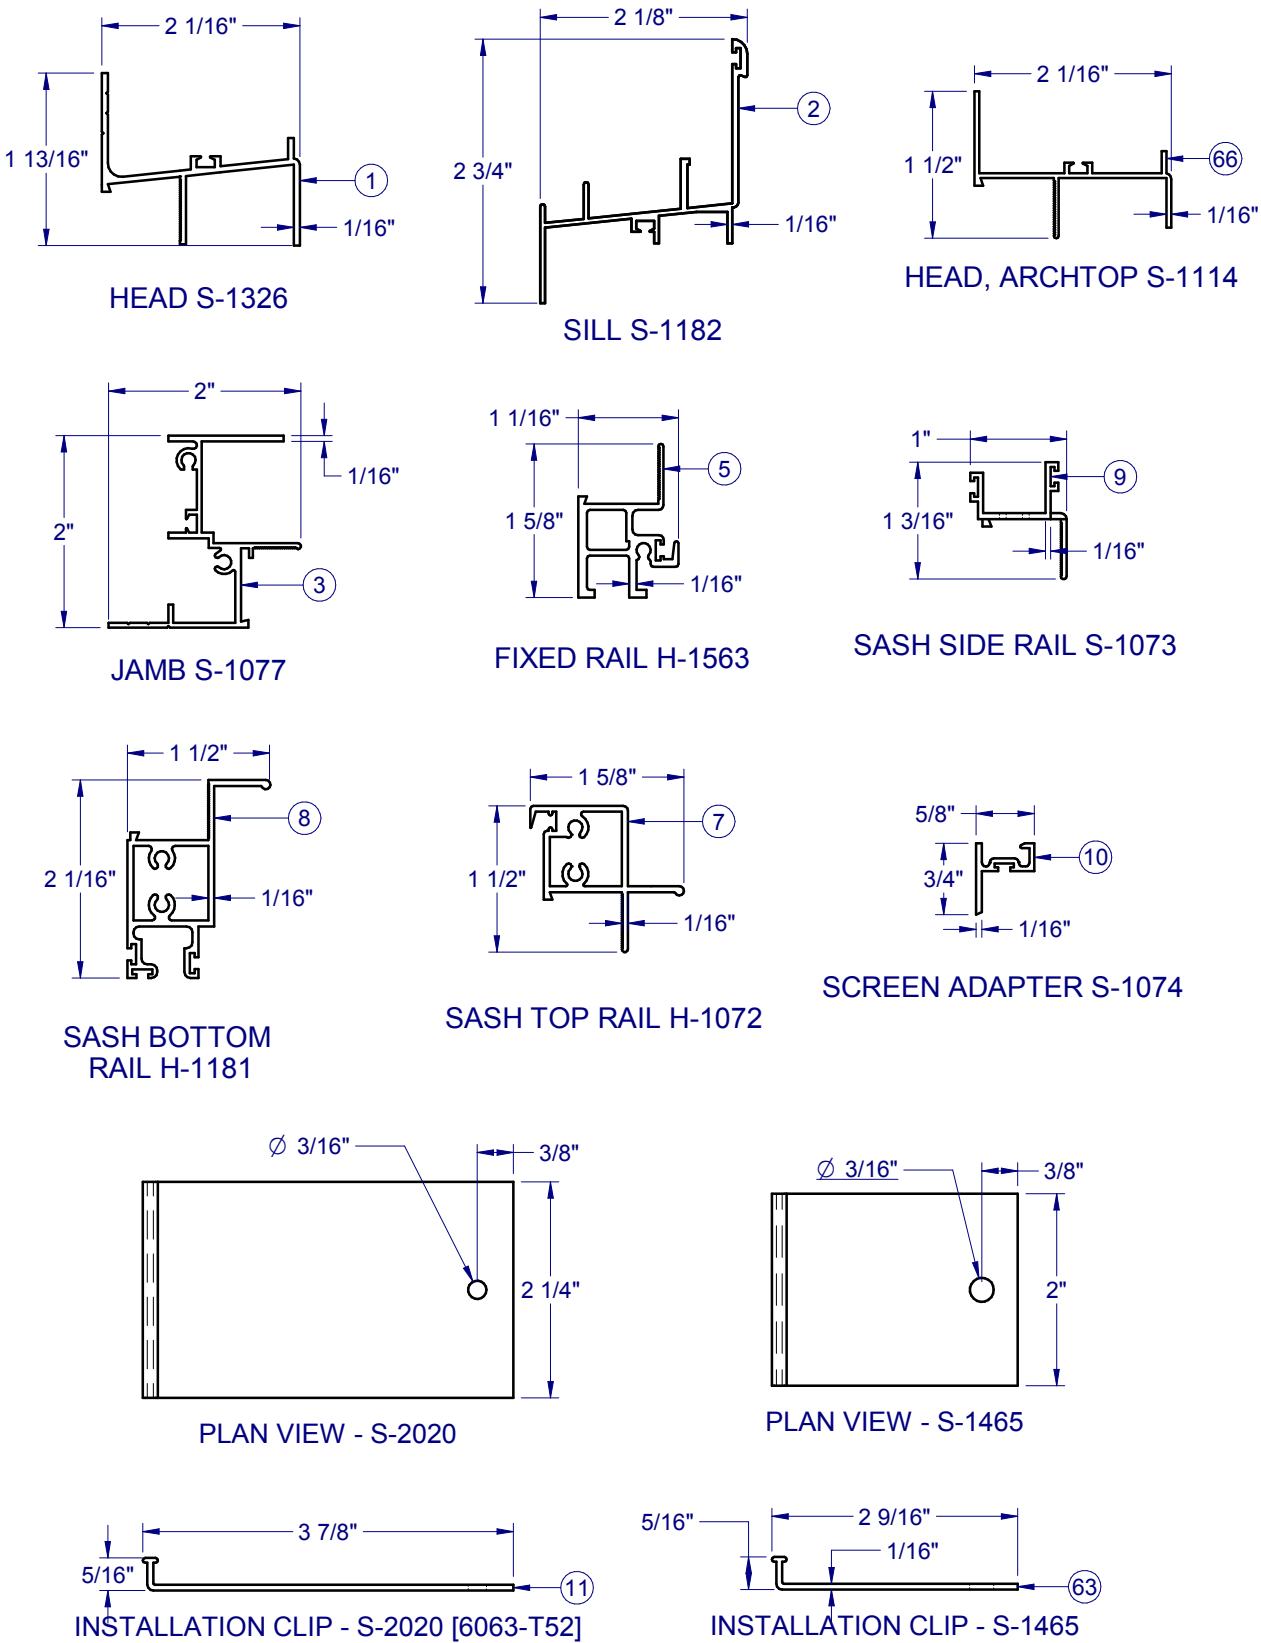



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

ASH01

**3500 ALUM.
SINGLE HUNG
NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
16778





9/16/2026

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:
BOM AND EXTRUSIONS

DRAWN BY:	DATE:
MCS	8/20/2026
DWG #:	REV.:
CWS-880	D
SCALE:	SHEET
1:2	3 OF 6

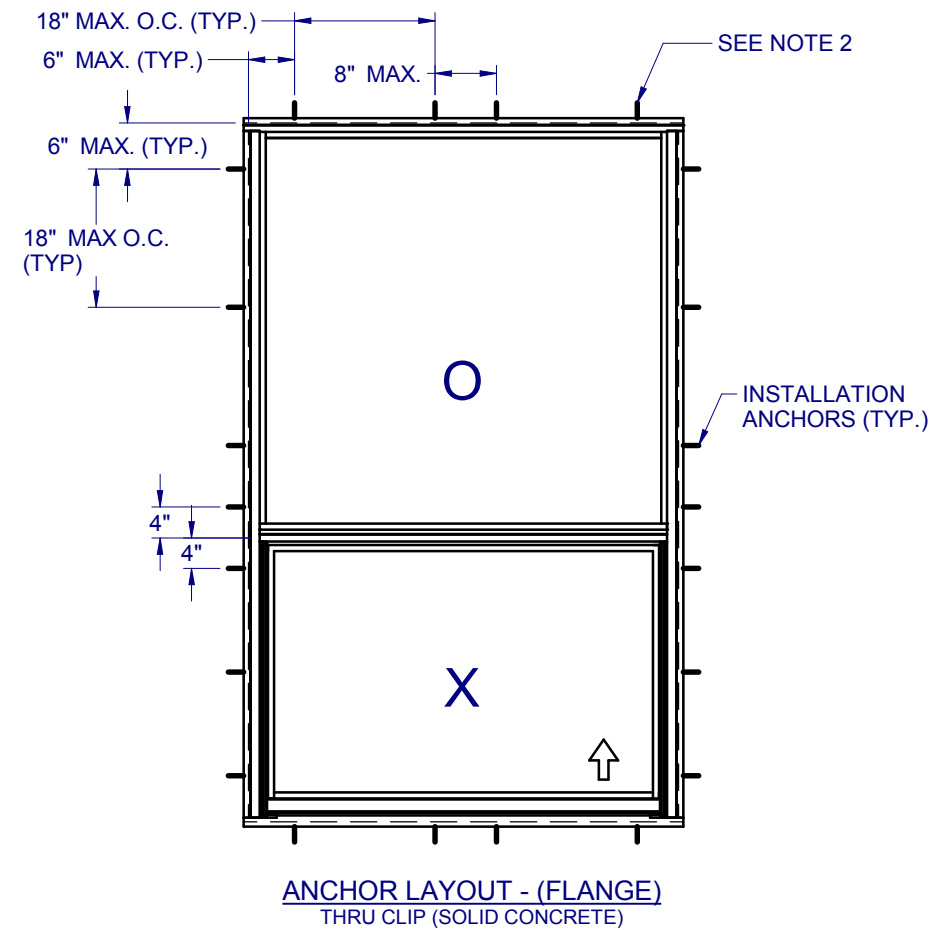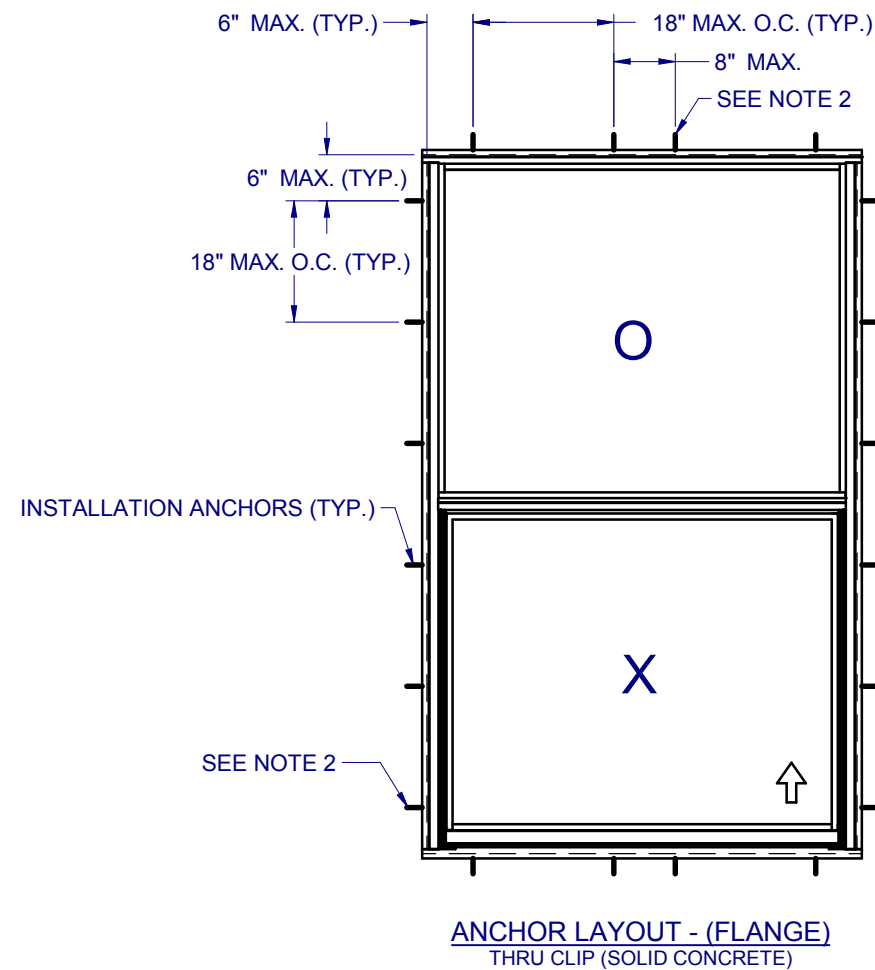

NOTES:

1. INSTALL ONE ANCHOR AT EACH LOCATION. SILL ANCHOR SPACING SAME AS HEAD.
2. SHIM AS REQ'D AT EACH SET OF INSTALLATION ANCHORS USING LOAD BEARING SHIMS. MAX. ALLOWABLE SHIM STACK TO BE 1/4". USE SHIMS WHERE SPACE GREATER THAN 1/16" IS PRESENT. LOAD BEARING SHIMS SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER. WOOD SHIMS ARE NOT ALLOWED.
3. ANCHOR TYPE, SIZE, SPACING AND EMBEDMENT SHALL BE SPECIFIED IN THESE DRAWINGS, SEE TABLE 1, SHEET 5.
4. ALL INSTALLATION ANCHORS MUST BE MADE OF OR COATED WITH A CORROSION RESISTANT MATERIAL. DISSIMILAR MATERIALS OR MATERIALS IN CONTACT WITH PRESSURE TREATED WOOD MUST BE PROTECTED TO PREVENT REACTION.
5. INSTALLATION ANCHORS SHALL BE IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM SPECIFIED IN TABLE 1, SHEET 5.
6. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO. FOR CONCRETE OPENINGS, EMBEDMENT SHALL BE BEYOND WOOD BUCKS, IF USED, AND INTO SUBSTRATE - 1X BUCKS ARE OPTIONAL.
7. A MINIMUM 4" CENTER-TO-CENTER SPACING SHALL BE MAINTAINED BETWEEN ALL MASONRY FASTENERS. A MINIMUM 1" CENTER-TO-CENTER SPACING SHALL BE MAINTAINED BETWEEN ALL WOOD AND METAL FASTENERS.
8. WOOD OR MASONRY OPENINGS, BUCKS AND BUCK FASTENERS SHALL BE PROPERLY DESIGNED BY THE ARCHITECT OR ENGINEER OF RECORD AND INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE. SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS AS SHOWN IN TABLE 1, SHEET 5. CONCRETE AND MASONRY SUBSTRATES SHALL NOT BE CRACKED.
9. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS FOLLOWING THE CURRENT VERSION OF THE REFERENCE DOCUMENTS:
FMA/AAMA 100(FIN WINDOWS), FMA/AAMA 200(FLANGE WINDOWS),
FMA/WDMA 250(BOX WINDOWS), FMA/AAMA/WDMA 300(EXTERIOR DOORS).



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

ASH01

**3500 ALUM.
SINGLE HUNG
NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
16778





9/16/2026

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:



**ANCHOR SCHEDULE AND
NOTES**

DRAWN BY:	DATE:
MCS	8/20/2026
DWG #:	REV.:
CWS-880	D
SCALE:	SHEET
1:25	4 OF 6

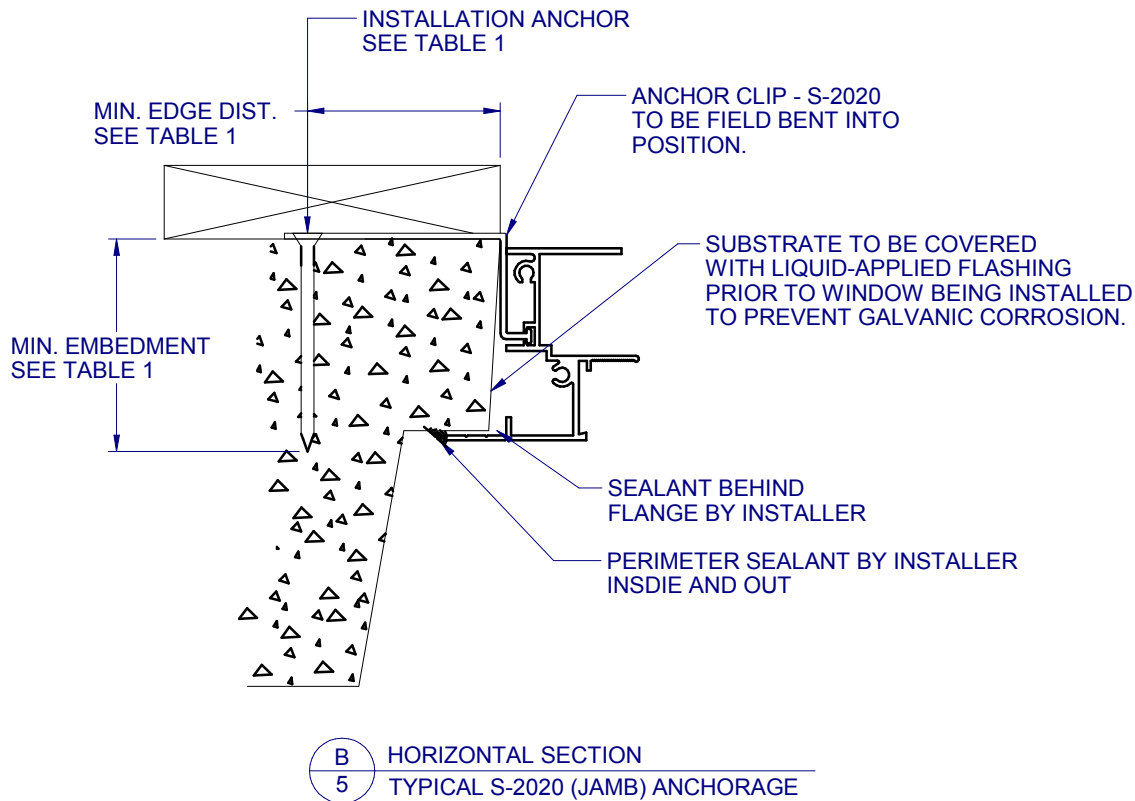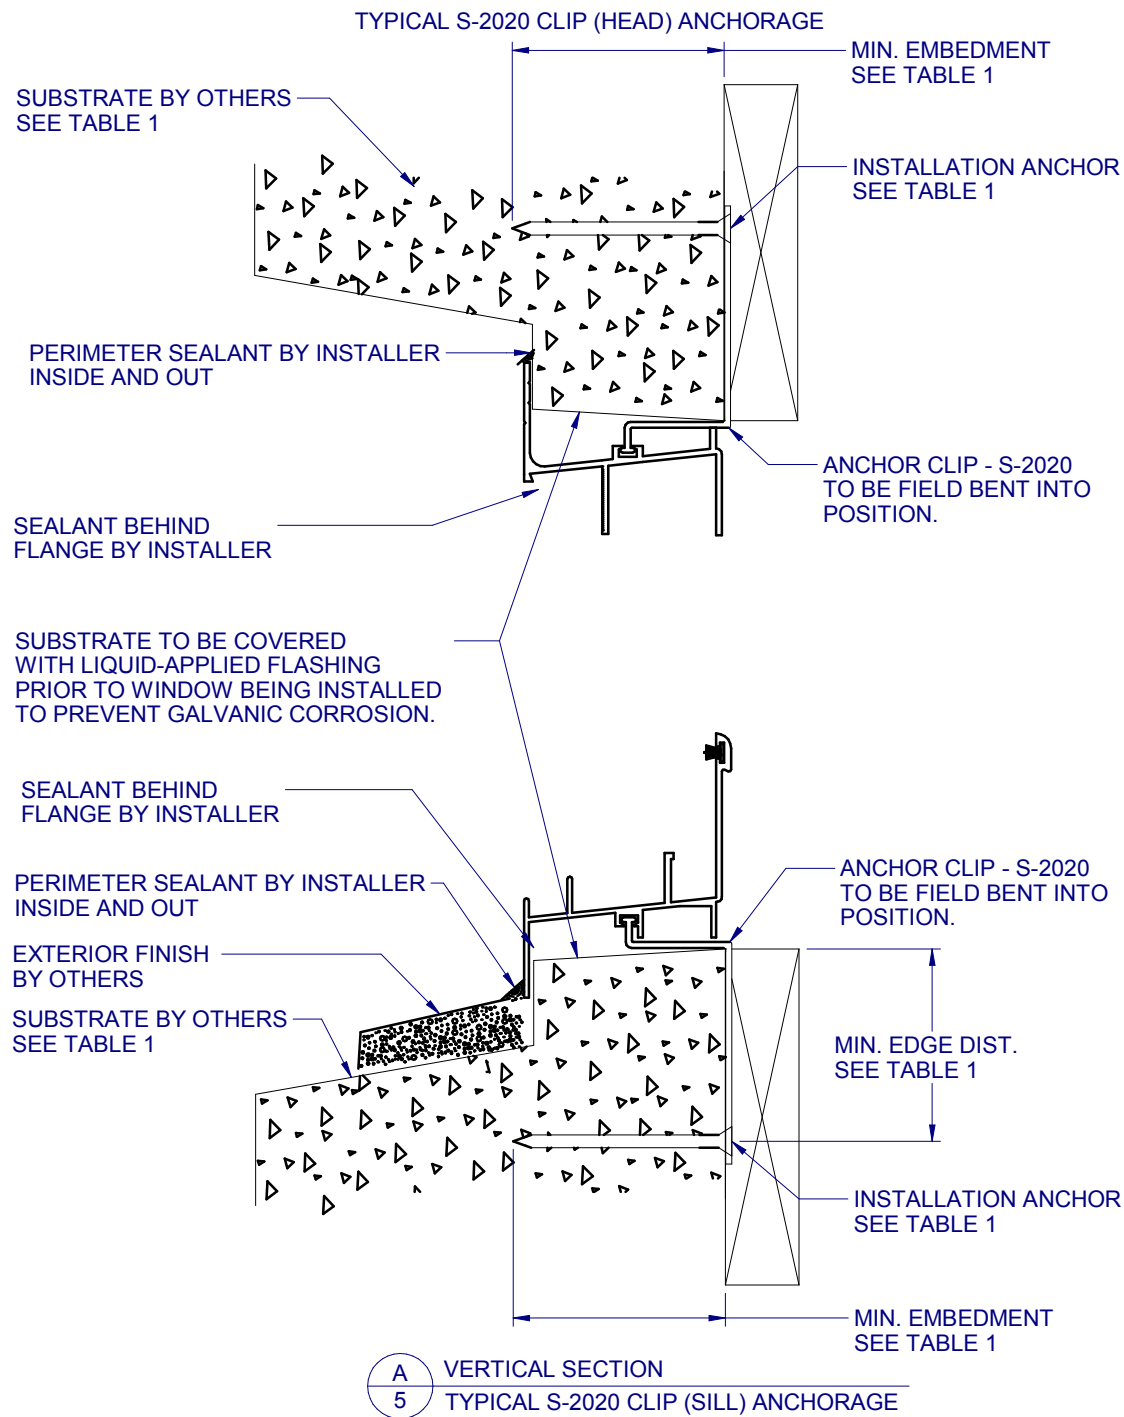

FOR INSTALLATIONS WITHIN 3,000 FEET OF A SALTWATER COASTLINE, ANCHORAGE MUST BE REVIEWED FOR COMPLIANCE WITH FBC SECTION 1711 OR SECTION R332 OF THE FLORIDA RESIDENTIAL CODE. REFER TO THE CORRESPONDING EVALUATION REPORT OF THIS APPROVAL FOR ADDITIONAL INFORMATION.

TABLE 1: APPROVED INSTALLATION FASTENERS			
SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DIST.
CONCRETE (2.0 KSI MIN.)	3/16" ITW TAPCON	1-3/4"	2"
CONCRETE (3.05 KSI MIN.)	3/16" DEWALT ULTRACON+	1-3/4"	2"
2x MIN. SPRUCE-PINE-FIR WOOD (G=0.42 MIN.)	3/16" ITW TAPCON OR DEWALT ULTRACON+	1-1/2"	7/8"
2x MIN. SPRUCE-PINE-FIR WOOD (G=0.42 MIN.)	#10 WOOD SCREW	1-1/2"	7/8"

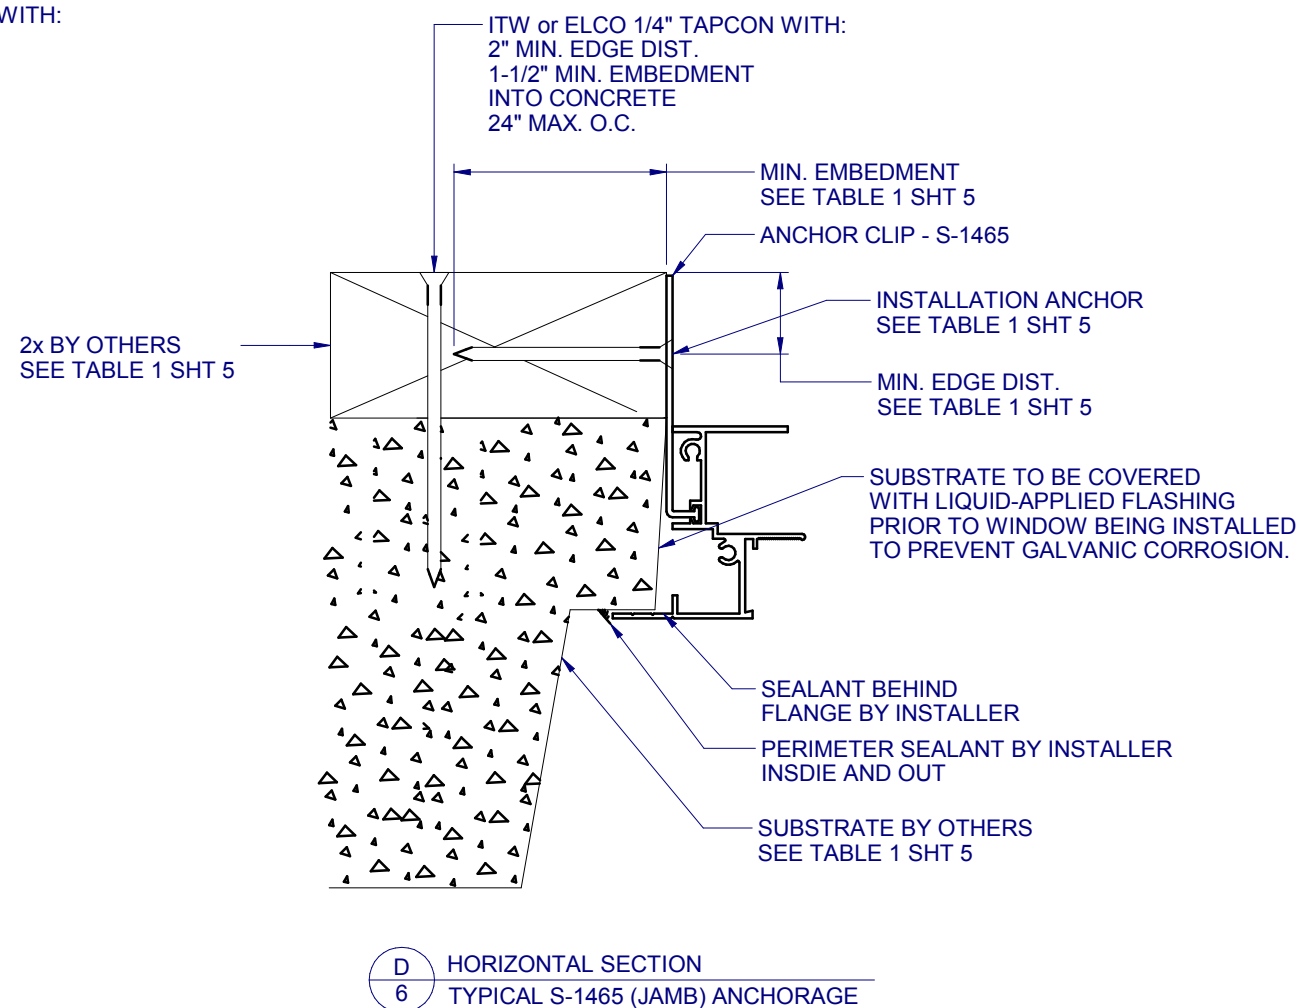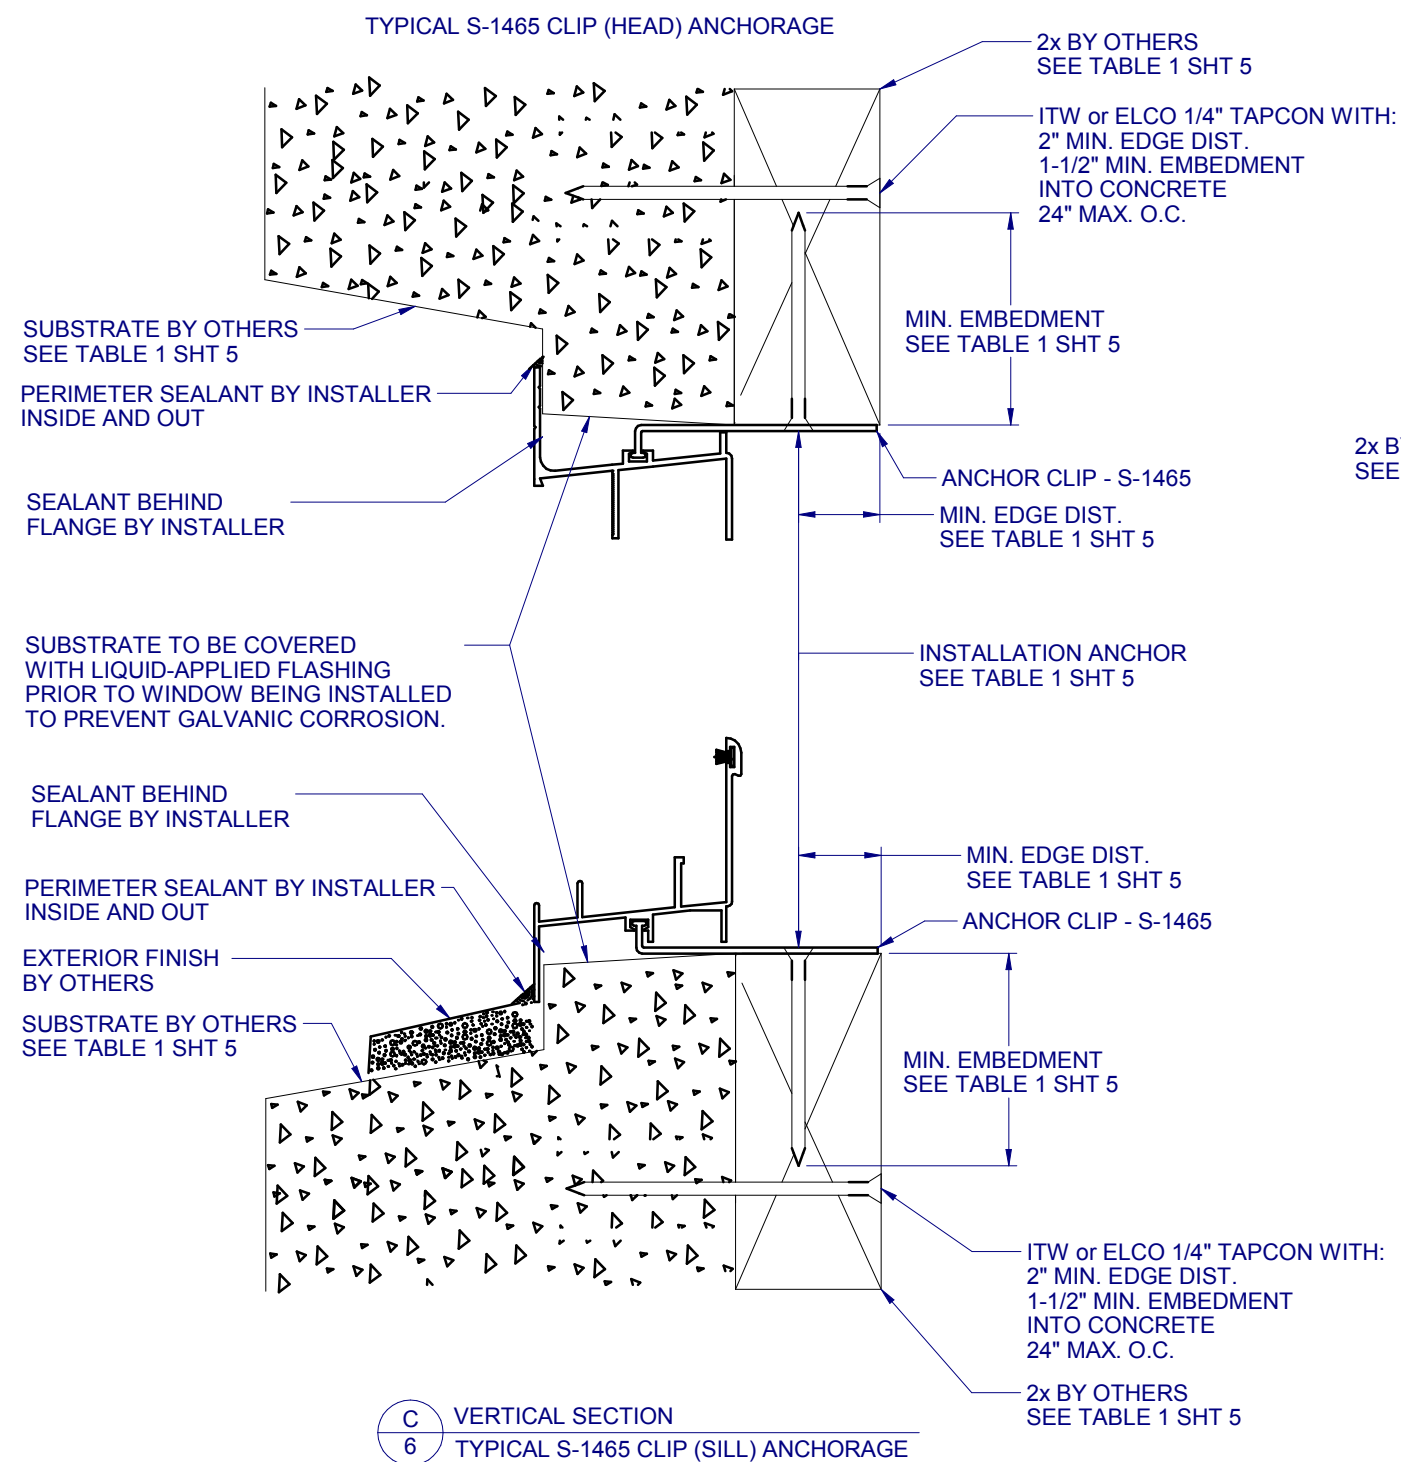

ASH01

3500 ALUM. SINGLE HUNG NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:

16778



9/16/2026

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

INSTALLATION DETAIL - 2x WITH CLIPS

DRAWN BY:

MCS

DATE:

8/20/2026

DWG #:

CWS-880

	REV.:
--	-------

D

SCALE:

1:2

SHEET
6 OF 6