REVISIONS				
REV	DESCRIPTION	DATE	APPROVED	
А	REVISED INSTALLATION DETAILS	06/22/15	R.L.	
В	REVISED PER NEW REQUIREMENTS	01/10/18	R.L.	

NOTES:

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ.
- 2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
- 4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
- 5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER. BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
- 6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
- 8. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
- 10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 11. FRAME MATERIAL: EXTRUDED RIGID PVC.
- 12. UNITS MUST BE GLAZED PER ASTM E1300-04/09, SEE SHEET 2 FOR GLASS DETAILS.
- 13. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
- 14. FOR FIN INSTALLATION INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

SHEET NO.


1

2 - 3

- 15. FOR FRAME ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #12 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 16. FOR FRAME ANCHORING INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 17. FOR FRAME ANCHORING INTO METAL STRUCTURE USE #12 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 18. ALL FASTENERS TO BE CORROSION RESISTANT.
- 19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW: A. WOOD - MINIMUM SPECIFIC GRAVITY OF G=0.42 B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI. C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
- D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .048" THICK MINIMUM


ALUMINUM AND VIN

20. UNITS MAY BE INSTALLED WITH OR WITHOUT FLANGE, OUTSIDE THE HVHZ.

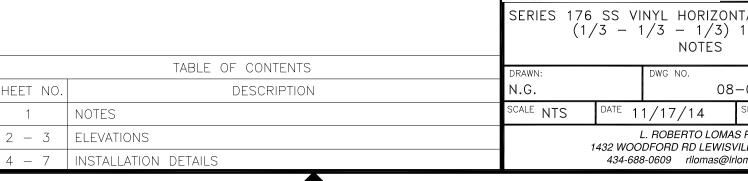

		SIGNED: 01/10/2018
EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SUPPLY 16341 DOMESTIC AVE 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204	3	ILLUS R. LOM
RIZONTAL SLIDING WINE 1/3) 111" X 63" TES	WOW	No. 6251# *
08-02534	rev B	SONAL ENGINE
4 ^{Sheet} 1 OF 7		
D LOMAS P.E. LEWISVILLE, NC 27023 omas@Irlomaspe.com		Luis R. Lomas P.E. FL No.: 62514

2018

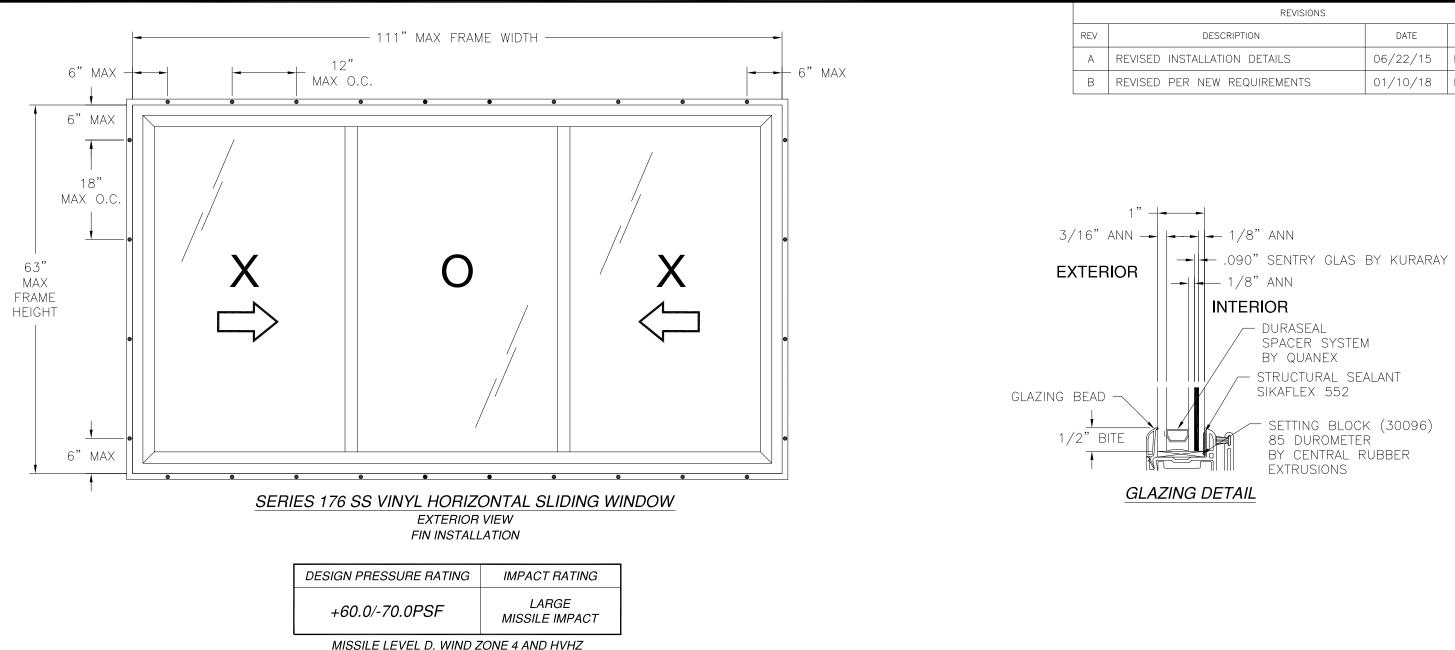

HARDWARE SCHEDULE

- (4) ASHLAND DUAL KEEPERS (13999) AT FIXED MEETING STILE 8" FROM HEAD & SILL
- (4) ASHLAND DUAL LOCKS (D2100AL/R) AT SASH LOCK STILE 8" FROM SASH CORNERS
- (4) ROLLER HOUSINGS AT EACH CORNER OF SASH BOTTOM RAILS.

(3) TRACKS AT OPERABLE SASH HEAD & SILL

- (1) ALUMINUM REINFORCEMENT (10300265) IN FIXED MEETING RAIL
- (5) ALUMINUM REINFORCEMENT (10300266) IN SASH TOP AND BOTTOM RAILS, JAMB STILES AND SASH LOCK RAIL


NOTES:


- 1. MAXIMUM SASH SIZE: 36 7/8" X 60 9/16".
- 2. MAXIMUM D.L.O.: 33 5/8" X 57 1/16".
- 3. (2) WEEPS WITH COVER (97-03) AT SILL FACE 4 1/8" FROM EACH CORNER.
- 4. (2) 1 1/2" X 1/4" WEEP SLOT AT SILL FACE 4 1/8" FROM EACH CORNER.
- 5. (2) 1/8" X 12" WEEP SLOT AT SILL FACE AND SILL SASH 3 1/8" FROM EACH END.
- 6. (2) 1/2" X 1/8" WEEP SLOT AT SILL BEHIND GLAZING LEG.



REVISIONS			
DESCRIPTION	DATE	APPROVED	
ED INSTALLATION DETAILS	06/22/15	R.L.	
ED PER NEW REQUIREMENTS	01/10/18	R.L.	

SIGNED: 01/10/2018

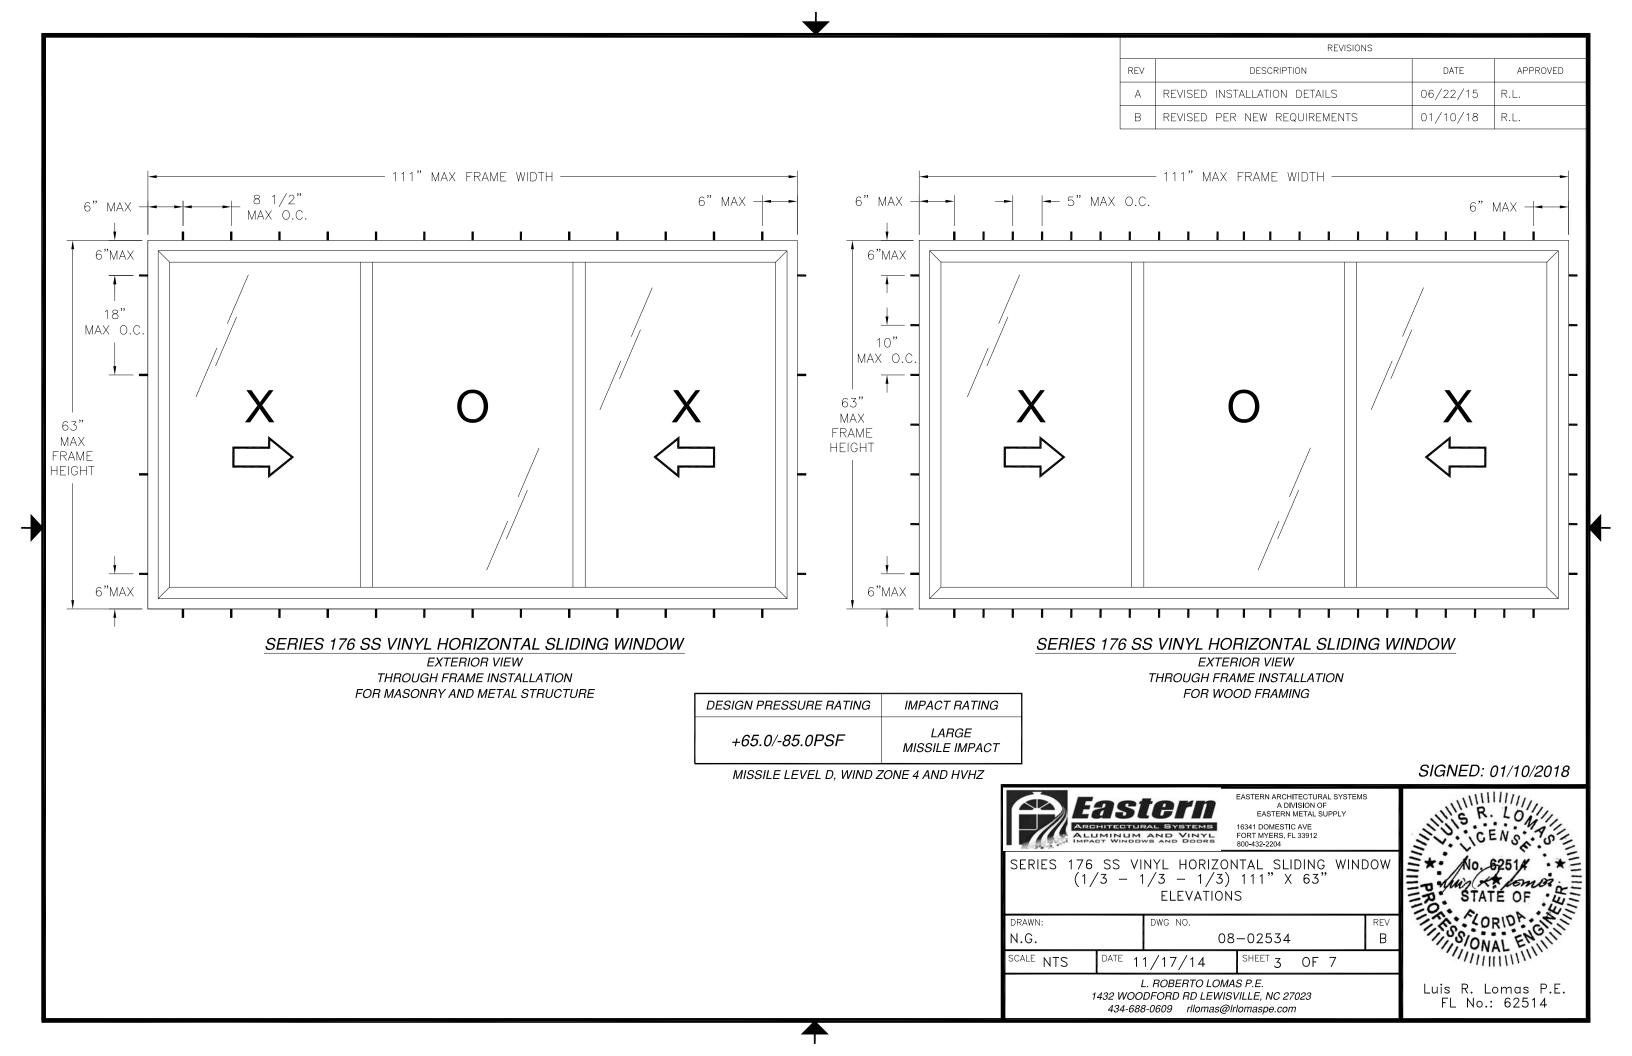

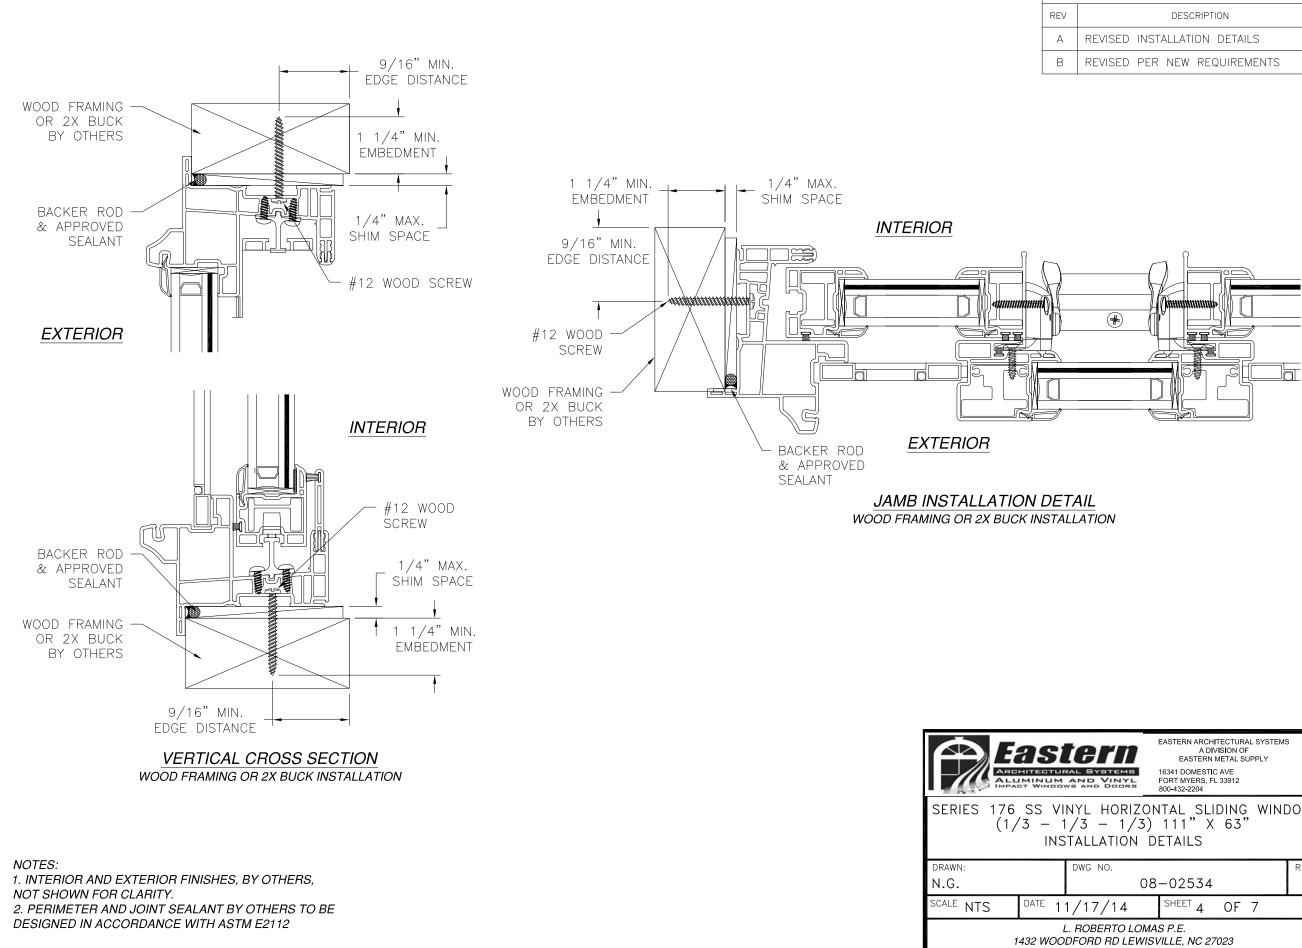


 \mathbf{T}

434-688-0609 rlld

REVISIONS			
DESCRIPTION	DATE	APPROVED	
ED INSTALLATION DETAILS	06/22/15	R.L.	
ED PER NEW REQUIREMENTS	01/10/18	R.L.	


	SIGNED: 01/10/2018
EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SUPPLY 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204	LICENS TOT
DRIZONTAL SLIDING WINDOW 1/3) 111" X 63" TION DETAILS	No. 6251# *
08-02534 REV	SONAL ENGLIS
14 ^{Sheet} 4 OF 7	
TO LOMAS P.E. D LEWISVILLE, NC 27023 Ilomas@Irlomaspe.com	Luis R. Lomas P.E. FL No.: 62514

REVISIONS					
REV	DESCRIPTION	DATE	APPROVED		
A	REVISED INSTALLATION DETAILS	06/22/15	R.L.		
В	REVISED PER NEW REQUIREMENTS	01/10/18	R.L.		

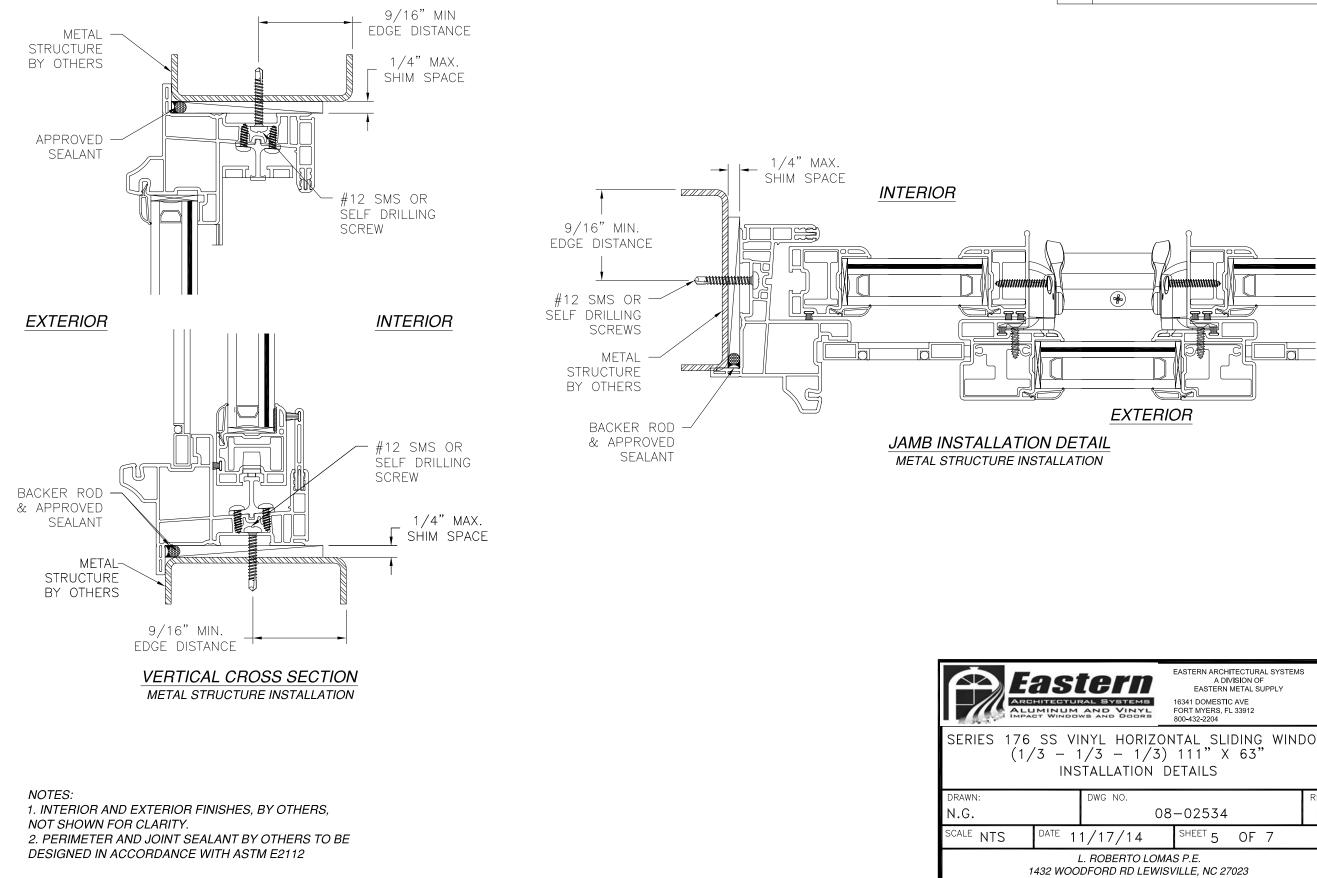


 \mathbf{T}

		SIGNED: 01/10/2018
ASTERN MINUM AND VINYL	EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SUPPLY 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204	LINUIS R. LOM
SS VINYL HORIZON 3 – 1/3 – 1/3) INSTALLATION DI	No. 62514 *	
dwg no.	-02534	B
DATE 11/17/14	^{Sheet} 5 OF 7	
L. ROBERTO LOMA 432 WOODFORD RD LEWISV 434-688-0609 rliomas@iri	Luis R. Lomas P.E. FL No.: 62514	

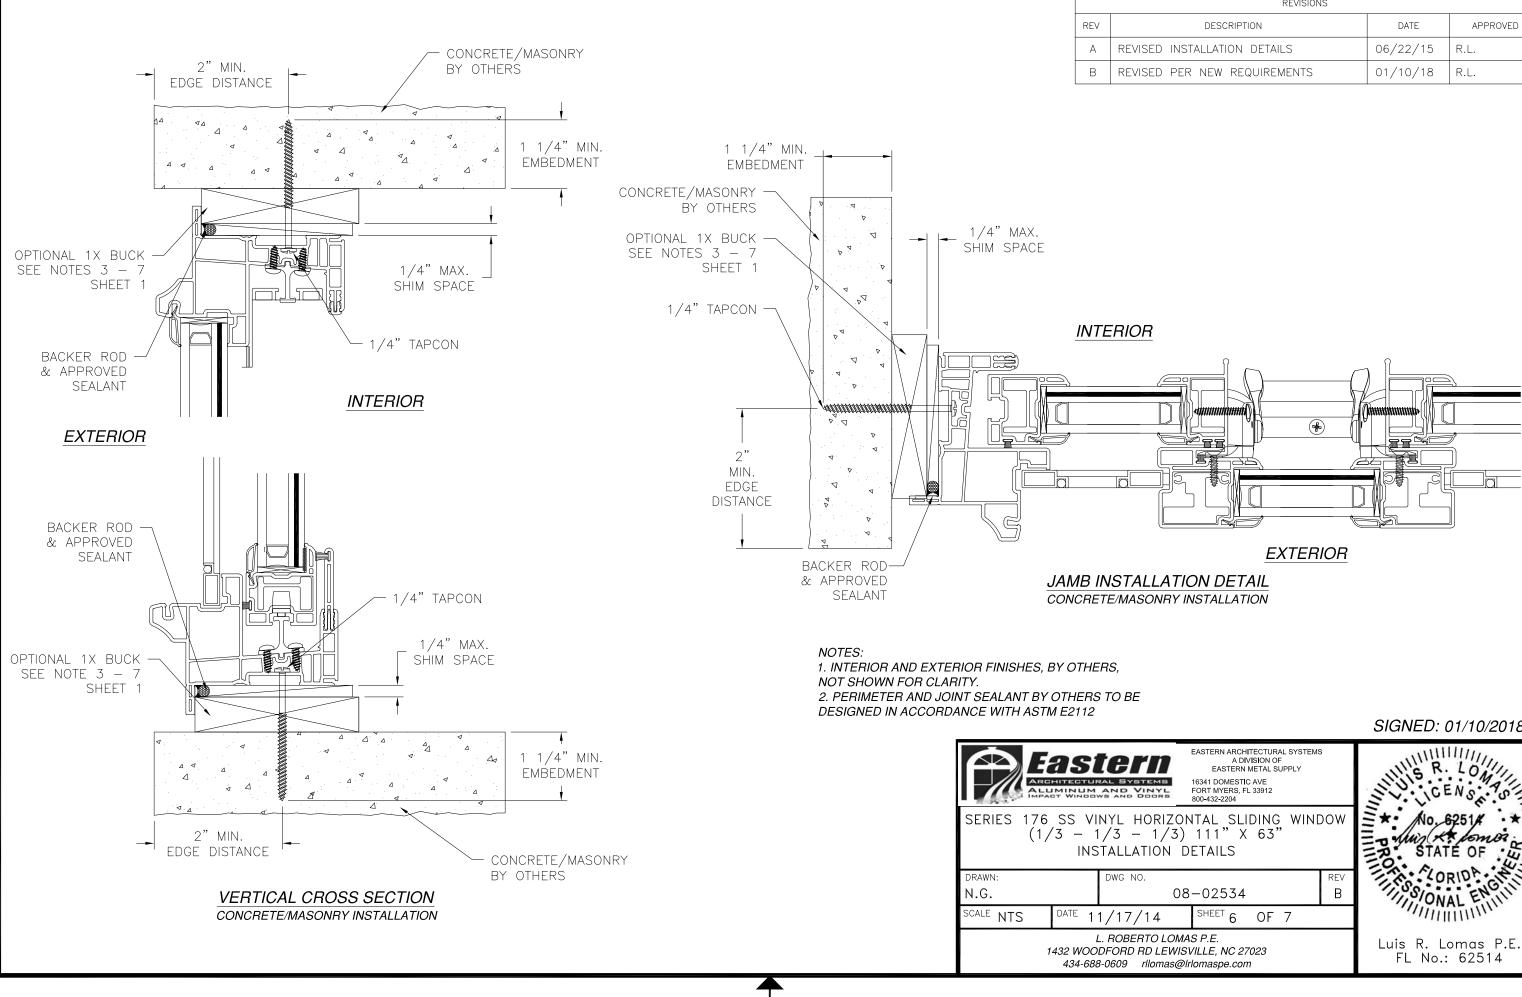

REVISIONS		
DESCRIPTION	DATE	APPROVED
ED INSTALLATION DETAILS	06/22/15	R.L.
ED PER NEW REQUIREMENTS	01/10/18	R.L.

	SIGNED: 01/10/2018
EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SUPPLY 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204	LICENS TO
DRIZONTAL SLIDING WINDON 1/3) 111" X 63" ION DETAILS	No. 6251#
08-02534 RE	
4 ^{SHEET} 6 OF 7	
O LOMAS P.E. D LEWISVILLE, NC 27023 Iomas@Irlomaspe.com	Luis R. Lomas P.E. FL No.: 62514

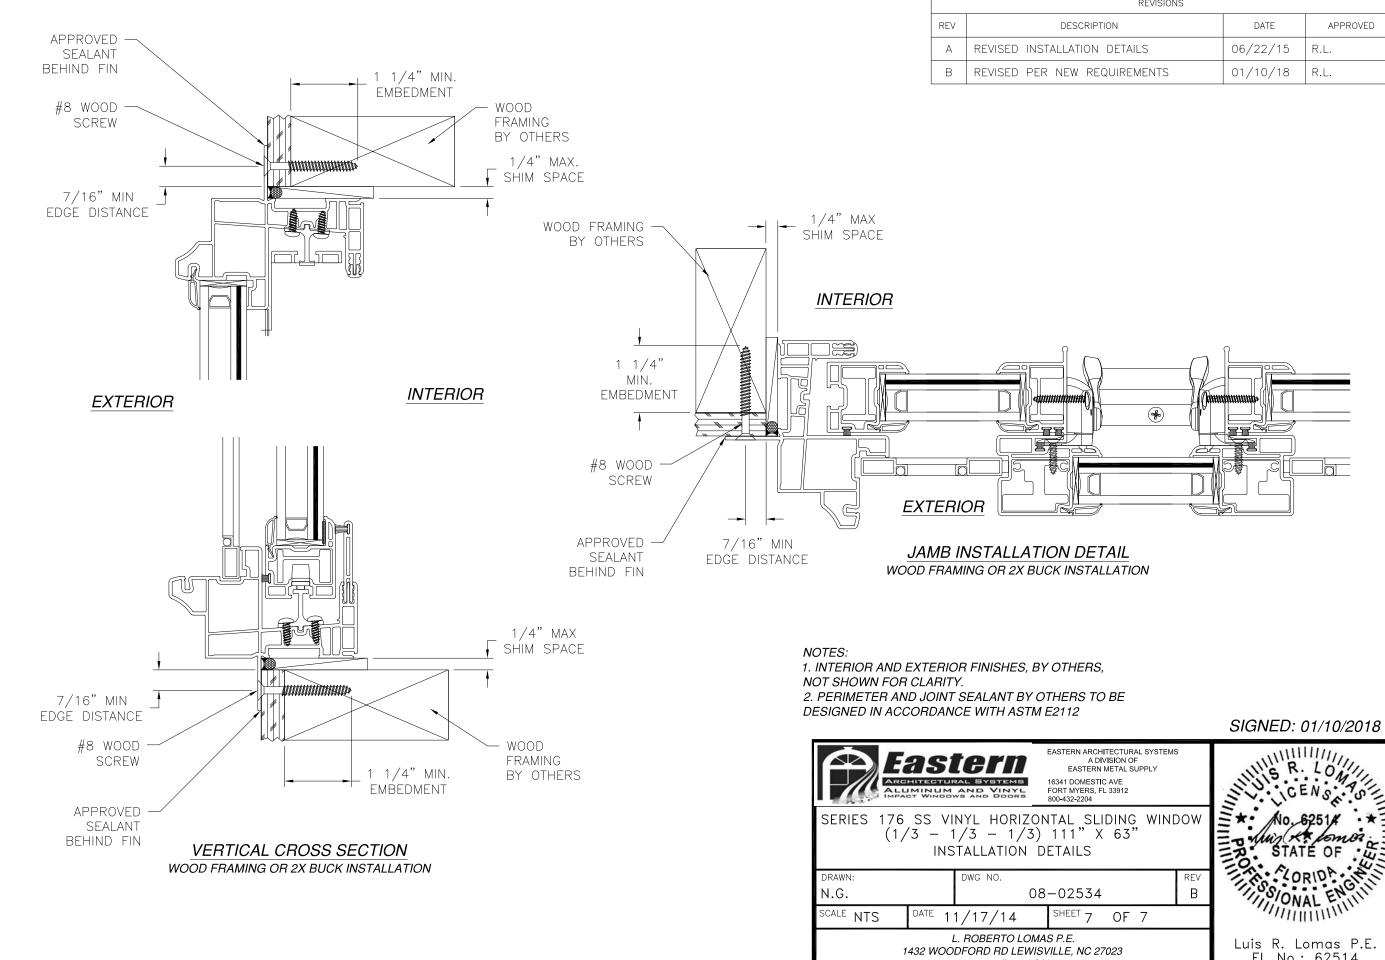

⁴³⁴⁻⁶⁸⁸⁻⁰⁶⁰⁹ rllc

 \mathbf{T}

REVISIONS			
DESCRIPTION	DATE	APPROVED	
ED INSTALLATION DETAILS	06/22/15	R.L.	
ED PER NEW REQUIREMENTS	01/10/18	R.L.	

EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SUPPLY 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204			111/11/10	R. LOM	A.S.
RIZONTAL SLIDING WINDOW 1/3) 111" X 63" ON DETAILS			111111111	IO. 6251# TATE OF	EER *
08-02534 REV			III SS	ONAL EN	314111
4 ^{SHEET} 7 0	F 7		.,,,	minin	
O LOMAS P.E. LEWISVILLE, NC 27023 omas@Irlomaspe.com				. Lomas No.: 6251	