


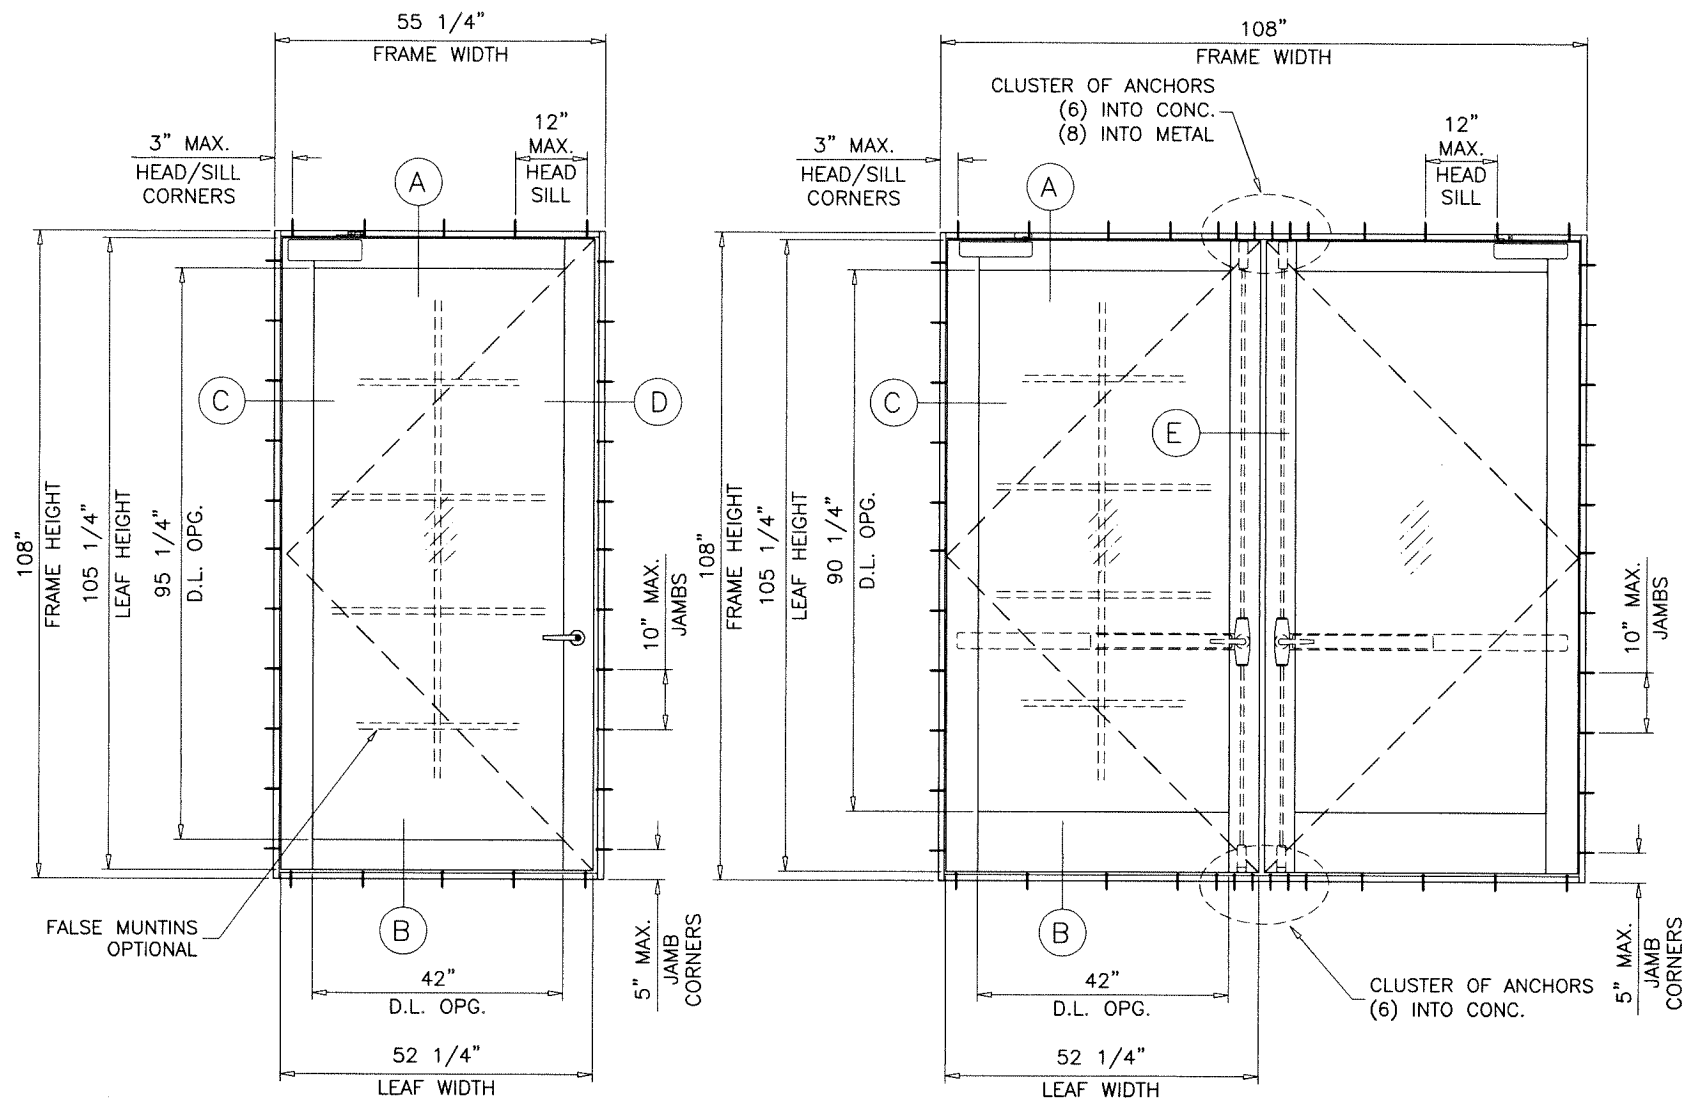

TYPICAL ELEVATIONS

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

MAXIMUM DESIGN LOAD RATING = + 80.0 PSF
(FOR SIZES SHOWN ABOVE OR SMALLER) - 80.0 PSF

GPX FIRE RATED OUTSWING DOOR

SEE SHEET 1 FOR DESIGN LOAD CAPACITY OF SINGLE (X) AND DOUBLE (XX) DOORS W/O TRANSOM.

SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF SINGLE (O/X) AND DOUBLE (O/XX) DOORS WITH TRANSOM.

DOORS CAN ALSO BE USED WITH SAFTIFIRST FIRE RATED WINDOWS. FOR DOORS WITH FIXED WDW. SYSTEM SEE SEPARATE APPROVAL FOR DOOR MULLION CAPACITY AND ANCHORING DETAILS.

THE LOWEST VALUE RESULTING FROM DOOR CAPACITY CHARTS OR FIXED WINDOW APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DOORS APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, I.E. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

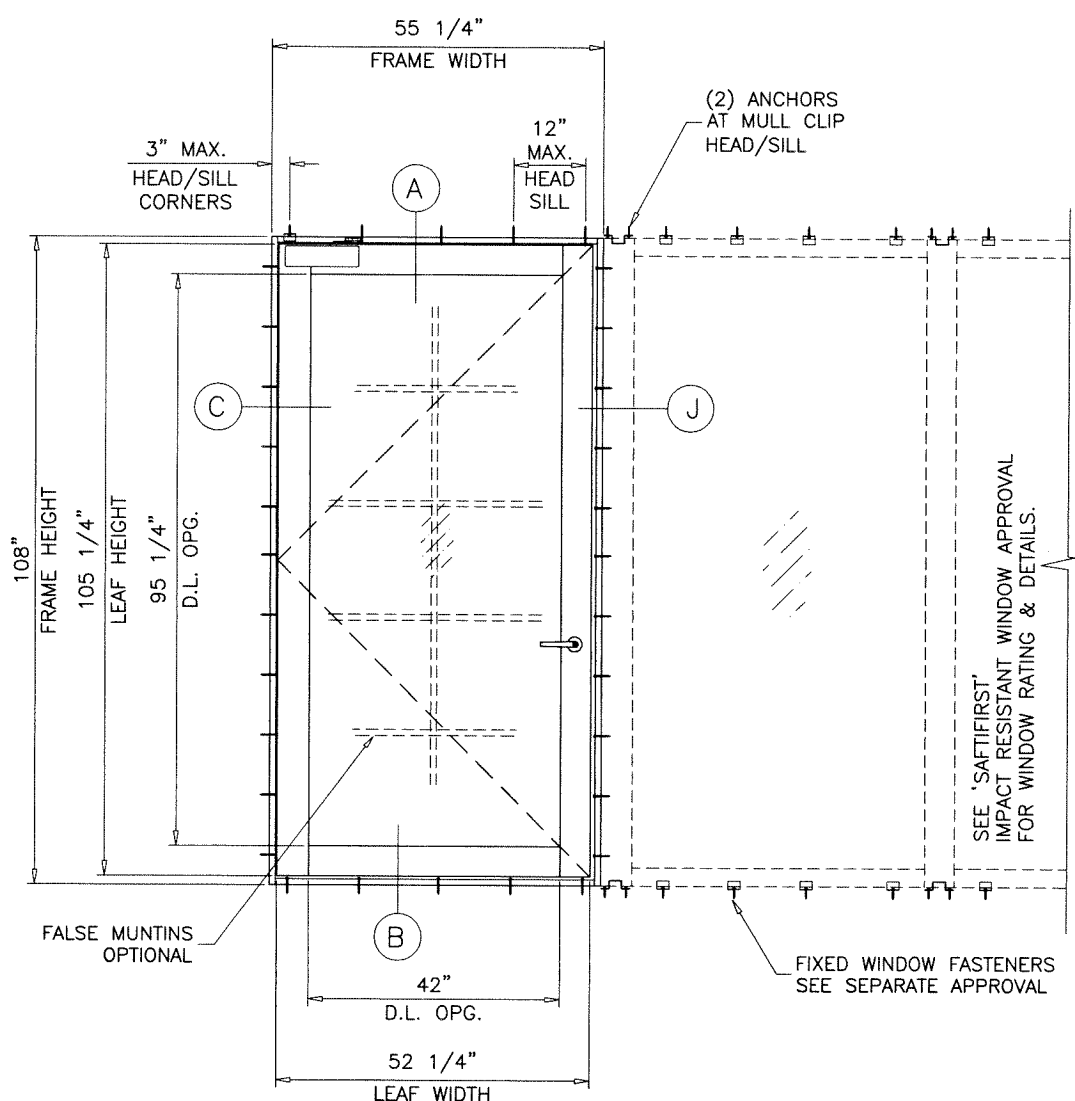


NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

Sealed: 9/29/2026

FL #16888

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

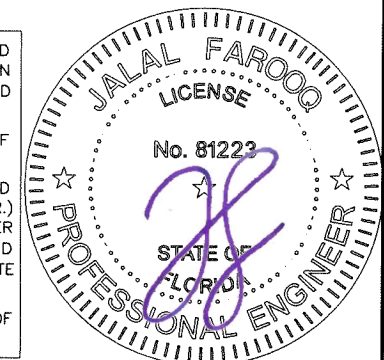


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W13-59SF

GPX FIRE RATED OUTSWING DOOR (L.M.I.)
SAFTIFIRST
100 NORTH HILL DRIVE, SUITE 12
BRISBANE, CA. 94005-1010
TEL. (415) 230-6740 FAX. (415) 230-6741

no	date	by	description
C	07.25.23		UPDATED TO 2023 FBC
D	11.27.24		TRANSOM GLASS OPTION #2 ADD.
E	01.30.25		CORNER DETAIL REV.
F	09.28.26		UPDATED TO 2026 FBC

date: 12-02-13
scale: 3/8"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.
W13-59
sheet 1 of 9

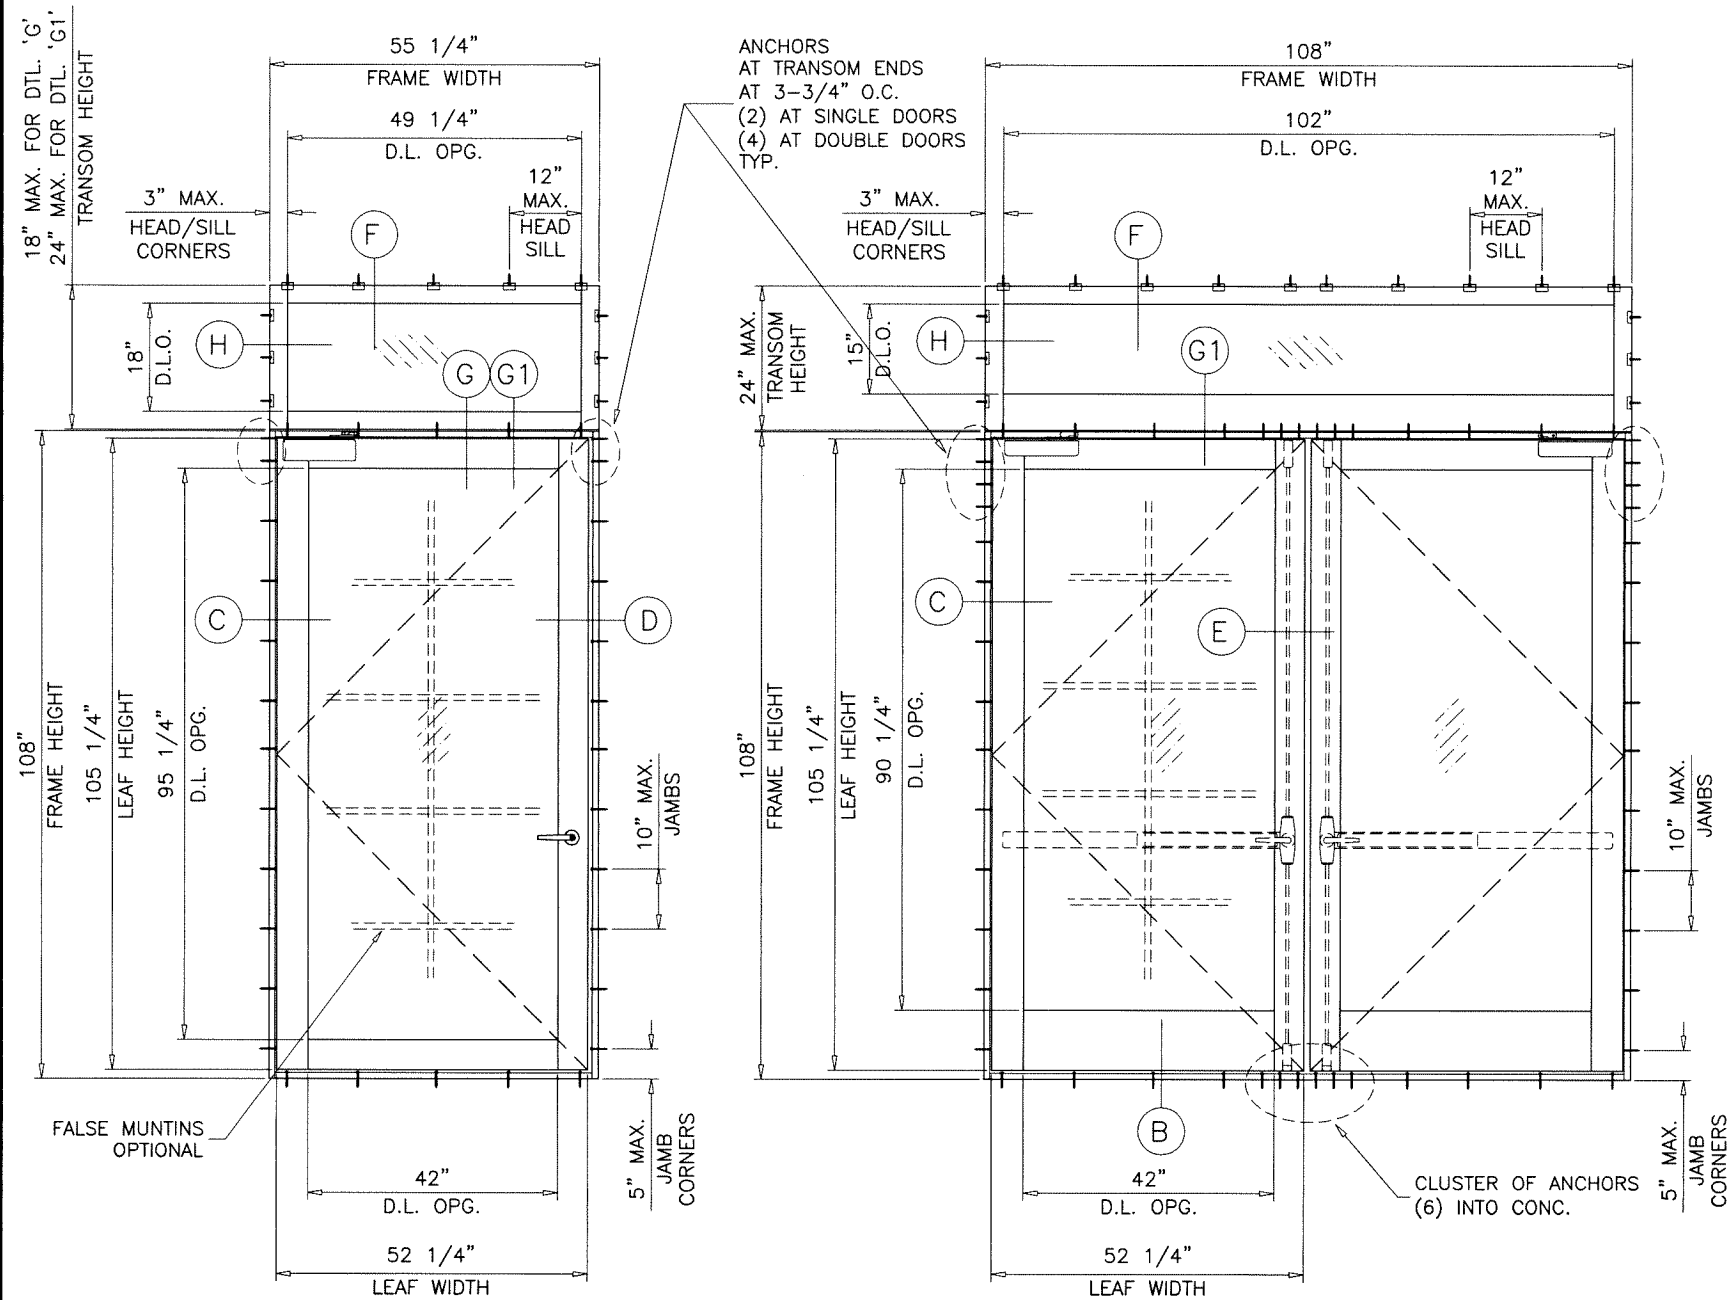


TYPICAL ELEVATIONS

MAXIMUM DESIGN LOAD RATING = + 80.0 PSF
(FOR SIZES SHOWN ABOVE OR SMALLER) - 80.0 PSF

Sealed: 9/29/2026

FL #16888

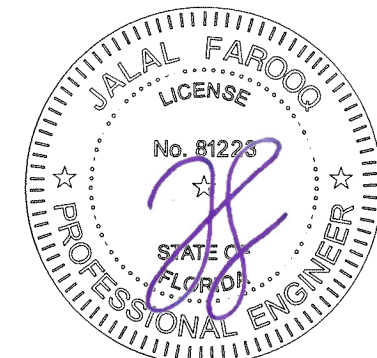

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

GPX FIRE RATED OUTSWING DOOR (L.M.I.)

SAFTIFIRST
100 NORTH HILL DRIVE, SUITE 12
BRISBANE, CA. 94005-1010
TEL. (415) 230-6740 FAX. (415) 230-6741


revisions:	
no	date by description

date:	12-02-13
scale:	3/8" = 1' - 0"
dr. by:	TARIQ
chk. by:	


drawing no.

W13-59


sheet 2 of 9

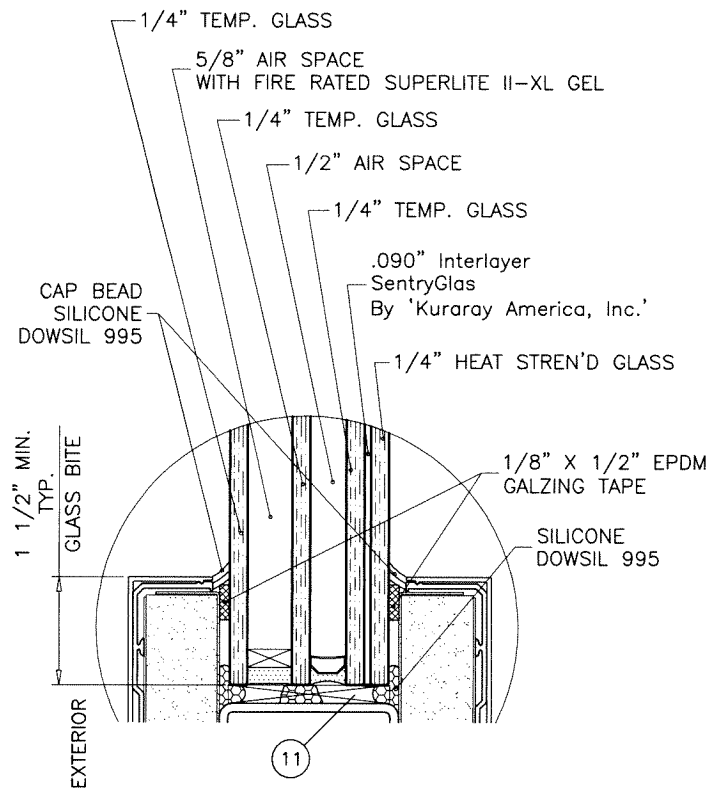


GLAZING DETAIL DOOR LEAF OPTION #1
 2-3/16" OVERALL INSUL. LAM. GLASS

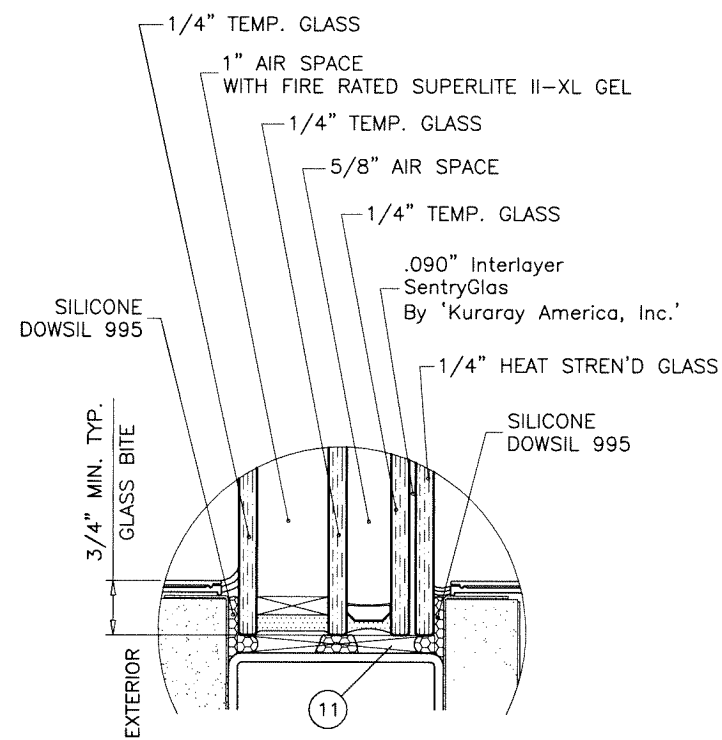

GLAZING DETAIL TRANSOM OPTION #1
 2-11/16" OVERALL INSUL. LAM. GLASS

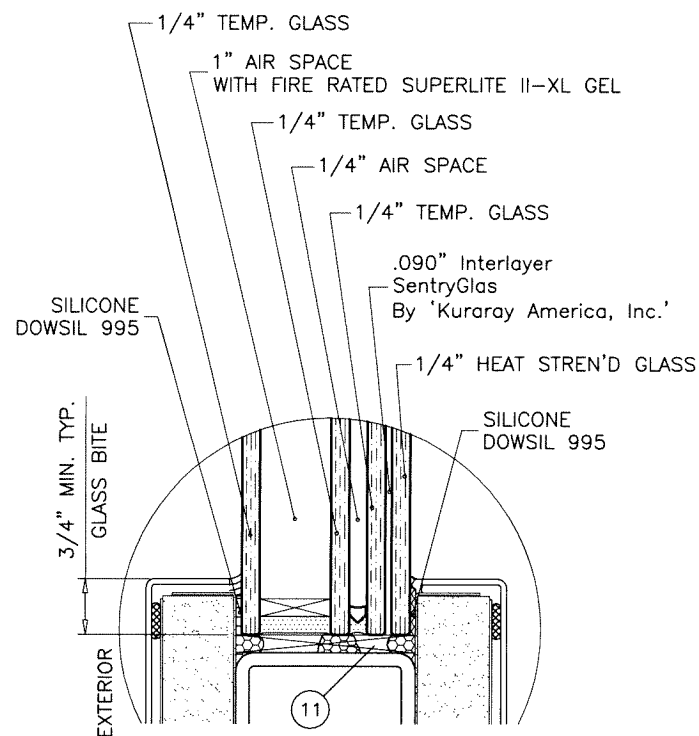

GLAZING DETAIL DOOR LEAF OPTION #2
 2-5/16" OVERALL INSUL. LAM. GLASS

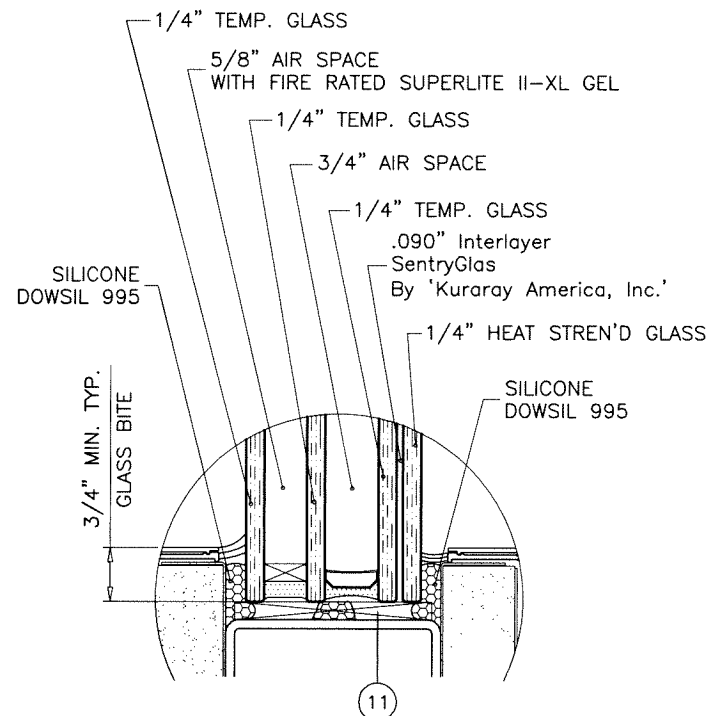

GLAZING DETAIL TRANSOM OPTION #2
 2-7/16" OVERALL INSUL. LAM. GLASS

Sealed: 9/29/2026

FL #16888





AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W13-59SF

GPX FIRE RATED OUTSWING DOOR (L.M.I.)

SAFTIFIRST
 100 NORTH HILL DRIVE, SUITE 12
 BRISBANE, CA. 94005-1010
 TEL. (415) 230-6740 FAX. (415) 230-6741

Revisions:	
no	date by description

date: 12-02-13	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
drawing no.		W13-59	
sheet 3 of 9			

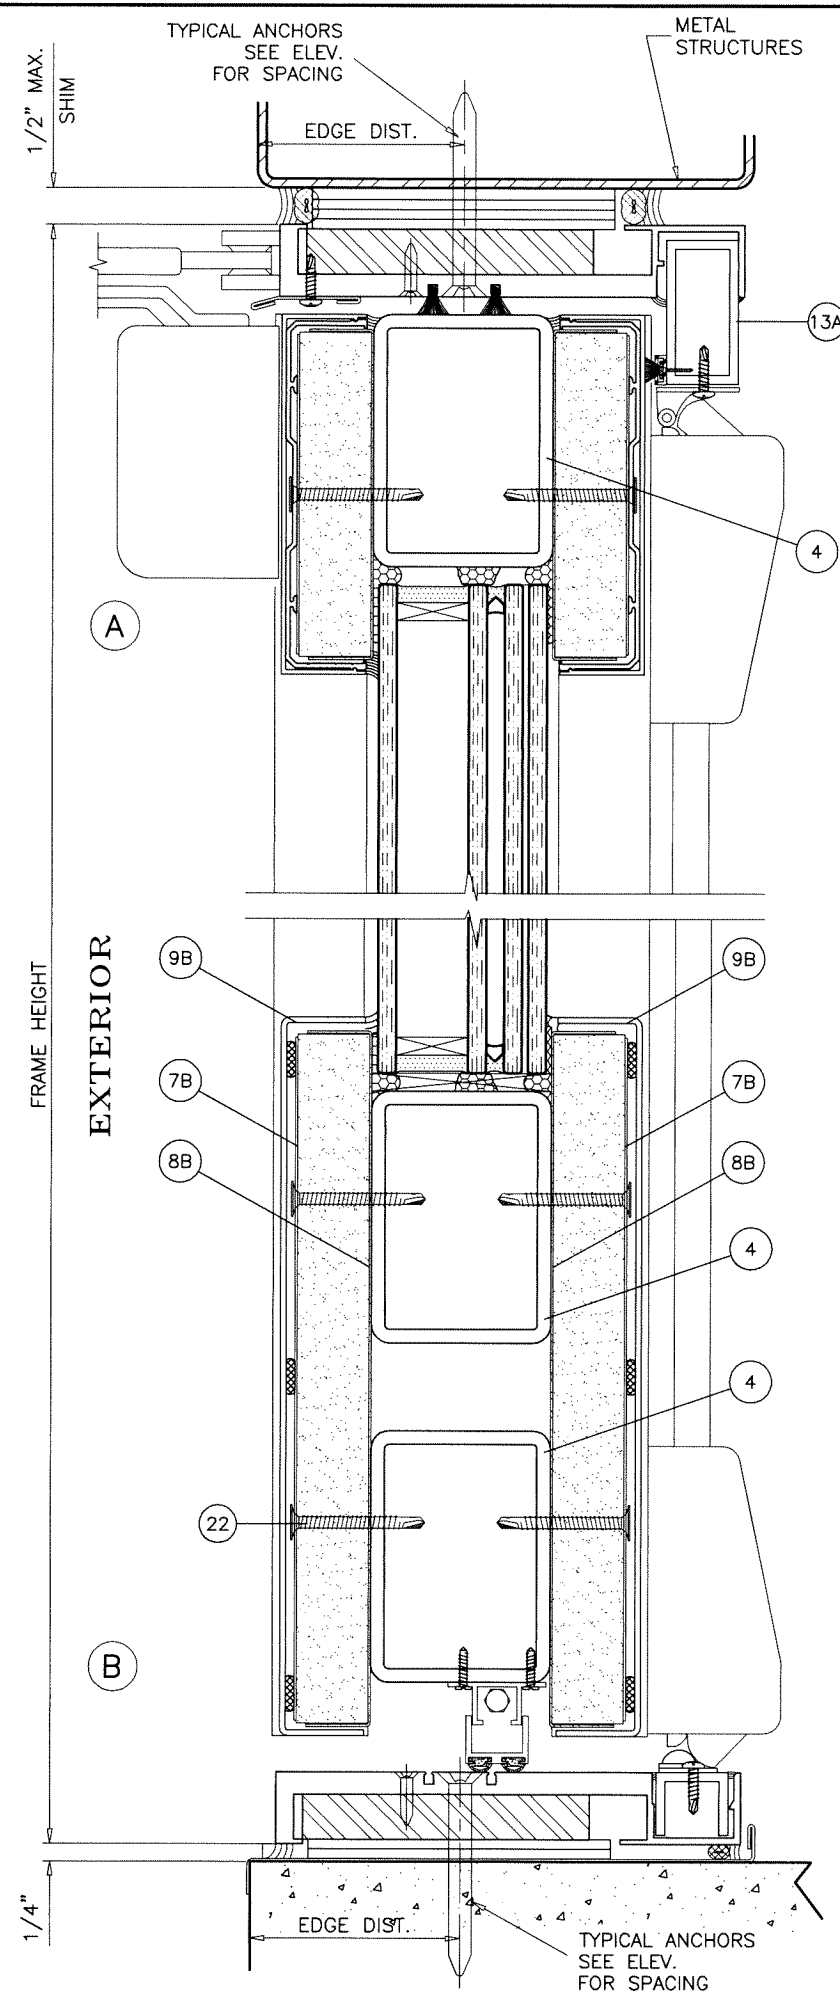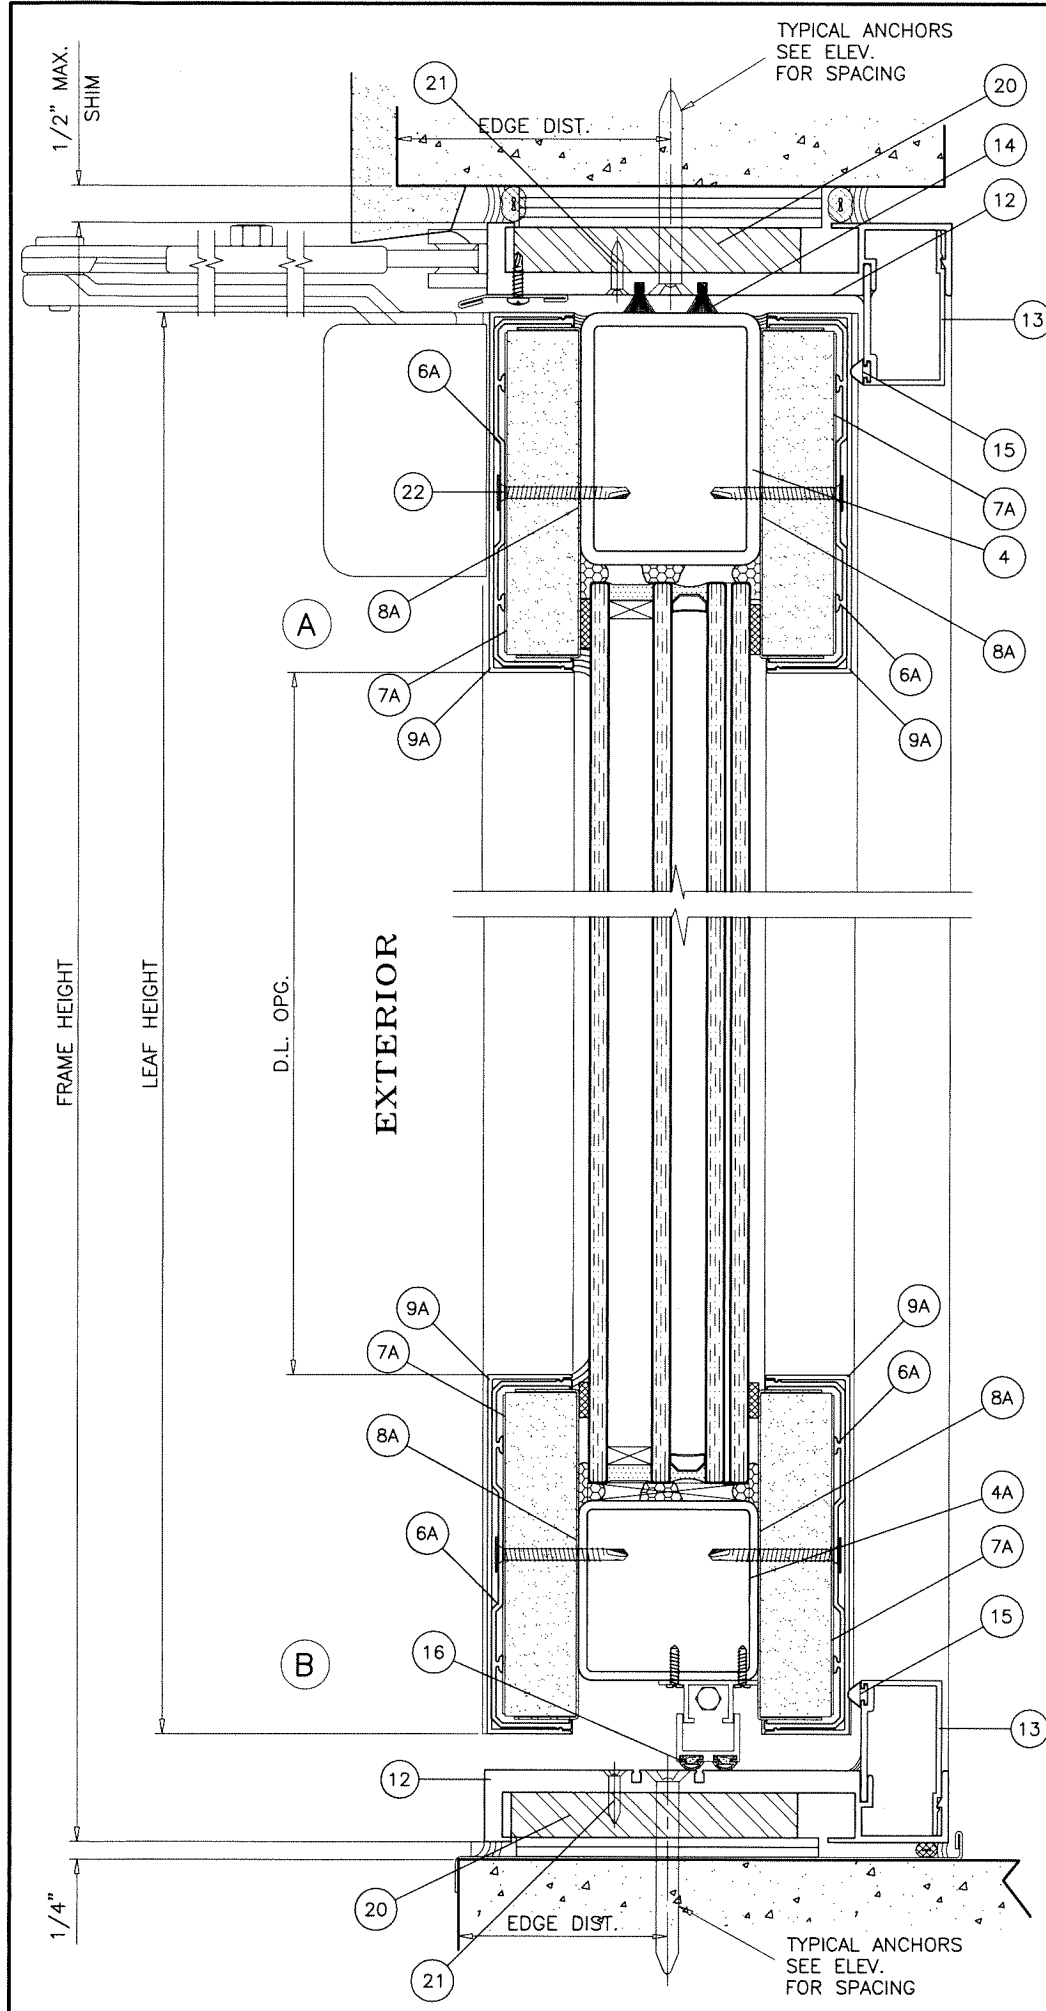

METAL STRUCTURES NOT BY 'SAFTIFIRST'
MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND
TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

— AT DOORS —
5/16" DIA. ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI)

DIRECTLY INTO CONCRETE OR BLOCKS
1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

ANCHOR EDGE DISTANCES

INTO CONCRETE OR BLOCKS = 3-1/8" MIN.

5/16" DIA. SELF DRILLING SCREWS (Fu=120 KSI, Fy=92 KSI)

INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
(3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T6 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES


INTO METAL STRUCTURE = 1" MIN.

SEALANTS:

ALL FRAME CORNERS, JOINTS, MULLION SEAMS AND PERIMETER
OF GLAZING BEAD TO FRAME SEALED WITH SILICONE SEALANT.

Sealed: 9/29/2026

FL #16888

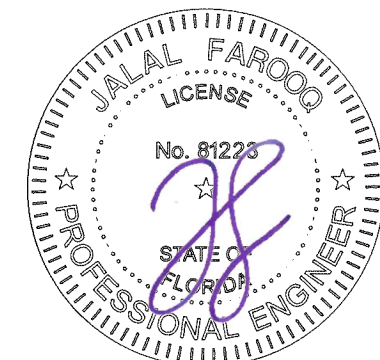

GPX FIRE RATED OUTSWING DOOR (L.M.I.)

SAFTIFIRST



100 NORTH HILL DRIVE, SUITE 12
BRISBANE, CA. 94005-1010

TEL. (415) 230-6740 FAX. (415) 230-6741

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)


COMP-ANL\W13-59SF

revisions:		no date by description	
date:	12-02-13	no	date
scale:	3/8" = 1"	by	description
dr. by:	TARIQ		
chk. by:			
drawing no.		W13-59	
sheet 4 of 9			

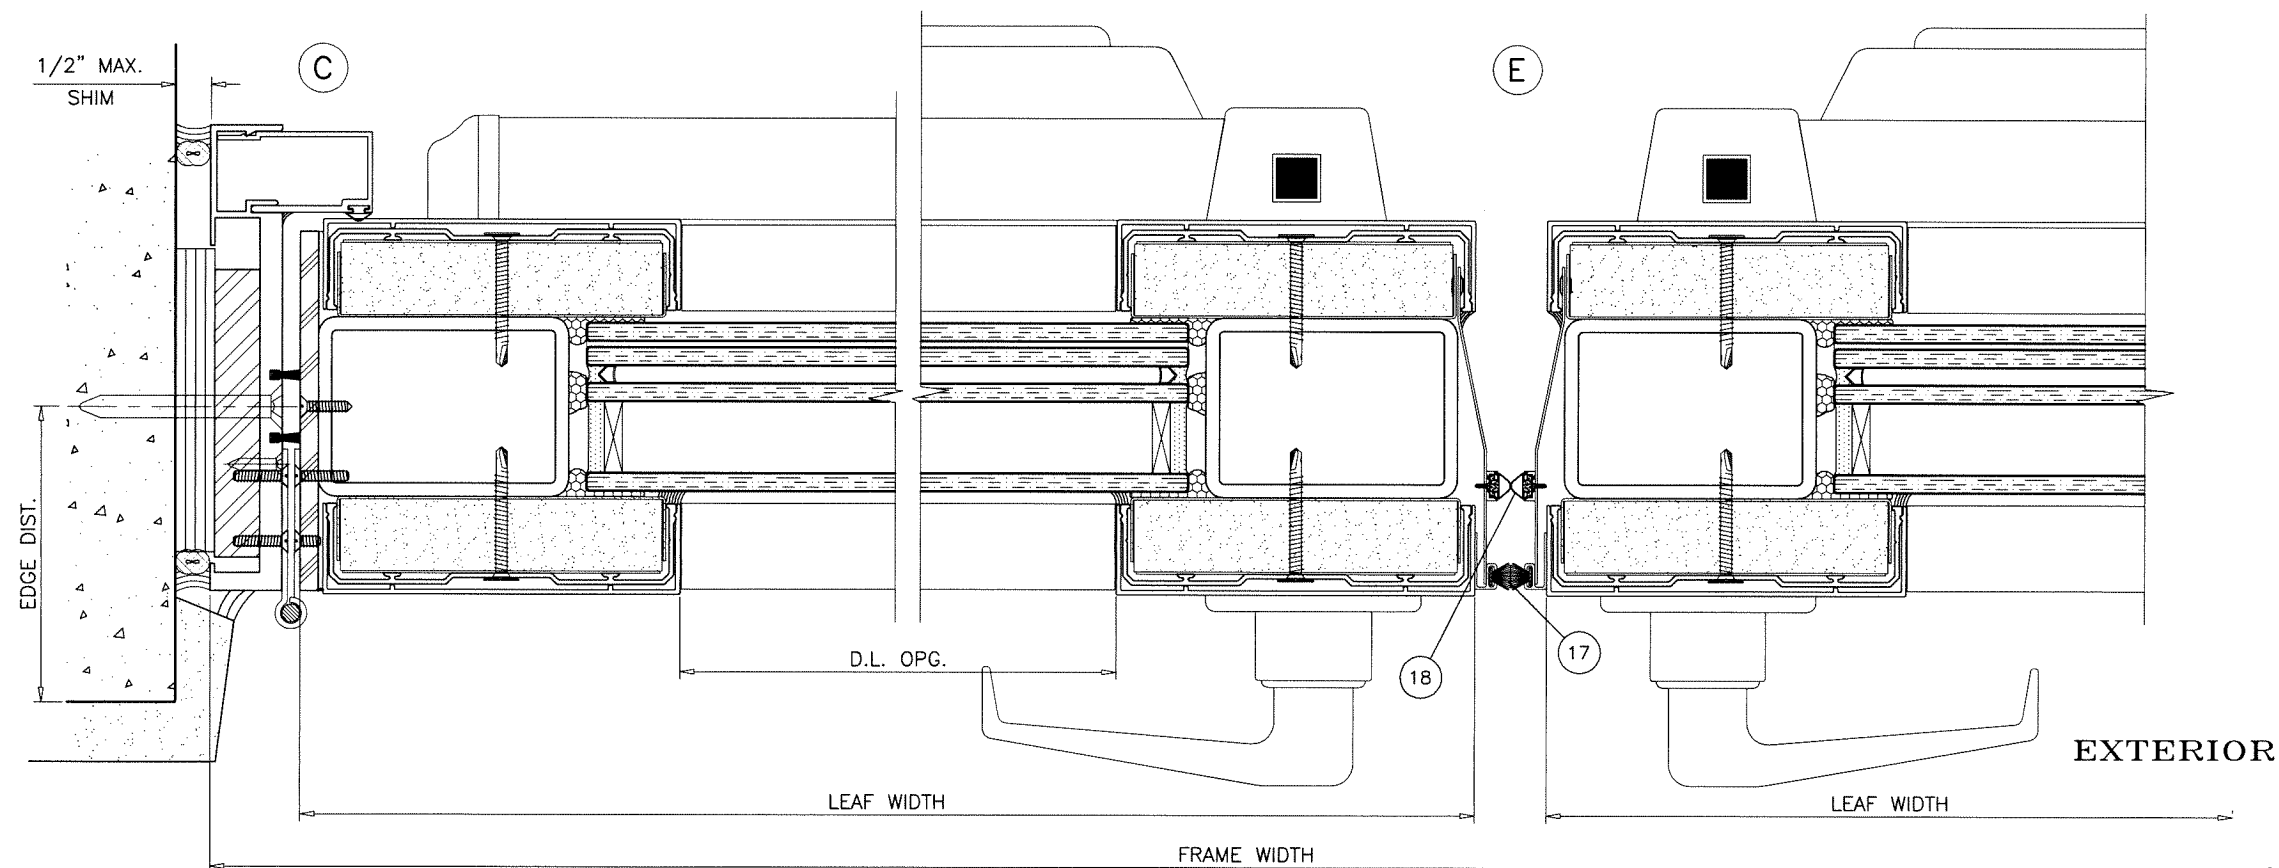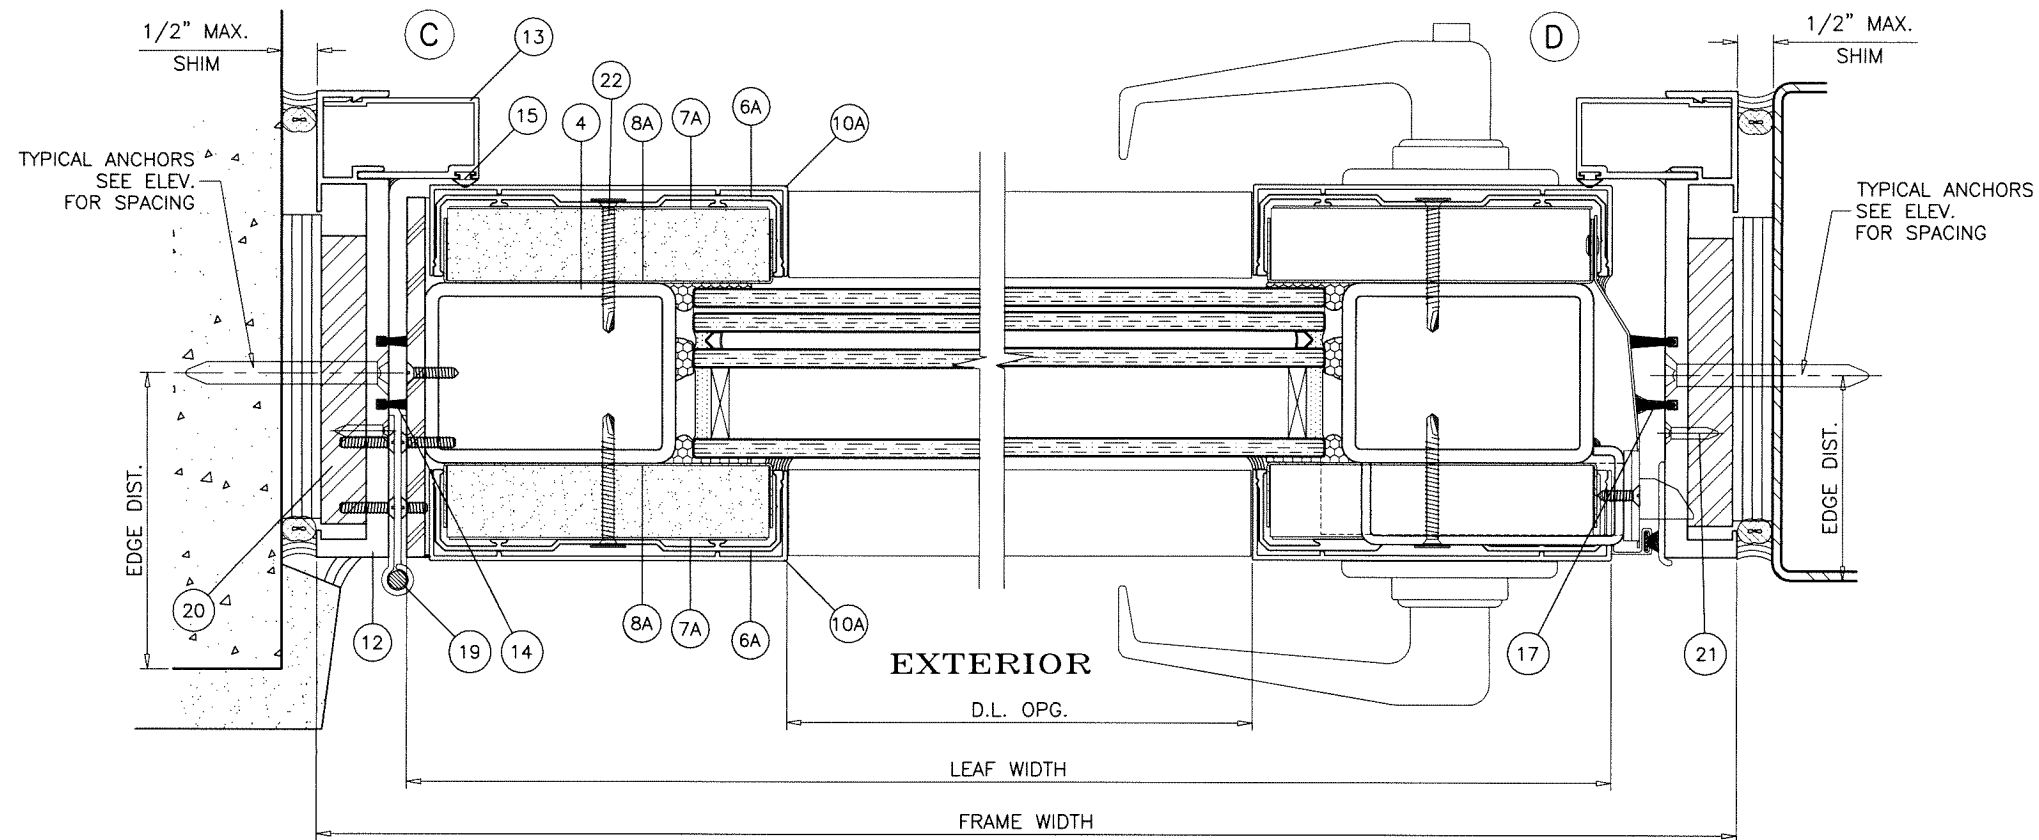

Sealed: 9/29/2026


FL #16888

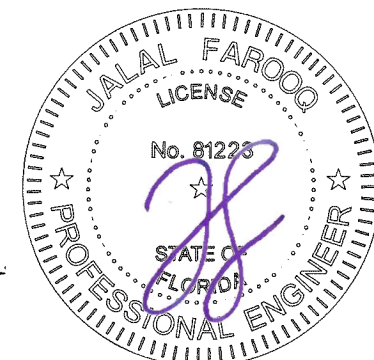

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W13-59SF

GPX FIRE RATED OUTSWING DOOR (L.M.I.)
SAFTIFIRST
 100 NORTH HILL DRIVE, SUITE 12
 BRISBANE, CA. 94005-1010
 TEL. (415) 230-6740 FAX. (415) 230-6741

revisions:		no date by description	
date:	12-02-13	scale:	3/8" = 1"
dr. by:	TARIQ	chk. by:	
drawing no.		W13-59	
sheet 5 of 9			

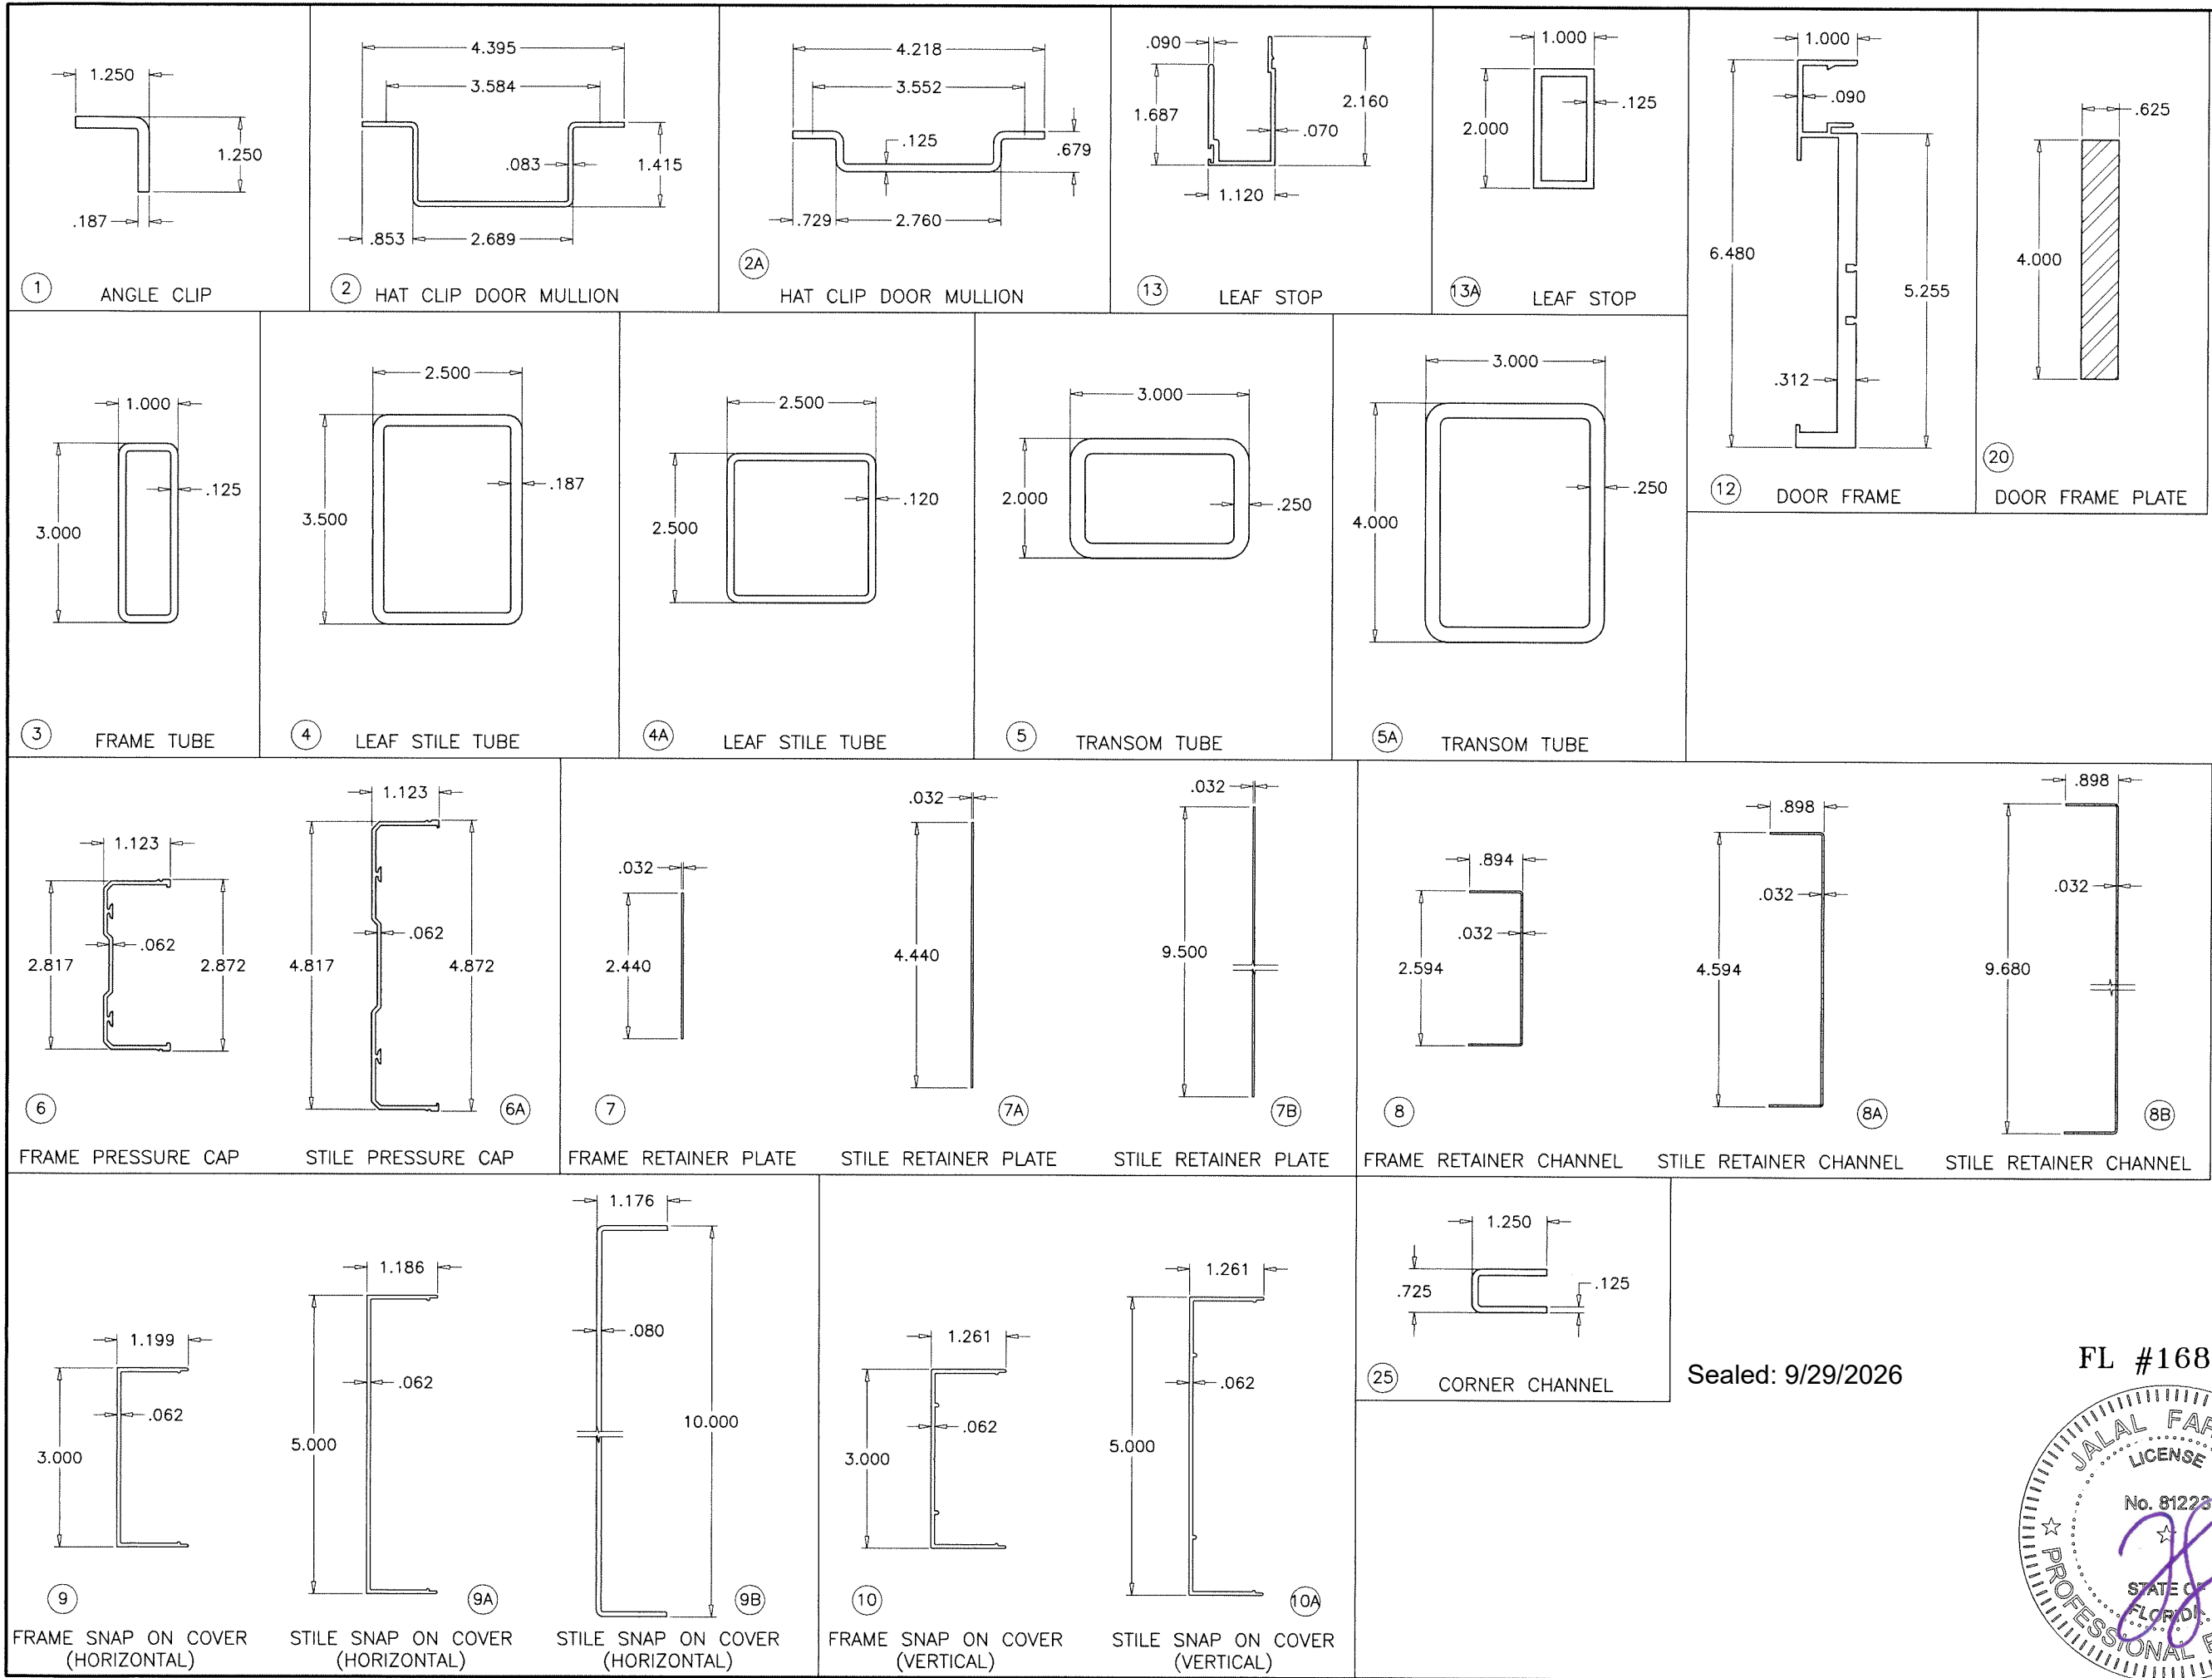

Sealed: 9/29/2026

FL #16888




af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W13-59SF

GPX FIRE RATED OUTSWING DOOR (L.M.I.)
SAFTIFIRST
100 NORTH HILL DRIVE, SUITE 12
BRISBANE, CA. 94005-1010
TEL. (415) 230-6740 FAX. (415) 230-6741

revisions:	no	date	by	description

date: 12-02-13
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W13-59
sheet 8 of 9

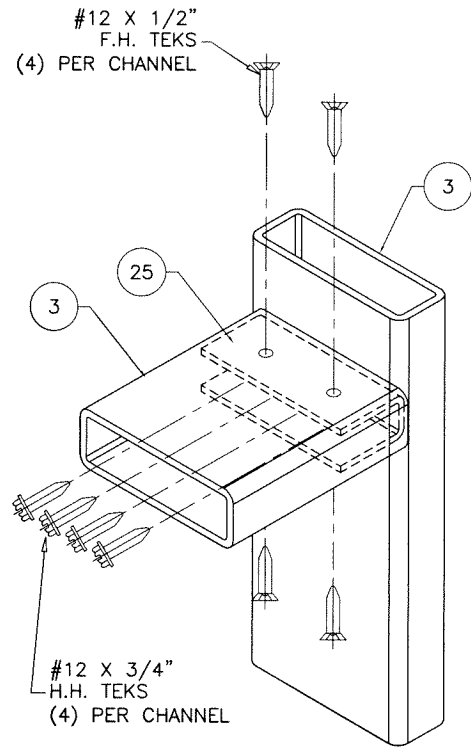

ITEM NO.	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	AS REQD.	ANGLE CLIP, 2" LONG	A36 STEEL	A60 JET-COAT ASTM A-653
2	AS REQD.	HAT CLIP, 2" LONG	A36 STEEL	A60 JET-COAT ASTM A-653
2A	AS REQD.	HAT CLIP, 2" LONG	A36 STEEL	A60 JET-COAT ASTM A-653
3	4/ WDW.	FRAME TUBE	STEEL	ASTM A-513
4	AS REQD.	LEAF STILE TUBE	STEEL	ASTM A-513
4A	AS REQD.	LEAF STILE TUBE	STEEL	ASTM A-513
5	AS REQD.	TRANSOM TUBE	STEEL	ASTM A-513
6	8/ WDW.	FRAME PRESSURE CAP	6063-T5	-
6A	AS REQD.	STILE PRESSURE CAP	6063-T5	-
7	8/ WDW.	FRAME RETAINER PLATE	STEEL	A60 JET-COAT ASTM A-653
7A	AS REQD.	STILE RETAINER PLATE	STEEL	A60 JET-COAT ASTM A-653
7B	AS REQD.	STILE RETAINER PLATE	STEEL	A60 JET-COAT ASTM A-653
8	8/ WDW.	FRAME RETAINER CHANNEL	STEEL	A60 JET-COAT ASTM A-653
8A	AS REQD.	STILE RETAINER CHANNEL	STEEL	A60 JET-COAT ASTM A-653
8B	AS REQD.	STILE RETAINER CHANNEL	STEEL	A60 JET-COAT ASTM A-653
9	8/ WDW.	FRAME SNAP ON COVER HORIZONTAL	6063-T5	-
9A	AS REQD.	STILE SNAP ON COVER HORIZONTAL	6063-T5	-
9B	AS REQD.	STILE SNAP ON COVER HORIZONTAL	6063-T5	-
10	8/ WDW.	FRAME SNAP ON COVER VERTICAL	6063-T5	-
10A	AS REQD.	STILE SNAP ON COVER VERTICAL	6063-T5	-
11	2/ LITE	SETTING BLOCK, 1/4" X 1-3/8" X 3" LONG	EPDM	DUROMETER 80±5 SHORE A
12	4	DOOR FRAME	6063-T5	-
13	4	LEAF STOP	6063-T5	-
13A	4	LEAF STOP	6063-T5	-
14	AS REQD.	POLYPILE W'STRIPPING, .30" HIGH	-	PEMKO
15	AS REQD.	BULB W'STRIPPING	VINYL	PEMKO
16	#355A	BULB W'STRIPPING	VINYL	-
17	369	POLYPILE W'STRIPPING, .60" HIGH	-	PEMKO
18	351PK	MEETING RAIL SEAL	SILICONE	-
19	#919	CONT. HINGE	ST/ST	-
20	-	DOOR FRAME PLATE	STEEL	A36, Fu MIN. = 58 KSI
21	#10 X 3/4"	PLATE FASTENERS, AT 4" FROM ENDS & 24" O.C.	STEEL	FH SMS
22	#10 X 1-3/4"	ASSEMBLY FASTENERS AT 4" FROM ENDS & 12" O.C.	STEEL	FLAT HEAD TEKS
23	#12 X 1"	CLIP ANGLE TO FRAME FASTENER	STEEL	HH TEKS
24	1/4-20 X 1-1/4"	CLIP ANGLE TO ANGLE FASTENER	STEEL	HH BOLT W/ NUT AND WASHER
25	1/ CORNER	CORNER CHANNEL	STEEL	ASTM A-513

ALL WELDS PER AWS.
ELECTRODE = ER70 MIN.

LOCK OPTIONS:

OPTION #1:

ACTIVE LEAF:

LEVER LOCK SET SERIES 8200 BY 'SARGENT'
AT 40" FROM BOTTOM

INACTIVE LEAF:

MANUALLY OPERATED FLUSH BOLTS AT 12" FROM
TOP AND BOTTOM.

OPTION #2:

ACTIVE & INACTIVE LEAF:

VERTICAL ROD PANIC EXIT DEVICE SERIES 9827-F BY
'VON DUPRIN' LOCATED AT 40" FROM SILL AT EACH LEAF.

HINGES:

CONTINUOUS STAINLESS STEEL HINGE SYSTEM (ZERO#919)
FASTENED WITH #12-24 X 3/8" FH MS
(20) SCREWS AT HINGE STILE
(20) SCREWS AT FRAME JAMB
SPACED AT 1-1/2" FROM ENDS
AND 6" O.C. IN STAGGERED HOLES

Sealed: 9/29/2026

FL #16888



af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
FAX. (305) 262-6978

COMP-ANL\W13-59SF

GPX FIRE RATED OUTSWING DOOR (L.M.I.)

SAFTIFIRST
100 NORTH HILL DRIVE, SUITE 12
BRISBANE, CA. 94005-1010
TEL. (415) 230-6740
FAX. (415) 230-6741

revisions:	no	date	by	description
date:	12-02-13	scale:	3/8" = 1"	
dr. by:	TARIQ	chk. by:		
drawing no.	W13-59			
sheet	9 of 9			