


GENERAL NOTES

1. THIS APPROVAL APPLIES TO IMPACT RESISTANT CASEMENT WINDOWS WITH OR WITHOUT FIXED TRANSOM OR SIDELIGHT WINDOWS, CONSTRUCTED AND GLAZED AS INDICATED HEREIN.
2. ALLOWABLE DESIGN PRESSURES +65/-70 PSF
3. THESE WINDOWS HAVE BEEN DESIGNED AND TESTED TO TAS 201, 202 & 203 PROTOCOLS IN ACCORDANCE WITH THE REQUIREMENTS OF THE 5TH EDITION (2014) FLORIDA BUILDING CODE (FBC) INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ) PROVISIONS.
4. THESE WINDOWS AS SHOWN HEREIN ARE LARGE AND SMALL MISSILE IMPACT RATED, SHUTTERS ARE NOT REQUIRED.
5. WOOD OR MASONRY OPENINGS, 1x OR 2x WOOD BUCKS, AND BUCK FASTENERS, BY OTHERS, SHALL BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS IMPOSED BY THE GLAZING SYSTEM TO THE BUILDING STRUCTURE.
6. ANCHOR TYPE, SIZE, SPACING, AND EMBEDMENT SHALL BE AS SPECIFIED IN THESE DRAWINGS. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO.
7. ALL FASTENERS PENETRATING INTO PRESSURE TREATED WOOD SHALL BE CAPABLE OF PREVENTING CORROSION DUE TO REACTION WITH PRESSURE TREATMENT CHEMICALS.
8. DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE PROTECTED TO PREVENT REACTIONS IN ACCORDANCE WITH FBC CHAPTERS 20 AND 23.
9. A WIND LOAD DURATION FACTOR Cd = 1.6 WAS USED FOR THE ANALYSIS OF WOOD SCREWS ONLY.
10. THE MERBAU WINDOWS LISTED IN THIS APPROVAL ARE CONSTRUCTED OF A NATURALLY DURABLE SPECIES (SPECIFIC GRAVITY = 0.68) IN COMPLIANCE WITH FBC CHAPTER 23. OTHER NATURALLY DURABLE WOOD SPECIES OF EQUAL OR GREATER STRENGTH MAY BE SUBSTITUTED FOR ALL WOOD COMPONENTS.
11. MEMBERS NOTCHED AS NEEDED TO FIT HARDWARE AS SHOWN HEREIN.
12. ALL RAISED PANELS AND/OR GLAZING AS SHOWN IN GLAZING DETAILS ON SHEET 13, AND ALL HARDWARE TYPES IN THE IN THE HARDWARE NOTES BELOW MAY BE USED IN ANY WINDOW CONFIGURATION.
13. SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS AS SHOWN IN INSTALLATION ANCHOR REQUIREMENTS TABLE ON SHEET 2. CONCRETE OR MASONRY SUBSTRATES SHALL NOT BE CRACKED. FOR INSTALLATION TO METAL SUBSTRATES, ANCHORS SHALL BE LONG ENOUGH TO BE FULLY THREADED THROUGH THE METAL THICKNESS WITH AN ADDITIONAL 3/16" MIN. OF THREADS BEYOND.

DESIGN PRESSURE

+65/-70 PSF

APPROVED SHAPES

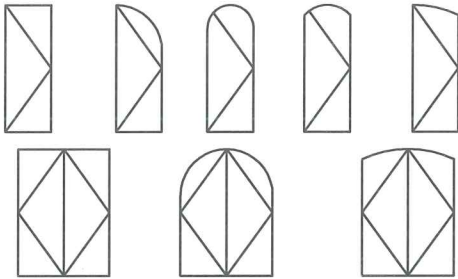

NOTES:

1. OTHER SHAPES MAY APPLY PROVIDED THEY ARE SIMILAR TO THOSE SHOWN & HAVE CORNER CONSTRUCTION AS DESCRIBED ON SHEET 1.
2. ALL SHAPED UNITS MUST FIT INSCRIBED INTO THE ALLOWABLE RECTANGULAR UNITS & BE GOVERNED BY THE ALLOWABLE PRESSURE OF THE RESPECTIVE RECTANGULAR UNIT.

TYPICAL CORNER CONSTRUCTION


FRAME CORNERS: VERTICAL JAMB ENDS ARE COPED AND BUTTED TO HORIZONTAL JAMBS WITH JOINT FULLY GLUED WITH WOOD GLUE AND DOWELED WITH (3) 1/2" DIA. x 3 5/16" LONG MERBAU WOOD DOWELS.

PANEL CORNERS (PANEL HEIGHT ≤ 120 1/16"): HORIZONTAL SASH ENDS ARE COPED AND BUTTED TO VERTICAL SASH PROFILES WITH JOINT FULLY GLUED WITH WOOD GLUE AND DOWELED WITH (2) 1/2" DIA. x 3 7/16" AND (1) 5/8" DIA. x 3 1/4" MERBAU WOOD DOWELS.

PANEL CORNERS (PANEL HEIGHT > 120 1/16"): HORIZONTAL SASH ENDS ARE COPED AND BUTTED TO VERTICAL SASH PROFILES WITH JOINT FULLY GLUED WITH WOOD GLUE AND DOWELED WITH (4) 1/2" DIA. x 3 7/16" AND (3) 5/8" DIA. x 3 1/4" MERBAU WOOD DOWELS.

HARDWARE NOTES (THIS SHEET):

- HINGES: (#15) G-U HARDWARE 5020-SM LOCATED 8-3/8" (MAX) FROM CORNERS OR SPRINGLINE AND 27-3/8" O.C. (MAX), OR (#16) SIMONSWERK BAKA C2-20WF LOCATED 6" (MAX) FROM CORNERS OR SPRINGLINE AND 26-3/8" O.C. (MAX).
- LOCKS: (#17) SIEGENIA NO. 3/45M5 OR (#18) G-U HWC-35 MULTI-POINT LOCKS WITH LOCKING POINTS AT THE FOLLOWING LOCATIONS:
- HEAD - (1) LOCKING POINTS FOR PANEL WIDTHS ≤ 33",
(2) LOCKING POINTS FOR PANEL WIDTHS > 33",
- SILL - (1) LOCKING POINTS FOR PANEL WIDTHS ≤ 20",
(2) LOCKING POINTS FOR PANEL WIDTHS ≤ 35",
(3) LOCKING POINTS FOR PANEL WIDTHS > 35"
- JAMBS - (2) LOCKING POINTS FOR PANEL HEIGHTS ≤ 41",
(3) LOCKING POINTS FOR PANEL HEIGHTS ≤ 57",
(4) LOCKING POINTS FOR PANEL HEIGHTS > 57",

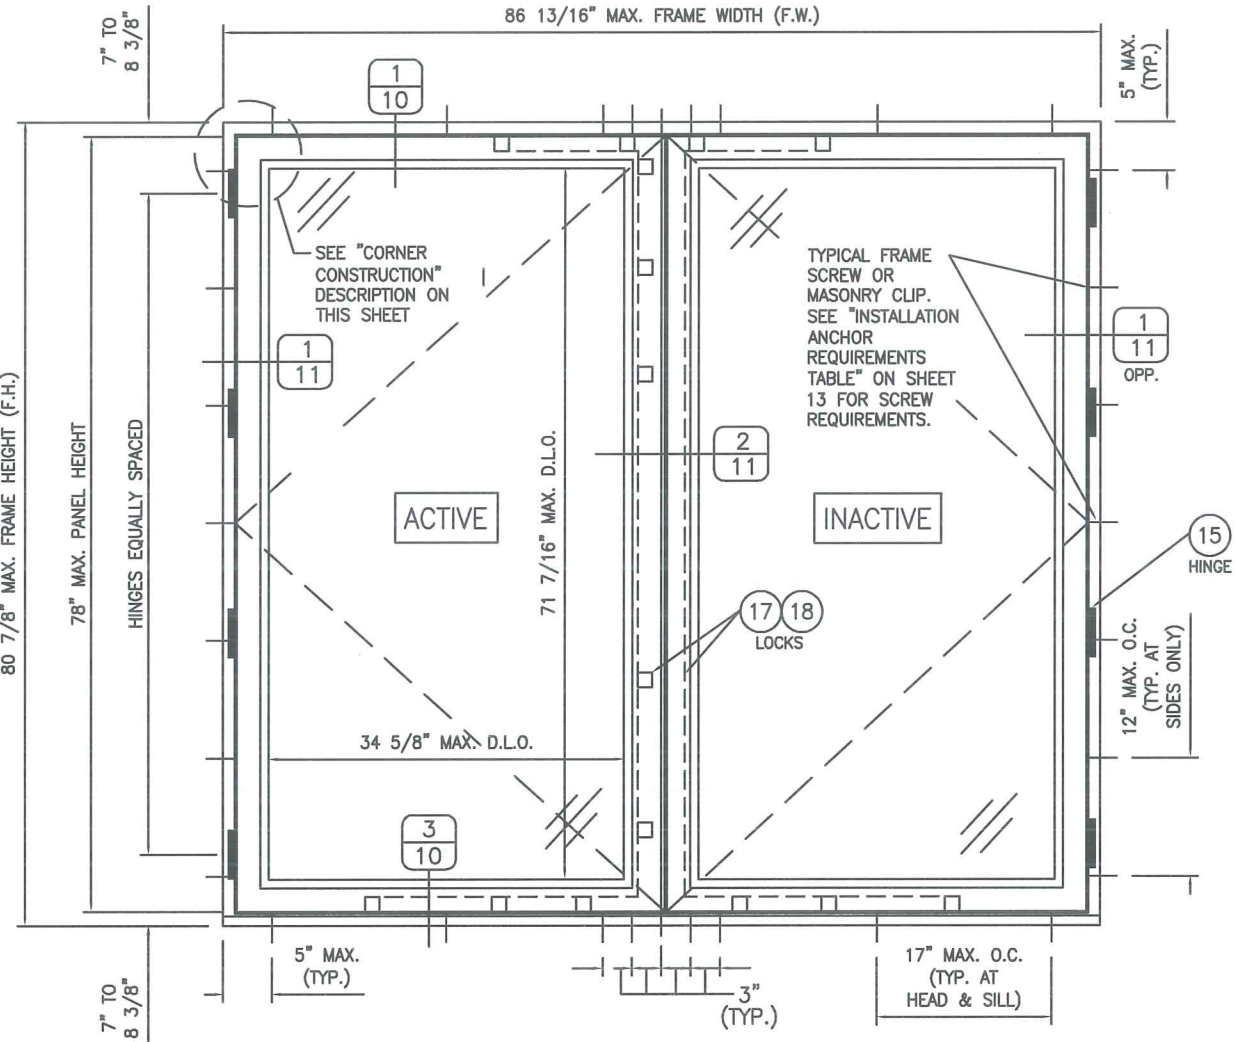

EXTERIOR ELEVATION
DOUBLE WINDOW UNIT

DATE: 2/26/14

DATE
6/15/15

REVISION DESCRIPTION

UPDATED TO 2014 FBC

NO.

1

12 FT WOOD SLIM EUROPEAN IMPACT OUTSWING CASEMENT WINDOWS

LUXBAUM, LLC
WINDOWS + DOORS

2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409
Ph: (561) 684-1500
www.luxbaum.com




SCOTT WALTERS
FL PE# 62354

WALTERS ENGINEERING
(CO.# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33411

DRAWING NO.
CASEMENT WINDOW

SHEET NO.
1 OF 15

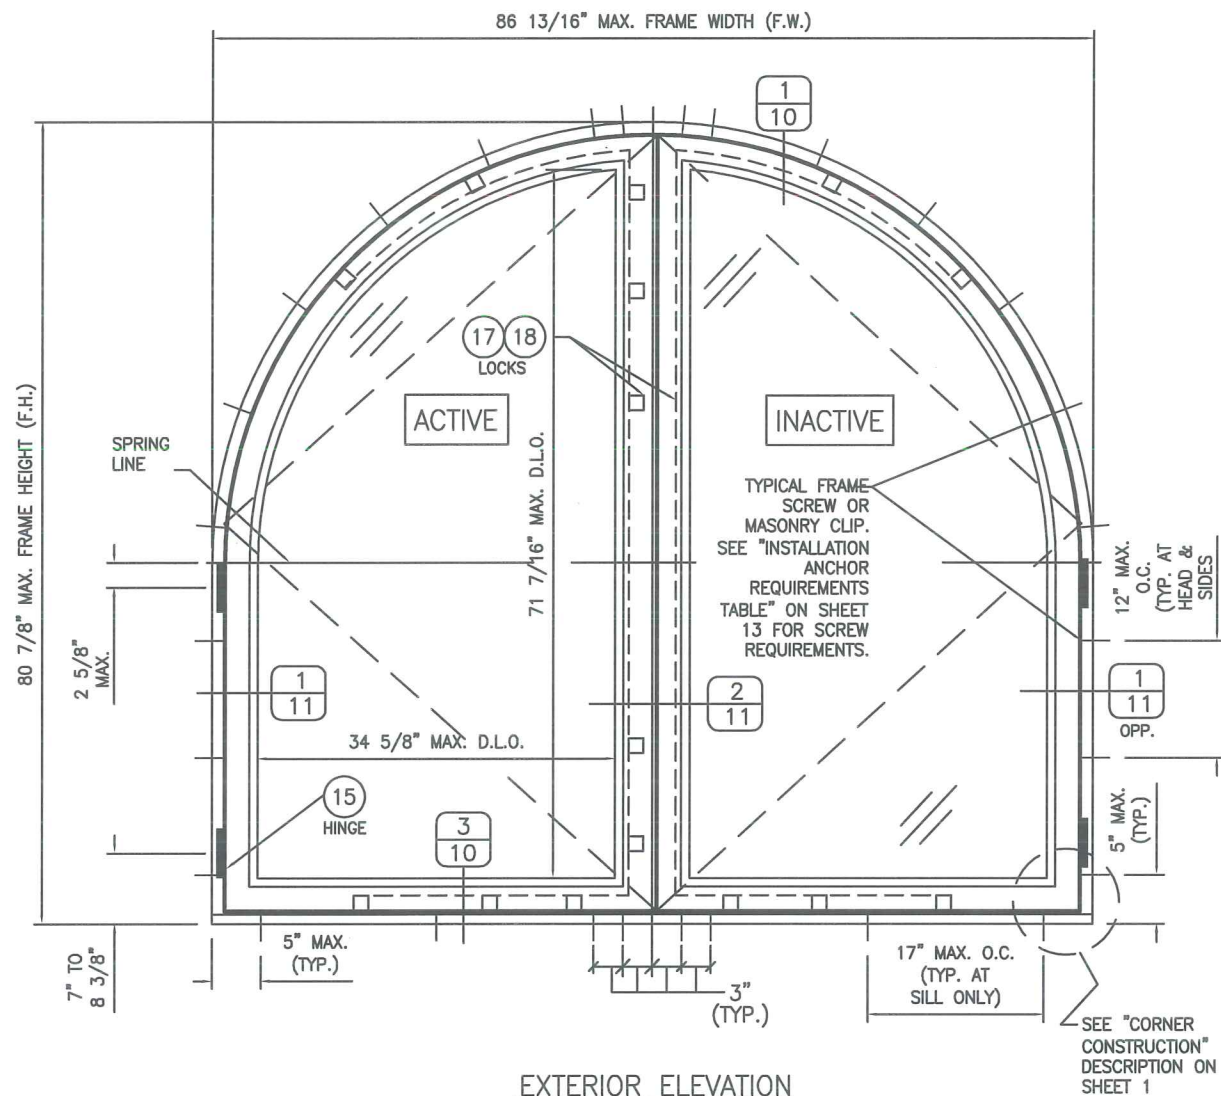


EXTERIOR ELEVATION
DOUBLE HALF ROUND WINDOW UNIT
(EYEBROW TOP WINDOWS SHALL ALSO APPLY PROVIDING CORNER
CONSTRUCTION IS EQUAL TO THE RECTANGULAR UNIT)

HARDWARE NOTES (THIS SHEET):

HINGES: (#15) G-U HARDWARE 5020-SM LOCATED 8-3/8\" (MAX) FROM CORNERS OR SPRINGLINE AND 27-3/8\" O.C. (MAX), OR (#16) SIMONSWERK BAKA C2-20WF LOCATED 6\" (MAX) FROM CORNERS OR SPRINGLINE AND 26-3/8\" O.C. (MAX).

LOCKS: (#17) SIEGENIA NO. 3/45M5 OR (#18) G-U HWC-35 MULTI-POINT
LOCKS WITH LOCKING POINTS AT THE FOLLOWING LOCATIONS:

- HEAD - (1) LOCKING POINTS FOR PANEL WIDTHS $\leq$ 33\",
(2) LOCKING POINTS FOR PANEL WIDTHS $>$ 33\",
SILL - (1) LOCKING POINTS FOR PANEL WIDTHS $\leq$ 20\",
(2) LOCKING POINTS FOR PANEL WIDTHS $\leq$ 35\",
(3) LOCKING POINTS FOR PANEL WIDTHS $>$ 35\",
JAMBS - (2) LOCKING POINTS FOR PANEL HEIGHTS $\leq$ 41\",
(3) LOCKING POINTS FOR PANEL HEIGHTS $\leq$ 57\",
(4) LOCKING POINTS FOR PANEL HEIGHTS $>$ 57\",

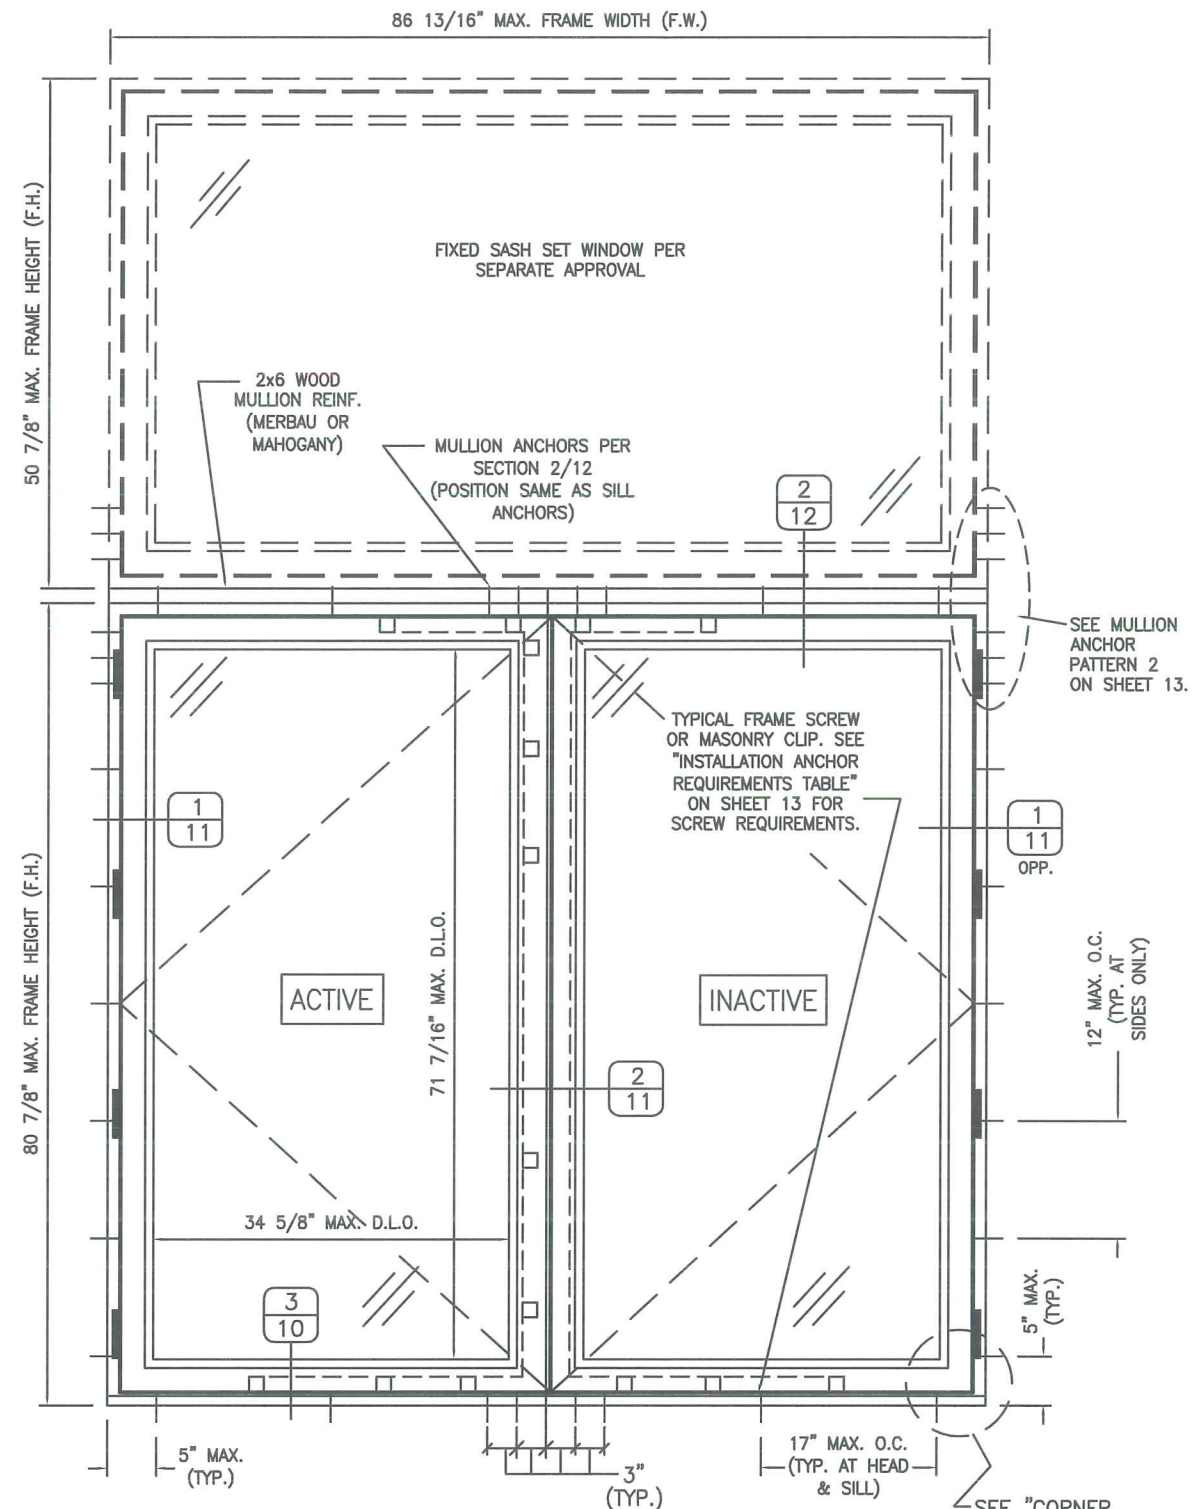


EXTERIOR ELEVATION
DOUBLE WINDOW UNIT WITH MULLIED TRANSOM
SEE DOUBLE WINDOW ELEVATION FOR DETAIL NOT SHOWN

LIMITATIONS:

1. LOWER DESIGN PRESSURE (DP) FROM TRANSOM OR WINDOWS SHALL CONTROL FOR ENTIRE ASSEMBLY.
2. (4) OR (6) ANCHORS TO BE PROVIDED AT HORIZONTAL MULLION END. (SEE MULLION PATTERN 2 ON SHEET 13.)



DATE:	2/26/14
DATE	6/15/15
REVISION DESCRIPTION	UPDATED TO 2014 FBC
NO.	1
12 FT WOOD SLIM EUROPEAN IMPACT OUTSWING CASEMENT WINDOWS	
LUXBAUM, LLC WINDOWS + DOORS	
2400 CENTREPARK WEST DR, SUITE 150 WEST PALM BEACH, FL 33409	
Ph: (561) 684-1500 www.luxbaum.com	
DRAWING NO.	CASEMENT WINDOW
SHEET NO.	2 OF 15

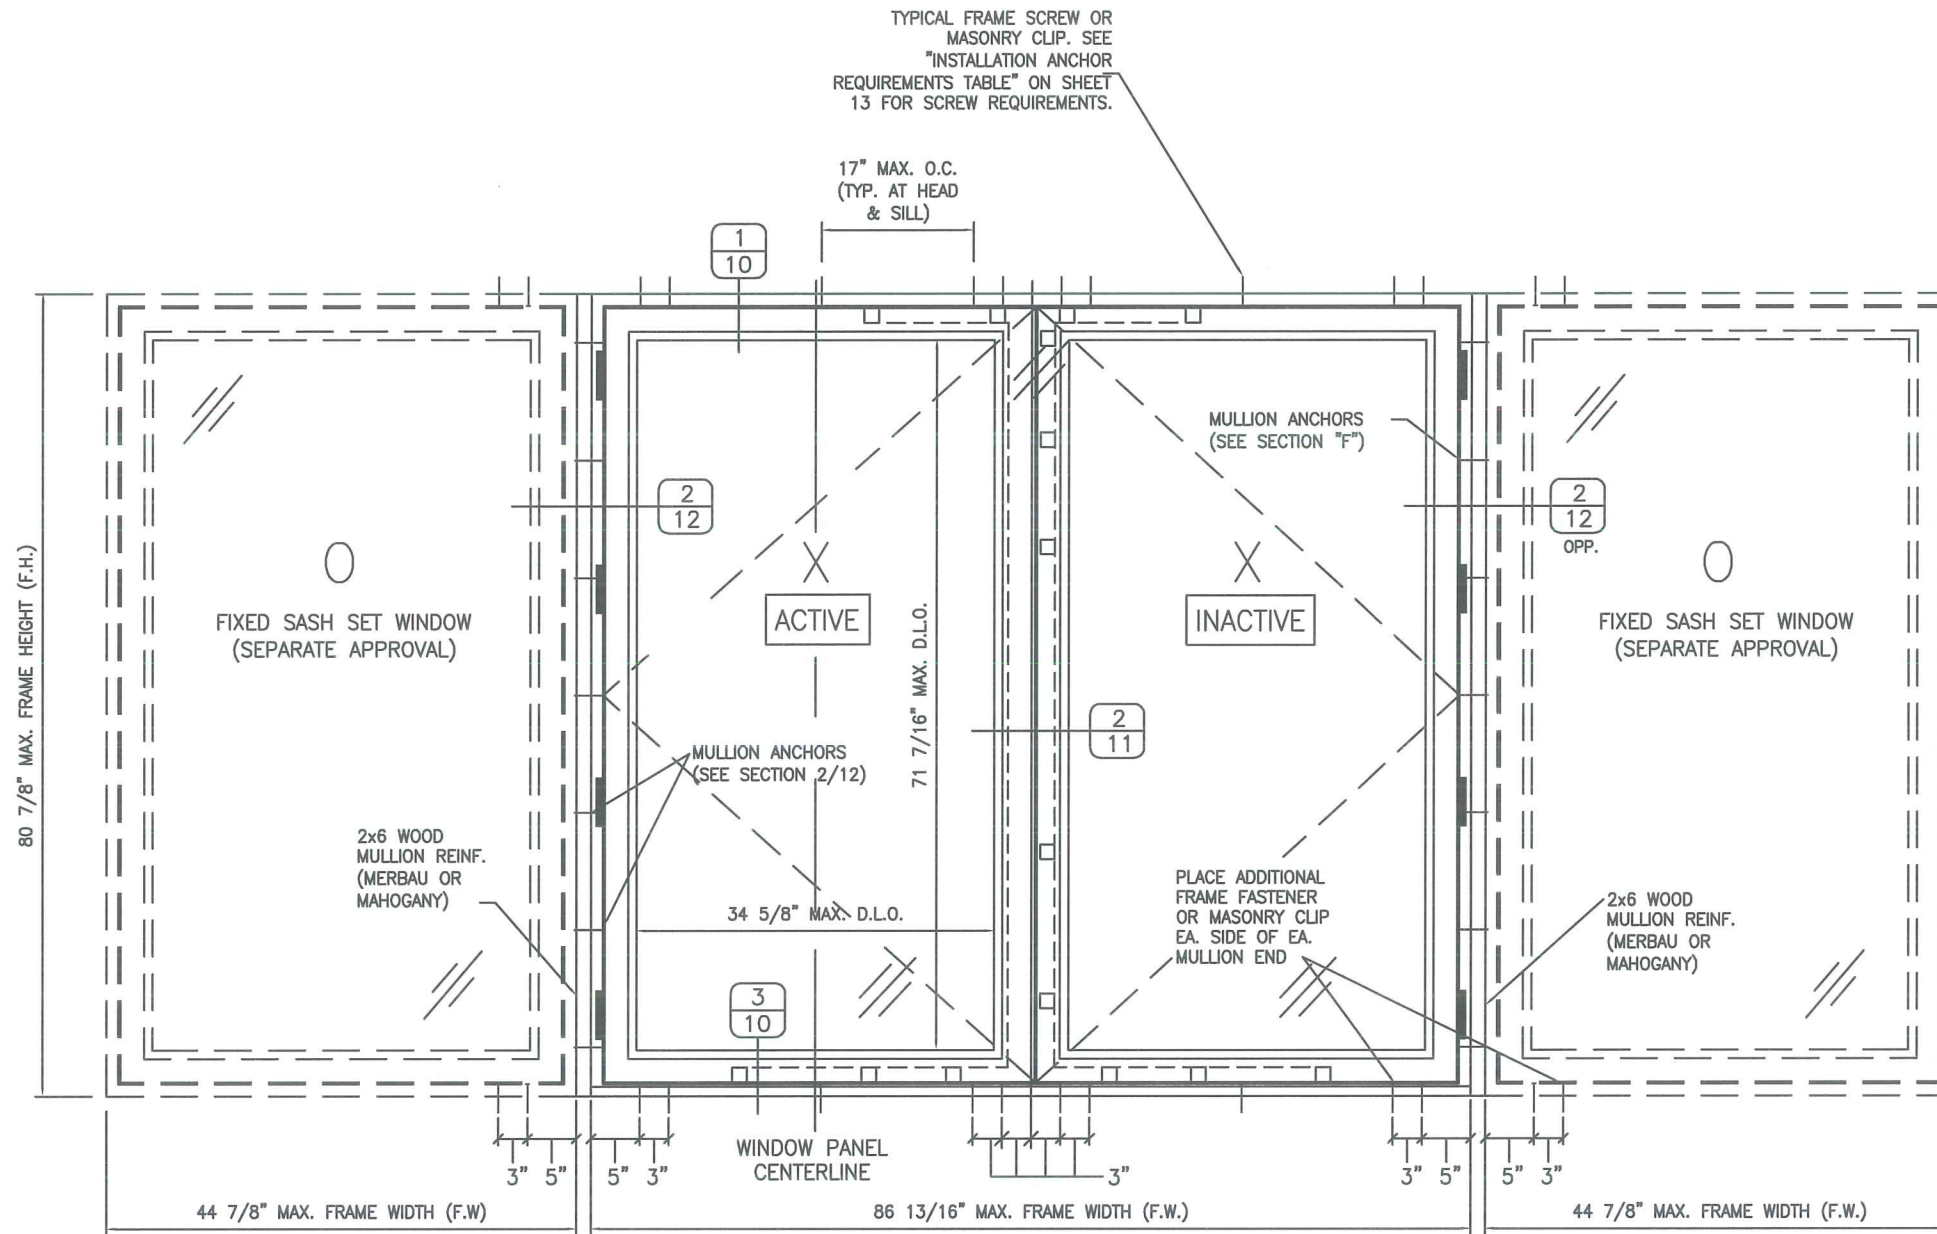

EXTERIOR ELEVATION
DOUBLE CASEMENT WINDOW UNIT WITH MULLED SIDE LIGHTS
(MAX. FOUR UNITS MAY BE COMBINED)

HARDWARE NOTES (THIS SHEET):

HINGES: (#15) G-U HARDWARE 5020-SM LOCATED 8-3/8" (MAX) FROM CORNERS OR SPRINGLINE AND 27-3/8" O.C. (MAX), OR (#16) SIMONSWERK BAKA C2-20WF LOCATED 6" (MAX) FROM CORNERS OR SPRINGLINE AND 26-3/8" O.C. (MAX).

LOCKS: (#17) SIEGENIA NO. 3/45M5 OR (#18) G-U HWC-35 MULTI-POINT LOCKS WITH LOCKING POINTS AT THE FOLLOWING LOCATIONS:


- HEAD - (1) LOCKING POINTS FOR PANEL WIDTHS $\leq$ 33",
(2) LOCKING POINTS FOR PANEL WIDTHS $>$ 33",
- SILL - (1) LOCKING POINTS FOR PANEL WIDTHS $\leq$ 20",
(2) LOCKING POINTS FOR PANEL WIDTHS $\leq$ 35",
(3) LOCKING POINTS FOR PANEL WIDTHS $>$ 35"
- JAMBS - (2) LOCKING POINTS FOR PANEL HEIGHTS $\leq$ 41",
(3) LOCKING POINTS FOR PANEL HEIGHTS $\leq$ 57",
(4) LOCKING POINTS FOR PANEL HEIGHTS $>$ 57",

NOTES:


1. LOWER DESIGN PRESSURE (DP) FROM CASEMENT OR FIXED WINDOWS SHALL CONTROL FOR ENTIRE ASSEMBLY.
2. (4) ANCHORS TO BE PROVIDED AT VERTICAL MULLION ENDS AS SHOWN.
3. SEE DOUBLE WINDOW ELEVATIONS FOR DETAIL NOT SHOWN.
4. 0-XX-0 UNIT SHOWN. TWO DOUBLE OPERABLE UNITS (I.E. XX-XX) MAY ALSO BE MULLED TOGETHER WITH THE MULLION CONDITIONS SHOWN.



DATE: 2/26/14	
DATE	6/15/15
REVISION DESCRIPTION	1 UPDATED TO 2014 FBC
NO.	1
12 FT WOOD SLIM EUROPEAN IMPACT OUTSWING CASEMENT WINDOWS	
 LUXBAUM LLC WINDOWS + DOORS 2400 CENTREPARK WEST DR, SUITE 150 WEST PALM BEACH, FL 33409 Ph: (561) 684-1500 www.luxbaum.com	
DRAWING NO. CASEMENT WINDOW	
SHEET NO. 3 OF 15	

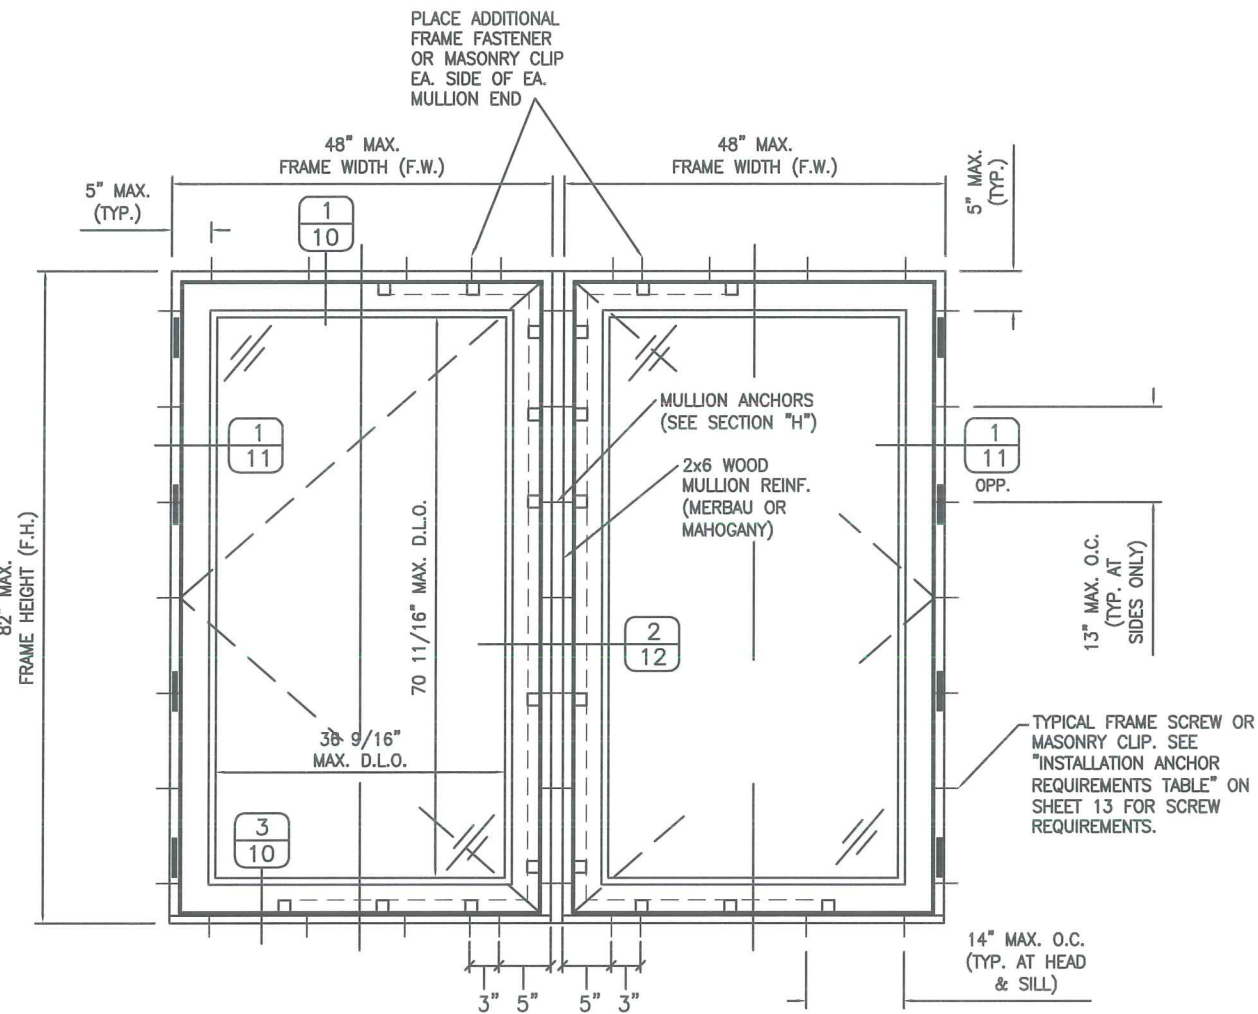

EXTERIOR ELEVATION
MULLED MULTIPLE OPERABLE CASEMENT WINDOW UNIT
(MAX. FOUR UNITS MAY BE COMBINED)

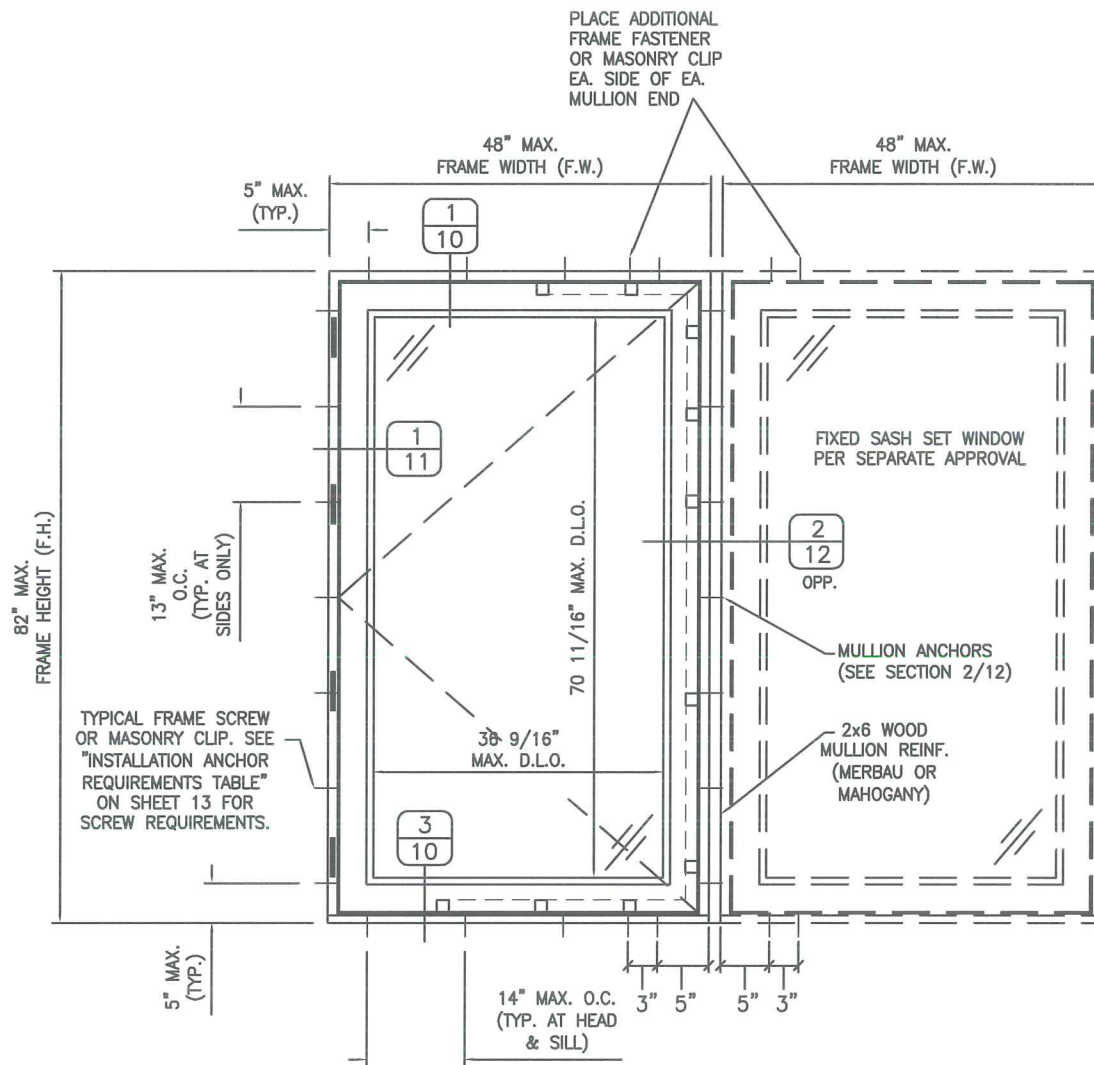

EXTERIOR ELEVATION
MULLED MULTIPLE OPERABLE/FIXED WINDOW UNIT
(MAX. FOUR UNITS MAY BE COMBINED WITH
ANY COMBINATION OF FIXED & OPERABLE)

HARDWARE NOTES (THIS SHEET):

HINGES: (#15) G-U HARDWARE 5020-SM LOCATED 8-3/8" (MAX) FROM CORNERS OR SPRINGLINE AND 27-3/8" O.C. (MAX), OR (#16) SIMONSWERK BAKA C2-20WF LOCATED 6" (MAX) FROM CORNERS OR SPRINGLINE AND 22-7/8" O.C. (MAX).

LOCKS: (#17) SIEGENIA NO. 3/50M5 OR (#18) G-U HWC-40 MULTI-POINT LOCKS WITH LOCKING POINTS AT THE FOLLOWING LOCATIONS:

- HEAD - (1) LOCKING POINTS FOR PANEL WIDTHS <= 33",
(2) LOCKING POINTS FOR PANEL WIDTHS <= 42",
(3) LOCKING POINTS FOR PANEL WIDTHS > 42"
- SILL - (1) LOCKING POINTS FOR PANEL WIDTHS <= 20",
(2) LOCKING POINTS FOR PANEL WIDTHS <= 35",
(3) LOCKING POINTS FOR PANEL WIDTHS > 35"
- JAMBS - (2) LOCKING POINTS FOR PANEL HEIGHTS <= 41",
(3) LOCKING POINTS FOR PANEL HEIGHTS <= 57",
(4) LOCKING POINTS FOR PANEL HEIGHTS <= 77",
(5) LOCKING POINTS FOR PANEL HEIGHTS > 77"

NOTES:

1. LOWER DESIGN PRESSURE (DP) FROM CASEMENT OR FIXED WINDOWS SHALL CONTROL FOR ENTIRE ASSEMBLY.
2. (4) ANCHORS TO BE PROVIDED AT VERTICAL MULLION ENDS AS SHOWN.
3. X-X AND X-O UNITS SHOWN. UP TO FOUR UNITS MAY BE MULLED TOGETHER WITH THE MULLION CONDITIONS SHOWN, IN ANY COMBINATION OF FIXED & OPERABLE.

DATE: 2/26/14

DATE: 6/15/15


REVISION DESCRIPTION

NO. 1

12 FT WOOD SLIM EUROPEAN IMPACT OUTSWING CASEMENT WINDOWS

LUXBAUM, LLC
WINDOWS + DOORS


2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409
Ph: (561) 684-1500
www.luxbaum.com



SCOTT WALTERS
FL PE# 62354
WALTERS ENGINEERING
(CO.# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412

DRAWING NO.
CASEMENT WINDOW

SHEET NO.
4 OF 15

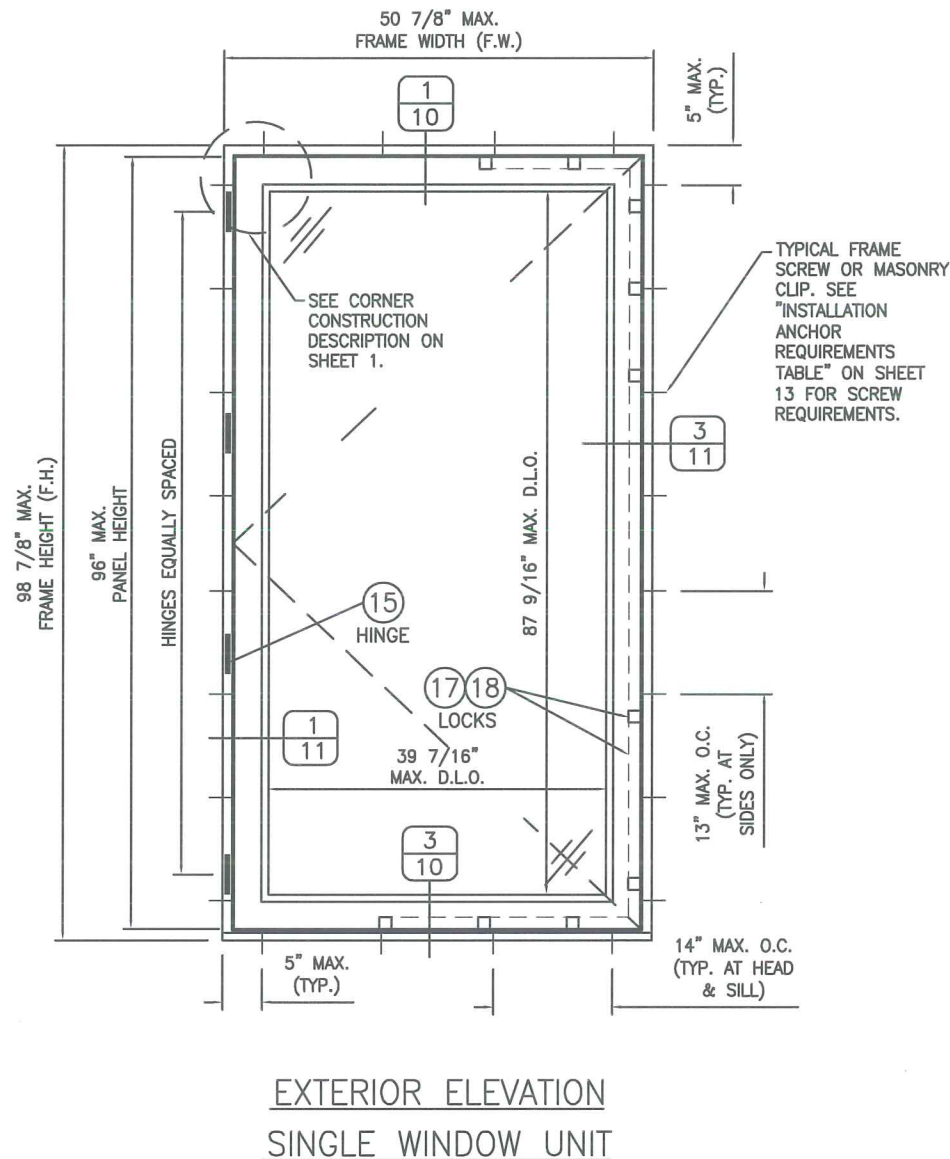


EXTERIOR ELEVATION
SINGLE WINDOW UNIT

HARDWARE NOTES (THIS SHEET):

HINGES: (#15) G-U HARDWARE 5020-SM LOCATED 8-3/8" (MAX) FROM CORNERS OR SPRINGLINE AND 27-3/8" O.C. (MAX), OR (#16) SIMONSWERK BAKA C2-20WF LOCATED 6" (MAX) FROM CORNERS OR SPRINGLINE AND 22-7/8" O.C. (MAX).

LOCKS: (#17) SIEGENIA NO. 3/50M5 OR (#18) G-U HWC-40 MULTI-POINT LOCKS WITH LOCKING POINTS AT THE FOLLOWING LOCATIONS:


- HEAD - (1) LOCKING POINTS FOR PANEL WIDTHS ≤ 33",
(2) LOCKING POINTS FOR PANEL WIDTHS ≤ 42",
(3) LOCKING POINTS FOR PANEL WIDTHS > 42"
- SILL - (1) LOCKING POINTS FOR PANEL WIDTHS ≤ 20",
(2) LOCKING POINTS FOR PANEL WIDTHS ≤ 35",
(3) LOCKING POINTS FOR PANEL WIDTHS > 35"
- JAMBS - (2) LOCKING POINTS FOR PANEL HEIGHTS ≤ 41",
(3) LOCKING POINTS FOR PANEL HEIGHTS ≤ 57",
(4) LOCKING POINTS FOR PANEL HEIGHTS ≤ 77",
(5) LOCKING POINTS FOR PANEL HEIGHTS > 77"

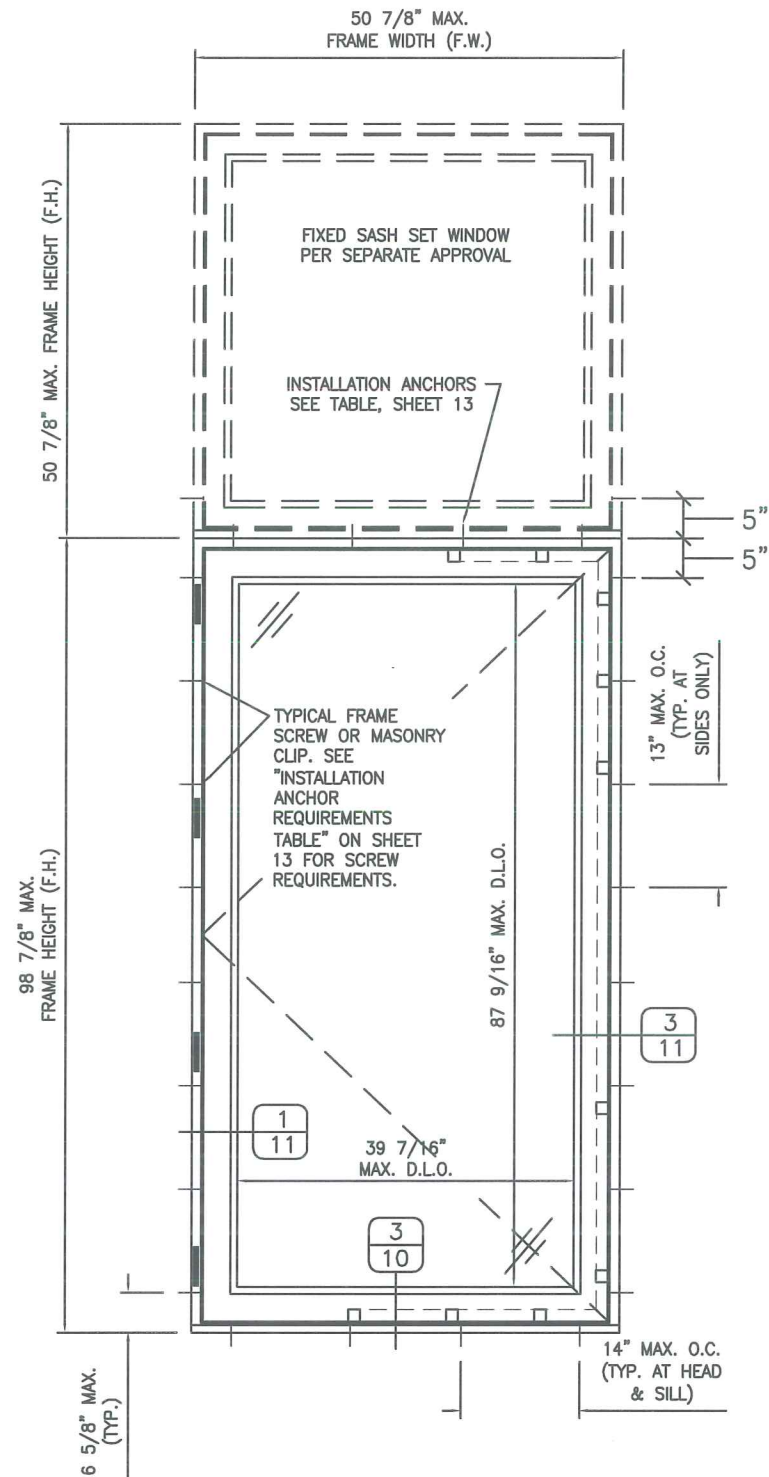


EXTERIOR ELEVATION
CASEMENT WINDOW WITH DIRECT-STACK TRANSOM
SEE SINGLE WINDOW ELEVATION FOR DETAIL NOT SHOWN

NOTES:
1. LOWER DESIGN PRESSURE (DP) FROM TRANSOM OR WINDOWS SHALL CONTROL FOR ENTIRE ASSEMBLY.
2. (4) OR (6) ANCHORS TO BE PROVIDED AT HORIZONTAL MULLION END. (SEE MULLION PATTERN 2 ON SHEET 13.)


DATE: 2/26/14	
DATE: 6/15/15	REVISION DESCRIPTION: UPDATED TO 2014 FBC
NO. 1	
12 FT WOOD SLIM EUROPEAN IMPACT OUTSWING CASEMENT WINDOWS LUXBAUM, LLC WINDOWS + DOORS 2400 CENTREPARK WEST DR, SUITE 150 WEST PALM BEACH, FL 33409 Ph: (561) 684-1500 www.luxbaum.com	
SCOTT WOLTERS FL PE# 62364 WOLTERS ENGINEERING (COA# 27194) 15211 97TH ROAD N WEST PALM BEACH, FL 33412	
DRAWING NO. CASEMENT WINDOW	
SHEET NO. 5 OF 15	

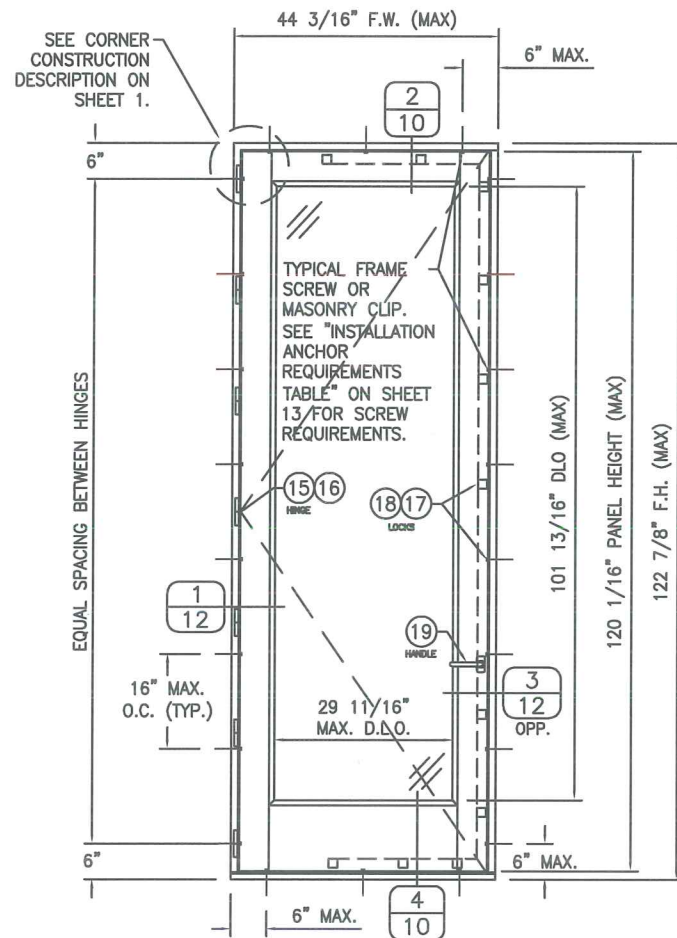

EXTERIOR ELEVATION
SINGLE OUTSWING WINDOW
(RECTANGULAR)

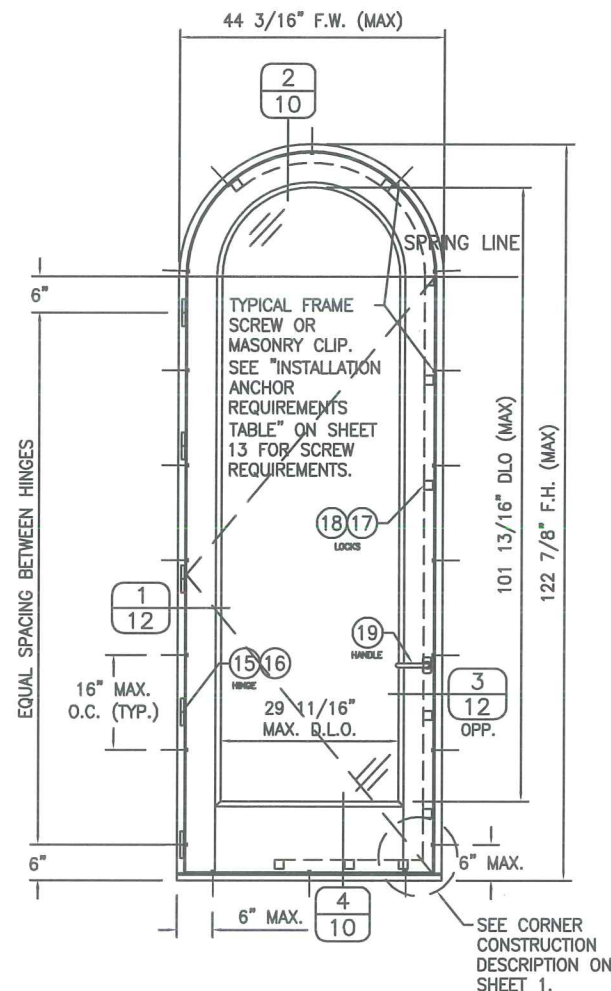

EXTERIOR ELEVATION
SINGLE OUTSWING WINDOW
(CIRCLE TOP)

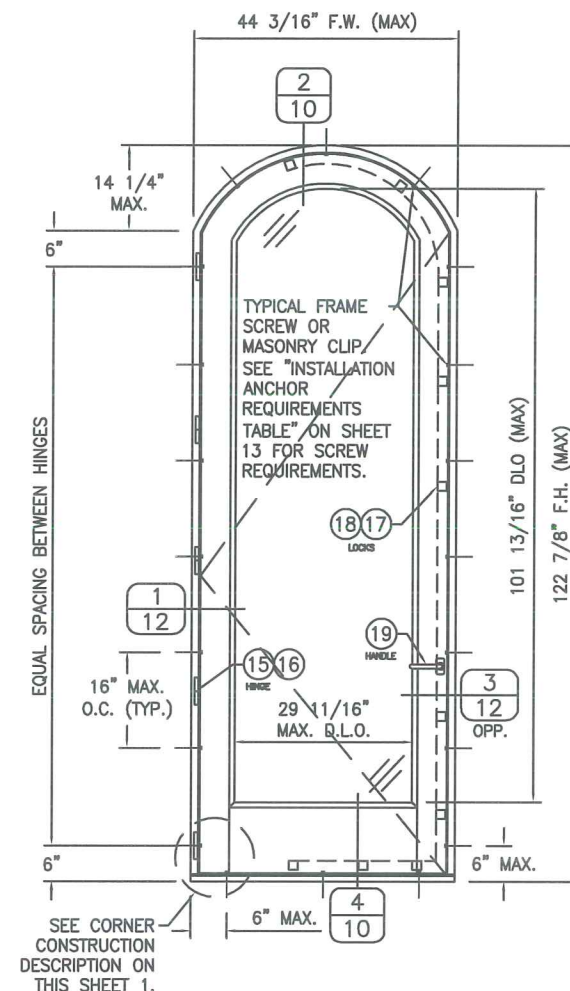

EXTERIOR ELEVATION
SINGLE OUTSWING WINDOW
(ARCH TOP)

HARDWARE NOTES (THIS SHEET):

HINGES: (#15) G-U HARDWARE 5020-SM OR (#16) SIMONSWERK BAKA C2-20WF, LOCATED 6" (MAX) FROM CORNERS OR SPRINGLINE AND 26.4" O.C. (MAX).

LOCKS: (#17) SIEGENIA NO. 3/45M5 OR (#18) G-U HWC-35 MULTI-POINT LOCKS WITH LOCKING POINTS AT THE FOLLOWING LOCATIONS:

- HEAD - (1) LOCKING POINTS FOR PANEL WIDTHS < 20",
(2) LOCKING POINTS FOR PANEL WIDTHS >= 20",
- SILL - (1) LOCKING POINTS FOR PANEL WIDTHS < 20",
(3) LOCKING POINTS FOR PANEL WIDTHS >= 20"
- JAMBS - (5) LOCKING POINTS FOR PANEL HEIGHTS < 96",
(6) LOCKING POINTS FOR PANEL HEIGHTS < 108",
(7) LOCKING POINTS FOR PANEL HEIGHTS < 126",
(8) LOCKING POINTS FOR PANEL HEIGHTS >= 126"

DATE: 2/26/14

DATE
6/15/15



REVISION DESCRIPTION
UPDATED TO 2014 FBC

NO. 1

12 FT WOOD SLIM EUROPEAN IMPACT OUTSWING CASEMENT WINDOWS

LUXBAUM LLC
WINDOWS + DOORS


2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409
Ph: (561) 684-1500
www.luxbaum.com

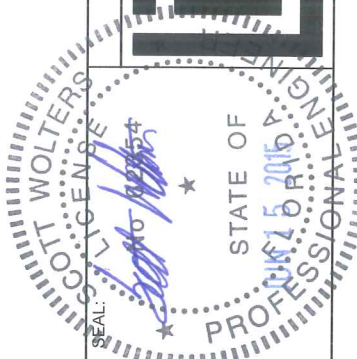


SCOTT WALTERS
FL PE# 62364
WALTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412

DRAWING NO.
CASEMENT WINDOW


SHEET NO.
6 OF 15

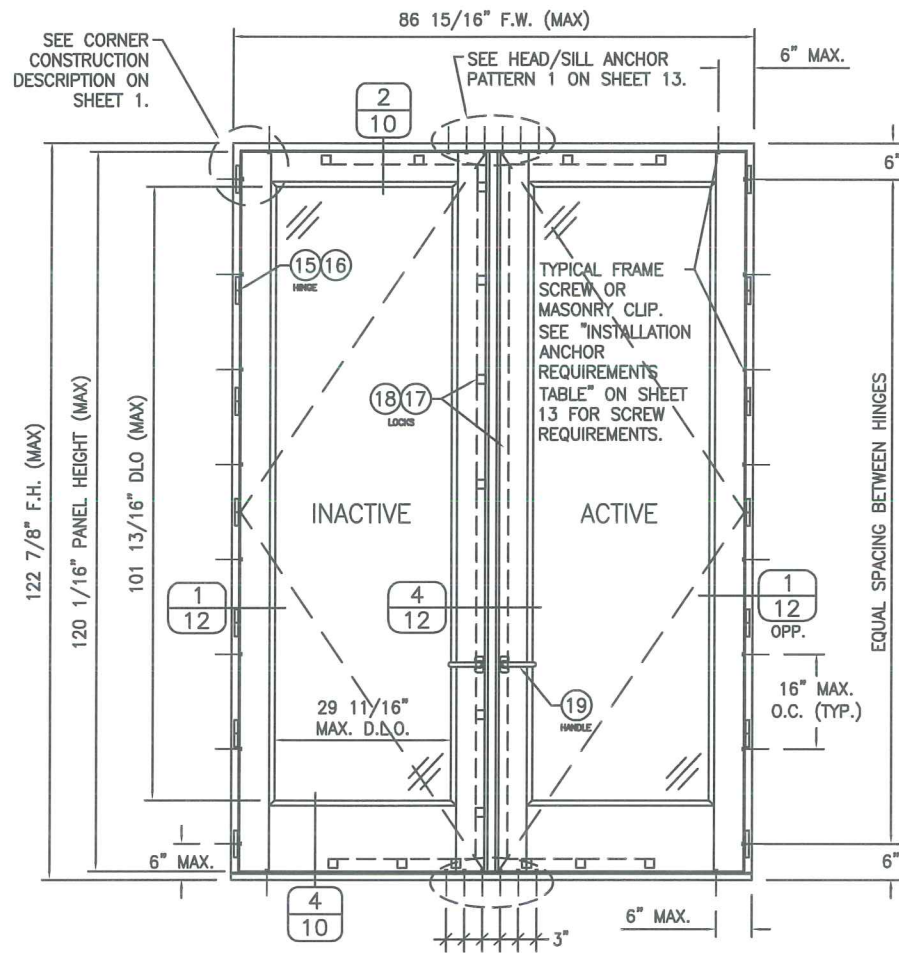

EXTERIOR ELEVATION
DOUBLE OUTSWING WINDOW
(RECTANGULAR)

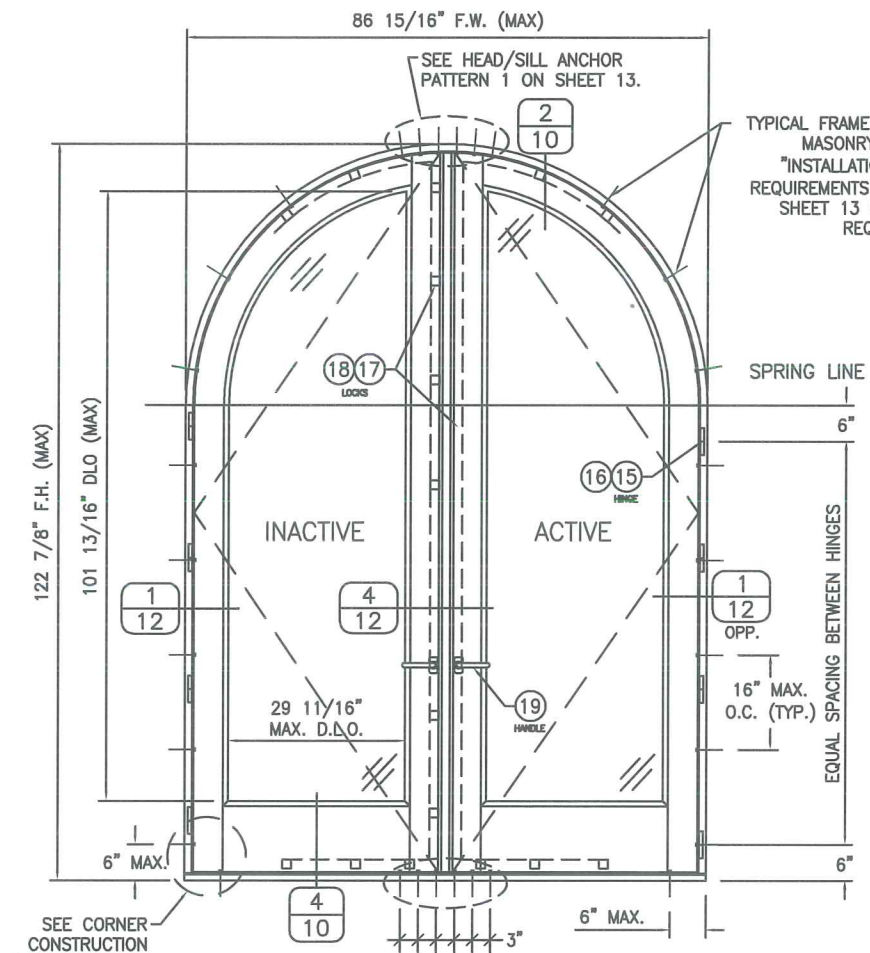

EXTERIOR ELEVATION
DOUBLE OUTSWING WINDOW
(CIRCLE TOP)

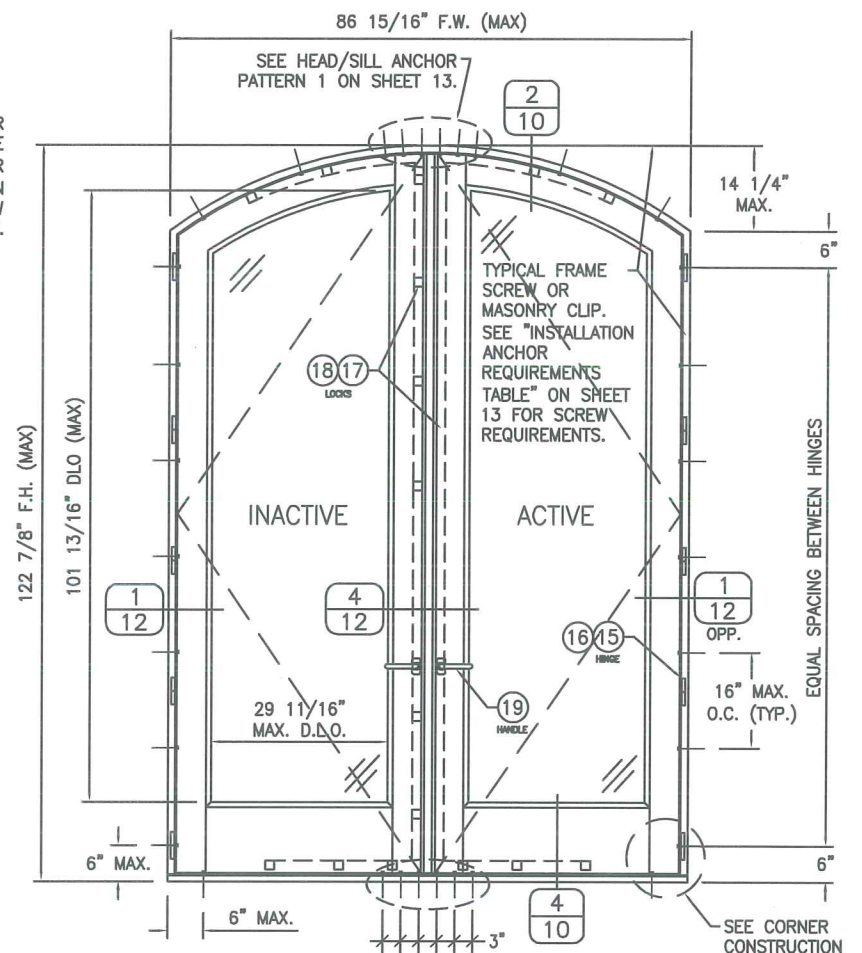

EXTERIOR ELEVATION
DOUBLE OUTSWING WINDOW
(ARCH TOP)

HARDWARE NOTES (THIS SHEET):

HINGES: (#15) G-U HARDWARE 5020-SM OR (#16) SIMONSWERK BAKA C2-20WF, LOCATED 6" (MAX) FROM CORNERS OR SPRINGLINE AND 26.4" O.C. (MAX).

LOCKS: (#17) SIEGENIA NO. 3/45M5 OR (#18) G-U HWC-35 MULTI-POINT
LOCKS WITH LOCKING POINTS AT THE FOLLOWING LOCATIONS:

HEAD - (1) LOCKING POINTS FOR PANEL WIDTHS < 20",
(2) LOCKING POINTS FOR PANEL WIDTHS >= 20",

SILL - (1) LOCKING POINTS FOR PANEL WIDTHS < 20",
(3) LOCKING POINTS FOR PANEL WIDTHS >= 20"

JAMBS - (5) LOCKING POINTS FOR PANEL HEIGHTS < 96",
(6) LOCKING POINTS FOR PANEL HEIGHTS < 108",
(7) LOCKING POINTS FOR PANEL HEIGHTS < 126",
(8) LOCKING POINTS FOR PANEL HEIGHTS >= 126"

DATE: 2/26/14

DATE
6/15/15



REVISION DESCRIPTION
UPDATED TO 2014 FBC

NO. 1

12 FT WOOD SLIM EUROPEAN IMPACT OUTSWING CASEMENT WINDOWS

LUXBAUM LLC
WINDOWS + DOORS


2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409
Ph: (561) 684-1500
www.luxbaum.com

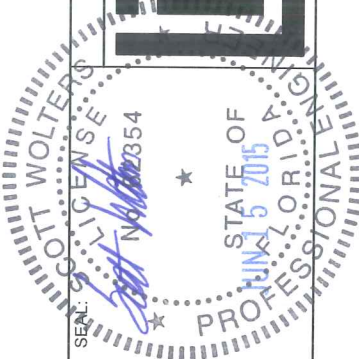

SCOTT WALTERS
FL PE# 62354
WALTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412

DRAWING NO.
CASEMENT WINDOW


SHEET NO.
7 OF 15

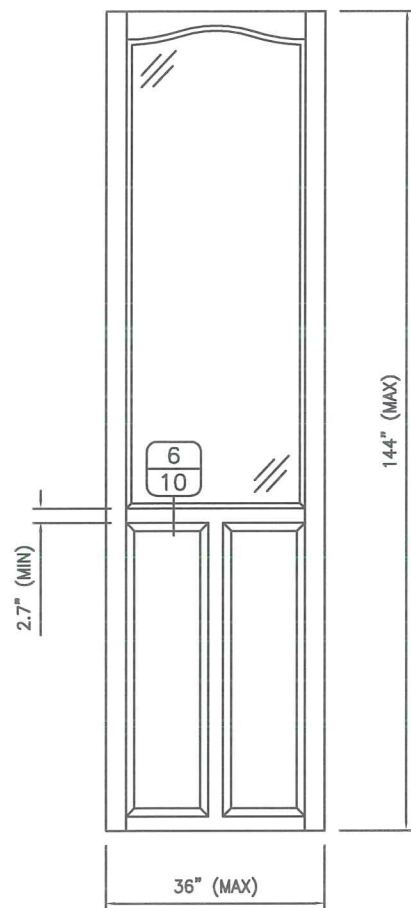


EXTERIOR ELEVATION
PARTIAL RAISED PANEL WITH
STANDARD MID-RAILS

NOTES:

- TOP & MID RAILS MAY BE OF ANY CONFIGURATION PROVIDING THE SMALLEST CROSS SECTION OF RAILS IS EQUAL TO OR LARGER THAN THAT DETAILED IN DRAWINGS.
- MULTIPLE MID RAIL (BOTH HORIZONTAL & VERTICAL) MAY BE USED WITH THESE PANELS. STANDARD PARTIAL PANEL CONDITION IS SHOWN ABOVE. OTHER PARTIAL PANEL CONFIGURATIONS ARE ALSO PART OF THIS APPROVAL, PROVIDING THEY ARE SIMILAR IN CONSTRUCTION TO THAT SHOWN ABOVE.
- PANEL ONLY IS SHOWN. FOR INSTALLATION INTO FRAME, SEE OTHER ELEVATIONS.

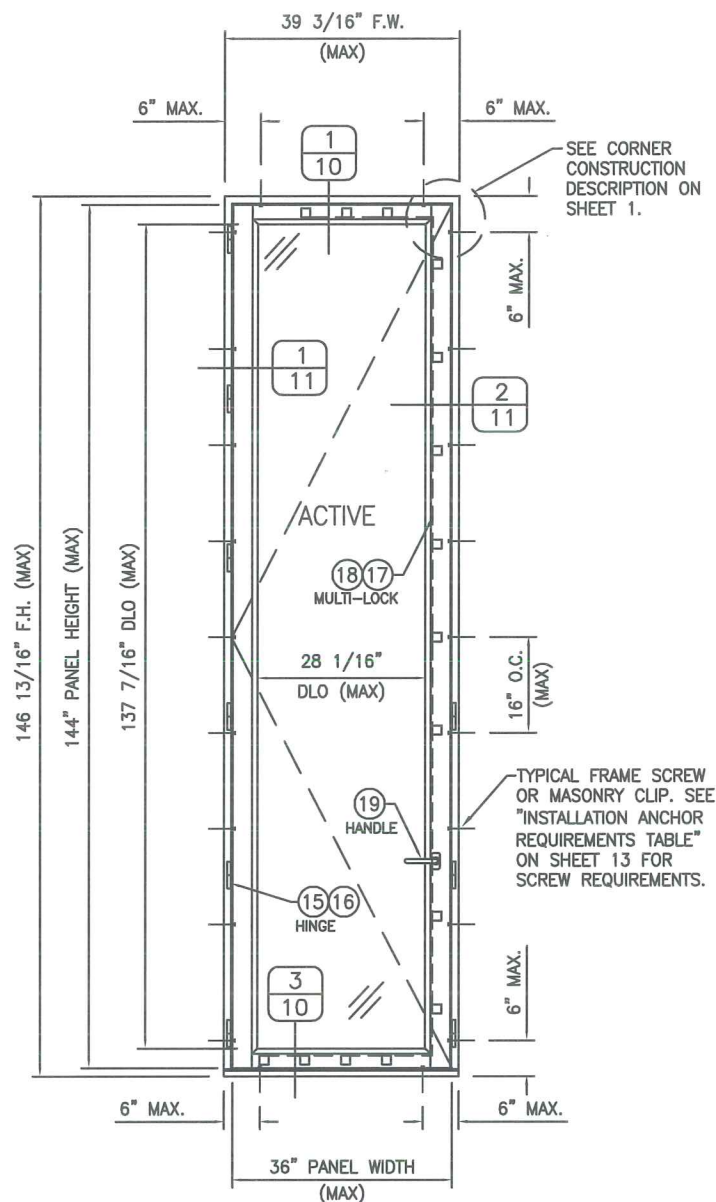


EXTERIOR ELEVATION
SINGLE RECTANGULAR WINDOW

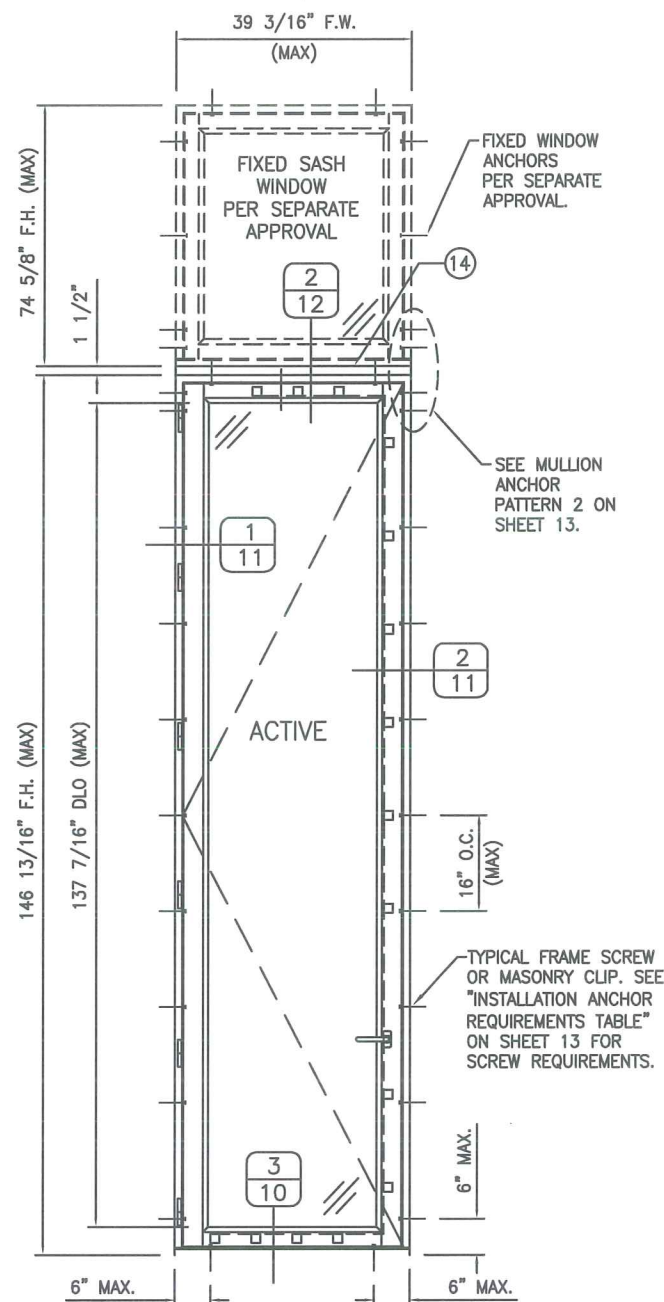

EXTERIOR ELEVATION
SINGLE WINDOW WITH TRANSOM

NOTES:


- LOWER DESIGN PRESSURE (DP) FROM TRANSOM OR WINDOWS SHALL CONTROL FOR ENTIRE ASSEMBLY.
- (4) OR (6) ANCHORS TO BE PROVIDED AT HORIZONTAL MULLION END. (SEE MULLION PATTERN 2 ON SHEET 13.)

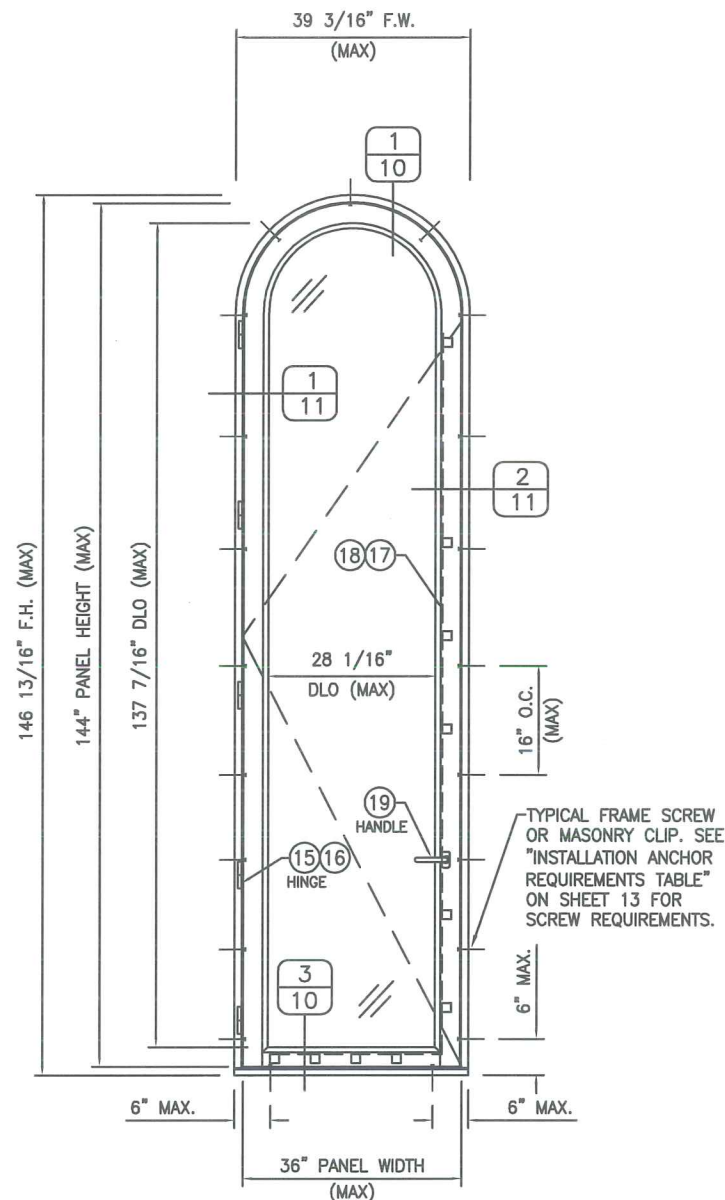

EXTERIOR ELEVATION
SINGLE HALF ROUND WINDOW

HARDWARE NOTES (THIS SHEET):


- HINGES: (#15) G-U HARDWARE 5020-SM OR (#16) SIMONSWERK BAKA C2-20WF, LOCATED 6" (MAX) FROM CORNERS OR SPRINGLINE AND 26.4" O.C. (MAX).
- LOCKS: (#17) SIEGENIA NO. 3/45M5 OR (#18) G-U HWC-35 MULTI-POINT LOCKS WITH LOCKING POINTS AT THE FOLLOWING LOCATIONS:
- HEAD - (1) LOCKING POINTS FOR PANEL WIDTHS < 20", (3) LOCKING POINTS FOR PANEL WIDTHS >= 20",
 - SILL - (1) LOCKING POINTS FOR PANEL WIDTHS < 20", (4) LOCKING POINTS FOR PANEL WIDTHS >= 20"
 - JAMBS - (5) LOCKING POINTS FOR PANEL HEIGHTS < 96", (6) LOCKING POINTS FOR PANEL HEIGHTS < 108", (7) LOCKING POINTS FOR PANEL HEIGHTS < 126", (8) LOCKING POINTS FOR PANEL HEIGHTS >= 126"

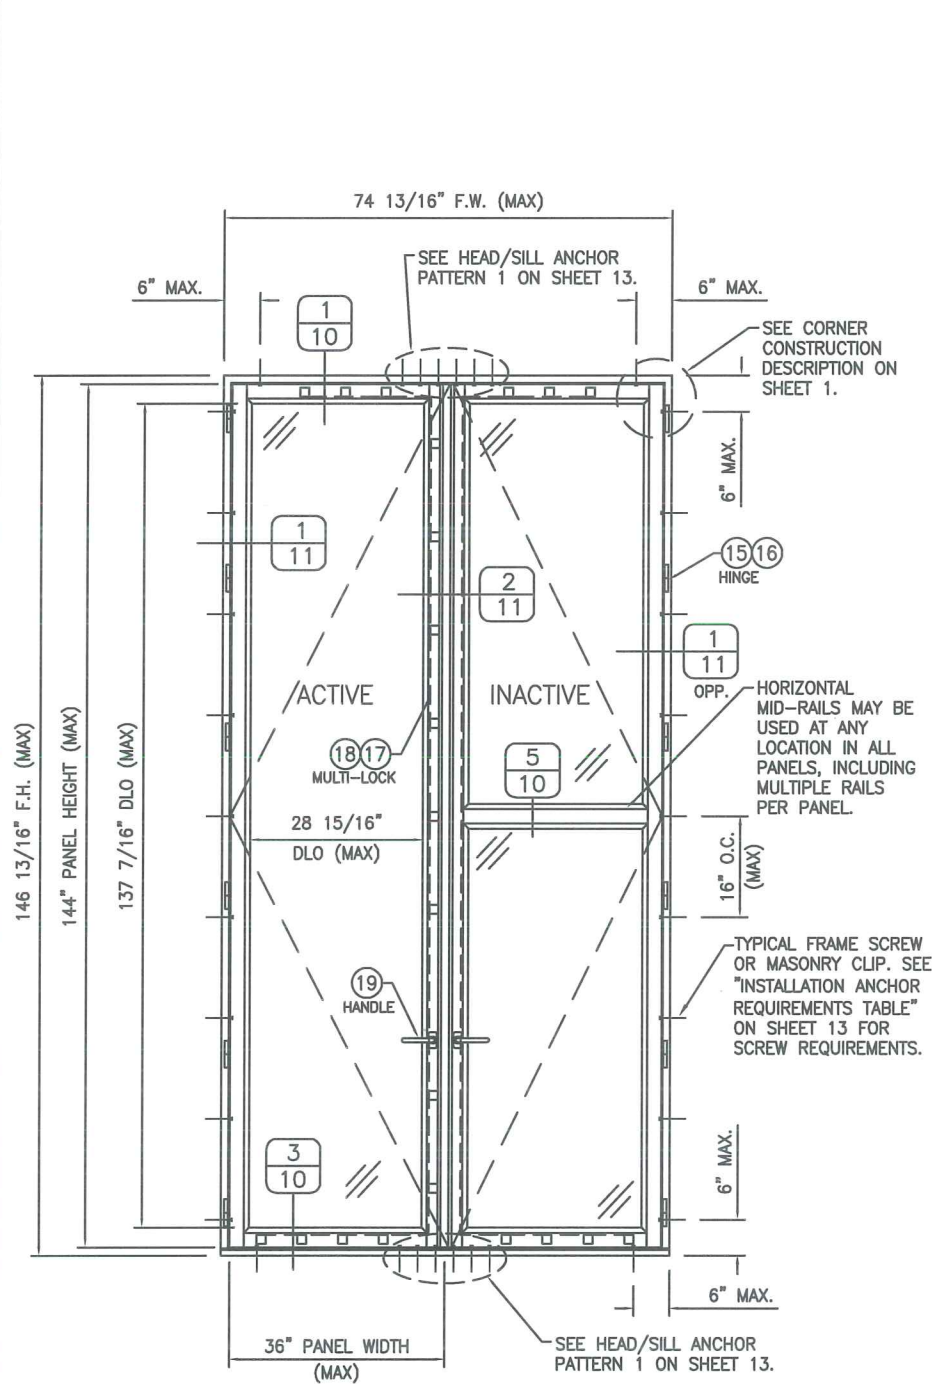

EXTERIOR ELEVATION
DOUBLE RECTANGULAR WINDOW


HARDWARE NOTES (THIS SHEET):

- HINGES: (#15) G-U HARDWARE 5020-SM OR (#16) SIMONSWERK BAKA C2-20WF, LOCATED 6" (MAX) FROM CORNERS OR SPRINGLINE AND 26.4" O.C. (MAX).
- LOCKS: (#17) SIEGENIA NO. 3/45M5 OR (#18) G-U HWC-35 MULTI-POINT LOCKS WITH LOCKING POINTS AT THE FOLLOWING LOCATIONS:
- HEAD - (1) LOCKING POINTS FOR PANEL WIDTHS < 20", (3) LOCKING POINTS FOR PANEL WIDTHS >= 20",
 - SILL - (1) LOCKING POINTS FOR PANEL WIDTHS < 20", (4) LOCKING POINTS FOR PANEL WIDTHS >= 20"
 - JAMBS - (5) LOCKING POINTS FOR PANEL HEIGHTS < 96", (6) LOCKING POINTS FOR PANEL HEIGHTS < 108", (7) LOCKING POINTS FOR PANEL HEIGHTS < 126", (8) LOCKING POINTS FOR PANEL HEIGHTS >= 126"

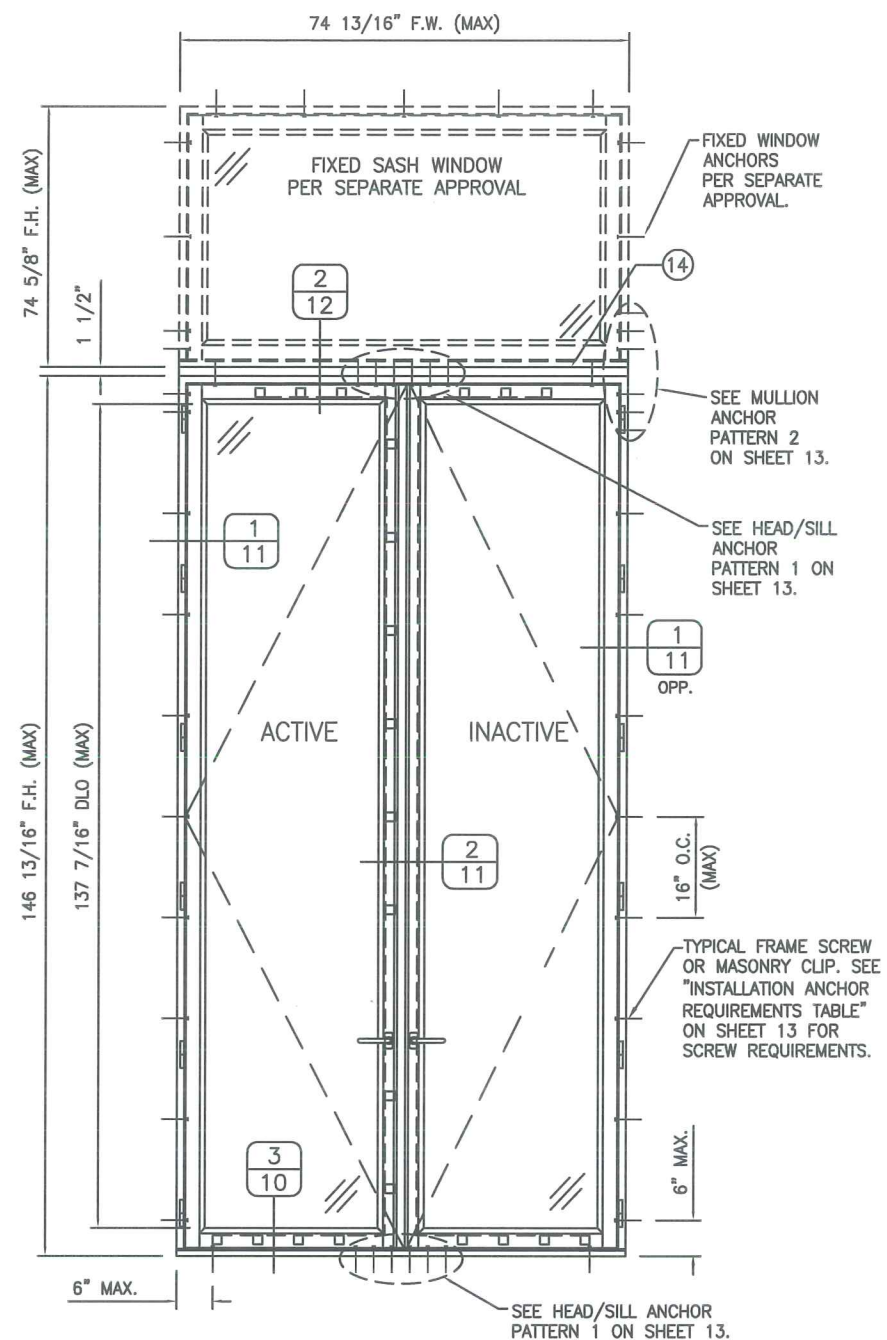


EXTERIOR ELEVATION
DOUBLE WINDOW WITH MULLED TRANSOM

- NOTES:**
1. LOWER DESIGN PRESSURE (DP) FROM TRANSOM OR WINDOWS SHALL CONTROL FOR ENTIRE ASSEMBLY.
 2. (4) OR (6) ANCHORS TO BE PROVIDED AT HORIZONTAL MULLION END. (SEE MULLION PATTERN 2 ON SHEET 13.)

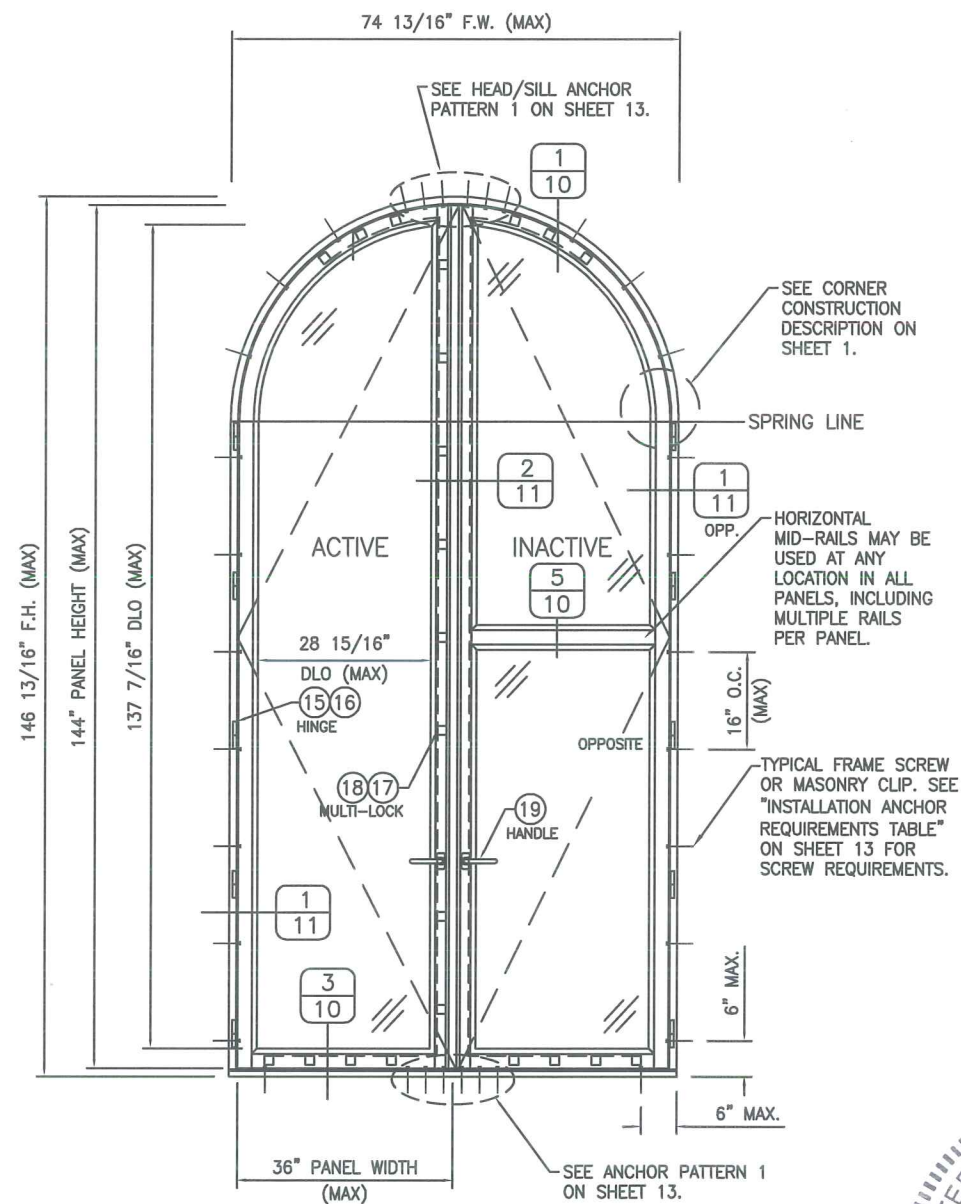

EXTERIOR ELEVATION
DOUBLE HALF ROUND WINDOW

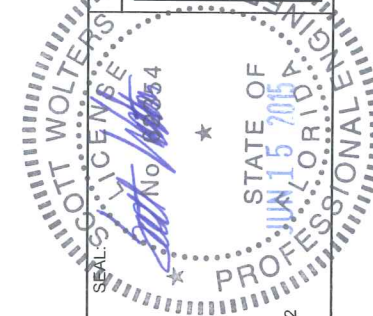

SCOTT WALTERS
FL PE# 62354

WALTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412

DRAWING NO.
CASEMENT WINDOW

SHEET NO.
9 OF 15






12 FT WOOD SLIM EUROPEAN IMPACT OUTSWING CASEMENT WINDOWS

LUXBAUM, LLC
WINDOWS + DOORS

2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409

Ph: (561) 684-1500
www.luxbaum.com

DATE	REVISION DESCRIPTION	NO.
2/26/14		
6/15/15	UPDATED TO 2014 FBC	1

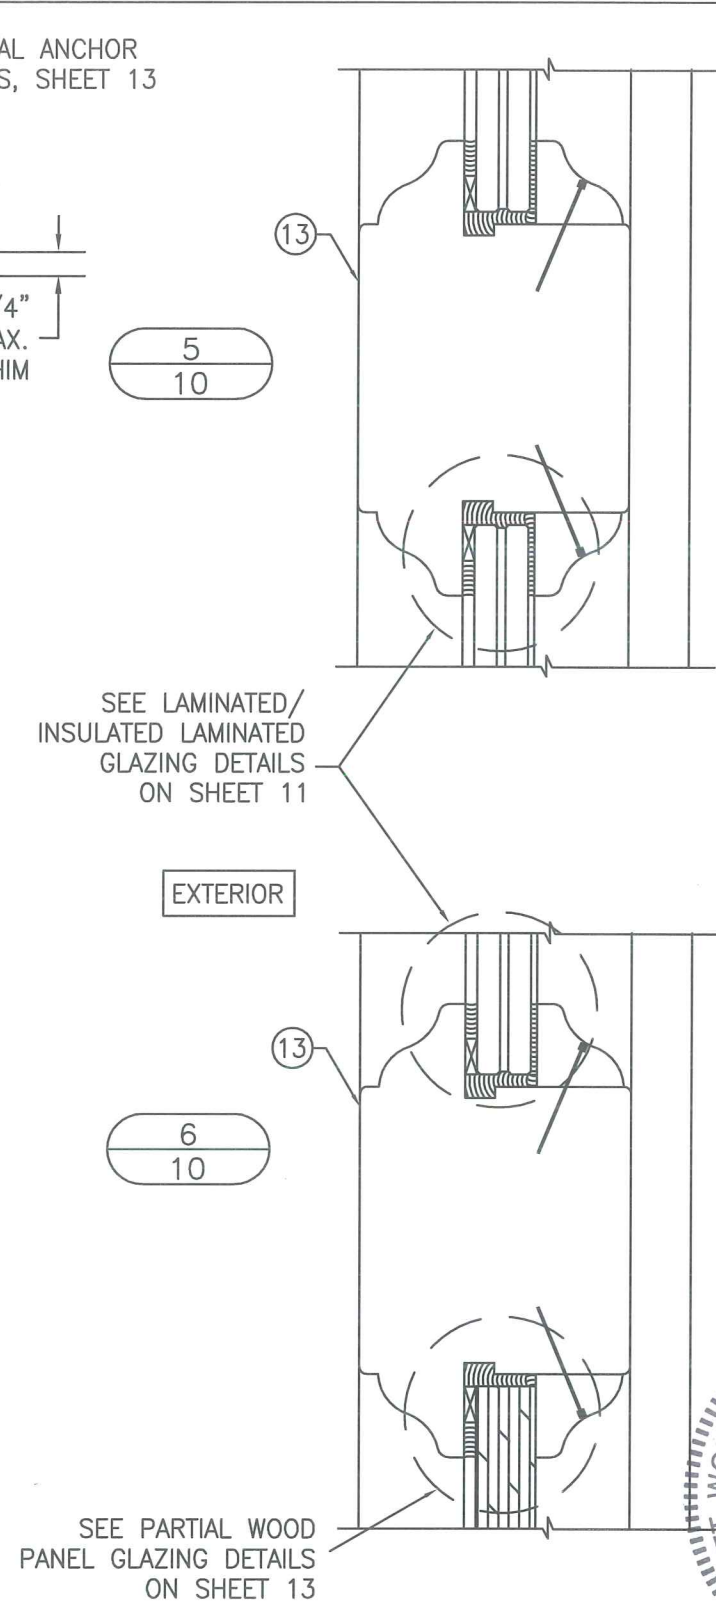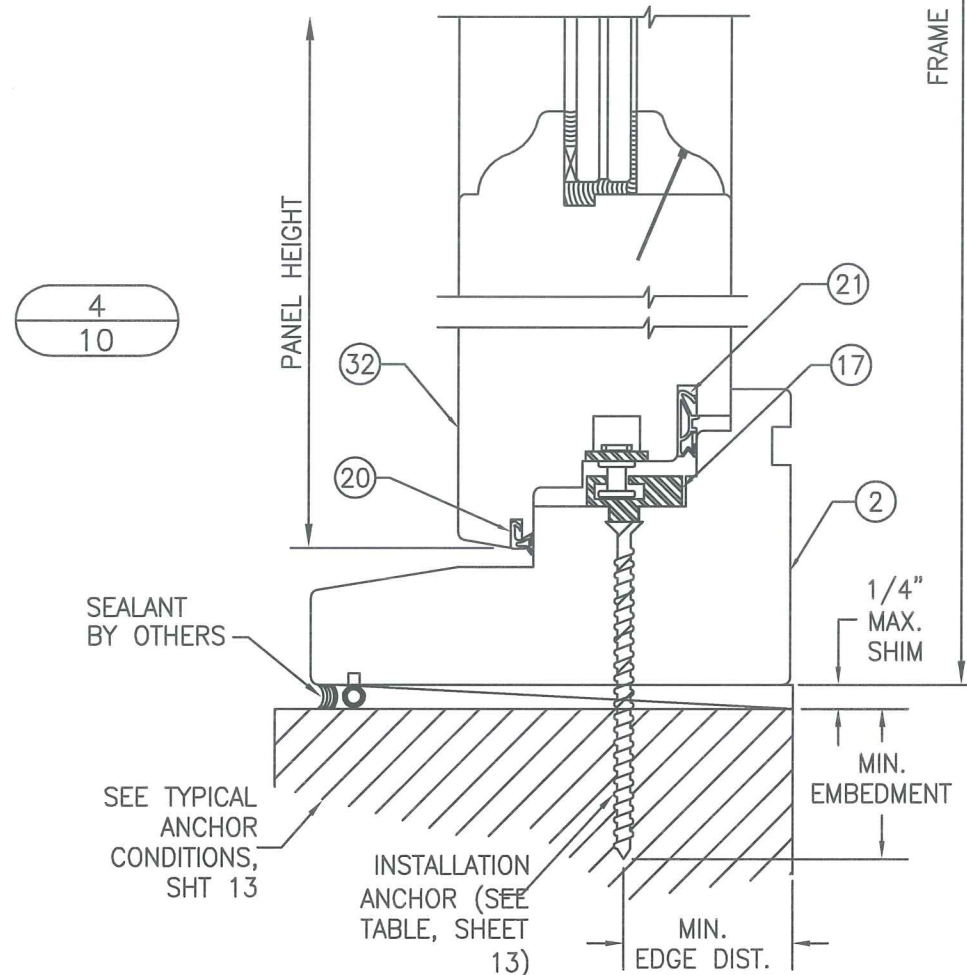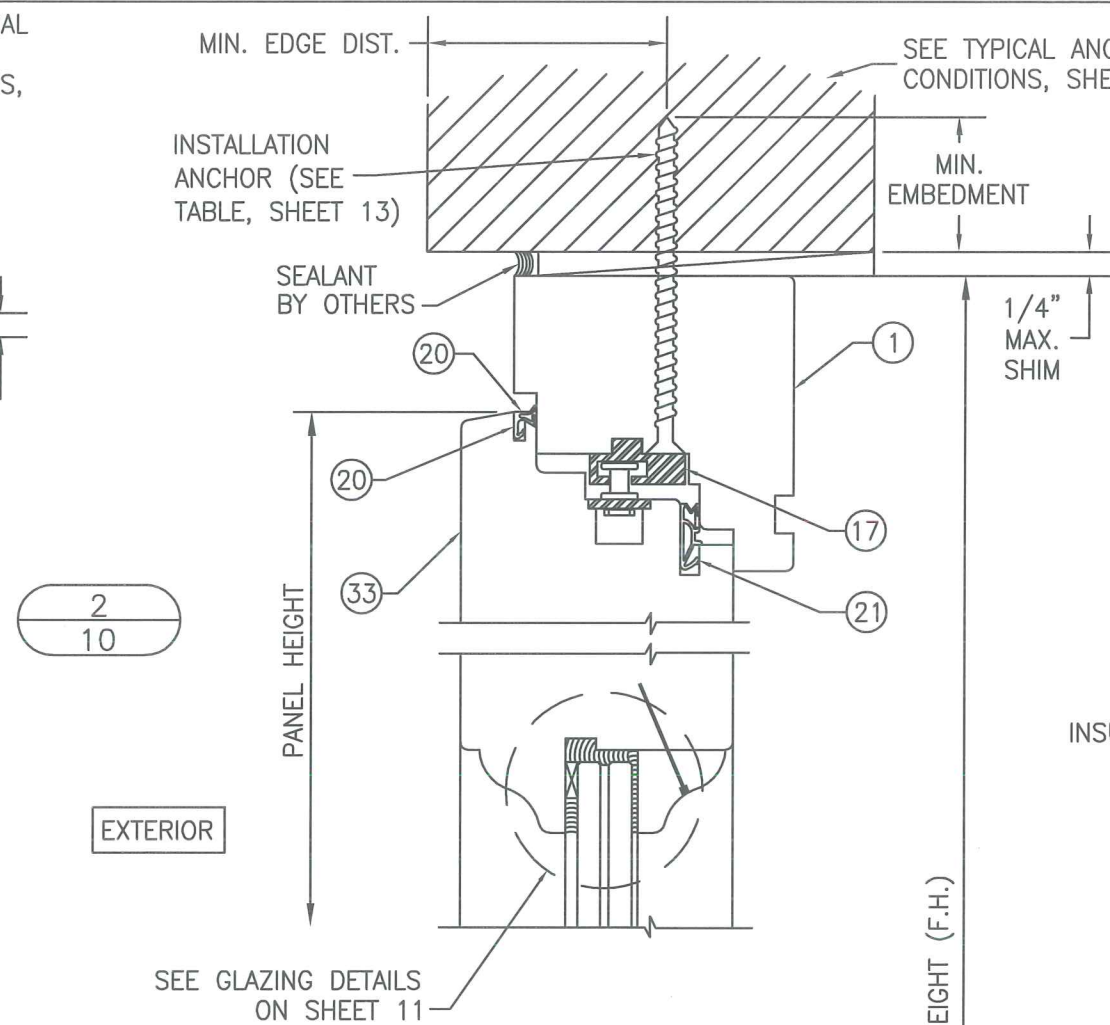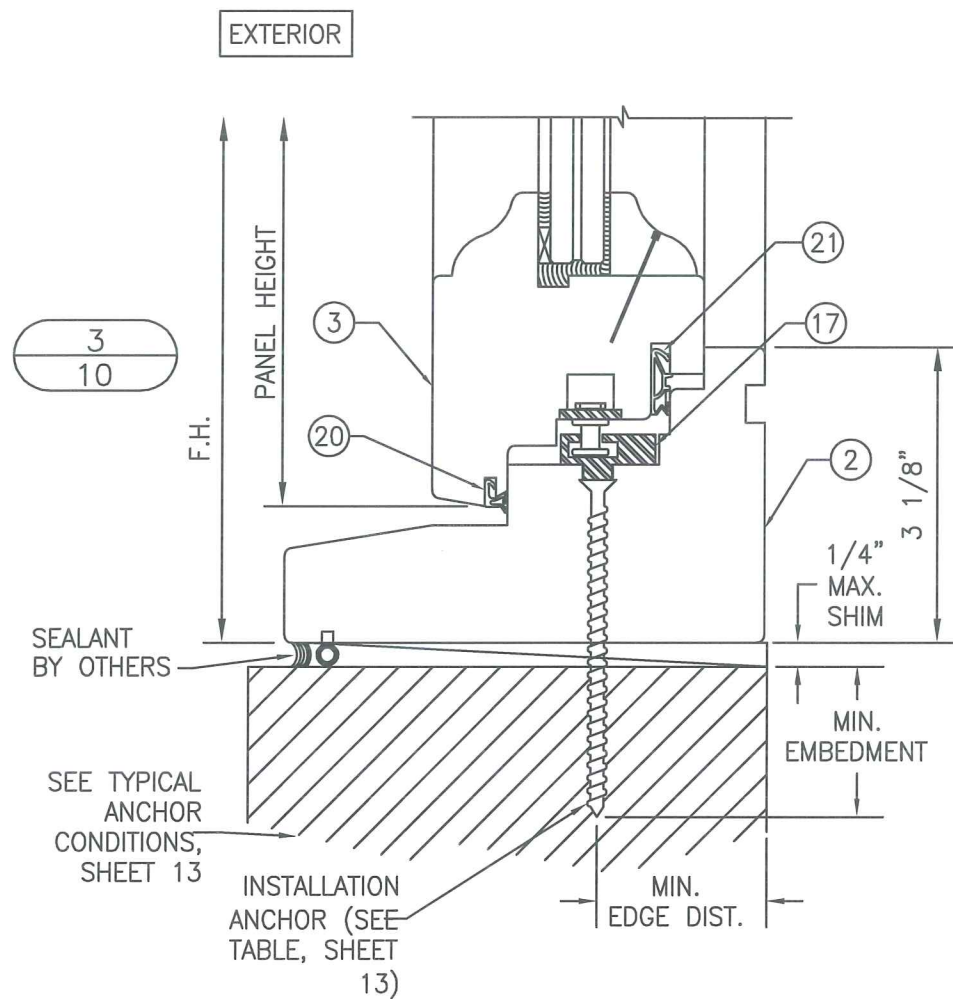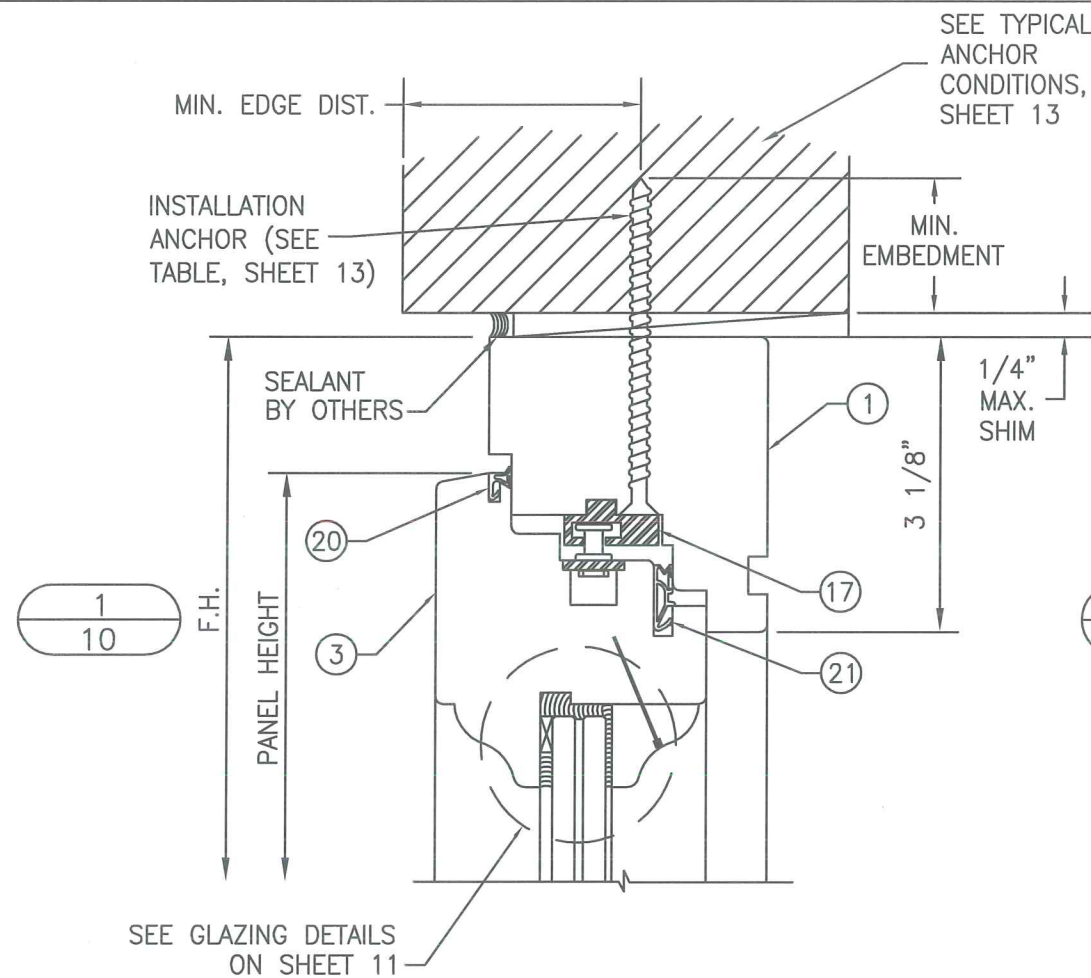

DATE: 2/26/14	
DATE: 6/15/15	REVISION DESCRIPTION: UPDATED TO 2014 FBC
NO. 1	

12 FT EUROPEAN WOOD IMPACT OUTSWING CASEMENT WINDOWS


LUXBAUM LLC
WINDOWS + DOORS
2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409
Ph: (561) 684-1500
www.luxbaum.com

SCOTT WOLTERS
FL PE# 62354


WOLTERS ENGINEERING
(CO.# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412

DRAWING NO. CASEMENT WINDOW

SHEET NO. 10 OF 15

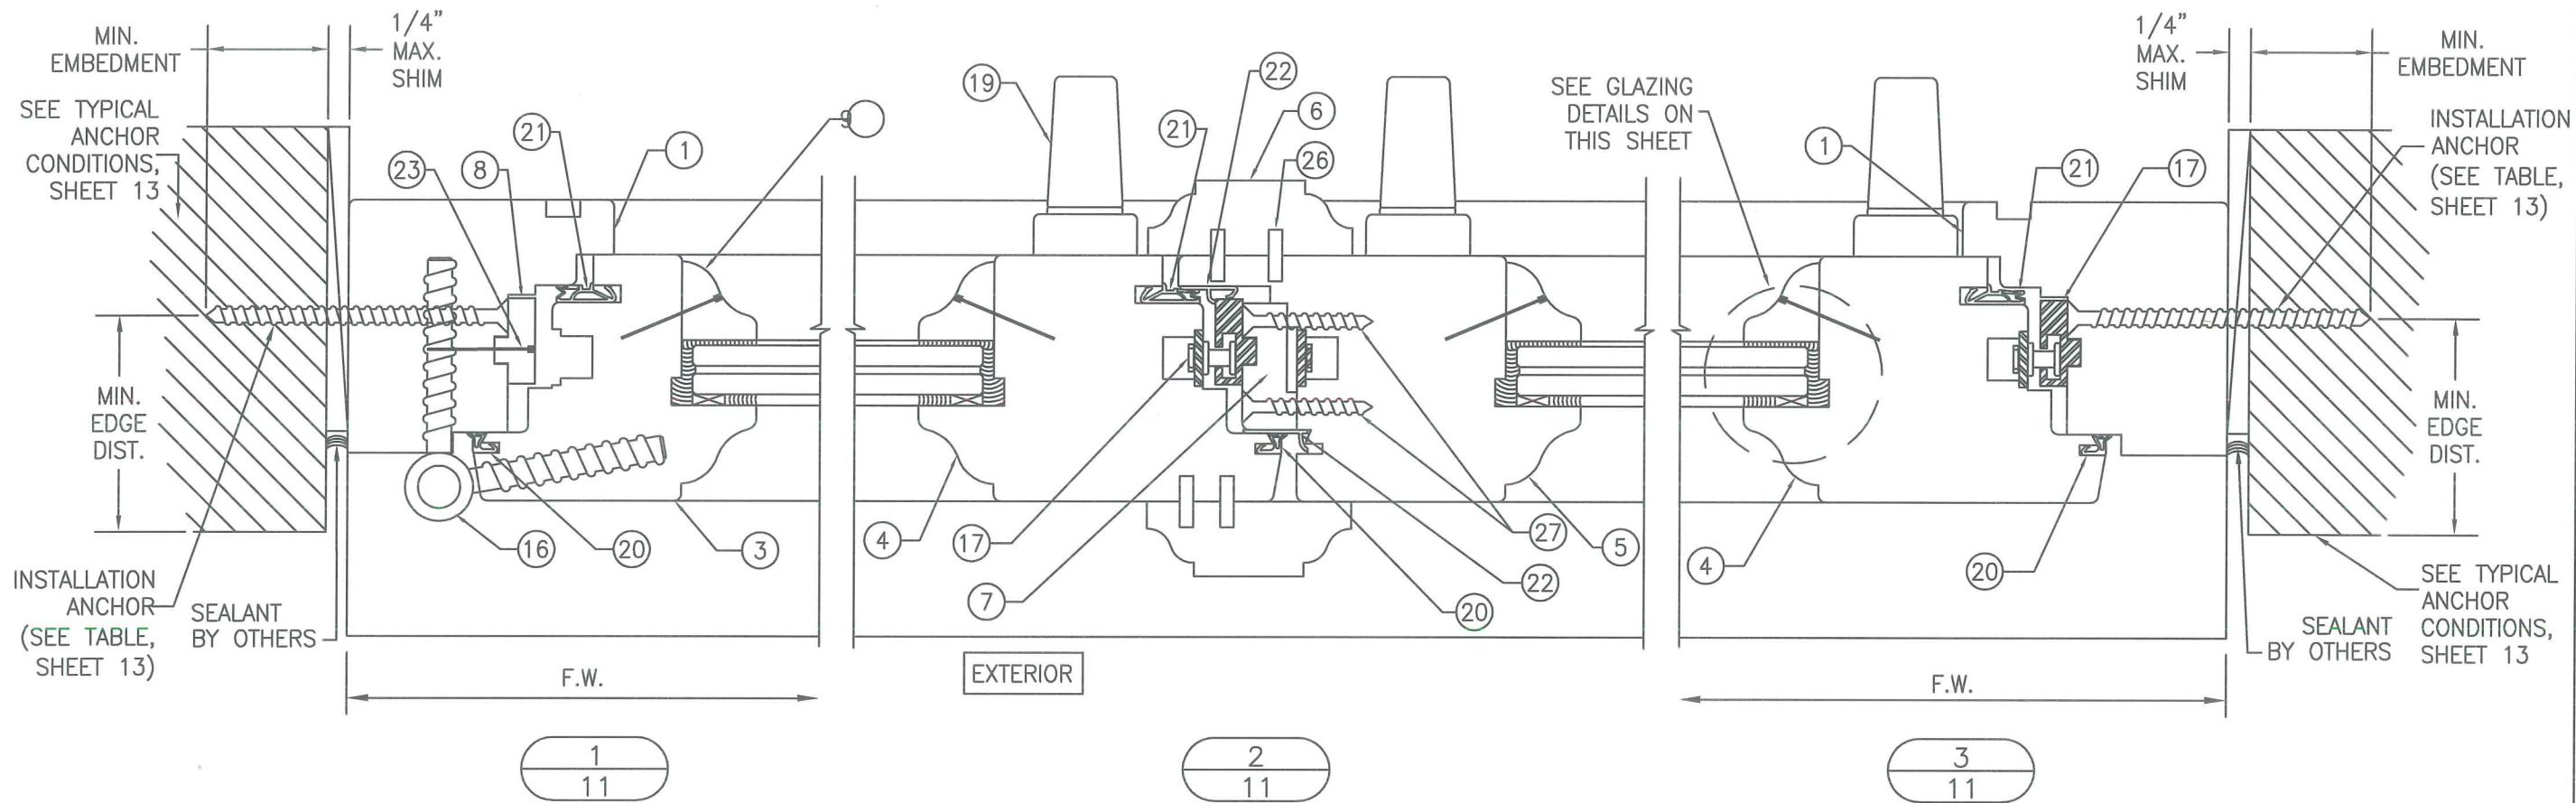


GLAZING DETAILS

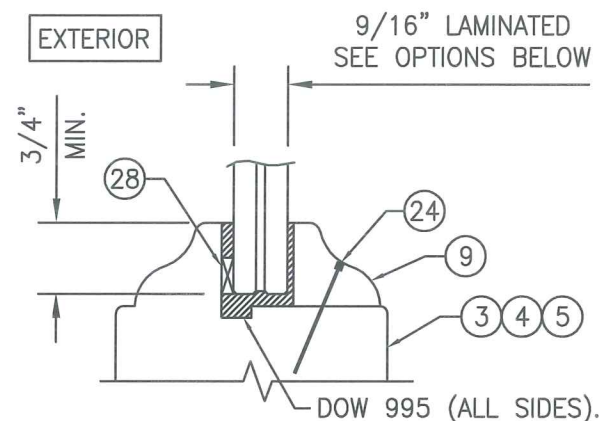


9/16" GLAZING DETAIL

- OPTION 1: 9/16" SAF-GLAS LAMINATED GLASS (1/4" A.N./0.015" ADHESIVE/0.07" POLYCARBONATE/0.015" ADHESIVE/1/4" A.N.)
- OPTION 2: 9/16" SAF-GLAS LAMINATED GLASS (1/4" HT.ST./0.015" ADHESIVE/0.07" POLYCARBONATE/0.015" ADHESIVE/1/4" HT.ST.)
- OPTION 3: 9/16" DUPONT SENTRYGLAS IONOPLAST LAMINATED GLASS (1/4" A.N./0.090" SGP/1/4" A.N.)

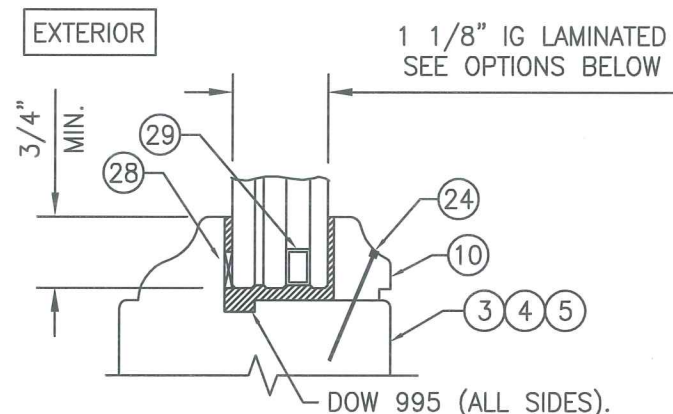

1 1/8" GLAZING DETAIL

- OPTION 4: 1 1/8" I.G. LAMINATED GLASS (3/16" H.S./0.090" SGP/3/16" H.S. EXTERIOR - 1/2" AIR SPACE - 3/16" TEMPERED INTERIOR)
- OPTION 5: 1" I.G. LAMINATED GLASS (1/4" A.N./0.090" SGP/1/4" A.N. EXTERIOR - 1/4" SPACE - 3/16" TEMPERED INTERIOR)

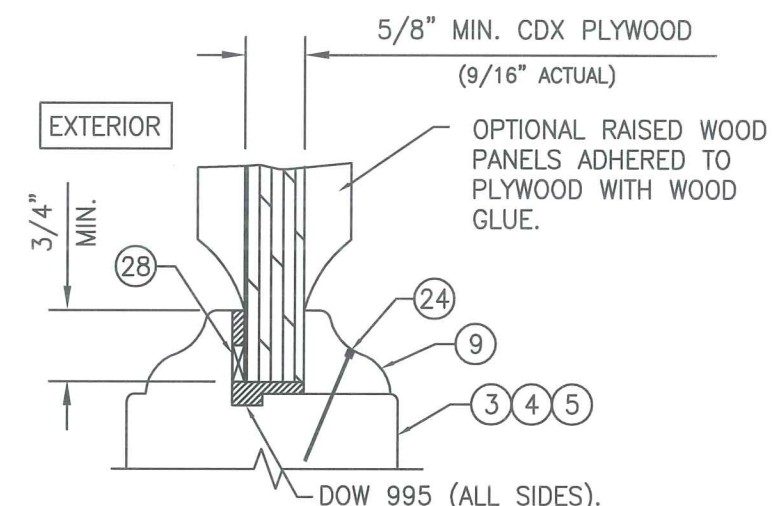

PARTIAL WOOD PANEL DETAIL

DATE: 2/26/14

DATE 6/15/15

REVISION DESCRIPTION


NO. 1

12 FT EUROPEAN WOOD IMPACT OUTSWING CASEMENT WINDOWS

LUXBAUM, LLC
WINDOWS + DOORS

2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409

Ph: (561) 684-1500
www.luxbaum.com



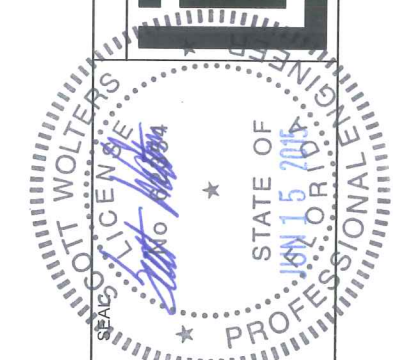


SCOTT WOLTERS
FL PE# 62354


WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412

DRAWING NO.
CASEMENT WINDOW


SHEET NO.
11 OF 15

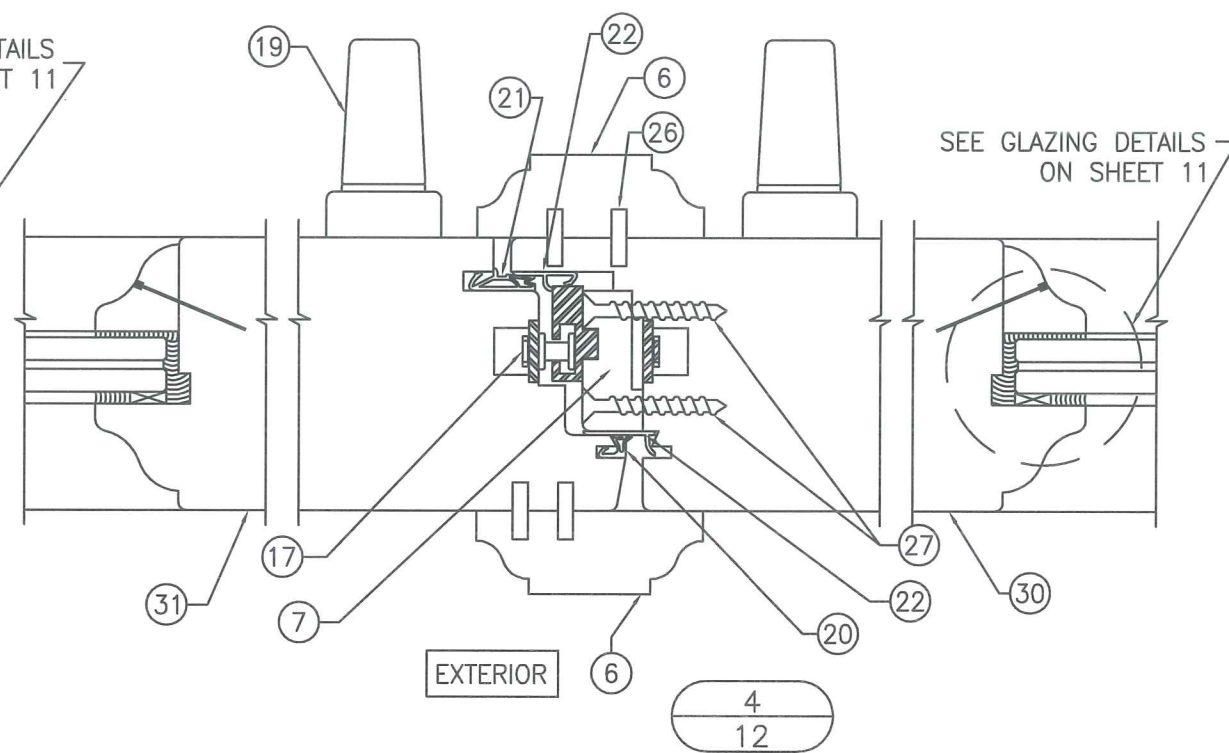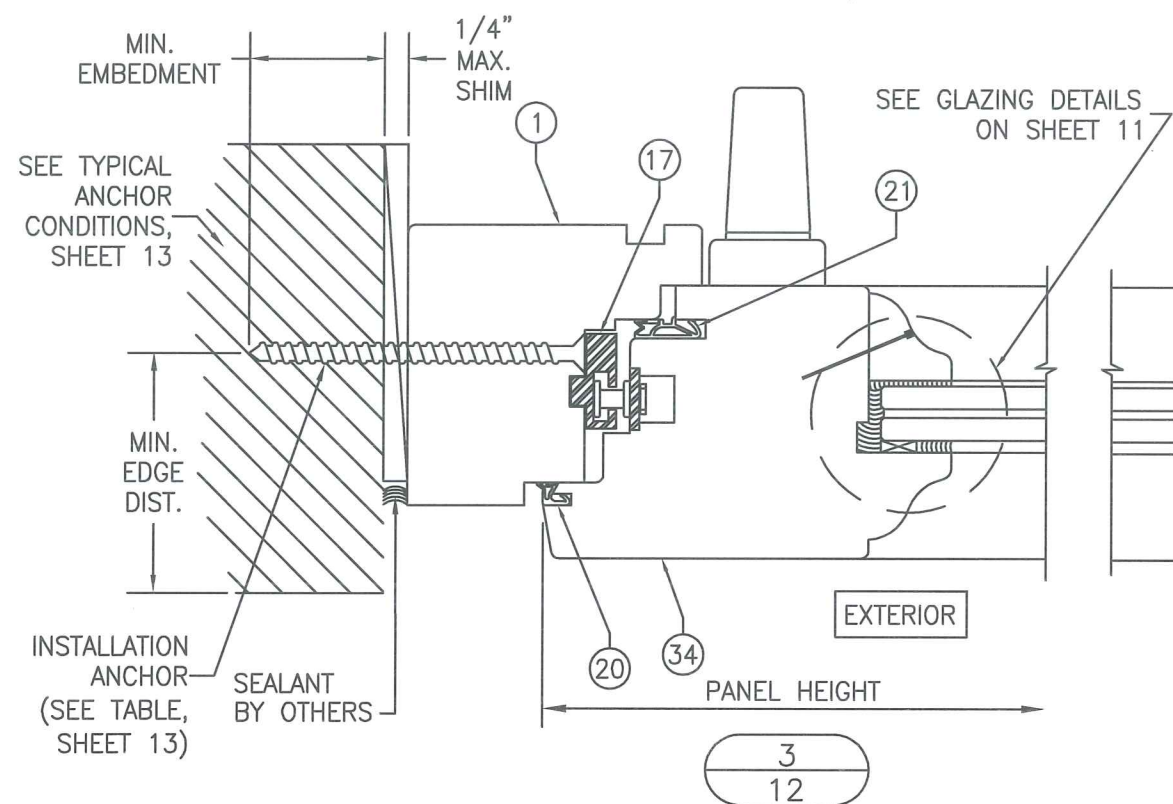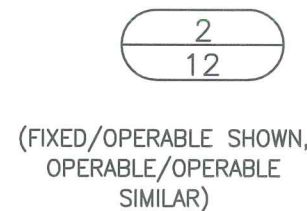


DATE: 2/26/14	
NO. 1	REVISION DESCRIPTION UPDATED TO 2014 FBC
DATE 6/15/15	
12 FT EUROPEAN WOOD IMPACT OUTSWING CASEMENT WINDOWS	
 LUXBAUM WINDOWS + DOORS 2400 CENTREPARK WEST DR, SUITE 150 WEST PALM BEACH, FL 33412 Ph: (561) 684-1500 www.luxbaum.com	
SCOTT WOLTERS FL PE# 62354 WOLTERS ENGINEERING (COA# 27194) 15211 97TH ROAD N WEST PALM BEACH, FL 33412	
DRAWING NO. CASEMENT WINDOW	
SHEET NO. 12 OF 15	

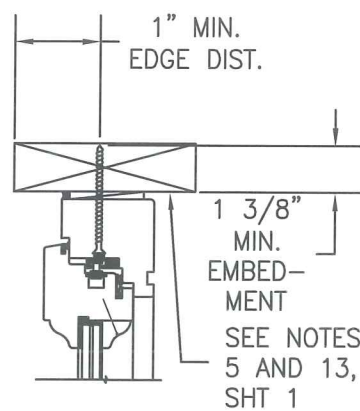


WOOD

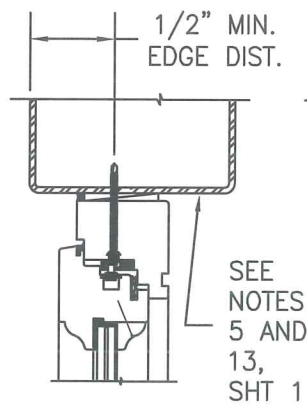


STEEL OR ALUMINUM

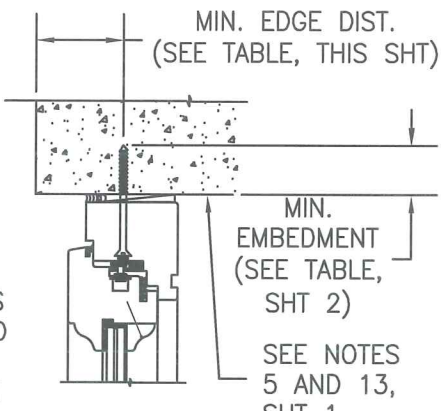

CONCRETE OR CMU

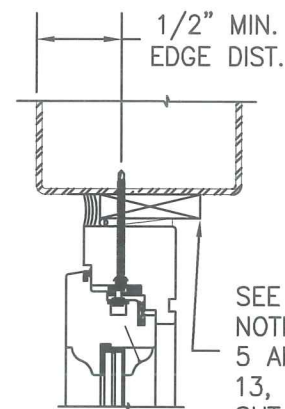


STEEL OR ALUMINUM WITH 1x WOOD BUCK

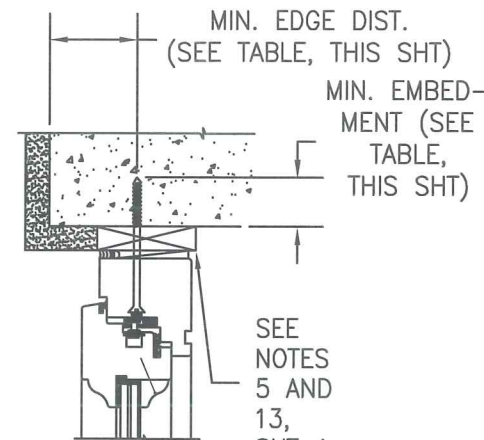


CONCRETE OR CMU WITH 1x WOOD BUCK

TYPICAL ANCHOR CONDITIONS

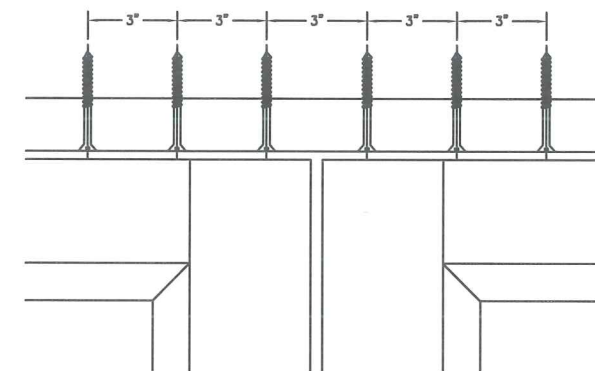


HEAD ANCHOR PATTERN 1
(SILL SIMILAR)

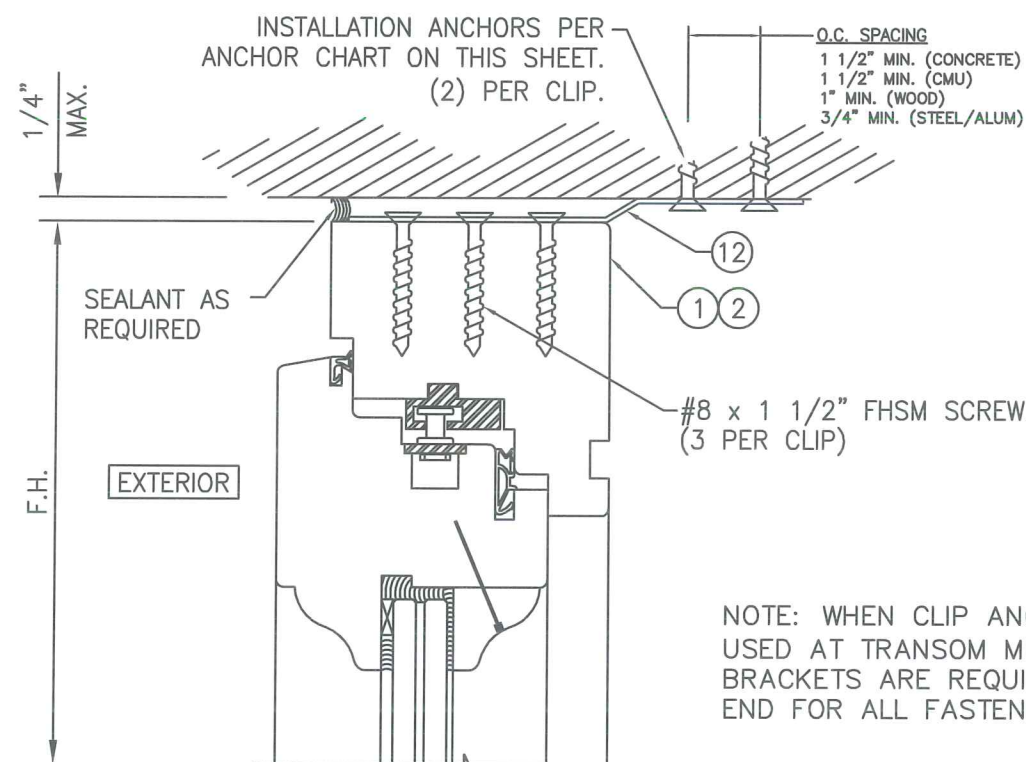


OPTIONAL CLIP ANCHOR DETAIL
(SILL AND JAMBS SIMILAR)

NOTE: WHEN CLIP ANCHORS ARE USED AT TRANSOM MULLIONS, (6) BRACKETS ARE REQUIRED AT EACH END FOR ALL FASTENER TYPES.

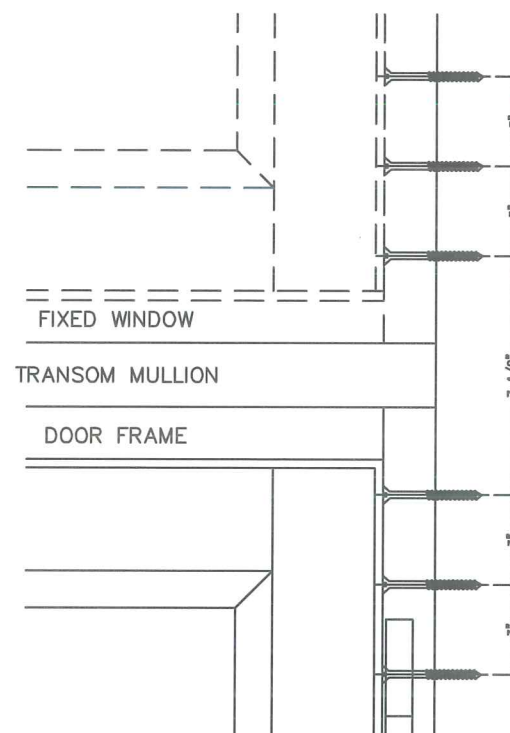

HORIZONTAL MULLION ANCHOR PATTERN 2
(CMU AND WOOD)

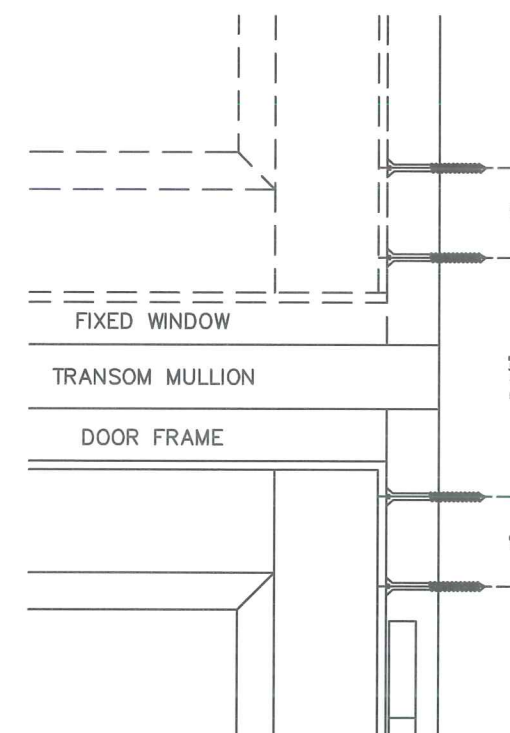

HORIZONTAL MULLION ANCHOR PATTERN 2
(CONCRETE AND METAL)

INSTALLATION ANCHOR REQUIREMENTS TABLE

ID	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE
A	CONCRETE OR GROUT-FILLED CMU (2850 PSI MIN)	1/4" ELCO COATED CARBON STEEL ULTRACON OR AGGRE-GATOR 300S	1 3/4"	2 1/2"
B	CONCRETE OR GROUT-FILLED CMU (2000 PSI MIN)	1/4" ITW COATED CARBON STEEL TAPCON	1 1/2"	3"
C	CONCRETE (3000 PSI MIN)	1/4" ITW 410 STAINLESS TAPCON	1 3/4"	2 1/2"
D	CONCRETE (3000 PSI MIN)	1/4" HILTI COATED CARBON STEEL OR STAINLESS STEEL KWIK-CON II	1"	2 1/2"
E	HOLLOW OR GROUT-FILLED CMU (ASTM C-90)	1/4" HILTI COATED CARBON STEEL OR STAINLESS STEEL KWIK-CON II	1"	2 1/2"

ID	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE
F	2x MIN. SOUTHERN PINE WOOD (G=0.55 MIN)	#12 GRADE 5 WOOD SCREW	1 3/8"	1"
G	16 GAUGE (0.060") MIN. STEEL STUD 33 KSI YIELD MIN.	#12-24 ITW TEKS SELF-DRILLING SCREW	FULL	1/2"
H	1/8" ALUM. 6063-T5 MIN. OR 1/8" STEEL 33 KSI MIN.	#12 GRADE 5 SELF-TAPPING / DRILLING SCREW	FULL	1/2"

DATE: 2/26/14

DATE: 6/15/15


REVISION DESCRIPTION

NO. 1

12 FT EUROPEAN WOOD IMPACT OUTSWING CASEMENT WINDOWS


LUXBAUM, LLC
WINDOWS + DOORS

2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409
Ph: (561) 684-1500
www.luxbaum.com

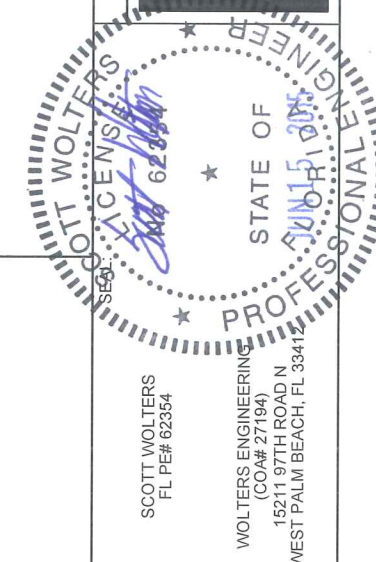


DRAWING NO.
CASEMENT WINDOW


SHEET NO.
13 OF 15

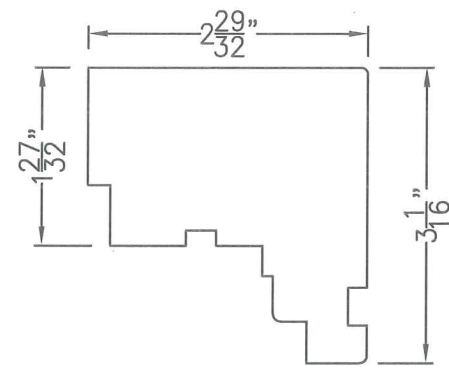

① HEAD & SIDE JAMB

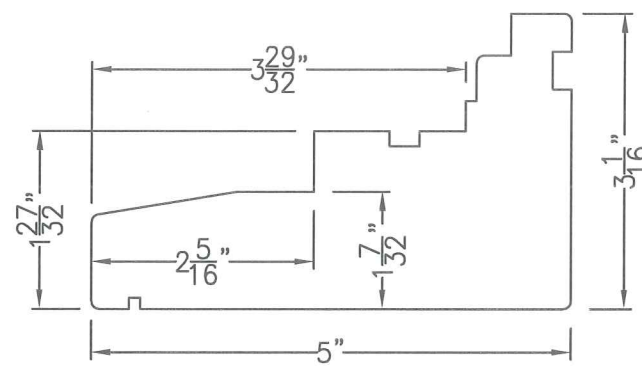


② SILL JAMB

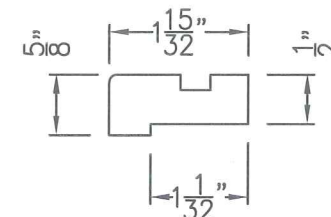


⑦ FILLET (MEETING STILE)


MERBAU WOOD: S.G. = 0.68
E = 2.6 x 10 psi
Sy = 21,300 psi
Fb = 12,780 psi

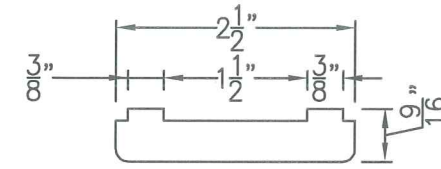


③5 MULLION CAP

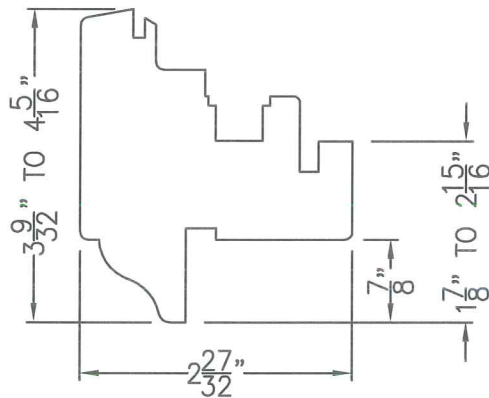


③ RAIL & STILE

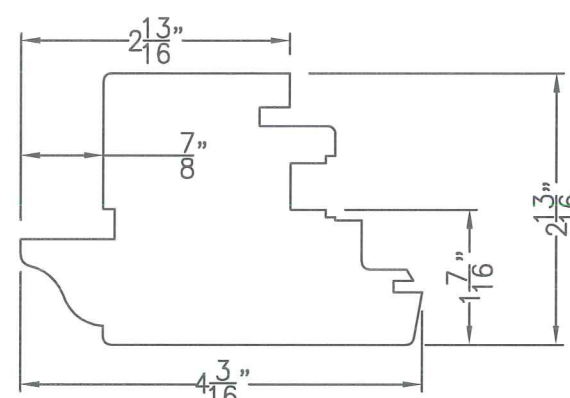


④ ACTIVE MEETING STILE




⑧ FILLET




⑥ ASTRAGAL

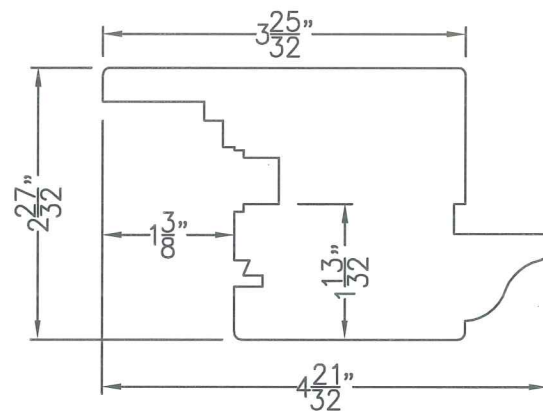


⑤ INACTIVE MEETING STILE

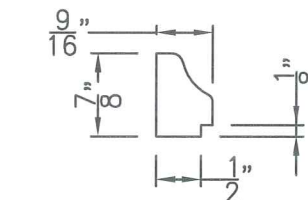

⑩ INSULATED GLASS STOP




⑨ GLASS/PANEL STOP

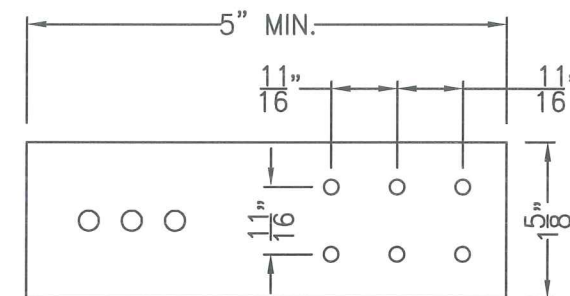


⑫ MOUNTING CLIP


THICKNESS = 0.060"

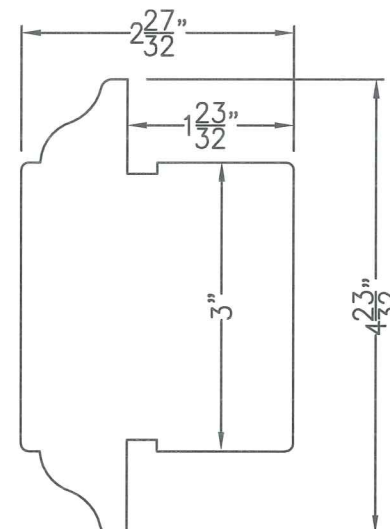

⑬ MID RAIL

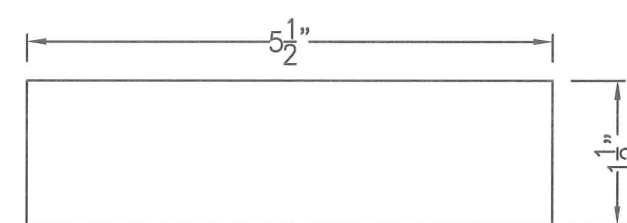

⑭ HORIZONTAL MULLION
(L = TRANSOM F.W.)

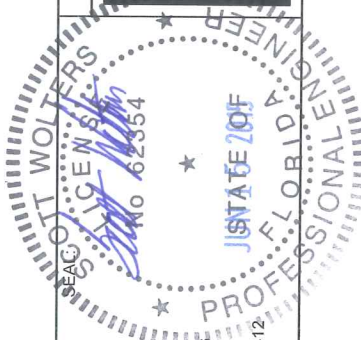

SCOTT WOLTERS
FL PE# 62354
WOLTERS ENGINEERING
(CO.# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412

DRAWING NO.
CASEMENT WINDOW






SHEET NO.
14 OF 15

12 FT EUROPEAN WOOD IMPACT OUTSWING CASEMENT WINDOWS


LUXBAUM, LLC
WINDOWS + DOORS
2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409
Ph: (561) 684-1500
www.luxbaum.com

DATE: 2/26/14

NO.	REVISION DESCRIPTION	DATE
1	UPDATED TO 2014 FBC	6/15/15

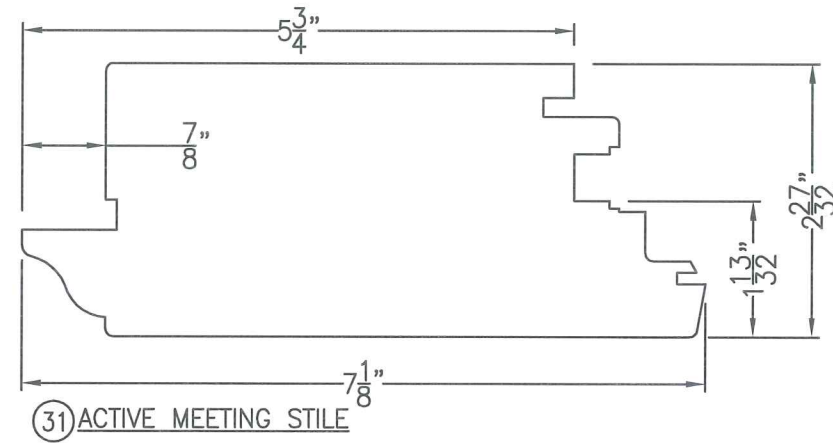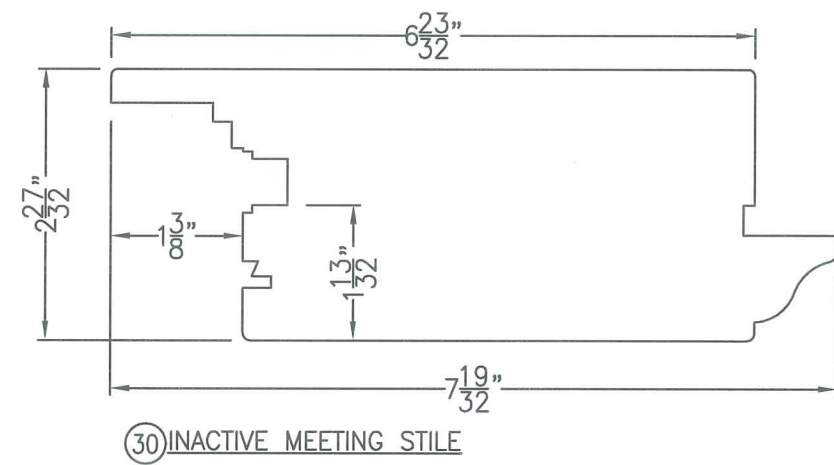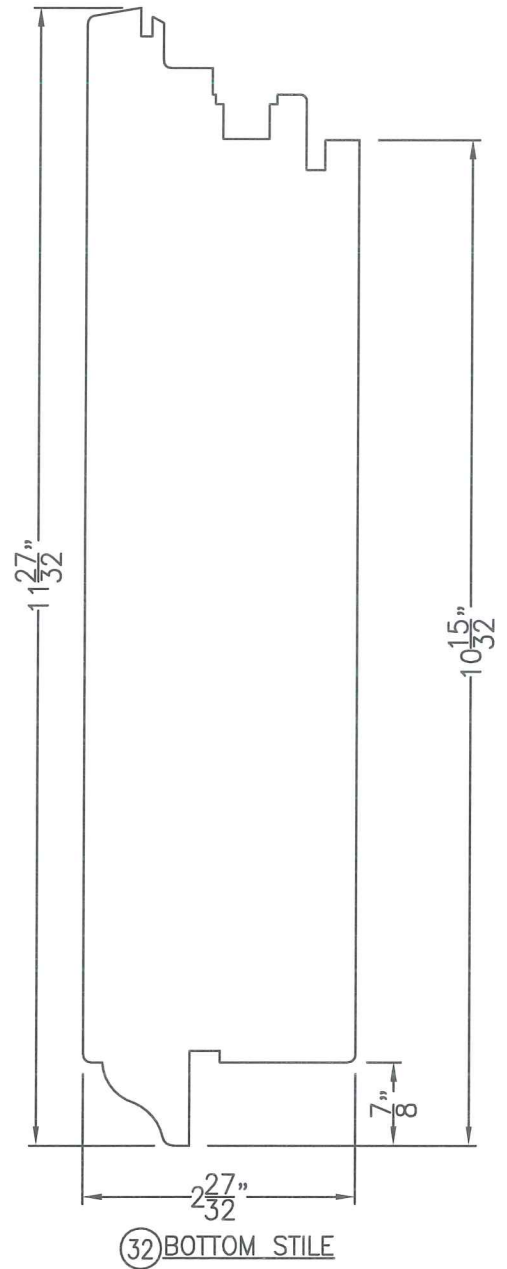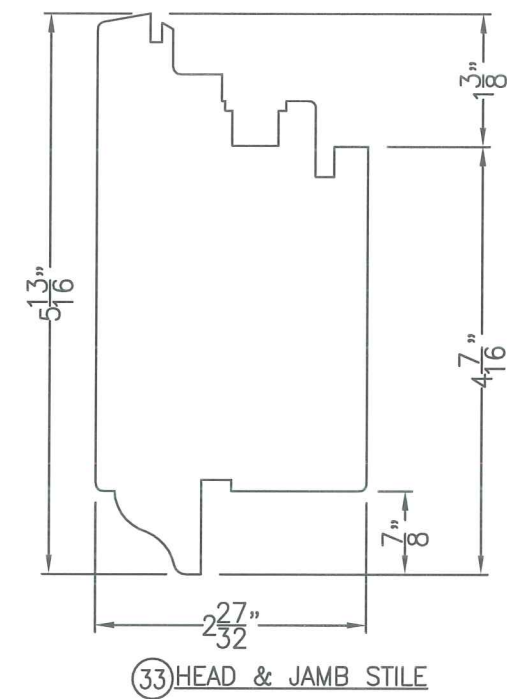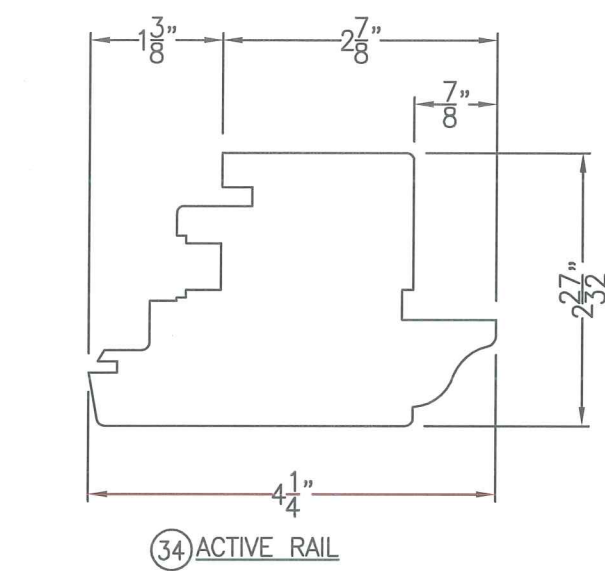

ITEM #	PART	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS			
1	7478	HEAD & SIDE JAMB	MERBAU
2	78127	SILL JAMB	MERBAU
3	7283	RAIL & STILE (LARGE P/N 72109)	MERBAU
4	72106	ACTIVE MEETING STILE	MERBAU
5	72118	INACTIVE MEETING STILE	MERBAU
6	2260	ASTRAGAL	MERBAU
7	1637	FILLET (MEETING STILE)	MERBAU
8	1625	SPACER/FILLET	MERBAU
9	2223	GLASS/PANEL STOP	MERBAU
10	1522	GLASS STOP (I.G. GLASS)	MERBAU
12	-	MOUNTING CLIP	0.045" 316 STAINLESS STEEL (50 ksi)
13	72105	MID RAIL	MERBAU
14	-	MULLION (5 1/2" X 1 1/2")	MERBAU
30	72193	INACTIVE MEETING STILE	MERBAU
31	72181	ACTIVE MEETING STILE	MERBAU
32	72301	BOTTOM STILE	MERBAU
33	72148	HEAD & JAMB STILE	MERBAU
34	72109	ACTIVE RAIL (HANDLE SIDE)	MERBAU
35	1464	MULLION CAP	MERBAU
HARDWARE			
15	-	HINGE	G-U HARDWARE 5020-SM
16	-	ALT. HINGE	BAKA C2-20
17	-	MULTI-POINT LOCK SET	SIEGENIA NO. 3/45M5 / 3/50M5
18	-	MULTI-POINT LOCK SET	G-U HARDWARE HWC-35 / HWC-40
19	-	HANDLE	AS REQUIRED TO OPERATE LOCKS
SEALS AND SEALANTS			
20	-	COMPRESSION SEAL	DEVENTER SV33
21	-	COMPRESSION SEAL	DEVENTER SV12
22	-	COMPRESSION SEAL	DEVENTER S6544
MISCELLANEOUS FASTENERS			
23	-	23 GAGE BRAD NAIL	4" FROM ENDS & 14" O.C.
24	-	23 GAGE BRAD NAIL	2" FROM CORNERS & 4" O.C.
25	-	NO. 12 X 3 1/2" SMS	4" FROM CORNERS & 12" O.C.
26	-	NO. 0 BISCUIT	4" FROM ENDS & 14" O.C.
27	-	NO. 8 X 1 1/2" SMS	4" FROM ENDS & 14" O.C. (2 ROWS)
28	-	1/16" X 1/4" NEOPRENE SHIM	1" FROM CORNERS & 8" O.C.
29	-	ALUMINUM INS. GLASS SPACER	CARDINAL I.G.

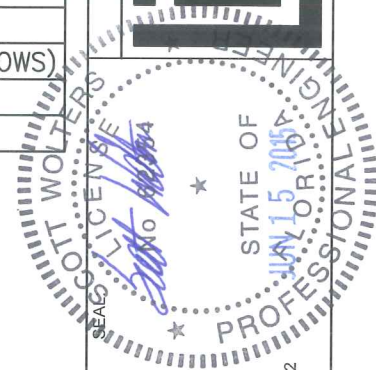

DATE: 2/26/14

DATE: 6/15/15

REVISION DESCRIPTION: UPDATED TO 2014 FBC

NO. 1

12 FT EUROPEAN WOOD IMPACT OUTSWING CASEMENT WINDOWS

LUXBAUM LLC
WINDOWS + DOORS
2400 CENTREPARK WEST DR, SUITE 150
WEST PALM BEACH, FL 33409
Ph: (561) 684-1500
www.luxbaum.com

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412

DRAWING NO. CASEMENT WINDOW

SHEET NO. 15 OF 15