

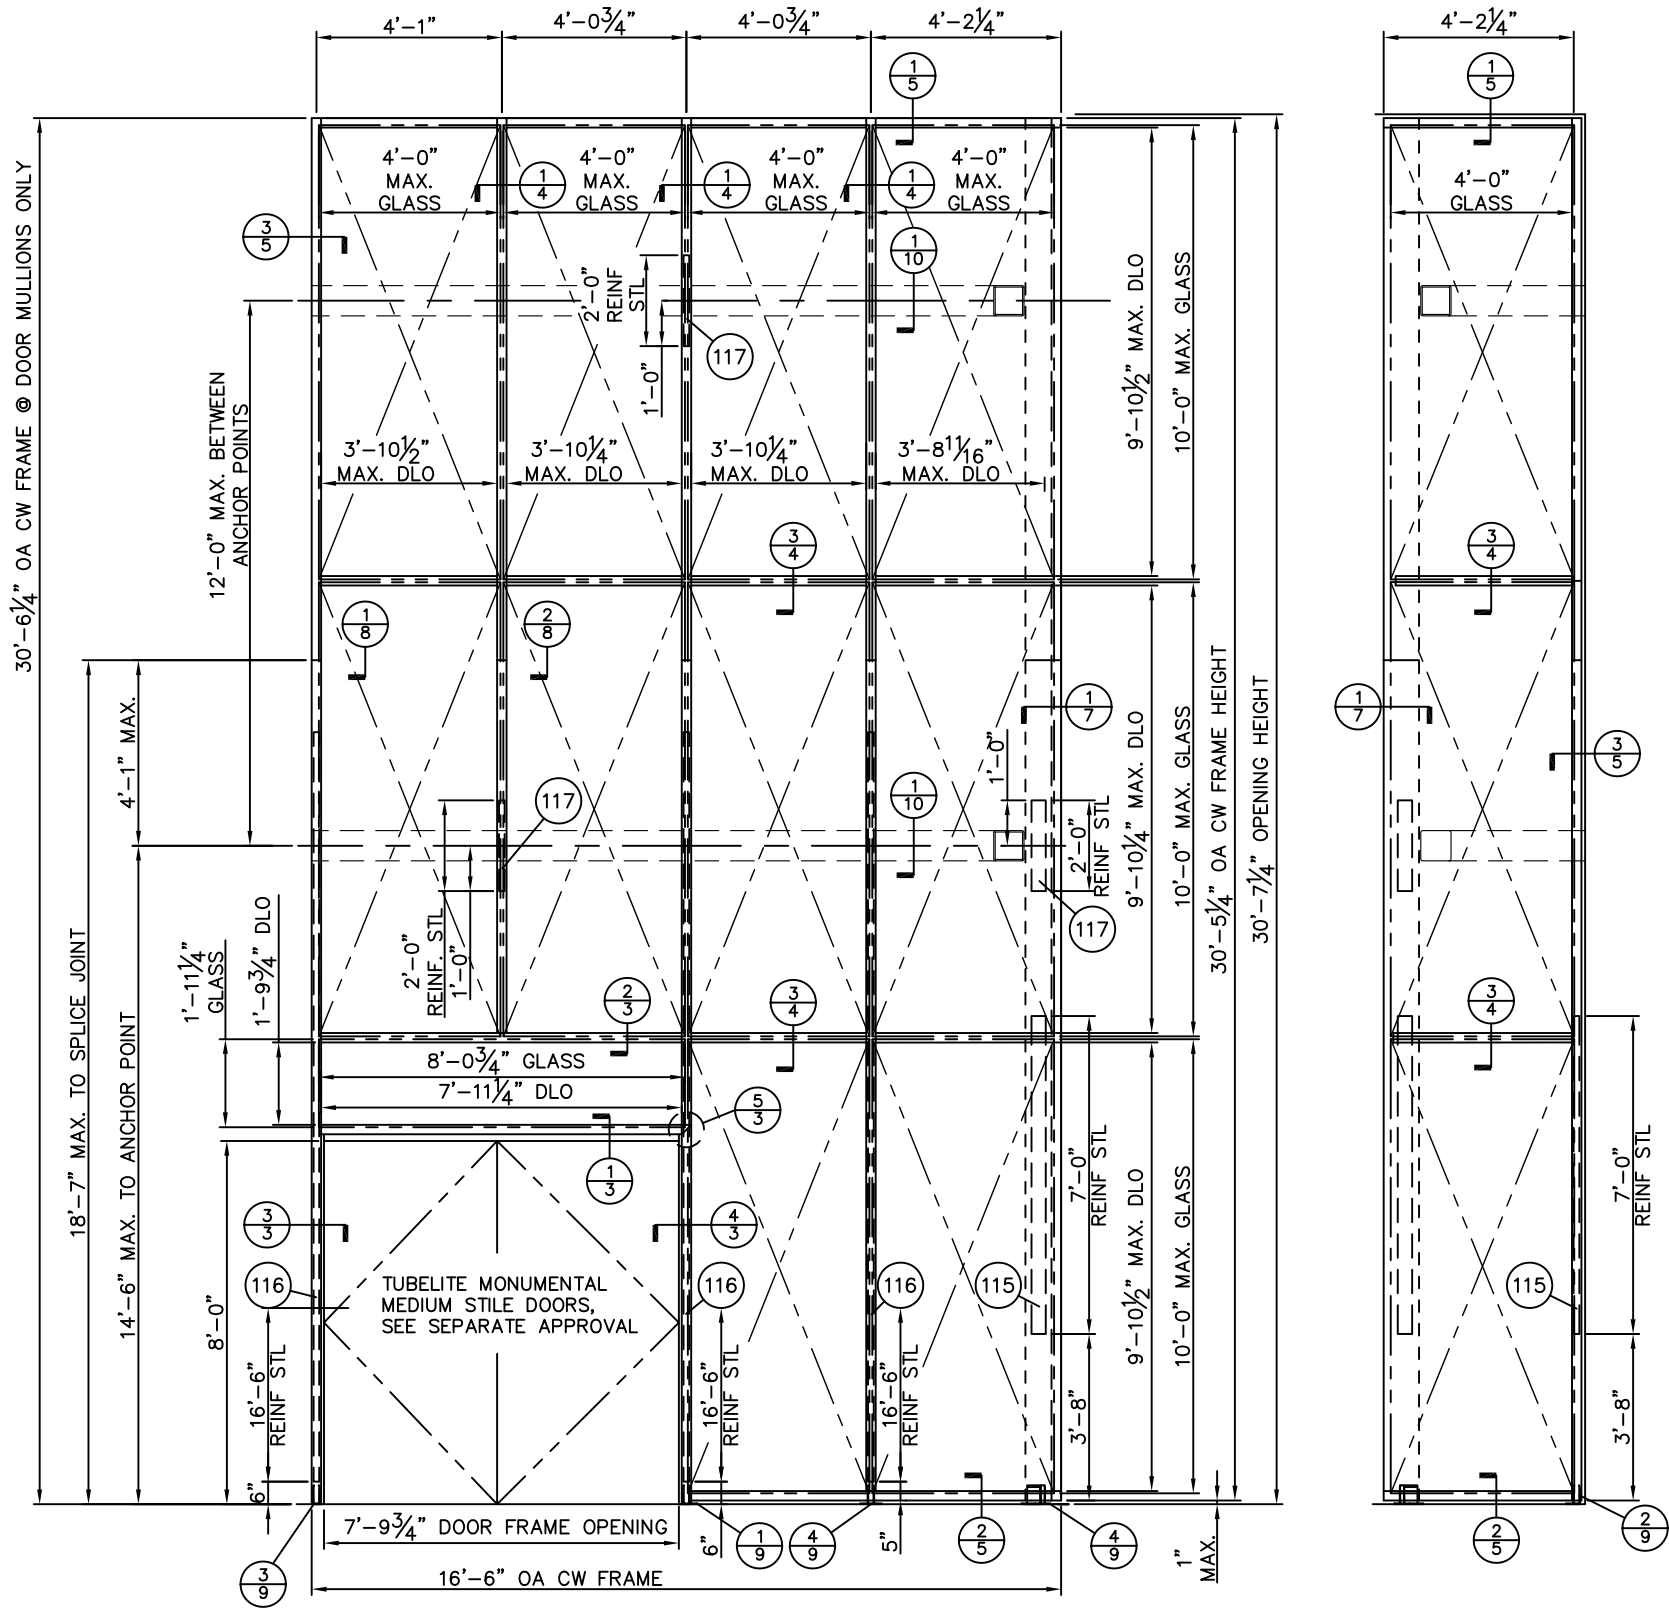


TABLE OF CONTENTS:

SHTS	CONTENT
1	NOTES, TWIN-SPAN ELEVATION
2	SINGLE-SPAN ELEV., GLAZING, ANCHORS
3-7	SECTION DETAILS
8	SPLICE JOINT
9-10	ANCHOR DETAILS
11-12	ASSEMBLY DETAILS
13	PART DRAWINGS
14	PART DWGS, BILL OF MATERIALS

E1	TWIN-SPAN ELEVATION
1	SEE DP CHART, TABLE A

TABLE A. ELEV. E1/1 DESIGN PRESSURE CHART (PSF)

MAX. GLASS WIDTH	GLASS HEIGHT	
	45" & Under	120" & Under
		+/-63.3
	48"	+/-60



10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320

GENERAL NOTES

1. THIS CURTAIN WALL SYSTEM HAS BEEN TESTED TO ASTM E283, ASTM E330, ASTM E331, AAMA 501.1/501.4/501.5, AND TAS 202, AND MEETS THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC), CURRENT EDITION, INCLUDING THE HIGH VELOCITY HURRICANE ZONE.
2. THE INSTALLED CURTAIN WALL SYSTEM SHALL BE FABRICATED, GLAZED, AND ANCHORED IN ACCORDANCE WITH THIS DRAWING AS WELL AS THE APPLICABLE TEST REPORTS. A FLORIDA LICENSED ENGINEER FAMILIAR WITH CURTAIN WALL DESIGN SHALL APPROVE SHOP DRAWINGS FOR EACH PROJECT, AND THIS ENGINEER OF RECORD SHALL TAKE FULL RESPONSIBILITY FOR THE INSTALLED SYSTEM DESIGN AS A WHOLE WHILE MAKING SURE THAT THE LIMITATIONS INDICATED IN THIS DRAWING HAVE NOT BEEN EXCEEDED.
3. THIS DRAWING INDICATES VARIOUS APPROVED GLAZING METHODS AND FRAMING TYPES WHICH MAY BE USED SINGLY OR IN COMBINATION FOR EACH PROJECT. ANY NUMBER OF PANELS MAY BE USED HORIZONTALLY PROVIDED THE MAXIMUM DLO SIZES AS INDICATED IN THIS DRAWING ARE NOT EXCEEDED.
4. THIS PRODUCT IS NON-IMPACT AND REQUIRES THE USE OF APPROVED IMPACT PROTECTIVE DEVICES IN WINDBORNE DEBRIS AREAS.
5. REQUIRED DESIGN PRESSURES SHALL BE DETERMINED FOR EACH PROJECT IN ACCORDANCE WITH APPLICABLE CODE REQUIREMENTS AND GOVERNING WIND SPEEDS FOR THE PROJECT LOCATION.
6. THE ALLOWABLE DESIGN PRESSURE RATINGS IN THIS DRAWING ARE AS LIMITED BY ASTM E-1300 GLASS TABLES, TESTING, AND CALCULATIONS.
7. DISSIMILAR MATERIALS THAT COME INTO CONTACT, INCLUDING BUT NOT LIMITED TO FASTENERS IN CONTACT WITH PRESSURE TREATED WOOD SUBSTRATES OR ALUMINUM, SHALL BE COATED OR OTHERWISE PROTECTED PER FBC REQUIREMENTS TO PREVENT CORROSION OR GALVANIC REACTIONS.
8. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER INFILTRATION RESISTANCE OF THE INSTALLED PRODUCT ARE NOT WITHIN THE SCOPE OF THIS APPROVAL AND SHALL BE THE RESPONSIBILITY OF OTHERS.
9. THE 4/3 ALLOWABLE STRESS INCREASE HAS NOT BEEN USED IN THE ANCHOR ANALYSIS FOR THIS SYSTEM. THE 1.6 Cd FACTOR WAS USED IN THE ANALYSIS OF WOOD SUBSTRATE.
10. STRUCTURAL INTEGRITY OF SUBSTRATE MATERIALS TO RECEIVE THE LOADS FROM THIS PRODUCT, TO BE VERIFIED BY OTHERS OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.
11. THIS PRODUCT SHALL BE INSTALLED USING ONE OF THE APPROVED FASTENING OR WELDING METHODS INDICATED IN THIS DRAWING, AS APPROPRIATE FOR THE SUBSTRATE TYPE. WELD SIZES AND LOCATIONS FOR INTERMEDIATE ANCHORS SHALL BE AS INDICATED IN THE DETAILS FOR EACH CLIP TYPE, AND FOR U, F, AND T-ANCHORS THE ANCHOR SIZE, EMBEDMENT, EDGE DISTANCE, AND PATTERN WITHIN THE CLIP SHALL BE IN ACCORDANCE WITH TABLE D, SHEET 2, AND APPLICABLE DETAILS.
12. MINIMUM ANCHOR EMBEDMENTS LISTED IN THIS DRAWING SHALL BE BEYOND WALL DRESSING OR STUCCO AND FULLY INTO SUBSTRATE.
13. SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS AS SHOWN IN TABLE D, SHEET 2. CONCRETE SUBSTRATES SHALL NOT BE CRACKED.

TUBELITE
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
WALKER, MICHIGAN 49544
PH: 800.866.2227
FX: 616.501.0008
WEB SITE: WWW.TUBELITEINC.COM

REVISION HISTORY:

REV	DATE	DRAWN	DESCRIPTION
O	5.7.14	LT	ORIGINAL RELEASE
A	2.26.15	LT	ANCHOR REVISIONS
B	10.26.20	LT	FBC CODE UPDATE

DATE: 05.07.14

DRAWING NUMBER:
FPA-400-SSG-NI

DRAWN:

FINAL REVIEW:


SCALE: N.T.S.

REVISION: B

SHEET NAME:

NOTES,
ELEVATION

SHEET: 1 OF 14

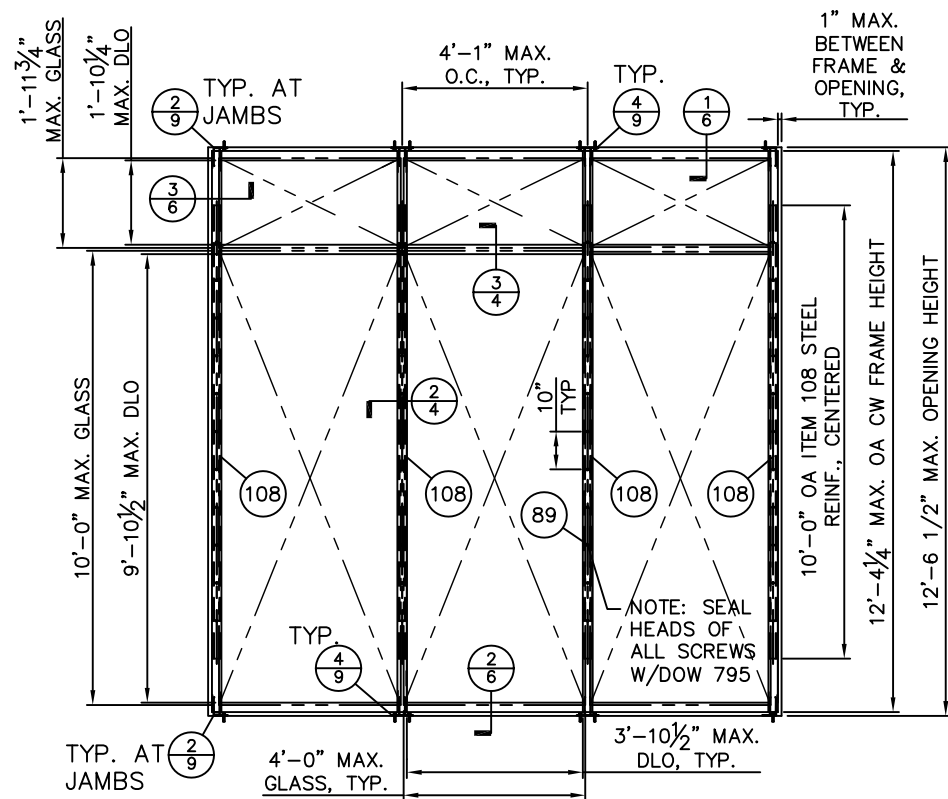

E3
2 **SINGLE-SPAN ELEVATION**
SEE DP CHART, TABLE C


TABLE C. ELEV. E3/2 DESIGN PRESSURE CHART (PSF)

MAX. GLASS WIDTH	FRAME HEIGHT 148-1/4" & Under	FRAME HEIGHT 112" & Under
32" & Under	+72/-80	
36"	+72/-78	
42"	+/-68.5	
48"	+/-60	

TABLE D. QUALIFIED ANCHOR INFORMATION

ID	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE
A	SOLID UNCRACKED CONCRETE (3000 PSI MIN)	3/8" HILTI KWIK BOLT 3 CARBON OR STAINLESS STEEL, MAY BE USED ALL LOCATIONS, REQUIRED AT DET. 1/9 FOR CONCRETE INSTALL	2 1/2"	3"
B	SOLID UNCRACKED CONCRETE (3000 PSI MIN)	1/2" ITW RED HEAD LDT CARBON OR STAINLESS STEEL, MAY BE USED ALL LOCATIONS EXCEPT DET. 1/9	3 1/2"	3"
C	SOUTHERN PINE WOOD (G=0.55 MIN)	3/8" GRADE 5 LAG SCREW, MAY BE USED ALL LOCATIONS EXCEPT DET. 1/9	2 1/2"	1 1/2"
D	SOUTHERN PINE WOOD (G=0.55 MIN)	1/2" GRADE 5 LAG SCREW, MAY BE USED ALL LOCATIONS, REQUIRED AT DET. 1/9 FOR WOOD INSTALL	3"	2"
E	1/4" ALUM. 6063-T5 MIN. OR 1/4" STEEL 36 KSI MIN.	3/8-16 GRADE 5 SHEET METAL SCREW	SEE NOTE	3/4"



NOTE: ANCHORS THROUGH METAL SHALL BE OF SUFFICIENT LENGTH TO PROVIDE THREAD ENGAGEMENT THROUGH THE FULL METAL THICKNESS

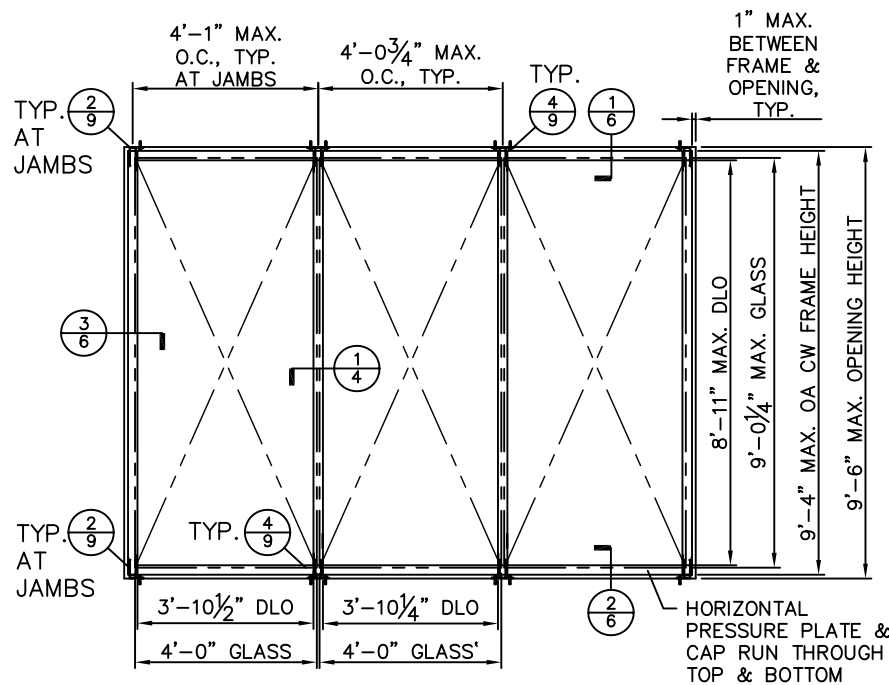

E2
2 **SINGLE-SPAN ELEVATION**
SEE DP CHART, TABLE B

TABLE B. ELEV. E2/2 DESIGN PRESSURE CHART (PSF)

MAX. GLASS WIDTH	FRAME HEIGHT 112" & Under	FRAME HEIGHT 30" & Under
30" & Under	+/-90	
36"	+/-75.8	
42"	+/-65.2	
48"	+/-57.1	

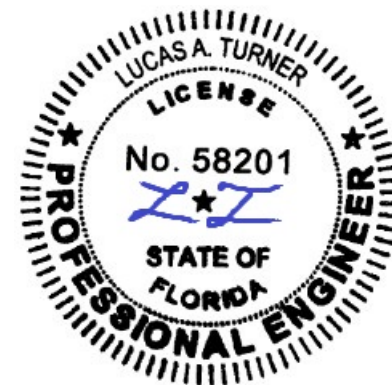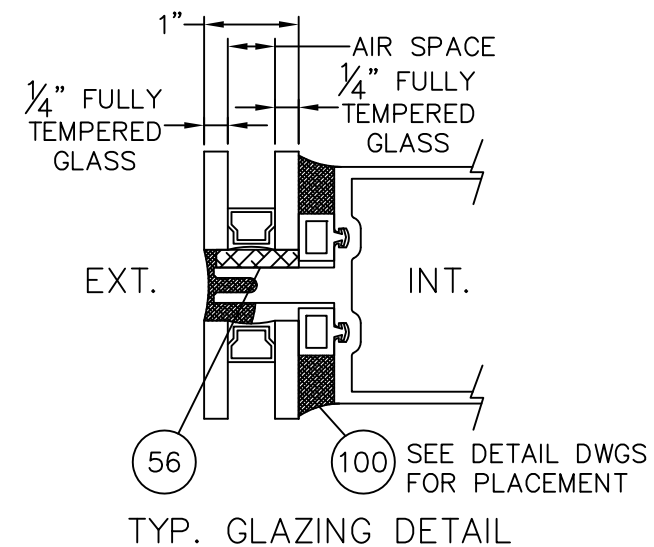

10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320






TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

TUBELITE
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS
3056 WALKER RIDGE DRIVE N.W.
WALKER, MICHIGAN 49544
PH: 800.866.2227
FX: 616.301.0008
WEB SITE: WWW.TUBELITEINC.COM

REVISION HISTORY:

REV	DATE	DESCRIPTION	DRAWN
O	5.7.14	ORIGINAL RELEASE	LT
A	2.26.15	ANCHOR REVISIONS	LT
B	10.26.20	FBC CODE UPDATE	LT

DATE:	05.07.14
DRAWING NUMBER:	FPA-400-SSG-NI
DRAWN:	
FINAL REVIEW:	
SCALE:	N.T.S.
REVISION:	B
SHEET NAME:	ELEVATIONS, ANCHORAGE, GLAZING
SHEET:	2 OF 14

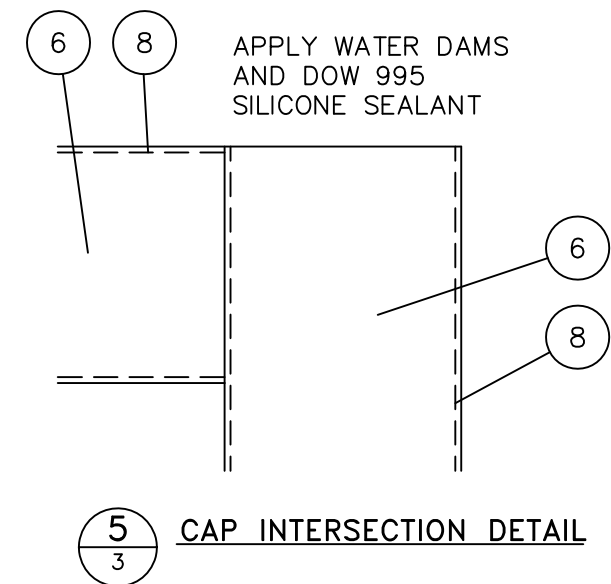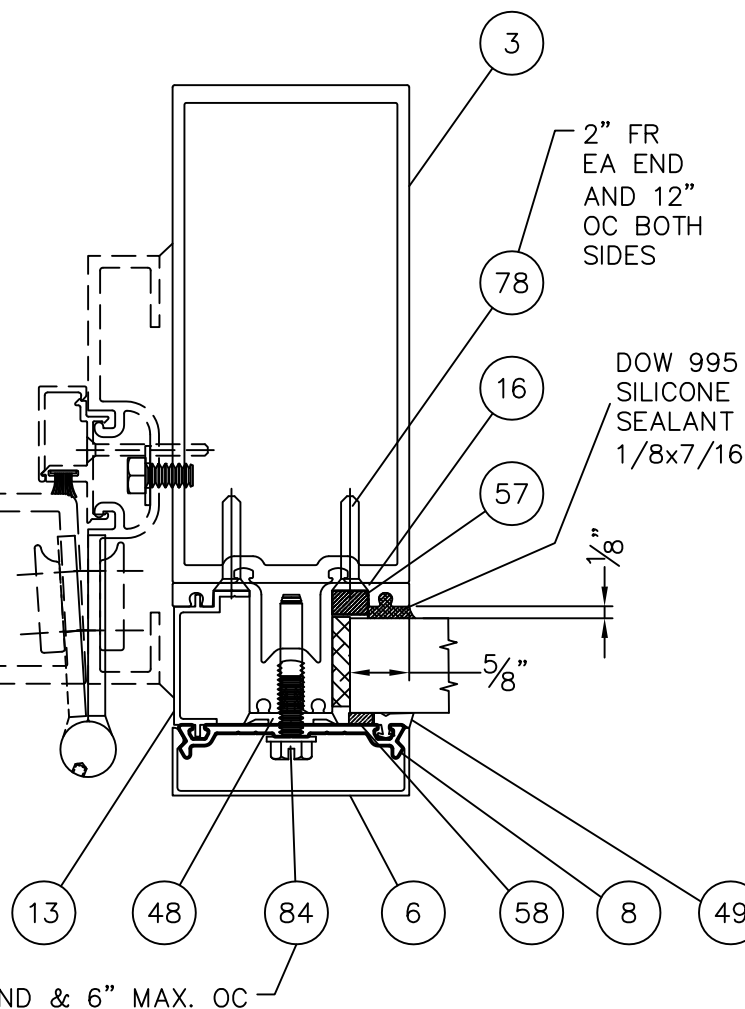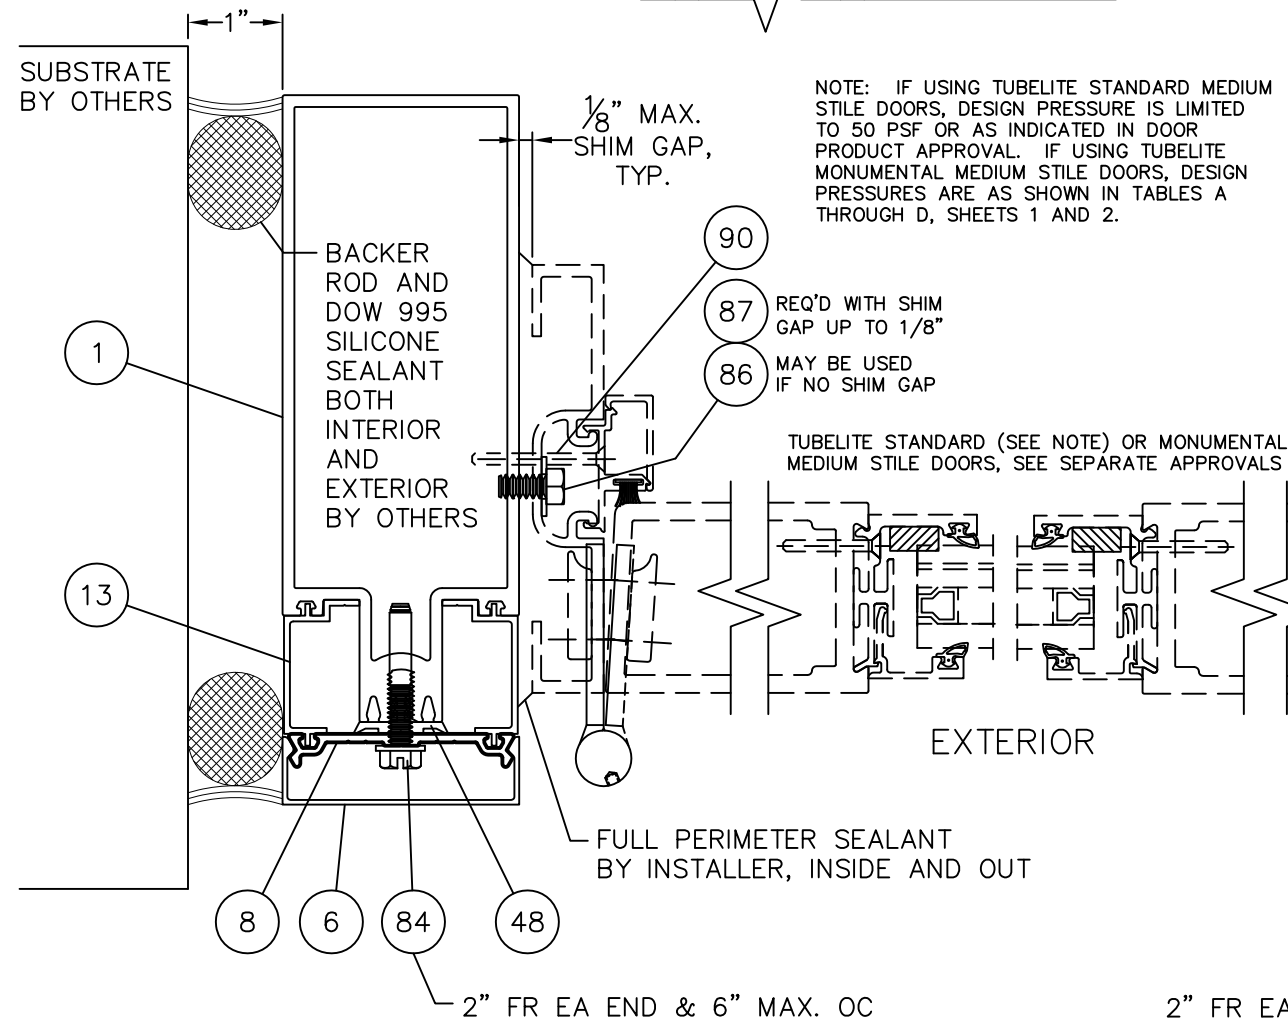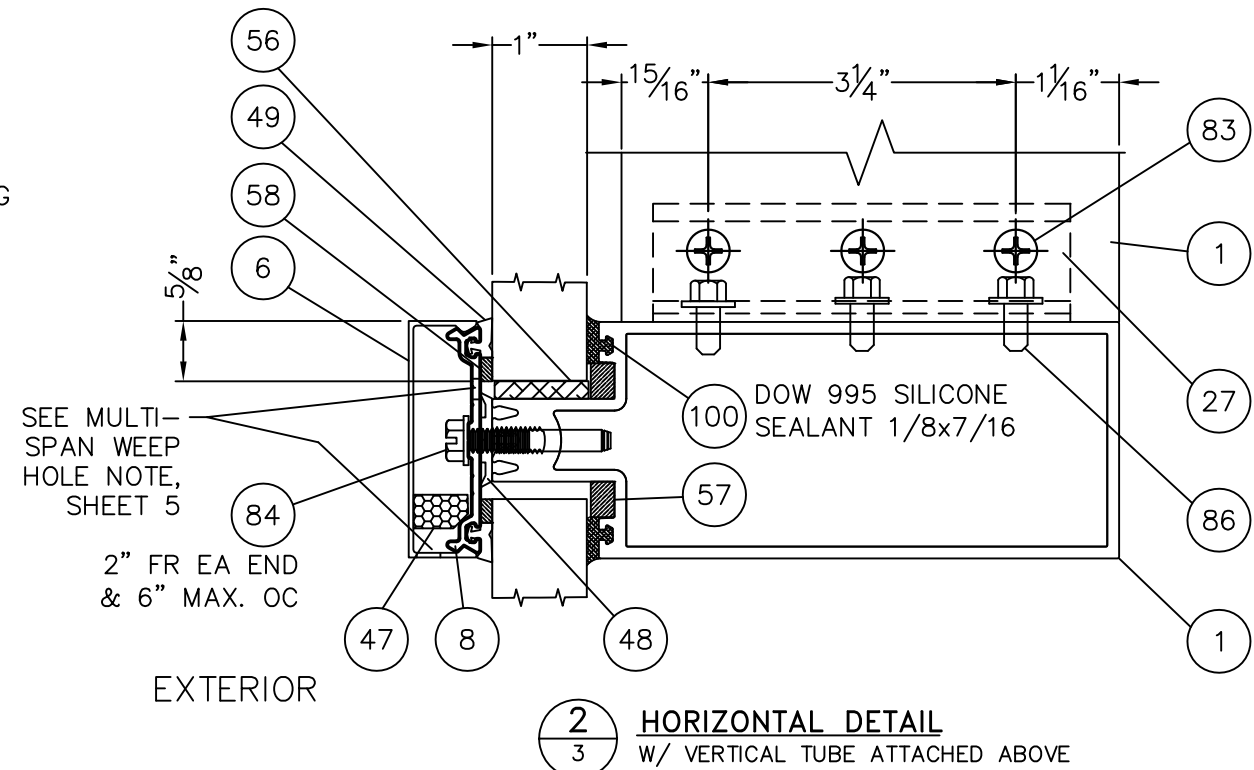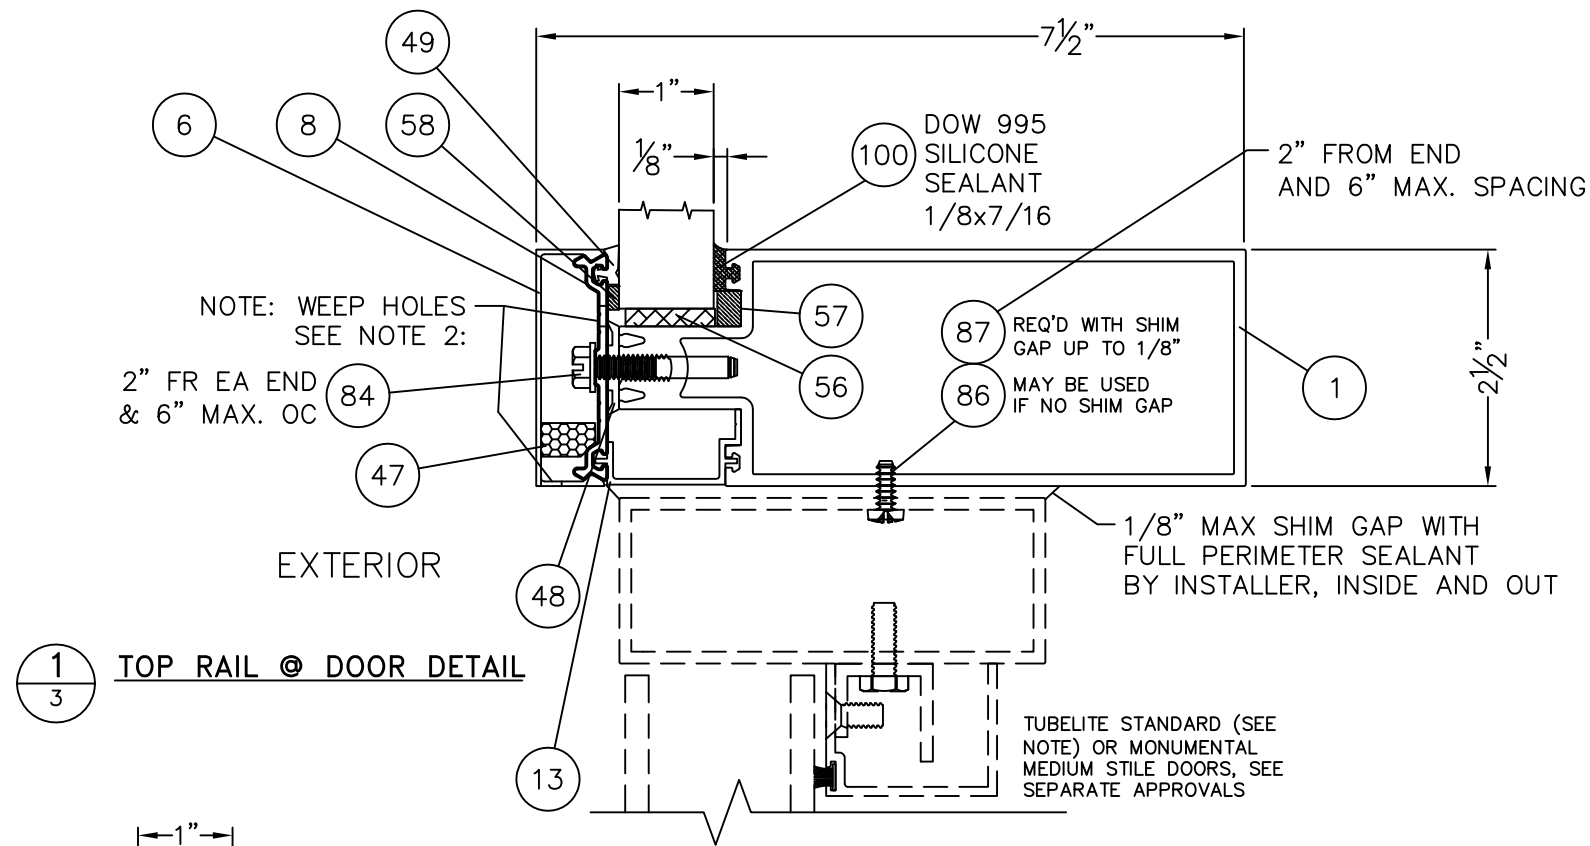

10/26/2020
 LUCAS A. TURNER, P.E.
 FL PE # 58201
 TURNER ENGINEERING & CONSULTING, INC.
 (COA # 29779)
 2428 OLD NATCHEZ TRC TRL
 CAMDEN, TN 38320

TUBELITE
 CW 400 SSG NON-IMPACT
 CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
 WALKER, MICHIGAN 49544
 PH: 800.866.2227
 FX: 616.301.0008
 WEB SITE: WWW.TUBELITEINC.COM


TUBELITE
 DEPENDABLE
 LEADERS IN ECO-EFFICIENT STOREFRONT,
 CURTAINWALL AND ENTRANCE SYSTEMS

REVISION HISTORY:

REV	DATE	DESCRIPTION
O	5.7.14	ORIGINAL RELEASE
A	2.26.15	ANCHOR REVISIONS
B	10.26.20	FBC CODE UPDATE



DATE:	05.07.14
DRAWING NUMBER:	FPA-400-SSG-NI
DRAWN:	
FINAL REVIEW:	
SCALE:	N.T.S.
REVISION:	B
SHEET NAME:	DOOR SECTION DETAILS
SHEET:	3 OF 14

1 HEAD DETAIL
TWIN-SPAN

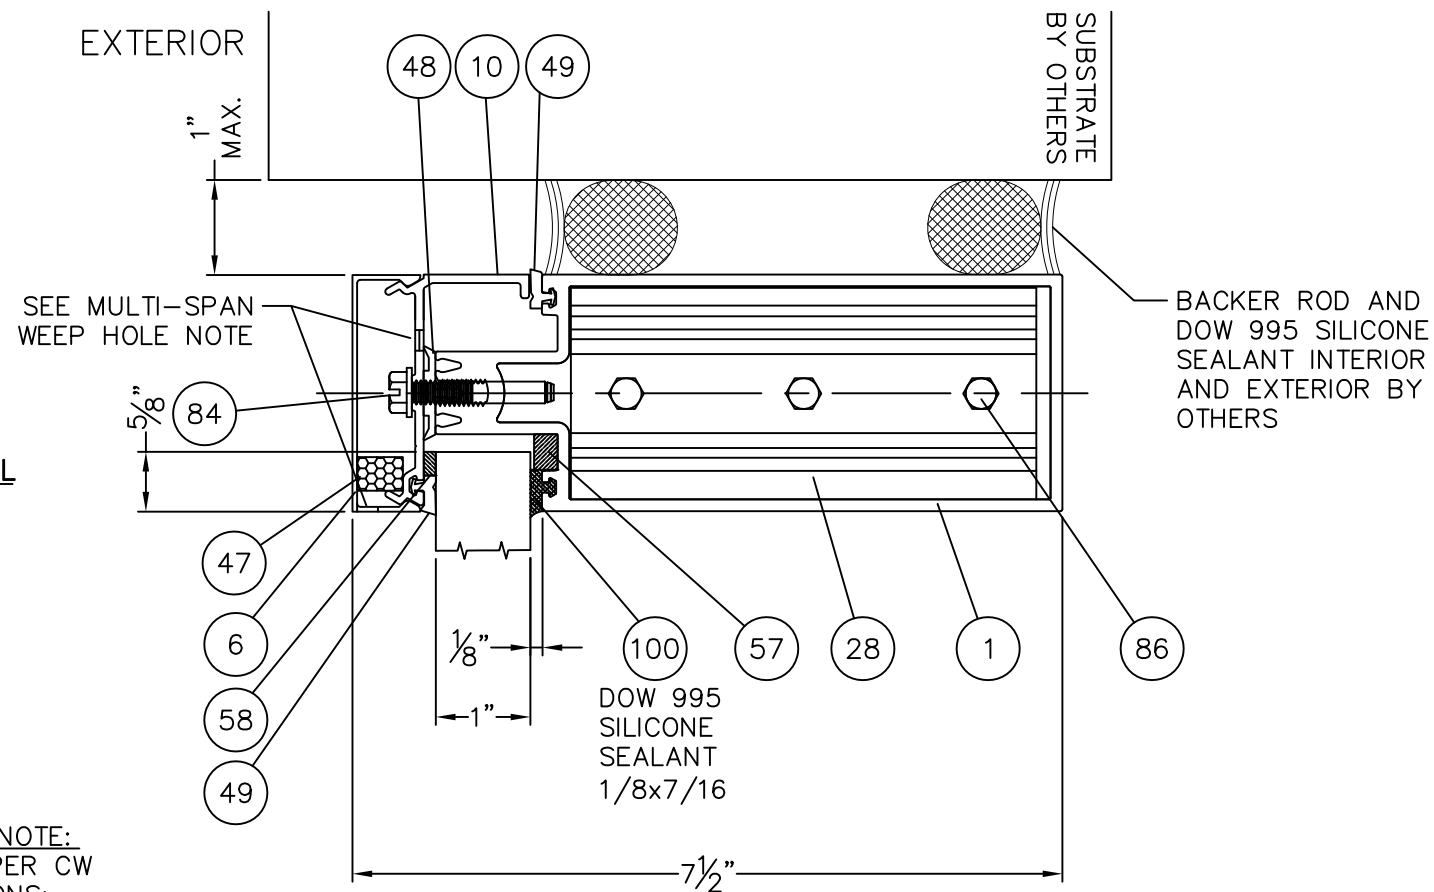

TWIN-SPAN WEEP HOLE NOTE:
WEEP HOLE LOCATIONS PER CW
INSTALLATION INSTRUCTIONS:
PRESSURE PLATE - (3) 1/4"
DIA. HOLES ONE MID BAY AND
(1) HALF WAY BETWEEN 1/4
POINTS AND END OF PRESSURE
PLATE. MIN 4" FROM EA END.
SNAP COVER - (2) 1/4" X 1/2"
LONG SLOTS 1' MAX FROM EA
END TO CENTER OF SLOT.

2 SILL DETAIL
TWIN-SPAN

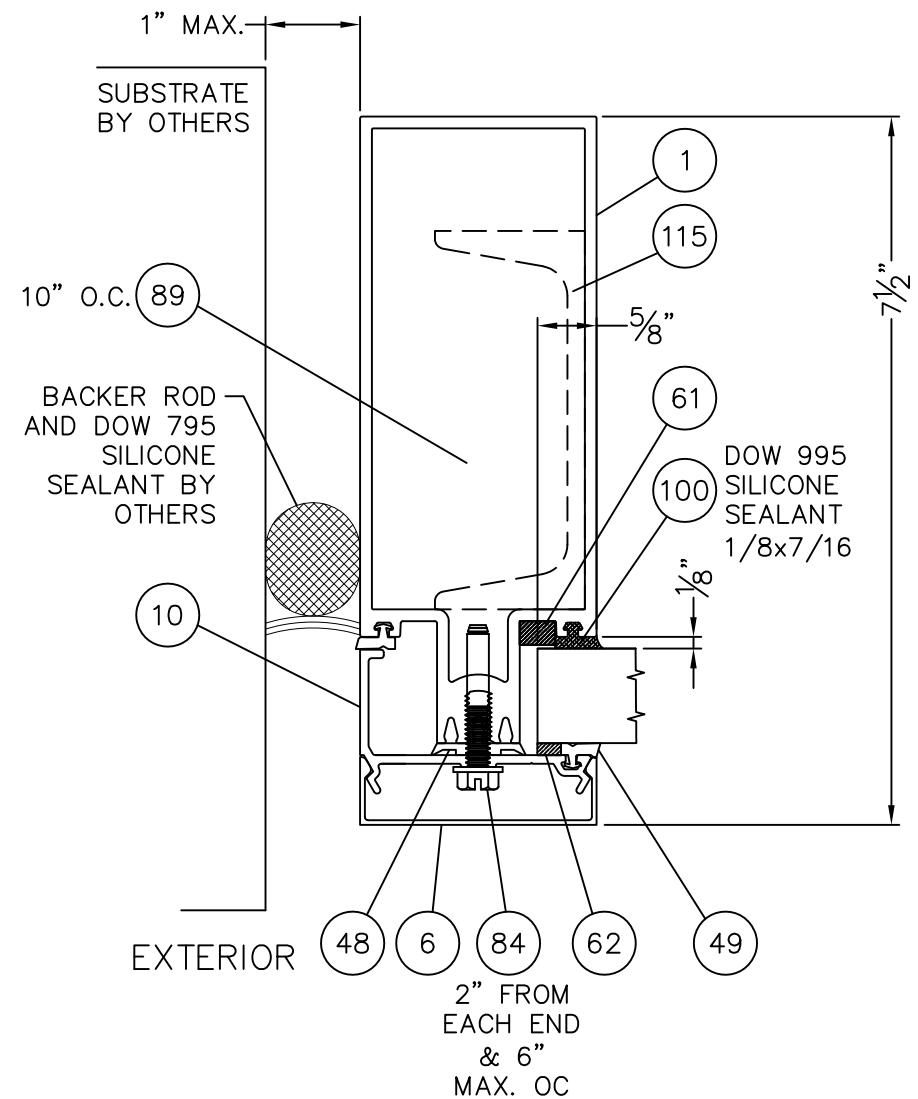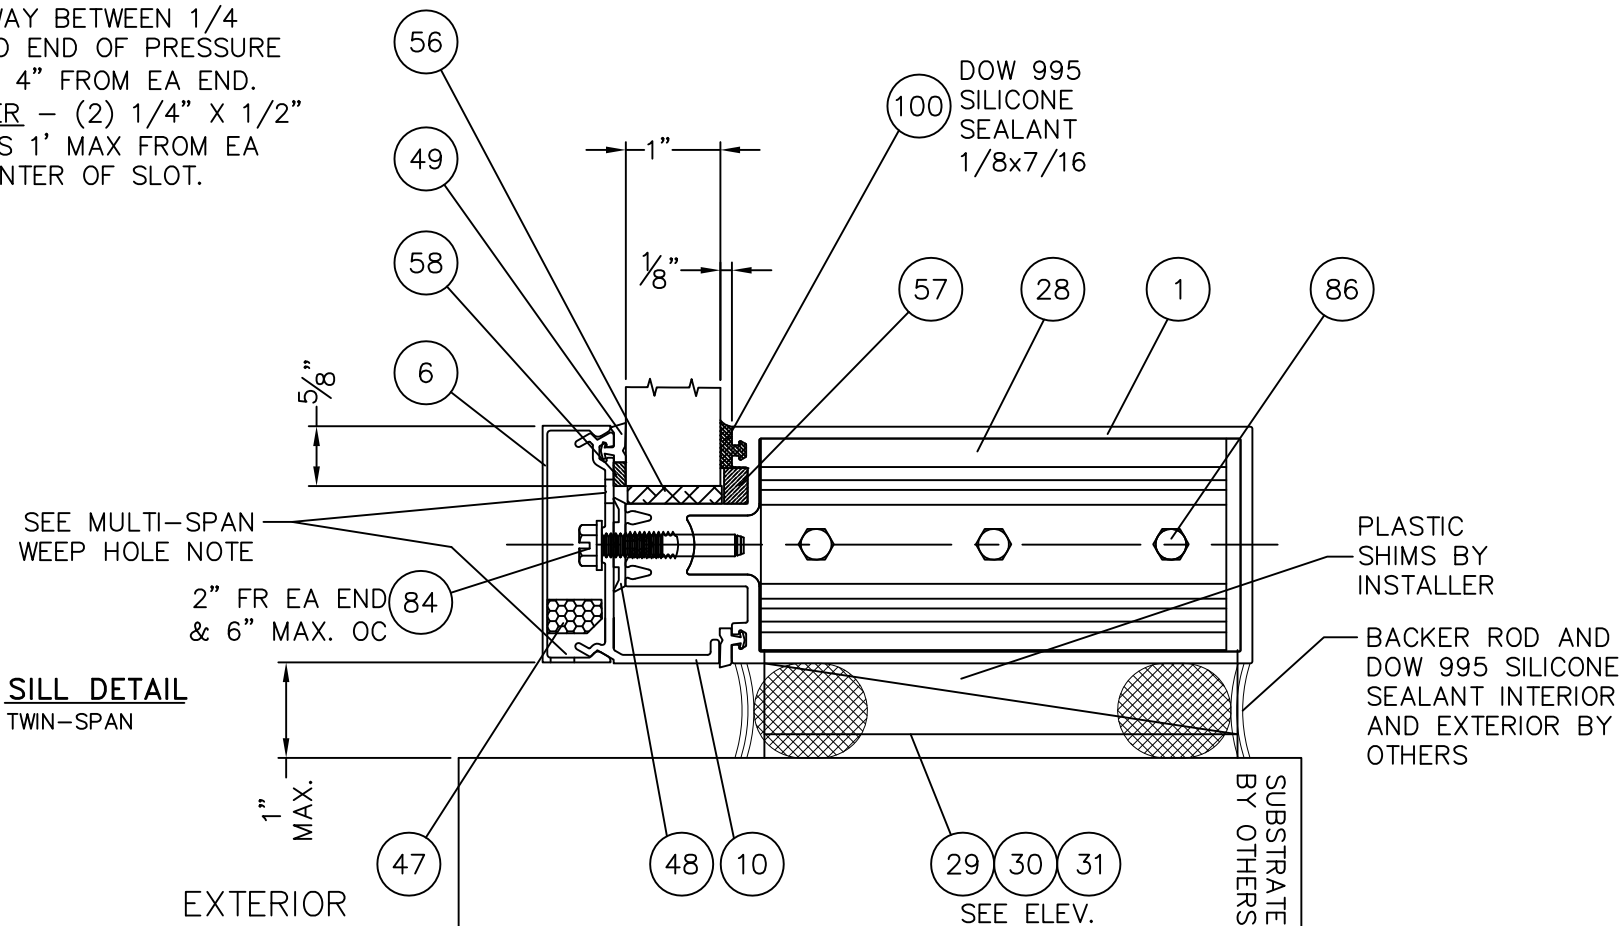

3 JAMB DETAIL
TWIN-SPAN



10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
WALKER, MICHIGAN 49544
PH: 800.866.2227
FX: 616.301.0008
WEB SITE: WWW.TUBELITEINC.COM

TUBELITE
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS


REVISION HISTORY:

REV	DATE	DESCRIPTION
O	5.7.14	ORIGINAL RELEASE
A	2.26.15	ANCHOR REVISIONS
B	10.26.20	FBC CODE UPDATE

DATE:	05.07.14
DRAWING NUMBER:	FPA-400-SSG-NI
DRAWN:	
FINAL REVIEW:	
SCALE:	N.T.S.
REVISION:	B



SHEET NAME:	TWIN-SPAN PERIMETER DETAILS
SHEET:	5 OF 14

1 HEAD DETAIL
SINGLE-SPAN

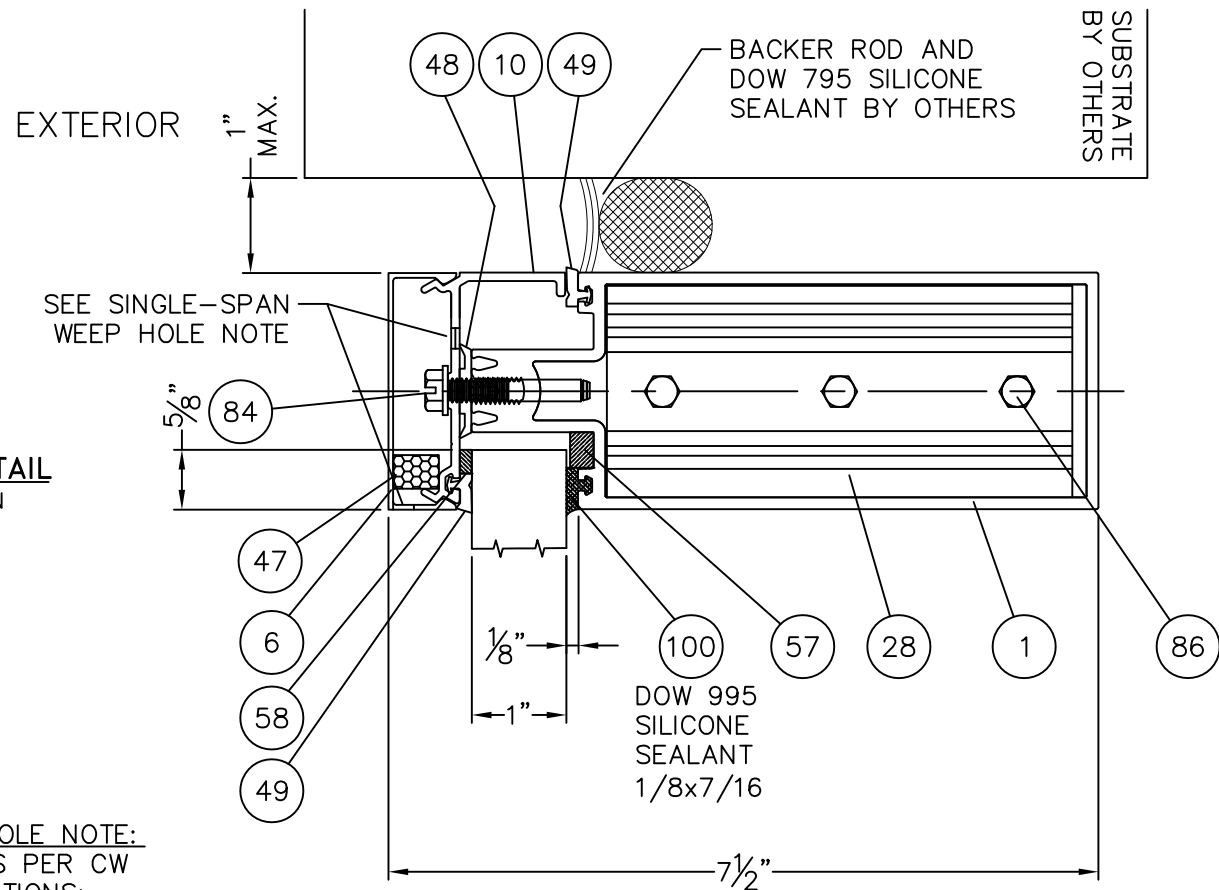

SINGLE-SPAN WEEP HOLE NOTE:
WEEP HOLE LOCATIONS PER CW
INSTALLATION INSTRUCTIONS:
PRESSURE PLATE - (3) 1/4"
DIA. HOLES ONE MID BAY AND
(1) HALF WAY BETWEEN 1/4
POINTS AND END OF PRESSURE
PLATE. MIN 4" FROM EA END.
SNAP COVER - (2) 1/4" X 1"
LONG SLOTS 1 3/16" MAX FROM
EA END TO CENTER OF SLOT.

2 SILL DETAIL
SINGLE-SPAN

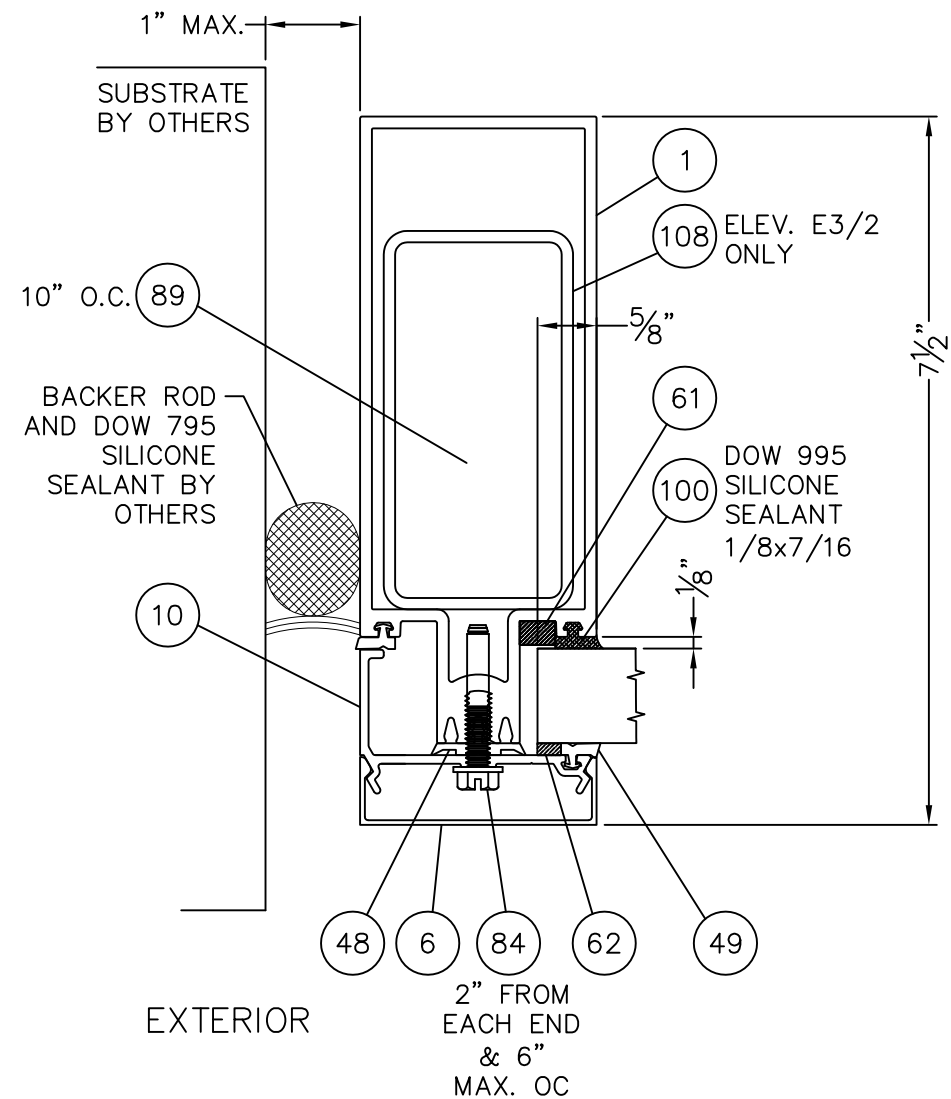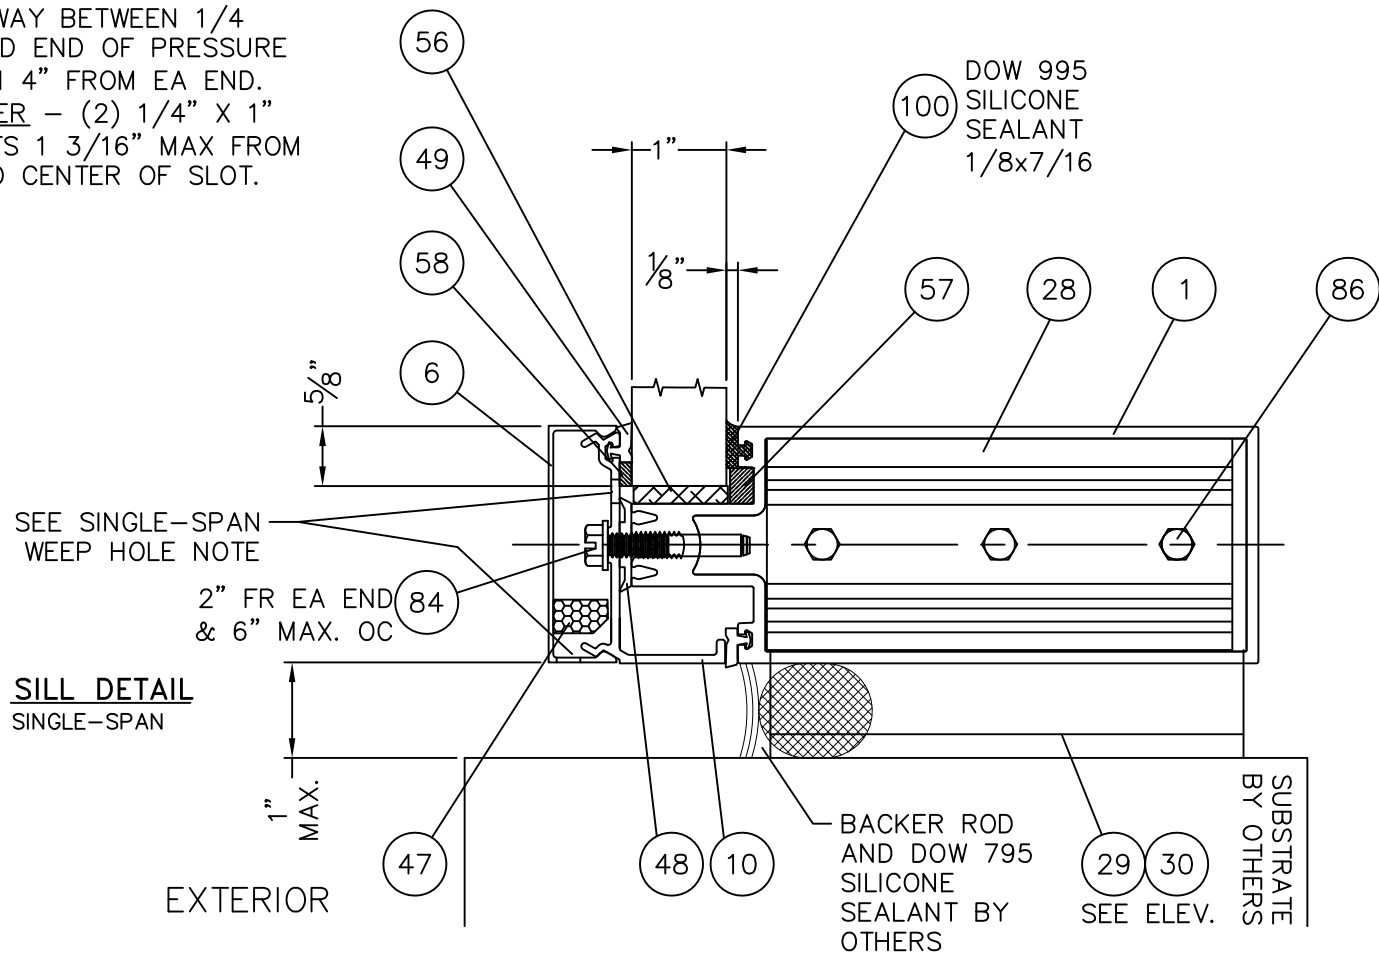

3 JAMB DETAIL
SINGLE-SPAN



10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
WALKER, MICHIGAN 49544
PH: 800.866.2227
FX: 616.301.0008
WEB SITE: WWW.TUBELITEINC.COM

TUBELITE
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS

REVISION HISTORY:

REV	DATE	DESCRIPTION
O	5.7.14	ORIGINAL RELEASE
A	2.26.15	ANCHOR REVISIONS
B	10.26.20	FBC CODE UPDATE

DATE: 05.07.14

DRAWING NUMBER: FPA-400-SSG-NI

DRAWN:

FINAL REVIEW:

SCALE: N.T.S.



REVISION: B

SHEET NAME:

SINGLE-SPAN
PERIMETER
DETAILS

SHEET: 6 OF 14

SEE SHEET 10
FOR ADDITIONAL
DETAILS.
ANCHOR~WELD AND
BOLT CALL OUTS

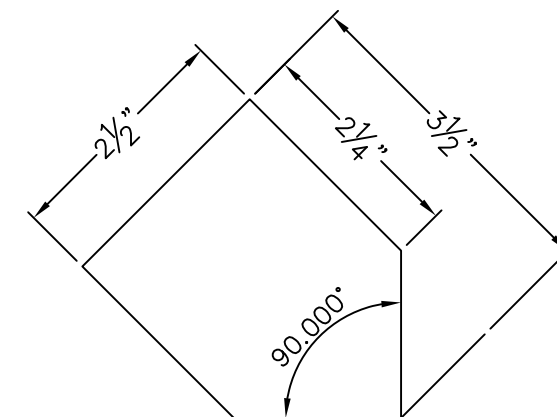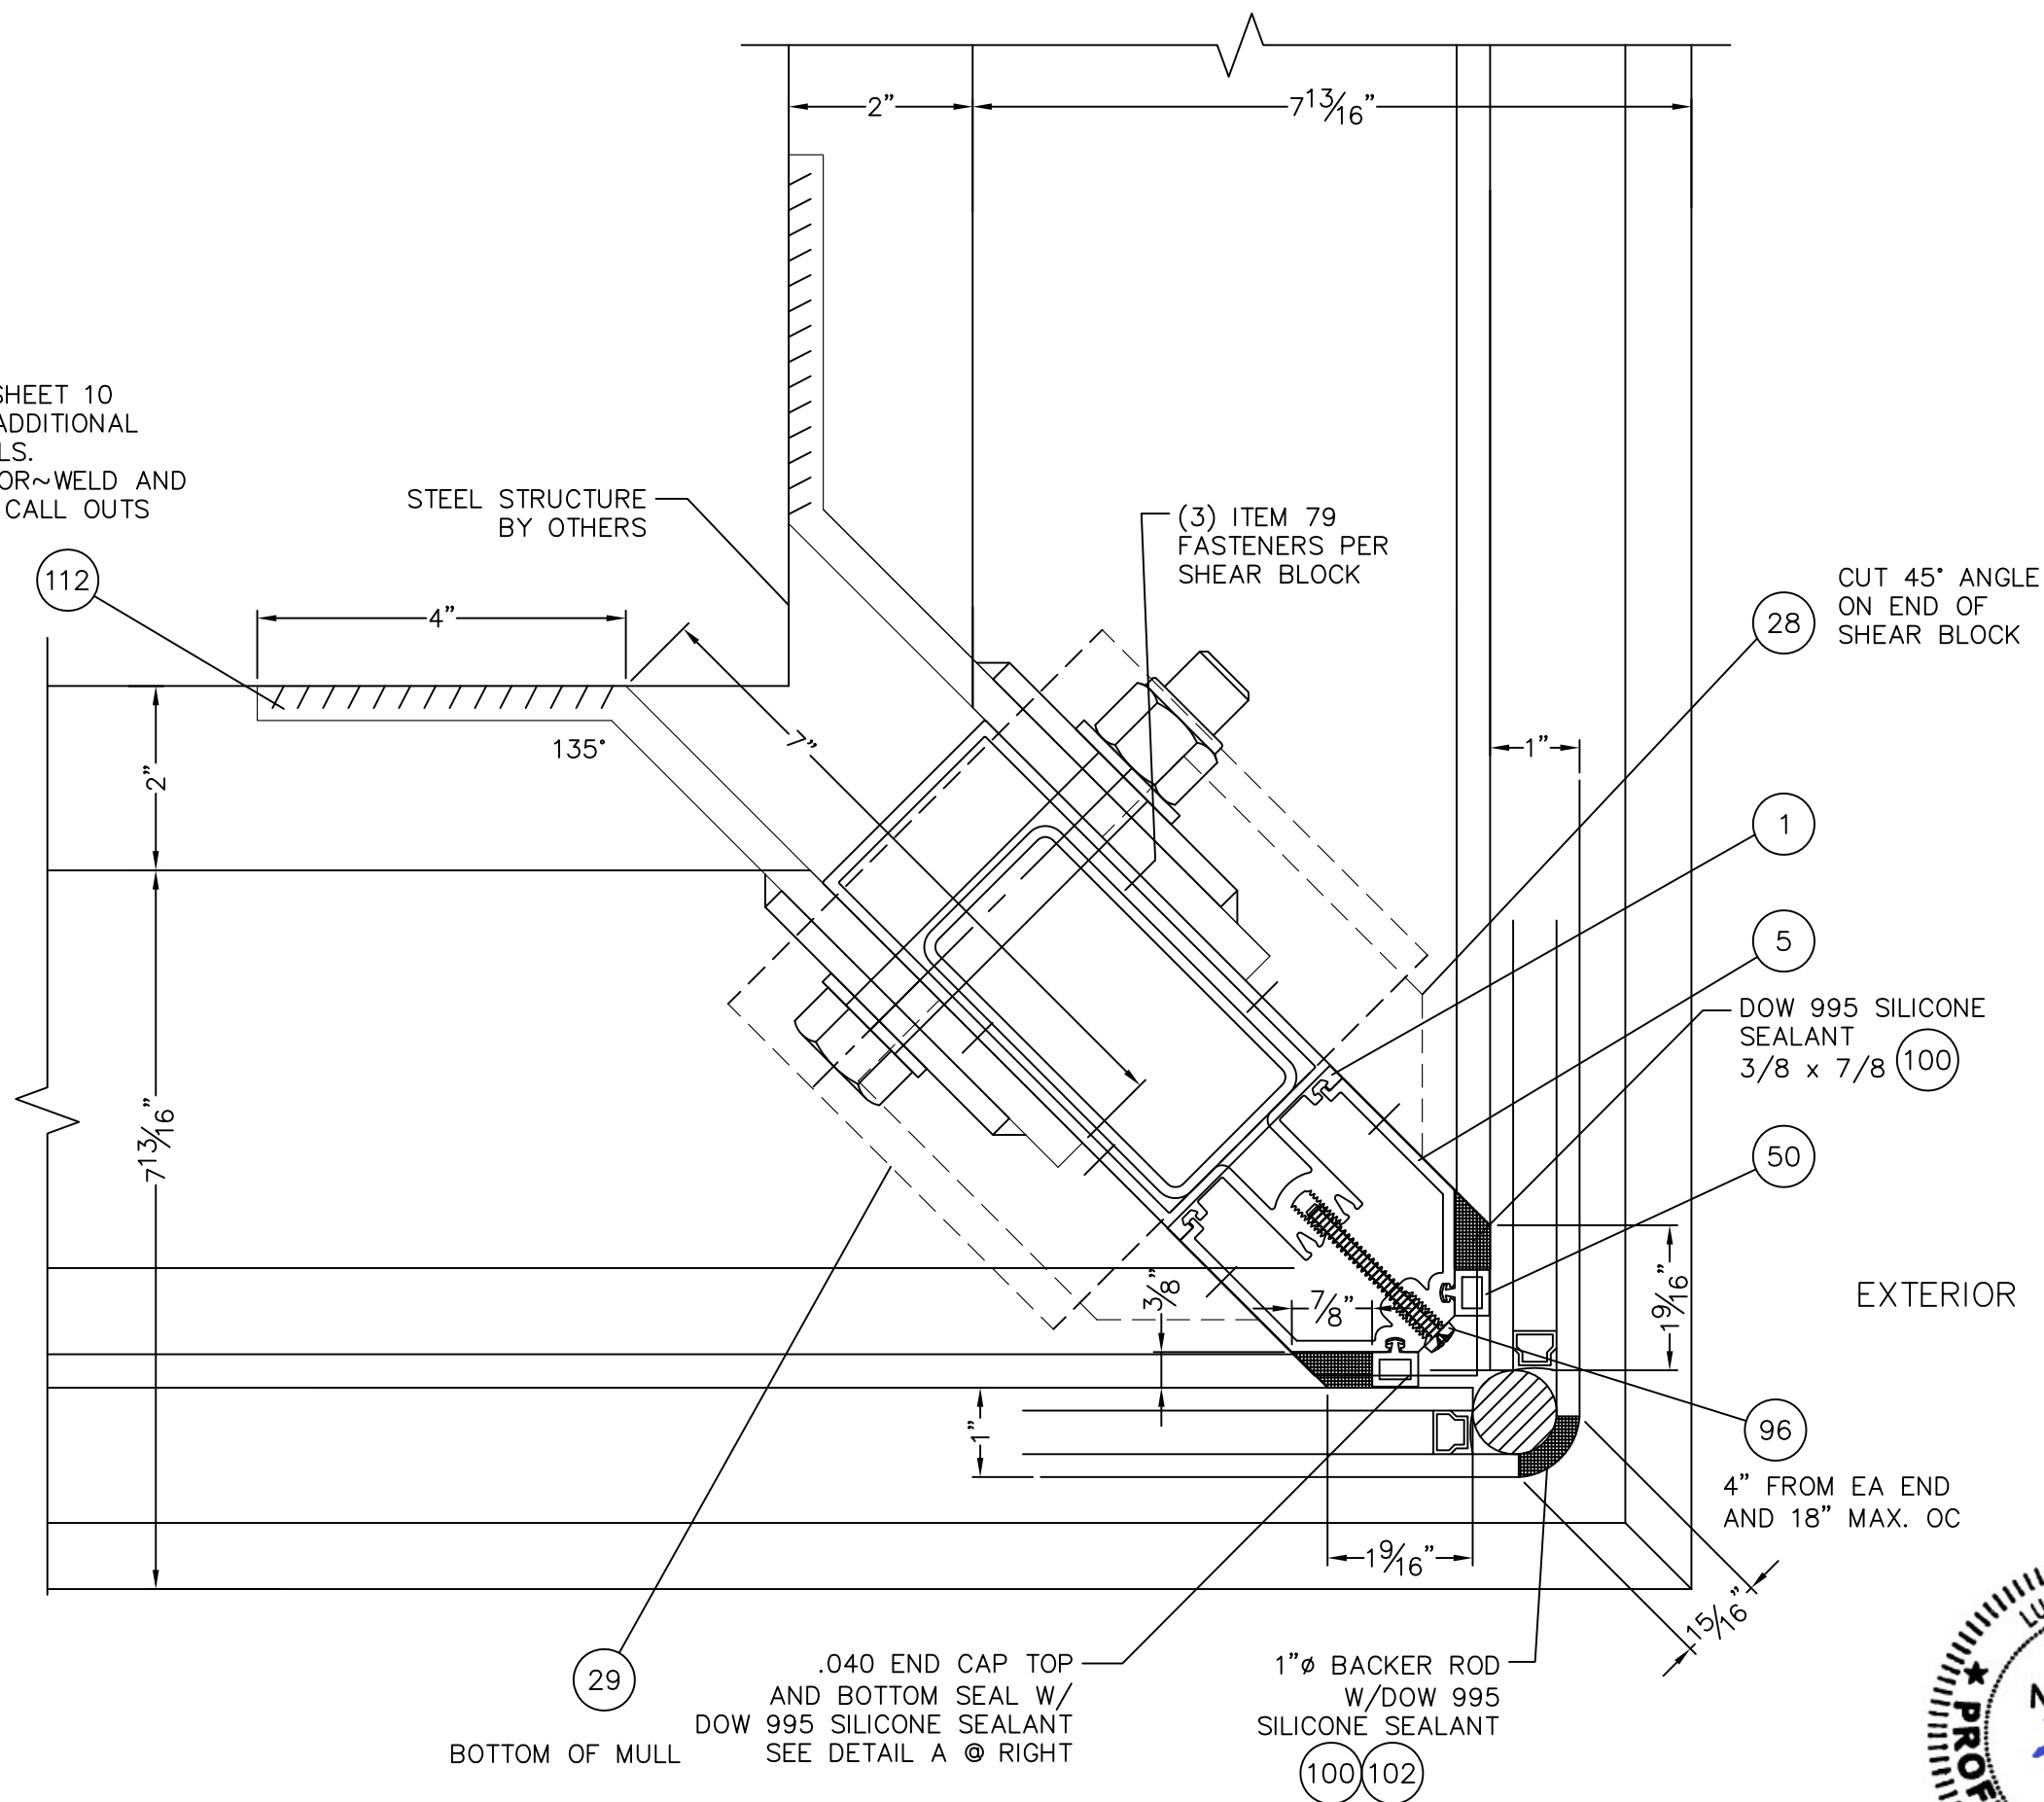

DETAIL A
.040 ALUM END CAP



10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
WALKER, MICHIGAN 49544
PH: 800.866.2227
FX: 616.301.0008
WEB SITE: WWW.TUBELITEINC.COM

TUBELITE
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS

REVISION HISTORY:

REV	DATE	DESCRIPTION	DRAWN
O	5.7.14	ORIGINAL RELEASE	LT
A	2.26.15	ANCHOR REVISIONS	LT
B	10.26.20	FBC CODE UPDATE	LT

DATE: 05.07.14

DRAWING NUMBER:
FPA-400-SSG-NI

DRAWN:

FINAL REVIEW:

SCALE: N.T.S.

REVISION: B


SHEET NAME:

CORNER
SECTION
DETAIL


SHEET: 7 OF 14

1
7

STRUCTURAL GLAZED OUTSIDE CORNER DETAIL

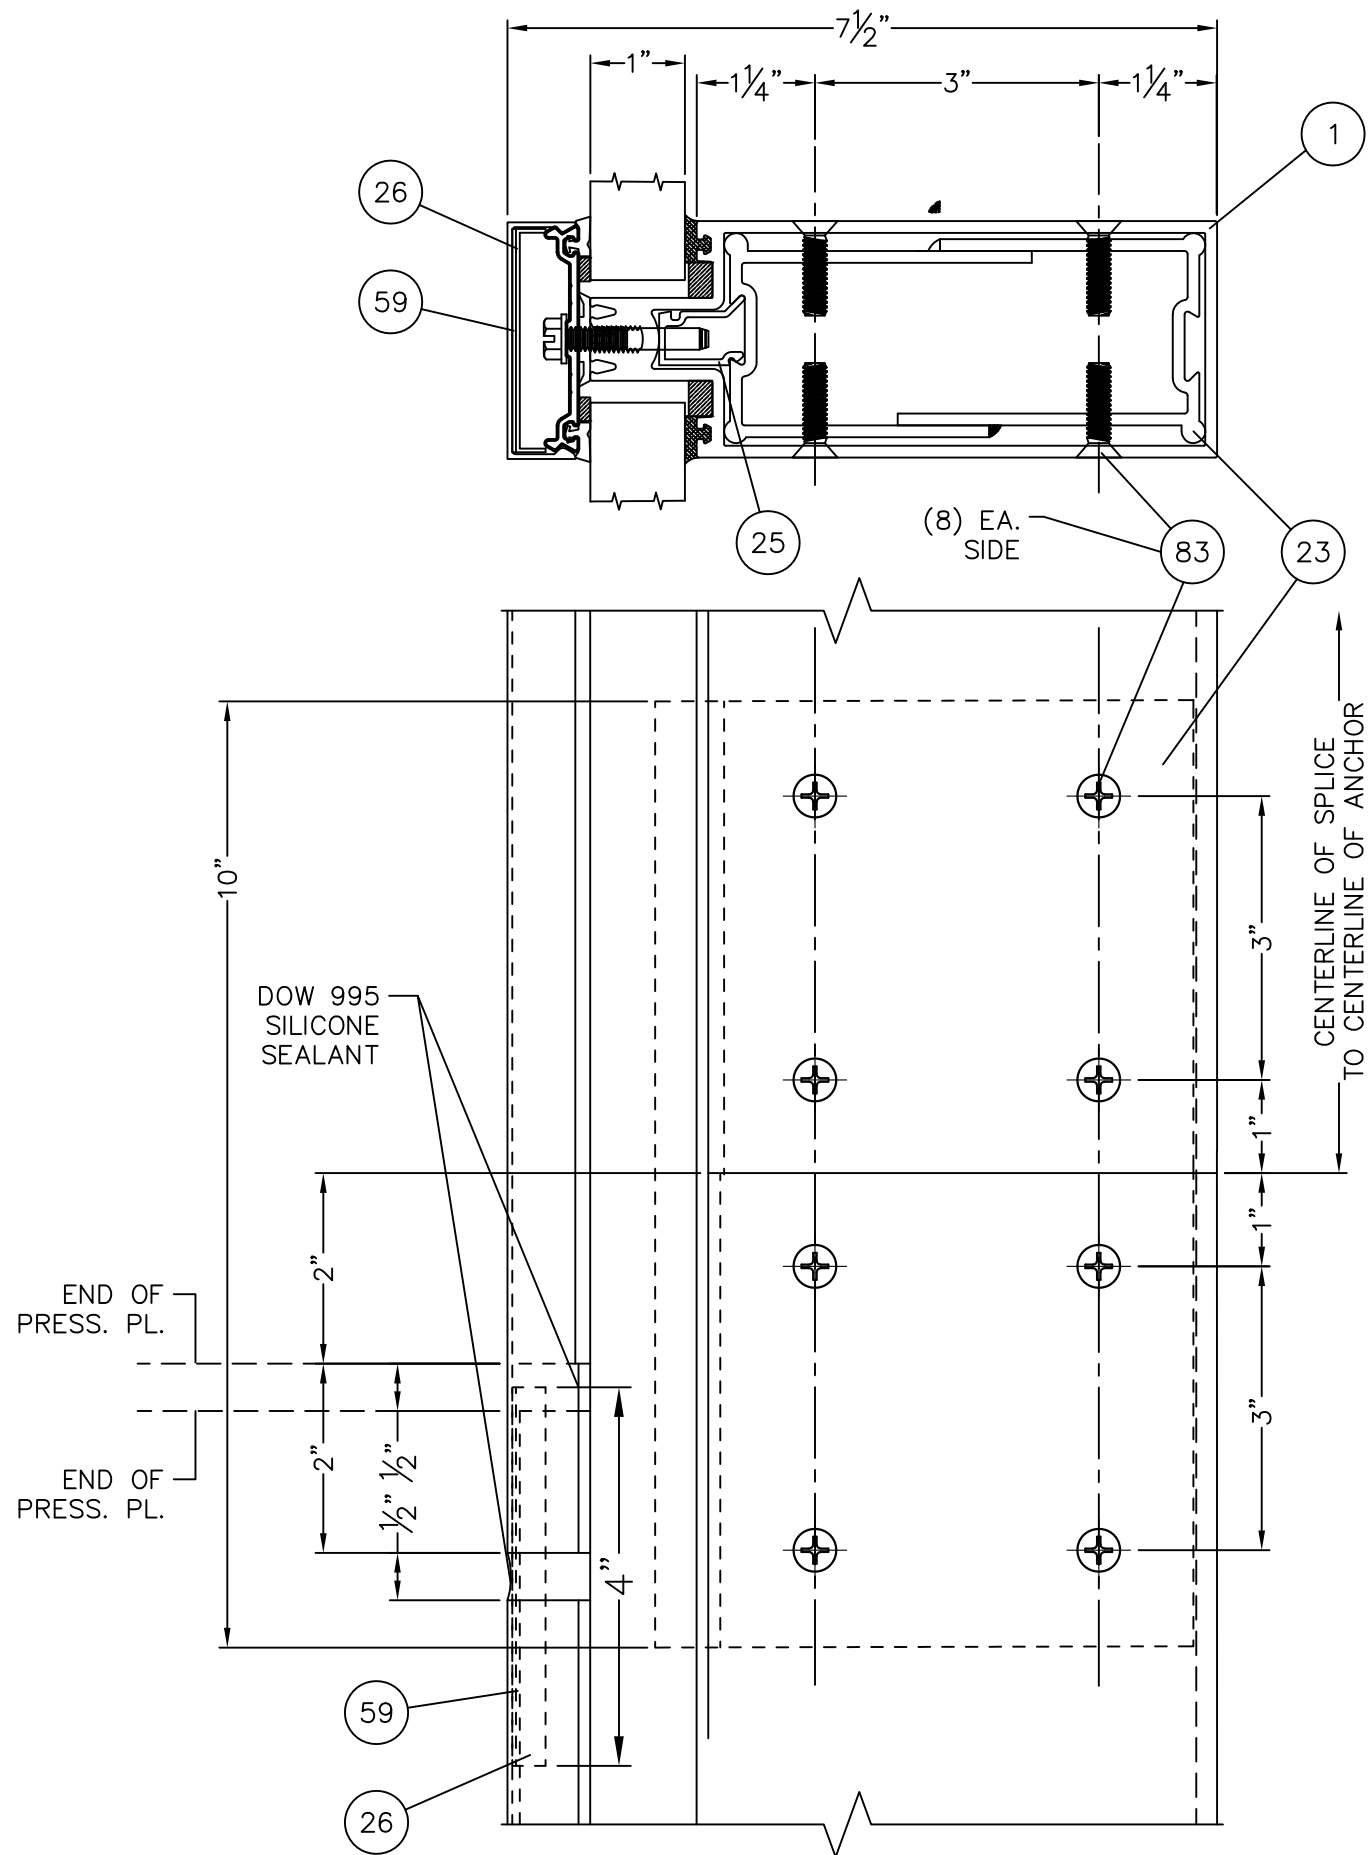

1
8 **TYPICAL MULL SPLICE DETAIL**

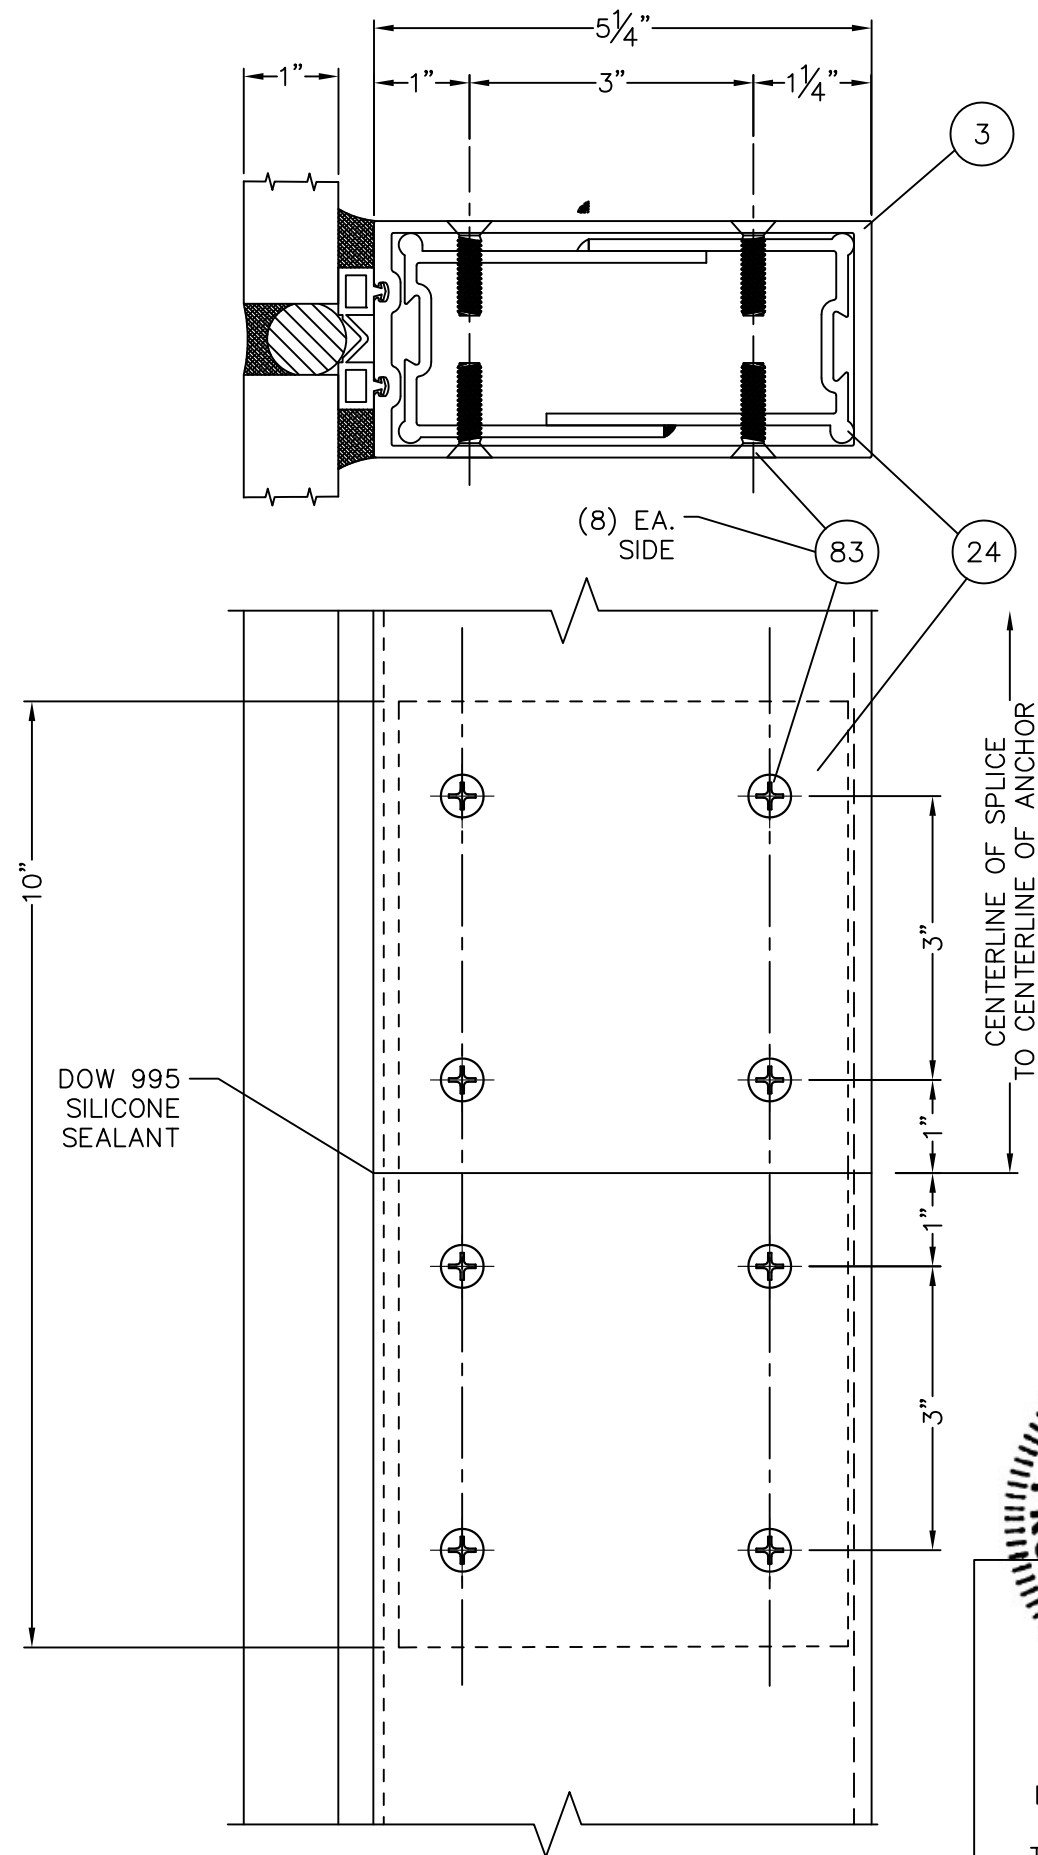

2
8 **STRUCTURAL GLAZED MULL SPLICE DETAIL**



10/26/2020
 LUCAS A. TURNER, P.E.
 FL PE # 58201
 TURNER ENGINEERING &
 CONSULTING, INC.
 (COA # 29779)
 2428 OLD NATCHEZ TRC TRL
 CAMDEN, TN 38320

TUBELITE
 CW 400 SSG NON-IMPACT
 CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
 WALKER, MICHIGAN 49544
 PH: 800.866.2227
 FX: 616.301.0008
 WEB SITE: WWW.TUBELITEINC.COM


TUBELITE
 DEPENDABLE
 LEADERS IN ECO-EFFICIENT STOREFRONT,
 CURTAINWALL AND ENTRANCE SYSTEMS

REVISION HISTORY:


REV	DATE	DRAWN	DESCRIPTION
O	5.7.14	LT	ORIGINAL RELEASE
A	2.26.15	LT	ANCHOR REVISIONS
B	10.26.20	LT	FBC CODE UPDATE

DATE: 05.07.14
 DRAWING NUMBER: FPA-400-SSG-NI
 DRAWN:
 FINAL REVIEW:
 SCALE: N.T.S.
 REVISION: B


SHEET NAME: SPLICE JOINT DETAILS
 SHEET: 8 OF 14

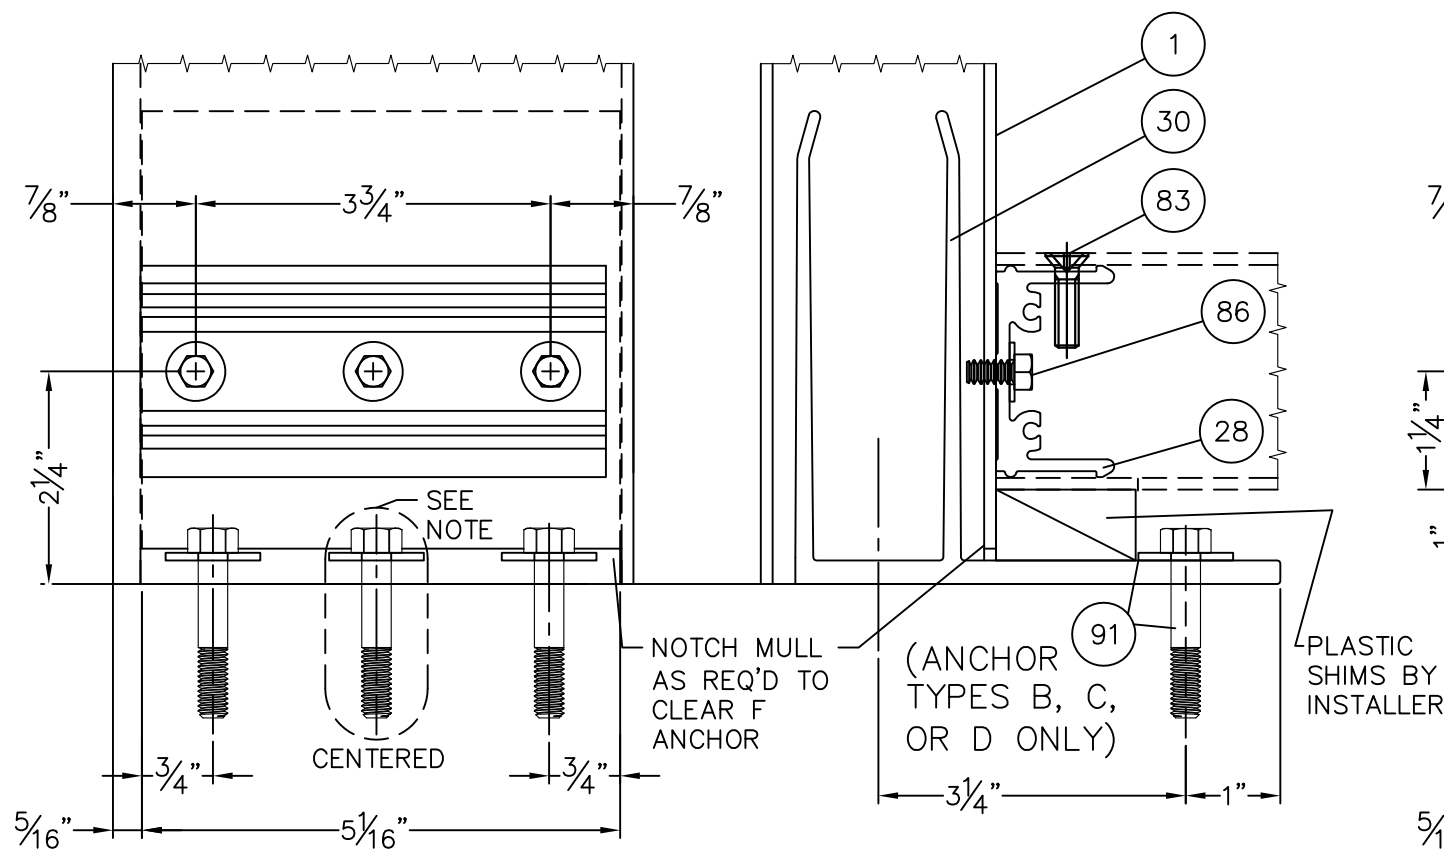


1
9 F ANCHOR AND SHEAR BLOCK CLIP ASSEMBLY & INSTALLATION @ DOOR MULL SILL ONLY

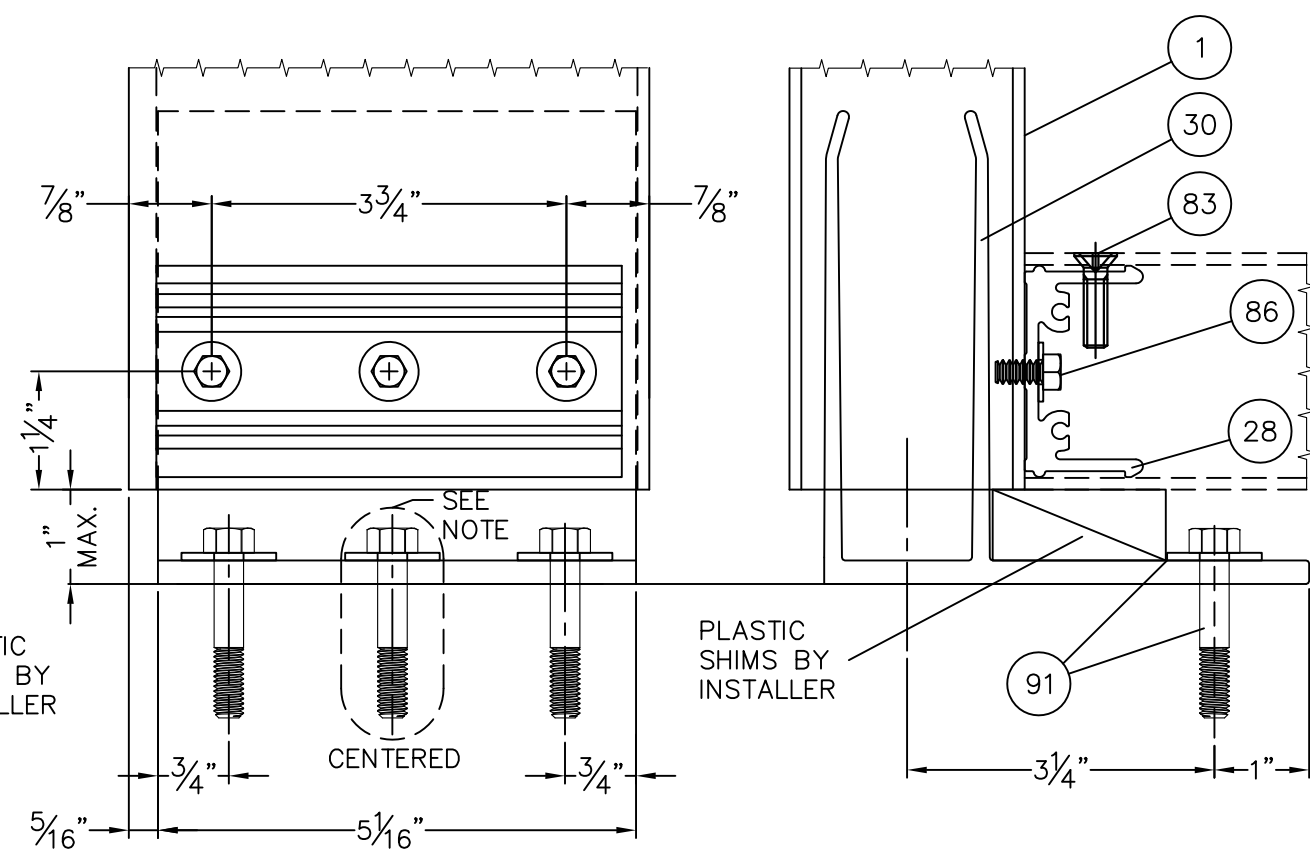

2
9 F ANCHOR AND SHEAR BLOCK CLIP ASSEMBLY & INSTALLATION @ JAMB MULL (HEAD AND SILL SIMILAR)

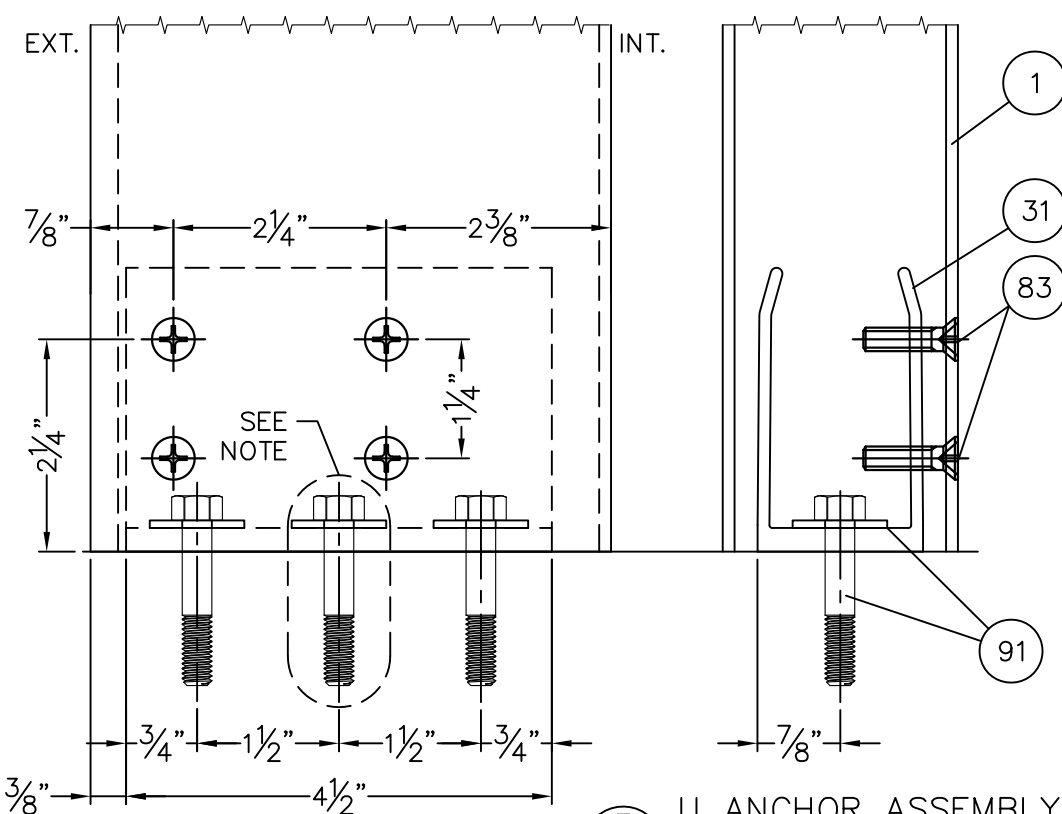


3
9 U ANCHOR ASSEMBLY & INSTALLATION @ DOOR JAMB ONLY

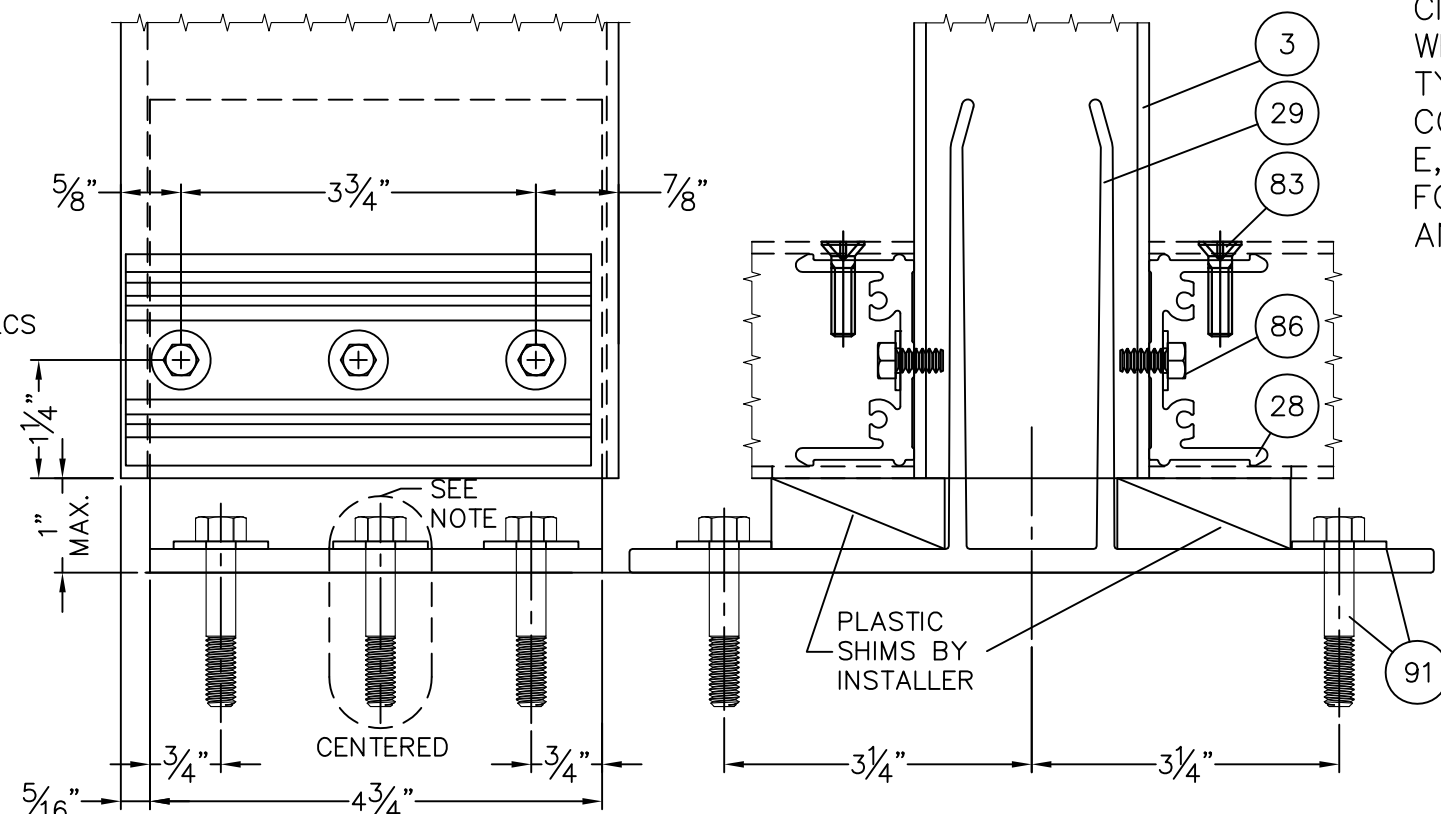

4
9 T ANCHOR AND SHEAR BLOCK CLIP ASSEMBLY & INSTALLATION @ TYP STRUCTURAL MULL (HEAD AND SILL SIM.)

NOTE: DO NOT INSTALL CIRCLED ANCHORS WHEN USING ANCHOR TYPES A OR B IN CONCRETE, SEE TABLE E, SHT 2. INSTALL FOR ANCHOR TYPES C AND D.

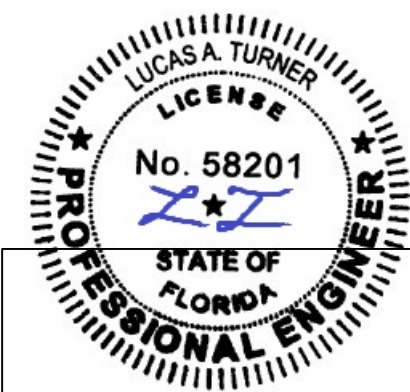

10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING & CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
WALKER, MICHIGAN 49544
PH: 800.866.2227
FX: 616.501.0008
WEB SITE: WWW.TUBELITEINC.COM

TUBELITE
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS

REVISION HISTORY:

REV	DATE	DRAWN	DESCRIPTION
O	5.7.14	LT	ORIGINAL RELEASE
A	2.26.15	LT	ANCHOR REVISIONS
B	10.26.20	LT	FBC CODE UPDATE

DATE: 05.07.14

DRAWING NUMBER: FPA-400-SSG-NI

DRAWN:

FINAL REVIEW:


SCALE: N.T.S.

REVISION: B



SHEET NAME:

ANCHOR
DETAILS


SHEET: 9 OF 14

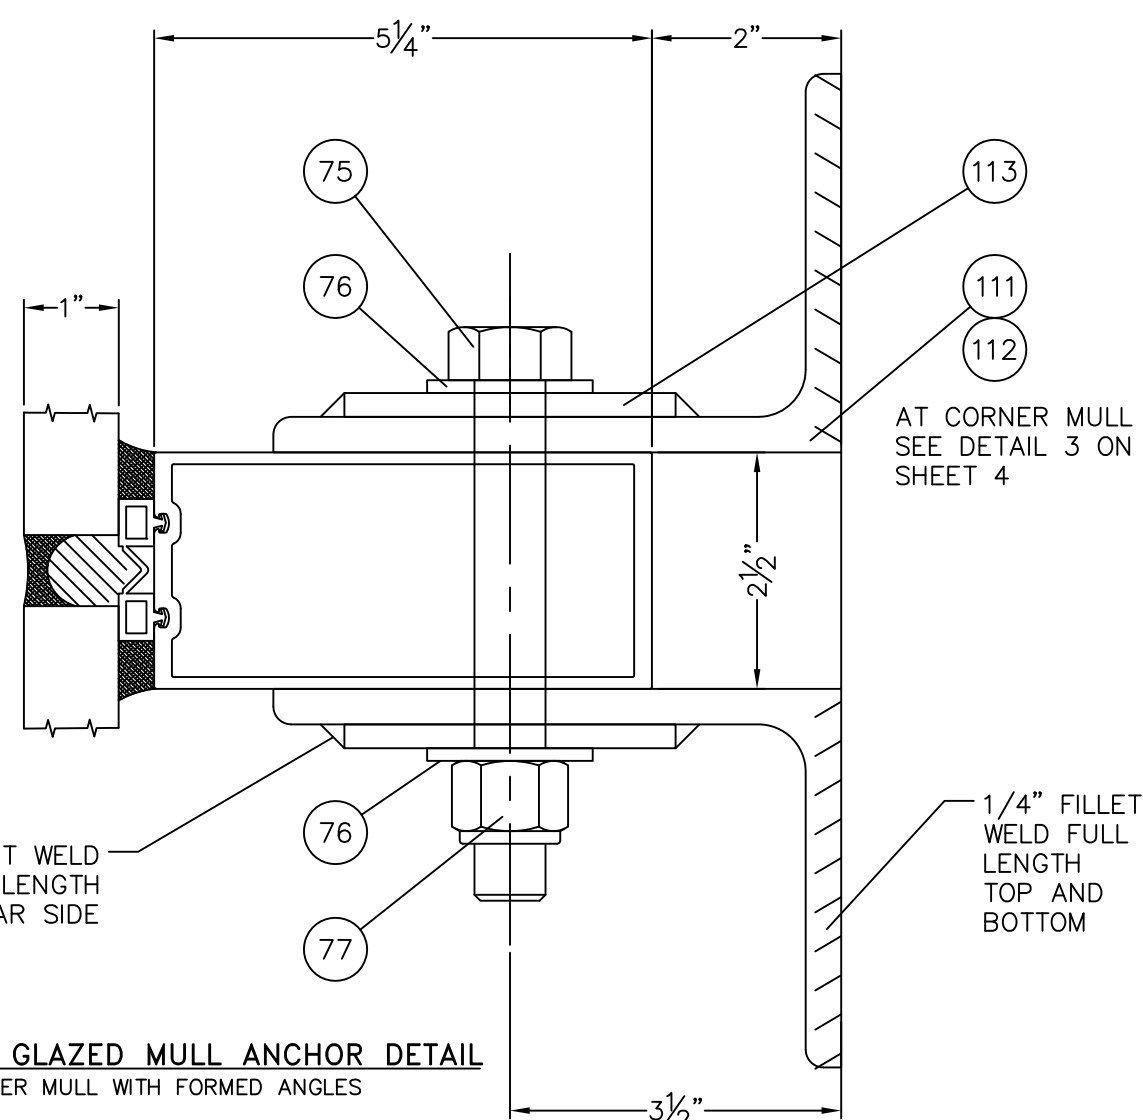

1
10 **STRUCTURAL GLAZED MULL ANCHOR DETAIL**
SIMILAR AT CORNER MULL WITH FORMED ANGLES

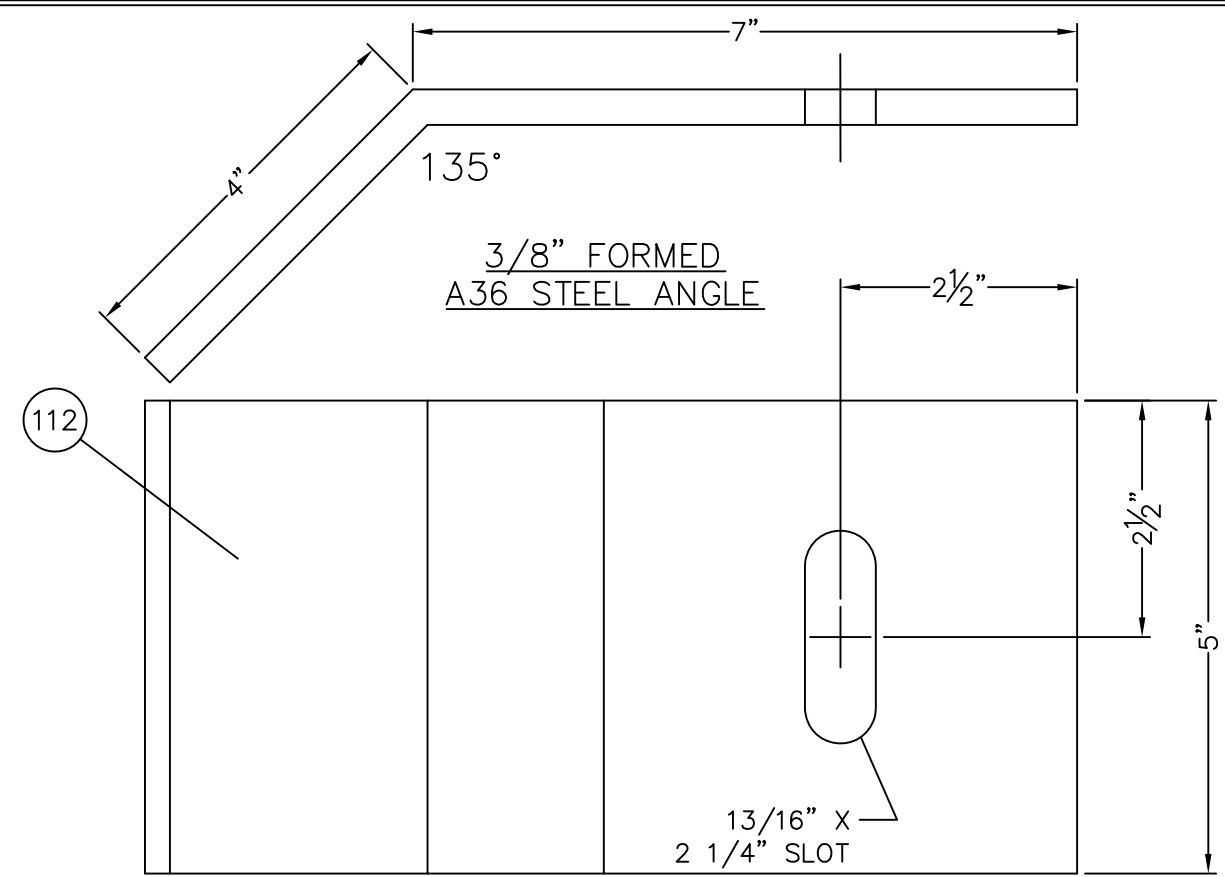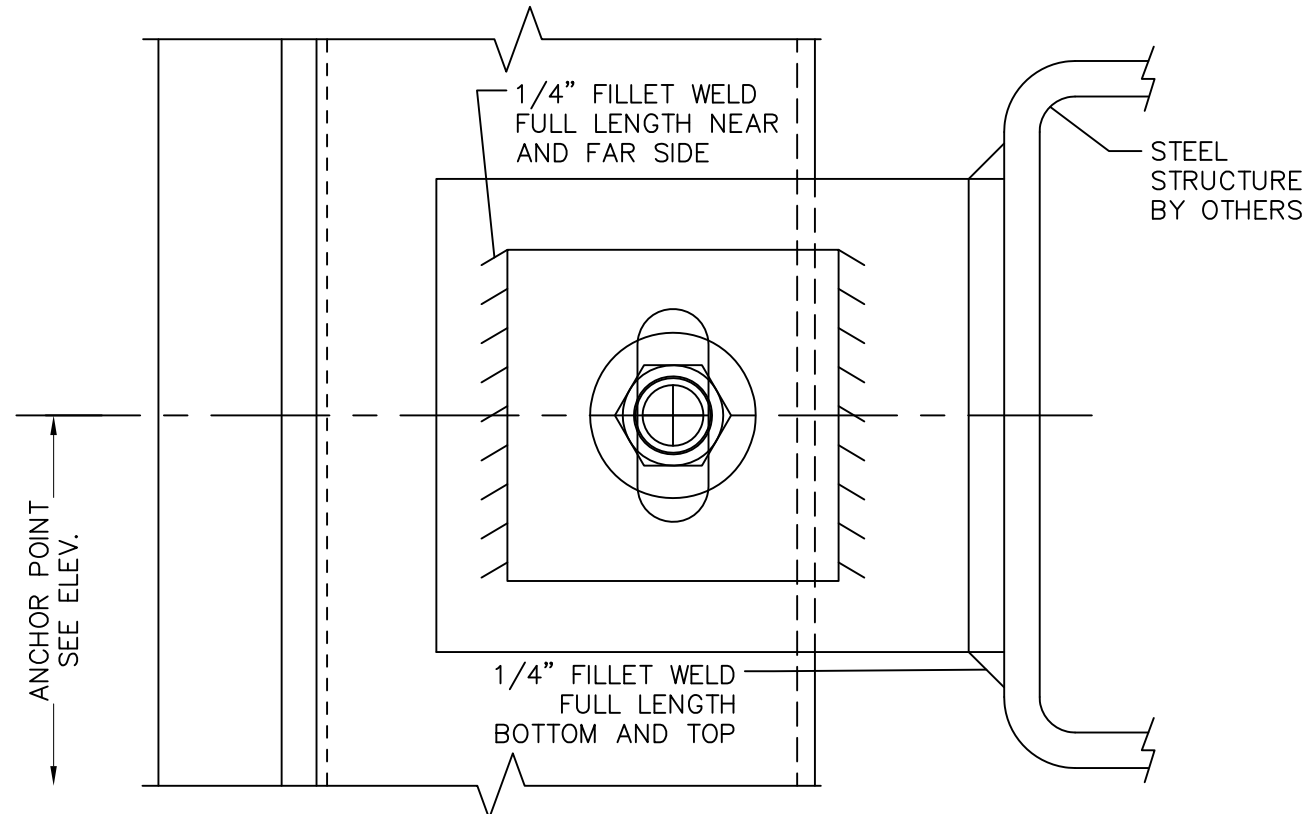

STEEL ANCHOR PARTS BY OTHERS

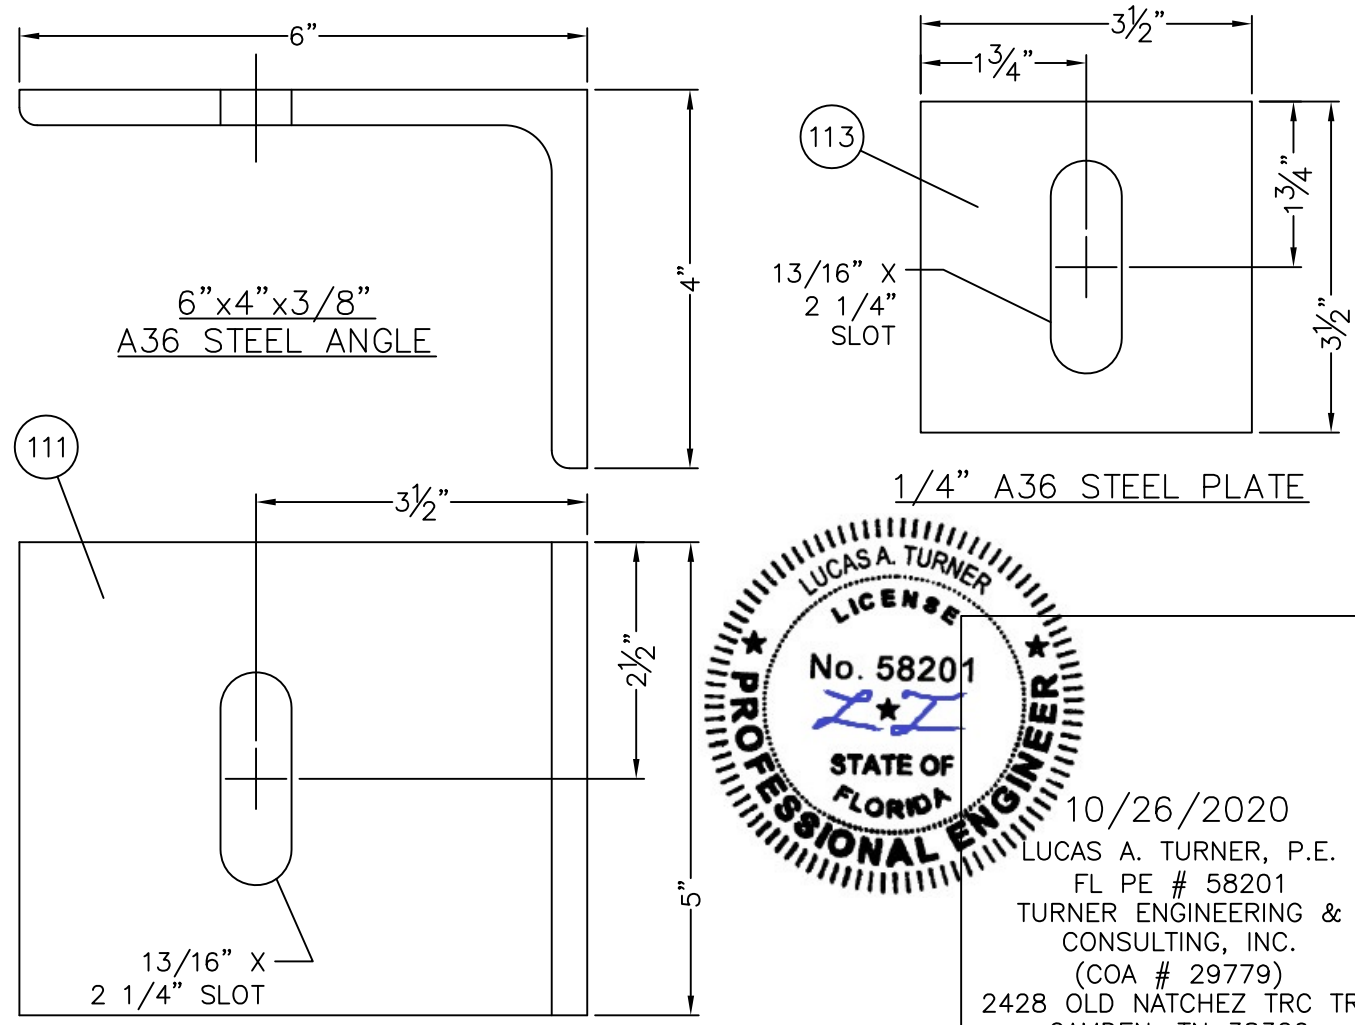

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

TUBELITE
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS

REVISION HISTORY:

REV	DATE	DESCRIPTION	DRAWN
O	5.7.14	ORIGINAL RELEASE	LT
A	2.26.15	ANCHOR REVISIONS	LT
B	10.26.20	FBC CODE UPDATE	LT

DATE: 05.07.14

DRAWING NUMBER: FPA-400-SSG-NI

DRAWN:

FINAL REVIEW:








SCALE: N.T.S.

REVISION: B



SHEET NAME: ANCHOR DETAILS

SHEET: 10 OF 14

10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320

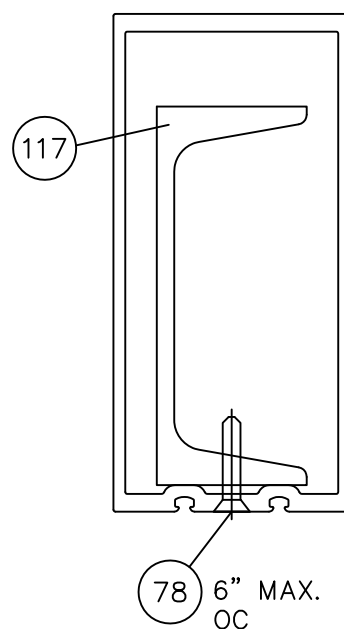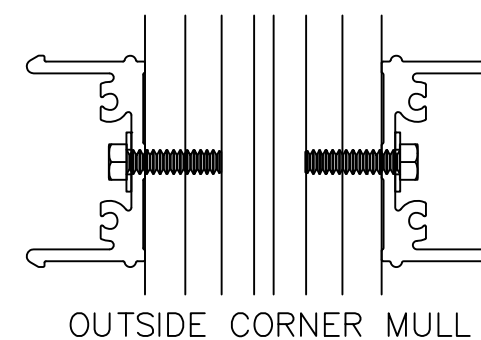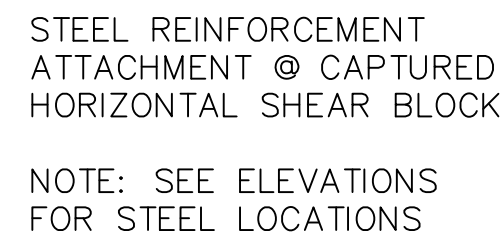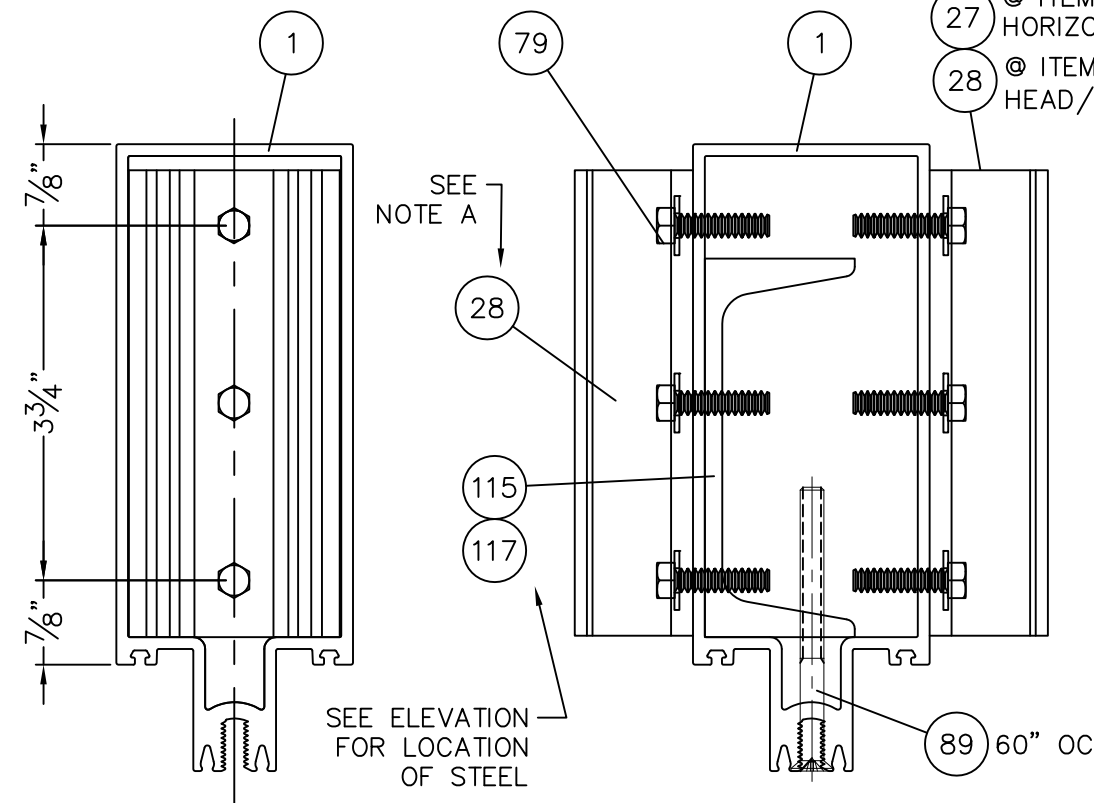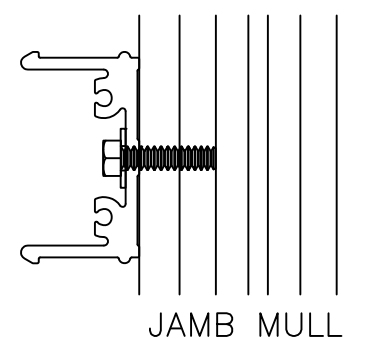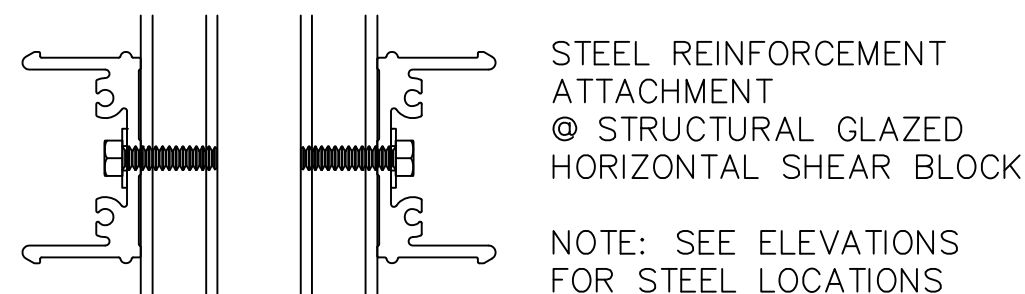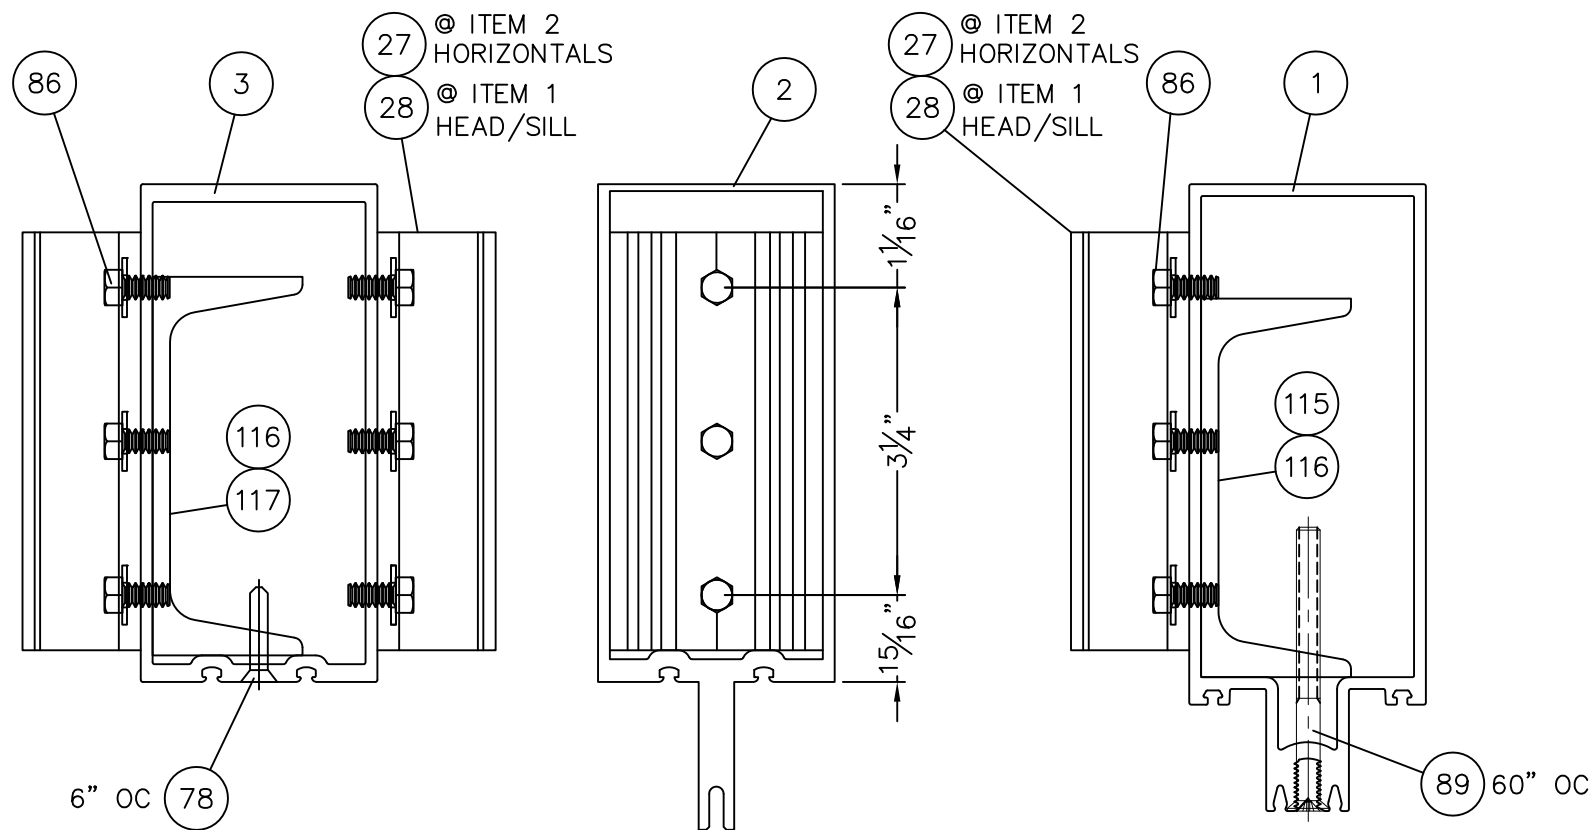

STEEL REINFORCEMENT ATTACHMENT © ITEM 117 (24" LG CHANNEL)

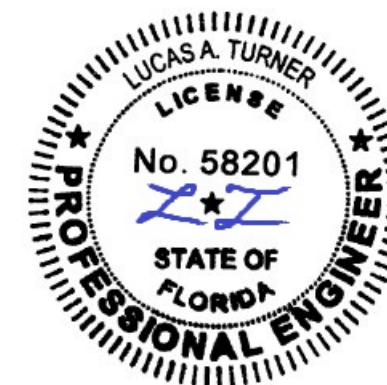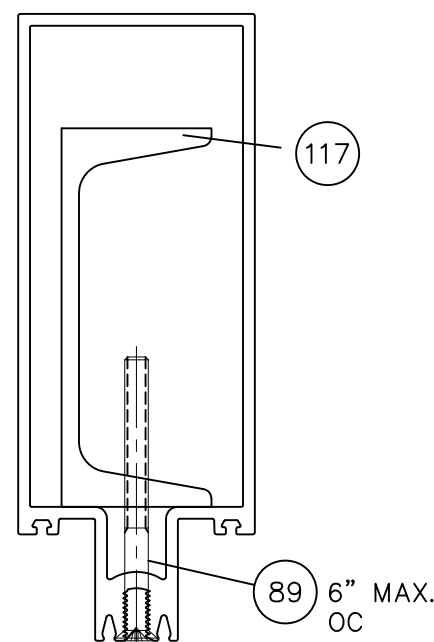

10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING & CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
WALKER, MICHIGAN 49544
PH: 800.866.2227
FX: 616.301.0008
WEB SITE: WWW.TUBELITEINC.COM

TUBELITE
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS

REVISION HISTORY:

REV	DATE	DESCRIPTION
O	5.7.14	ORIGINAL RELEASE
A	2.26.15	ANCHOR REVISIONS
B	10.26.20	FBC CODE UPDATE

DATE: 05.07.14

DRAWING NUMBER: FPA-400-SSG-NI

DRAWN:

FINAL REVIEW:

SCALE: N.T.S.

REVISION: B

SHEET NAME:

ASSEMBLY DETAILS

SHEET: 11 OF 14

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
 WALKER, MICHIGAN 49544
 PH: 800.866.2227
 FX: 616.301.0008
 WEB SITE: WWW.TUBELITEINC.COM

TUBELITE
 DEPENDABLE
 LEADERS IN ECO-EFFICIENT STOREFRONT,
 CURTAINWALL AND ENTRANCE SYSTEMS

REVISION HISTORY:

REV	DATE	DRAWN	DESCRIPTION
O	5.7.14	LT	ORIGINAL RELEASE
A	2.26.15	LT	ANCHOR REVISIONS
B	10.26.20	LT	FBC CODE UPDATE

DATE: 05.07.14

DRAWING NUMBER: FPA-400-SSG-NI

DRAWN:

FINAL REVIEW:

SCALE: N.T.S.


REVISION: B

SHEET NAME:

ASSEMBLY DETAILS


SHEET: 12 OF 14

SEALING NOTE:
 DOW 995 CAULK END OF ALL HORIZONTAL
 EXTRUSIONS PRIOR TO ASSEMBLY. AND CAULK
 PERIMETER OF WATER DAM AFTER ASSEMBLY

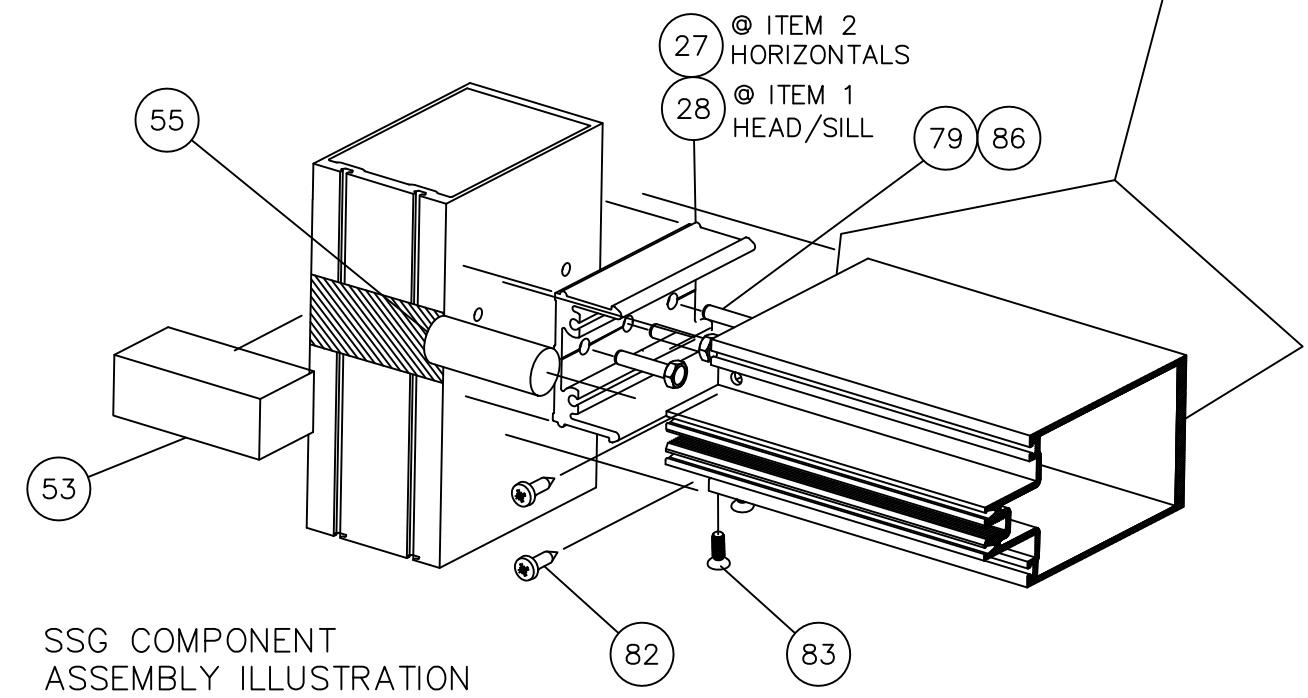

SSG COMPONENT
 ASSEMBLY ILLUSTRATION


NOTE: AT CORNER
 MULL CUT WATER DAM
 BLOCK AS REQ'D AND
 SEAL W/ 995 CAULK

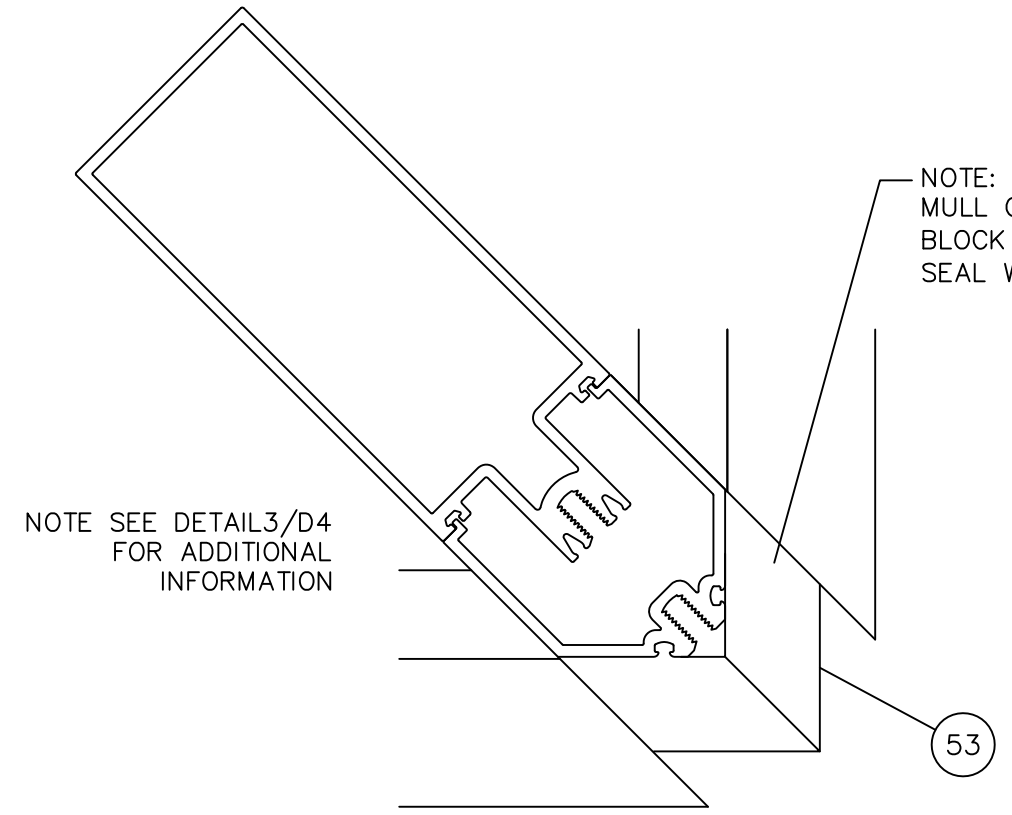

SSG COMPONENT
 ILLUSTRATION

NOTE SEE DETAIL3/D4
 FOR ADDITIONAL
 INFORMATION


SEALING NOTE:
 DOW 995 CAULK END
 OF ALL HORIZONTAL
 EXTRUSIONS PRIOR TO
 ASSEMBLY. AND CAULK
 PERIMETER OF WATER
 DAM AFTER ASSEMBLY

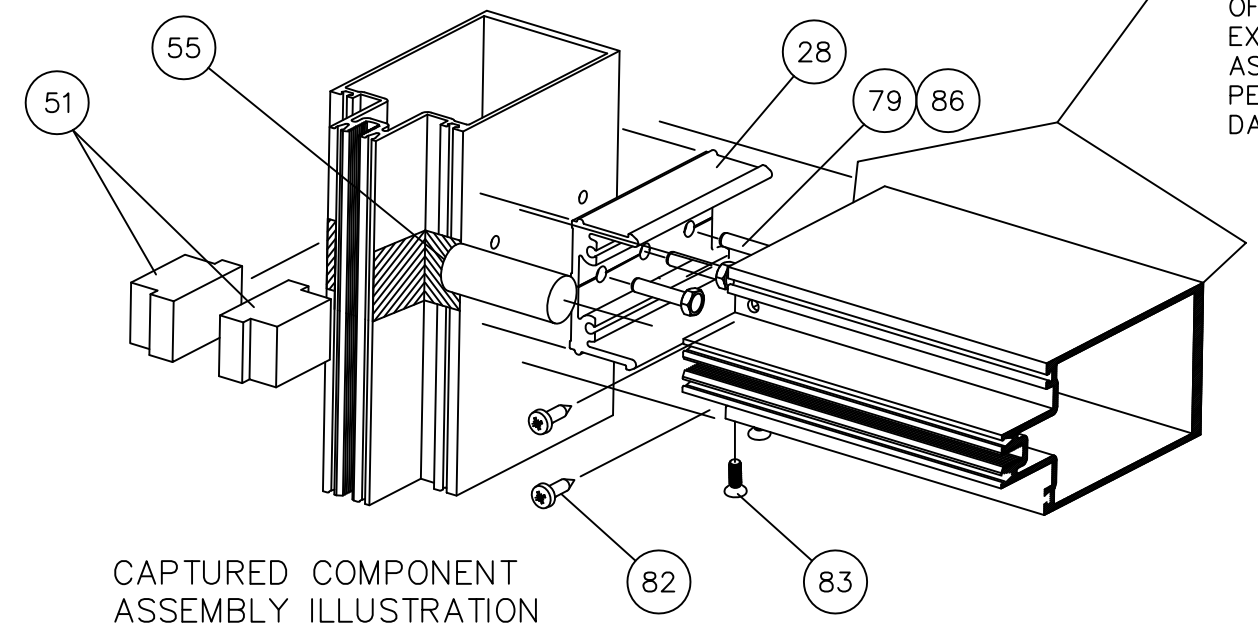


CAPTURED COMPONENT
 ASSEMBLY ILLUSTRATION




10/26/2020
 LUCAS A. TURNER, P.E.
 FL PE # 58201
 TURNER ENGINEERING &
 CONSULTING, INC.
 (COA # 29779)
 2428 OLD NATCHEZ TRC TRL
 CAMDEN, TN 38320

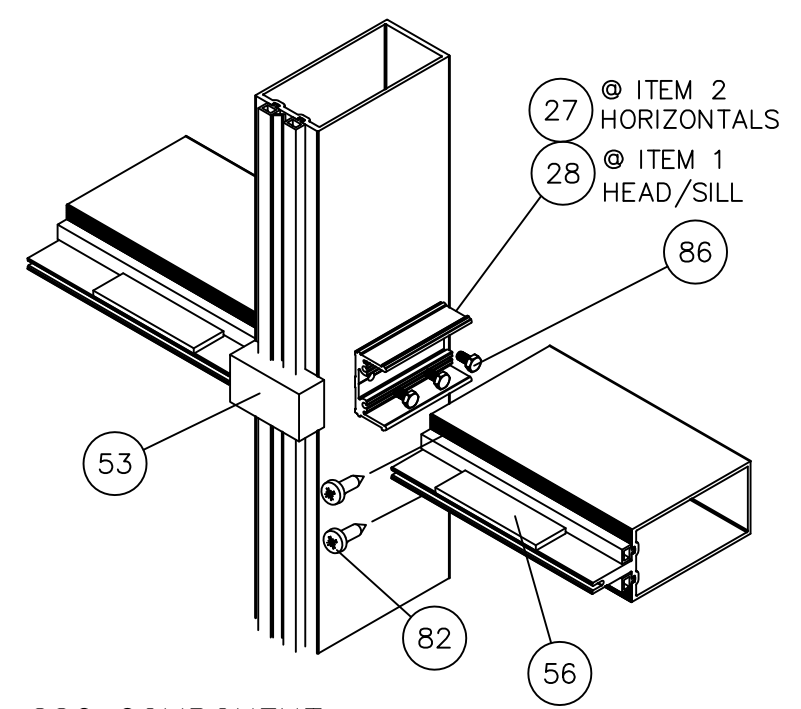


SSG COMPONENT
 ASSEMBLY ILLUSTRATION

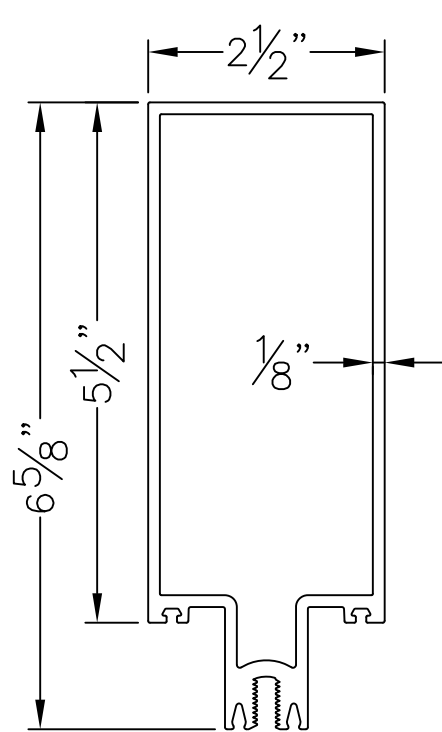


ITEM 1 – E55TB02FS
CURTAINWALL TUBE

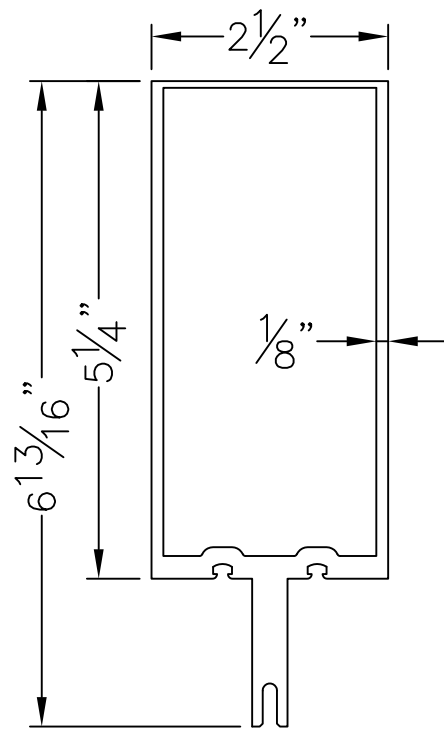


ITEM 2 – E5TB252FS
CURTAINWALL TUBE

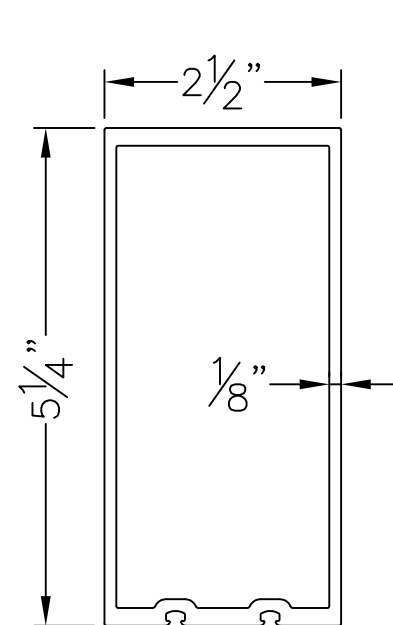


ITEM 3 –
E55TB04FS
CURTAINWALL
STRUCTURAL
GLAZING TUBE

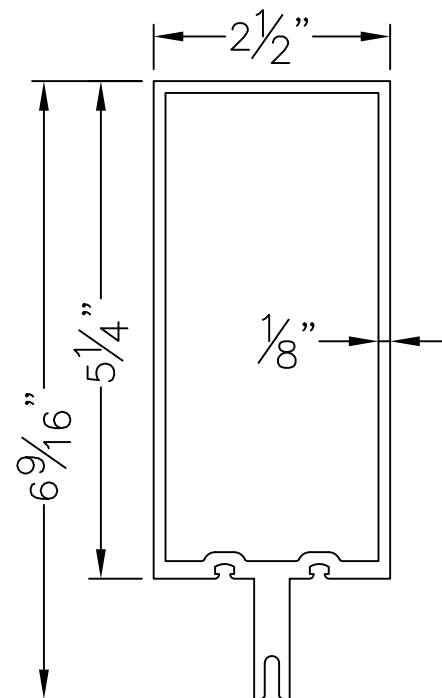


ITEM 4 – E5TB108B
CURTAINWALL TUBE

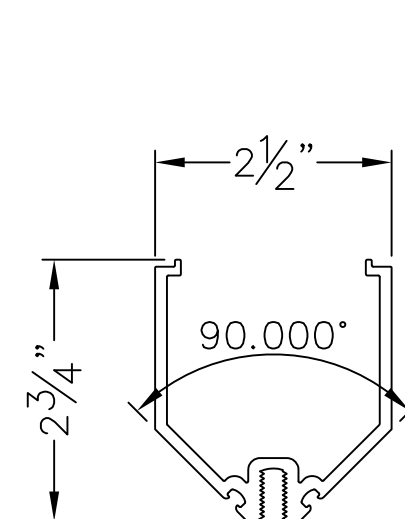


ITEM 5 – E5TB67FS
OUTSIDE CORNER
BUTT GLAZED
CURTAINWALL ADAPTOR

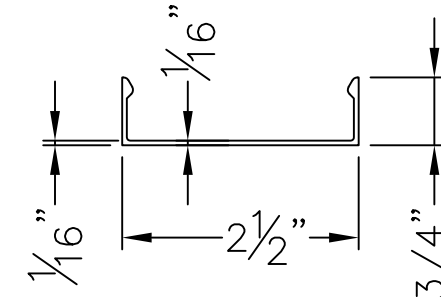


ITEM 6 – E4TB64FS
COVER, FACE
2-1/2 X 3/4

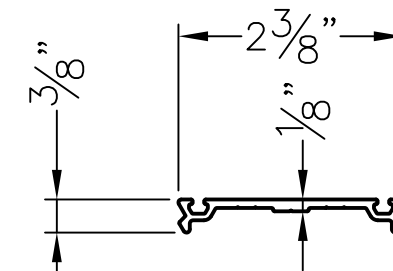


ITEM 8–M4TB224
PRESSUE PLATE (1")

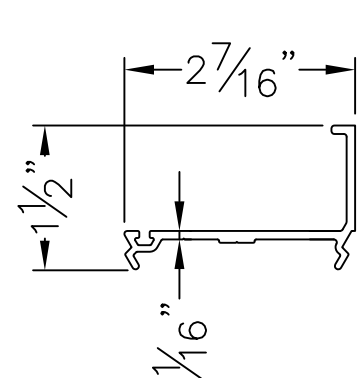


ITEM 10–M4TB225
CURTAINWALL FILLER–
PRESSUE PLATE (1")

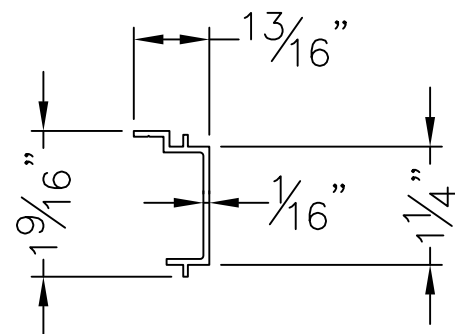


ITEM 13 – E3192
GLAZING POCKET
CLOSURE (1")

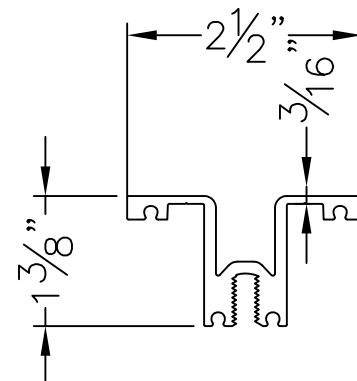


ITEM 16 –
E4TB170FS SCREW
APPLIED HORN

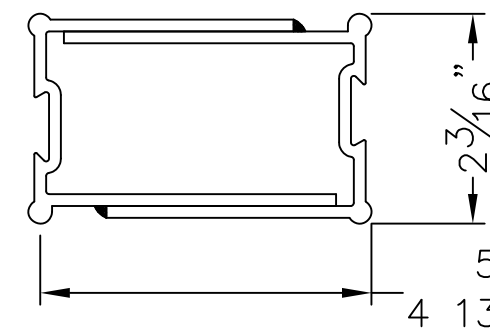


ITEM 23 & 24
P1627D ~ USE WITH ITEM 1
P1627J ~ USE WITH ITEM 3
MULL SPLICE 10" LG

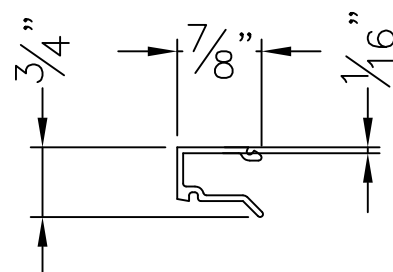


ITEM 25 – P1631
FILLER 10" LG

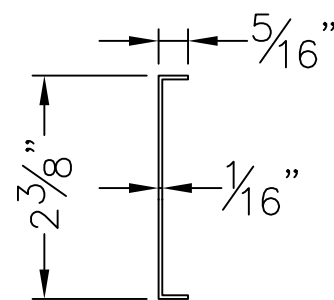


ITEM 26 – P1628B
FACE COVER SPLICE
SLEEVE 4" LG

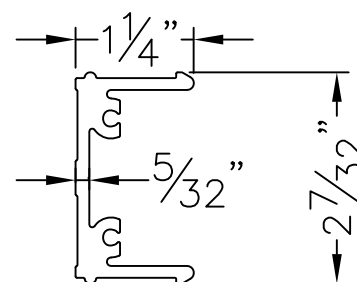

E4TB113 – EXTRUSION
ITEM 27 – PTB59
ITEM 28 – PTB60
SHEAR BLOCK CLIP

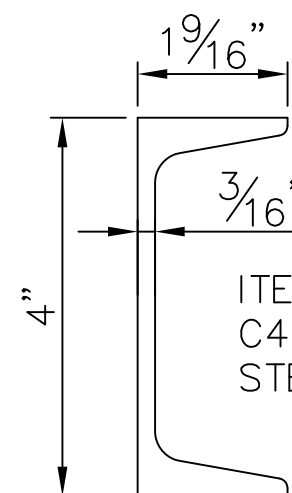

ITEM 115–118
C4 X 5.4 A36
STEEL CHANNEL

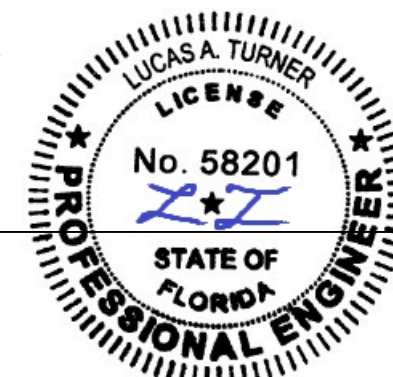

10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

3056 WALKER RIDGE DRIVE N.W.
WALKER, MICHIGAN 49544
PH: 800.866.2227
FX: 616.501.0008
WEB SITE: WWW.TUBELITEINC.COM

TUBELITE
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS

REVISION HISTORY:

REV	DATE	DESCRIPTION	DRAWN
O	5.7.14	ORIGINAL RELEASE	LT
A	2.26.15	ANCHOR REVISIONS	LT
B	10.26.20	FBC CODE UPDATE	LT

DATE: 05.07.14

DRAWING NUMBER: FPA-400-SSG-NI

DRAWN:

FINAL REVIEW:

SCALE: N.T.S.

REVISION: B


SHEET NAME:

PART DRAWINGS

SHEET: 13 OF 14

CW 400 SSG NON-IMPACT – PARTS LIST			
ITEM	PART NUMBER	DESCRIPTION	MATERIAL
1	E55TB02FS	EXTRUSION, TUBE, NON-THERMAL	ALUMINUM – 6063-T6
2	E5TB252FS	EXTRUSION, TUBE SSG HORIZONTAL	ALUMINUM – 6063-T5
3	E55TB04FS	EXTRUSION, TUBE, STRUCTURAL GLAZING	ALUMINUM – 6063-T6
4	E55TB108B	EXTRUSION, TUBE SSG HORIZONTAL	ALUMINUM – 6063-T5
5	E5TB67FS	EXTRUSION, OUTSIDE BUTT GLAZED CORNER	ALUMINUM – 6063-T5
6	E4TB64FS	EXTRUSION, COVER, FACE, 2-1/2 X 3/4	ALUMINUM – 6063-T5
8	M4TB224	EXTRUSION, PRESSURE PLATE (1")	ALUMINUM – 6063-T5
10	M4TB225	EXTRUSION, FILLER-PRESSURE PLATE (1")	ALUMINUM – 6063-T5
13	E3192	EXTRUSION, GLAZING POCKET FILLER (1")	ALUMINUM – 6063-T5
16	E4TB170FS	EXTRUSION, SCREW APPLIED HORN	ALUMINUM – 6063-T5
23	P1627D	MULL SPLICE FOR ITEM 1	ALUMINUM – 6063-T5
24	P1627J	MULL SPLICE FOR ITEM 3	ALUMINUM – 6063-T5
25	P1631	MULL SPLICE FILLER FOR ITEM 1	ALUMINUM – 6063-T5
26	P1628B	FACE COVER SPLICE SLEEVE	ALUMINUM – 6063-T5
27	PTB59F	SHEAR BLOCK	ALUMINUM – 6063-T5
28	PTB60F	SHEAR BLOCK	ALUMINUM – 6063-T5
29	PTB21A/B	ANCHOR, 'T' CUT & PRE-DRILLED. LG P/N A=4.761", B=5.053"	ALUMINUM – 6063-T6
30	PTB20A/B	ANCHOR, 'F' CUT & PRE-DRILLED. LG P/N A=4.761", B=5.053"	ALUMINUM – 6063-T6
31	PTB22	ANCHOR, 'U' CUT & PRE-DRILLED	ALUMINUM – 6063-T6
47	PTB42	WEEP BAFFLE	P-PART – FOAM
48	PTB94	GASKET, THERMAL BARRIER, EPG (PRESSURE PLATE)	P-PART – RUBBER
49	PTB28	GLAZING, FIXED, 1/8 THICK (CW)	P-PART – RUBBER
50	PTB75	GASKET, STRUCTURAL GLAZING	P-PART – RUBBER
51	PTB93	WATER DAM SINGLE POCKET	P-PART – RUBBER
53	PTB76A	WATER DAM 1"	P-PART – RUBBER
55	P1094	ROD, ETHAFOAM 3/4" DIA X 2" LONG	P-PART – FOAM
56		BLOCK, SETTING, 3/16" x 1" x 4" LG	P-PART – SILICONE
57	P6551	GLAZING TAPE 1/4 x 3/8 (THERMALBOND V2100 OR V2200)	P-PART – FOAM
58	P6552	GLAZING TAPE 1/8 x 1/4 (THERMALBOND V2100 OR V2200)	P-PART – FOAM
59	BY OTHERS	TWO FACE TAPE	P-PART – FOAM
61	TREMCO SGT 922	GLAZING TAPE 1/4 x 3/8	P-PART – FOAM
62	TREMCO SGT 922	GLAZING TAPE 1/8 x 1/4	P-PART – FOAM
75	BY OTHERS	BOLT, 3/4-10 X 5 1/4 HEX HEAD CLASS 2A	P-PART – FASTENER
76	BY OTHERS	3/4 FLAT WASHER	P-PART – FASTENER
77	BY OTHERS	3/4-10 HEX HEAD NYLOCK NUT	P-PART – FASTENER
78	S207	SCREW, 10-24 X 1 1/4 FLAT HEAD PHIL	P-PART – FASTENER
79	S328	SCREW, 1/4-20 X 1 HEX HEAD TYPE D (shear block)	P-PART – FASTENER
82	S270	SCREW, 10-24 X 3/4 PAN HEAD PHIL, SS (shear block)	P-PART – FASTENER
83	S6505	SCREW, 1/4-20 X 3/4 FLAT HEAD CLASS 2A (shear blk & mull splice)	P-PART – FASTENER
84	S359	SCREW, 1/4-20 1-1/2 HEX HD TYPE F (pres plate)	P-PART – FASTENER
85	S191	SCREW, 10-24 X 1/2 TRUSS HEAD PHIL (horiz mull & dr stop)	P-PART – FASTENER
86	S139	SCREW, 1/4-20 X 1/2 HEX HEAD TYPE B (shear blk)	P-PART – FASTENER
87	S369	SCREW, 1/4-20 3/4 HEX HD TYPE CA (pres plate & subframe w/ shim)	P-PART – FASTENER
88	S131	SCREW, 8-32 5/16 FLAT HEAD PHIL (lock face plate)	P-PART – FASTENER
89	S155	SCREW, 1/4-20 X 3" FLAT HEAD PHIL (reinforcing steel)	P-PART – FASTENER
91	BY OTHERS	INSTALLATION ANCHORS AND WASHERS, SEE TABLE D, SHEET 2	
96	S211	SCREW, 1/4-20 X 2 1/4 PAN HEAD PHIL, SS	P-PART – FASTENER


ITEM	PART NUMBER	DESCRIPTION	MATERIAL
99	BY OTHERS	DOW 795 SILICONE BUILDING SEALANT	
100	BY OTHERS	DOW 995 SILICONE SEALANT BLACK – STRUCTURAL GLAZING	
101	BY OTHERS	3/4 ø BACKER ROD– STRUCTURAL GLAZING	
102	BY OTHERS	1 1/4 ø BACKER ROD– STRUCTURAL GLAZING	
108	P6600	TUBE, 2"x4"x11 GA (.120) WALL (120" LG)	A36 STEEL
109	P6601	TUBE, 2"x4"x1/4" WALL (120" LG)	A36 STEEL
111	P6603	ANGLE 6"x4"x3/8"	A36 STEEL
112	P6604	FORMED ANGLE 7"x4"x3/8"	A36 STEEL
113	P6605	PLATE 3 1/2"x3 1/2"	A36 STEEL
115	P6606	CHANNEL C4x5.4 (84" LG)	A36 STEEL
116	P6607	CHANNEL C4x5.4 (198" LG)	A36 STEEL
117	P6608	CHANNEL C4x5.4 (24" LG)	A36 STEEL
118	P6609	CHANNEL C4x5.4 (120" LG)	A36 STEEL

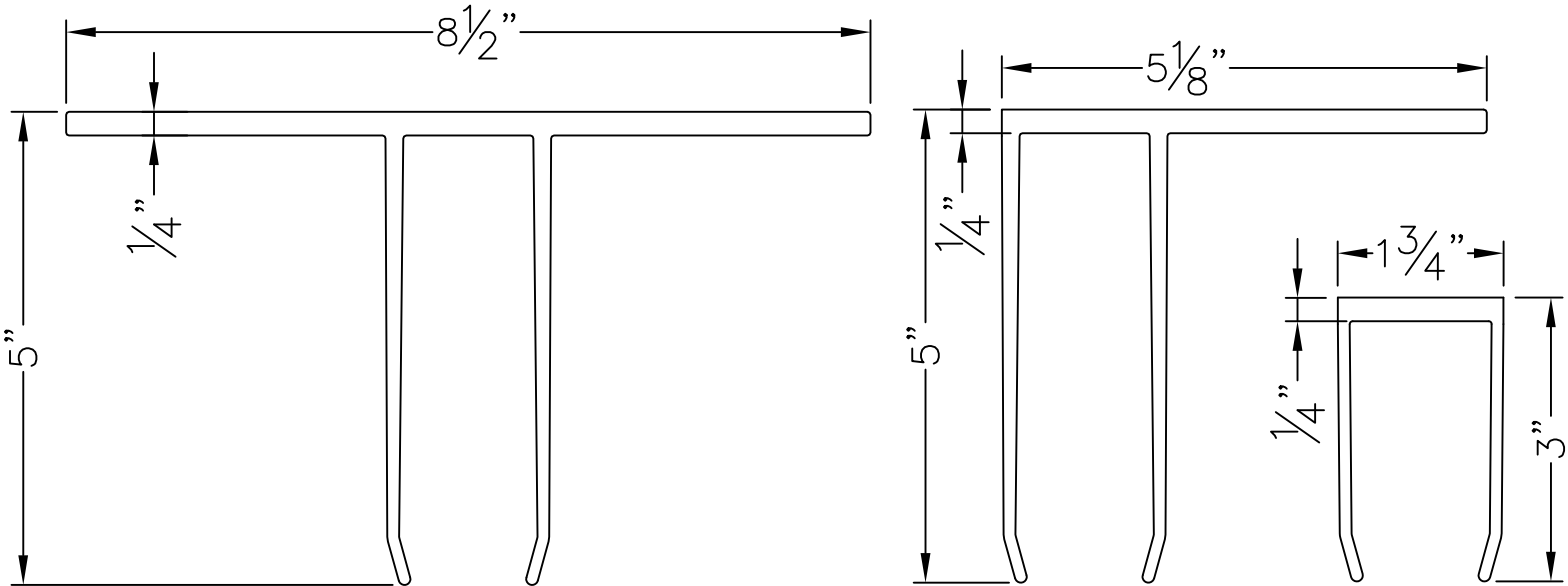


ITEM 29 – PTB21
T ANCHOR

ITEM 30 – PTB20
F ANCHOR


ITEM 31 – PTB22
U ANCHOR

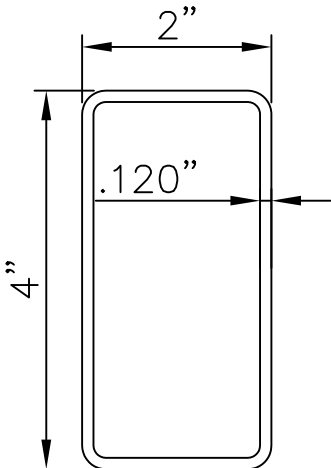

ITEM 108 P6600
2"x4"x .120
A36 STEEL TUBE

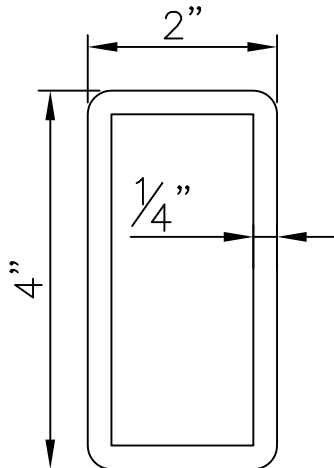

ITEM 109 P6601
2"x4"x 1/4
A36 STEEL TUBE

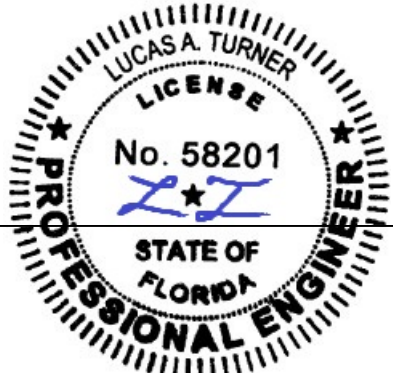

10/26/2020
LUCAS A. TURNER, P.E.
FL PE # 58201
TURNER ENGINEERING &
CONSULTING, INC.
(COA # 29779)
2428 OLD NATCHEZ TRC TRL
CAMDEN, TN 38320

TUBELITE
CW 400 SSG NON-IMPACT
CURTAIN WALL SYSTEM

TUBELITE®
DEPENDABLE
LEADERS IN ECO-EFFICIENT STOREFRONT,
CURTAINWALL AND ENTRANCE SYSTEMS
3056 WALKER RIDGE DRIVE N.W.
WALKER, MICHIGAN 49544
PH: 800.866.2227
FX: 616.301.0008
WEB SITE: WWW.TUBELITEINC.COM

REVISION HISTORY:

REV	DATE	DESCRIPTION
O	5.7.14	ORIGINAL RELEASE
A	2.26.15	ANCHOR REVISIONS
B	10.26.20	FBC CODE UPDATE

DATE:	05.07.14
DRAWING NUMBER:	FPA-400-SSG-NI
DRAWN:	
FINAL REVIEW:	
SCALE:	N.T.S.
REVISION:	B
SHEET NAME:	BOM, PART DWGS
SHEET:	14 OF 14