





JM Eagle
15661 Delano Road
Cochranton PA, 16314

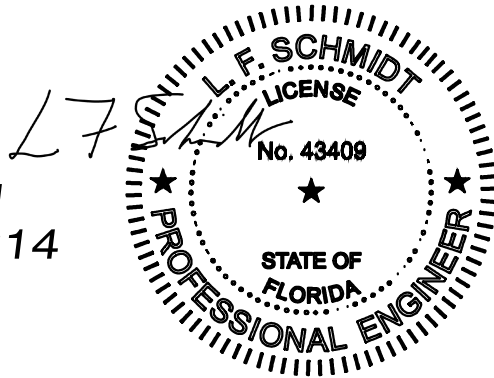

Digitally signed by Lyndon F Schmidt
Date: 2023.07.03 07:33:41 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA




PF™ COMPOSITE DOOR JAMB
INSWING / OUTSWING
"IMPACT"

PF™ COMPOSITE JAMB

GENERAL NOTES

- 1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
- 2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- 3. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
- 4. This "IMPACT" door jamb, as a component, is to be used as a substitute to a similar door jamb in an impact approval (complies with FBC Sections 1609.1.2 & R301.2.1.2) door system possessing a current Florida Statewide Product Approval.
- 5. The design pressure of the assembly shall be the lesser of the design pressure for the door jamb shown in this approval or the design pressure of the door assembly used in conjunction with this approval.
- 6. The maximum frame size of the door assembly shall be lesser of the maximum frame size stated in this approval or the maximum frame size of door assembly approval used in conjunction with this approval.
- 7. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

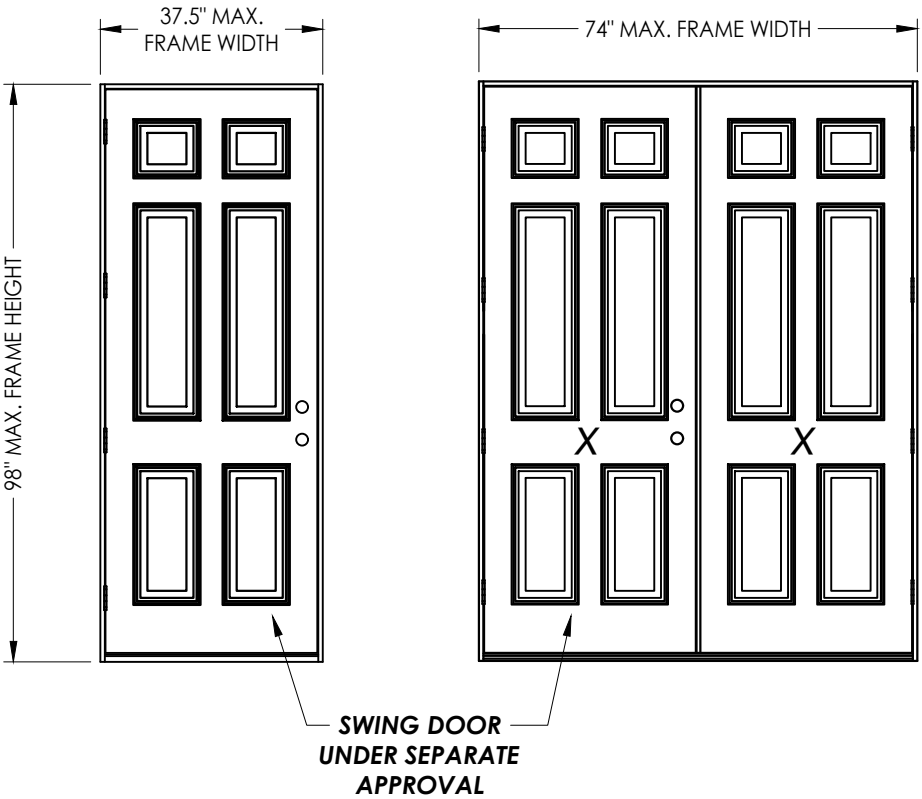

CONFIGURATION	MAX. FRAME DIMENSION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	37.5" x 98.0"	+60.0	-60.0	+65.0	-65.0
XX	74.0" x 98.0"	+60.0	-60.0	+65.0	-65.0

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Elevations
3	Horizontal cross sections
4	Vertical cross sections
5	Buck and frame anchoring (X)
6	Buck and frame anchoring (XX)
7	Bill of materials and components

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
JM Eagle
COMPONENTS

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

57/01/23UPDATE TO 8TH ED. (2023) FBC

48/07/20UPDATE TO 7TH ED. (2020) FBC

310/03/17UPDATE TO 6TH ED. (2017) FBC

22/27/15UPDATE TO 5TH ED. (2014) FBC

18/27/14Rev. Per Public Comments

NO. DATE

REVISIONS

DATE: 5/28/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-17055.2


SHEET 1 OF 7

© 2014 R.W. BUILDING CONSULTANTS INC.


RW

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\JM Eagle\FL-17055 R4\FL-17055.1-4.dwg

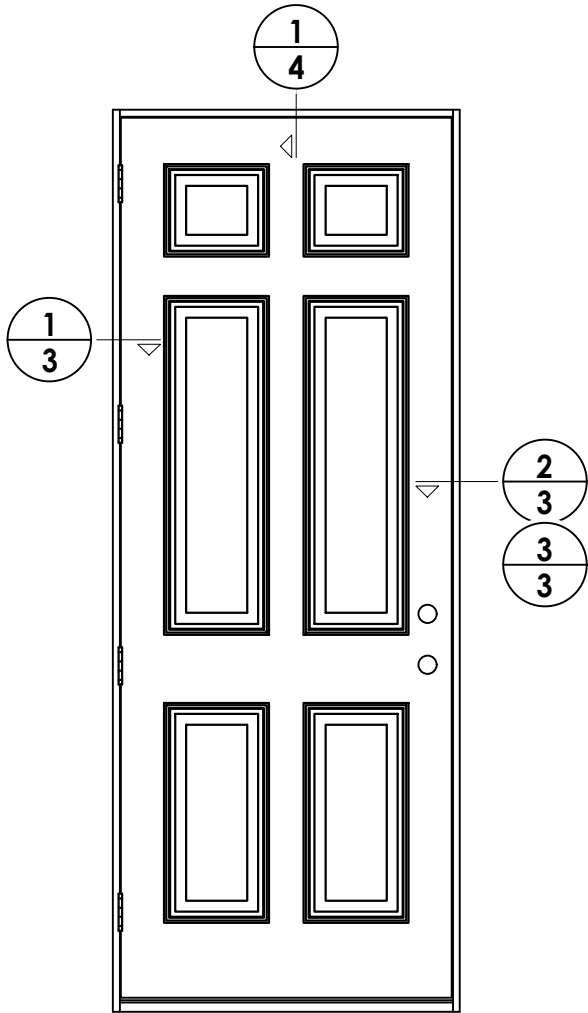



SINGLE DOOR ELEVATION

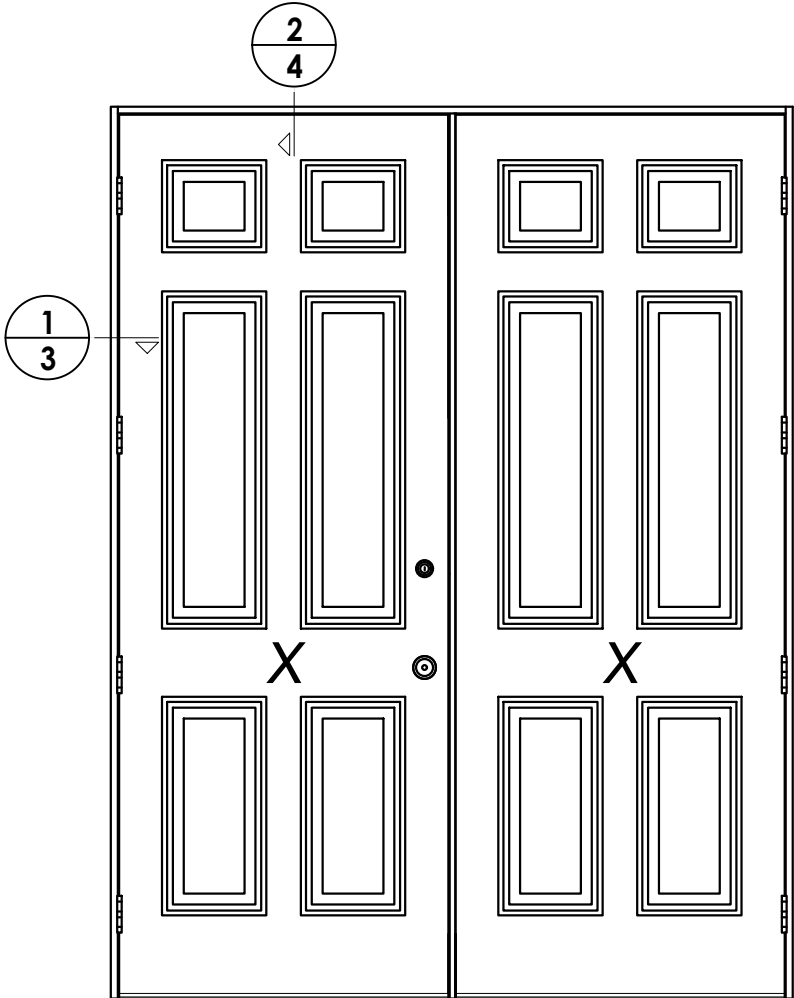


DOUBLE DOOR ELEVATION

DATE: 5/28/14					SHEET 2 OF 7				
SCALE: N.T.S.					DRAWING NO.: FL-17055.2				
DWG. BY: JK					CHK. BY: LFS				
NO.					DATE				
5	7/01/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	REVISIONS				
4	8/07/20	UPDATE TO 7TH ED. (2020)	FBC	LFS					
3	10/03/17	UPDATE TO 6TH ED. (2017)	FBC	JK					
2	2/27/15	UPDATE TO 5TH ED. (2014)	FBC	JK					
1	8/27/14	Rev. Per Public Comments		JK					
PRODUCT:					PART OR ASSEMBLY:				
JM Eagle COMPONENTS					ELEVATIONS				
Documents Prepared By:					R ^W BUILDING CONSULTANTS, INC.				
Lyndon F. Schmidt					P.O. Box 230, Valrico, FL 33595				
P.E. No. 43409					Phone No.: 813.659.9197				
					FBPE Registry No. 9813				

Z:\2023 FBC Drawings\JM Eagle\FL-17055 R4\FL-17055.1-4.dwg

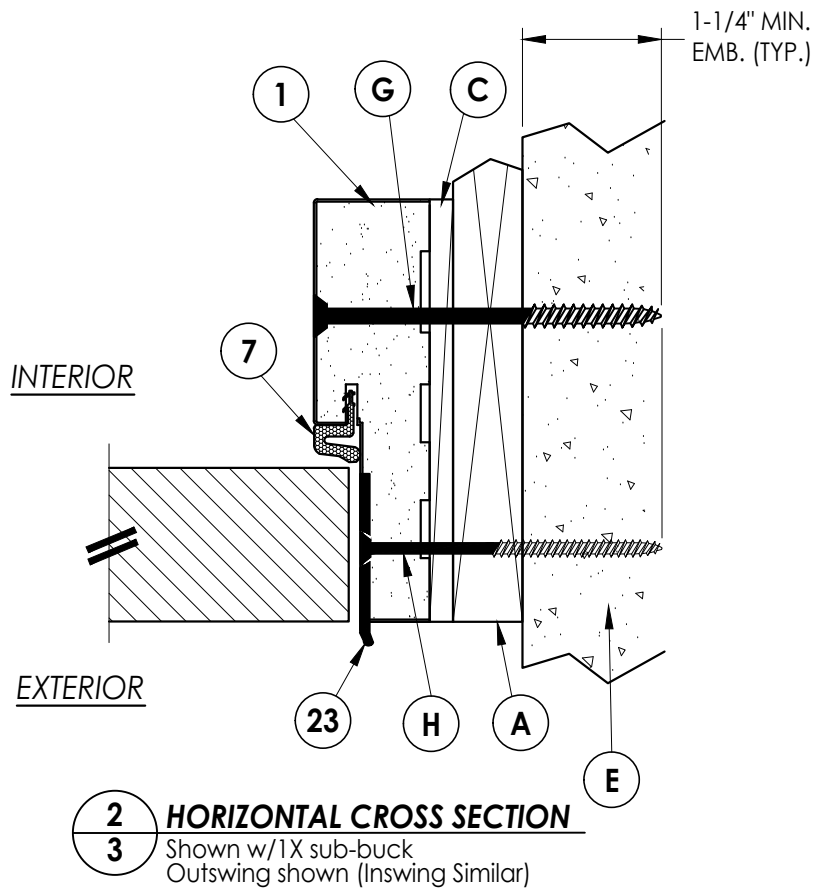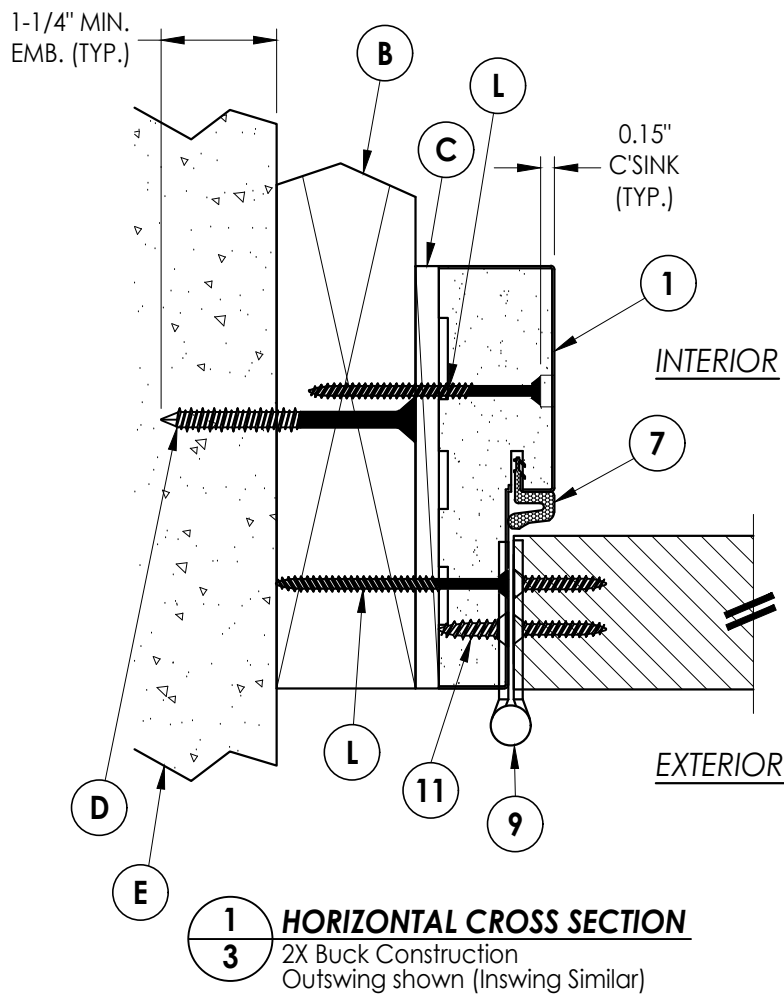

Note:
See separate Side-hinged door
Product Approval for door construction details
not shown, including lock hardware, astragal, hinge
and threshold connections.

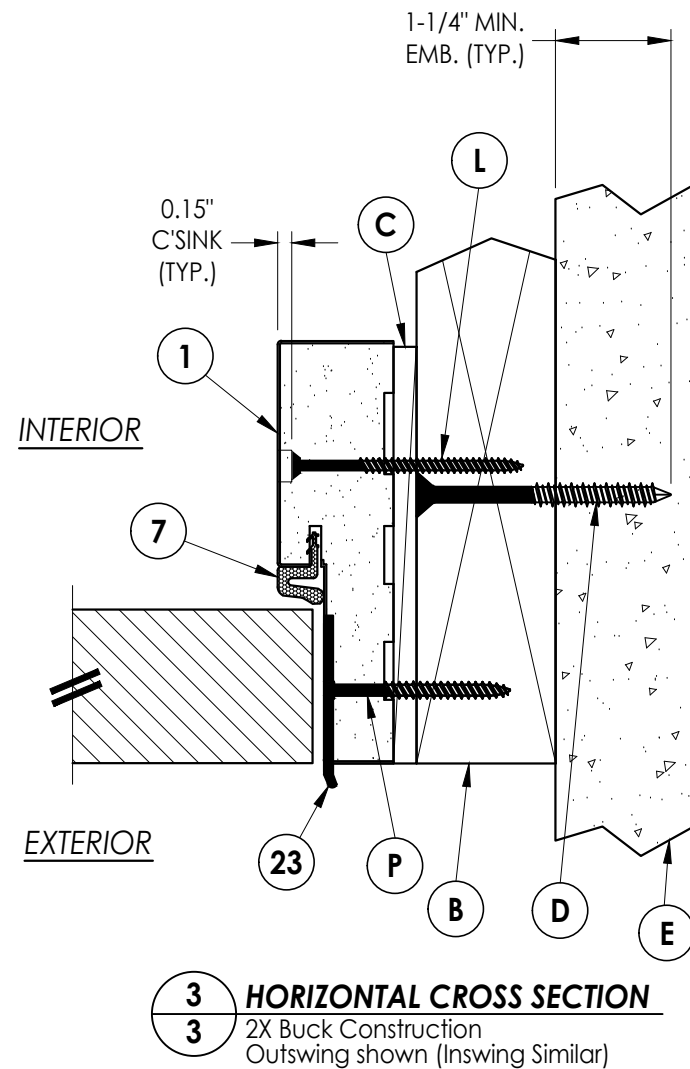

NO.	DATE	REVISIONS				
		DATE	BY	JK	JK	BY
5	7/01/23	UPDATE TO 8TH ED. (2023)	FBC	LFS		
4	8/07/20	UPDATE TO 7TH ED. (2020)	FBC	LFS		
3	10/03/17	UPDATE TO 6TH ED. (2017)	FBC	JK		
2	2/27/15	UPDATE TO 5TH ED. (2014)	FBC	JK		
1	8/27/14	Rev. Per Public Comments				

DATE: 5/28/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-17055.2

SHEET 3 OF 7



PRODUCT:	JM Eagle COMPONENTS	PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\JM Eagle\FL-17055 R4\FL-17055.1-4.dwg


Note:
See separate Side-hinged door
Product Approval for door construction details
not shown, including lock hardware, astragal, hinge
and threshold connections.

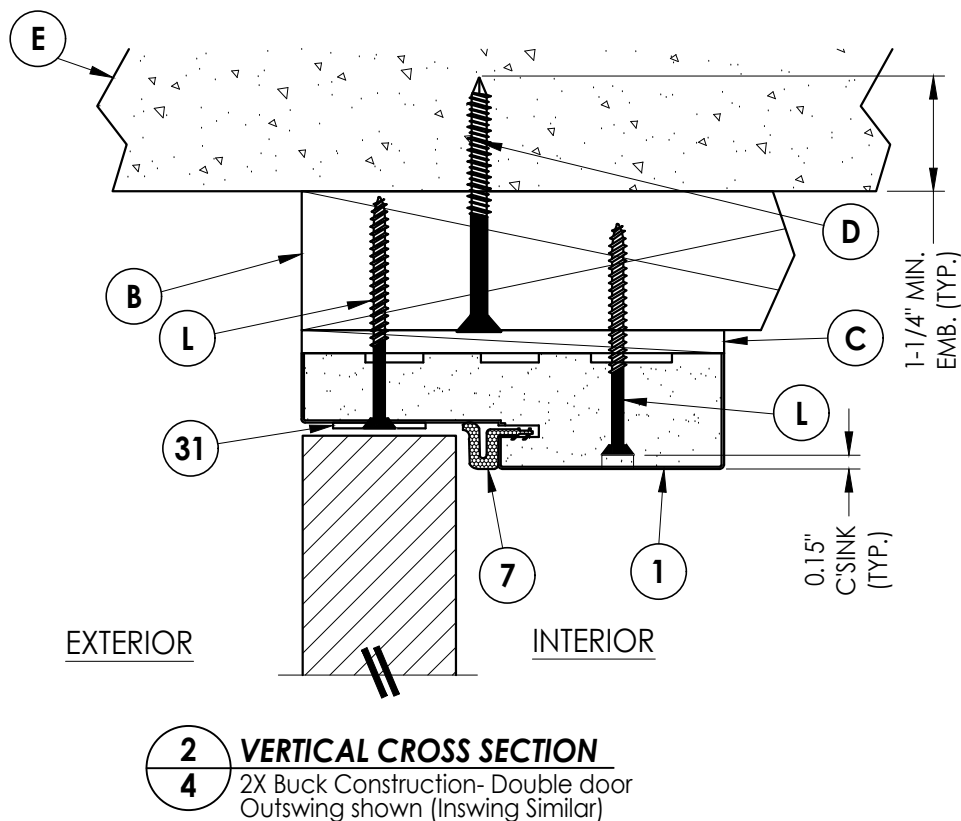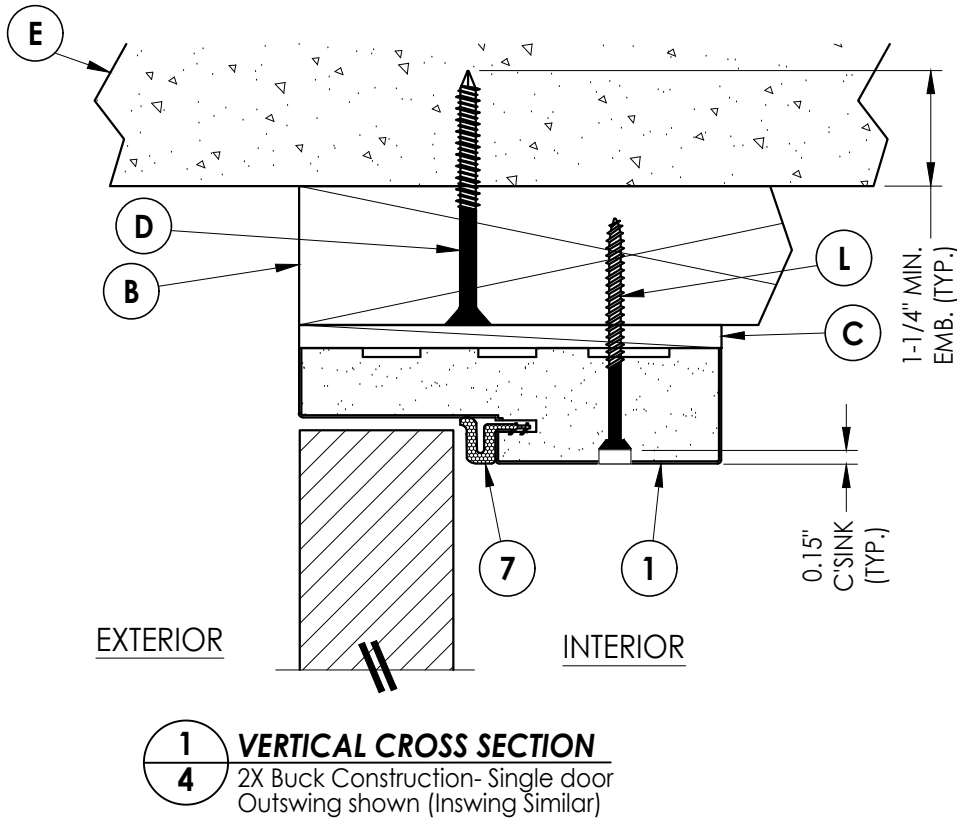


PRODUCT: JM Eagle COMPONENTS		PART OR ASSEMBLY: VERTICAL CROSS SECTIONS	
5	7/01/23	UPDATE TO 8TH ED. (2023)	LFS
4	8/07/20	UPDATE TO 7TH ED. (2020)	LFS
3	10/03/17	UPDATE TO 6TH ED. (2017)	JK
2	2/27/15	UPDATE TO 5TH ED. (2014)	JK
1	8/27/14	Rev. Per Public Comments	JK
NO. DATE		REVISIONS	
DATE: 5/28/14			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-17055.2			
SHEET 4 OF 7			

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409	BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813
---	--


Z:\2023 FBC Drawings\JM Eagle\FL-17055 R4\FL-17055.1-4.dwg

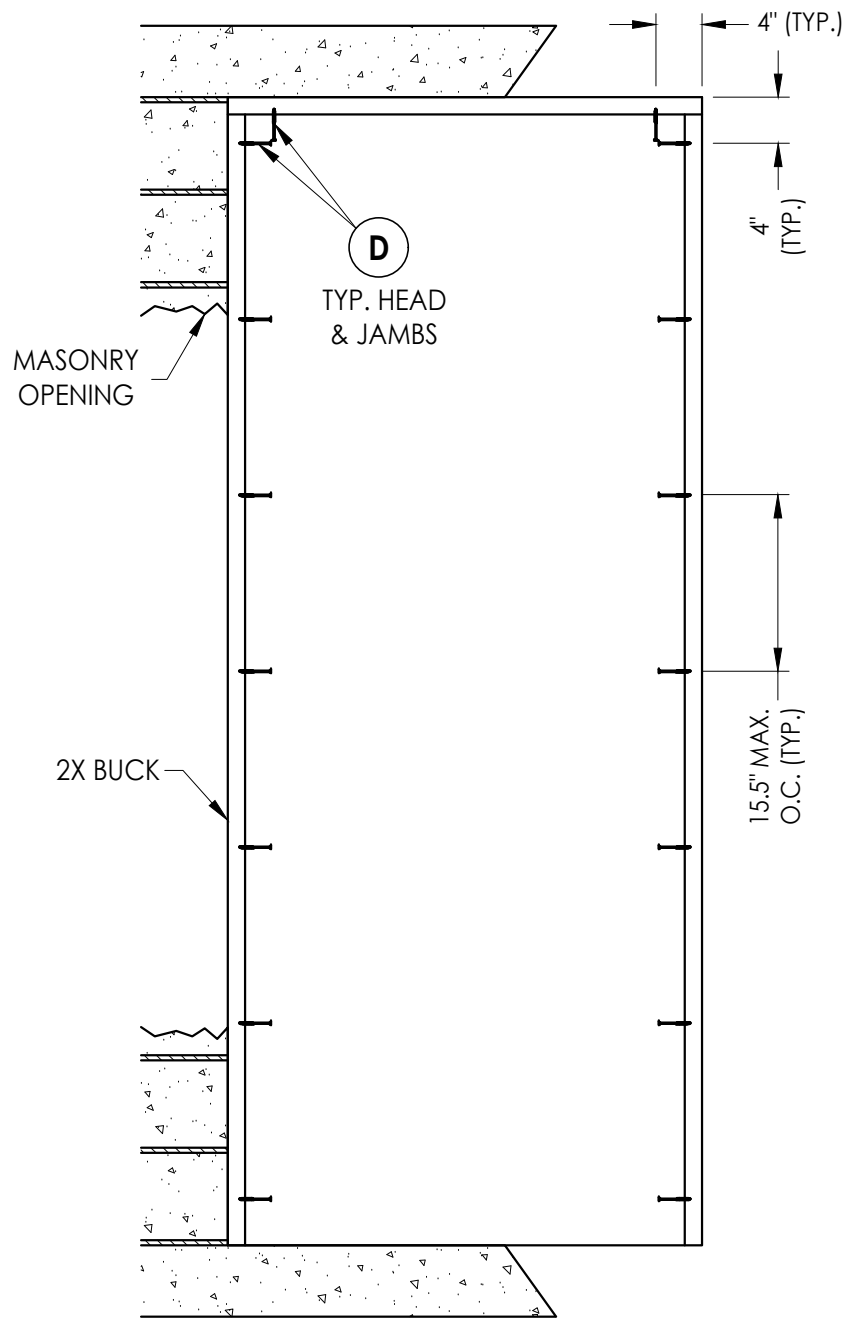


BUCK ANCHORING

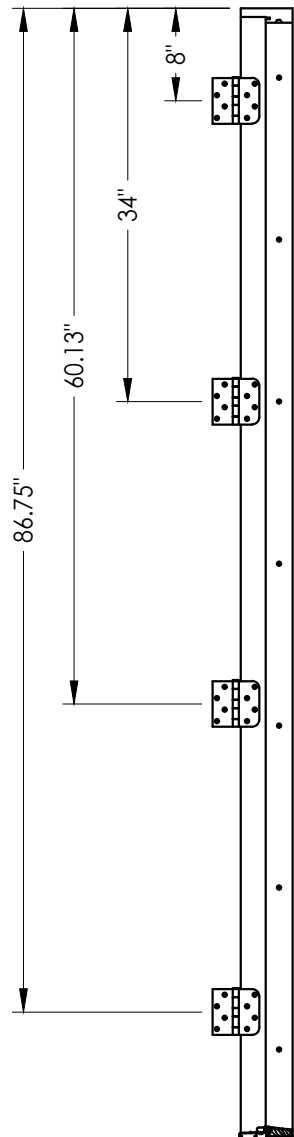

HINGE JAMB

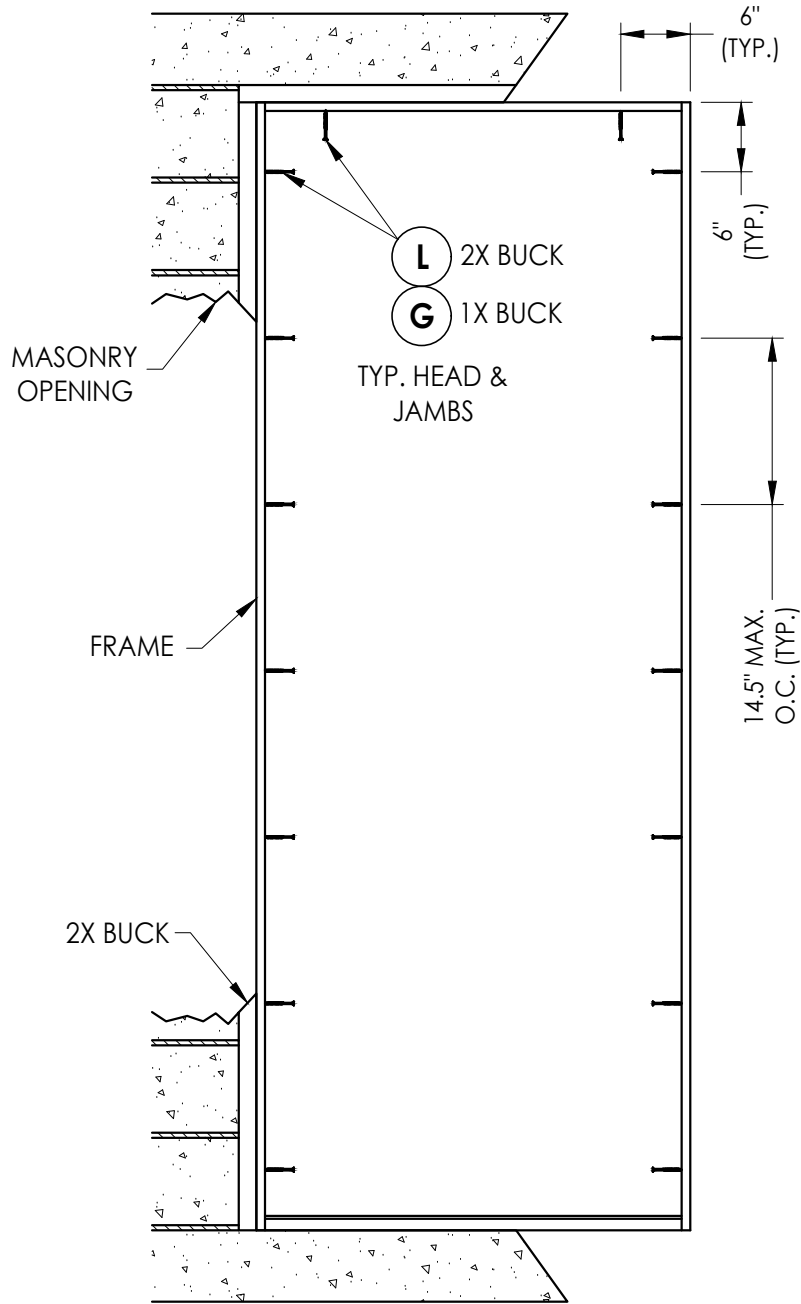

FRAME ANCHORING
Masonry 2X buck construction

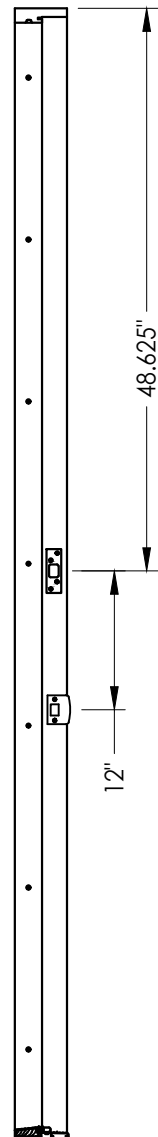

STRIKE JAMB

CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Note:

See separate Side-hinged door Product Approval for door construction details not shown, including lock hardware, astragal, hinge and threshold connections.

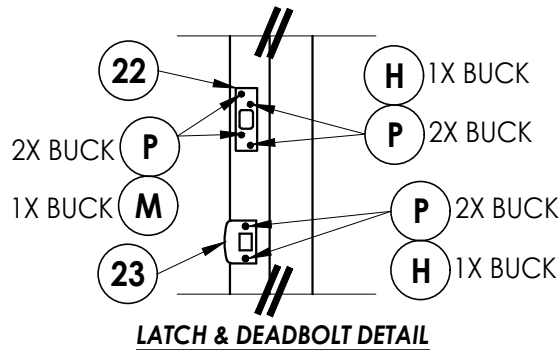


LATCH & DEADBOLT DETAIL

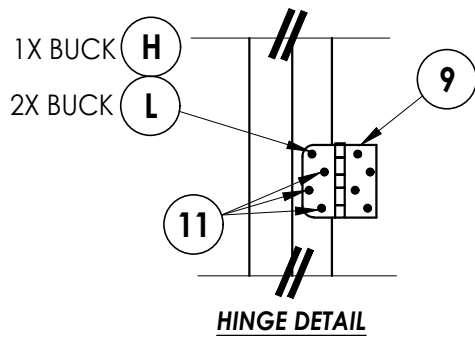


HINGE DETAIL

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: JM Eagle COMPONENTS		PART OR ASSEMBLY: BUCK AND FRAME ANCHORING (X)	
5	7/01/23	UPDATE TO 8TH ED. (2023)	FBC LFS
4	8/07/20	UPDATE TO 7TH ED. (2020)	FBC LFS
3	10/03/17	UPDATE TO 6TH ED. (2017)	FBC JK
2	2/27/15	UPDATE TO 5TH ED. (2014)	FBC JK
1	8/27/14	Rev. Per Public Comments	JK
NO.	DATE	REVISIONS	
DATE: 5/28/14			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-17055.2			
SHEET 5 OF 7			

Z:\2023 FBC Drawings\JM Eagle\FL-17055 R4\FL-17055.1-4.dwg

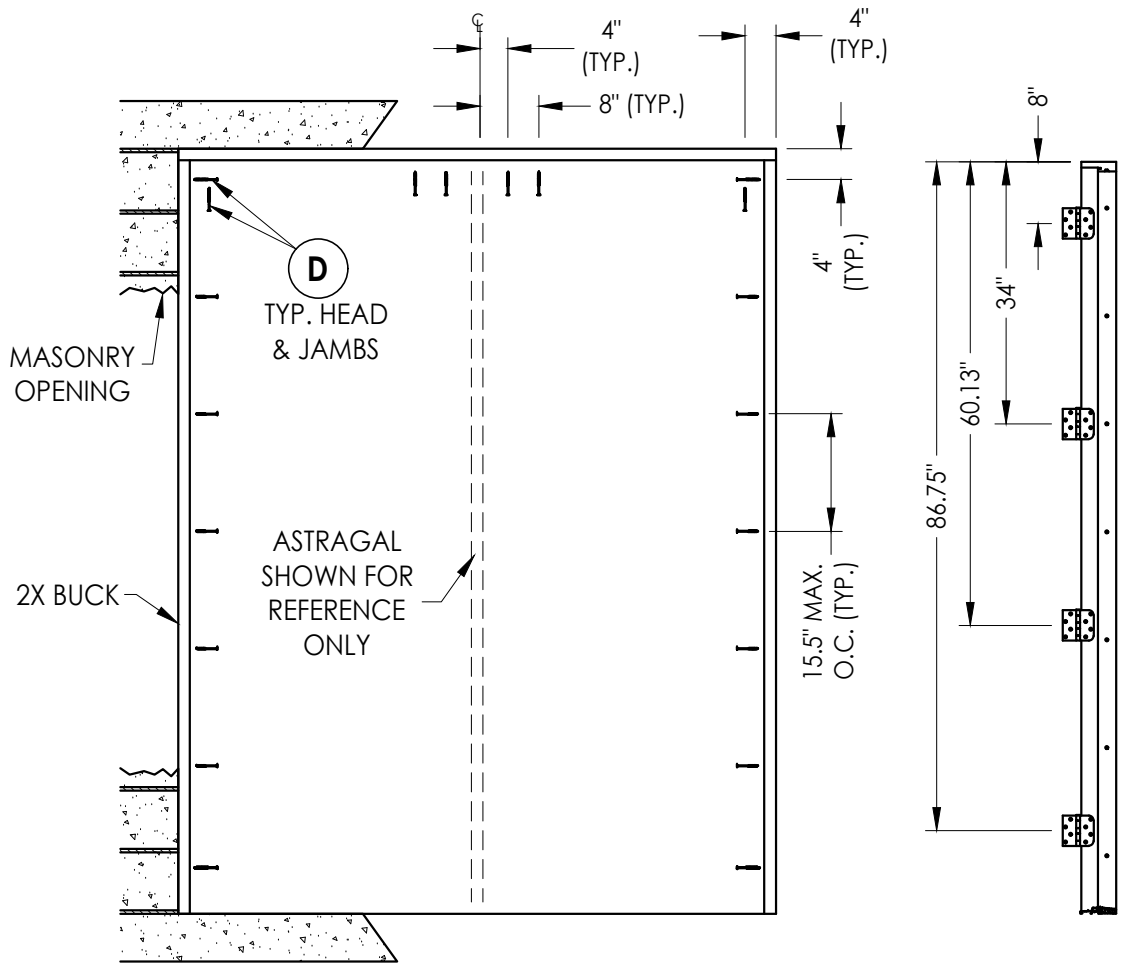

BUCK ANCHORING

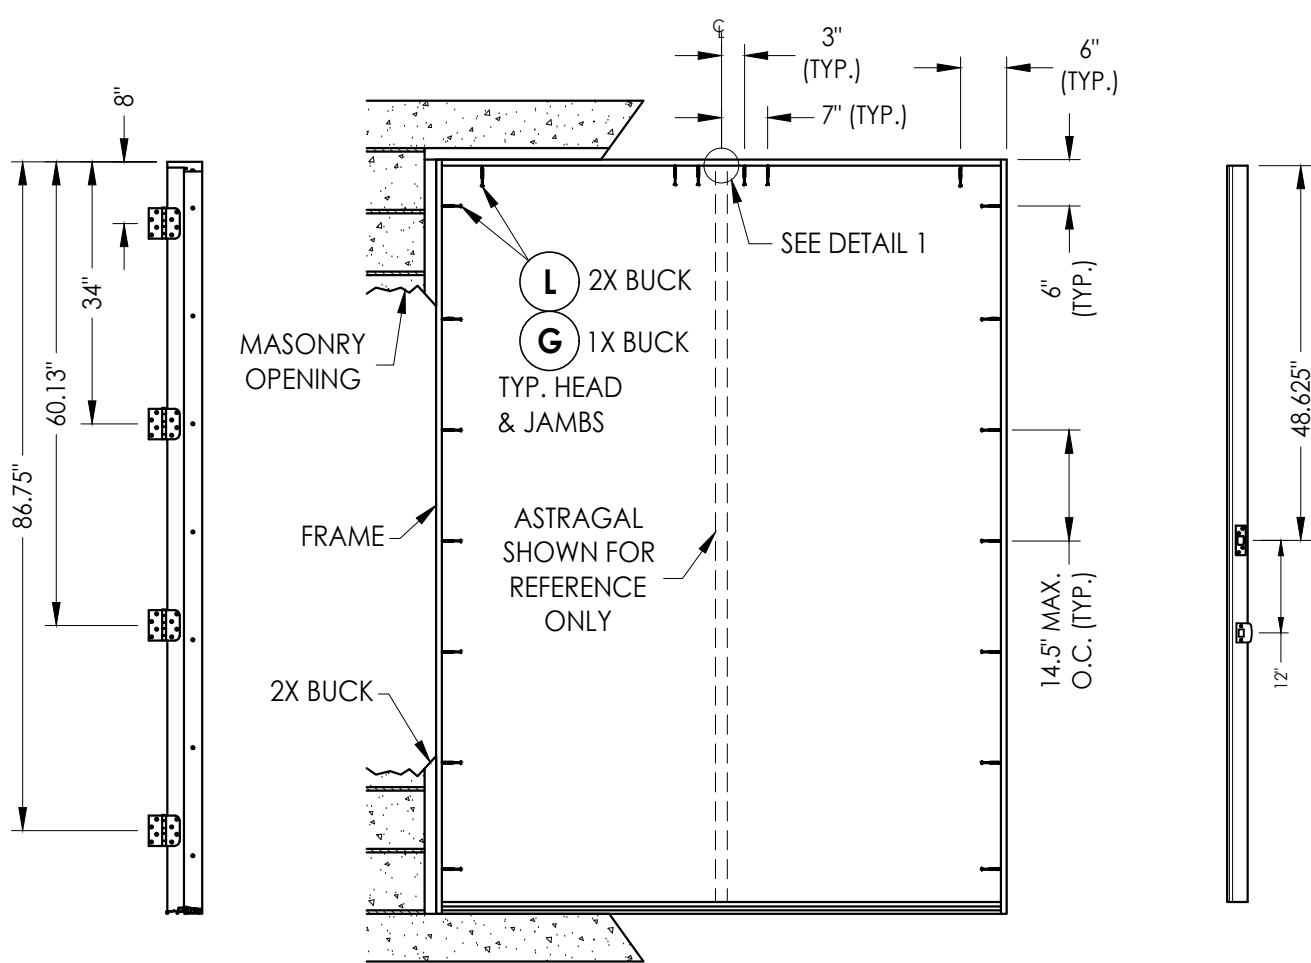

HINGE JAMB

FRAME ANCHORING

ASTRAGAL STRIKE JAMB

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:


1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Note:

See separate Side-hinged door Product Approval for door construction details not shown, including lock hardware, astragal, hinge and threshold connections.

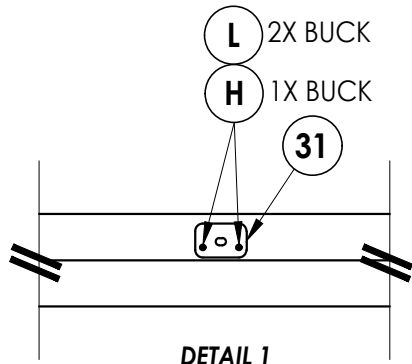

DETAIL 1

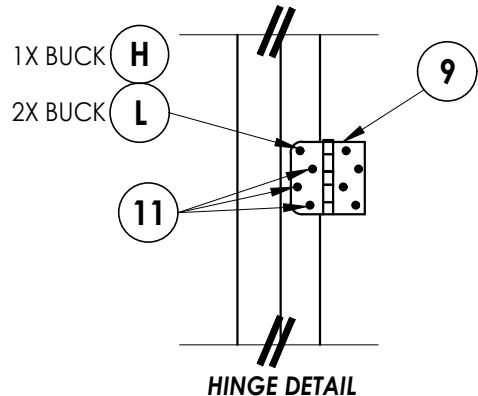

HINGE DETAIL

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: JM Eagle COMPONENTS

PART OR ASSEMBLY:
BUCK AND FRAME ANCHORING (XX)

NO.	DATE	REVISIONS
5	7/01/23	UPDATE TO 8TH ED. (2023) FBC LFS
4	8/07/20	UPDATE TO 7TH ED. (2020) FBC LFS
3	10/03/17	UPDATE TO 6TH ED. (2017) FBC JK
2	2/27/15	UPDATE TO 5TH ED. (2014) FBC JK
1	8/27/14	Rev. Per Public Comments JK

DATE: 5/28/14

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-17055.2

SHEET 6 OF 7

Z:\2023 FBC Drawings\JM Eagle\FL-17055 R4\FL-17055.1-4.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
H	3/16" x 3-1/4" PFH ITW CONCRETE SCREW	STEEL
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
K	1/4" X 3-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
M	#8 X 1-1/2" PFH WOOD SCREW	STEEL
N	3/16" X 2-3/4" PFH ITW CONCRETE SCREW	STEEL
P	#8 X 2" PFH WOOD SCREW	STEEL
1	HEAD AND JAMB	Wood Flour/PVC
7	WEATHERSTRIP (QEBD650 Q-LON)	FOAM
9	HINGE	STEEL
11	#9 X 3/4" PFH WOOD SCREW	STEEL
22	DEADBOLT STRIKE PLATE	STEEL
23	LATCH STRIKE PLATE	STEEL
24	#10 X 3/4" PFH SMS	STEEL
31	ASTRAGAL STRIKE PLATE	STEEL

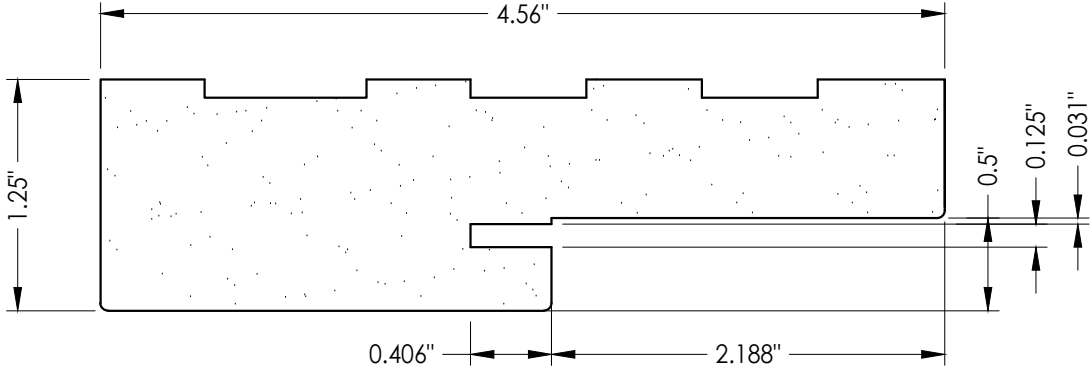

1 HEAD & SIDE JAMB

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813					
PRODUCT: JM Eagle COMPONENTS		BILL OF MATERIALS & COMPONENTS					
PART OR ASSEMBLY:							
NO.		DATE		REVISIONS			
5		7/01/23		UPDATE TO 8TH ED. (2023)		FBC	LFS
4		8/07/20		UPDATE TO 7TH ED. (2020)		FBC	LFS
3		10/03/17		UPDATE TO 6TH ED. (2017)		FBC	JK
2		2/27/15		UPDATE TO 5TH ED. (2014)		FBC	JK
1		8/27/14		Rev. Per Public Comments			JK
DATE:		5/28/14					
SCALE:		N.T.S.					
DWG. BY:		JK					
CHK. BY:		LFS					
DRAWING NO.:		FL-17055.2					
SHEET		7		OF		7	