


LA CANTINA DOORS

ALUMINUM THERMALLY CONTROLLED SLIDING DOOR

(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-11
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- FRAME MATERIAL: *ALUMINUM 6063-T5*.
- GLASS SHALL COMPLY WITH THE REQUIREMENTS OF ASTM E1300. SEE GLAZING DETAILS ON SHEET 1.
- DESIGNATIONS "X", "O", AND "P" STAND FOR THE FOLLOWING:
X: OPERABLE PANEL
O: FIXED PANEL
P: POCKET

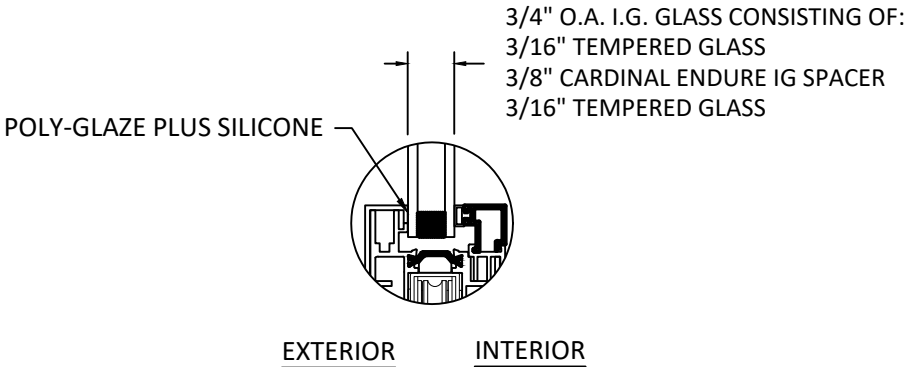

GLAZING DETAIL

- GLAZING NOTES:
- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - GLASS TYPE SHALL COMPLY WITH APPLICABLE GLAZING REQUIREMENTS PER CHAPTER 24 OF THE FBC

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAILS
2	ELEVATIONS AND DESIGN PRESSURE TABLE 8FT
3	ELEVATIONS AND DESIGN PRESSURE TABLE 10FT
4	ANCHOR LAYOUTS 8FT
5	ANCHOR LAYOUTS 10FT
6	VERTICAL SECTIONS
7	HORIZONTAL SECTIONS
8	ANCHOR DETAILS



LA CANTINA DOORS
1875 ORD WAY
OCEANSIDE, CA 92056
PH: (760) 734-1590 FX: (760) 734-1591

TITLE: ALUMINUM THERMALLY CONTROLLED SLIDING DOOR (NON-HVHZ)(NON-IMPACT)
GENERAL NOTES AND GLAZING DETAILS


PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F Norero
Reason: I am approving this document
Date: 2020.10.23 15:32:45 +02'00'

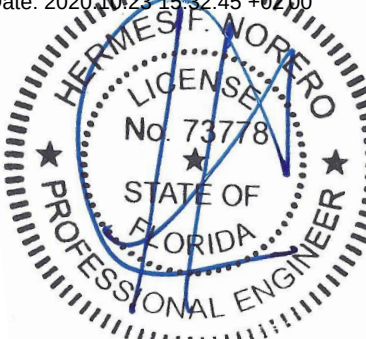

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578


DATE: 06.17.20

DWG. BY: LLCHK. BY: SM


SCALE: NTS

DWG. #: LCD012

c:\users\luiz lopes\desktop\manager\building drops\projects\la cantina\117104\117104-3 aluminum tc-sliding oxx\cd012 aluminum tc-sliding door (ox).dwg 10/19/2020 4:53 PM

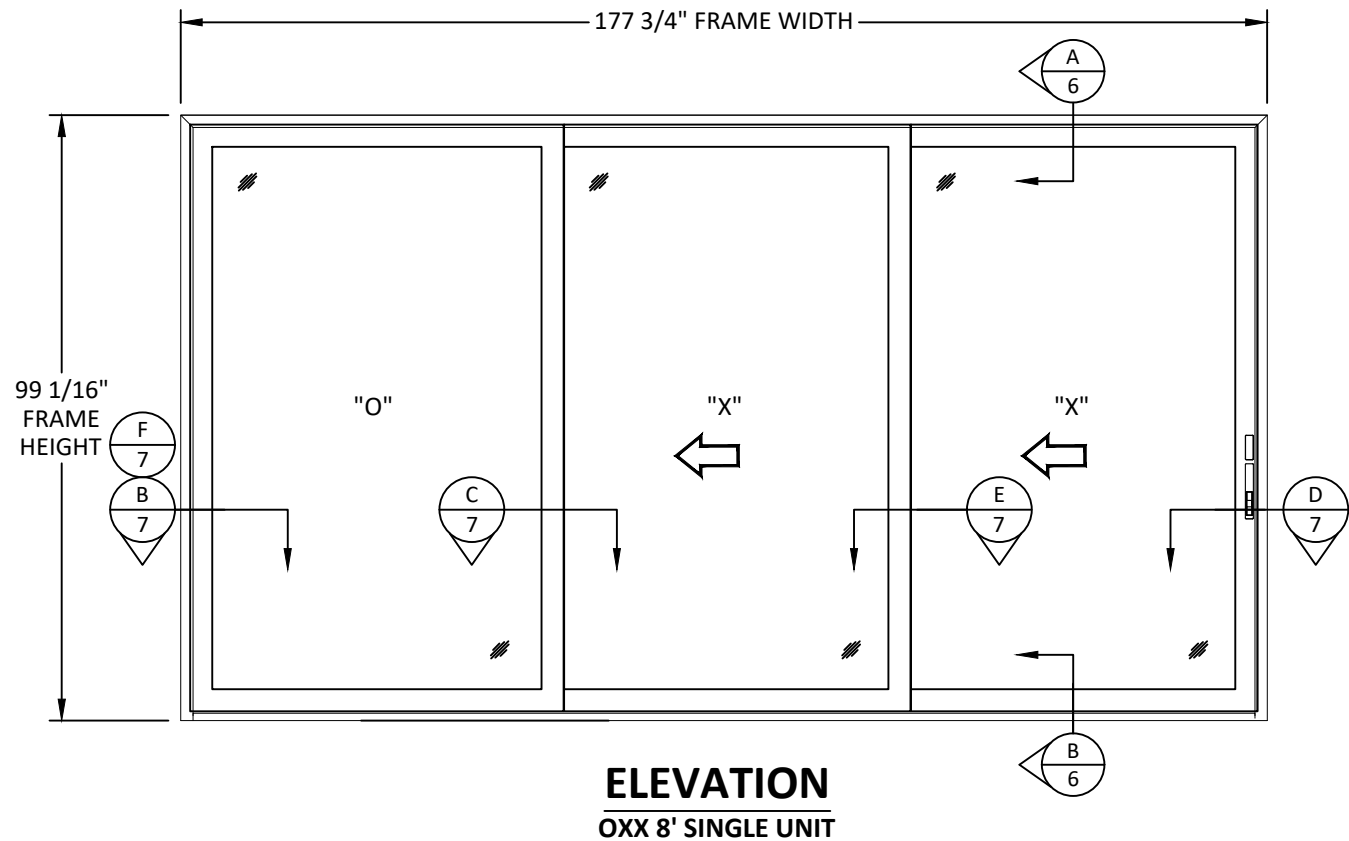

- PANEL NOTES:
1. ACTIVE PANEL SIZE: 60" X 96"
 2. ACTIVE PANEL D.L.O.: 53 15/16" X 90 1/8"
 3. FIXED PANEL SIZE: 60 3/4" X 96"
 4. FIXED PANEL D.L.O.: 54 3/4" X 90 1/8"

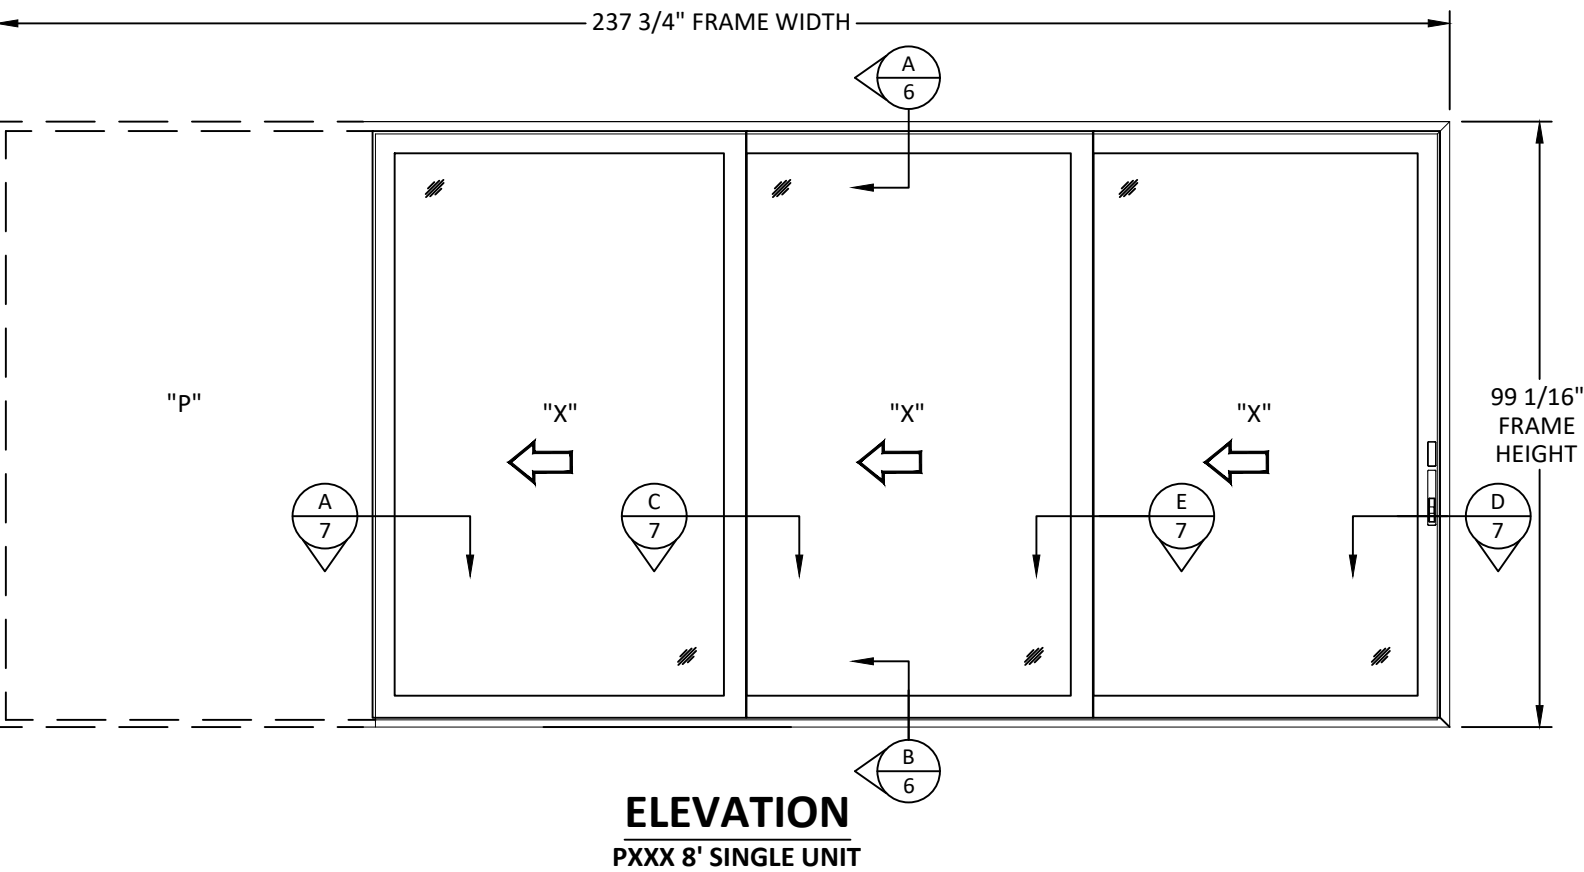

DESIGN PRESSURE TABLE (PSF)								
WHERE WATER PENETRATION RESISTANCE IS NOT REQUIRED								
NOMINAL PANEL WIDTH (INCHES)								
PANEL HEIGHT (INCHES)		48	52	56	60	64	68	72
	80	60.00	60.00	60.00	60.00	60.00	60.00	60.00
	82	60.00	60.00	60.00	60.00	60.00	60.00	-
	86	60.00	60.00	60.00	60.00	60.00	60.00	-
	90	60.00	60.00	60.00	60.00	60.00	-	-
	96	60.00	60.00	60.00	60.00	-	-	-
	104	55.40	51.94	49.05	-	-	-	-
	110	46.38	43.41	-	-	-	-	-
	114	41.44	-	-	-	-	-	-
	118	37.19	-	-	-	-	-	-
POSITIVE DESIGN PRESSURE TABLE (PSF)								
WHERE WATER PENETRATION RESISTANCE IS REQUIRED								
NOMINAL PANEL WIDTH (INCHES)								
PANEL HEIGHT (INCHES)		48	52	56	60	64	68	72
	80	45.00	45.00	45.00	45.00	45.00	45.00	45.00
	82	45.00	45.00	45.00	45.00	45.00	45.00	-
	86	45.00	45.00	45.00	45.00	45.00	45.00	-
	90	45.00	45.00	45.00	45.00	45.00	-	-
	96	45.00	45.00	45.00	45.00	-	-	-
	104	41.55	38.95	36.79	-	-	-	-
	110	34.78	32.56	-	-	-	-	-
	114	31.08	-	-	-	-	-	-
	118	27.89	-	-	-	-	-	-




LA CANTINA DOORS
1875 ORD WAY
OCEANSIDE, CA 92056
PH: (760) 734-1590 FX: (760) 734-1591

TITLE: ALUMINUM THERMALLY
CONTROLLED SLIDING DOOR
(NON-HVHZ)(NON-IMPACT)
ELEVATIONS AND DESIGN PRESSURE TABLE
8FT

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

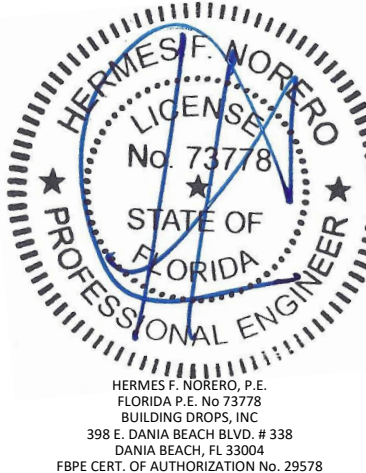

DATE: 06.17.20
DWG. BY: LL
CHK. BY: SM
SCALE: NTS
DWG. #: LCD012
SHEET

2

c:\users\luiz.lopes\desktop\manager\building drops\projects\la cantina\117104\117104-3 aluminum tc-sliding oxx\cd012 aluminum tc-sliding door (oxx).dwg 10/19/2020 4:53 PM

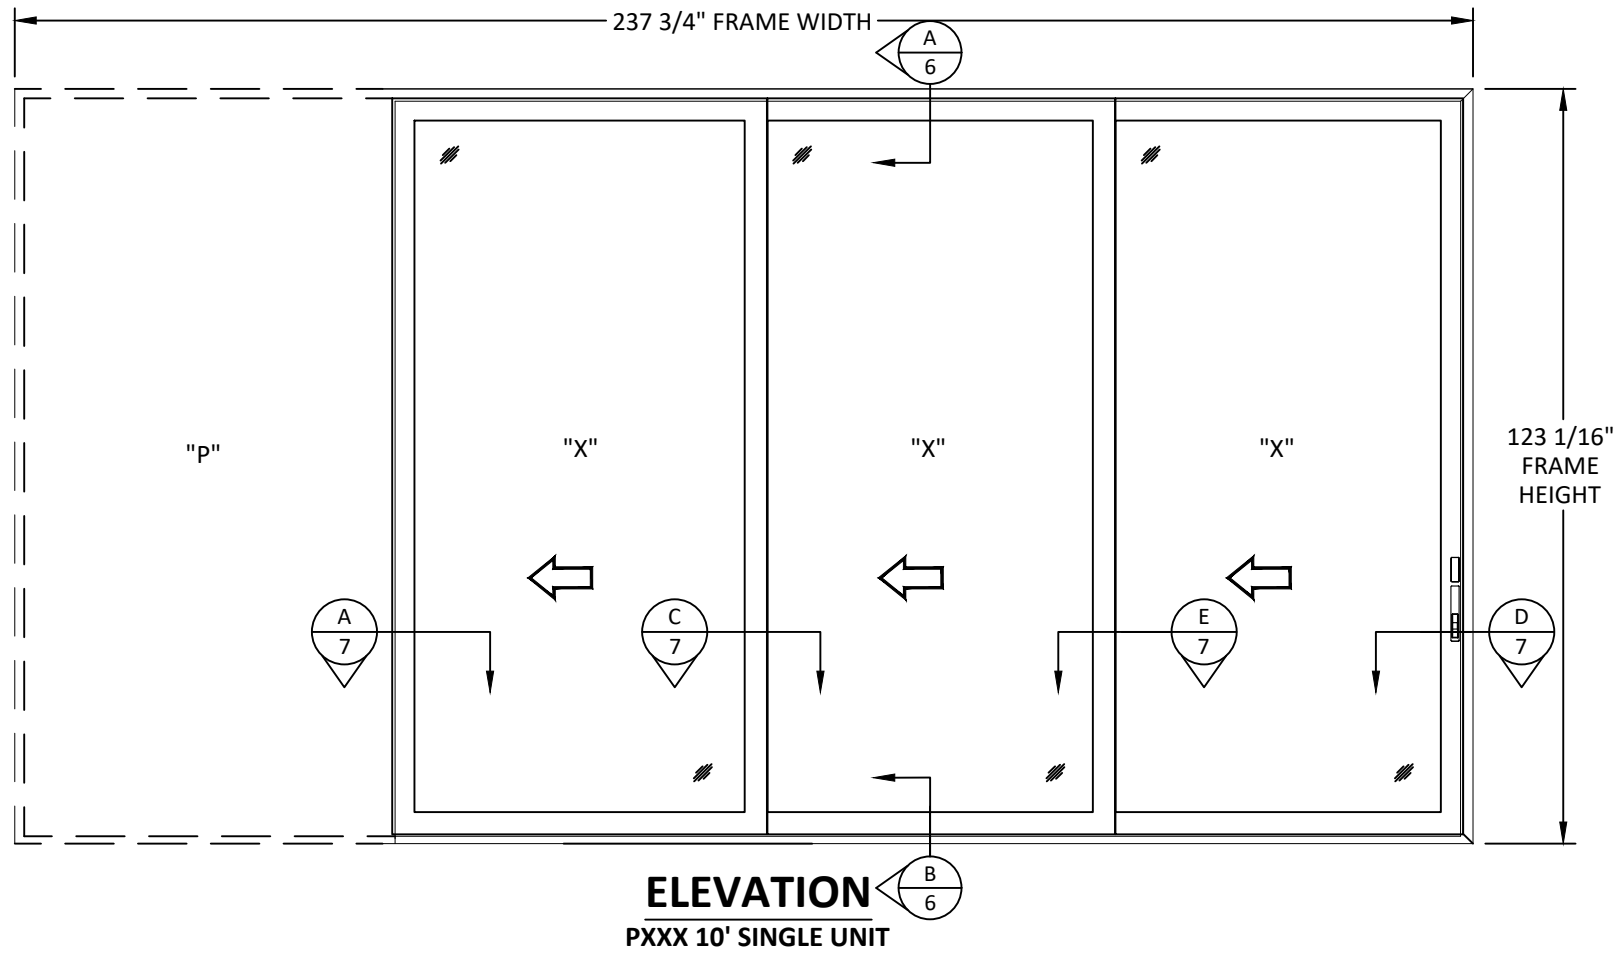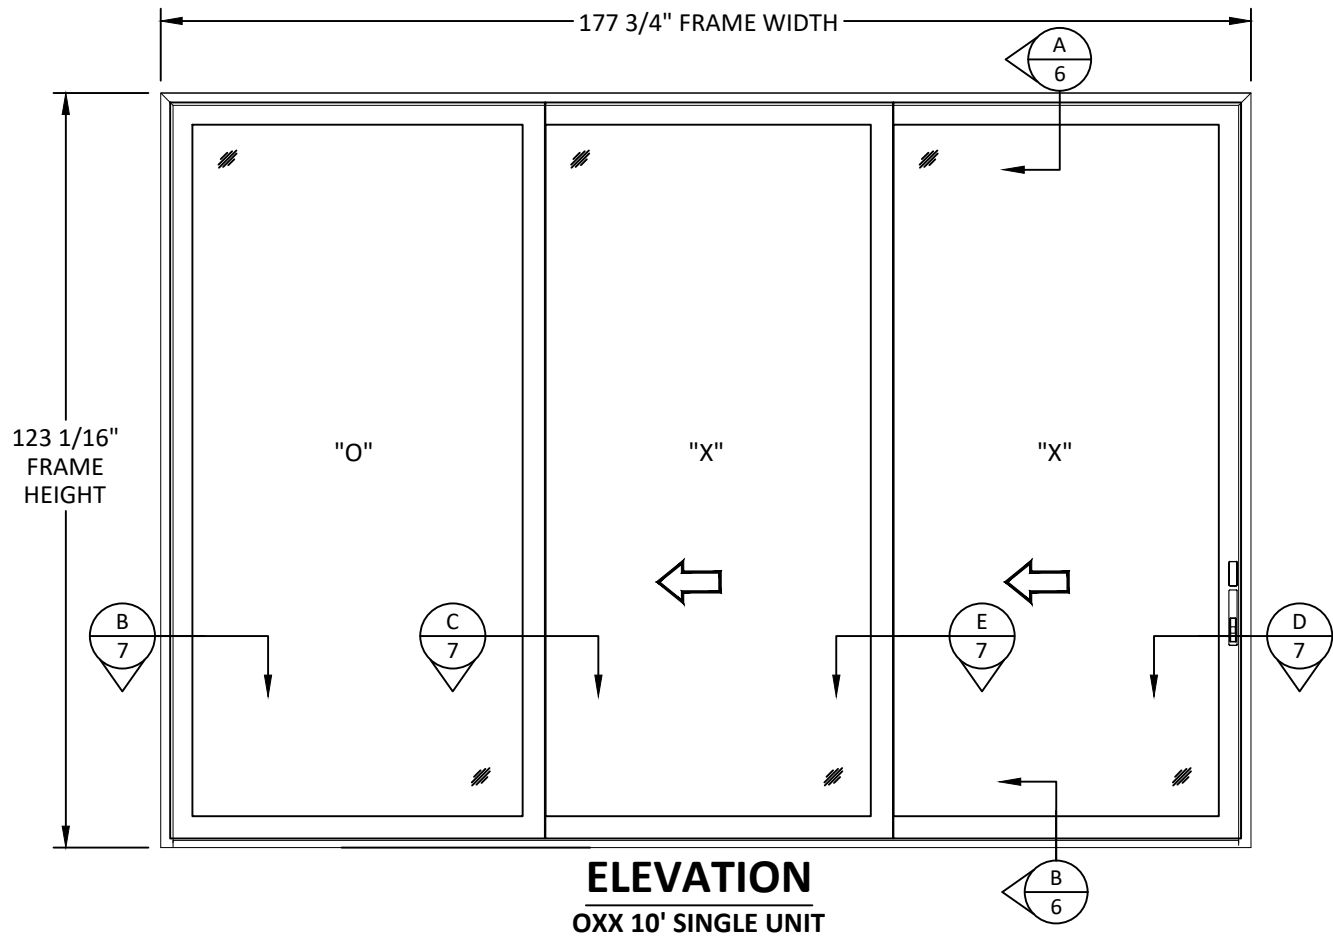

- PANEL NOTES:
- 1. ACTIVE PANEL SIZE: 60" X 120"
 - 2. ACTIVE PANEL D.L.O.: 53 15/16" X 114 1/8"
 - 3. FIXED PANEL SIZE: 60 3/4" X 120"
 - 4. FIXED PANEL D.L.O.: 54 3/4" X 114 1/8"

DESIGN PRESSURE TABLE (PSF)								
NOMINAL PANEL WIDTH (INCHES)								
PANEL HEIGHT (INCHES)		48	52	56	60	64	68	72
	100	30.00	30.00	30.00	30.00	30.00	30.00	30.00
	106	30.00	30.00	30.00	30.00	30.00	30.00	-
	110	30.00	30.00	30.00	30.00	30.00	-	-
	114	30.00	30.00	30.00	30.00	30.00	-	-
	120	30.00	30.00	30.00	30.00	-	-	-
	128	29.98	27.96	26.24	-	-	-	-
	134	26.00	24.22	-	-	-	-	-
	138	23.73	22.10	-	-	-	-	-
	144	20.80	-	-	-	-	-	-



LA CANTINA DOORS
1875 ORD WAY
OCEANSIDE, CA 92056
PH: (760) 734-1590 FX: (760) 734-1591


TITLE: ALUMINUM THERMALLY
CONTROLLED SLIDING DOOR
(NON-HVHZ)/(NON-IMPACT)
ELEVATIONS AND DESIGN PRESSURE TABLE
10FT

PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

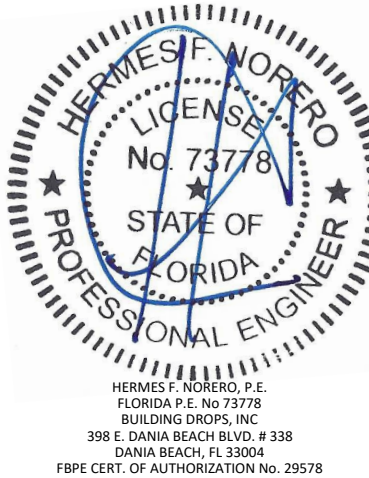

DATE: 06.17.20
DWG. BY: LL CHK. BY: SM
SCALE: NTS
DWG. #: LCD012
SHEET


3

c:\users\luiz.lopes\desktop\manager\building drops\projects\la cantina\117104\117104-3 aluminum tc-sliding door (ox).dwg 10/19/2020 4:53 PM

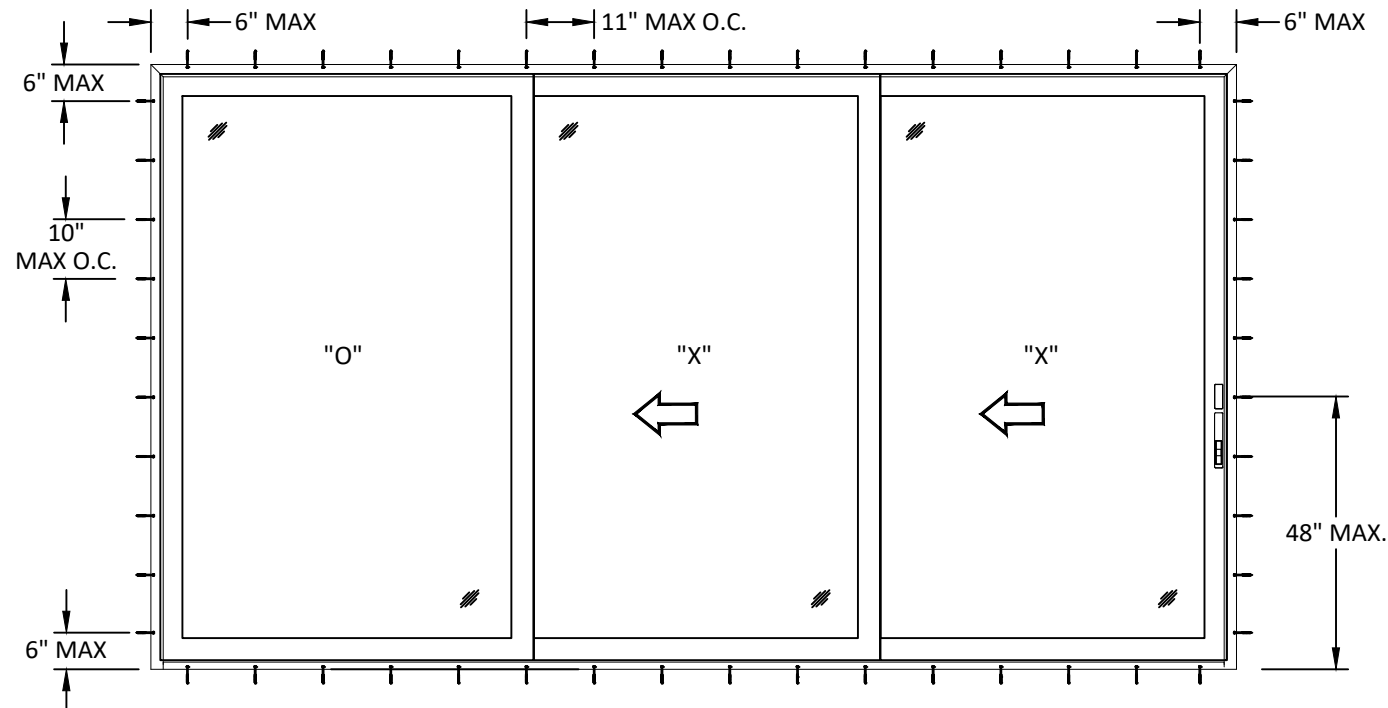

ANCHOR LAYOUT
OXX 8' SINGLE UNIT
THROUGH FRAME



NOTE:
X = OPERABLE
O = FIXED
P = POCKET

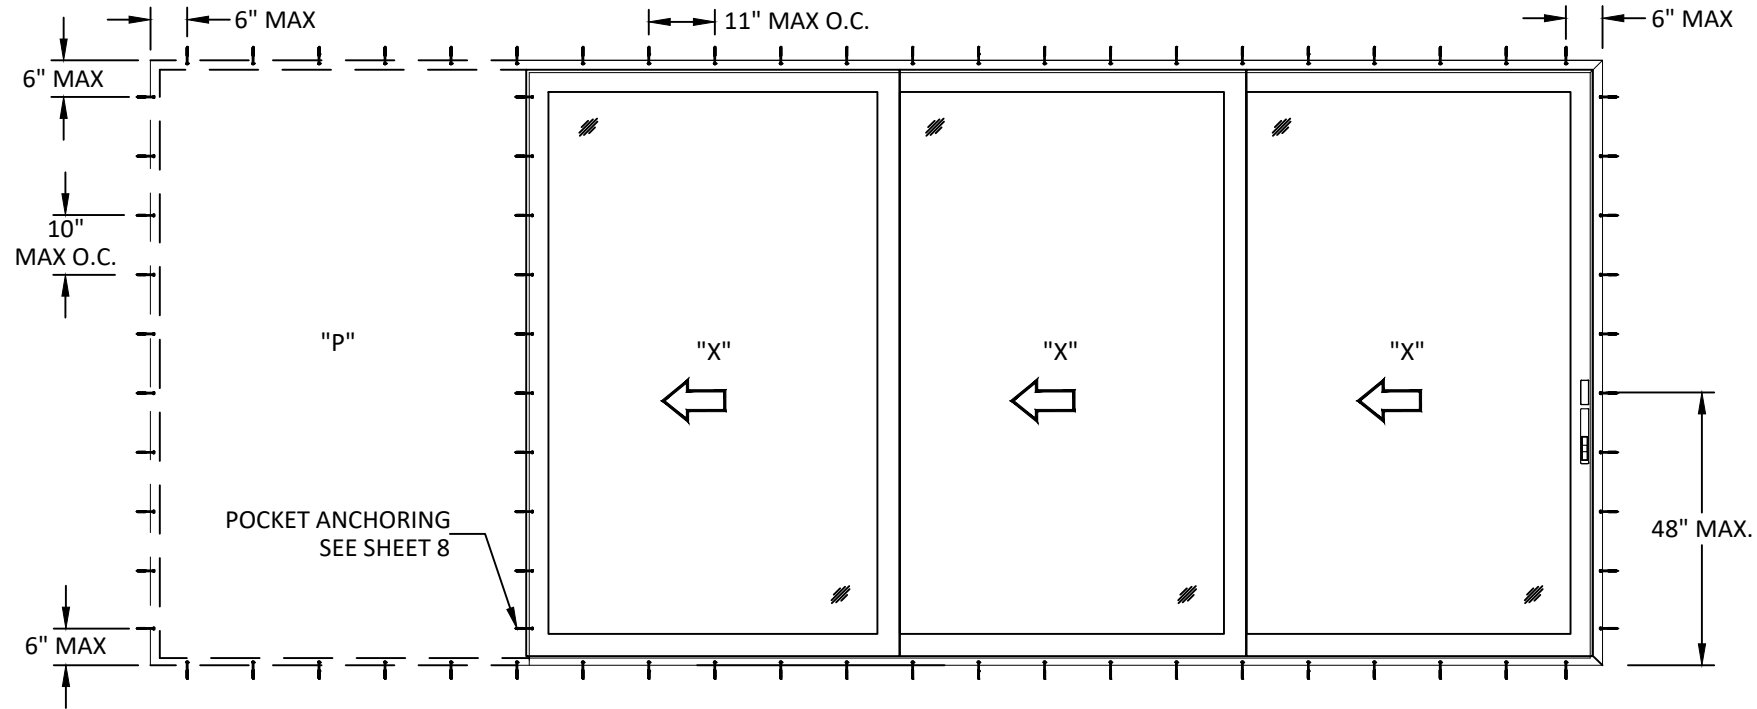

ANCHOR LAYOUT
PXXX 8' SINGLE UNIT
THROUGH FRAME

NOTE :
FOR MORE ANCHOR INFORMATION (INSTALLATION TYPE,
SPACING, QUANTITY, ANCHOR TYPE, QUALIFIED SUBSTRATES) SEE
SHEET 8

QUALIFIED CONFIGURATIONS

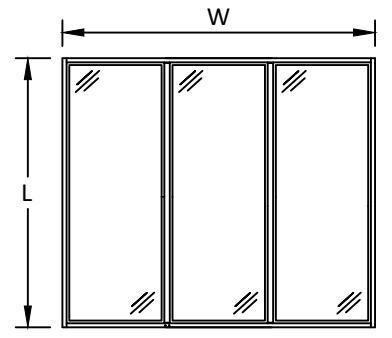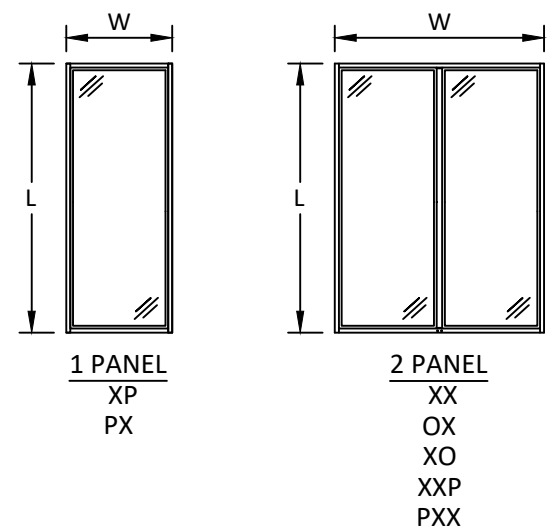

LA CANTINA DOORS
1875 ORD WAY
OCEANSIDE, CA 92056
PH: (760) 734-1590 FX: (760) 734-1591


TITLE: ALUMINUM THERMALLY
CONTROLLED SLIDING DOOR
(NON-HVHZ)(NON-IMPACT)
ANCHOR LAYOUTS 8FT

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

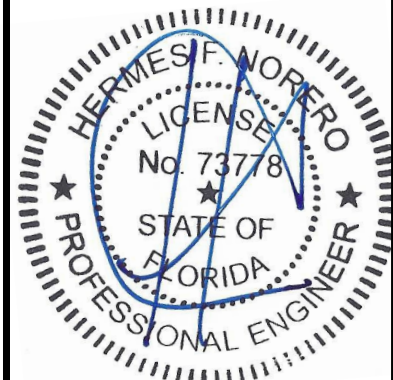


HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

DATE:	06.17.20
DWG. BY:	LL
CHK. BY:	SM
SCALE:	NTS
DWG. #:	LCD012
SHEET	4

c:\users\luiz\desktop\manager\building drops\projects\la cantina\117104\117104-3 aluminum tc-sliding oxx\cd012 aluminum tc-sliding door (oxx).dwg 10/19/2020 4:53 PM


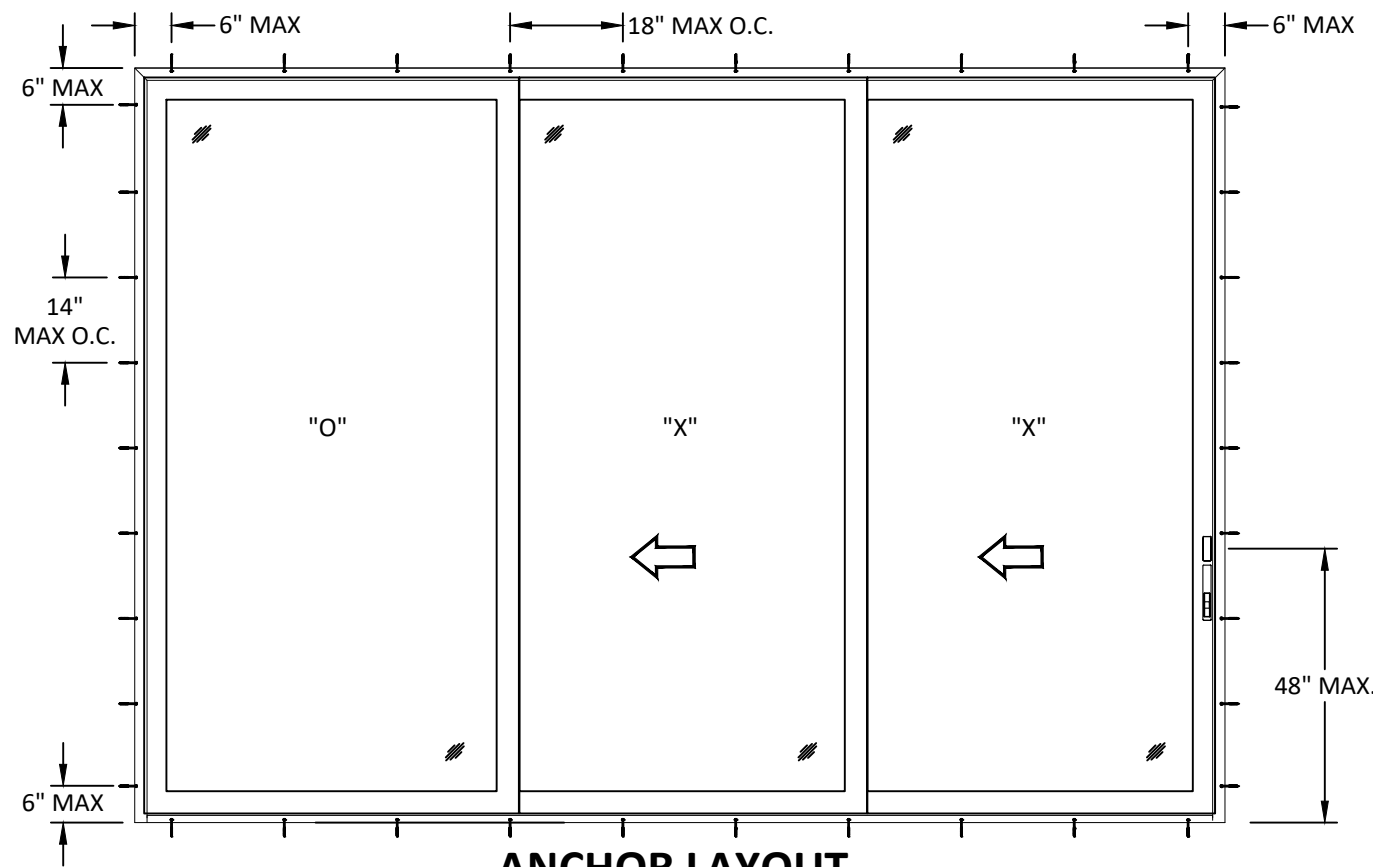


ANCHOR LAYOUT
OXX 10' SINGLE UNIT
THROUGH FRAME

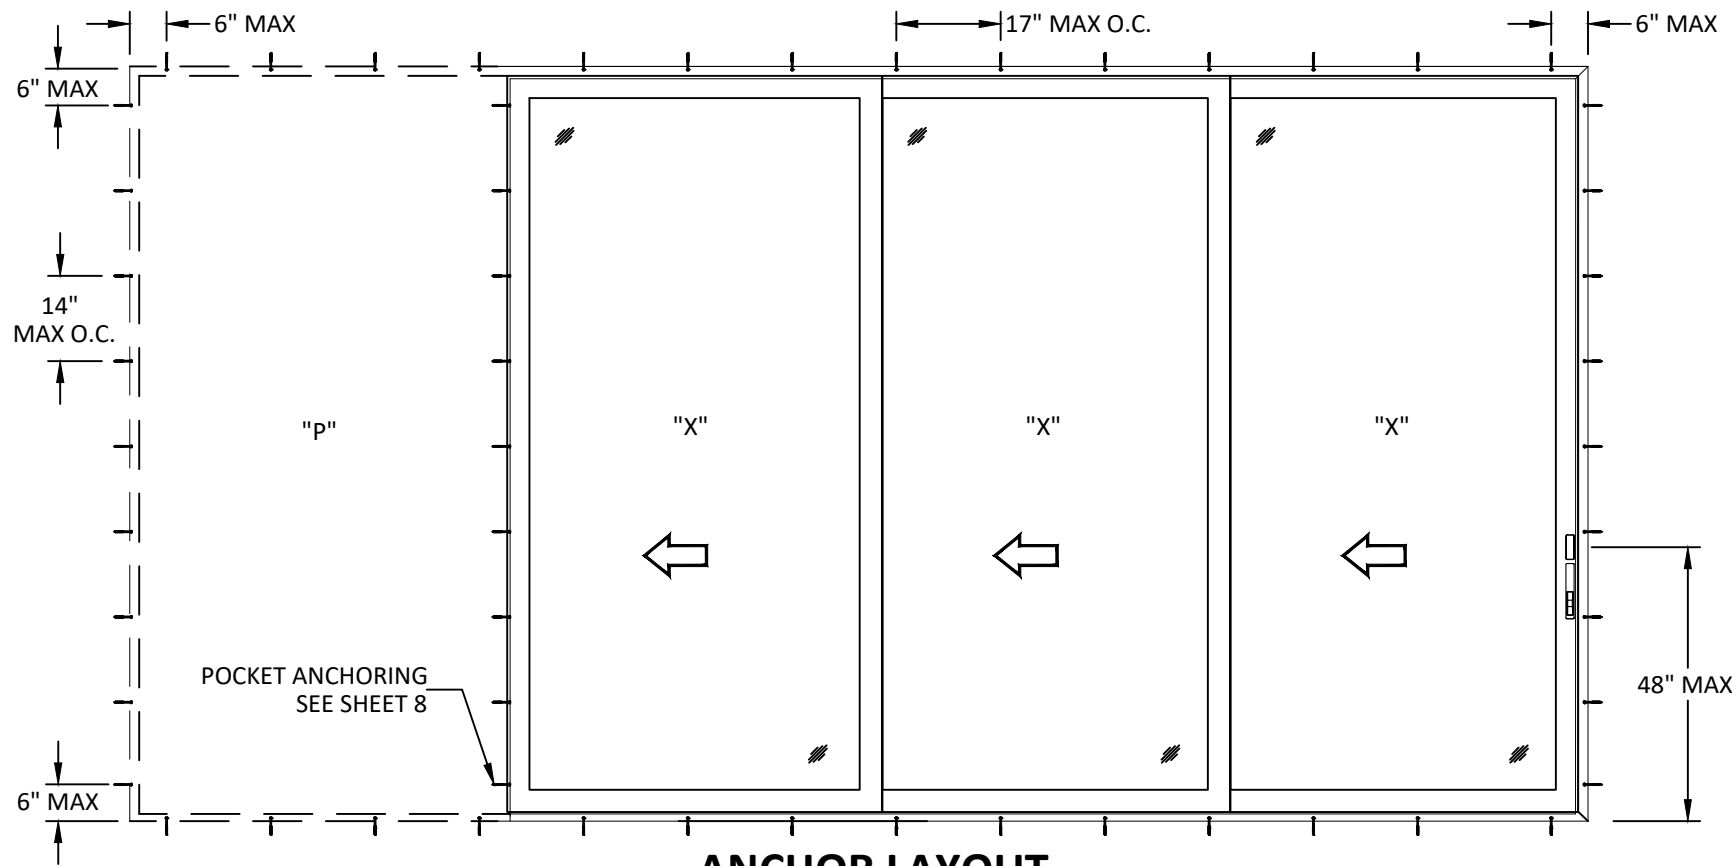

ANCHOR LAYOUT
PXXX 10' SINGLE UNIT
THROUGH FRAME

QUALIFIED CONFIGURATIONS

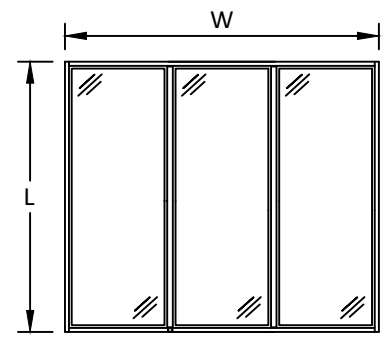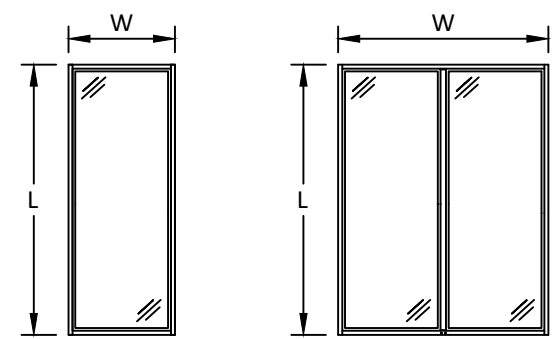

- 3 PANEL**
OXO
OXX
XXO
OXXP
PXXO
XXX
PXXX
XXXP

NOTE:
X = OPERABLE
O = FIXED
P = POCKET

NOTE :
FOR MORE ANCHOR INFORMATION (INSTALLATION TYPE,
SPACING, QUANTITY, ANCHOR TYPE, QUALIFIED SUBSTRATES) SEE
SHEET 8



LA CANTINA DOORS
1875 ORD WAY
OCEANSIDE, CA 92056
PH: (760) 734-1590 FX: (760) 734-1591


TITLE: ALUMINUM THERMALLY
CONTROLLED SLIDING DOOR
(NON-HVHZ)(NON-IMPACT)
ANCHOR LAYOUTS 10FT

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

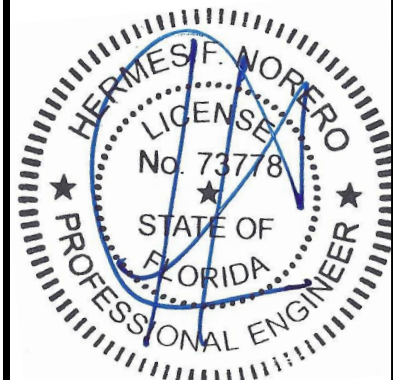


HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

DATE:	06.17.20
DWG. BY:	LL
CHK. BY:	SM
SCALE:	NTS
DWG. #:	LCD012
SHEET	5

c:\users\luiz lopes\desktop\building drops\projects\la cantina\117104\117104-3 aluminum tc-sliding oxi\cd012 aluminum tc-sliding door (oxi).dwg 10/19/2020 4:53 PM

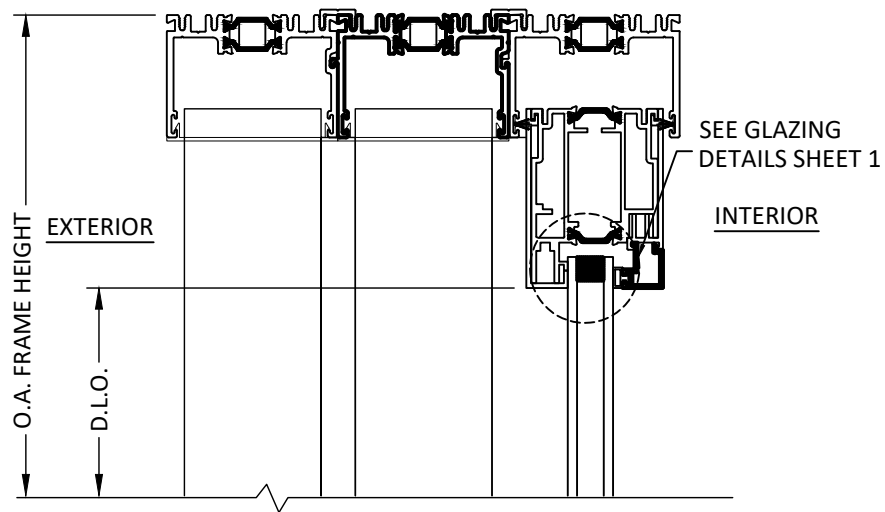


A
6 **VERTICAL SECTION**
HEAD DETAIL

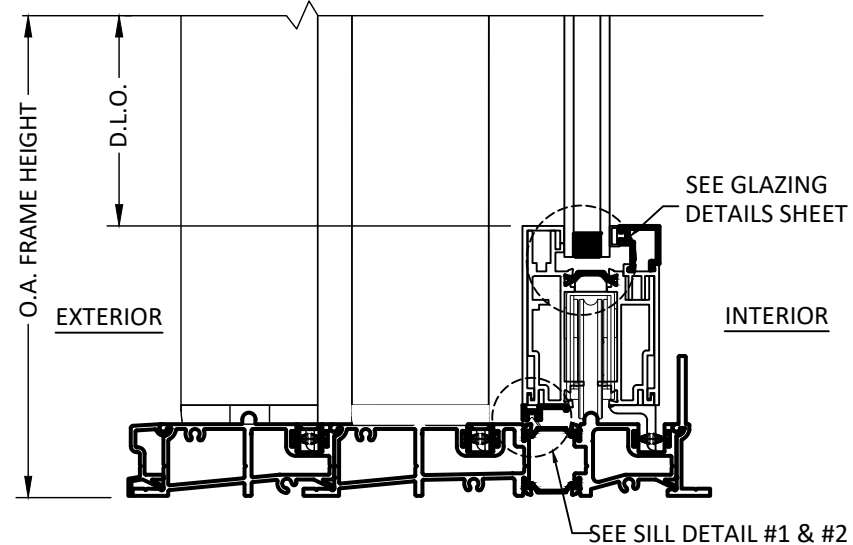


B
6 **VERTICAL SECTION**
SILL DETAIL

GASKET IN THE KERF
AT BOTTOM RAIL

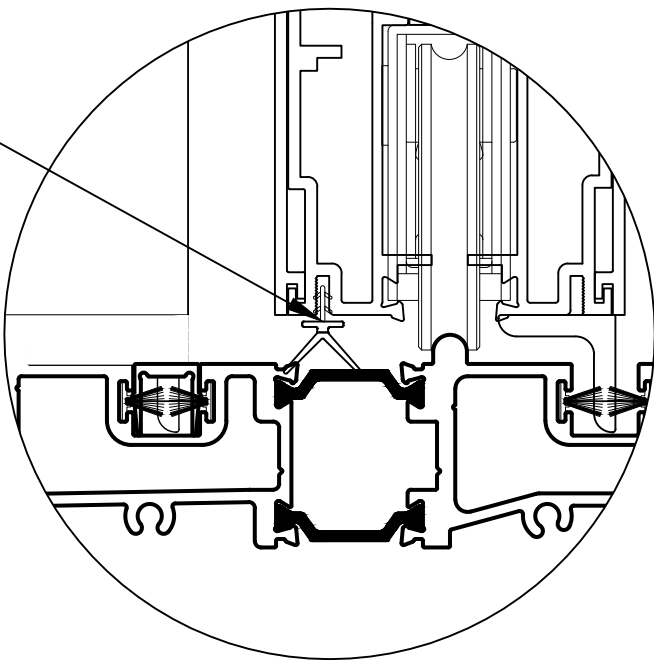

SILL DETAIL #1
STANDARD SLIDER SYSTEM

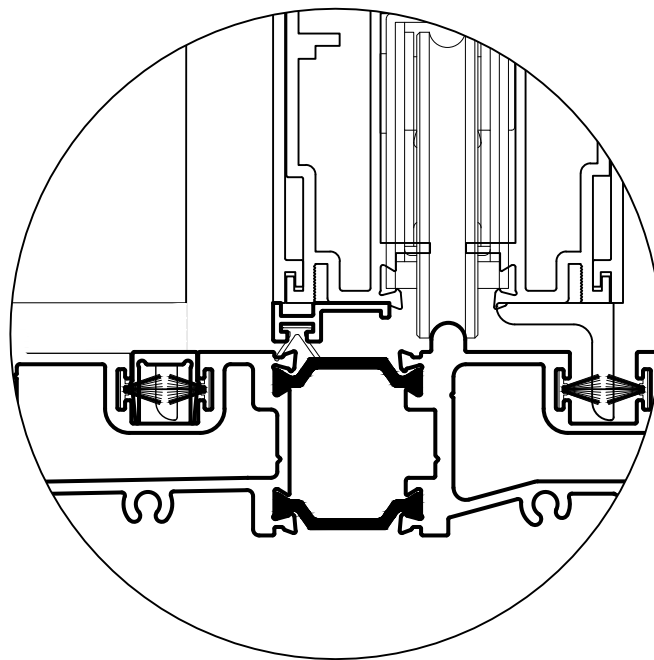

SILL DETAIL #2
REGULAR SLIDER SYSTEM



LA CANTINA DOORS
1875 ORD WAY
OCEANSIDE, CA 92056
PH: (760) 734-1590 FX: (760) 734-1591

TITLE: **ALUMINUM THERMALLY
CONTROLLED SLIDING DOOR
(NON-HVHZ)(NON-IMPACT)**


VERTICAL SECTIONS

PREPARED BY: **BUILDING DROPS, INC.**
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

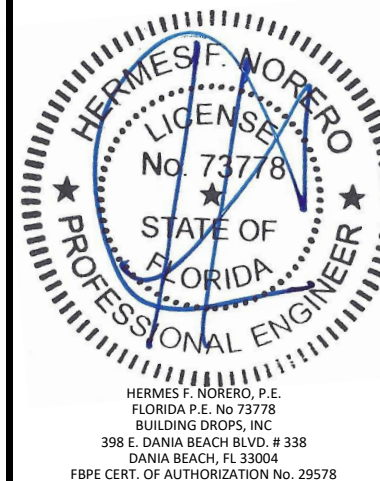


DATE:	06.17.20
DWG. BY: LL	CHK. BY: SM
SCALE:	NTS
DWG. #:	LCD012
SHEET	6

c:\users\luiz lopes\desktop\manager\building drops\projects\la cantina\117104\117104-3 aluminum tc-sliding door (oss).dwg 10/19/2020 4:53 PM

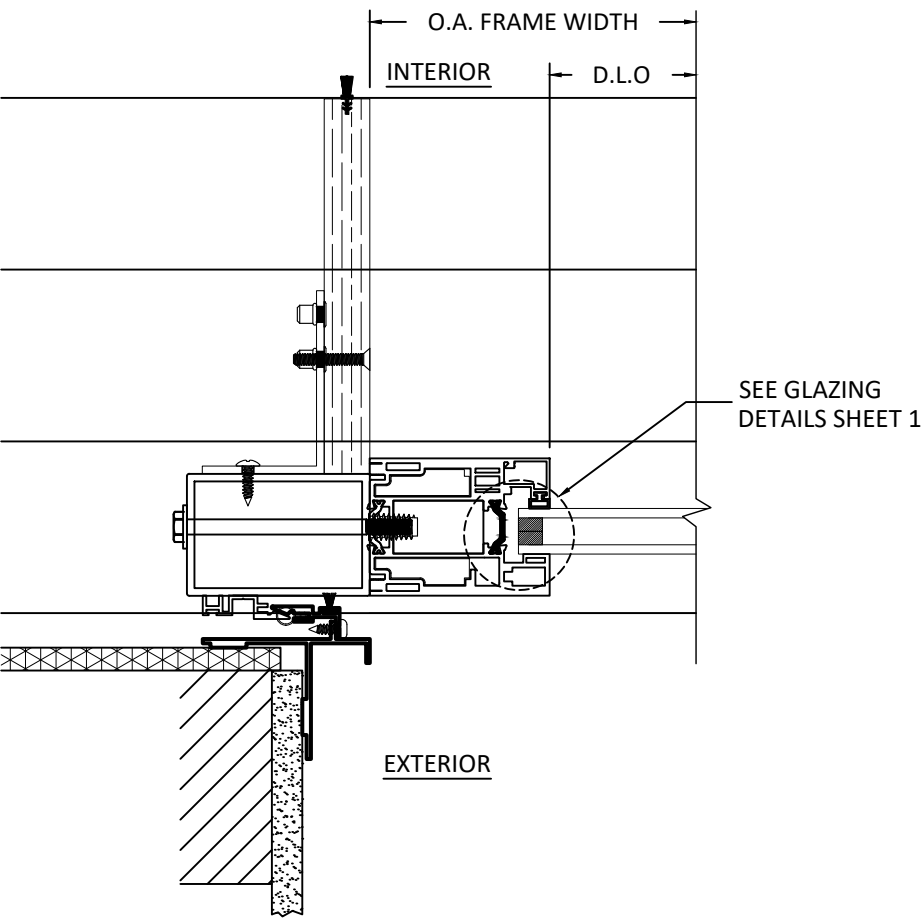


A
7 HORIZONTAL SECTION
POCKET DETAIL

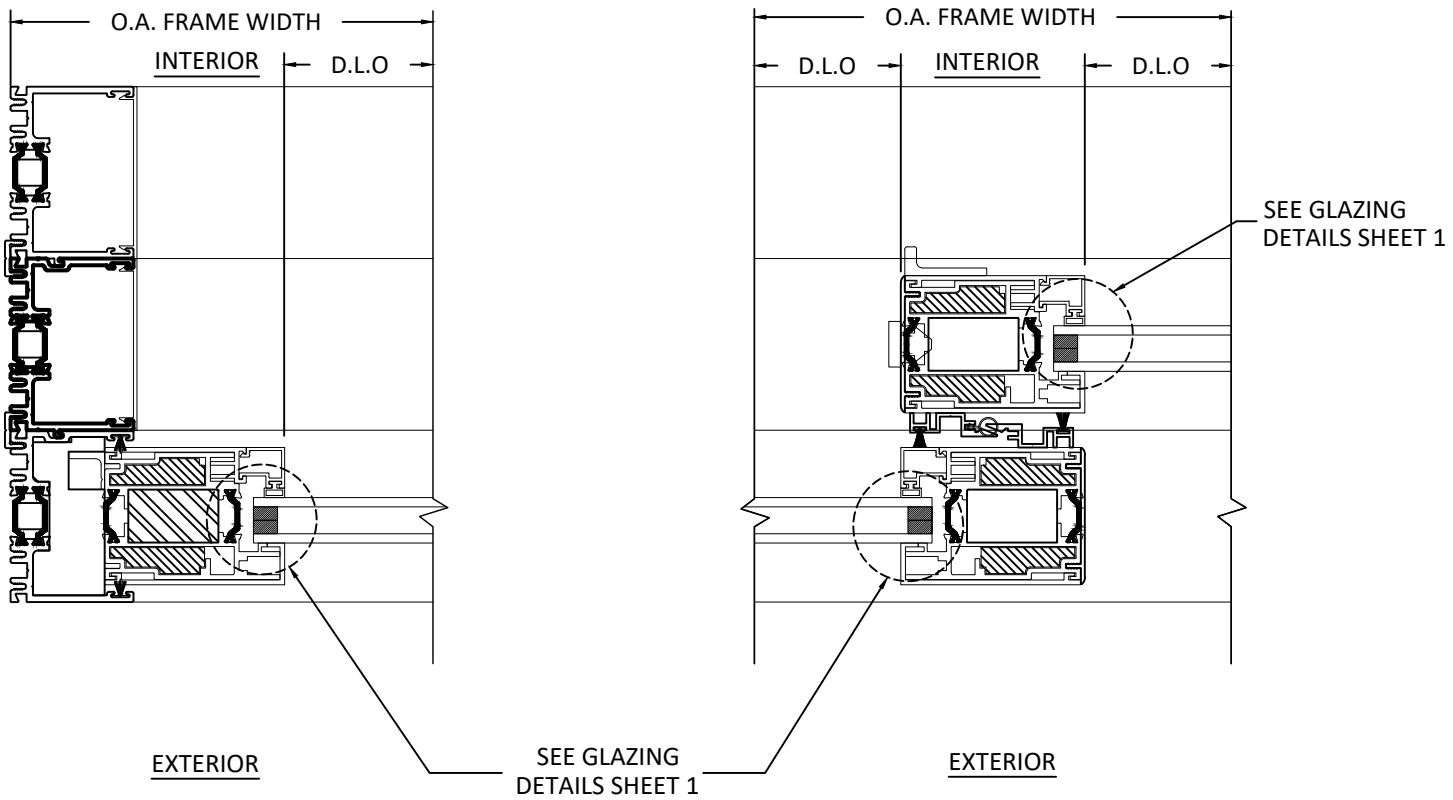


B
7 HORIZONTAL SECTION
JAMB DETAIL - REGULAR SIZE


C
7 HORIZONTAL SECTION
INTERLOCK DETAIL

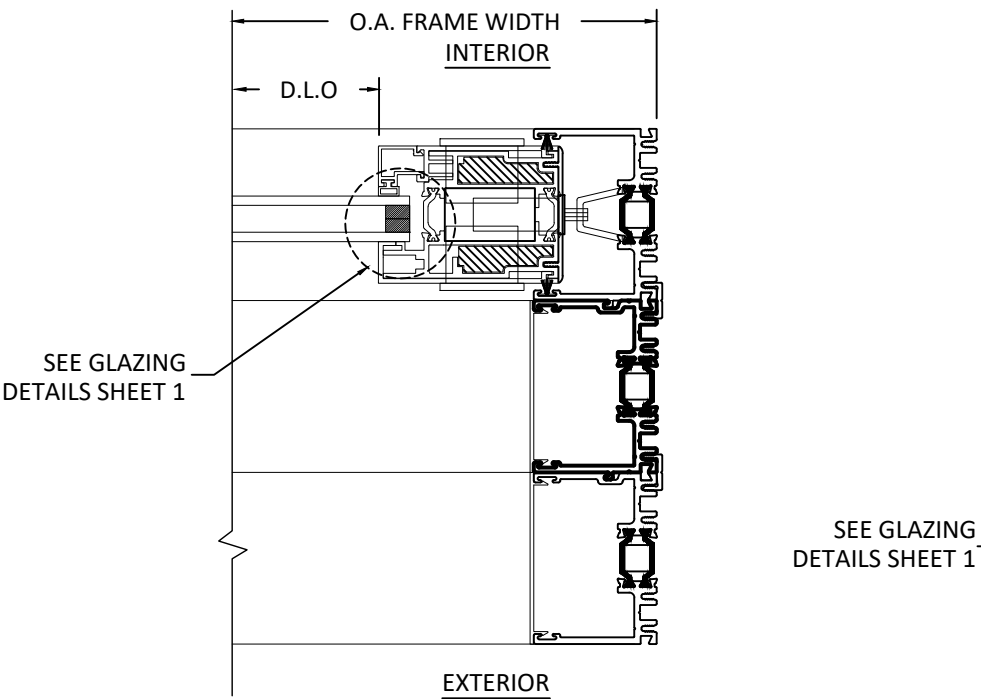

D
7 HORIZONTAL SECTION
LOCK STILE DETAIL

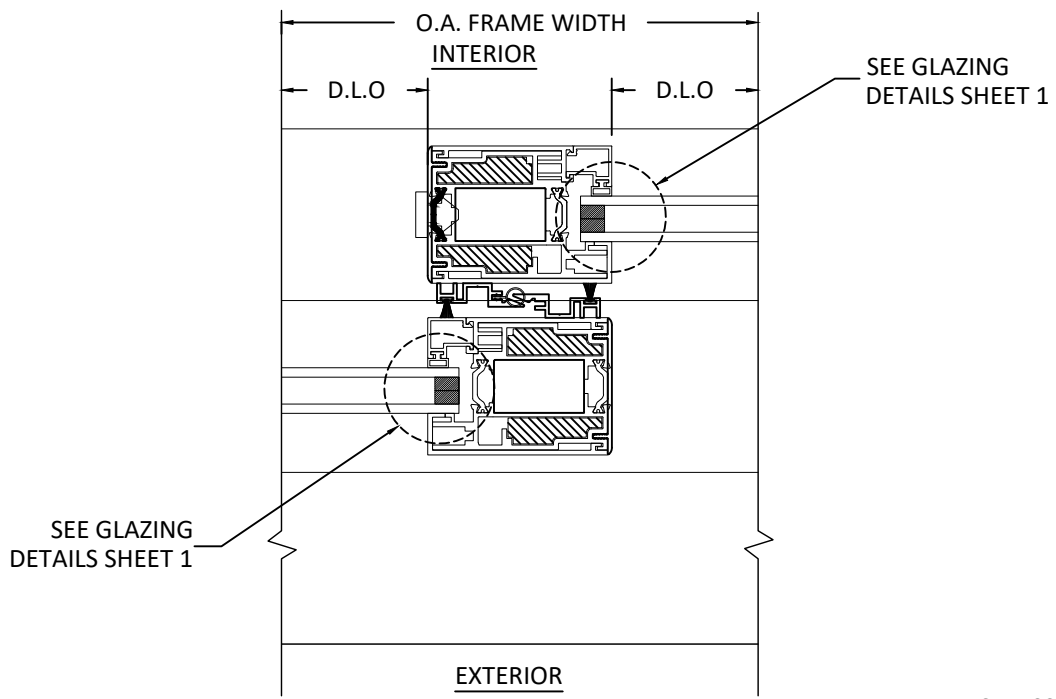

E
7 HORIZONTAL SECTION
INTERLOCK DETAIL

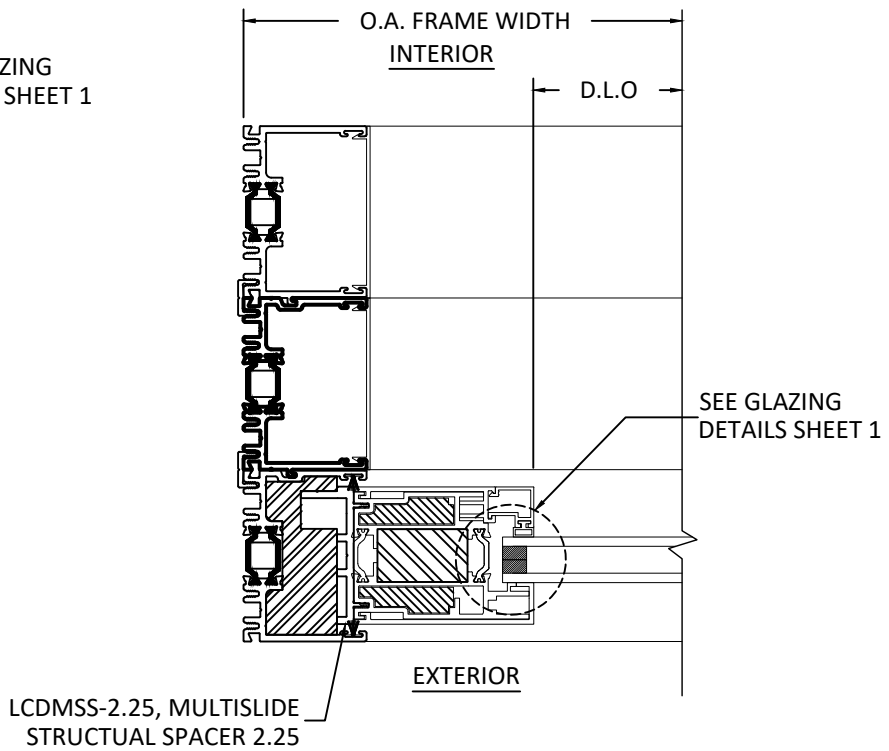

F
7 HORIZONTAL SECTION
JAMB DETAIL - STANDARD SIZE



LA CANTINA DOORS
1875 ORD WAY
OCEANSIDE, CA 92056
PH: (760) 734-1590 FX: (760) 734-1591

TITLE: ALUMINUM THERMALLY
CONTROLLED SLIDING DOOR
(NON-HVHZ)(NON-IMPACT)

HORIZONTAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

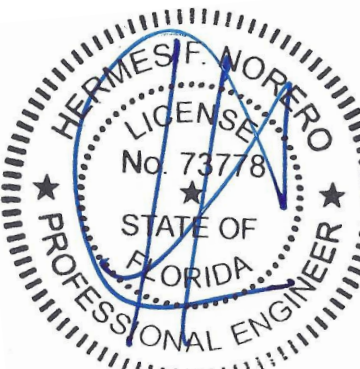


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578


DATE:	06.17.20
DWG. BY:	LL
CHK. BY:	SM
SCALE:	NTS
DWG. #:	LCD012
SHEET	7

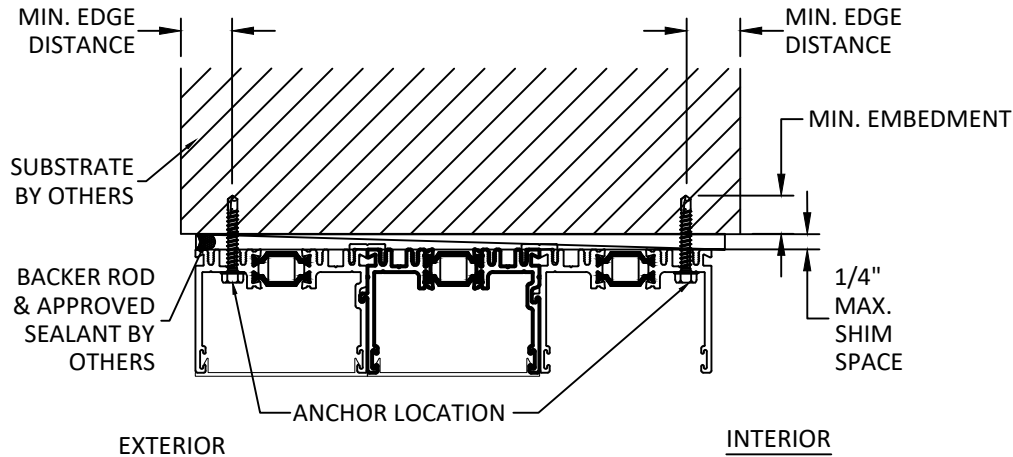


A
8
ANCHOR DETAIL
THROUGH FRAME

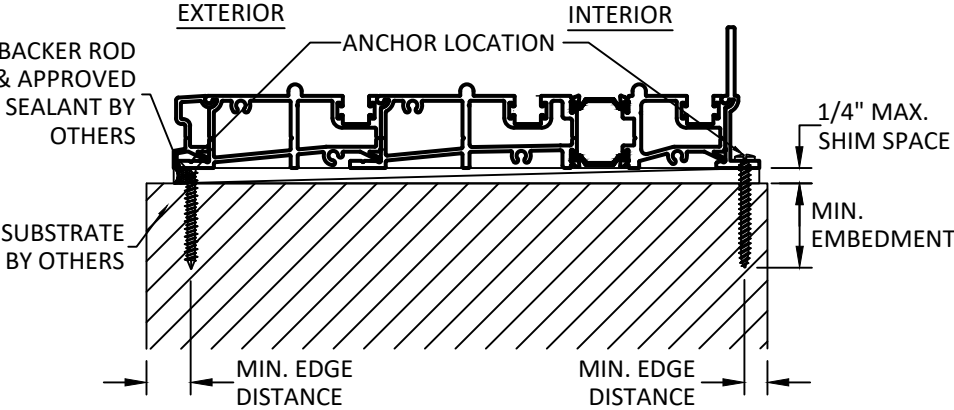

B
8
ANCHOR DETAIL
THROUGH FRAME

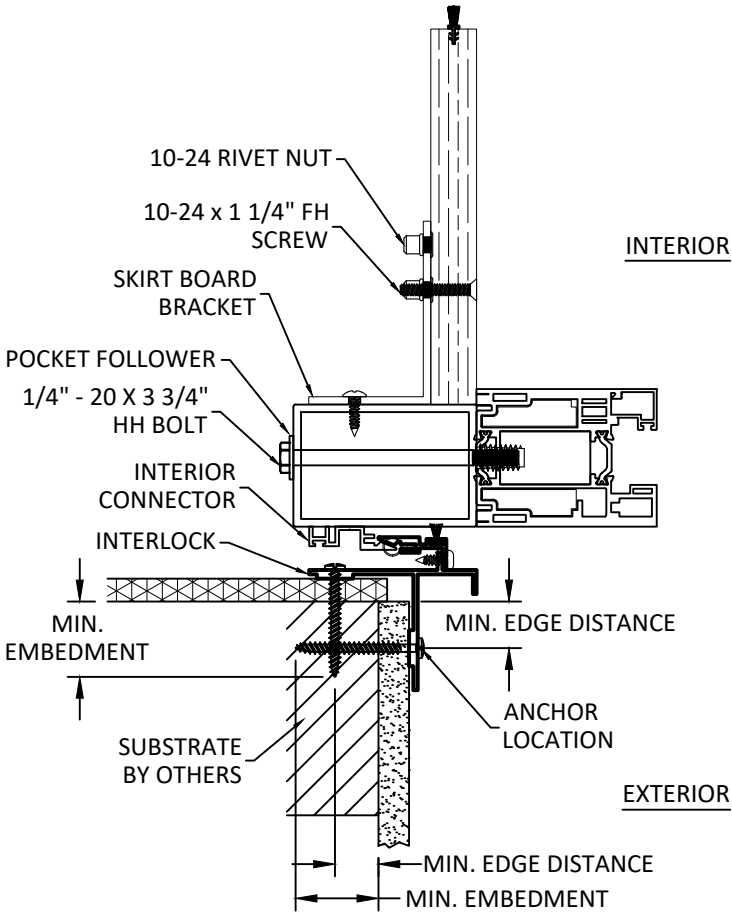

C
8
ANCHOR DETAIL
POCKET INSTALLATION

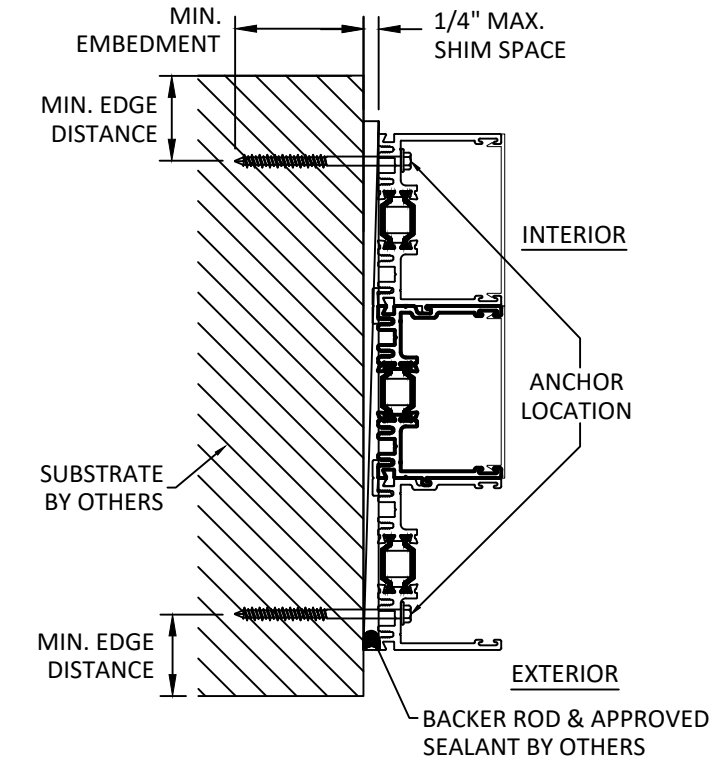

D
8
ANCHOR DETAIL
THROUGH FRAME

INSTALLATION NOTES:

1. TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. OPTIONAL 1X AND 2X WOOD STUDS FOR CONCRETE/CMU INSTALLATION.
3. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE					
INSTALLATION TYPE	QTY PER LOCATION	SUBSTRATE	ANCHOR TYPE	EMBEDMENT (IN.)	EDGE DISTANCE (IN.)
THRU FRAME	1	WOOD (MIN. S.G. = 0.55)	#14 WOOD SCREW	1.5000	0.7500
	1	CONCRETE (MIN. F'C = 3000 psi) OR CMU (PER ASTM C90)	1/4" TAPCON	1.2500	2.5000
	1	METAL STUD (STEEL MIN. 18GA, Fy = 33ksi, OR ALUMINUM MIN 1/8", 6063-T5)	#12 SMS OR SELF DRILLING SCREW	3 THREADS PENETRATION BEYOND METAL WALL	0.5000



LA CANTINA DOORS
1875 ORD WAY
OCEANSIDE, CA 92056
PH: (760) 734-1590 FX: (760) 734-1591

TITLE: ALUMINUM THERMALLY CONTROLLED SLIDING DOOR (NON-HVHZ)(NON-IMPACT)

ANCHOR DETAILS


PREPARED BY:

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 999-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

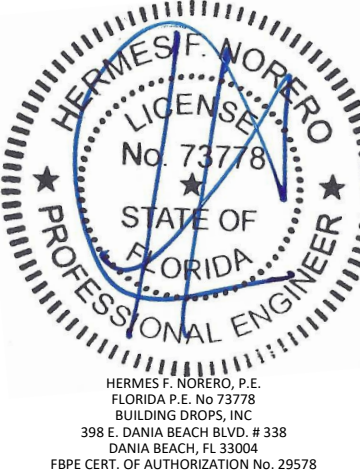

DATE:	06.17.20
DWG. BY:	LL
CHK. BY:	SM
SCALE:	NTS
DWG. #:	LCD012
SHEET	8