

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1–1/2” UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1–1/2” OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: MAHOGANY.
11. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 15 FOR GLASS DETAILS.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

13. FOR ANCHORING THROUGH INSTALLATION CLIP AND ANGLE CLIP INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
14. FOR ANCHORING THROUGH INSTALLATION CLIP AND ANGLE CLIP INTO METAL STRUCTURE OR 2X BUCK USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16” TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42

B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.

C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.

D. METAL STRUCTURE: STEEL 18GA (.048”) FY=33KSI/FU=52KSI OR ALUMINUM 6063–T5 FU=30KSI .048” THICK MINIMUM

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2 – 3	ELEVATIONS
4	B.O.M. AND CROSS SECTIONS
5 – 13	INSTALLATION DETAILS
14 – 15	COMPONENTS, HARDWARE & GLASS DETAILS

REILLY WINDOW & DOORS
901 BURMAN BLVD., BLDG 701
CALVERTON, NY 11933

RWD WOOD OUTSWING
FRENCH CASEMENT, IMPACT
NOTES

DRAWN:
R.L.

DWG NO.
08–03983A

REV
A


SCALE NTS

DATE 11/14/23

SHEET 1 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 02/11/2026

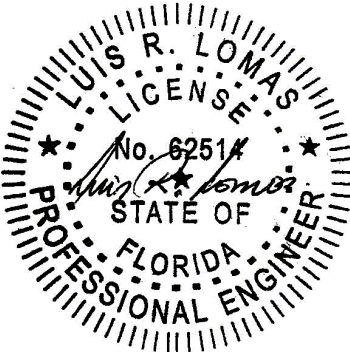


Luis R. Lomas P.E.
FL No.: 62514


NOTES:

1. PANEL SIZE: 36" X 64 3/8"
2. D.L.O.: 31 1/2" X 61 1/4"
3. FRAME HEAD TO JAMB CORNERS WERE COPED, BUTTED AND JOINED TOGETHER WITH #10X4-3/4" WOOD SCREWS AND SEALED WITH BINDAN D4.
4. SILL TO JAMB CORNERS ARE COPED, BUTTED AND JOINED WITH M8X1-9/16" MACHINE SCREWS THROUGH SILL INTO JAMBS THREADED INSERTS AND SEALED WITH SG20 SILICONE.
5. RAILS AND STILES ARE COPED, BUTTED AND JOINED WITH .394"X3.150" DOWELS, GLUED AND SEALED WITH BINDAN D4.
6. HINGES ARE LOCATED 5" FROM EACH END AND 28 1/2" MAX O.C. THERAFTER.

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

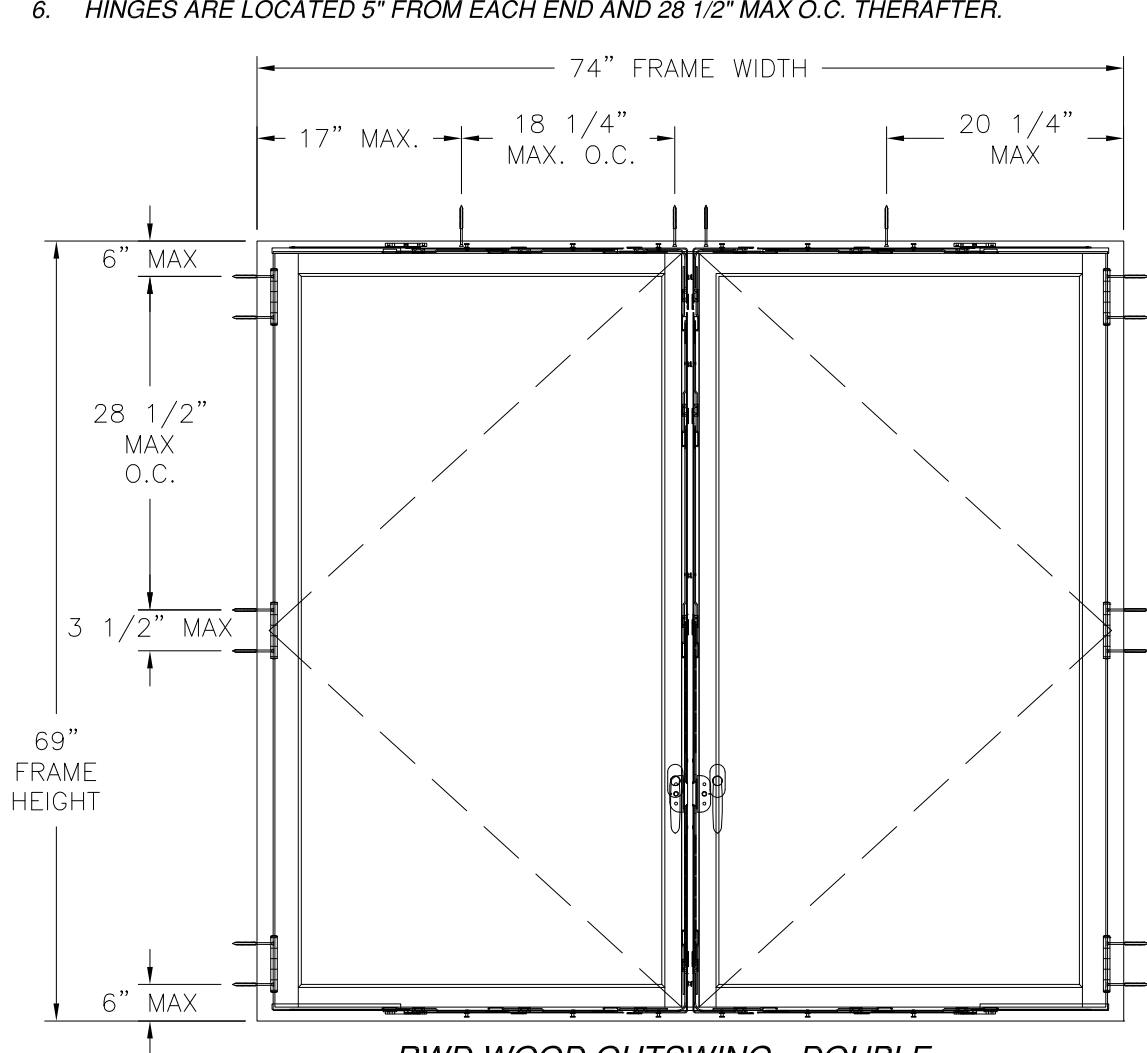

RWD WOOD OUTSWING - DOUBLE
EXTERIOR VIEW (ANCHORS THROUGH HARDWARE & HINGES)

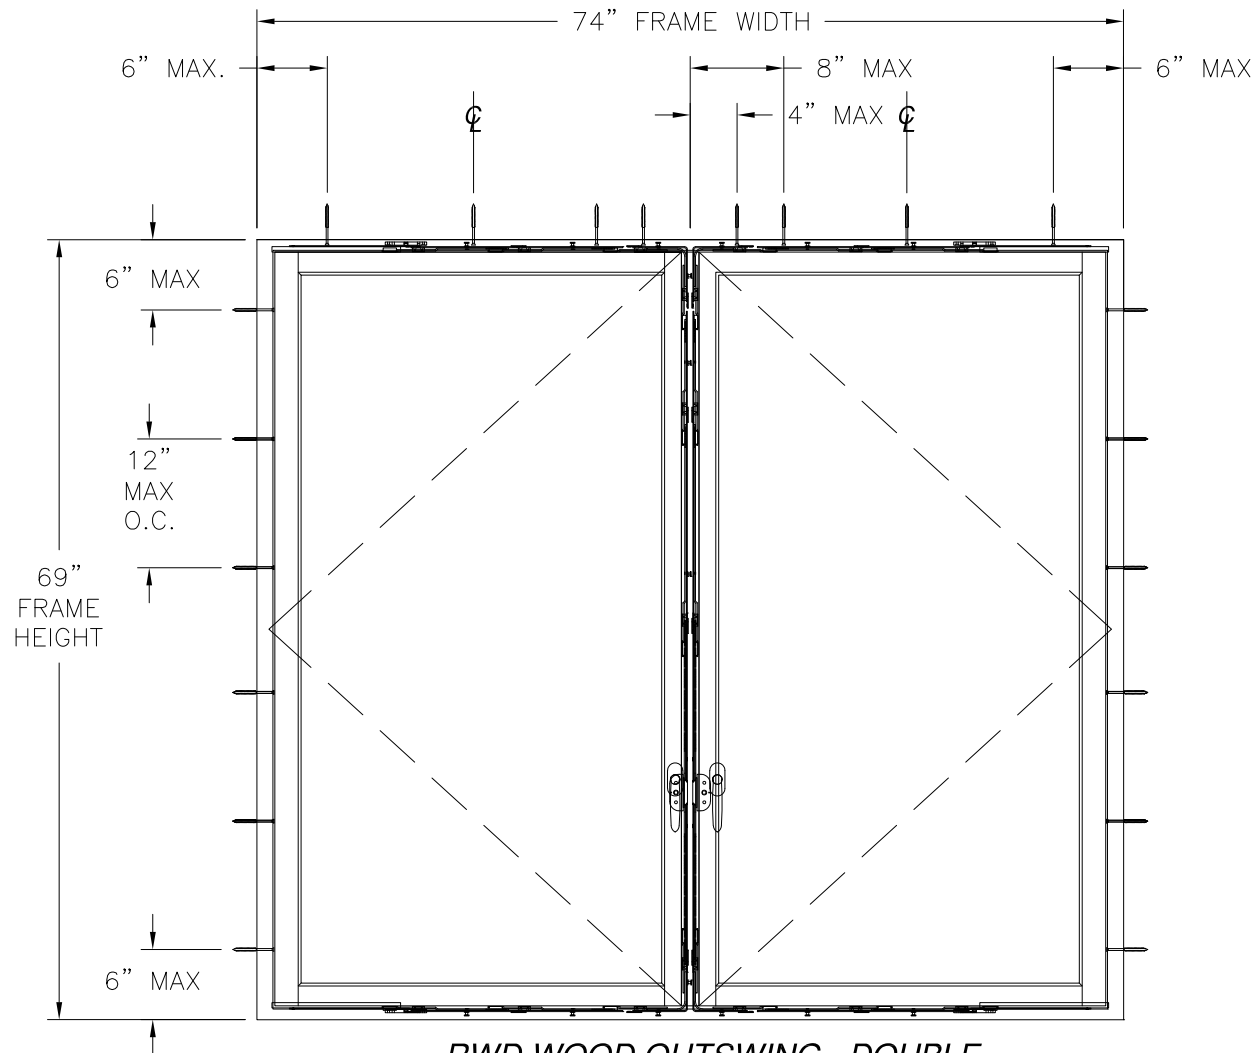

RWD WOOD OUTSWING - DOUBLE
EXTERIOR VIEW (ANCHORS THROUGH FRAME)

WEEP HOLES:
(6) 1/4" WEEP HOLES LOCATED 12" MAX
O.C. USING ASHLAND PROWEEP 60606

WITH GLASS A	
DESIGN PRESSURE RATING	IMPACT RATING
±65.0PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4
FOR OTHER SIZES SEE CHART #1 SHEET 3A

WITH GLASS B	
DESIGN PRESSURE RATING	IMPACT RATING
±60.0PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4
FOR OTHER SIZES SEE CHART #2 SHEET 3A

WITH GLASS B	
DESIGN PRESSURE RATING	IMPACT RATING
±65.0PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 3
FOR OTHER SIZES SEE CHART #3 SHEET 3A

HARDWARE SCHEDULE

A.	(6) BUTT HINGES BUTTON TIP UNLACQ POLISHED BRASS AT JAMBS
B.	(4) RWD CUSTOM SURFACE BOLTS AT BOTTOM AND TOP OF KEEPER/LOCK STILES
C.	(4) KEEPERS FOR SURFACE BOLTS AT HEAD/SILL
D.	(1) SINGLE POINT HOPPE STEEL LOCKING SYSTEM AT MEETING STILE


SIGNED: 02/11/2026

REILLY WINDOW & DOORS
901 BURMAN BLVD., BLDG 701
CALVERTON, NY 11933

RWD WOOD OUTSWING
FRENCH CASEMENT, IMPACT
DOUBLE CASEMENT ELEVATION


DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 2 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

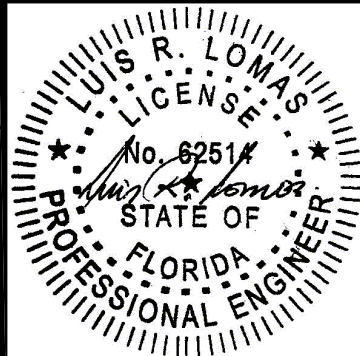


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

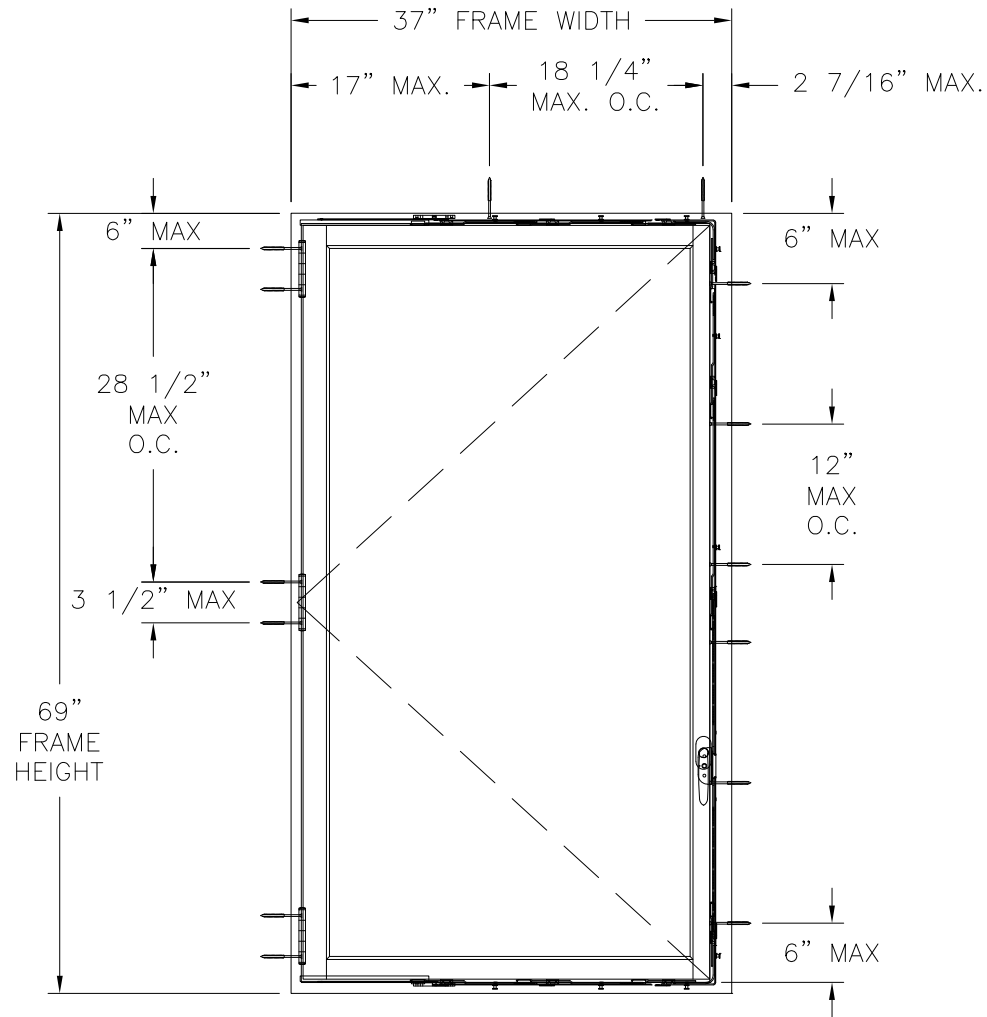

RWD WOOD OUTSWING - SINGLE
EXTERIOR VIEW (ANCHORS THROUGH HARDWARE & HINGES)

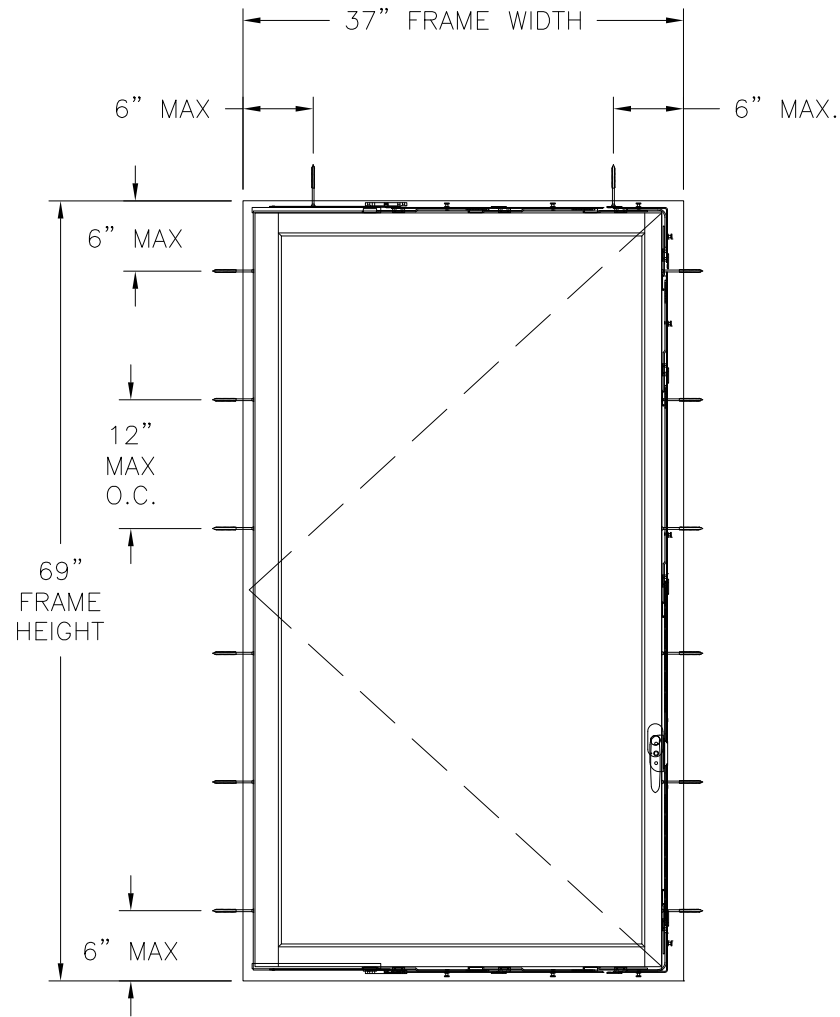

RWD WOOD OUTSWING - SINGLE
EXTERIOR VIEW (ANCHORS THROUGH FRAME)

WITH GLASS A

DESIGN PRESSURE RATING	IMPACT RATING
±65.0PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4
FOR OTHER SIZES SEE CHART #1 SHEET 3A

WITH GLASS B

DESIGN PRESSURE RATING	IMPACT RATING
±60.0PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4
FOR OTHER SIZES SEE CHART #2 SHEET 3A

WITH GLASS B

DESIGN PRESSURE RATING	IMPACT RATING
±65.0PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 3
FOR OTHER SIZES SEE CHART #3 SHEET 3A

HARDWARE SCHEDULE

A.	(6) BUTT HINGES BUTTON TIP UNLACQ POLISHED BRASS AT JAMBS
B.	(4) RWD CUSTOM SURFACE BOLTS AT BOTTOM AND TOP OF KEEPER/LOCK STILES
C.	(4) KEEPERS FOR SURFACE BOLTS AT HEAD/SILL
D.	(1) SINGLE POINT HOPPE STEEL LOCKING SYSTEM AT MEETING STILE


SIGNED: 02/11/2026

REILLY WINDOW & DOORS
901 BURMAN BLVD., BLDG 701
CALVERTON, NY 11933

RWD WOOD OUTSWING
FRENCH CASEMENT, IMPACT
SINGLE CASEMENT ELEVATION

DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 3 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

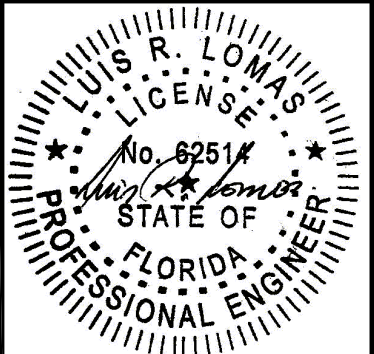

Luis R. Lomas P.E.
FL No.: 62514



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

Chart #1
Rating of units with glass A (psf)

Frame Height (in)	Frame width (in)											
	18.0		24.0		30.0		36.0		42.0		48.0	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
24.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0
30.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0
36.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	73.0	73.0
42.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	75.0	71.5	71.5	67.0	67.0
48.0	75.0	75.0	75.0	75.0	75.0	75.0	73.0	73.0	67.0	67.0	62.5	62.5
54.0	75.0	75.0	75.0	75.0	75.0	75.0	69.5	69.5	63.5	63.5	-	-
60.0	75.0	75.0	75.0	75.0	75.0	75.0	66.7	66.7	-	-	-	-
64.4	75.0	75.0	75.0	75.0	73.3	73.3	65.0	65.0	-	-	-	-
66.0	75.0	75.0	75.0	75.0	72.8	72.8	-	-	-	-	-	-
72.0	75.0	75.0	75.0	75.0	69.7	69.7	-	-	-	-	-	-
78.0	75.0	75.0	75.0	75.0	-	-	-	-	-	-	-	-
84.0	75.0	75.0	74.7	74.7	-	-	-	-	-	-	-	-
90.0	75.0	75.0	69.7	69.7	-	-	-	-	-	-	-	-
96.0	75.0	75.0	65.4	65.4	-	-	-	-	-	-	-	-
102.0	75.0	75.0	-	-	-	-	-	-	-	-	-	-
108.0	75.0	75.0	-	-	-	-	-	-	-	-	-	-
114.0	73.4	73.4	-	-	-	-	-	-	-	-	-	-

LARGE MISSILE IMPACT UP TO WIND ZONE 4

Chart #2
Rating of units with glass B (psf)

Frame Height (in)	Frame width (in)											
	18.0		24.0		30.0		36.0		42.0		48.0	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
24.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
30.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
36.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
42.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
48.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
54.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	-	-
60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	-	-	-	-
64.4	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	-	-	-	-
66.0	60.0	60.0	60.0	60.0	60.0	60.0	-	-	-	-	-	-
72.0	60.0	60.0	60.0	60.0	60.0	60.0	-	-	-	-	-	-
78.0	60.0	60.0	60.0	60.0	-	-	-	-	-	-	-	-
84.0	60.0	60.0	60.0	60.0	-	-	-	-	-	-	-	-
90.0	60.0	60.0	60.0	60.0	-	-	-	-	-	-	-	-
96.0	60.0	60.0	60.0	60.0	-	-	-	-	-	-	-	-
102.0	60.0	60.0	-	-	-	-	-	-	-	-	-	-
108.0	60.0	60.0	-	-	-	-	-	-	-	-	-	-
114.0	60.0	60.0	-	-	-	-	-	-	-	-	-	-

LARGE MISSILE IMPACT UP TO WIND ZONE 4

Chart #3
Rating of units with glass B (psf)

Frame Height (in)	Frame width (in)											
	18.0		24.0		30.0		36.0		42.0		48.0	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
24.00	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
30.00	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
36.00	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0
42.00	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	67.0	67.0
48.00	70.0	70.0	70.0	70.0	70.0	70.0	70.0	70.0	67.0	67.0	62.5	62.5
54.00	70.0	70.0	70.0	70.0	70.0	70.0	69.5	69.5	63.5	63.5	-	-
60.00	70.0	70.0	70.0	70.0	70.0	70.0	66.7	66.7	-	-	-	-
64.38	70.0	70.0	70.0	70.0	70.0	70.0	65.0	65.0	-	-	-	-
66.00	70.0	70.0	70.0	70.0	70.0	70.0	-	-	-	-	-	-
72.00	70.0	70.0	70.0	70.0	69.7	69.7	-	-	-	-	-	-
78.00	70.0	70.0	70.0	70.0	-	-	-	-	-	-	-	-
84.00	70.0	70.0	70.0	70.0	-	-	-	-	-	-	-	-
90.00	70.0	70.0	69.7	69.7	-	-	-	-	-	-	-	-
96.00	70.0	70.0	65.4	65.4	-	-	-	-	-	-	-	-
102.00	70.0	70.0	-	-	-	-	-	-	-	-	-	-
108.00	70.0	70.0	-	-	-	-	-	-	-	-	-	-
114.00	70.0	70.0	-	-	-	-	-	-	-	-	-	-

LARGE MISSILE IMPACT UP TO WIND ZONE 3




SIGNED: 02/11/2026

REILLY WINDOW & DOORS 901 BURMAN BLVD., BLDG 701 CALVERTON, NY 11933		
RWD WOOD OUTSWING FRENCH CASEMENT, IMPACT RATING CHARTS		
DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 3A OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@rlomaspe.com		

Luis R. Lomas P.E.
FL No.: 62514



PARTS LIST				
NO.	PART NUMBER	DESCRIPTION	MANUFACTURER	MATERIAL
1	CA3	CASING	REILLY	MAHOGANY
2	A2.12	HEAD & SILL FRAME	REILLY	MAHOGANY
3	SN1.2	NOSING	REILLY	MAHOGANY
4	J7B	HEAD	REILLY	MAHOGANY
5	WS24-B	WEATHERSTRIP BLACK	RCT	EPDM 75 SHORE A
6	GSA	GLASS STOP	REILLY	MAHOGANY
7	SL7A	SILL	REILLY	MAHOGANY
8	NEW ALUM EXT	EXTRUSION	NOVA	ALUMINUM 6063-T5
9	60606	PROWEEP 4 AMOUNT AS	ASHLAND HARDWARE	
10	90065A199	WOOD SCREW #8	McMASTER CARR	
11	J7C	JAMB	REILLY	MAHOGANY
12	A1.87	STILE	REILLY	MAHOGANY
13	A2.12B	STILE	REILLY	MAHOGANY
14	60 DURO-WH	ASTRAGAL WEATHER SEAL	IND-EX	60 DURO
15	A2.56	STILE	REILLY	MAHOGANY
16	125P-PBA-4.5X4.5	BUTT HINGE	SIEGENIA	
17	1740123	VERONA: WINDOW LEVER	HOPPE	BRASS
18	AS1.5B	EXTERIOR ASTRAGAL	REILLY	MAHOGANY
19	91771A199	#8-32 SMS	McMASTER CARR	
20	6116-WH-1875	GLAZING TAPE	LAMATEK	
21	6116-WH-375	GLAZING TAPE	LAMATEK	
22	995-WH-20 OZ	STRUCTURAL SILICONE CAULK	DOW CORNING	
23	90294A155	WOOD SCREW #6	McMASTER CARR	

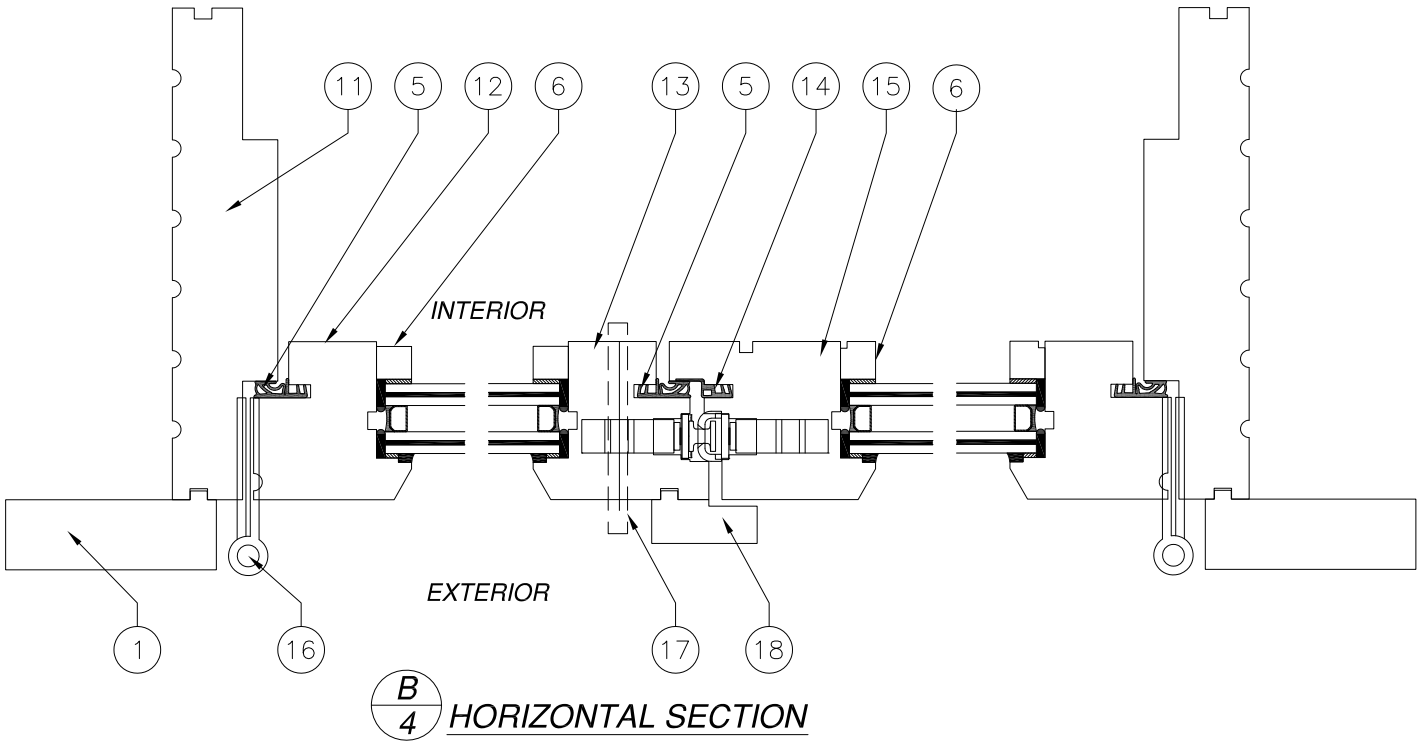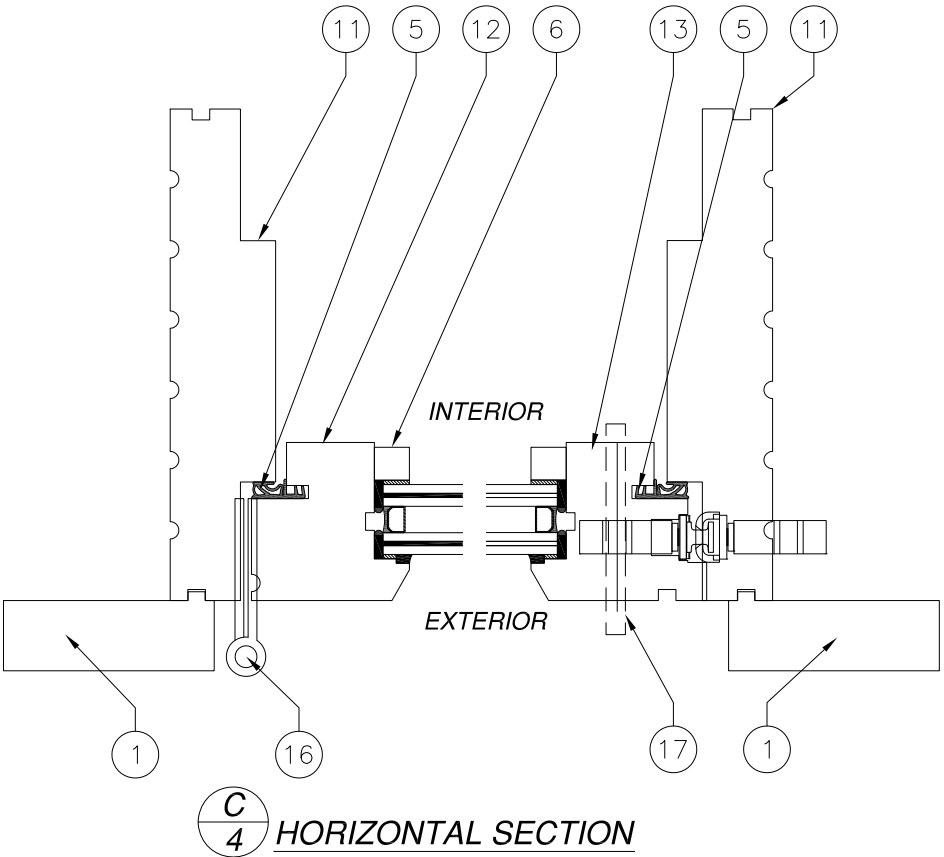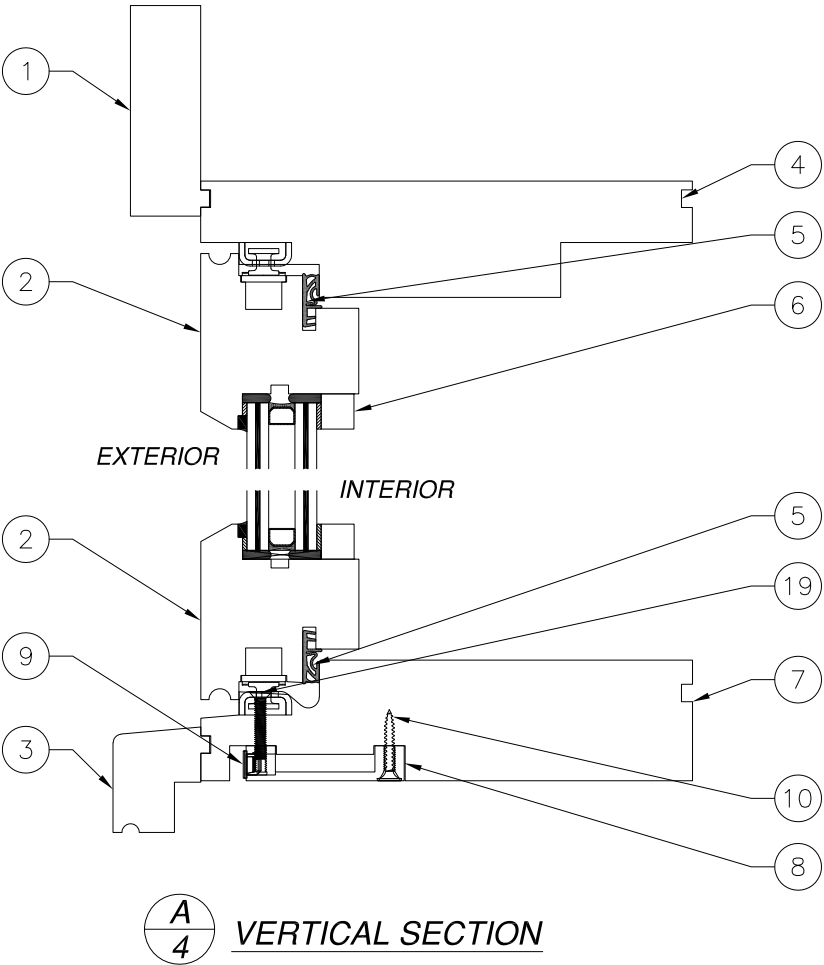

FOR ILLUSTRATION PURPOSES ONLY
FOR INSTALLATION DETAILS REFER TO SHEETS 5 - 10

SIGNED: 02/11/2026

REILLY WINDOW & DOORS
901 BURMAN BLVD., BLDG 701
CALVERTON, NY 11933

RWD WOOD OUTSWING
FRENCH CASEMENT, IMPACT
B.O.M. & CROSS SECTIONS

DRAWN:
R.L.

DWG NO.
08-03983A


REV
A

SCALE
NTS

DATE
11/14/23

SHEET
4 OF 15


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

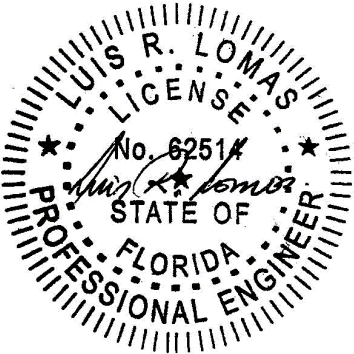

Luis R. Lomas P.E.
FL No.: 62514




REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

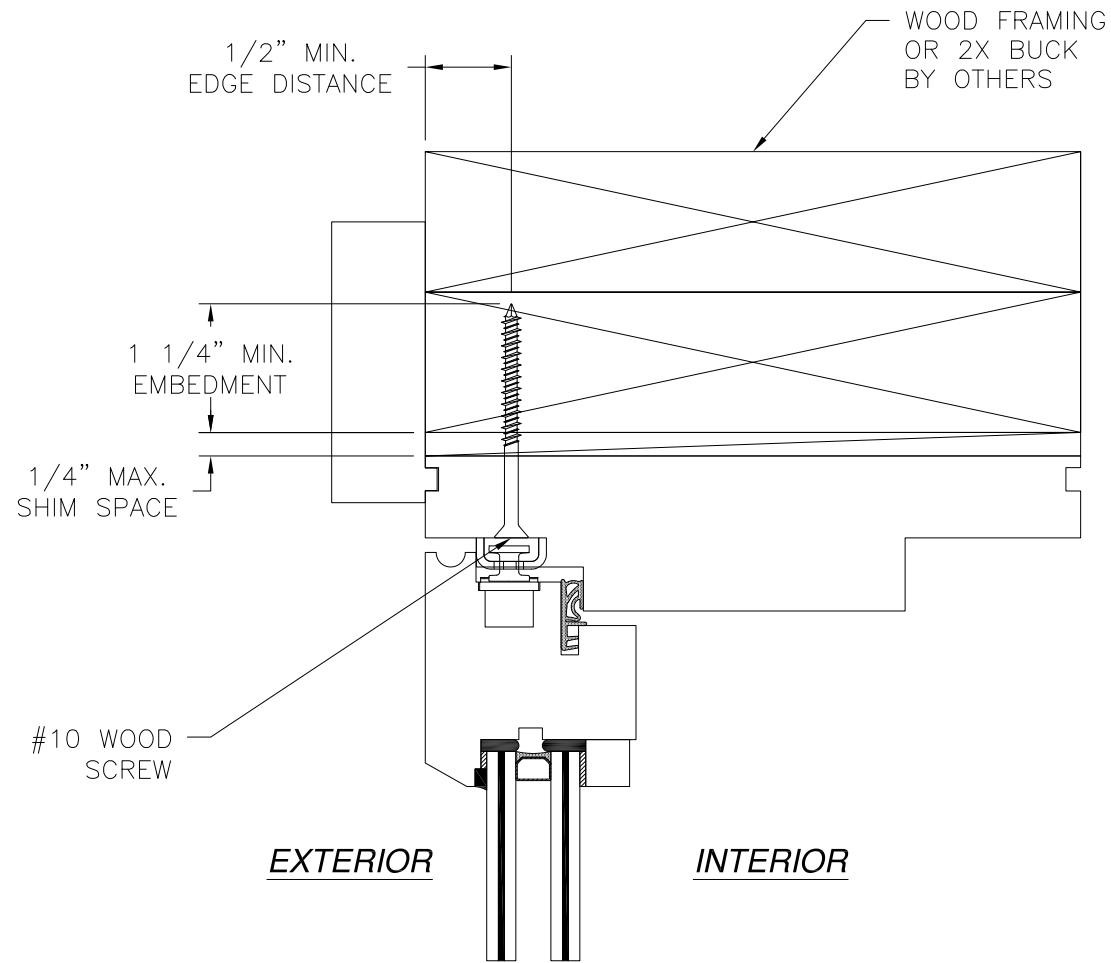


EXTERIOR

INTERIOR

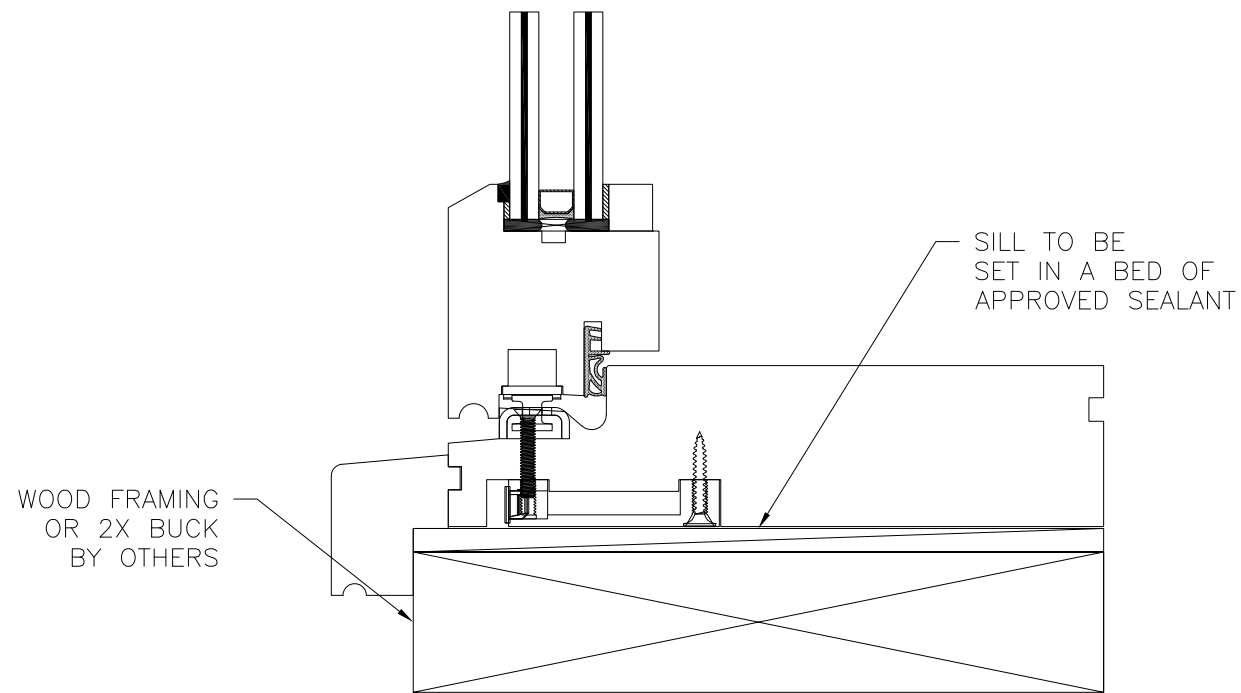

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

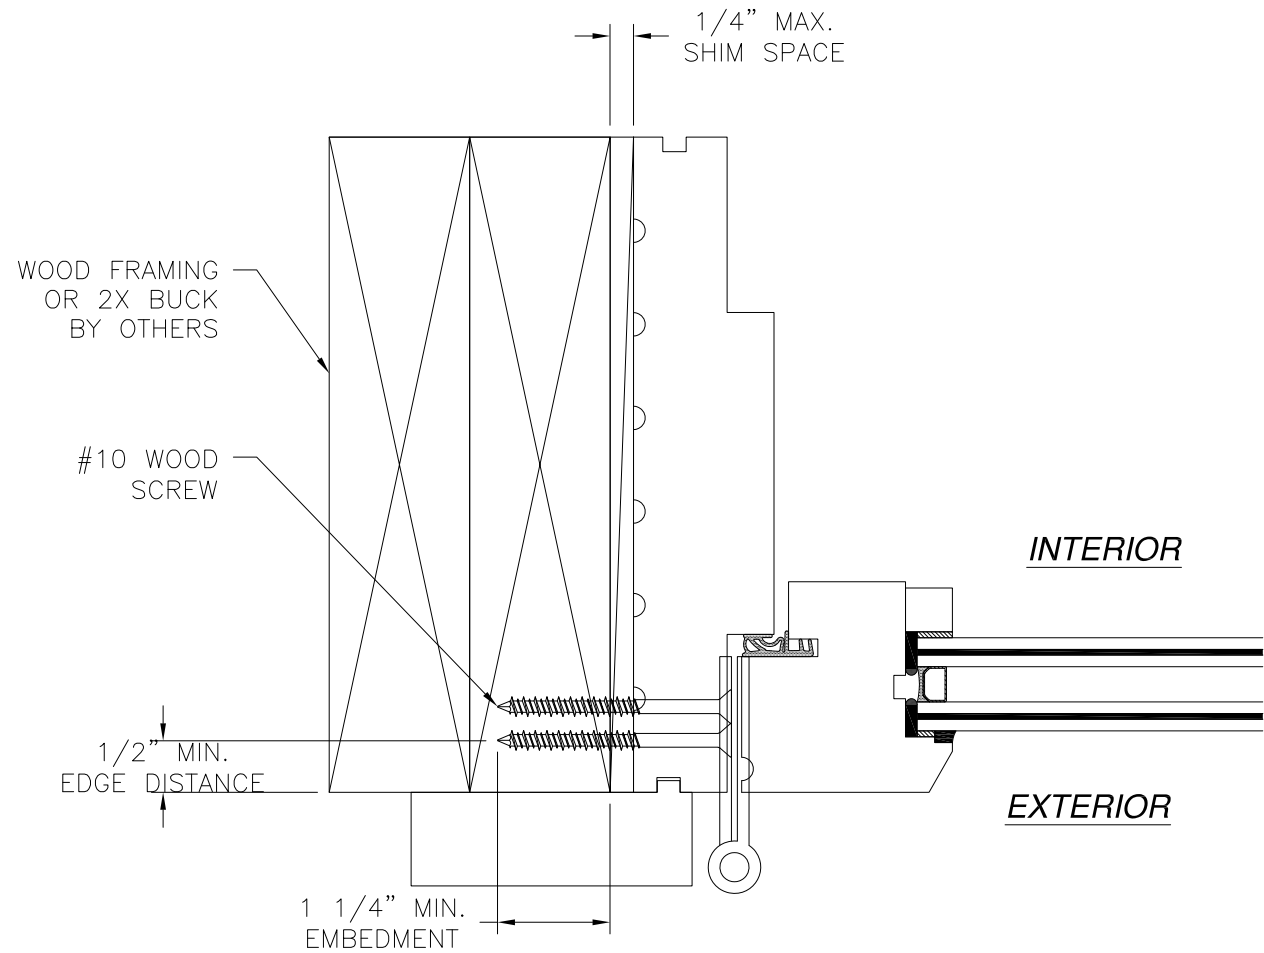


JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 02/11/2026



REILLY WINDOW & DOORS 901 BURMAN BLVD., BLDG 701 CALVERTON, NY 11933		
RWD WOOD OUTSWING FRENCH CASEMENT, IMPACT INSTALLATION DETAILS		
DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 5 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

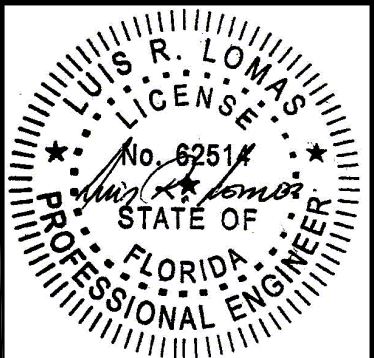


Luis R. Lomas P.E.
FL No.: 62514



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

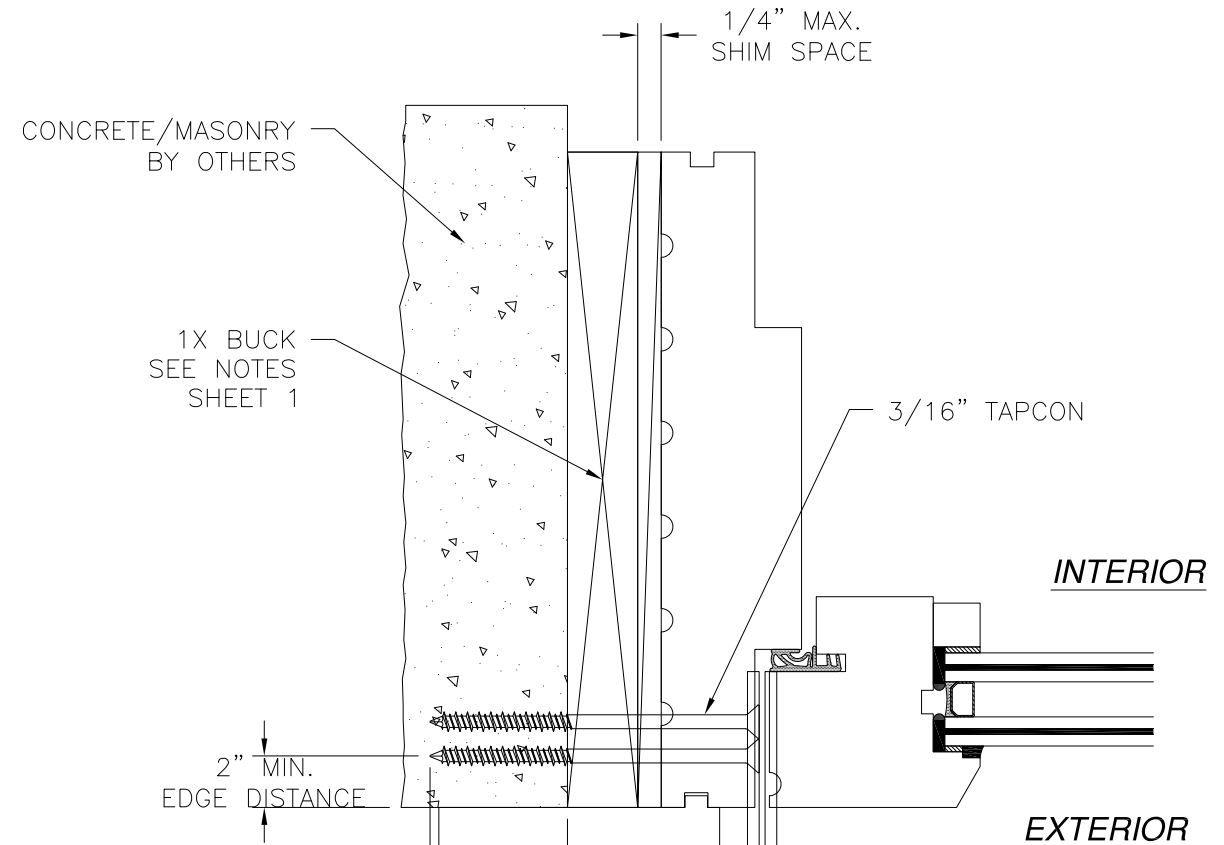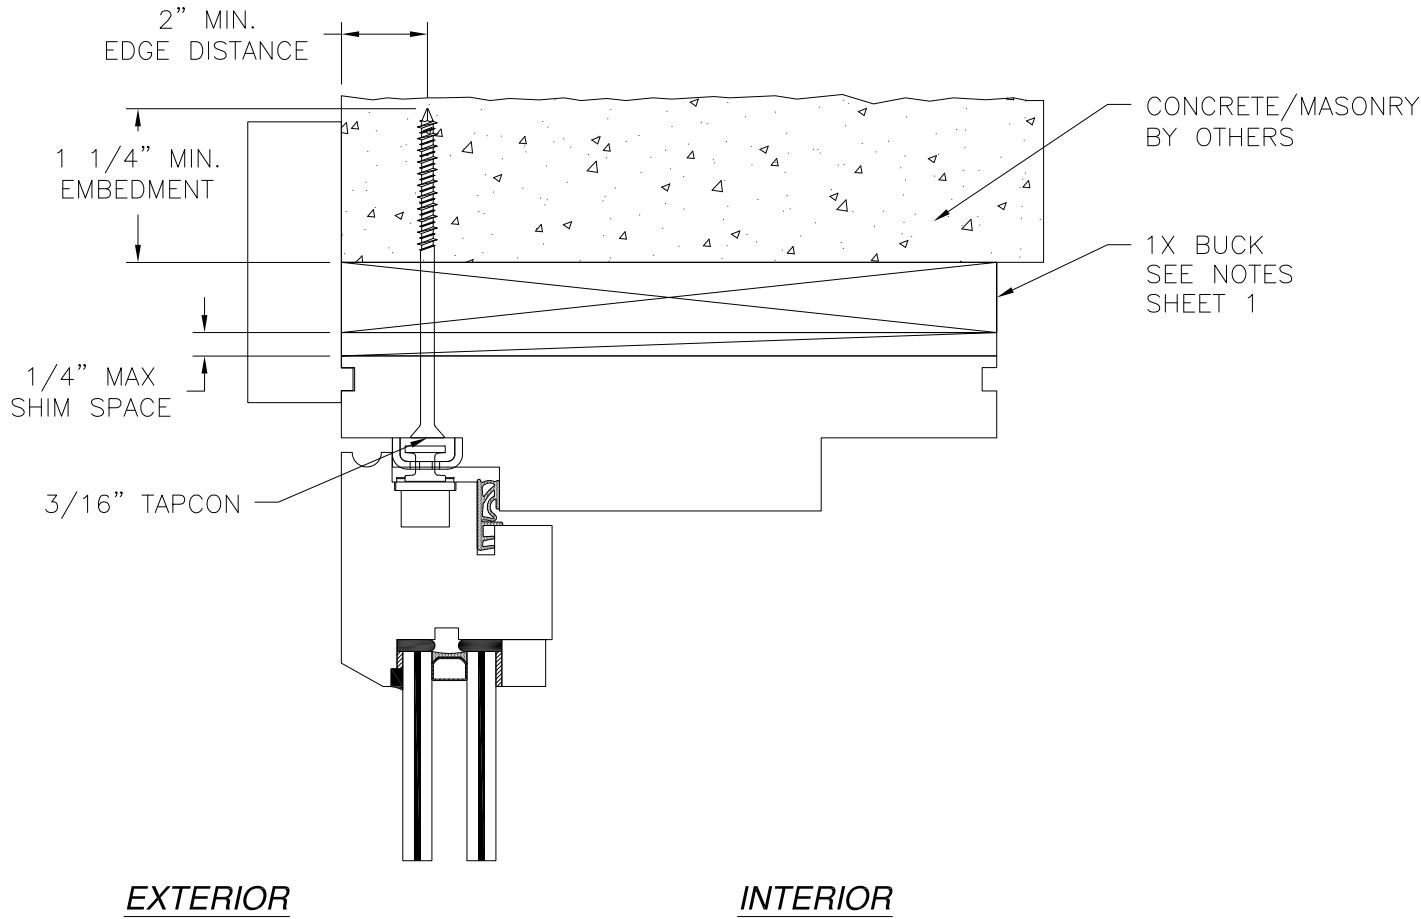

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

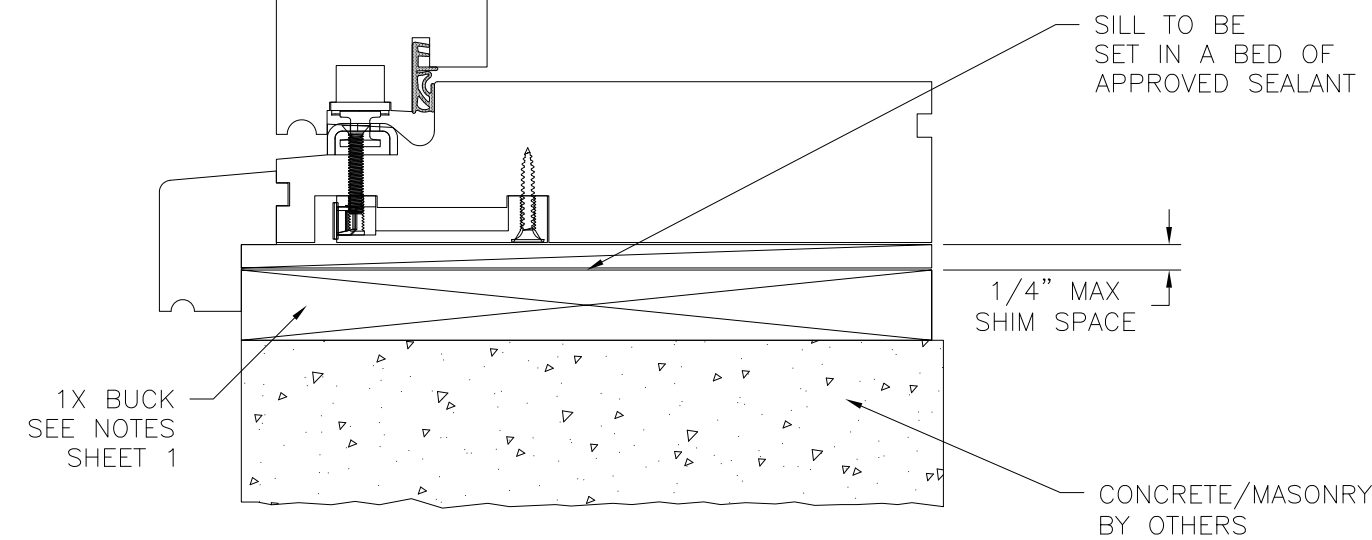


VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION


- NOTES:**
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 02/11/2026

REILLY WINDOW & DOORS 901 BURMAN BLVD., BLDG 701 CALVERTON, NY 11933		
RWD WOOD OUTSWING FRENCH CASEMENT, IMPACT INSTALLATION DETAILS		
DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 6 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

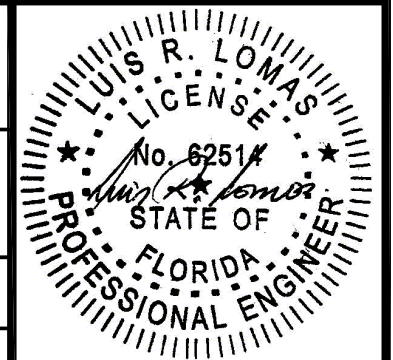


Luis R. Lomas P.E.
FL No.: 62514

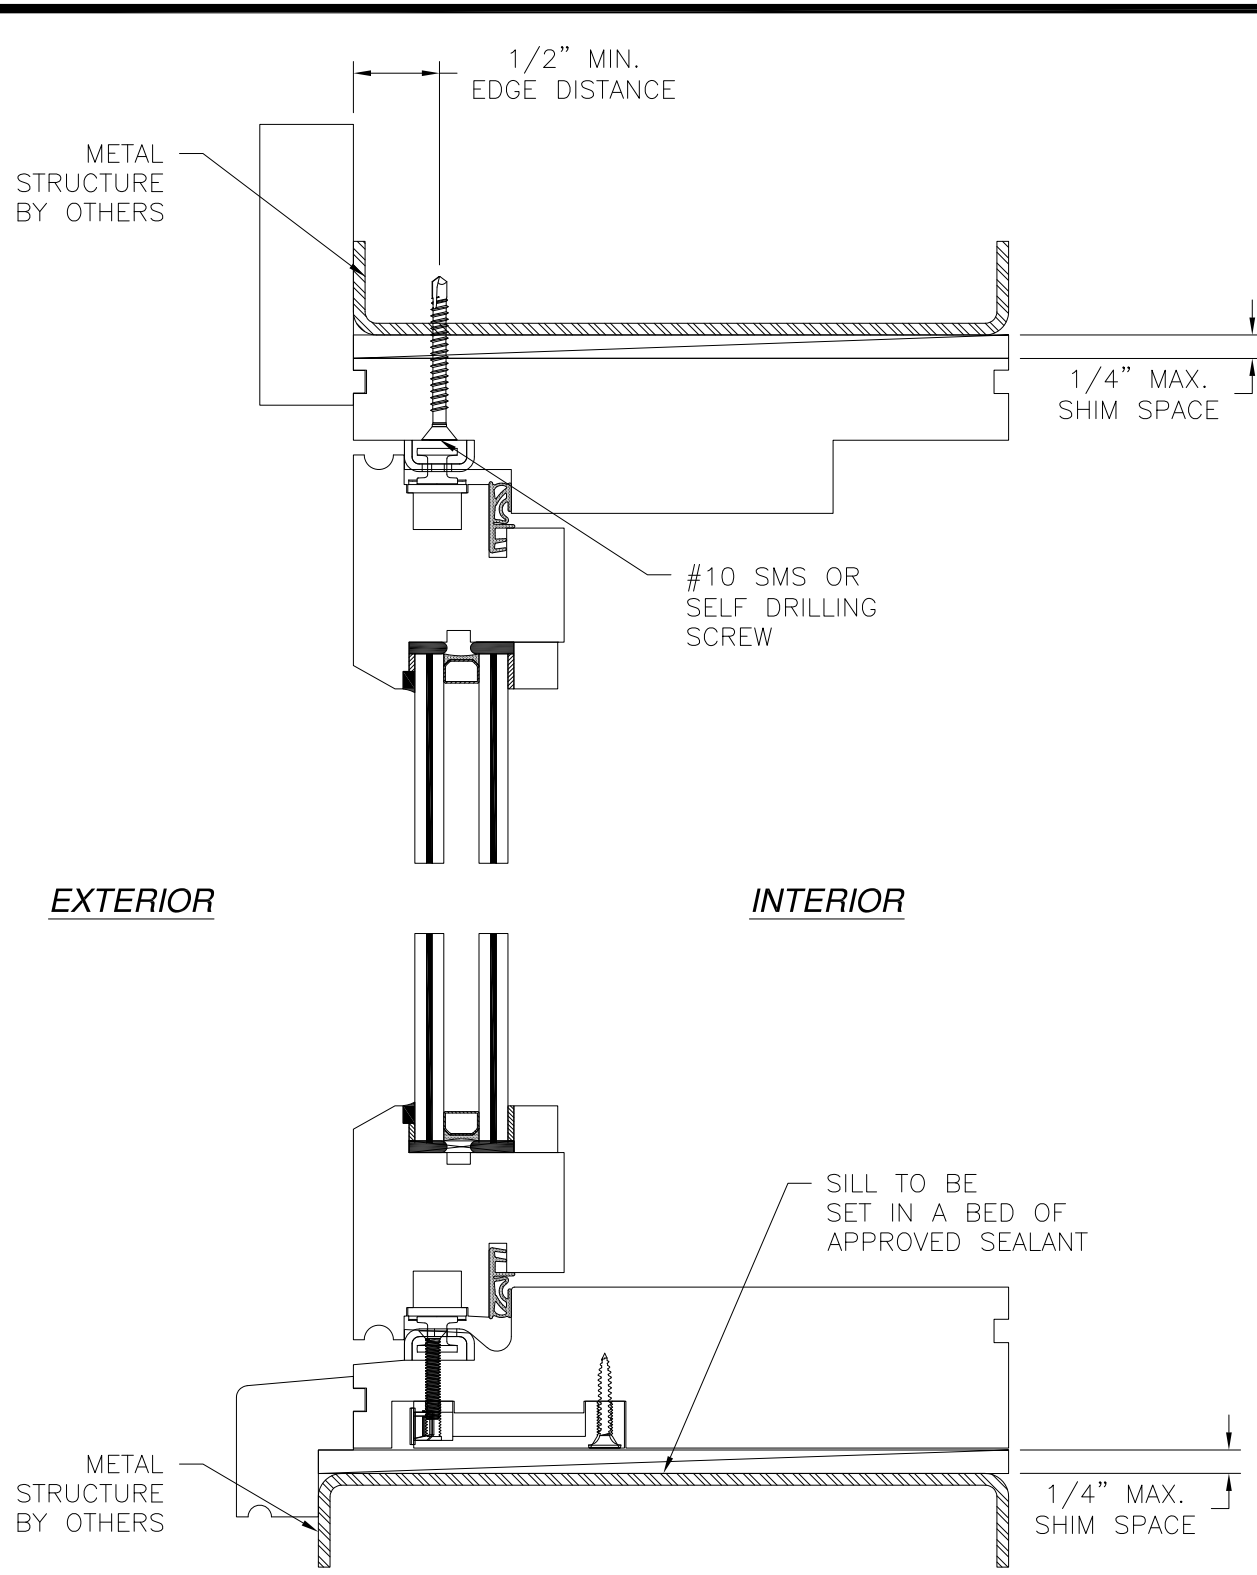

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

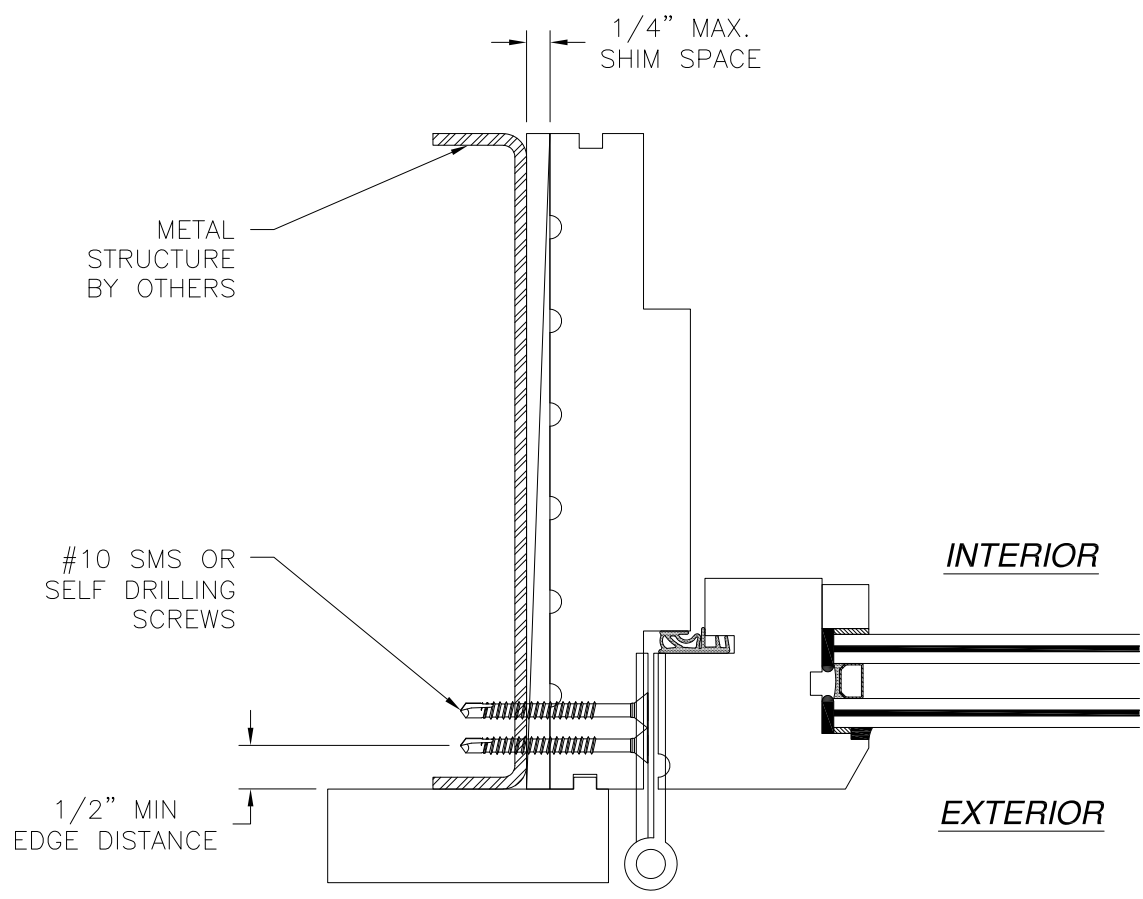

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION


REILLY WINDOW & DOORS
901 BURMAN BLVD., BLDG 701
CALVERTON, NY 11933

RWD WOOD OUTSWING
FRENCH CASEMENT, IMPACT
INSTALLATION DETAILS

DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 7 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 02/11/2026

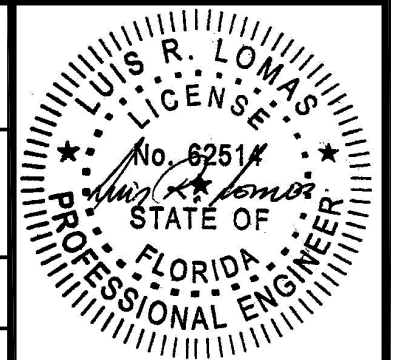

Luis R. Lomas P.E.
FL No.: 62514




REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

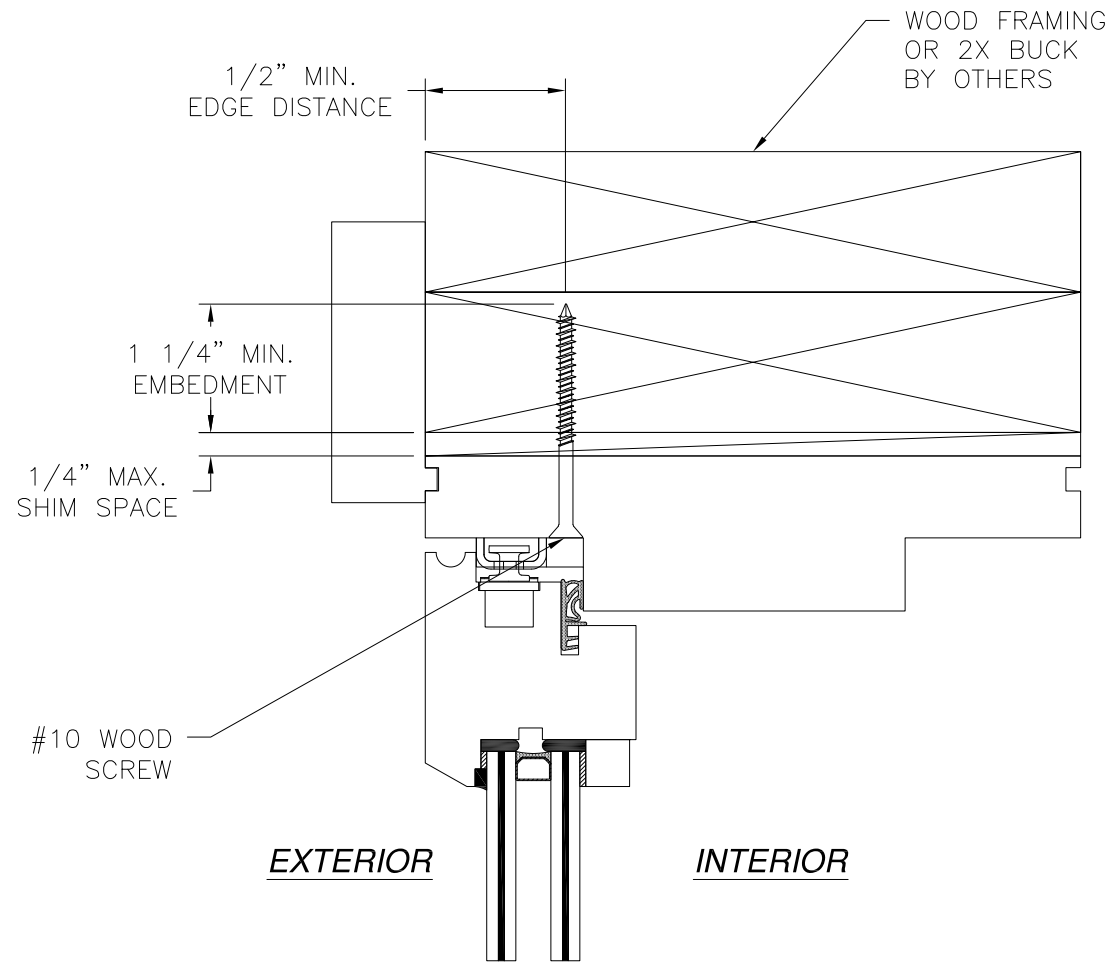


EXTERIOR

INTERIOR

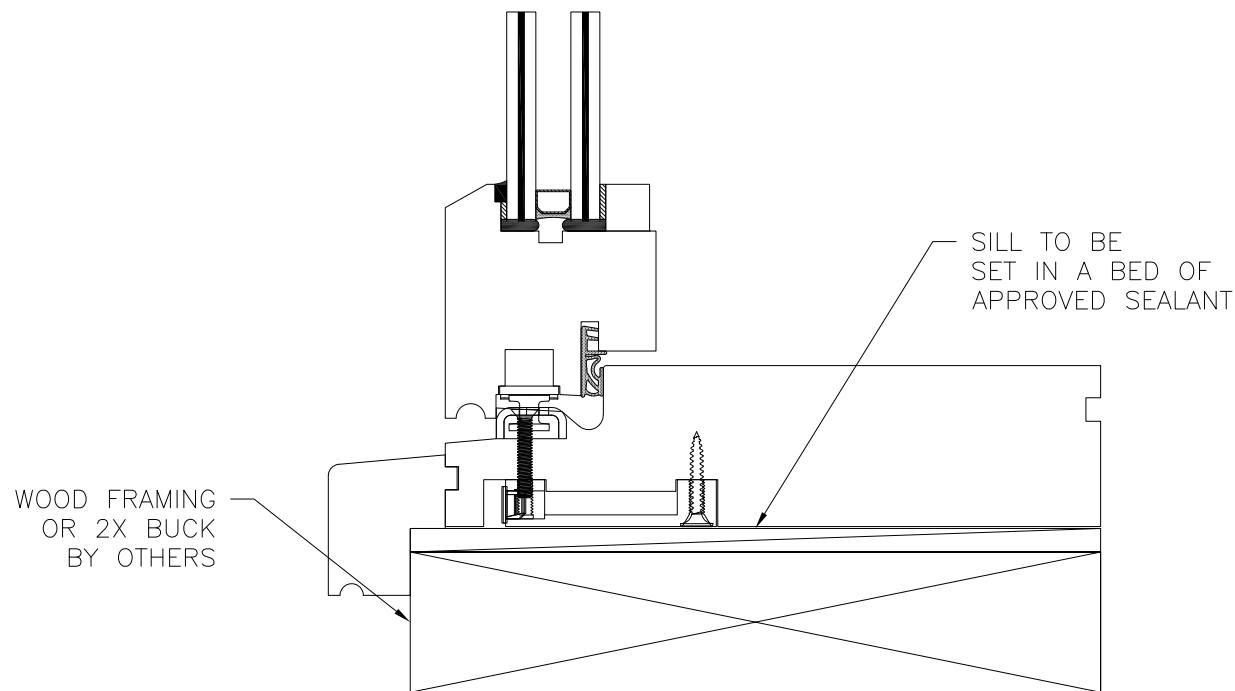

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

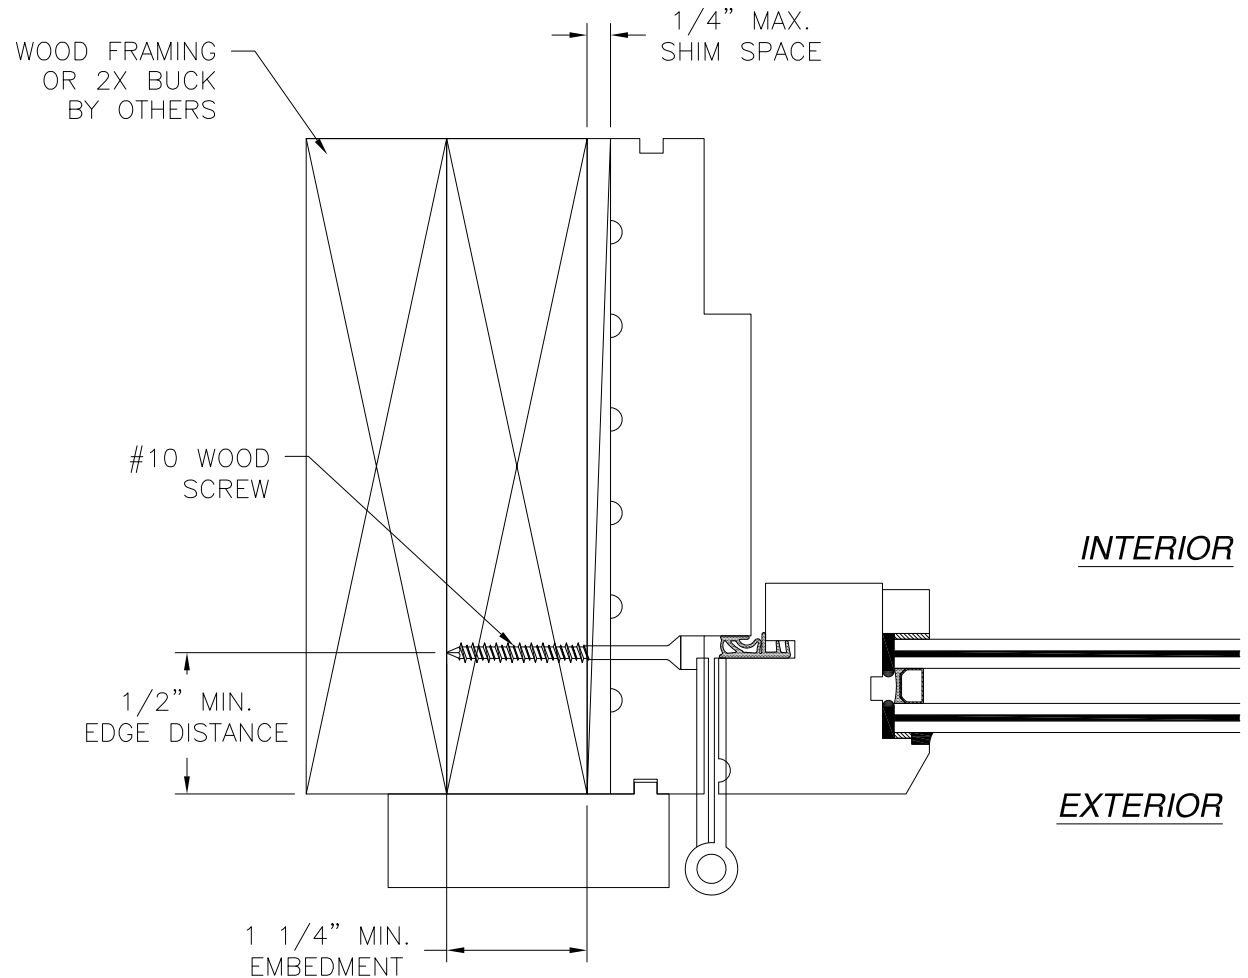

INTERIOR

EXTERIOR


JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 02/11/2026



REILLY WINDOW & DOORS 901 BURMAN BLVD., BLDG 701 CALVERTON, NY 11933		
RWD WOOD OUTSWING FRENCH CASEMENT, IMPACT INSTALLATION DETAILS		
DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 8 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

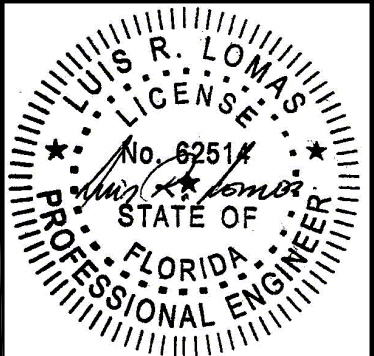

Luis R. Lomas P.E.
FL No.: 62514



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

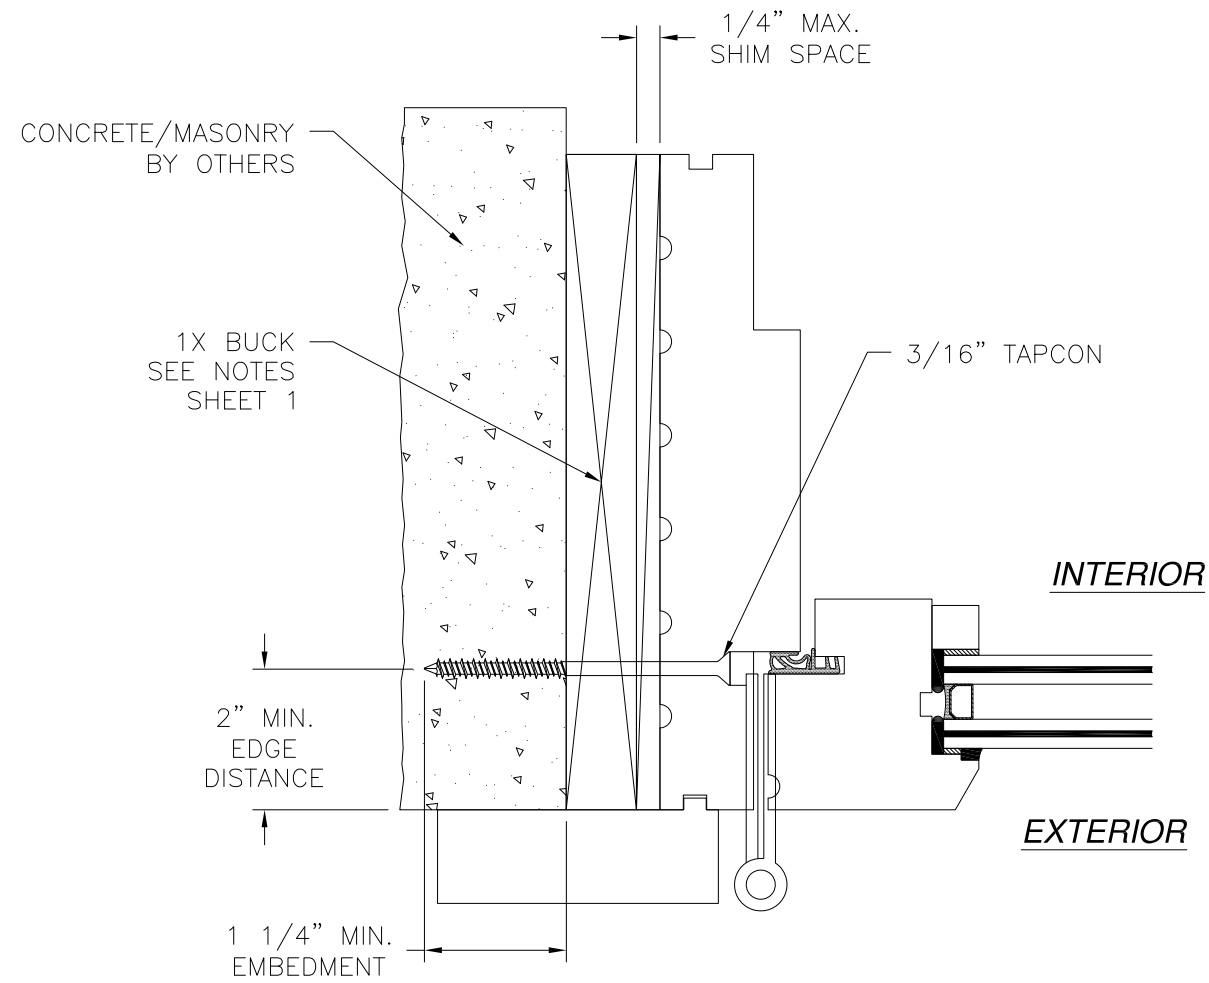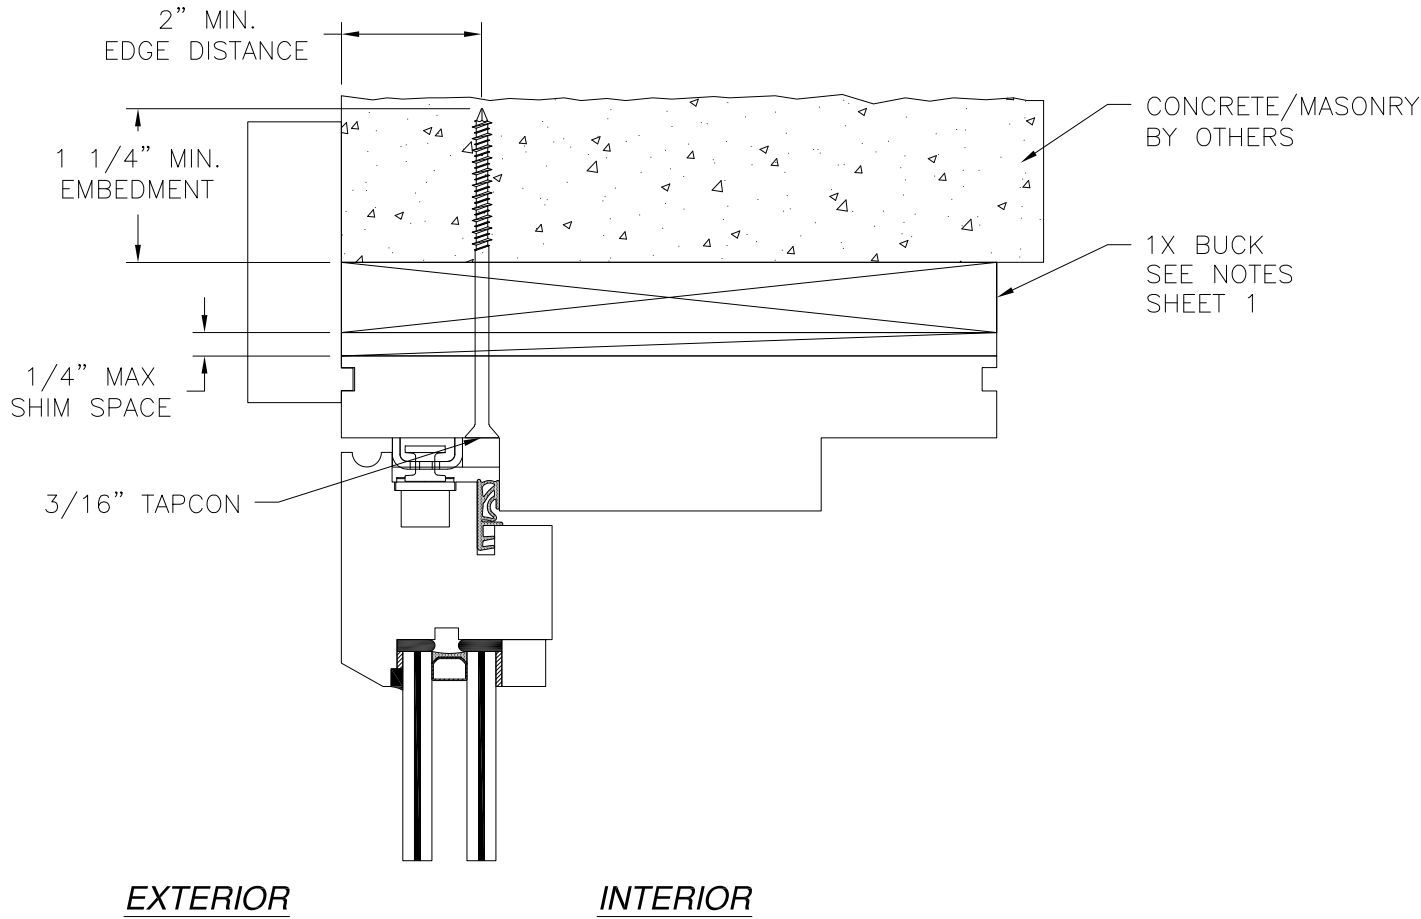


JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION


- NOTES:**
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 02/11/2026



REILLY WINDOW & DOORS 901 BURMAN BLVD., BLDG 701 CALVERTON, NY 11933		
RWD WOOD OUTSWING FRENCH CASEMENT, IMPACT INSTALLATION DETAILS		
DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 9 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

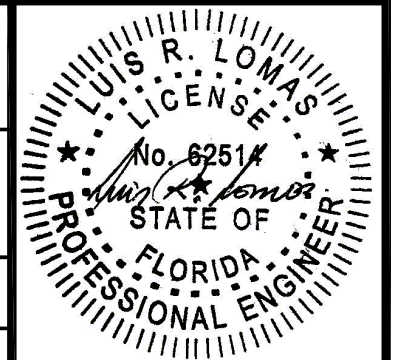

Luis R. Lomas P.E.
FL No.: 62514

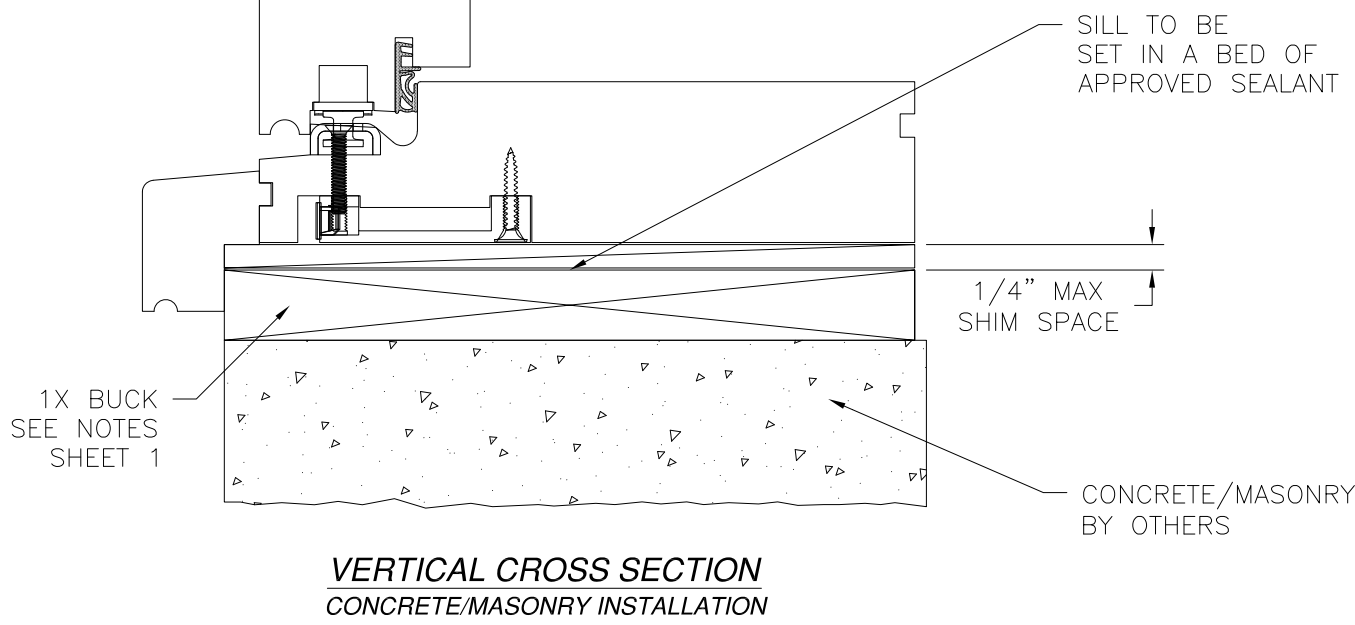


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

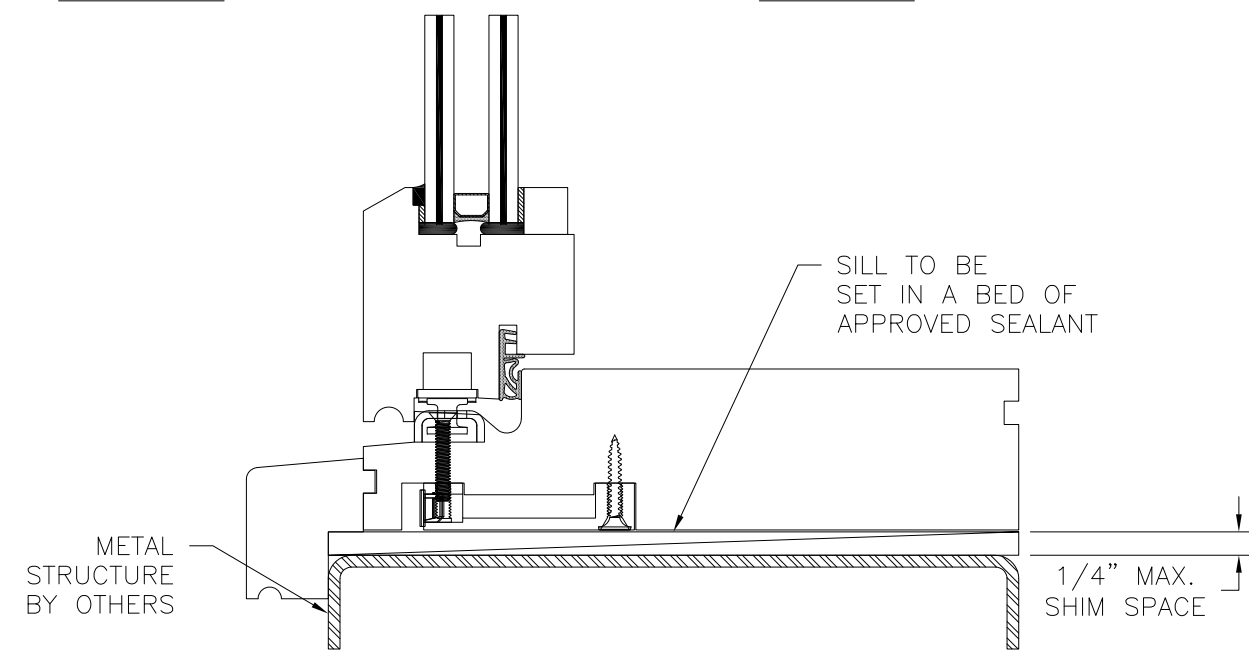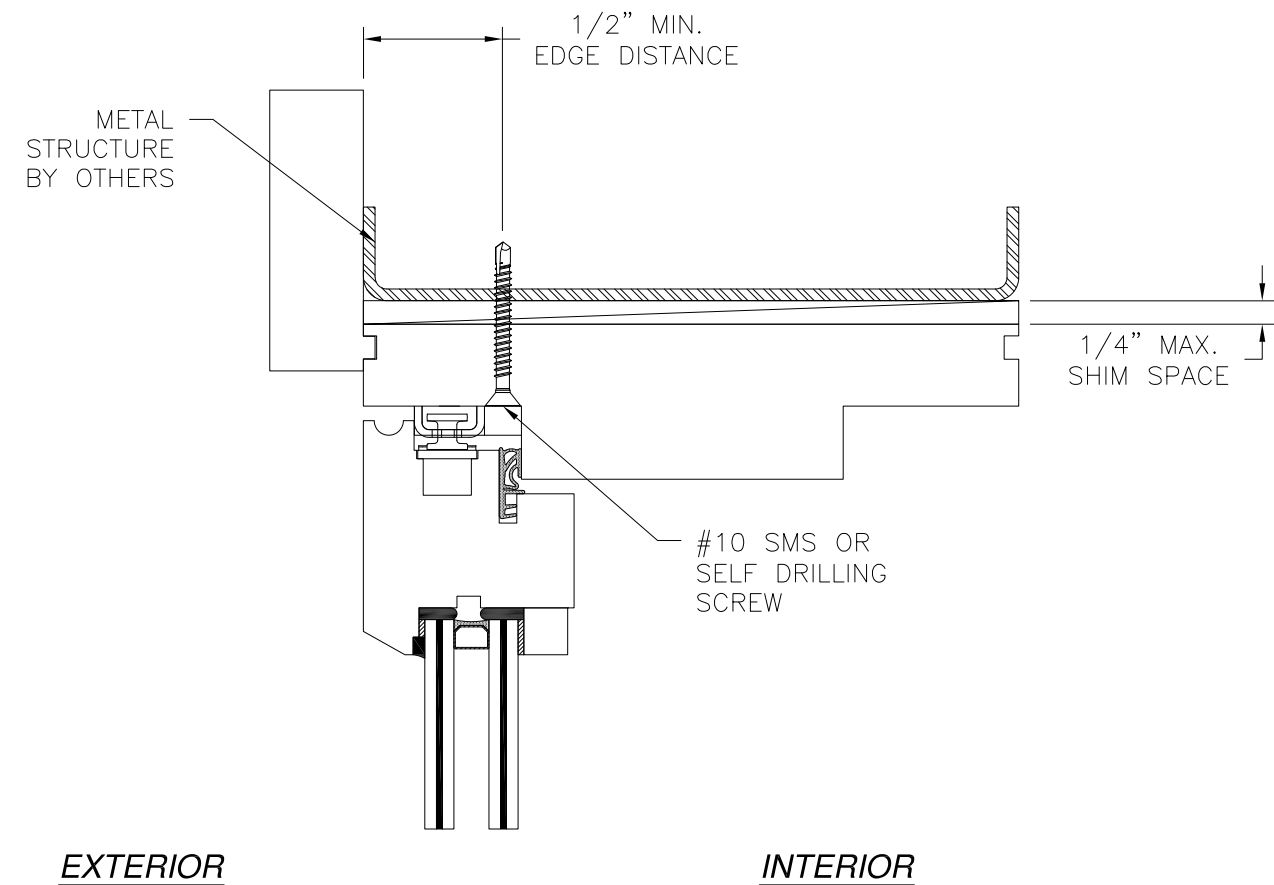

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION


- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

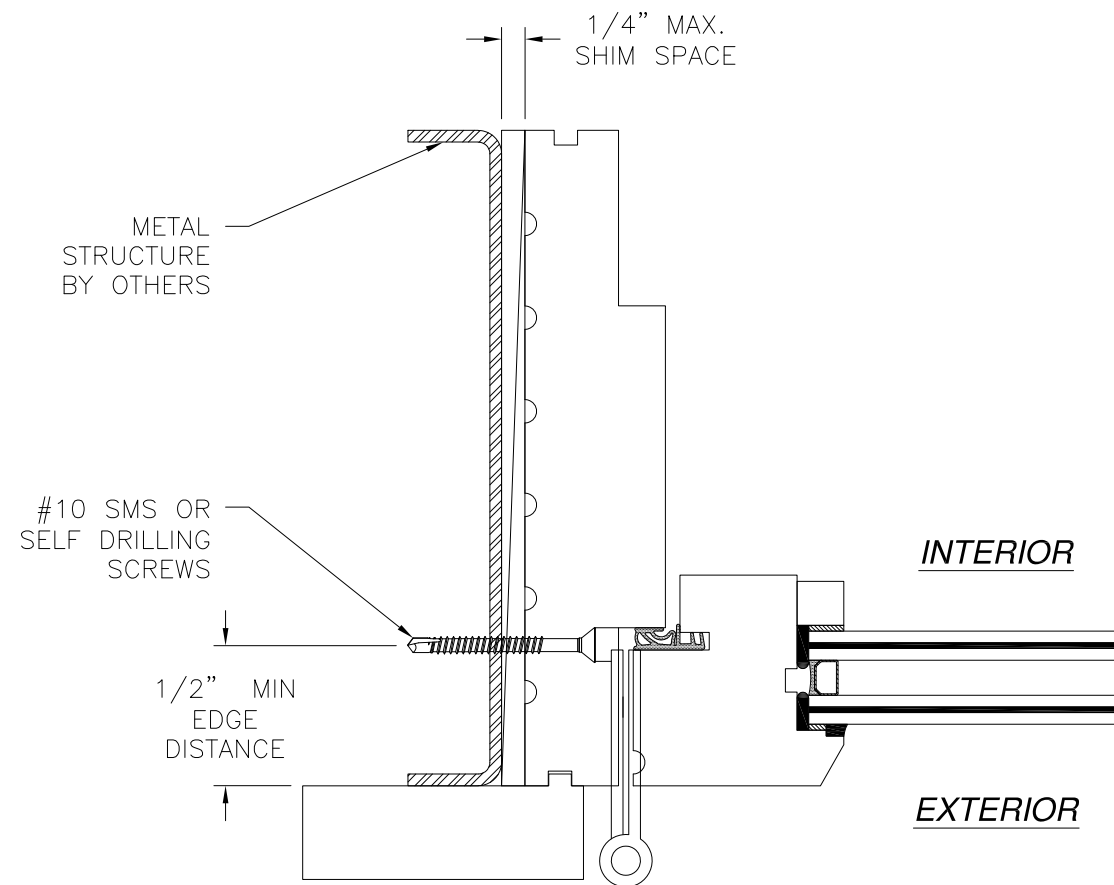

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION




REILLY WINDOW & DOORS 901 BURMAN BLVD., BLDG 701 CALVERTON, NY 11933		
RWD WOOD OUTSWING FRENCH CASEMENT, IMPACT INSTALLATION DETAILS		
DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 10 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 02/11/2026

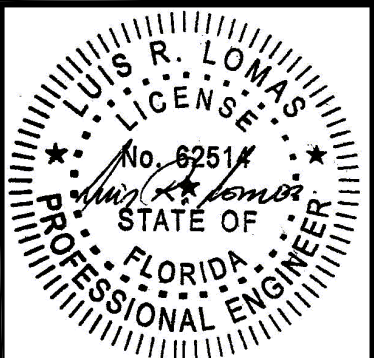

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

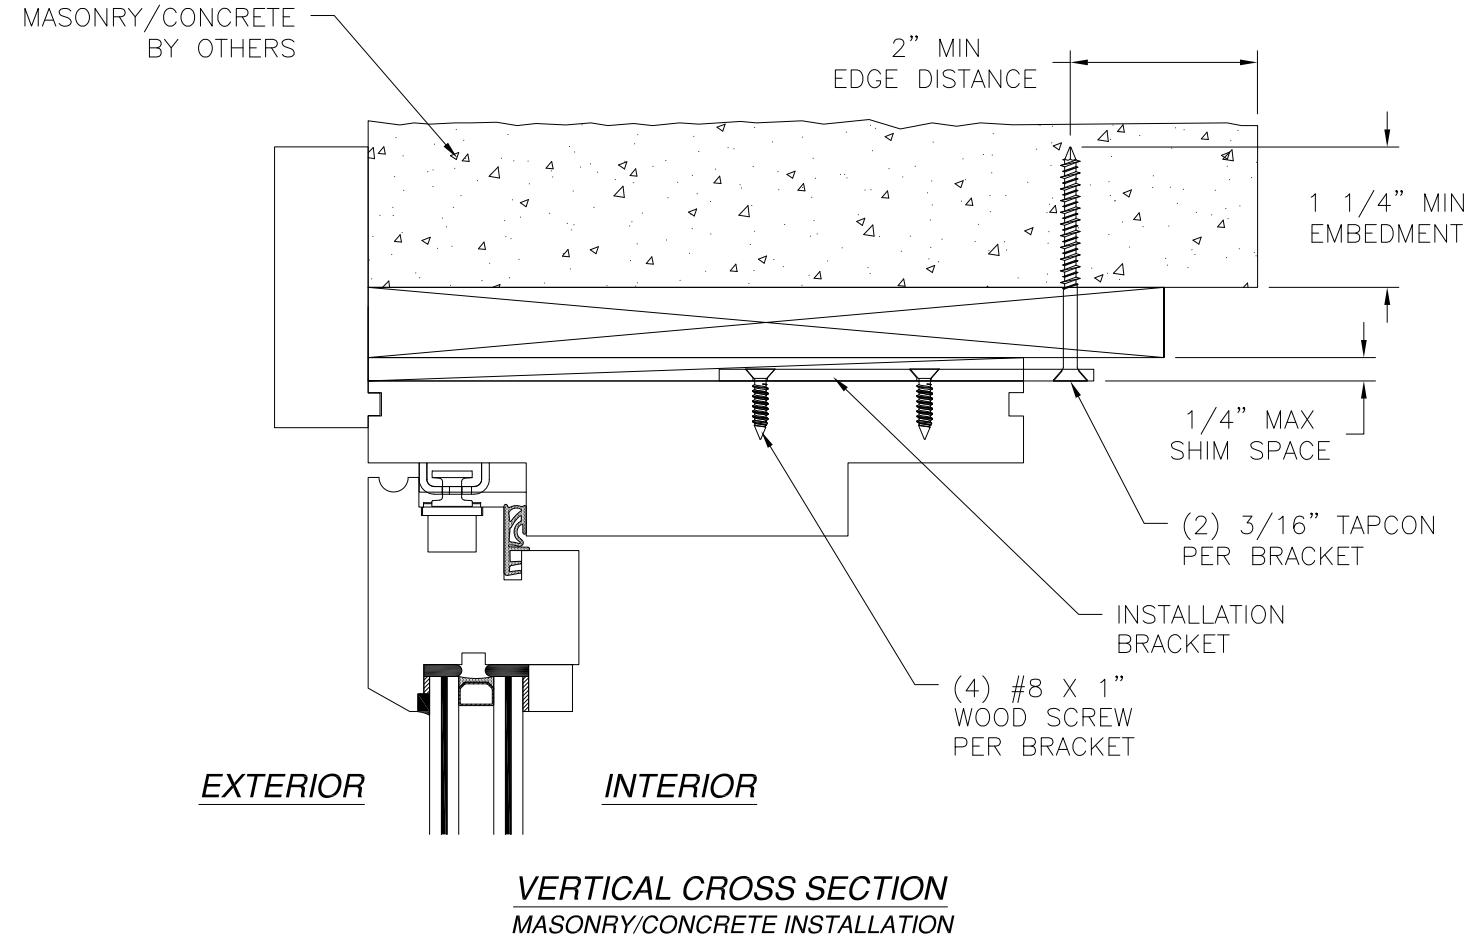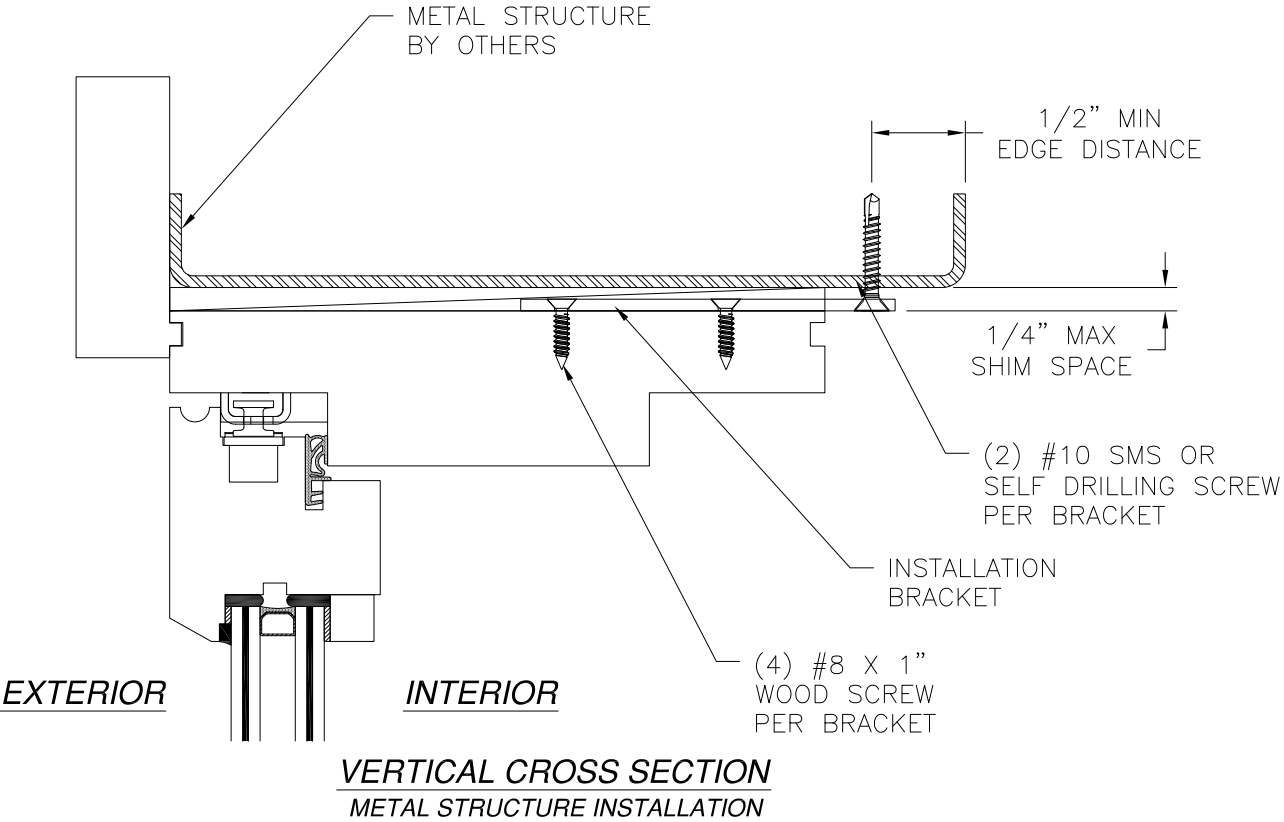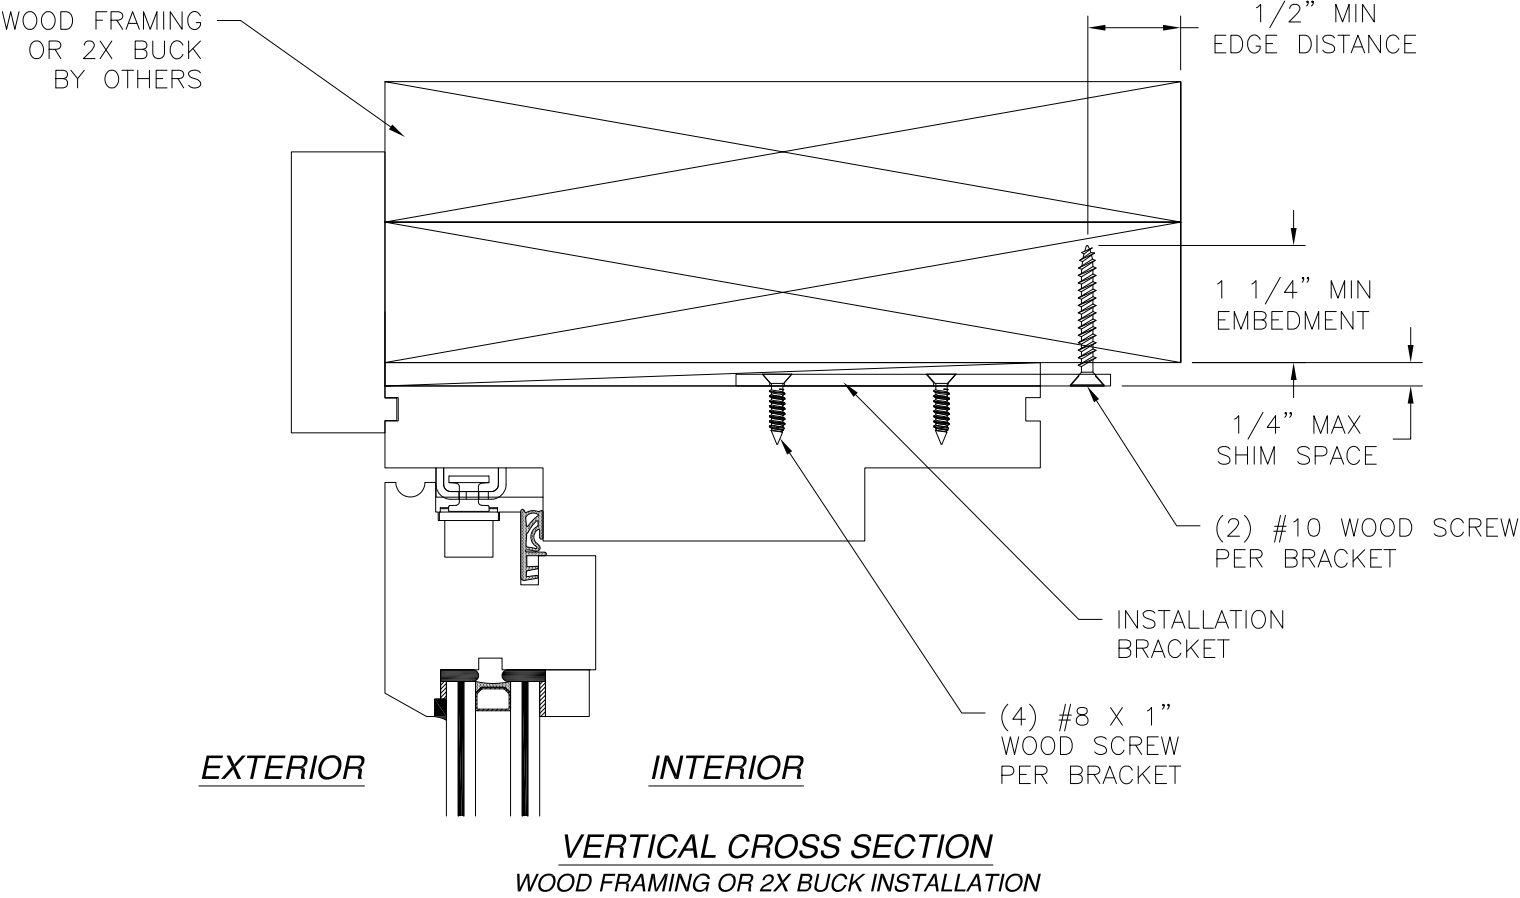

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 02/11/2026

REILLY WINDOW & DOORS
901 BURMAN BLVD., BLDG 701
CALVERTON, NY 11933

RWD WOOD OUTSWING
FRENCH CASEMENT, IMPACT
INSTALLATION DETAILS W/CLIP

DRAWN:
R.L.

DWG NO.
08-03983A


REV
A

SCALE
NTS


DATE
11/14/23

SHEET
11 OF 15


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

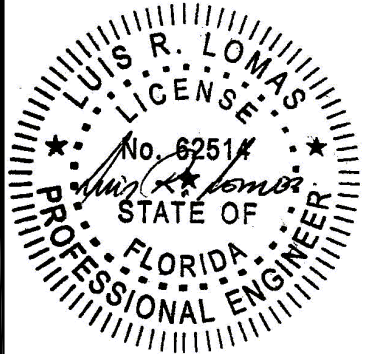


Luis R. Lomas P.E.
FL No.: 62514

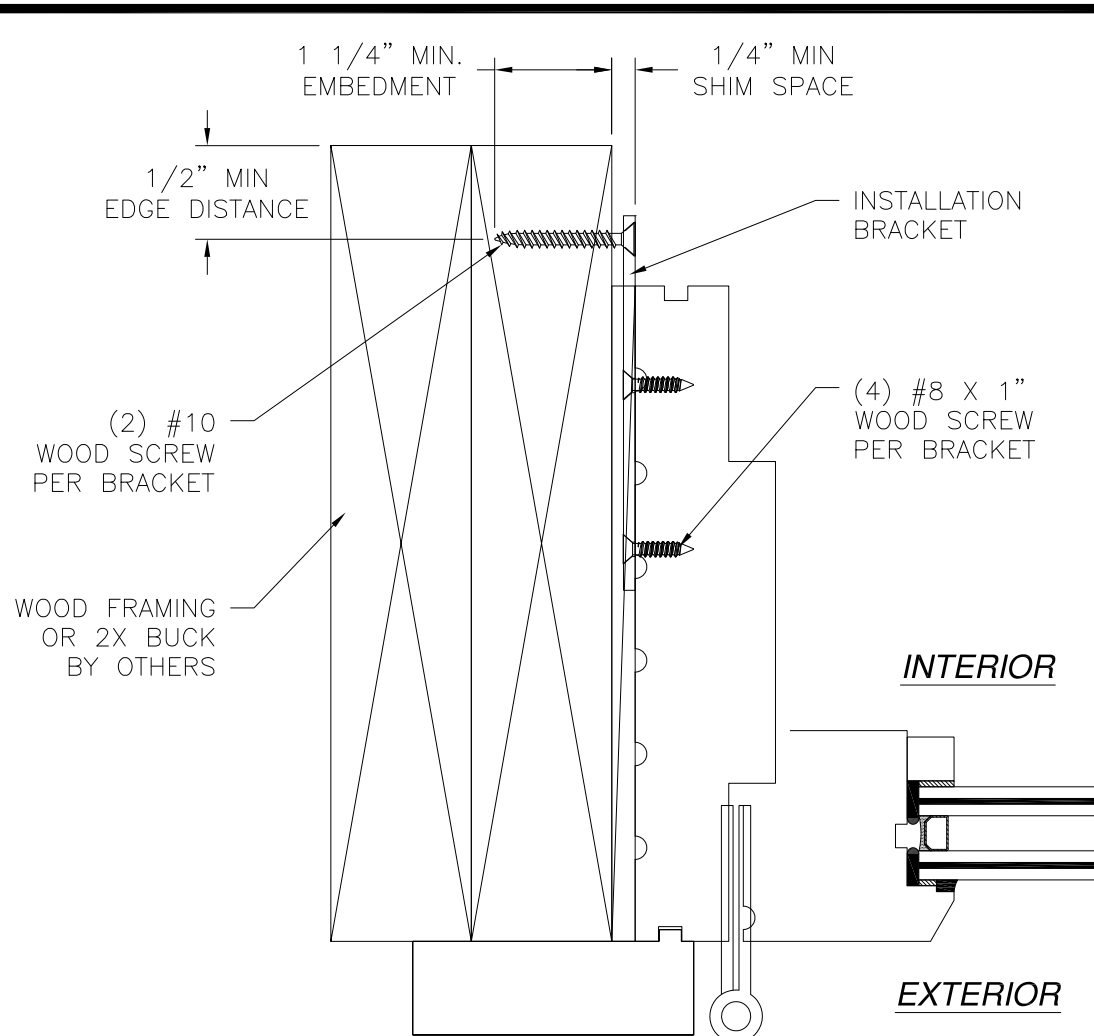

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

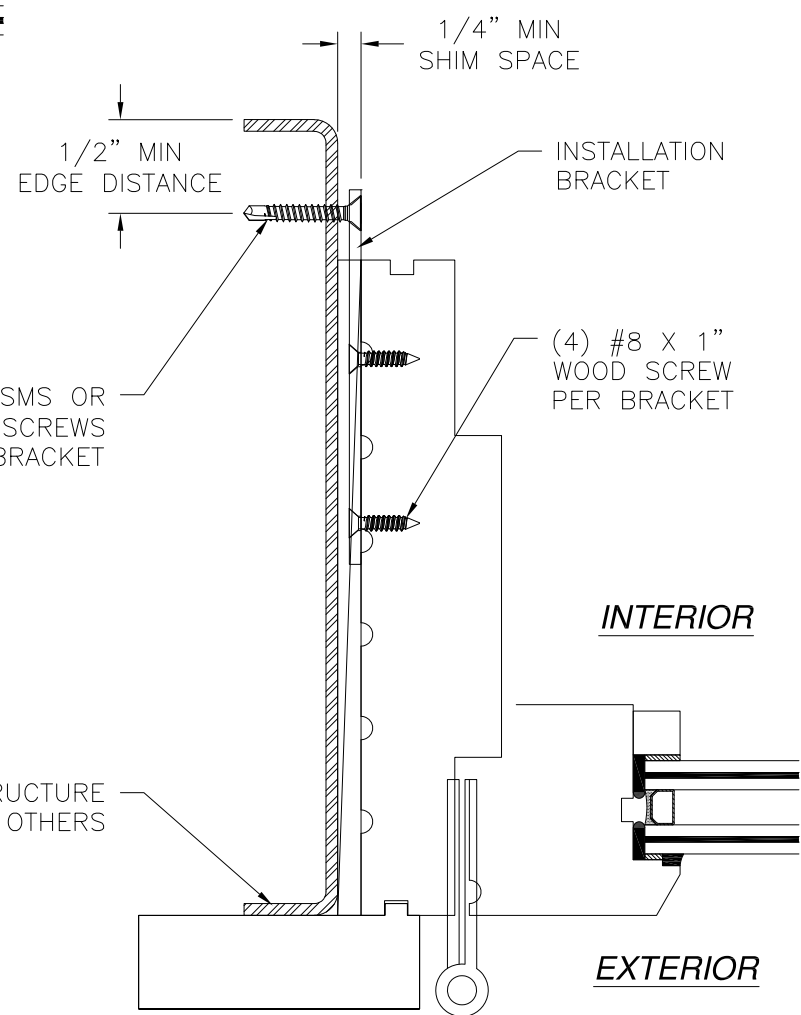

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

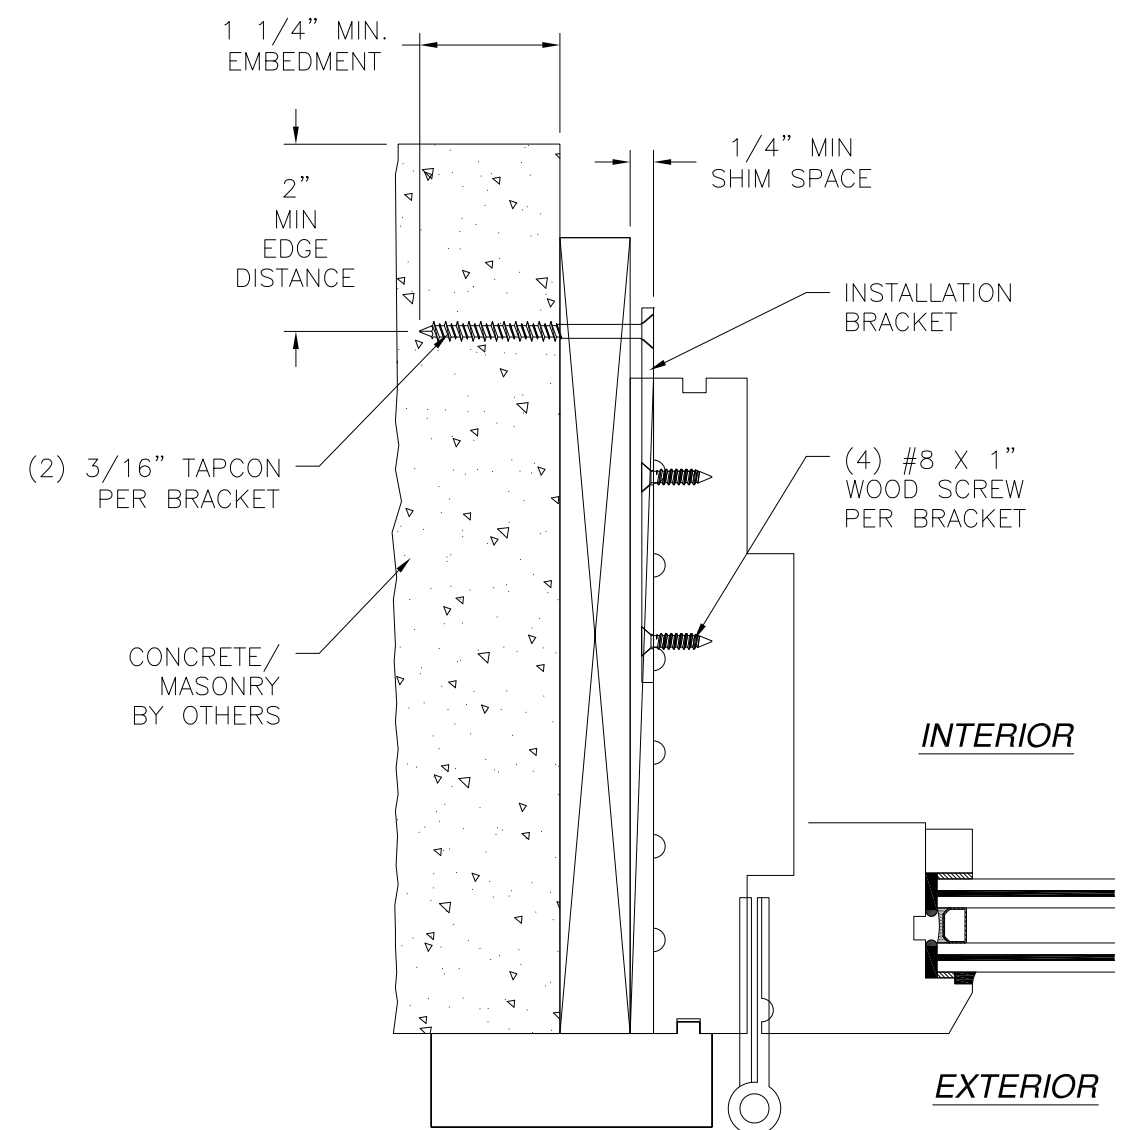

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REILLY WINDOW & DOORS
901 BURMAN BLVD., BLDG 701
CALVERTON, NY 11933

RWD WOOD OUTSWING
FRENCH CASEMENT, IMPACT
INSTALLATION DETAILS W/CLIP

DRAWN:
R.L.

DWG NO.
08-03983A

REV
A

SCALE
NTS

DATE
11/14/23


SHEET
12 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com


SIGNED: 02/11/2026

Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

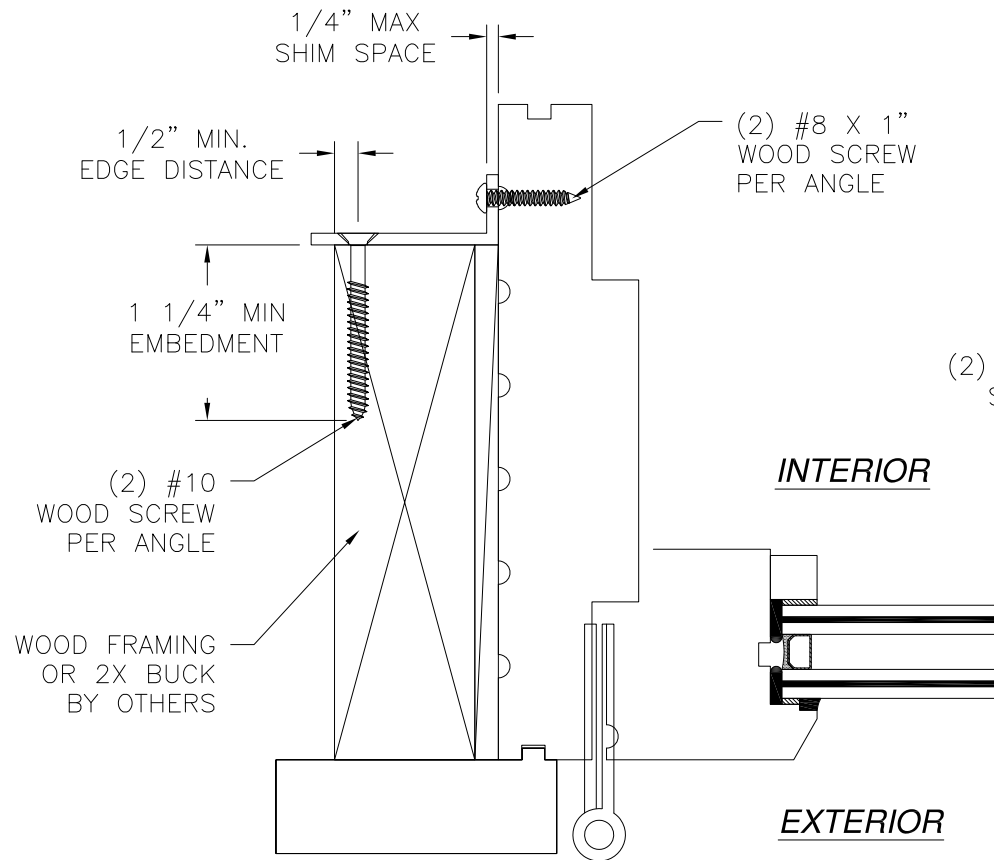


JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

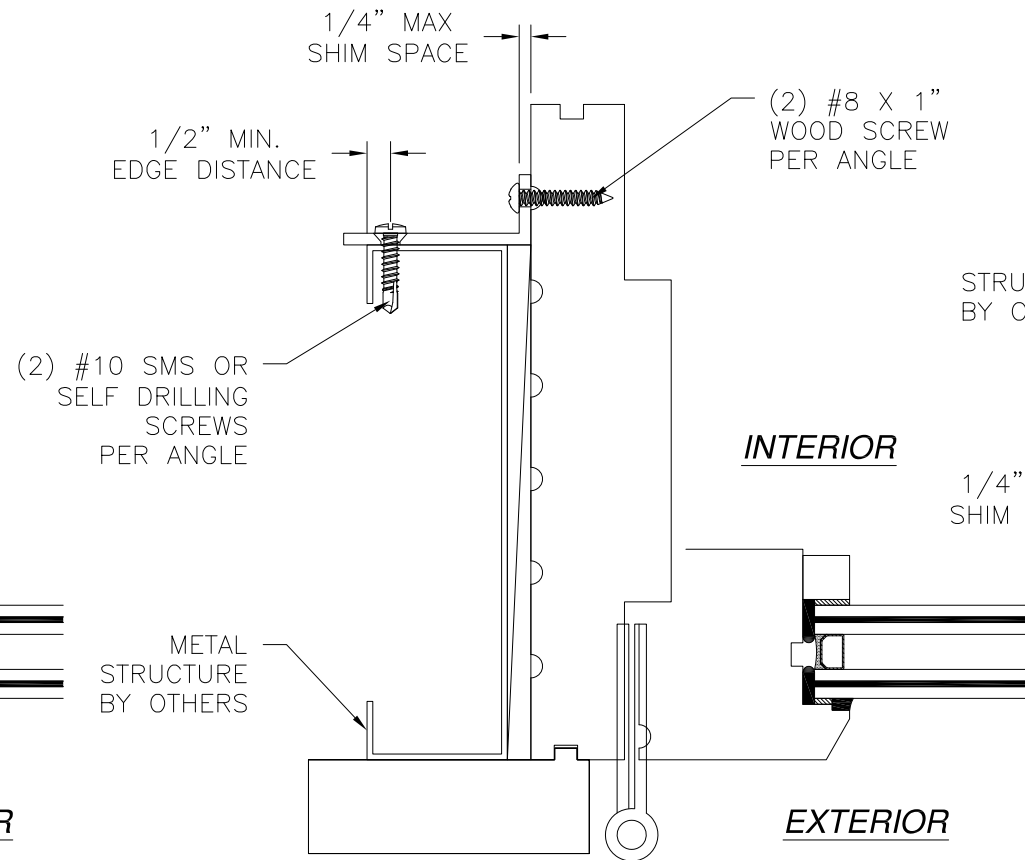

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

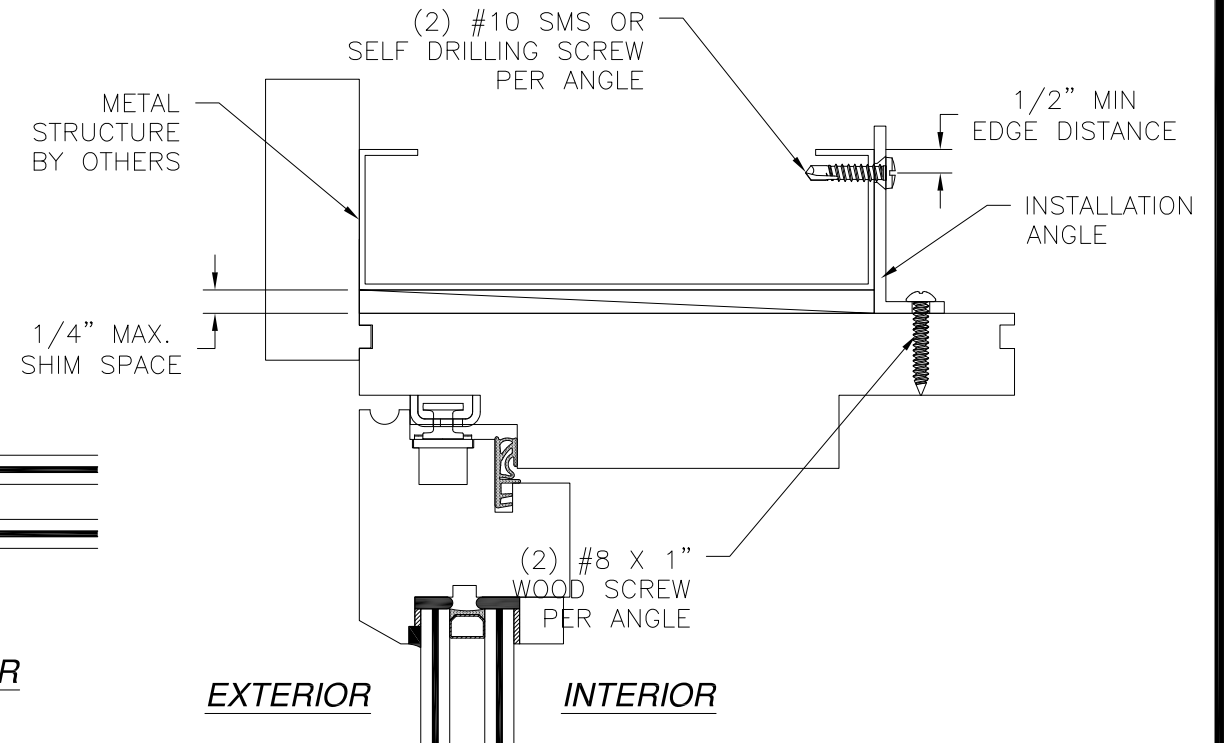

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

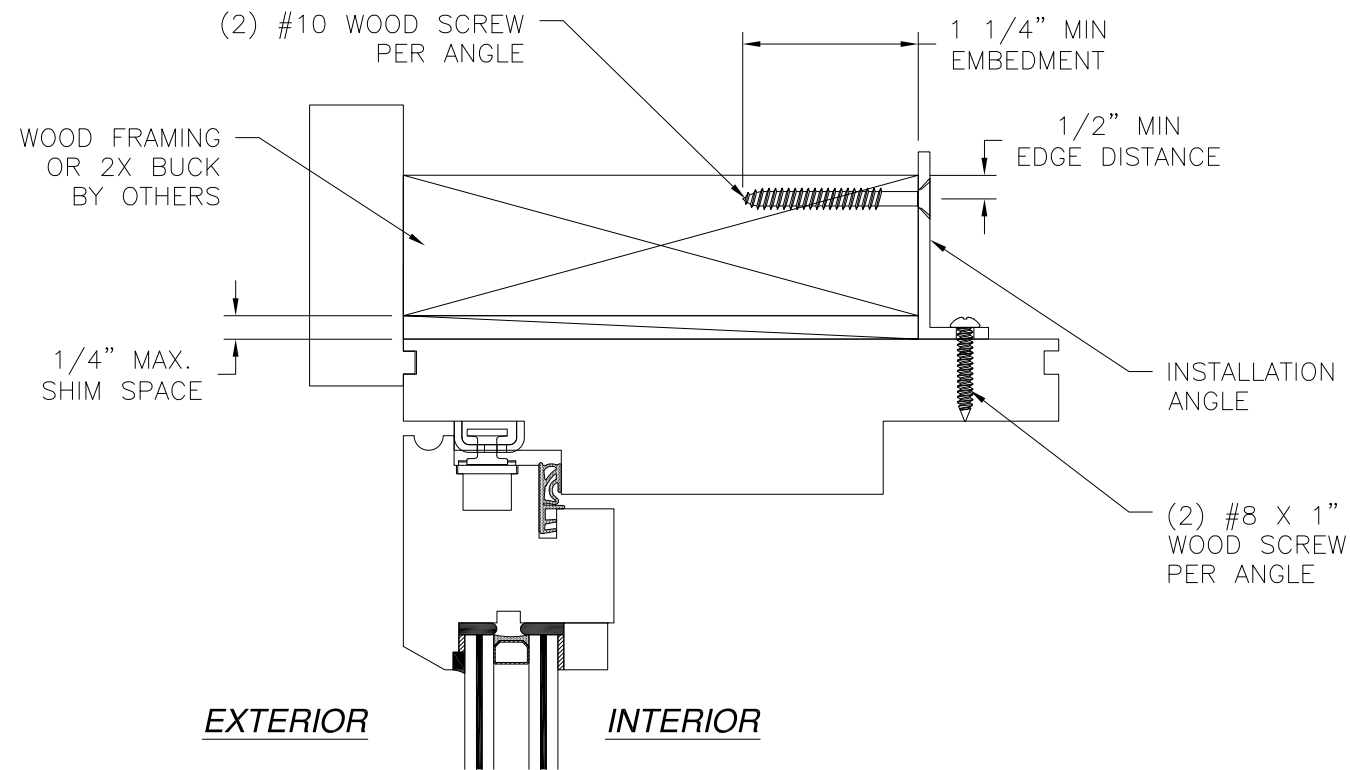


VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 02/11/2026

REILLY WINDOW & DOORS 901 BURMAN BLVD., BLDG 701 CALVERTON, NY 11933		
RWD WOOD OUTSWING FRENCH CASEMENT, IMPACT INSTALLATION DETAILS W/ANGLE		
DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 13 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

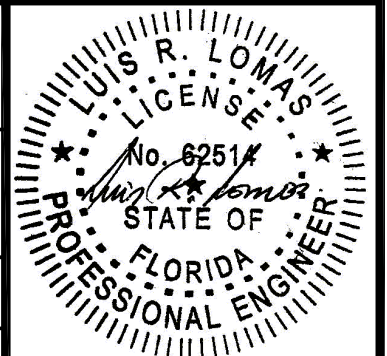


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

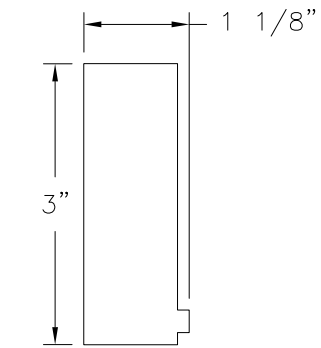


① **CASING**
MAHOGANY WOOD

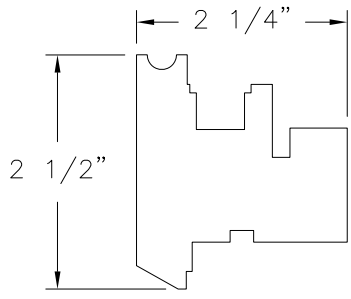


② **FRAME**
MAHOGANY WOOD




③ **NOSING**
MAHOGANY WOOD

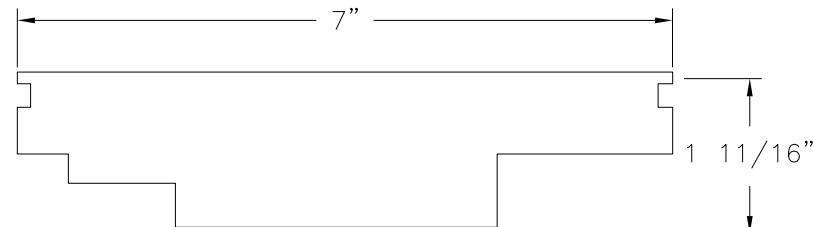


④ **HEAD**
MAHOGANY WOOD




⑤ **WEATHERSTRIP**
EPDM .75" DUROMETER




⑥ **GLASS STOP**
MAHOGANY WOOD

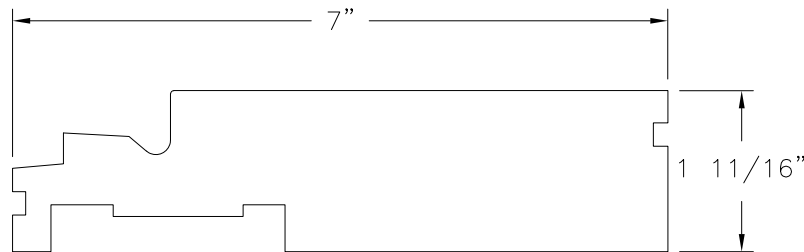


⑦ **SILL**
MAHOGANY WOOD

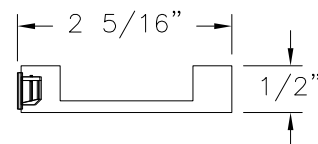


⑧ **EXTRUSION**
ALUMINUM 6063-T5 .125" THICK

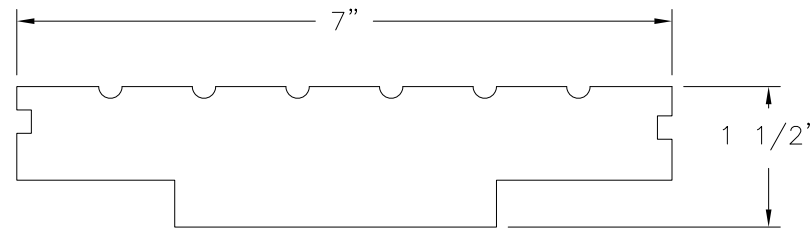


⑪ **JAMB**
MAHOGANY WOOD

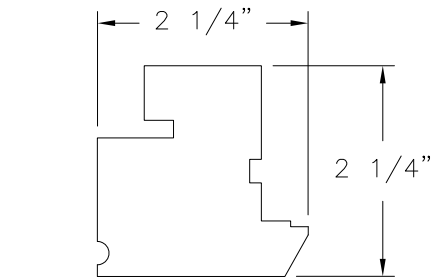


⑫ **STILE (JAMB)**
MAHOGANY WOOD

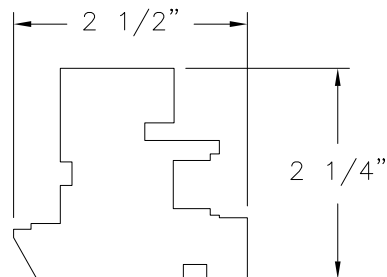


⑬ **MEETING STILE**
MAHOGANY WOOD




⑭ **WEATHER SEAL**
EPDM .75" DUROMETER

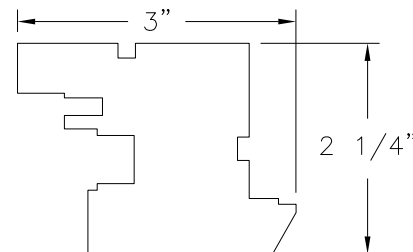


⑮ **STILE (ASTRAGAL)**
MAHOGANY WOOD

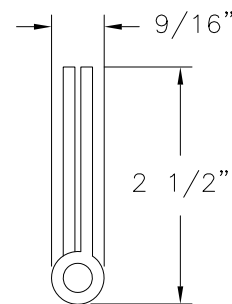


⑯ **BUTT HINGE**
BRASS

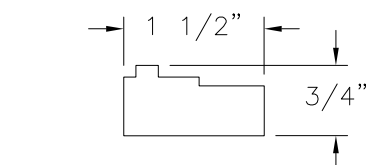

⑱ **EXTERIOR ASTRAGAL**
MAHOGANY WOOD

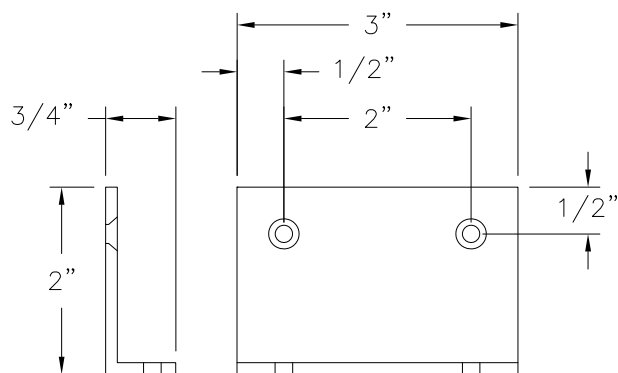


INSTALLATION ANGLE
ALUMINUM 6063-T5 .125 " THICK

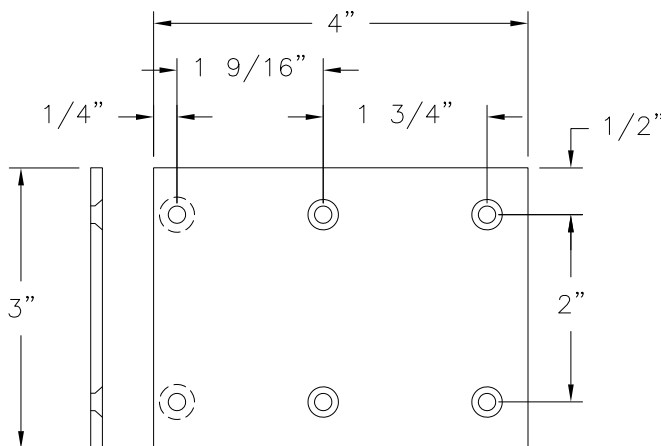

INSTALLATION BRACKET
ALUMINUM 6063-T5 .125 " THICK


REILLY WINDOW & DOORS 901 BURMAN BLVD., BLDG 701 CALVERTON, NY 11933		
RWD WOOD OUTSWING FRENCH CASEMENT, IMPACT COMPONENTS		
DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 14 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 02/11/2026

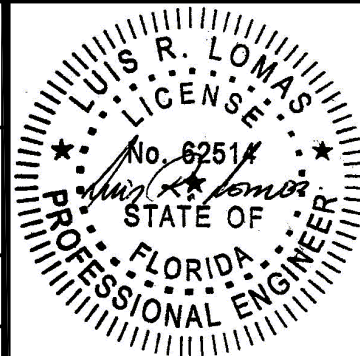


Luis R. Lomas P.E.
FL No.: 62514

HARDWARE BILL OF MATERIALS			
ITEM NO.:	PART NUMBER	DESCRIPTION	MANUFACTURER
77.1	895566	GEAR	SIEGENIA
77.2	FEUL0110-200011	CORNER DRIVE	SIEGENIA
77.3	896631	LINKAGE S/Z	SIEGENIA
77.4	896624	LINKAGE S/Z	SIEGENIA
78.1	895566	GEAR	SIEGENIA
78.2	FEUL0150-200010	CORNER DRIVE	SIEGENIA
78.3	FMEU0020-200010	CORNER DRIVE	SIEGENIA
78.4	896631S	LINKAGE S/Z	SIEGENIA
78.5	896624	LINKAGE S/Z	SIEGENIA
78.6	896624	LINKAGE S/Z	SIEGENIA
79	870938	FRICTION STAY	SIEGENIA
79	878255	MOUNT PLATE	SIEGENIA
79	817131	RUBBER STOP	SIEGENIA


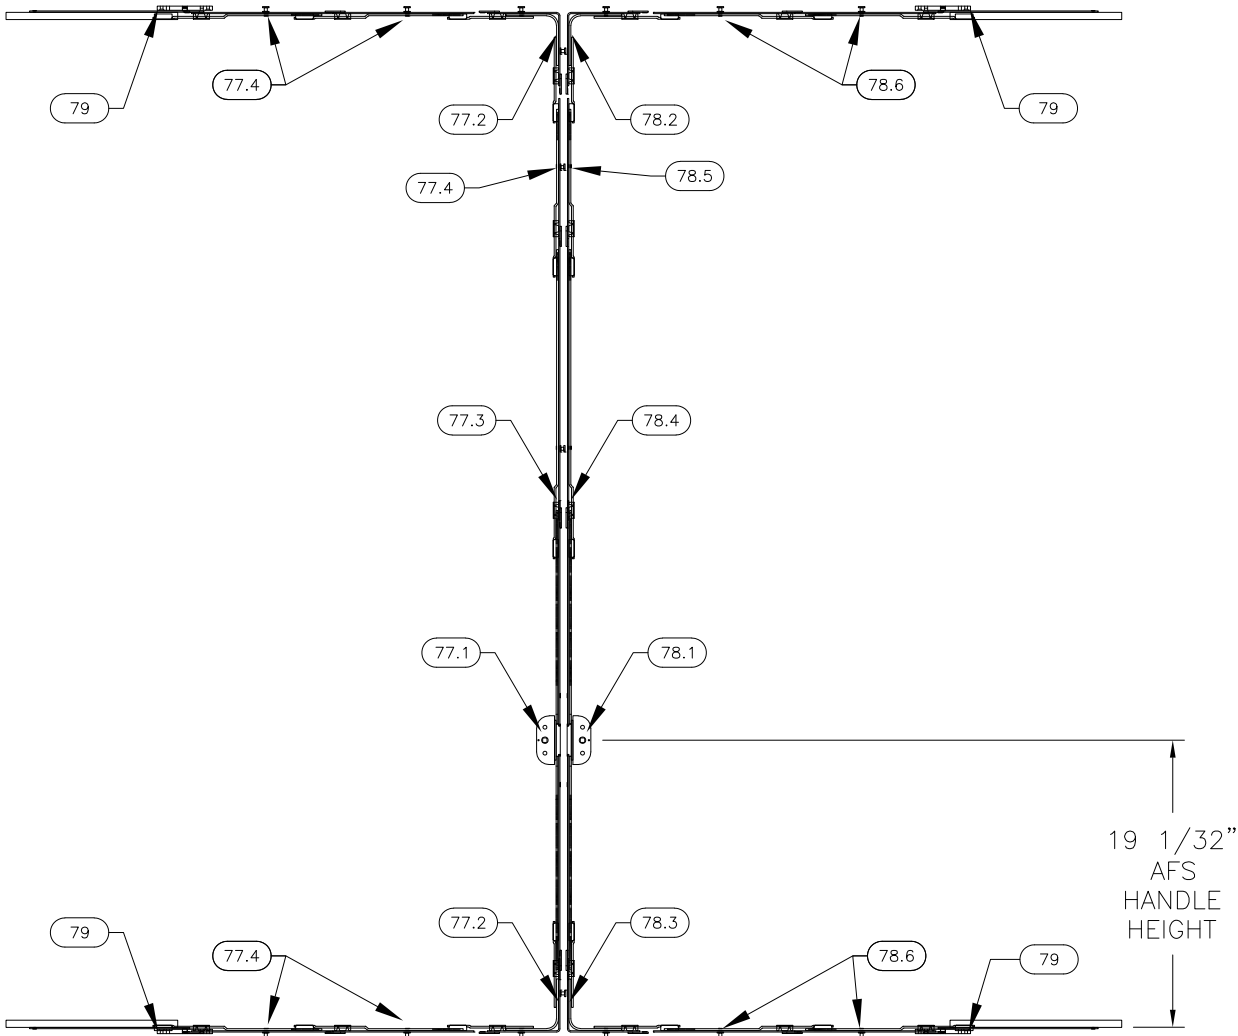


DOUBLE CASEMENT
HARDWARE LAYOUT

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	ADDED RATINGS FOR GLASS B	01/22/26	R.L.

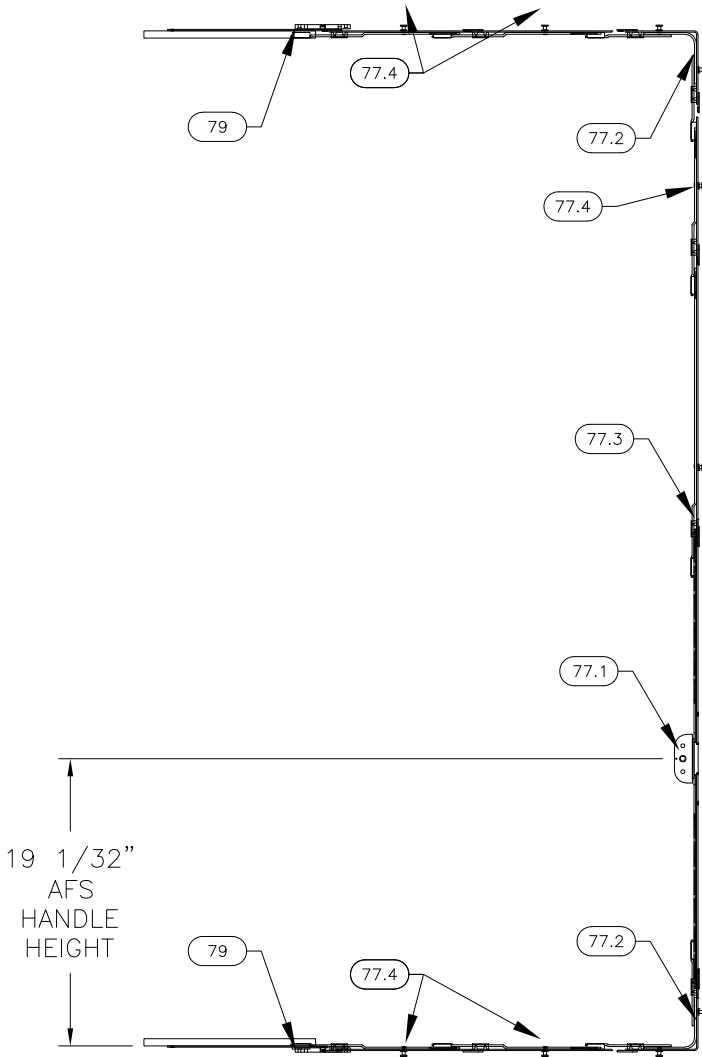

SINGLE CASEMENT
HARDWARE LAYOUT

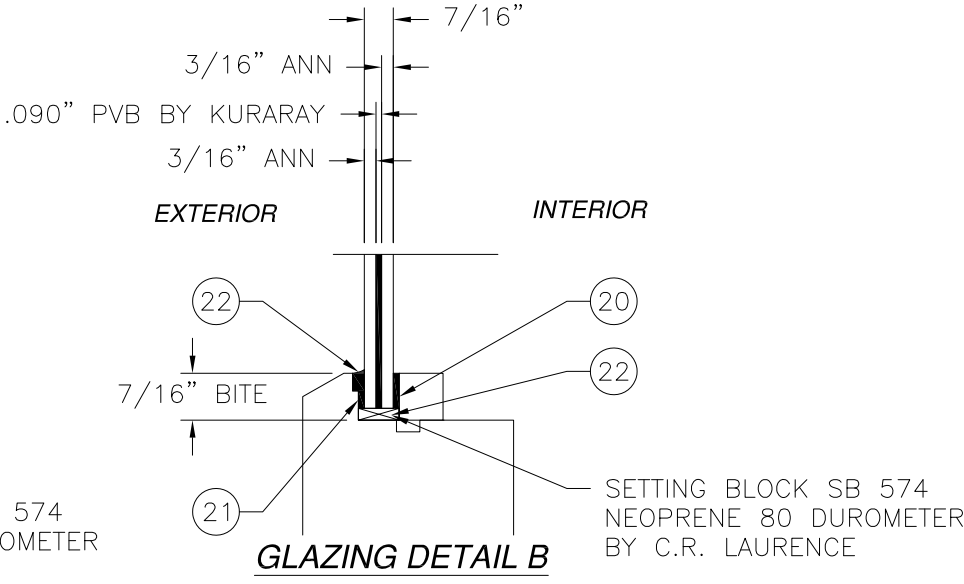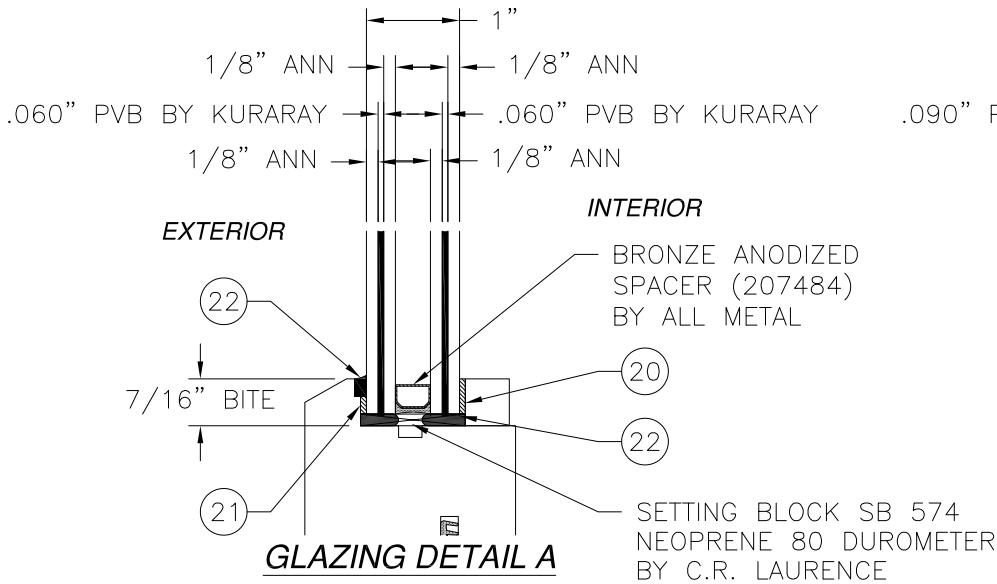


REILLY WINDOW & DOORS
901 BURMAN BLVD., BLDG 701
CALVERTON, NY 11933

RWD WOOD OUTSWING
FRENCH CASEMENT, IMPACT
HARDWARE & GLASS DETAILS

DRAWN: R.L.	DWG NO. 08-03983A	REV A
SCALE NTS	DATE 11/14/23	SHEET 15 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 02/11/2026

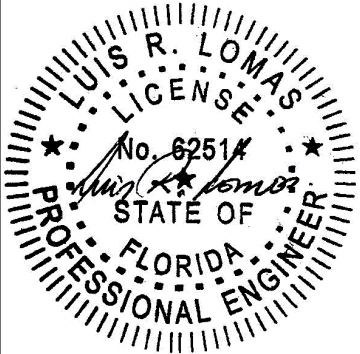

Luis R. Lomas P.E.
FL No.: 62514