CONTINENTAL GLASS SYSTEMS

SERIES 2800 LIFT AND SLIDE GLASS DOOR (SMI)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
   - TAS 201-94
   - TAS 202-94
   - TAS 203-94

2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, STEEL, AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.

3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.

4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS. IN HVHZ AREAS, ONE TIME PRODUCT APPROVAL TO BE OBTAINED FROM MIAMI-DADE RER.

5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING SMALL IMPACT RESISTANCE.


6. DOOR FRAME MATERIAL: ALUMINUM 6063-T6

7. DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM UNIT FRAMING SHALL BE PROTECTED AS DEFINED IN THE CURRENT FBC.

8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-16 GLASS CHARTS. SEE SHEET 2 FOR GLAZING DETAIL.

9. APPROVED STRUCTURAL SILICONE:
   A) 795 DOW CORNING
   B) 983 DOW CORNING

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	ELEVATION
3	ALLOWABLE CONFIGURATIONS
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	HORIZONTAL SECTIONS
7	ANCHOR LOCATIONS
8	SUBSTRATES
9	SUBSTRATES
10	COMPONENTS AND BILL OF MATERIALS
11	COMPONENTS, BILL OF MATERIALS AND CORNER ASSEMBLIES

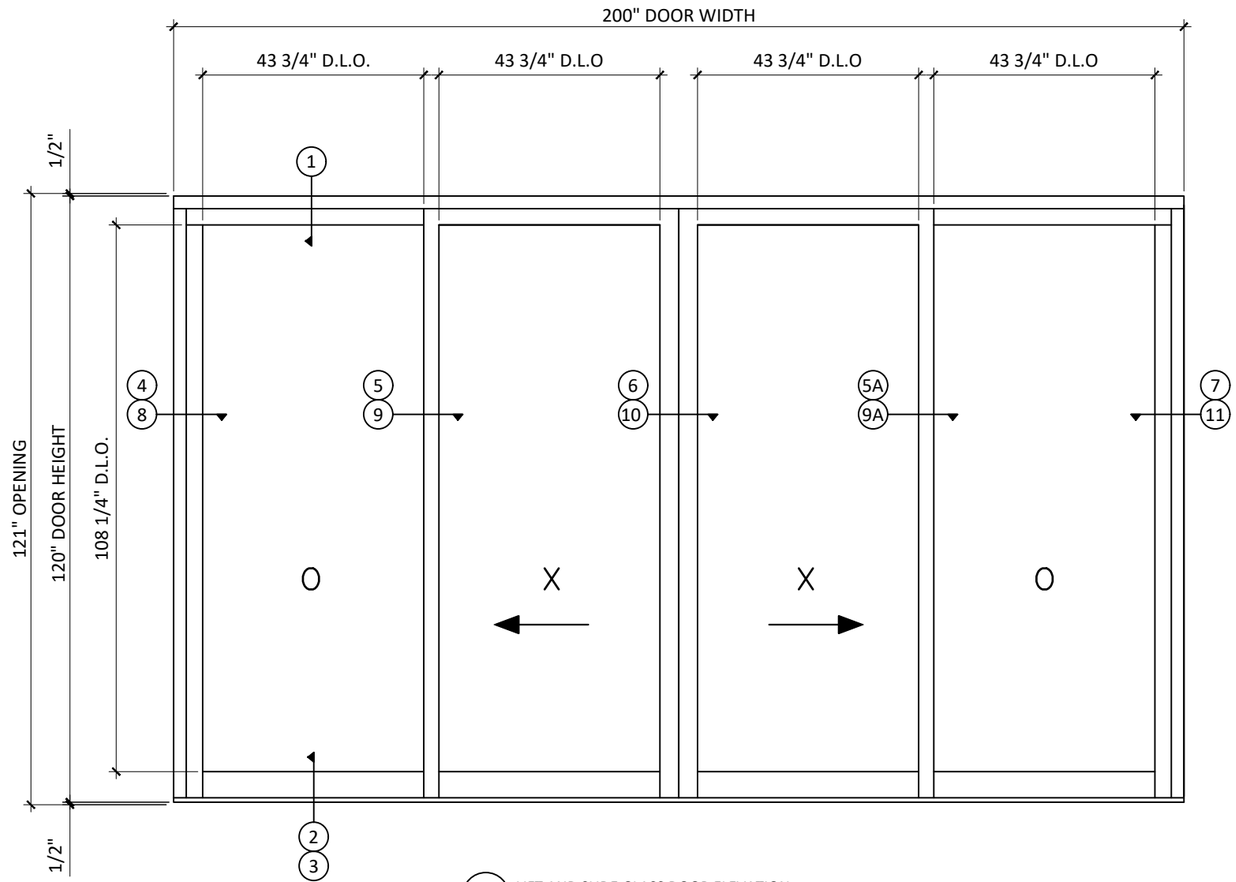

1 LIFT AND SLIDE GLASS DOOR ELEVATION
EXTERIOR VIEW

DESIGN PRESSURE RATING				
PANEL SIZE	REINFORCEMENT	DESIGN PRESSURE	GLAZING OPTIONS	MISSILE IMPACT RATING
50 5/16" x 120"	ALUMINUM	+120/-150.0 PSF	G1 OR G2	SMALL MISSILE IMPACT * FOR INSTALLATIONS 30FT ABOVE GRADE OR ABOVE ONLY
	NONE	+/-120.0 PSF		
50" x 132"	ALUMINUM	+/-150.0 PSF	G1	

Manufacturer:

CGS
CONTINENTAL GLASS SYSTEMS LLC.
325 West 74 Place Hialeah, Fl 33014
Phone 305.231.1101
Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS
REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

Soumel Loriga

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:
FL# 17175

SERIES:
2800 SERIES
S.M.I.


Description:
SGD SYSTEM

Drawn Date: 10-10-2020
Scale: AS NOTED


Project No.
FLORIDA APPROVAL 2020

Drawing Title
COVER


Sheet No.
SHEET: 1 OF: 11

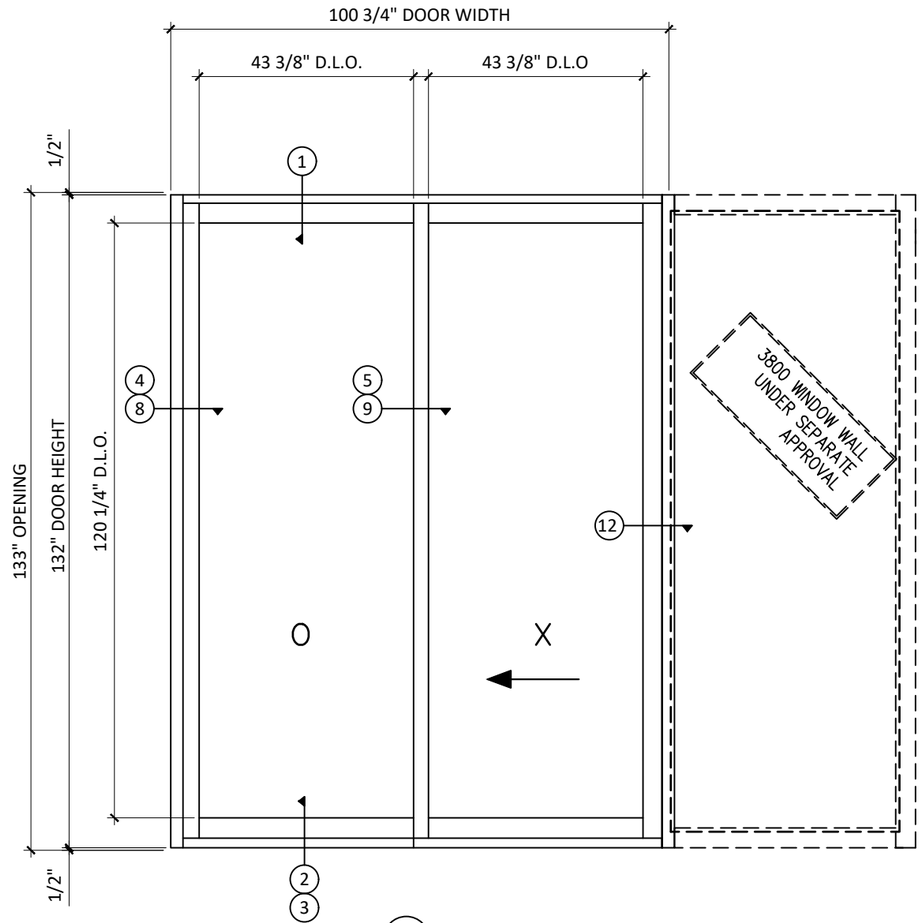

2 LIFT AND SLIDE GLASS DOOR ELEVATION
EXTERIOR VIEW

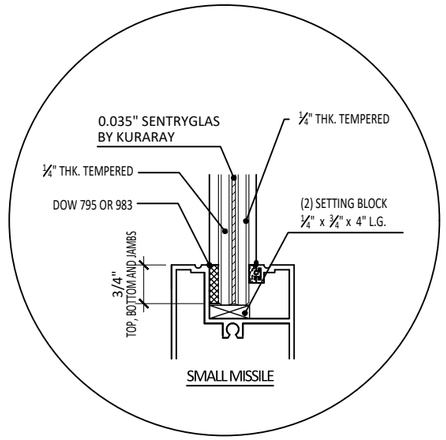

GLAZING DETAIL - G1

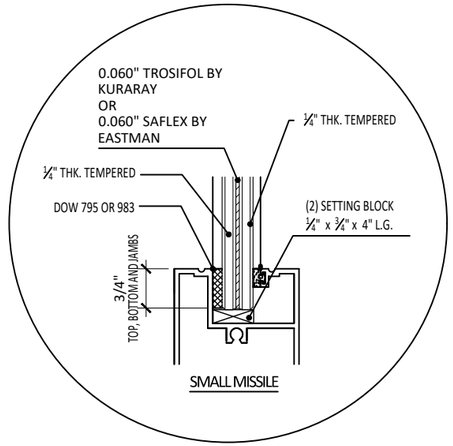

GLAZING DETAIL - G2

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.
325 West 74 Place Hialeah, Fl 33014
Phone 305.231.1101
Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 17175

SERIES:

2800 SERIES
S.M.I.

Description:


SGD SYSTEM

Drawn Date	Scale
10-10-2020	AS NOTED


Project No.
FLORIDA APPROVAL 2020

Drawing Title
ELEVATIONS


Sheet No.
SHEET: 2 OF:11

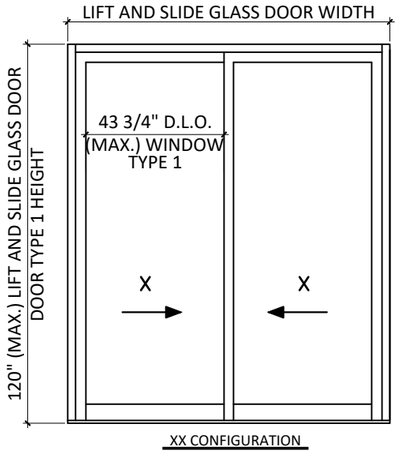


XX CONFIGURATION

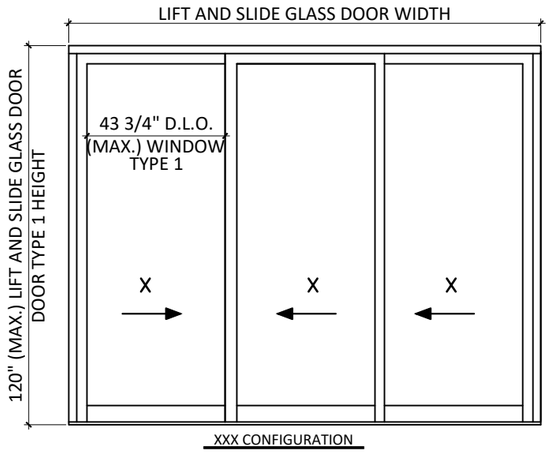


XXX CONFIGURATION

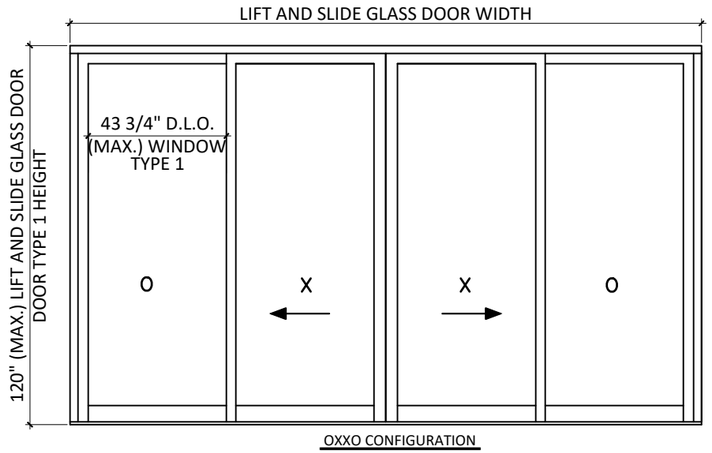


OXXO CONFIGURATION

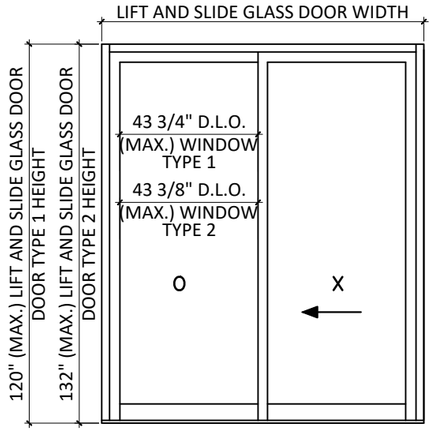


OX CONFIGURATION
(XO CONFIGURATION SIM.)

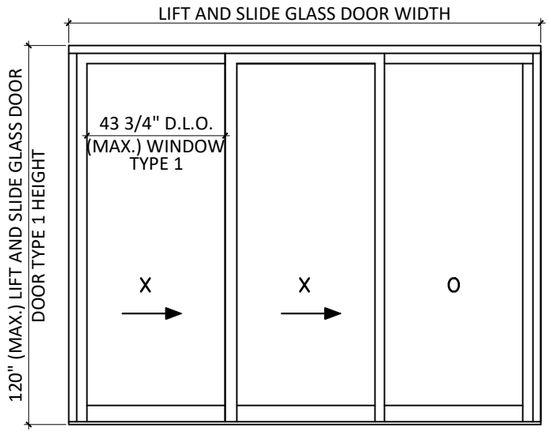


XXO CONFIGURATION
(OXX CONFIGURATION SIM.)

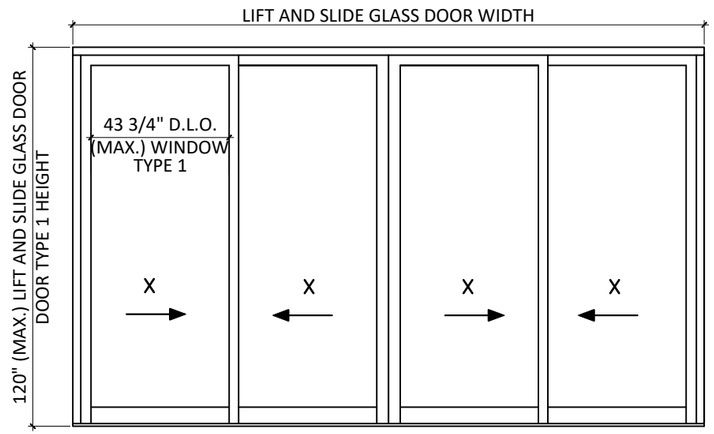

XXXX CONFIGURATION

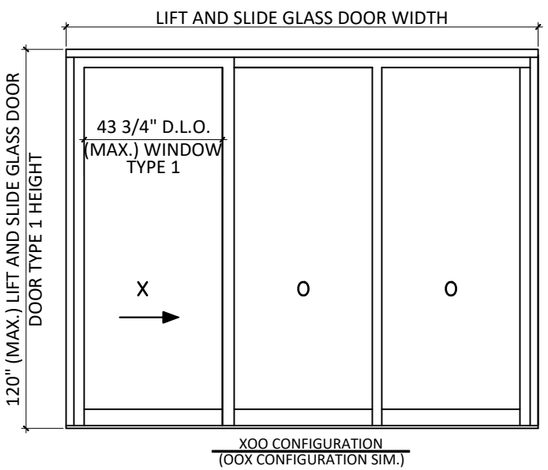

XOO CONFIGURATION
(OOX CONFIGURATION SIM.)

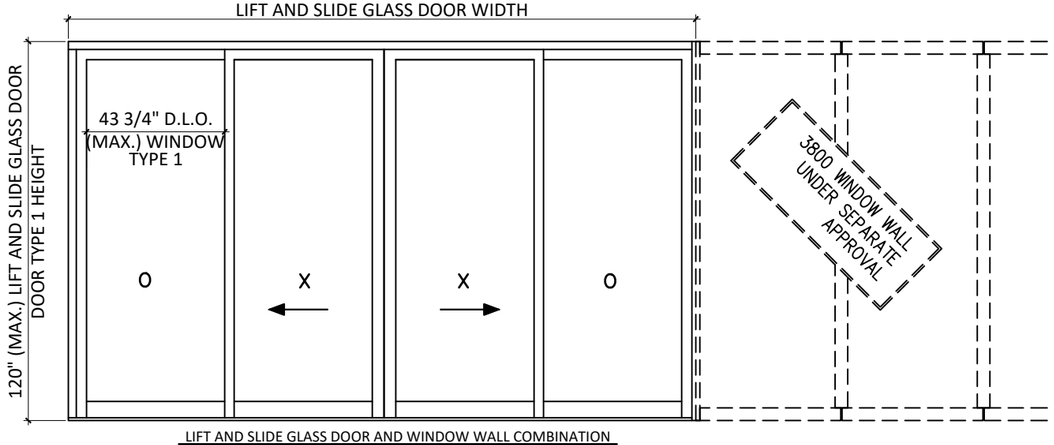

LIFT AND SLIDE GLASS DOOR AND WINDOW WALL COMBINATION

ALLOWABLE CONFIGURATIONS

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.
325 West 74 Place Hialeah, Fl 33014
Phone 305.231.1101
Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga

Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 17175

SERIES:

2800 SERIES
S.M.I.

Description:


SGD SYSTEM

Drawn Date	Scale
10-10-2020	AS NOTED

Project No.
FLORIDA APPROVAL 2020


Drawing Title
ELEVATIONS

Sheet No.
SHEET: 3 OF:11

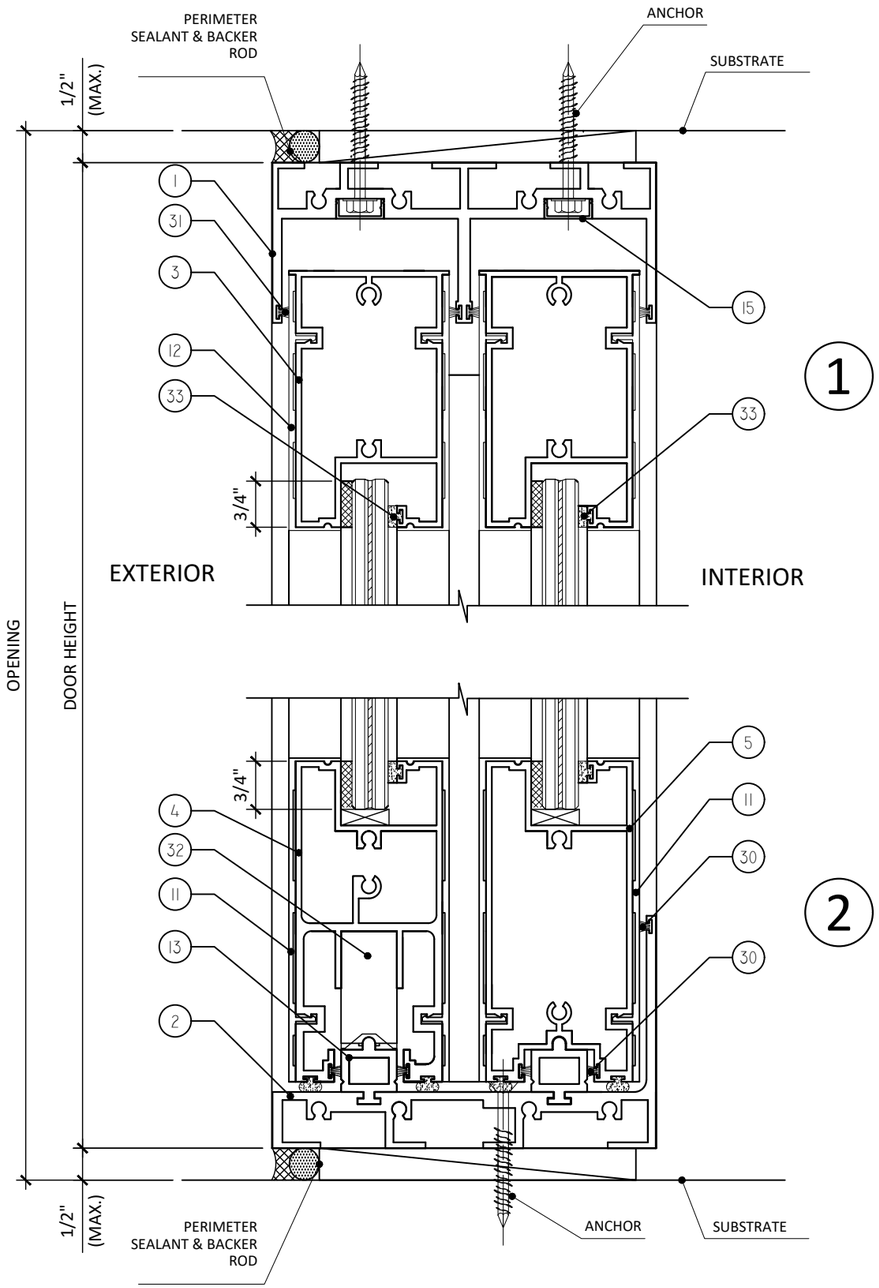

1

2

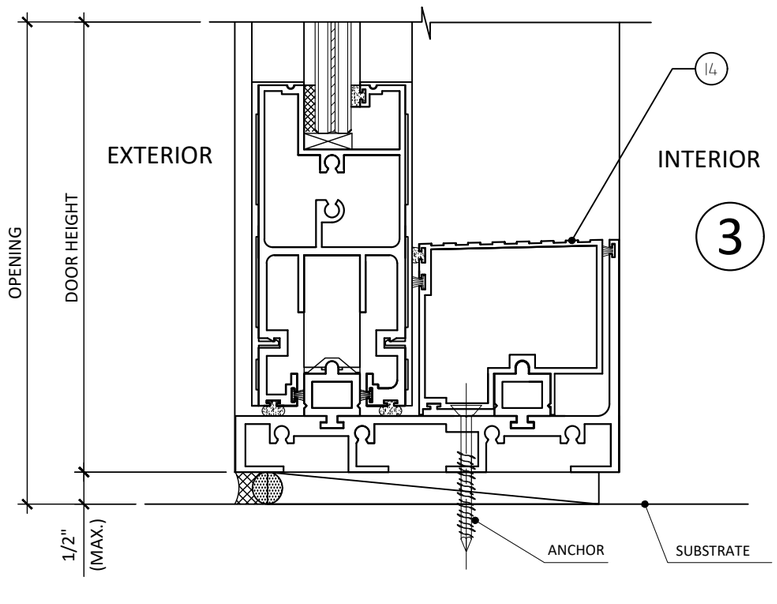

3

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.
325 West 74 Place Hialeah, Fl 33014
Phone 305.231.1101
Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga

Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 17175

SERIES:

2800 SERIES
S.M.I.

Description:


SGD SYSTEM

Drawn Date	Scale
10-10-2020	AS NOTED

Project No.
FLORIDA APPROVAL 2020


Drawing Title
DETAILS

Sheet No.
SHEET: 4 OF: 11

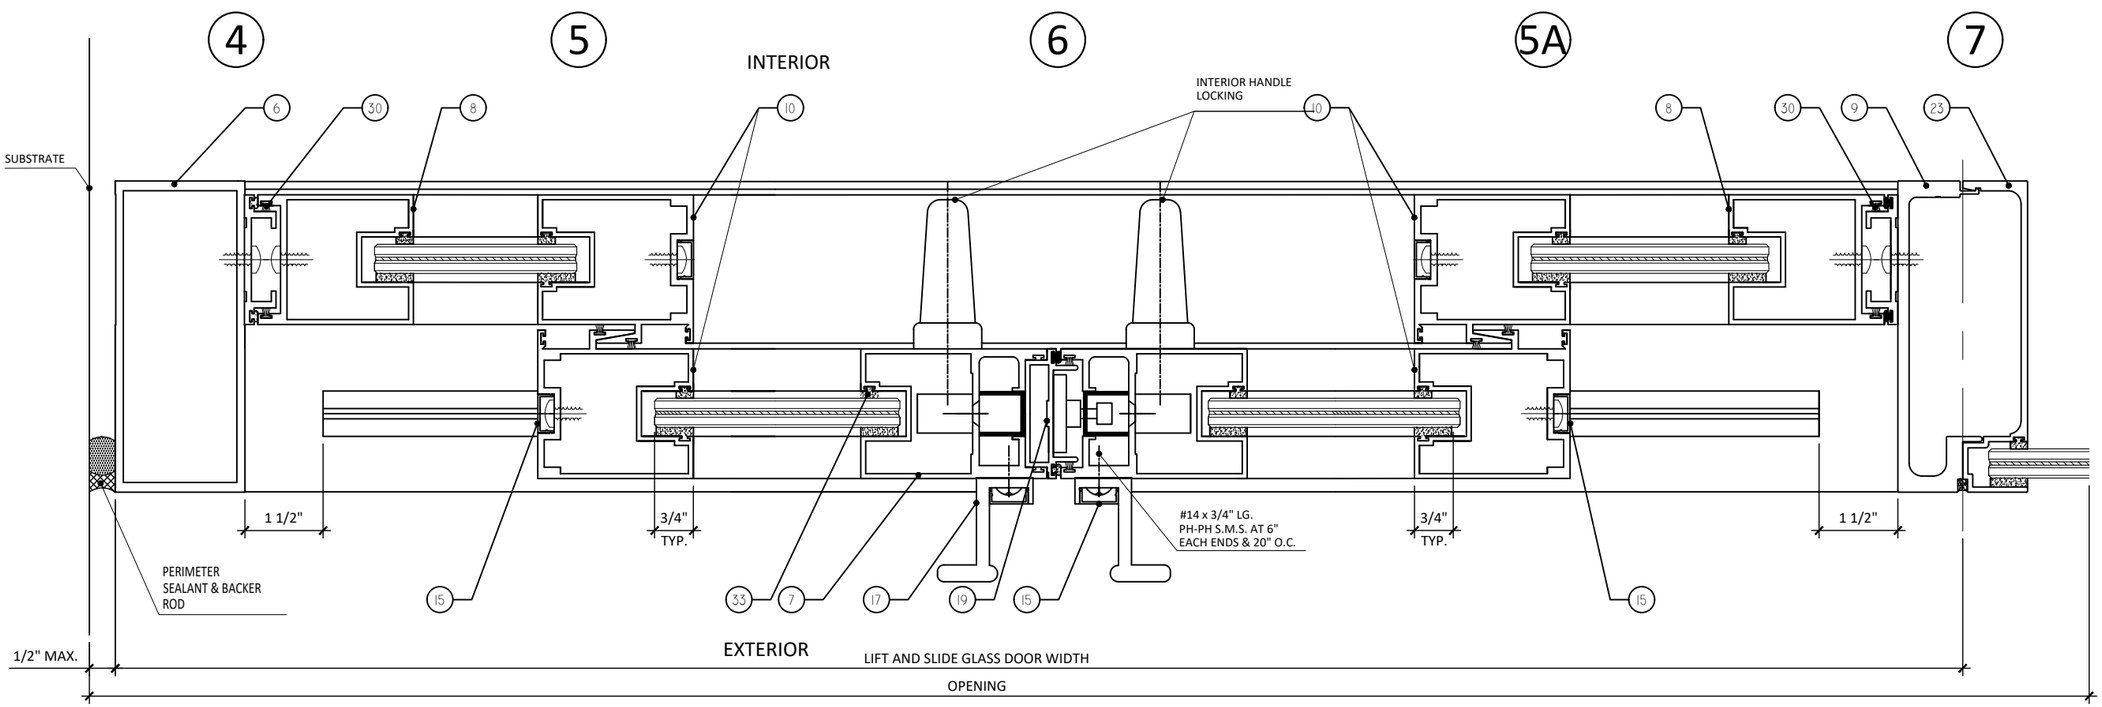

NOTES:
1- BACKER ROD DIAMETER EQUALS SEAL WIDTH x 120%
2- SEALANT DEPTH IS:
1/2" FOR WIDTHS UP TO 1" AND
5/8" FOR WIDTHS OVER 1".


Soumel Loriga

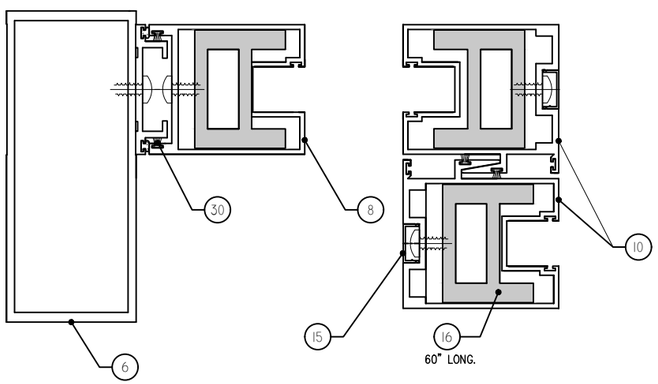

8

REINFORCED JAMB


UP TO 150 PSF

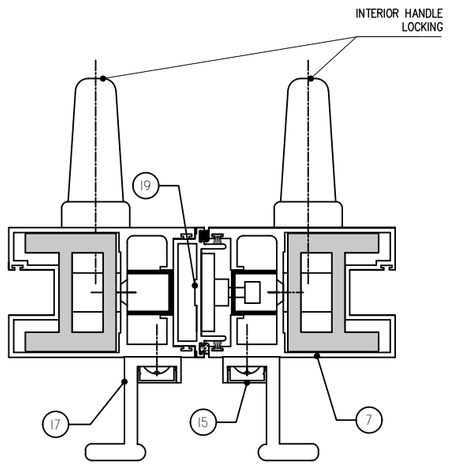

10

REINFORCED MEETING STILE


UP TO 150 PSF

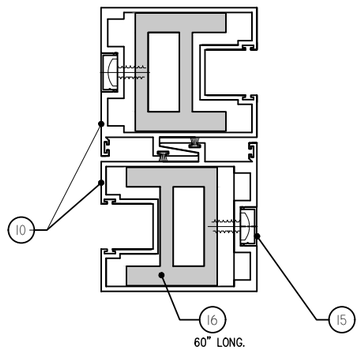

9A

REINFORCED INTERLOCK

UP TO 150 PSF

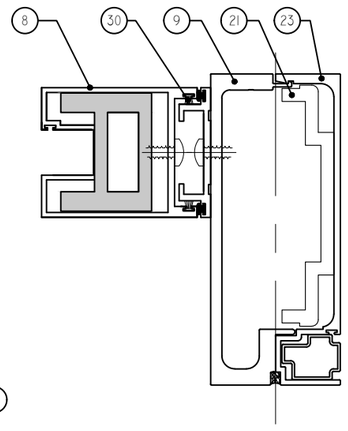

11

REINFORCED FIXED JAMB

UP TO 150 PSF

9

REINFORCED INTERLOCK

UP TO 150 PSF

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.
325 West 74 Place Hialeah, Fl 33014
Phone 305.231.1101
Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 17175

SERIES:

2800 SERIES S.M.I.

Description:


SGD SYSTEM

Drawn Date	Scale
10-10-2020	AS NOTED

Project No.
FLORIDA APPROVAL 2020

Drawing Title
DETAILS

Sheet No.
SHEET: 5 OF:11

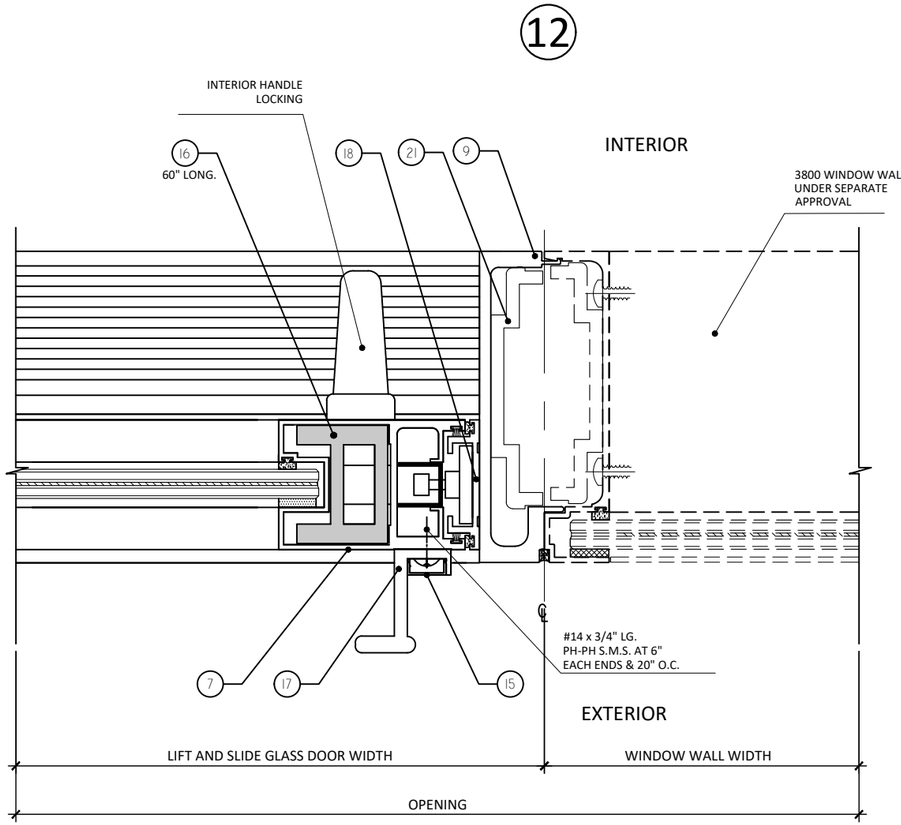

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.
325 West 74 Place Hialeah, Fl 33014
Phone 305.231.1101
Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga

Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 17175

SERIES:

2800 SERIES
S.M.I.

Description:


SGD SYSTEM

Drawn Date	Scale
10-10-2020	AS NOTED

Project No.
FLORIDA APPROVAL 2020

Drawing Title
DETAILS

Sheet No.
SHEET: 6 OF: 11

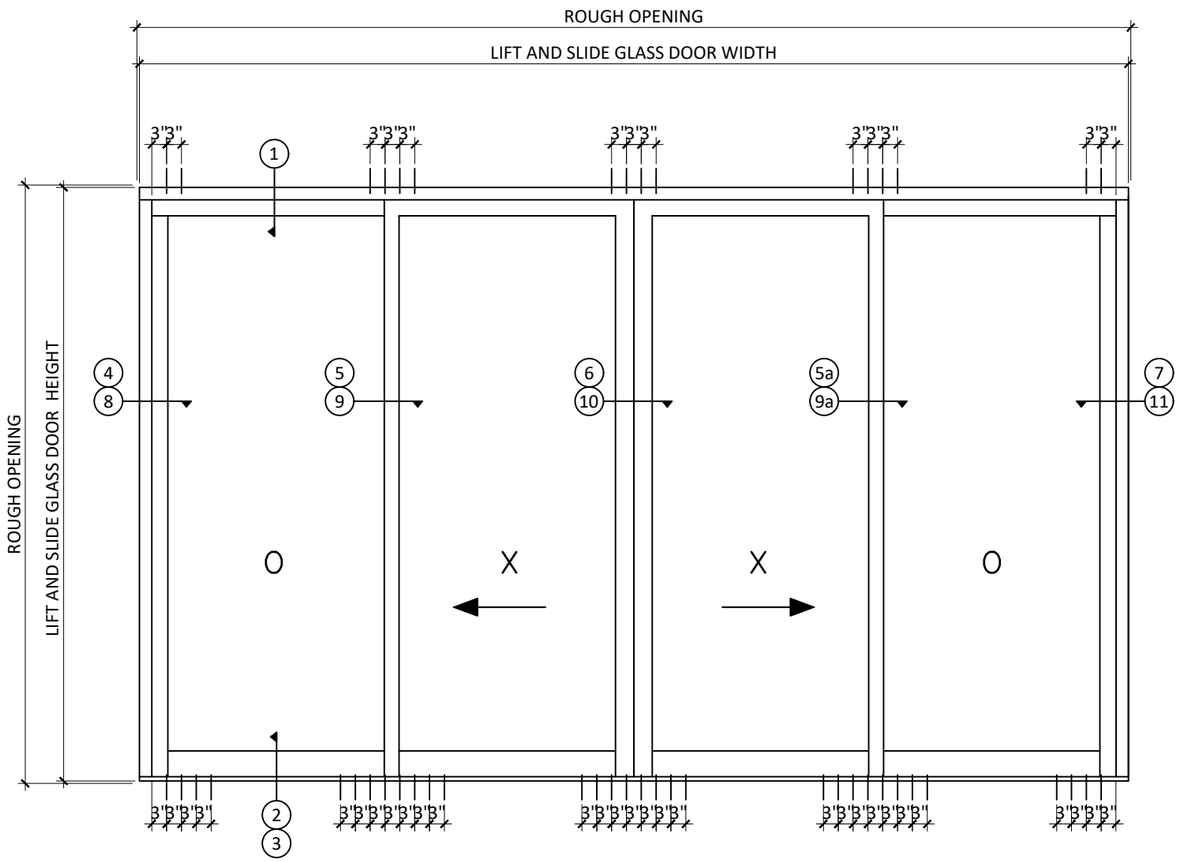

LIFT AND SLIDE GLASS DOOR ELEVATION
EXTERIOR VIEW

INSTALLATION NOTES:

1. TWO (2) INSTALLATION ANCHORS ON HEAD AND ONE (1) INSTALLATION ANCHOR ON SILL FOR EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR INSTALLATION DIRECTLY INTO CONCRETE/MASONRY, USE 5/16 INCH DIAMETER ELCO ULTRACON OR DEWALT ULTRACON WITH SUFFICIENT LENGTH TO ACHIEVE 1 3/4 INCH MINIMUM EMBEDMENT.
6. FOR INSTALLATION DIRECTLY INTO WOOD FRAME, USE #14 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT.
7. FOR INSTALLATION DIRECTLY INTO STEEL FRAME, USE 1/4" DIAMETER PT 5 GRADE 5 TEKS SELECT SCREWS OF SUFFICIENT LENGTH TO ACHIEVE *3 THREADS* MINIMUM PENETRATION BEYOND METAL FRAME SUBSTRATE.
8. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
9. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
10. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
11. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
12. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
    A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
    B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
    C. GROUT-FILLED CMU- UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.
    D. HOLLOW BLOCK CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.
    E. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 16 GA. (0.0598") MAX. 1/2" WALL THICKNESS.
    F. ALUMINUM - 6063-T6 MINIMUM YIELD STRENGTH OF 25 KSI. MINIMUM .25" WALL THICKNESS.

Manufacturer:
CGS
CONTINENTAL GLASS SYSTEMS LLC.
325 West 74 Place Hialeah, Fl 33014
Phone 305.231.1101
Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS
REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:
SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER
Soumel Loriga
Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:
FL# 17175

SERIES:
2800 SERIES
S.M.I.


Description:
SGD SYSTEM

Drawn Date: 10-10-2020
Scale: AS NOTED

Project No.
FLORIDA APPROVAL 2020


Drawing Title
ELEVATIONS

Sheet No.
SHEET: 7 OF:11

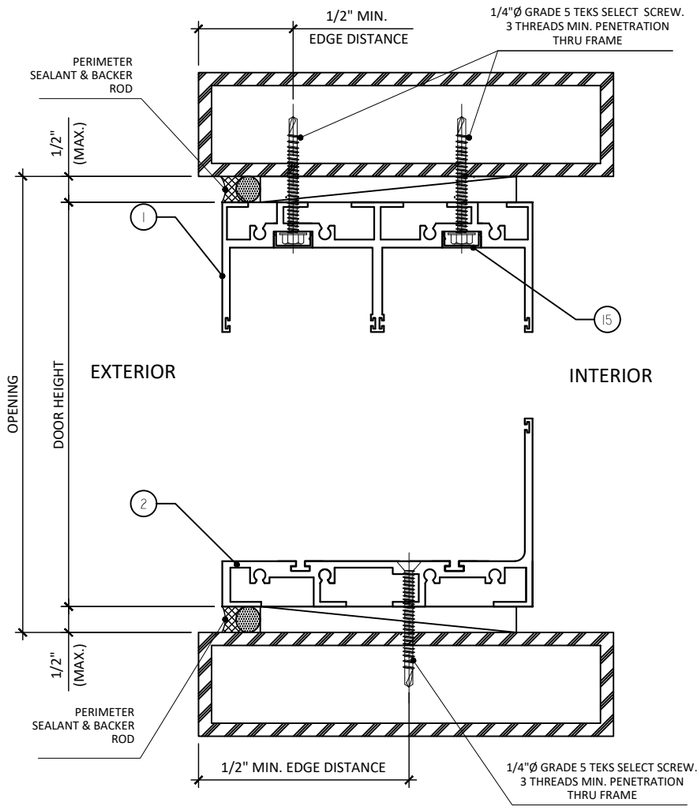

ALUMINUM TUBE

HEAD & SILL

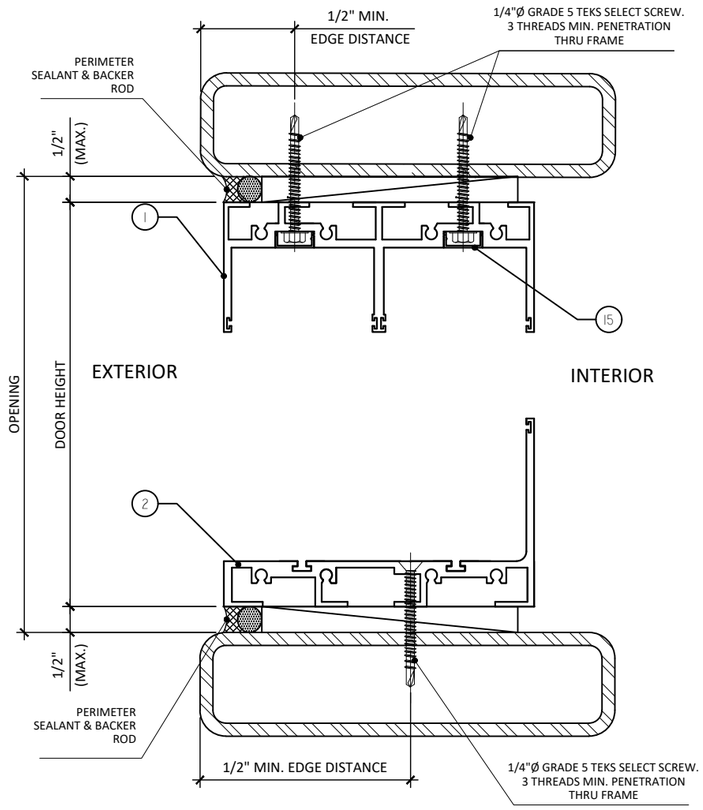

STEEL TUBE

HEAD & SILL

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.

325 West 74 Place Hialeah, Fl 33014

Phone 305.231.1101

Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga

Soumel Loriga, P.E.

PE Lic No.: 77736

Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 17175

SERIES:

2800 SERIES
S.M.I.

Description:

SGD SYSTEM

Drawn Date	Scale
10-10-2020	AS NOTED

Project No.


FLORIDA APPROVAL 2020

Drawing Title

DETAILS


Sheet No.

SHEET: 8 OF:11

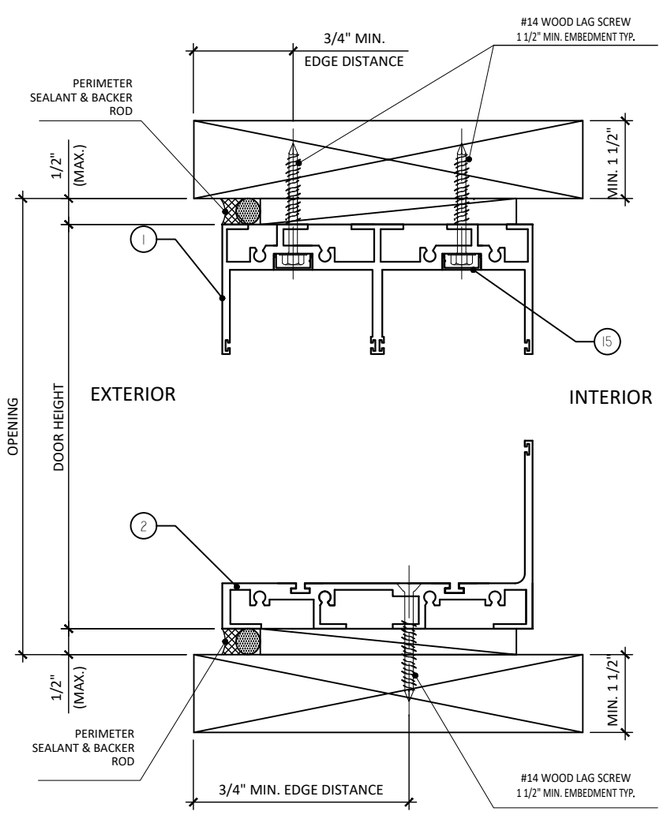

PT WOOD BUCK

HEAD & SILL

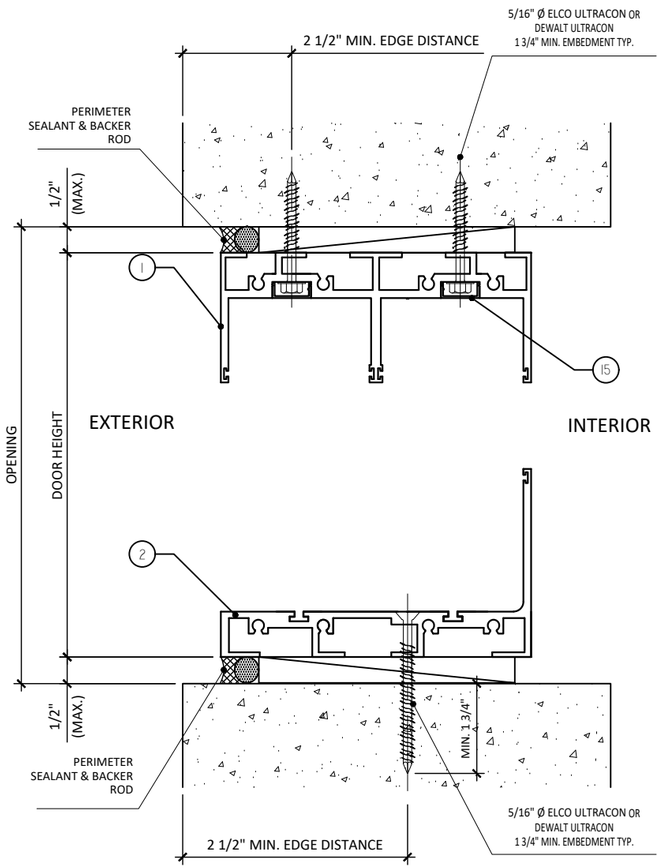

MASONRY

HEAD & SILL

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.
325 West 74 Place Hialeah, Fl 33014
Phone 305.231.1101
Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga

Soumel Loriga, P.E.
PE Lic No.: 77736
Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 17175

SERIES:

2800 SERIES
S.M.I.

Description:

SGD SYSTEM


Drawn Date	Scale
10-10-2020	AS NOTED

Project No.
FLORIDA APPROVAL 2020


Drawing Title
DETAILS

Sheet No.
SHEET: 9 OF:11


1 2800-02 – HEAD

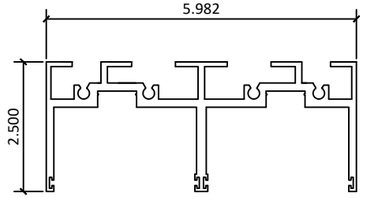


2 2800-03 – SILL

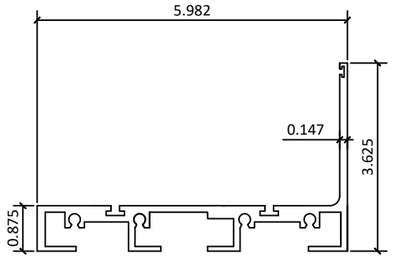


3 2800-08 – TOP PANEL




4 2800-09 – MOVING PANEL

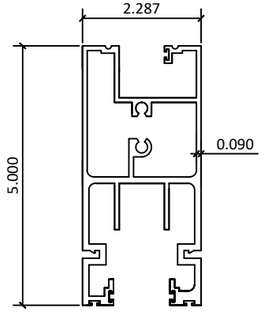


5 2800-19 – BOTTOM FIXED PANEL

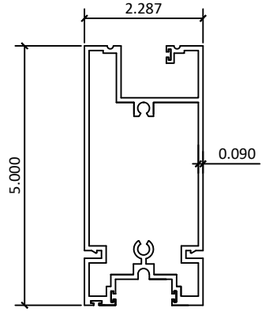


6 2800-04 – JAMB

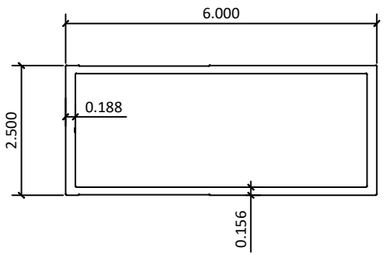


7 2800-10 – MOVING PANEL




8 2800-13 – FIXED STYLE




9 2800-22 – JAMB FIXED

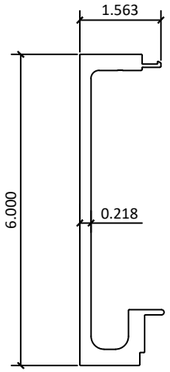


10 2800-11 – INTERLOCK




11 2800-25 – BOTTOM COVER

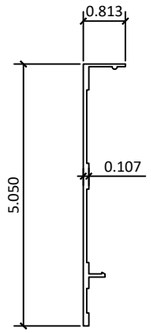

12 2800-26 – TOP COVER

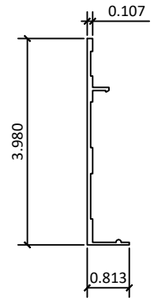

13 2800-05 – SILL TRACK



BILL OF MATERIALS				
ITEM #	PART NUMBER	PART NAME	ALLOY & TEMPERED	REMARKS
1	2800-02	HEAD	6063-T6	
2	2800-03	SILL	6063-T6	
3	2800-08	TOP PANEL	6063-T6	
4	2800-09	MOVING PANEL	6063-T6	
5	2800-19	BOTTOM FIXED PANEL	6063-T6	
6	2800-04	JAMB	6063-T6	
7	2800-10	MOVING PANEL	6063-T6	
8	2800-13	FIXED STILE	6063-T6	
9	2800-22	JAMB FIXED	6063-T6	
10	2800-11	INTERLOCK	6063-T6	
11	2800-25	BOTTOM COVER	6063-T6	
12	2800-26	TOP COVER	6063-T6	
13	2800-05	SILL TRACK	6063-T6	

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.

325 West 74 Place Hialeah, Fl 33014

Phone 305.231.1101

Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga

Soumel Loriga, P.E.

PE Lic No.: 77736

Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 17175

SERIES:

2800 SERIES S.M.I.

Description:

SGD SYSTEM

Drawn Date: 10-10-2020


Scale: AS NOTED

Project No.: FLORIDA APPROVAL 2020


Drawing Title: EXTRUSIONS & BOM

Sheet No.: SHEET: 10 OF:11


(14) 2800-24 – THRESHOLD




(15) 5500-09 – HEAD SCREW COVER




(16) 2800-23 – REINFORCING




(17) 2800-20 – HANDLE




(18) 2800-21 – JAMB ADAPTOR




(19) 2800-06 – ASTRAGAL




(21) 3000-14 – MALE & FEMALE REINFORCEMENT

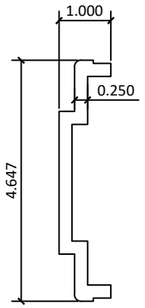


(23) 3000-06 – FEMALE

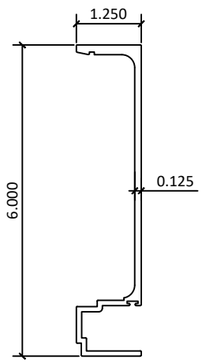


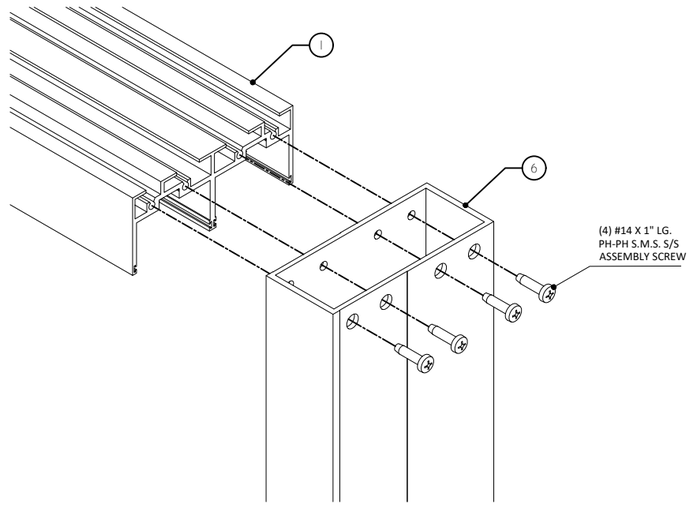


DOOR FRAME TOP CORNER

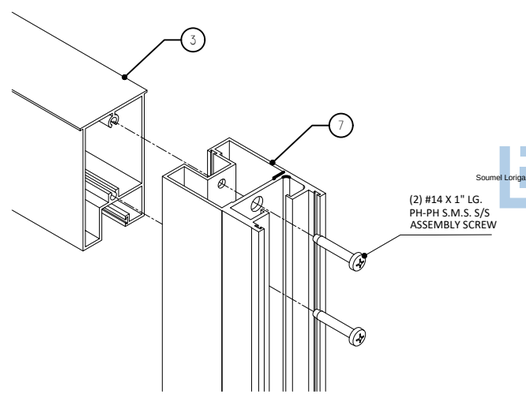

DOOR PANEL TOP CORNER

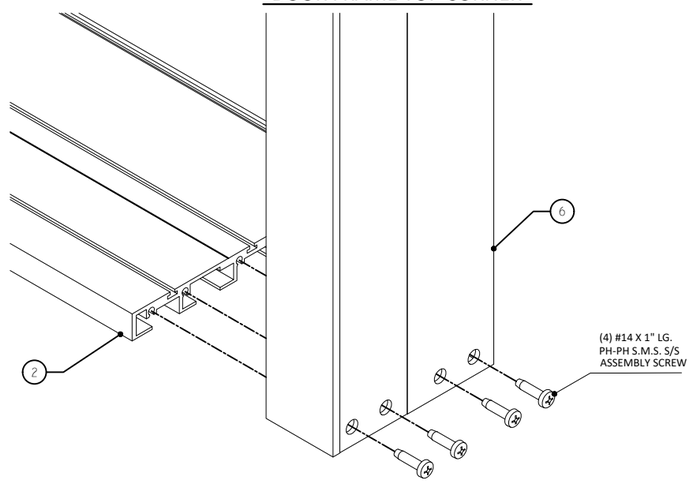

DOOR FRAME BOTTOM CORNER

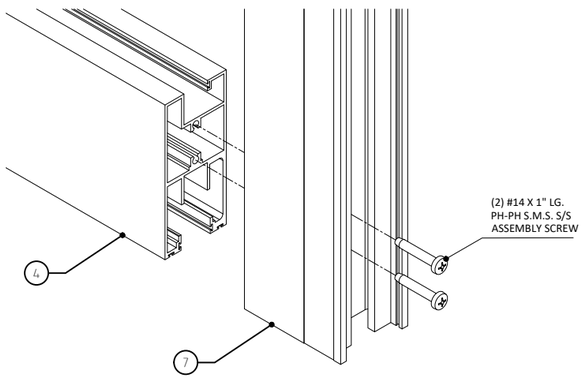

DOOR PANEL BOTTOM CORNER

BILL OF MATERIALS

ITEM #	PART NUMBER	PART NAME	ALLOY & TEMPERED	REMARKS
14	2800-24	THRESHOLD	6063-T6	
15	5500-09	HEAD SCREW COVER	6063-T6	
16	2800-23	REINFORCING L=60"	6063-T6	
17	2800-20	HANDLE	6063-T6	
18	2800-21	JAMB ADAPTOR	6063-T6	
19	2800-06	ASTRAGAL	6063-T6	
21	3000-14	MALE AND FEMALE REINFORCEMENT	6063-T6	
23	3000-06	FEMALE	6063-T6	
30		FIN. SEAL .187 x .250	ULTRAFAB	
31		FIN. SEAL .187 x .370	ULTRAFAB	
32		WHEEL		
33	CGS-02	GLASS SPACER	CENTRAL PLASTIC	

Manufacturer:

CGS

CONTINENTAL GLASS SYSTEMS LLC.

325 West 74 Place Hialeah, Fl 33014

Phone 305.231.1101

Toll Free 1.877.221.1101

Sub. No.	Rev. No.	Date	Drawn By	Submittal/Revision Description
	A	10/10/20		FBC 2020 CODE CHANGE

SLM ENGINEERS

REVIEWED FOR STRUCTURAL COMPLIANCE ONLY BY:

SOUMEL LORIGA LICENSE No. 77736 STATE OF FLORIDA PROFESSIONAL ENGINEER

Soumel Loriga, P.E.

PE Lic No.: 77736

Cert. of Authorization: 30891

FLORIDA NUMBER:

FL# 17175

SERIES:

2800 SERIES S.M.I.

Description:

SGD SYSTEM

Drawn Date	Scale
10-10-2020	AS NOTED

Project No.

FLORIDA APPROVAL 2020

Drawing Title

EXTRUSIONS & BOM

Sheet No.

SHEET: 11 OF:11