

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING, METAL STRUCTURE AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8".
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: ALUMINUM 6063-T5.
11. UNITS MUST BE GLAZED PER ASTM E1300, WITH SAFETY GLAZING.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.

13. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 OR #14 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 7/16" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
14. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16" ELCO ULTRACON OR 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 1 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING INTO METAL STRUCTURE USE #10 OR #14 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. ALL FASTENERS TO BE CORROSION RESISTANT.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - 17.1. WOOD - MINIMUM SPECIFIC GRAVITY OF G=0.42
 - 17.2. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - 17.3. GROUT FILLED MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, WITH Fm= 2,000 PSI.
 - 17.4. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .125" THICK MINIMUM

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2 - 3	ELEVATION
4	DESIGN PRESSURE CHARTS
5 - 6	CROSS SECTIONS
7 - 10	INSTALLATION DETAILS
11	COMPONENTS

SOLAR INNOVATIONS, INC.

31 ROBERTS RD
PINE GROVE, PA 17963

SERIES SI8000 G-3 MULTI TRACK
ALUMINUM SLIDING GLASS DOOR NON-IMPACT
NOTES

DRAWN:
N.G.

DWG NO.
08-02620

REV
F


SCALE NTS

DATE 01/27/15

SHEET 1 OF 11


L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/16/2026

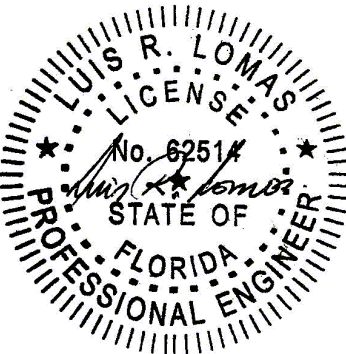

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

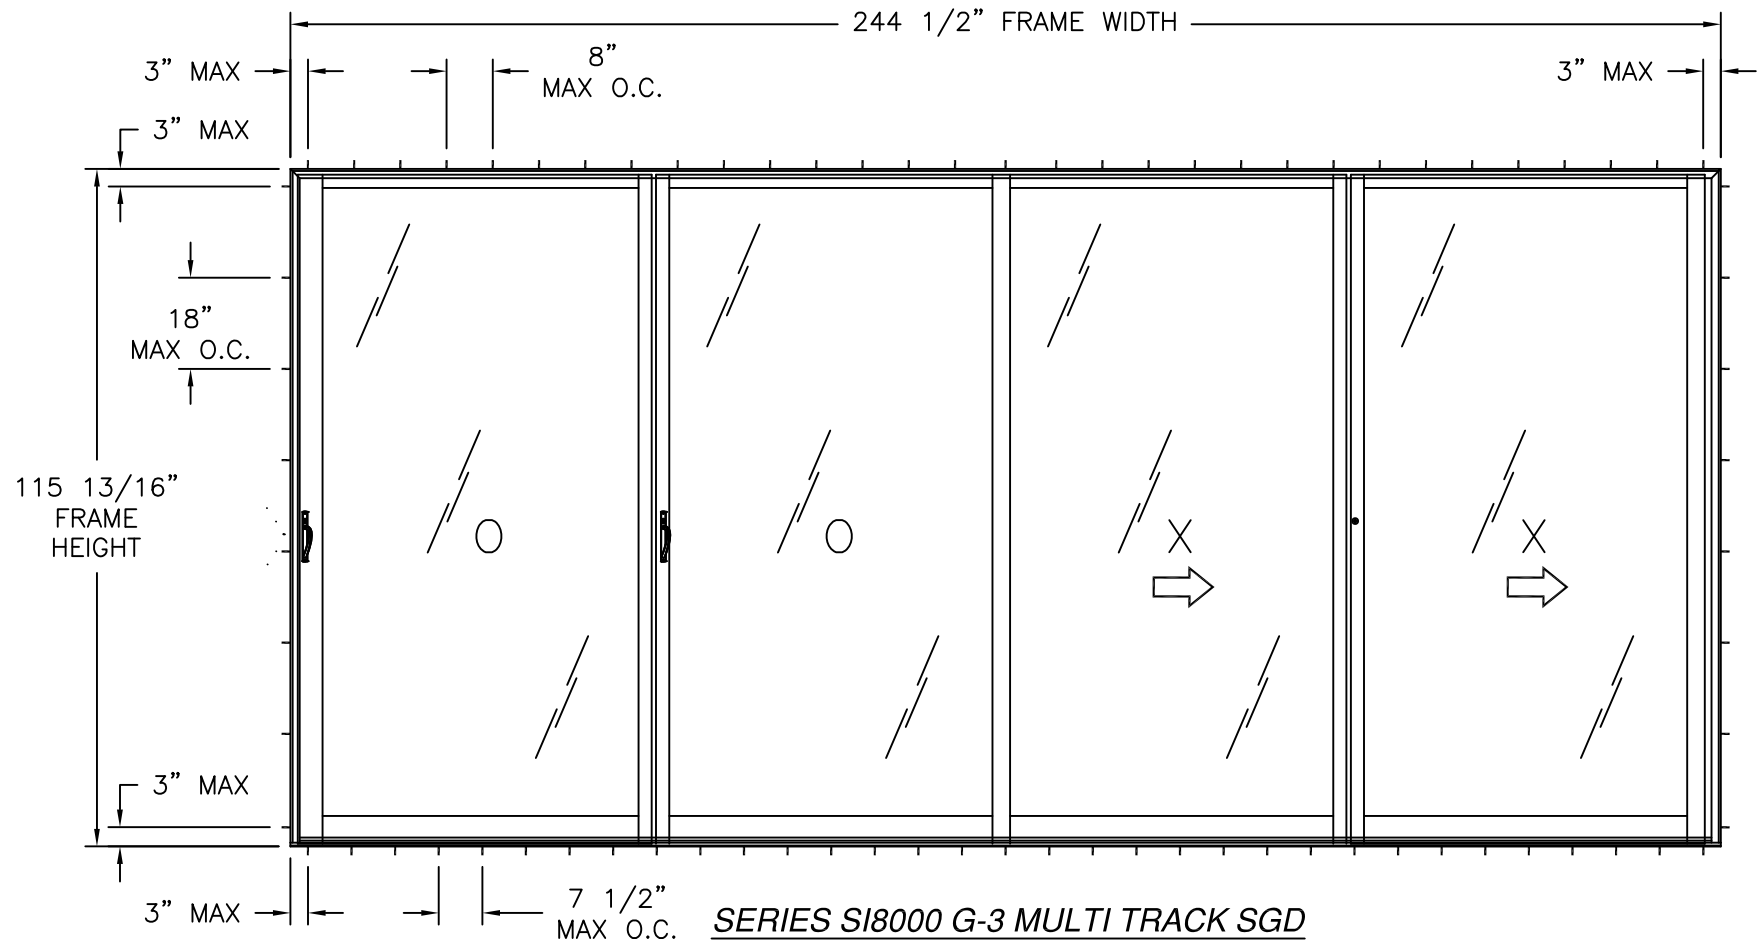

- NOTES:
1. OPERABLE PANEL MAXIMUM SIZE: 63 3/4" X 114 3/8"
 2. FIXED PANEL MAXIMUM SIZE: 63 1/8" X 114 3/8"
 3. OPERABLE PANEL MAXIMUM D.L.O.: 58 1/2" X 107 1/4"
 4. FIXED PANEL MAXIMUM D.L.O.: 55 5/8" X 107 1/4"
 5. (2) 1/4" DIAMETER WEEP HOLE LOCATED 6", 34", 59 1/2", 92 3/8" AND 119 1/4" FROM EACH END OF EXTERIOR SILL FACE
 6. (1) 1 1/4" X 1/4" WEEP HOLE WITH PLASTIC FLAP LOCATED 6", 34", 59 1/2", 65 1/2", 92 3/8" AND 119 1/4" FROM EACH END OF EXTERIOR SILL FACE.

SERIES SI8000 G-3 MULTI TRACK SGD
EXTERIOR VIEW
WITH #10 ANCHORS AND 3/16" ELCO ULTRACON
UNLIMITED NUMBER OF PANELS IN UNLIMITED CONFIGURATIONS ARE APPROVED AS LONG AS INDIVIDUAL PANEL
AREA DOES NOT EXCEED 50.63 FT² AND USES VERTICAL CONDITONS AS SHOWN IN APPROVAL DOCUMENT

WITH 1 1/2" THRESHOLD	
DESIGN PRESSURE RATING	IMPACT RATING
+50.0/-70.0PSF	NONE

SEE CHART #3, SHEET 4
WHERE WATER PENETRATION RESISTANCE IS REQUIRED

WITH 2 5/16" AND 3" THRESHOLD	
DESIGN PRESSURE RATING	IMPACT RATING
±70.0PSF	NONE

SEE CHART # 1, SHEET 4
WHERE WATER PENETRATION RESISTANCE IS REQUIRED


WITH ALL THRESHOLDS	
DESIGN PRESSURE RATING	IMPACT RATING
±70.0PSF	NONE

SEE CHART #2, SHEET 4
WHERE WATER PENETRATION RESISTANCE IS NOT REQUIRED

HARDWARE SCHEDULE	
A.	SINGLE HANDLE 2 POINT LOCK ON LOCK STILE 54 3/4" FROM BOTTOM RAIL
B.	METAL KEEPER AT JAMB AND MEETING STILES
C.	DUAL ROLLER & HOUSING AT EACH END OF BOTTOM RAILS


SOLAR INNOVATIONS, INC. 31 ROBERTS RD PINE GROVE, PA 17963		
SERIES SI8000 G-3 MULTI TRACK ALUMINUM SLIDING GLASS DOOR NON-IMPACT ELEVATION		
DRAWN: N.G.	DWG NO. 08-02620	REV F
SCALE NTS	DATE 01/27/15	SHEET 2 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 05/16/2026

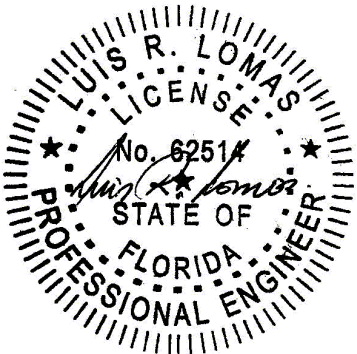

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

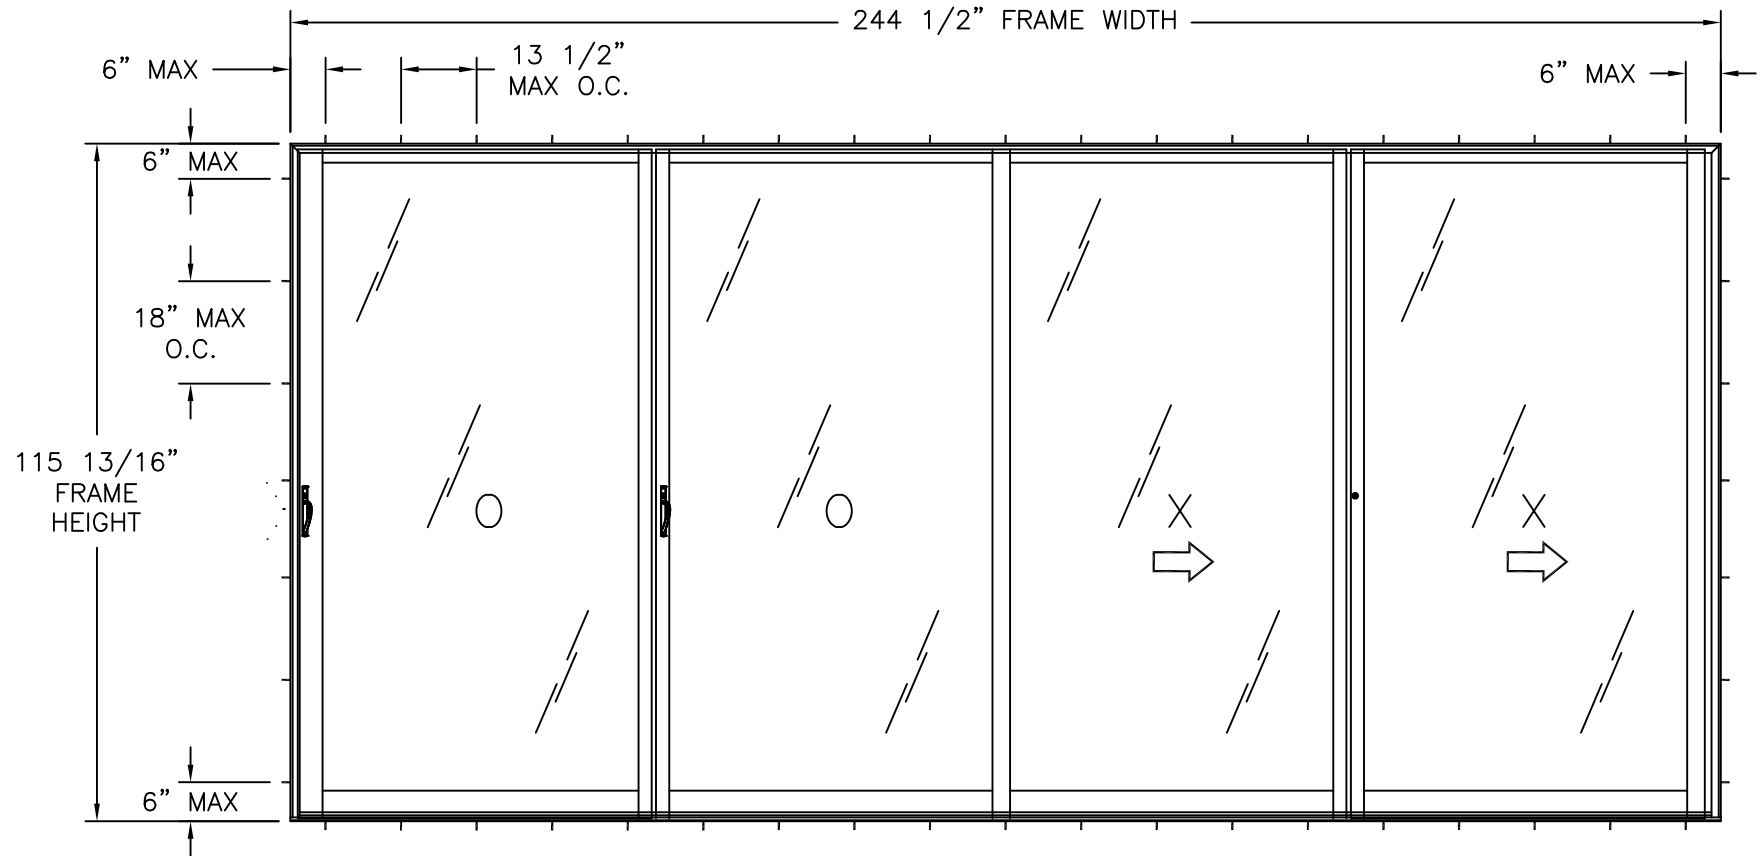

- NOTES:
1. OPERABLE PANEL MAXIMUM SIZE: 63 3/4" X 114 3/8"
 2. FIXED PANEL MAXIMUM SIZE: 63 1/8" X 114 3/8"
 3. OPERABLE PANEL MAXIMUM D.L.O.: 58 1/2" X 107 1/4"
 4. FIXED PANEL MAXIMUM D.L.O.: 55 5/8" X 107 1/4"
 5. (2) 1/4" DIAMETER WEEP HOLE LOCATED 6", 34", 59 1/2", 92 3/8" AND 119 1/4" FROM EACH END OF EXTERIOR SILL FACE
 6. (1) 1 1/4" X 1/4" WEEP HOLE WITH PLASTIC FLAP LOCATED 6", 34", 59 1/2", 65 1/2", 92 3/8" AND 119 1/4" FROM EACH END OF EXTERIOR SILL FACE.

SERIES SI8000 G-3 MULTI TRACK SGD

EXTERIOR VIEW

WITH #14 ANCHORS AND 1/4" TAPCONS

UNLIMITED NUMBER OF PANELS IN UNLIMITED CONFIGURATIONS ARE APPROVED AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 50.63 FT² AND USES VERTICAL CONDITONS AS SHOWN IN APPROVAL DOCUMENT

WITH 1 1/2" THRESHOLD

DESIGN PRESSURE RATING	IMPACT RATING
+50.0/-70.0PSF	NONE

SEE CHART #3, SHEET 4
WHERE WATER PENETRATION RESISTANCE IS REQUIRED

WITH 2 5/16" AND 3" THRESHOLD

DESIGN PRESSURE RATING	IMPACT RATING
±70.0PSF	NONE

SEE CHART # 1, SHEET 4
WHERE WATER PENETRATION RESISTANCE IS REQUIRED

WITH ALL THRESHOLDS

DESIGN PRESSURE RATING	IMPACT RATING
±70.0PSF	NONE

SEE CHART #2, SHEET 4
WHERE WATER PENETRATION RESISTANCE IS NOT REQUIRED

SIGNED: 05/16/2026

HARDWARE SCHEDULE	
A.	SINGLE HANDLE 2 POINT LOCK ON LOCK STILE 54 3/4" FROM BOTTOM RAIL
B.	METAL KEEPER AT JAMB AND MEETING STILES
C.	DUAL ROLLER & HOUSING AT EACH END OF BOTTOM RAILS

SOLAR INNOVATIONS, INC.
31 ROBERTS RD
PINE GROVE, PA 17963

SERIES SI8000 G-3 MULTI TRACK
ALUMINUM SLIDING GLASS DOOR NON-IMPACT
ELEVATION

DRAWN:
N.G.

DWG NO.
08-02620

REV
F

SCALE
NTS

DATE
01/27/15

SHEET
3 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

CHART #1
WHERE WATER PENETRATION RESISTANCE IS REQUIRED
WITH 2 5/16" AND 3" THRESHOLD

Maximum Design pressure (psf)																		
Panel Height (in)	Single Panel Width (in)																	
	24.0		30.0		36.0		42.0		48.0		54.0		60.0		63.75		66.0	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
78.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	102.6	70.0	99.1
84.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	101.3	70.0	95.3	70.0	92.1
90.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	94.5	70.0	89.0	70.0	85.9
96.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	98.5	70.0	88.6	70.0	83.4	70.0	80.6
102.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	98.3	70.0	90.9	70.0	83.4	70.0	78.5	70.0	75.8
108.0	70.0	105.0	70.0	105.0	70.0	105.0	70.0	100.8	70.0	91.3	70.0	84.2	70.0	78.7	70.0	74.1	70.0	71.6
114.38	70.0	105.0	70.0	105.0	70.0	105.0	70.0	93.9	70.0	84.9	70.0	78.0	70.0	72.7	70.0	70.0	-	-
120.0	70.0	105.0	70.0	105.0	70.0	97.9	70.0	85.0	70.0	75.6	68.4	68.4	62.8	62.8	-	-	-	-
126.0	70.0	105.0	70.0	100.1	70.0	84.3	70.0	73.1	64.9	64.9	58.6	58.6	-	-	-	-	-	-
132.0	70.0	105.0	70.0	86.9	70.0	73.1	63.3	63.3	56.1	56.1	50.6	50.6	-	-	-	-	-	-
138.0	70.0	94.2	70.0	75.9	63.8	63.8	55.2	55.2	48.9	48.9	-	-	-	-	-	-	-	-
144.00	70.0	82.9	66.7	66.7	56.0	56.0	48.5	48.5	42.9	42.9	-	-	-	-	-	-	-	-
150.0	70.0	73.3	58.9	58.9	49.5	49.5	42.8	42.8	37.8	37.8	-	-	-	-	-	-	-	-
156.0	65.1	65.1	52.3	52.3	43.9	43.9	37.9	37.9	-	-	-	-	-	-	-	-	-	-

CHART #2
WHERE WATER PENETRATION RESISTANCE IS NOT REQUIRED
FOR ALL THRESHOLDS

Maximum Design pressure (psf)																		
Panel Height (in)	Single Panel Width (in)																	
	24.0		30.0		36.0		42.0		48.0		54.0		60.0		63.75		66.0	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
78.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	102.6	102.6	99.1	99.1
84.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	101.3	101.3	95.3	95.3	92.1	92.1
90.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	94.5	94.5	89.0	89.0	85.9	85.9
96.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	98.5	98.5	88.6	88.6	83.4	83.4	80.6	80.6
102.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	98.3	98.3	90.9	90.9	83.4	83.4	78.5	78.5	75.8	75.8
108.0	105.0	105.0	105.0	105.0	105.0	105.0	100.8	100.8	91.3	91.3	84.2	84.2	78.7	78.7	74.1	74.1	71.6	71.6
114.38	105.0	105.0	105.0	105.0	105.0	105.0	93.9	93.9	84.9	84.9	78.0	78.0	72.7	72.7	70.0	70.0	-	-
120.0	105.0	105.0	105.0	105.0	97.9	97.9	85.0	85.0	75.6	75.6	68.4	68.4	62.8	62.8	-	-	-	-
126.0	105.0	105.0	100.1	100.1	84.3	84.3	73.1	73.1	64.9	64.9	58.6	58.6	-	-	-	-	-	-
132.0	105.0	105.0	86.9	86.9	73.1	73.1	63.3	63.3	56.1	56.1	50.6	50.6	-	-	-	-	-	-
138.0	94.2	94.2	75.9	75.9	63.8	63.8	55.2	55.2	48.9	48.9	-	-	-	-	-	-	-	-
144.00	82.9	82.9	66.7	66.7	56.0	56.0	48.5	48.5	42.9	42.9	-	-	-	-	-	-	-	-
150.0	73.3	73.3	58.9	58.9	49.5	49.5	42.8	42.8	37.8	37.8	-	-	-	-	-	-	-	-
156.0	65.1	65.1	52.3	52.3	43.9	43.9	37.9	37.9	-	-	-	-	-	-	-	-	-	-

CHART #3
WHERE WATER PENETRATION RESISTANCE IS REQUIRED
WITH 1 1/2" THRESHOLD

Maximum Design pressure (psf)																		
Panel Height (in)	Single Panel Width (in)																	
	24.0		30.0		36.0		42.0		48.0		54.0		60.0		63.75		66.0	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
78.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	102.6	50.0	99.1
84.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	101.3	50.0	92.1
90.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	94.5	50.0	85.9
96.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	98.5	50.0	88.6	50.0	83.4	50.0	80.6
102.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	98.3	50.0	90.9	50.0	83.4	50.0	78.5	50.0	75.8
108.0	50.0	105.0	50.0	105.0	50.0	105.0	50.0	100.8	50.0	91.3	50.0	84.2	50.0	78.7	50.0	74.1	50.0	71.6
114.38	50.0	105.0	50.0	105.0	50.0	105.0	50.0	93.9	50.0	84.9	50.0	78.0	50.0	72.7	50.0	70.0	-	-
120.0	50.0	105.0	50.0	105.0	50.0	97.9	50.0	85.0	50.0	75.6	50.0	68.4	50.0	62.8	-	-	-	-
126.0	50.0	105.0	50.0	100.1	50.0	84.3	50.0	73.1	50.0	64.9	50.0	58.6	-	-	-	-	-	-
132.0	50.0	105.0	50.0	86.9	50.0	73.1	50.0	63.3	50.0	56.1	50.0	50.6	-	-	-	-	-	-
138.0	50.0	94.2	50.0	75.9	50.0	63.8	50.0	55.2	48.9	48.9	-	-	-	-	-	-	-	-
144.00	50.0	82.9	50.0	66.7	50.0	56.0	48.5	48.5	42.9	42.9	-	-	-	-	-	-	-	-
150.0	50.0	73.3	50.0	58.9	49.5	49.5	42.8	42.8	37.8	37.8	-	-	-	-	-	-	-	-
156.0	50.0	65.1	50.0	52.3	43.9	43.9	37.9	37.9	-	-	-	-	-	-	-	-	-	-

SIGNED: 05/16/2026

SOLAR INNOVATIONS, INC.
31 ROBERTS RD
PINE GROVE, PA 17963

SERIES SI8000 G-3 MULTI TRACK
ALUMINUM SLIDING GLASS DOOR NON-IMPACT
DESIGN PRESSURE CHARTS

DRAWN:
N.G.

DWG NO.
08-02620


REV
F

SCALE
NTS

DATE
01/27/15


SHEET
4 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

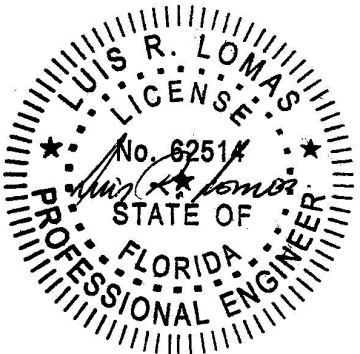

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

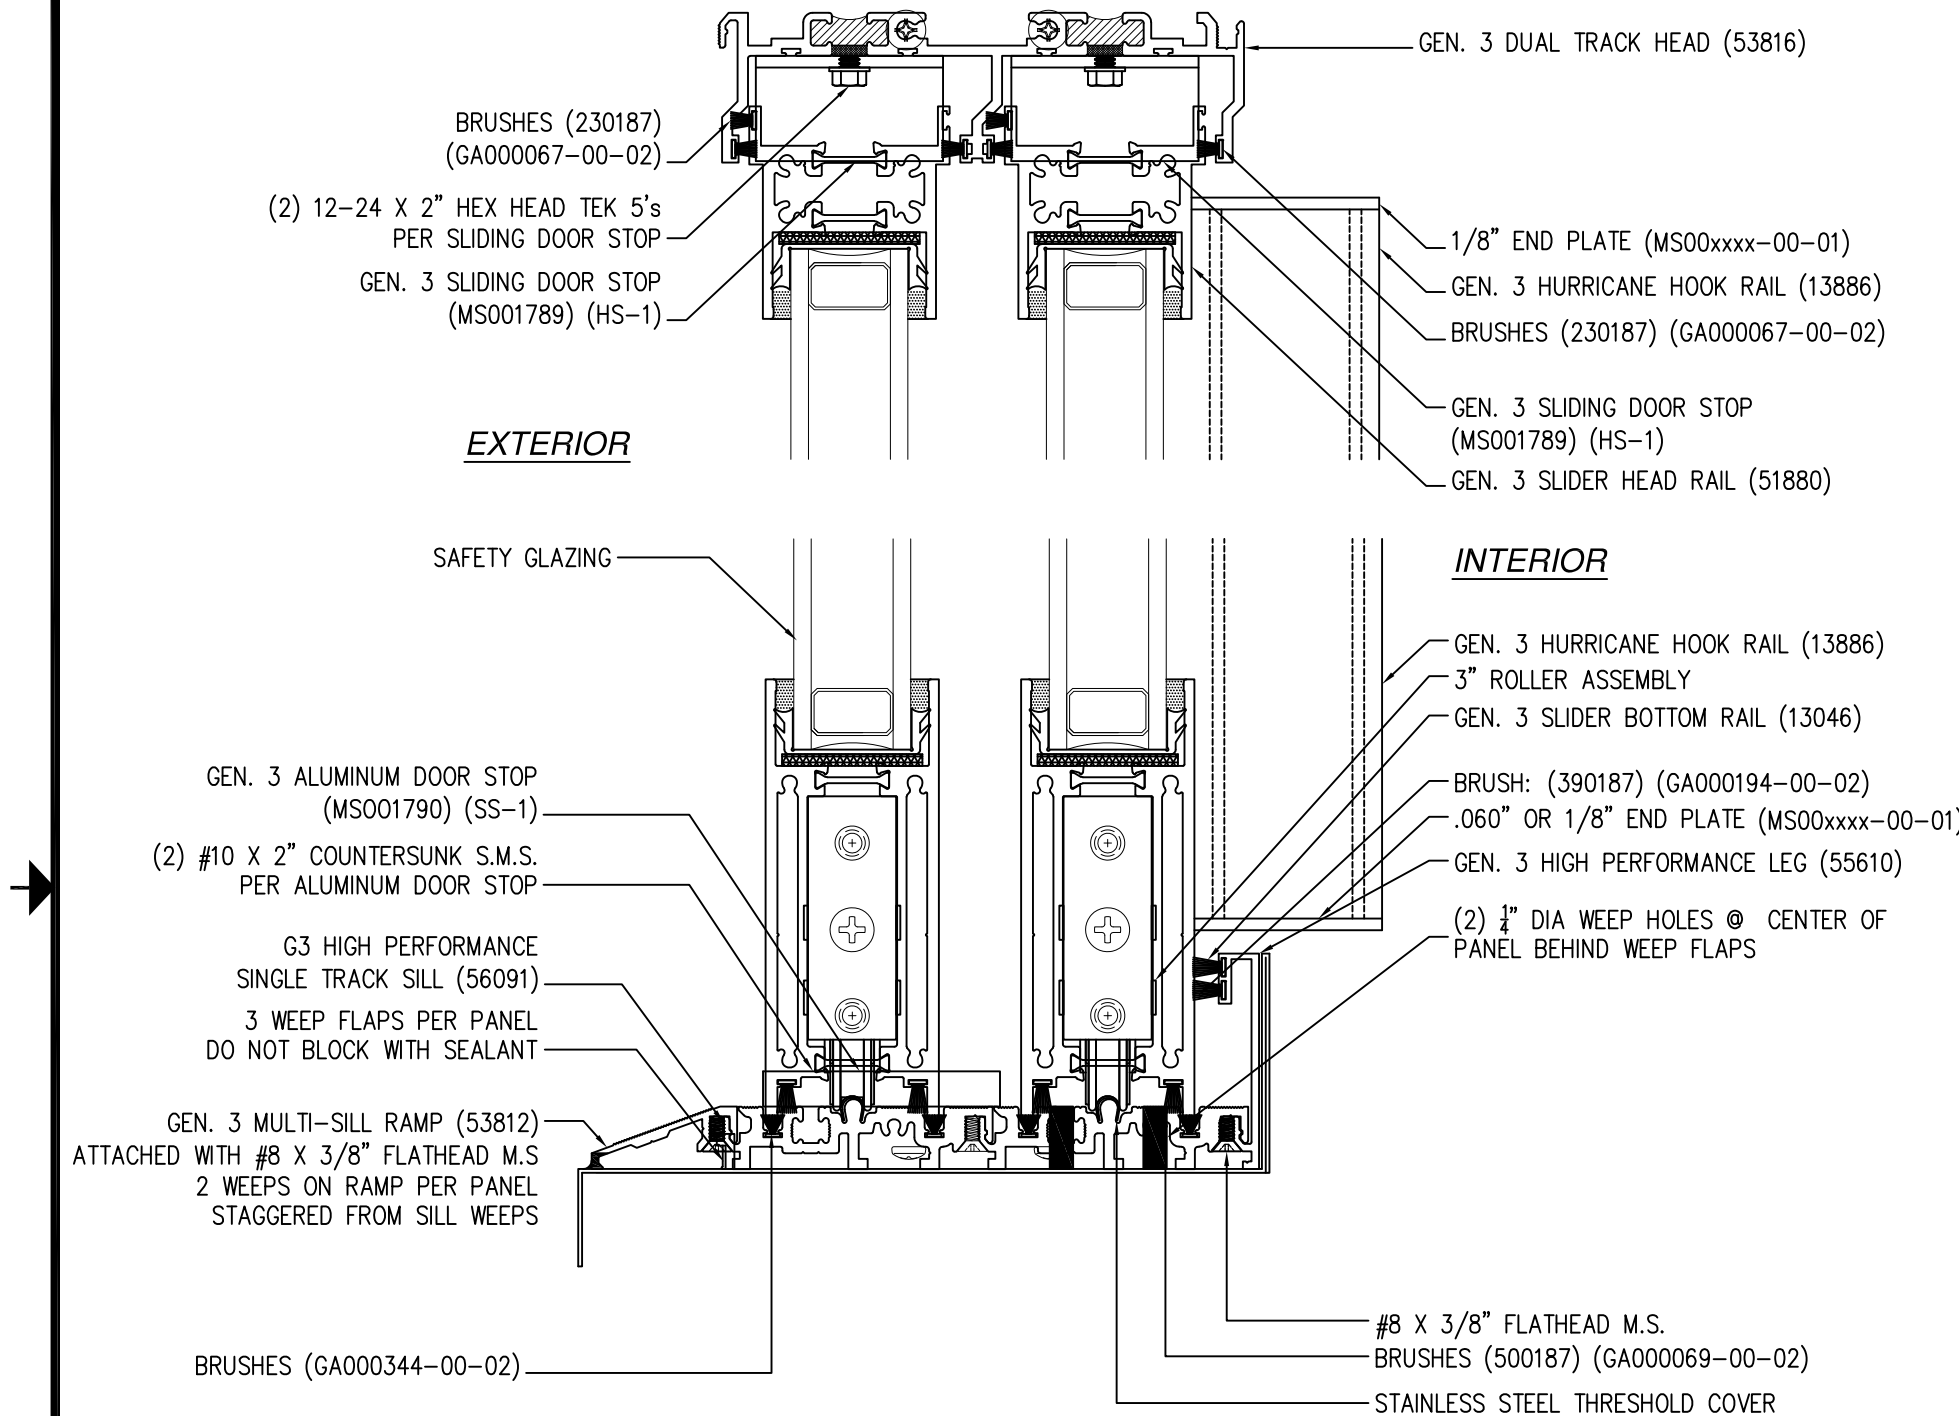

VERTICAL CROSS SECTION

SOLAR INNOVATIONS, INC.

31 ROBERTS RD
PINE GROVE, PA 17963

SERIES SI8000 G-3 MULTI TRACK
ALUMINUM SLIDING GLASS DOOR NON-IMPACT
VERTICAL CROSS SECTION

DRAWN: N.G.

DWG NO. 08-02620

REV F

SCALE NTS

DATE 01/27/15

SHEET 5 OF 11

L. ROBERTO LOMAS P.E.


208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/16/2026

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

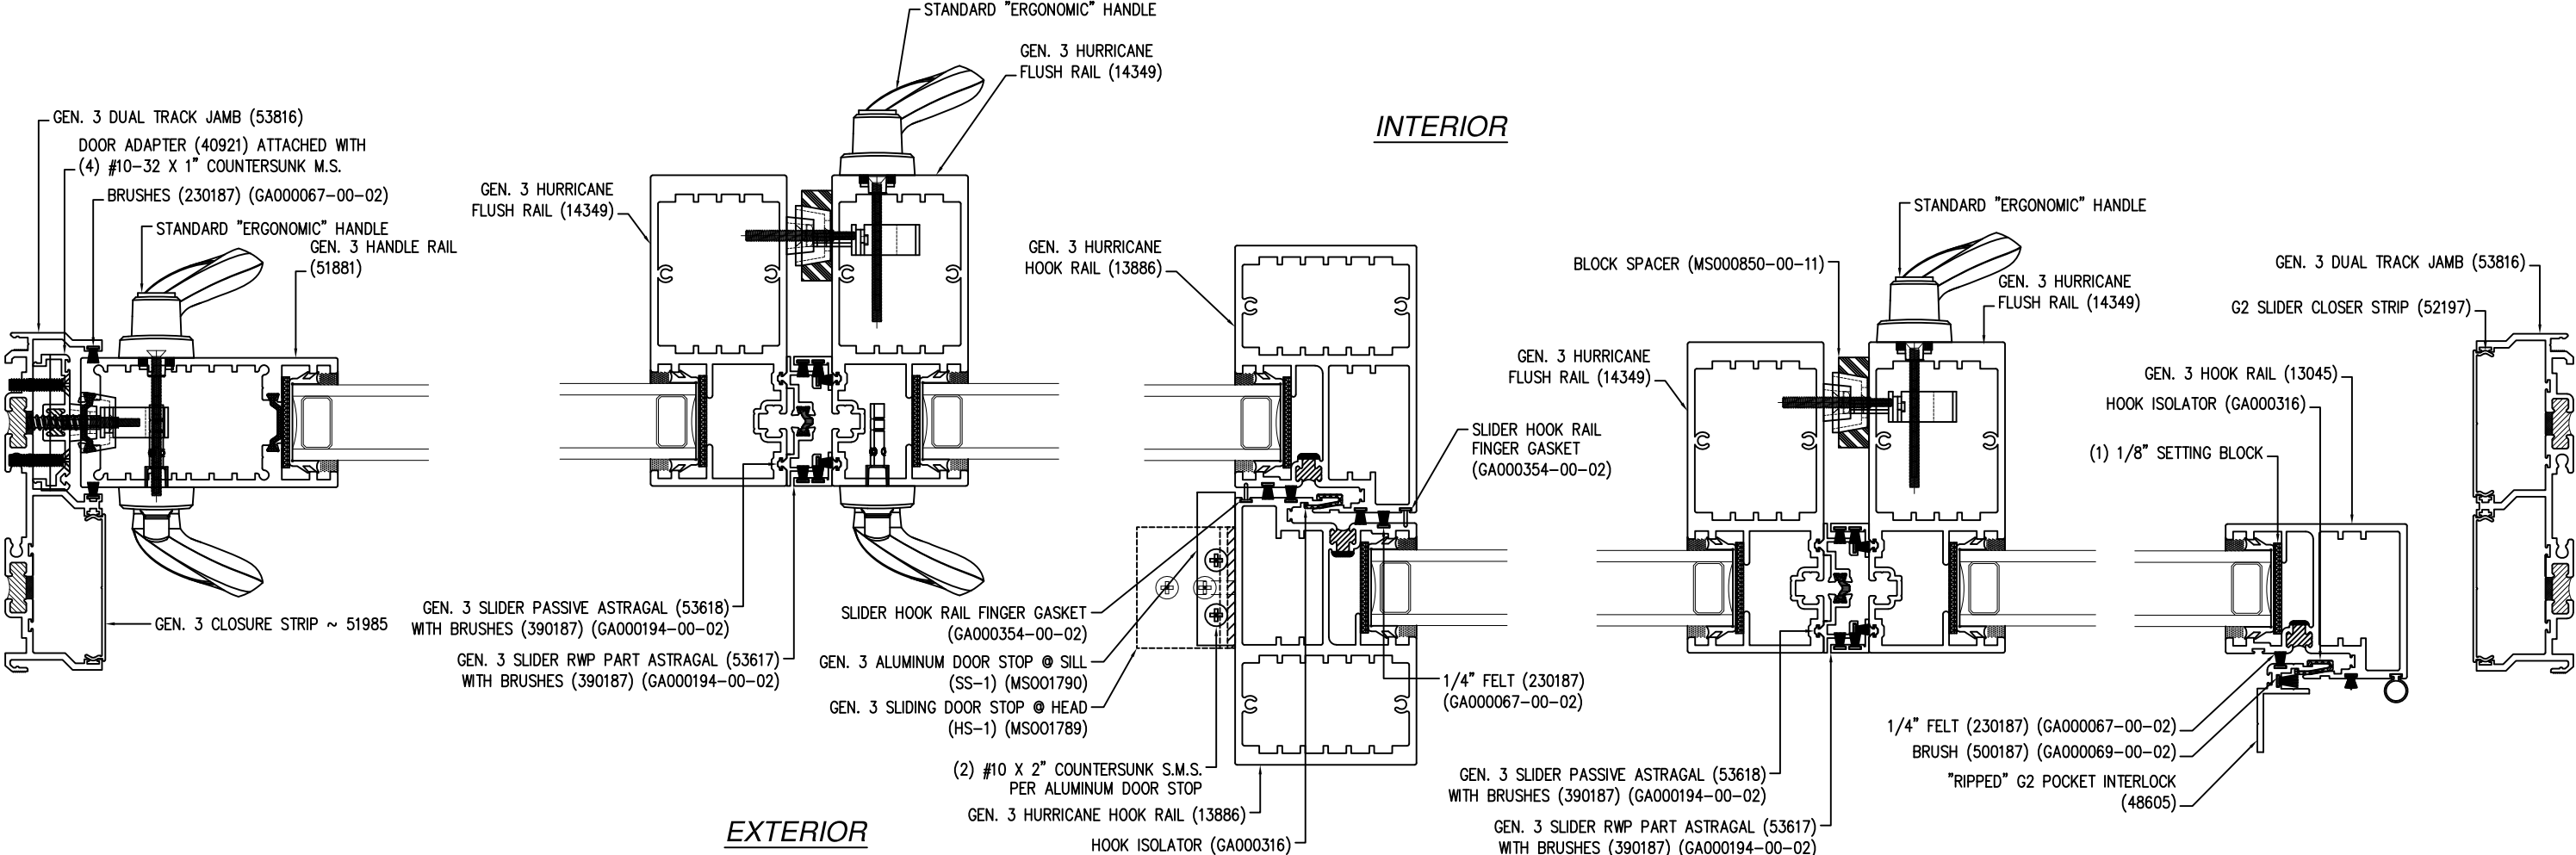

HORIZONTAL CROSS SECTION

SIGNED: 05/16/2026

SOLAR INNOVATIONS, INC.

31 ROBERTS RD
PINE GROVE, PA 17963

SERIES SI8000 G-3 MULTI TRACK

ALUMINUM SLIDING GLASS DOOR NON-IMPACT


HORIZONTAL CROSS SECTION

DRAWN: N.G.	DWG NO. 08-02620	REV F
SCALE NTS	DATE 01/27/15	SHEET 6 OF 11

L. ROBERTO LOMAS P.E.


208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

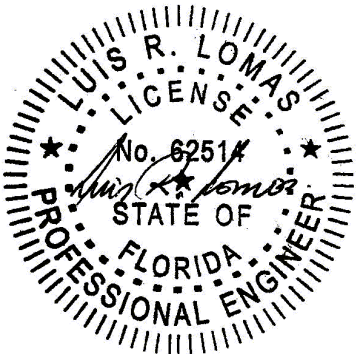


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

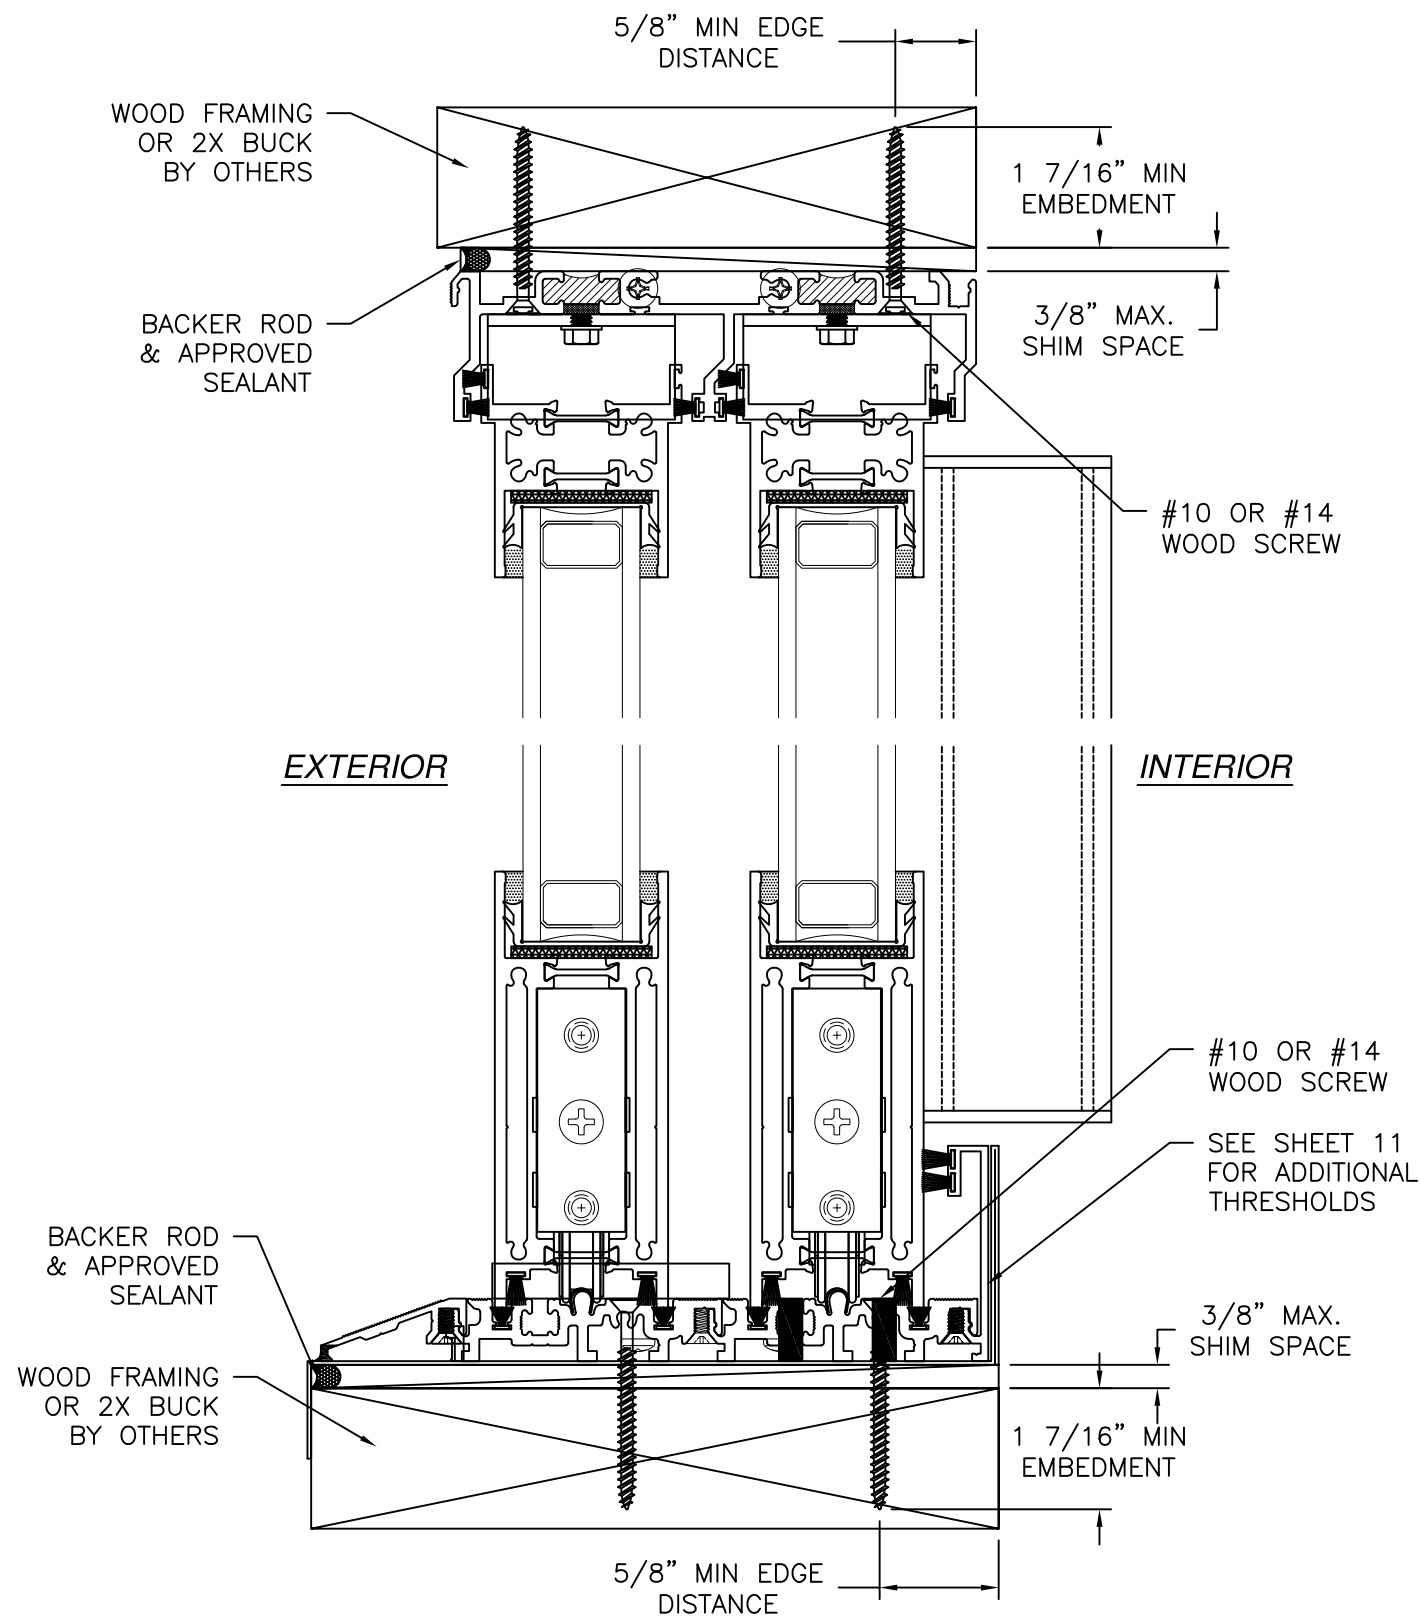

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

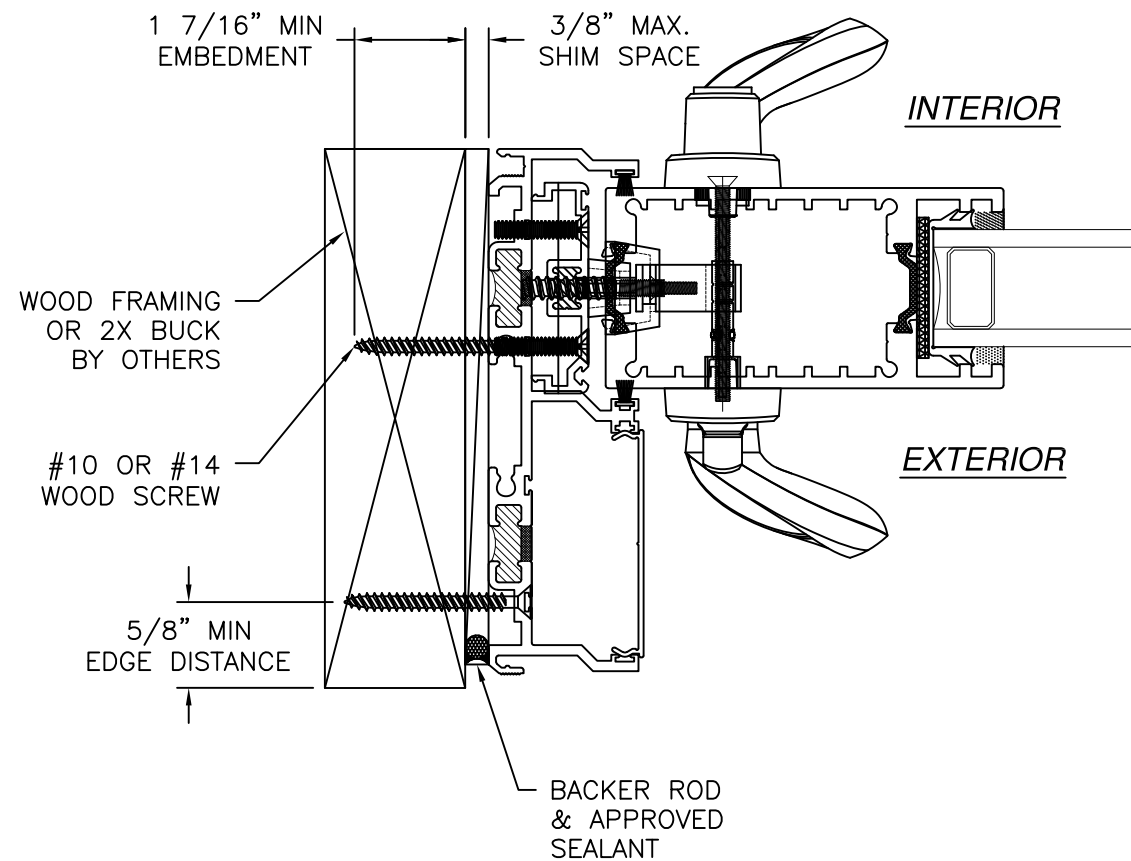

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

SOLAR INNOVATIONS, INC.

31 ROBERTS RD
PINE GROVE, PA 17963

SERIES SI8000 G-3 MULTI TRACK
ALUMINUM SLIDING GLASS DOOR NON-IMPACT
INSTALLATION DETAILS

DRAWN:

N.G.

DWG NO.

08-02620

REV

F

SCALE

NTS

DATE

01/27/15

SHEET

7

OF


11

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/16/2026

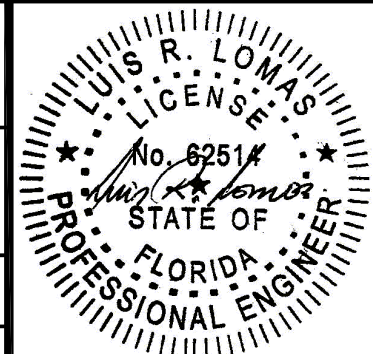


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

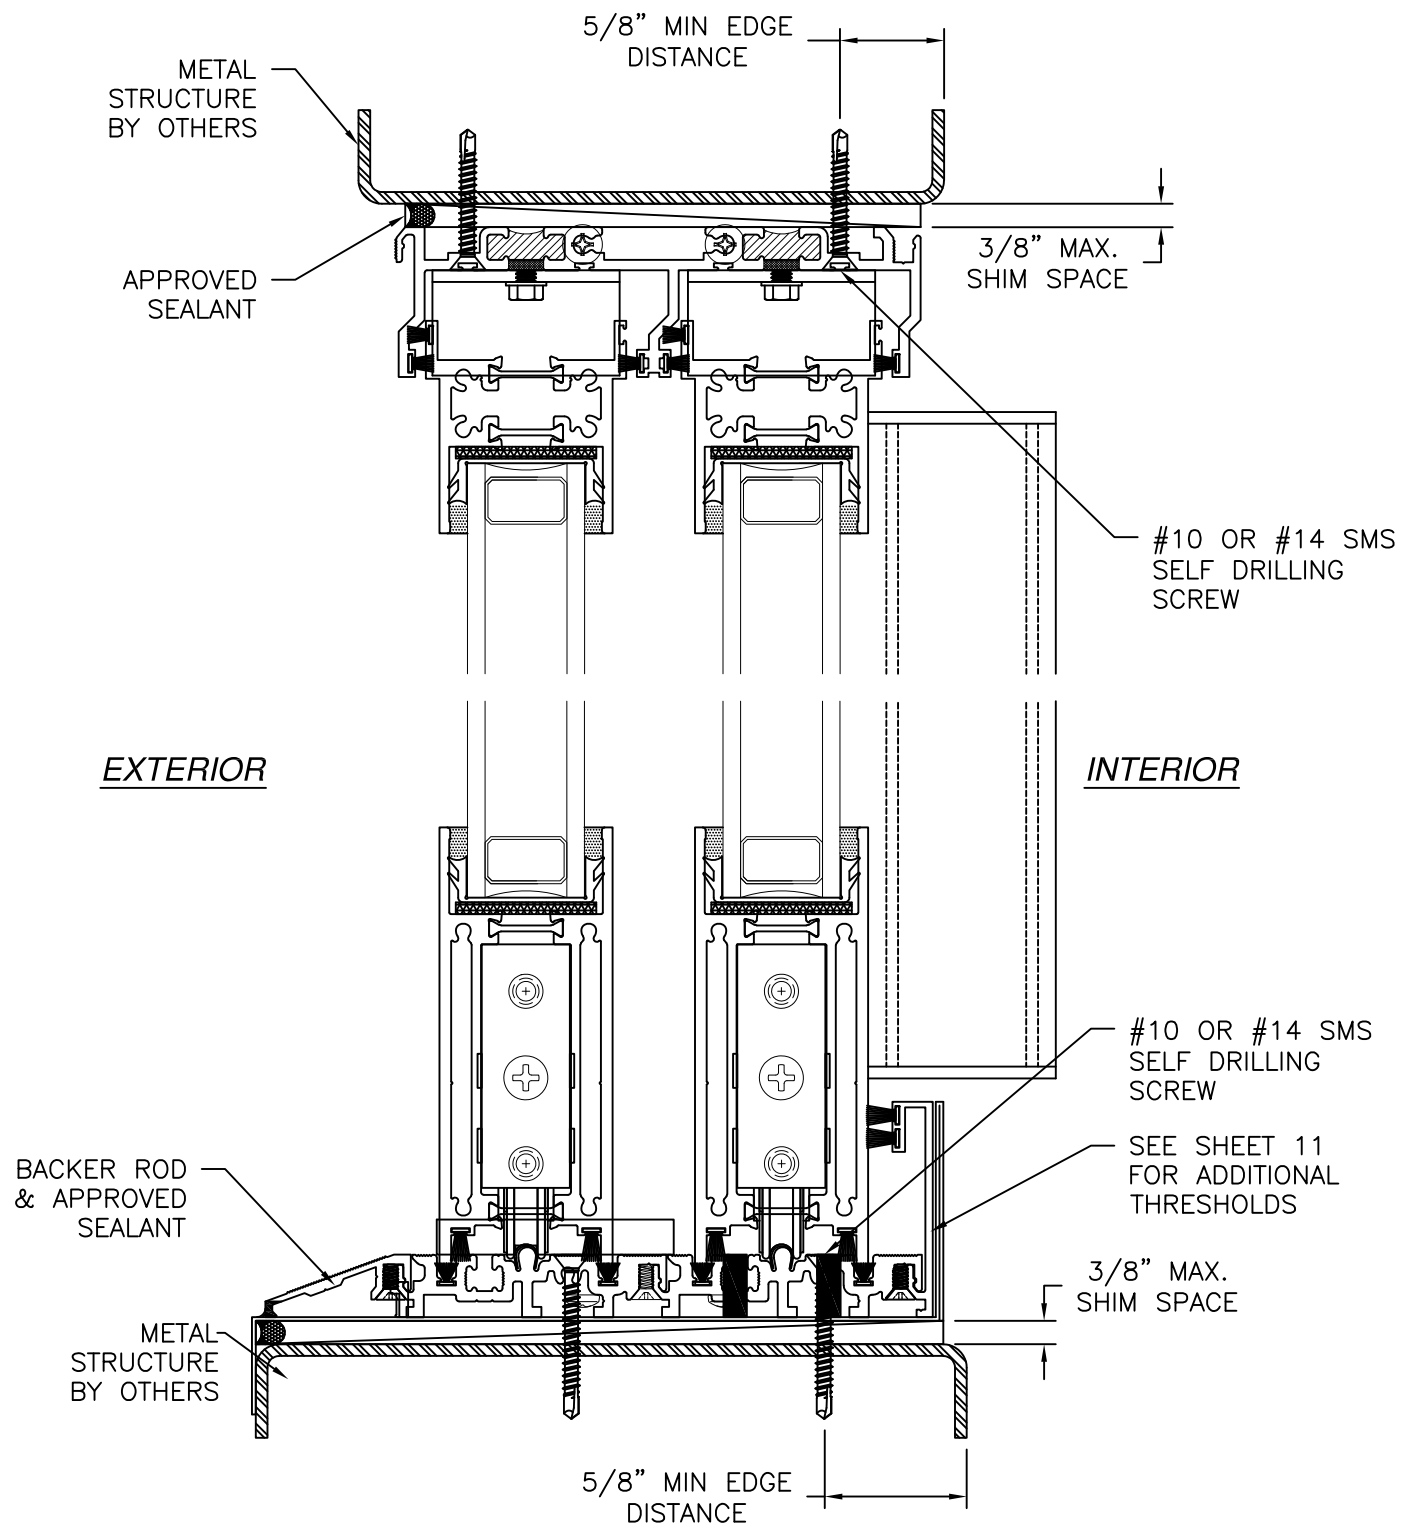

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

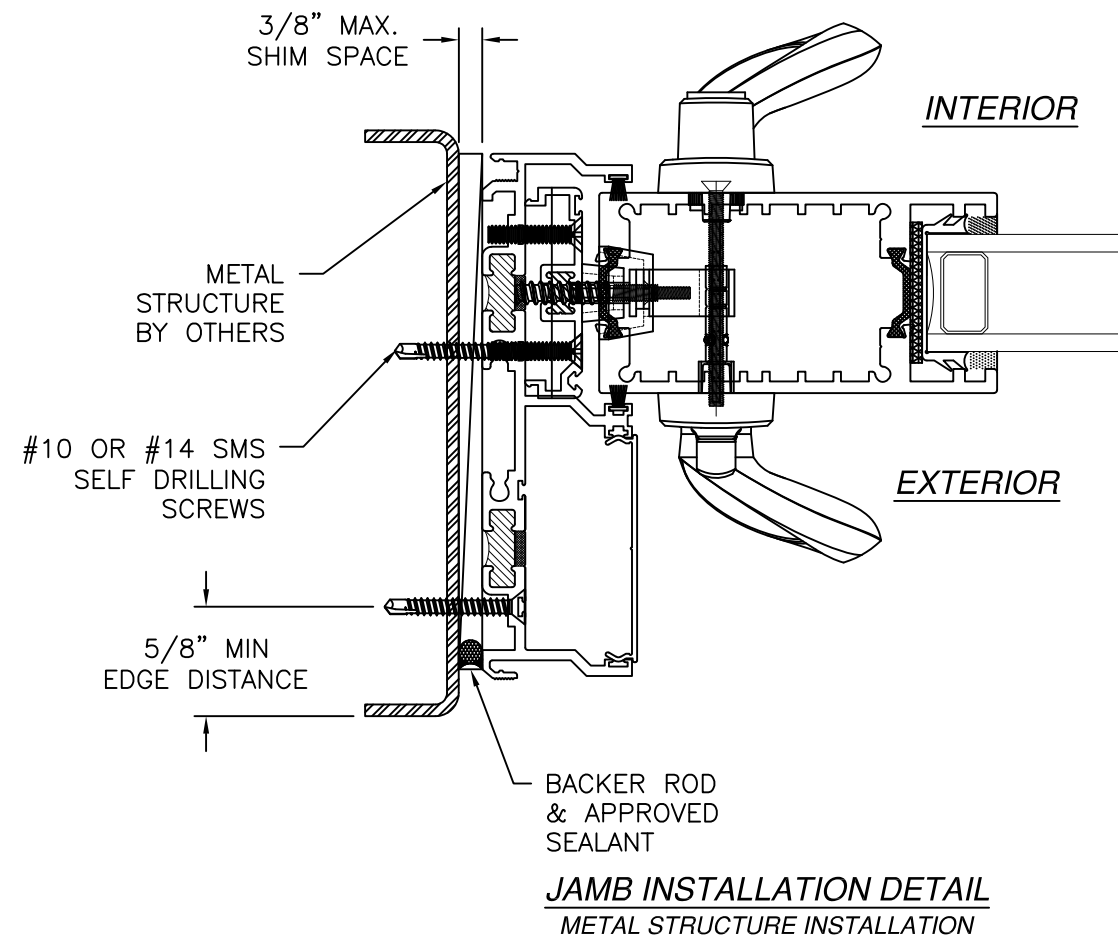


SOLAR INNOVATIONS, INC.
31 ROBERTS RD
PINE GROVE, PA 17963

SERIES SI8000 G-3 MULTI TRACK
ALUMINUM SLIDING GLASS DOOR NON-IMPACT
INSTALLATION DETAILS


DRAWN: N.G.	DWG NO. 08-02620	REV F
SCALE NTS	DATE 01/27/15	SHEET 8 OF 11

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 05/16/2026

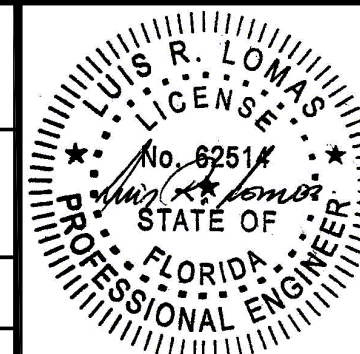

Luis R. Lomas P.E.
FL No.: 62514

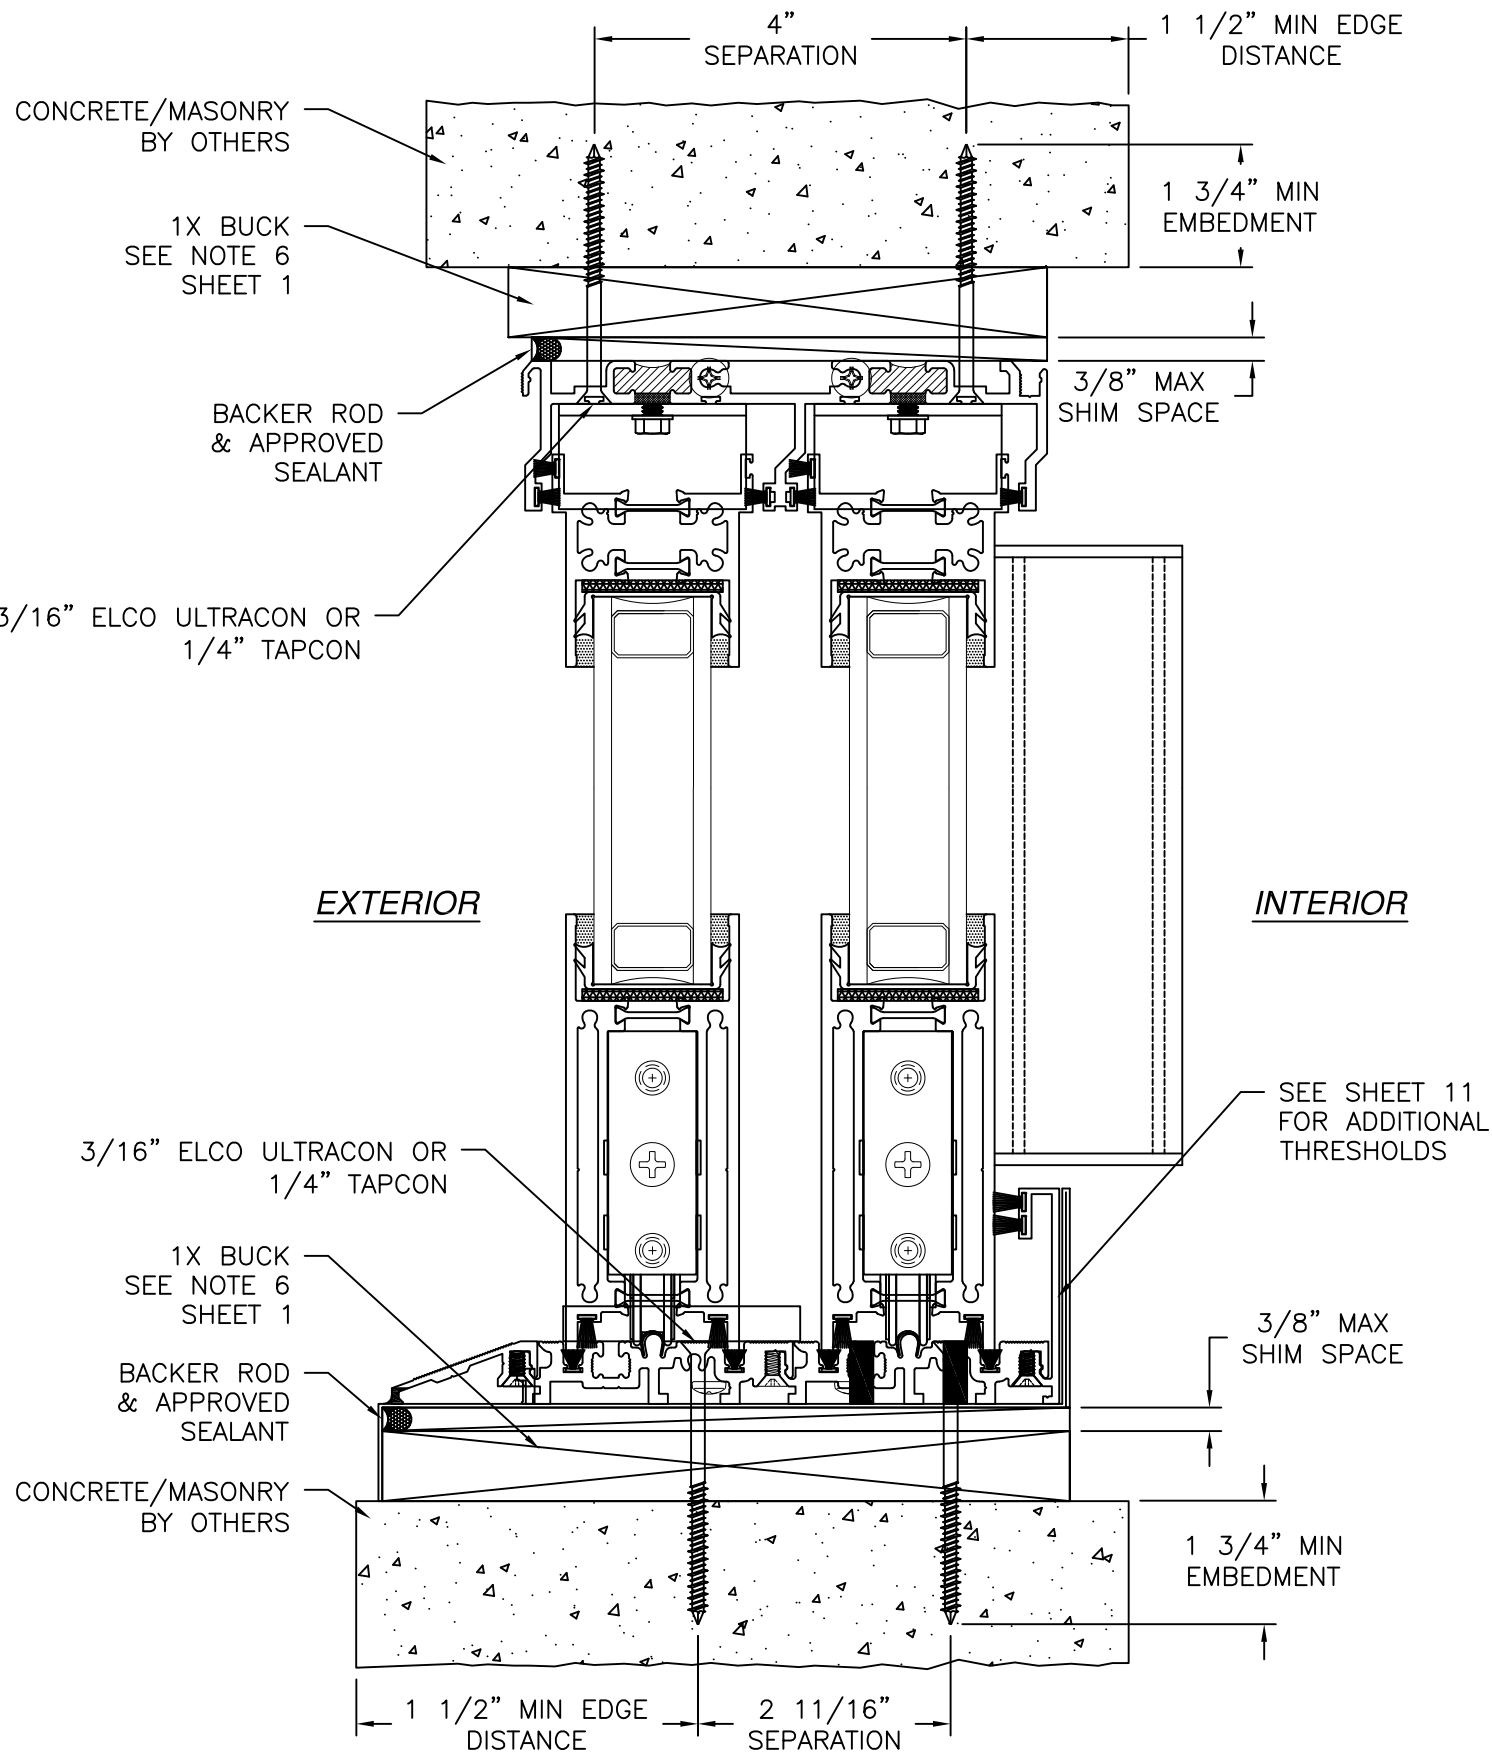

VERTICAL CROSS SECTION
 CONCRETE/MASONRY WITH 1X BUCK INSTALLATION
 FOR CONCRETE/MASONRY WITHOUT 1X BUCK REFER TO
 JAMB INSTALLATION DETAIL

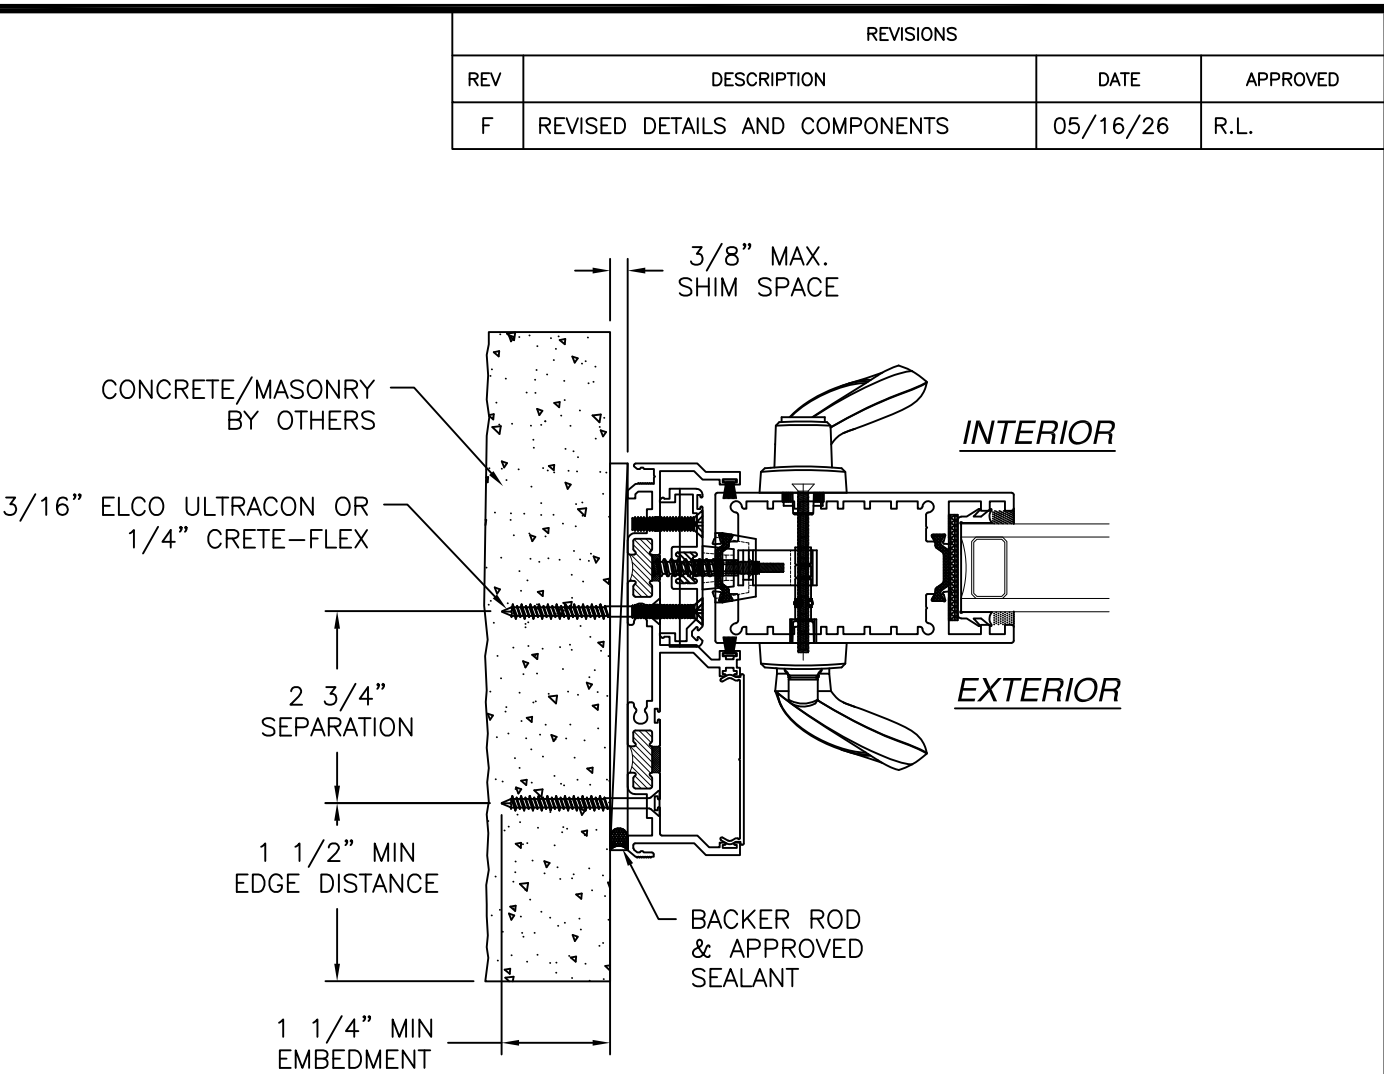

JAMB INSTALLATION DETAIL
 CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION
 FOR CONCRETE/MASONRY WITH 1X BUCK REFER TO
 HEAD AND SILL INSTALLATION DETAILS

NOTES:
 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,
 NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE
 DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.


SOLAR INNOVATIONS, INC.
 31 ROBERTS RD
 PINE GROVE, PA 17963

SERIES SI8000 G-3 MULTI TRACK
 ALUMINUM SLIDING GLASS DOOR NON-IMPACT
 INSTALLATION DETAILS

DRAWN: N.G. DWG NO. 08-02620 REV F
 SCALE NTS DATE 01/27/15 SHEET 9 OF 11


L. ROBERTO LOMAS P.E.
 208 7th Ave, INDIALANTIC, FL 32903
 434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/16/2026

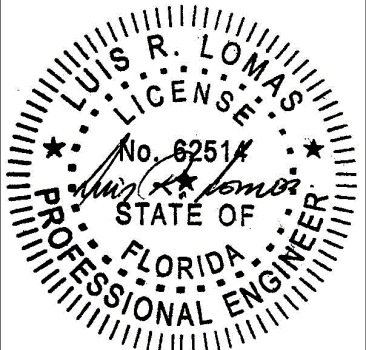


Luis R. Lomas P.E.
 FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

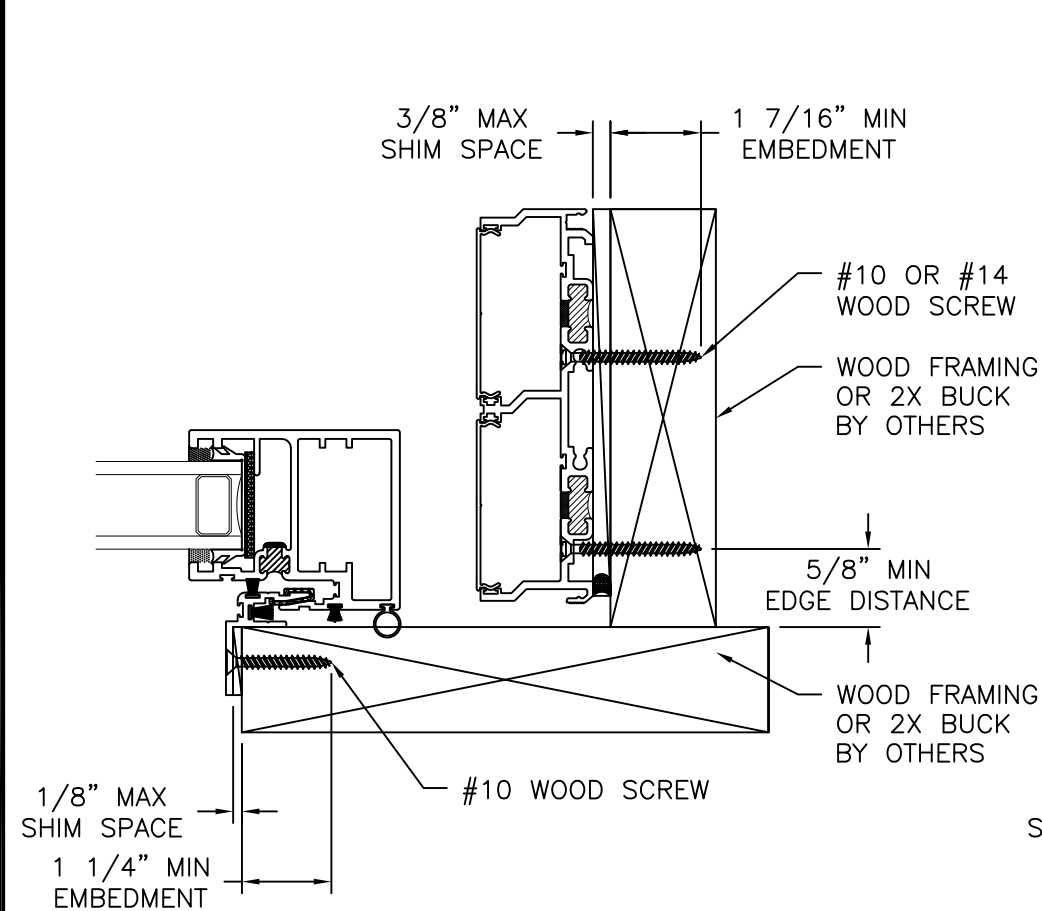

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

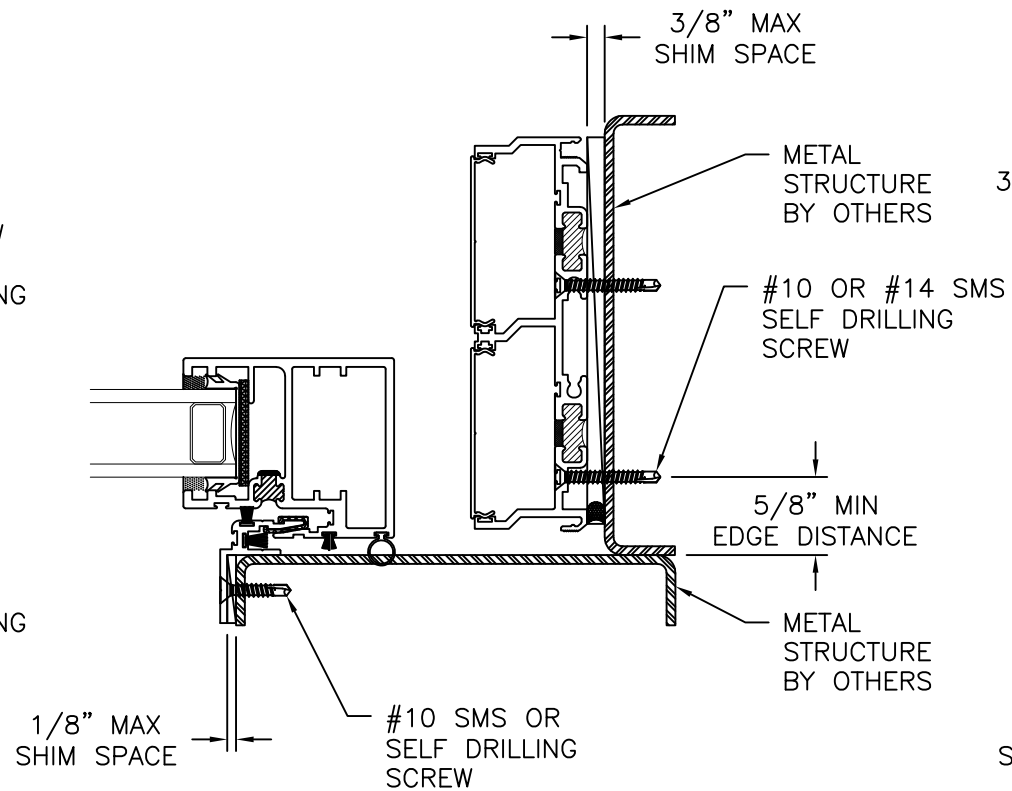


JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

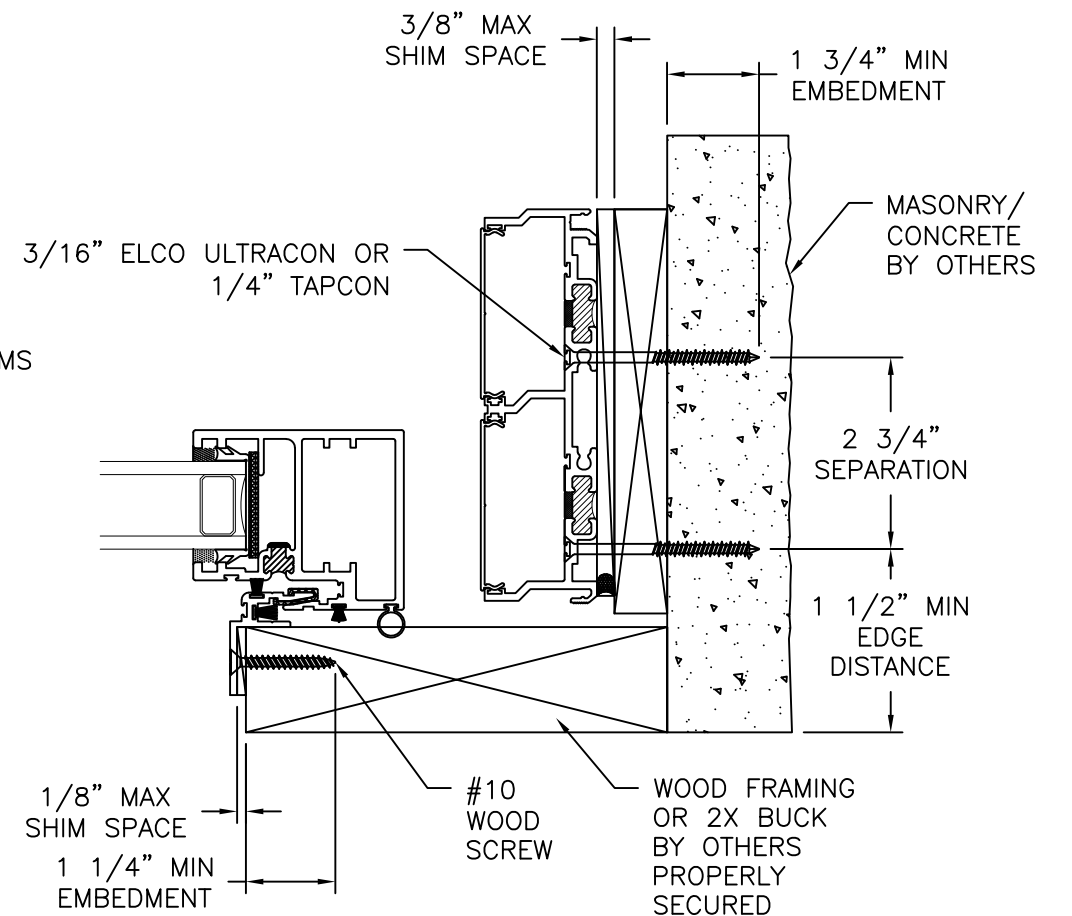

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION


















SIGNED: 05/16/2026

SOLAR INNOVATIONS, INC. 31 ROBERTS RD PINE GROVE, PA 17963		
SERIES SI8000 G-3 MULTI TRACK ALUMINUM SLIDING GLASS DOOR NON-IMPACT POCKET INSTALLATION DETAILS		
DRAWN: N.G.	DWG NO. 08-02620	REV F
SCALE NTS	DATE 01/27/15	SHEET 10 OF 11
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

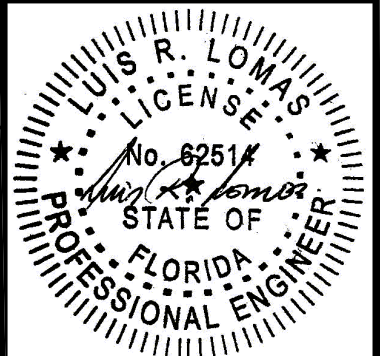

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
F	REVISED DETAILS AND COMPONENTS	05/16/26	R.L.

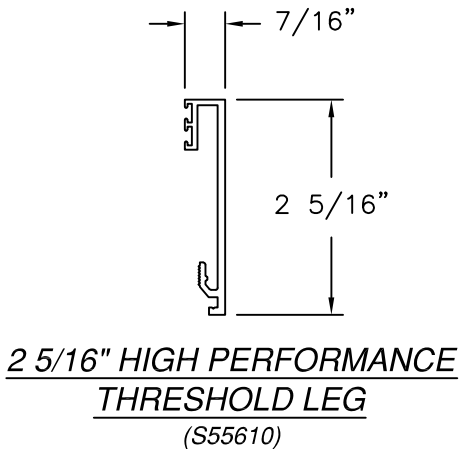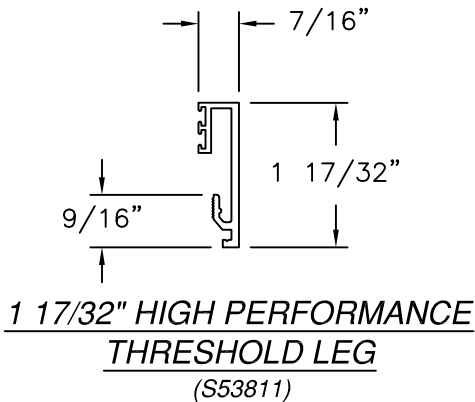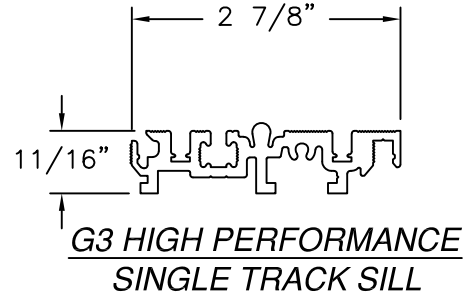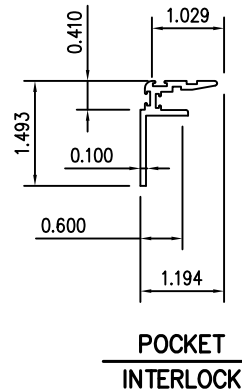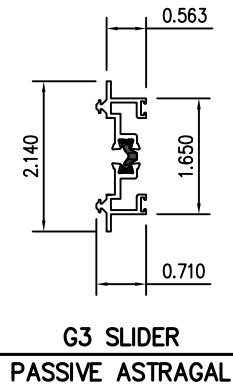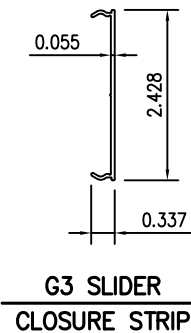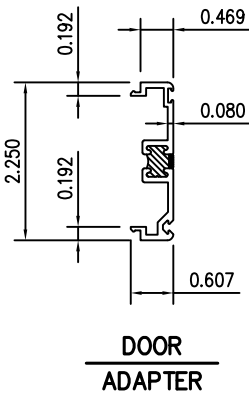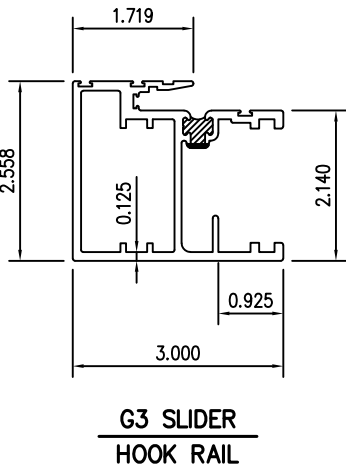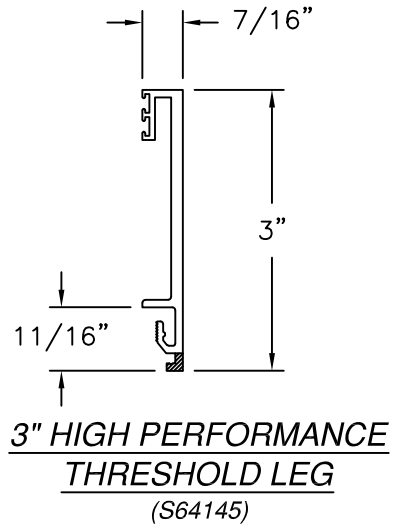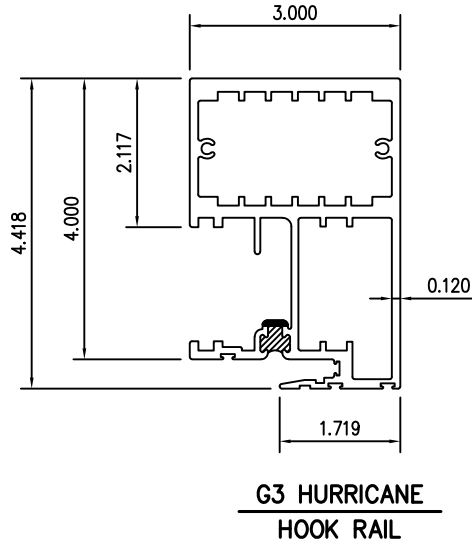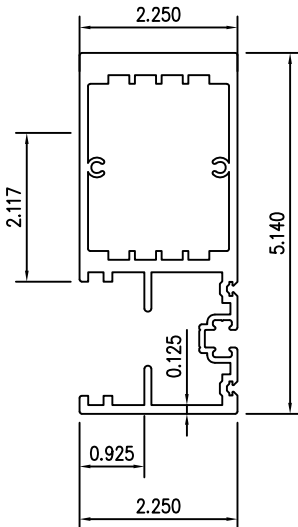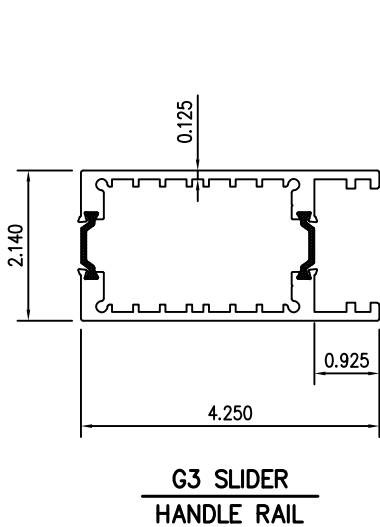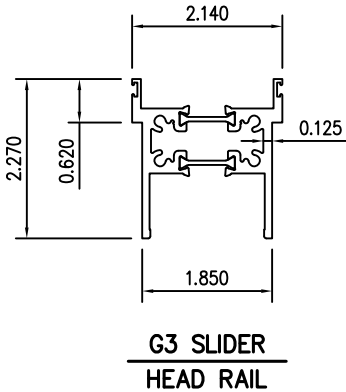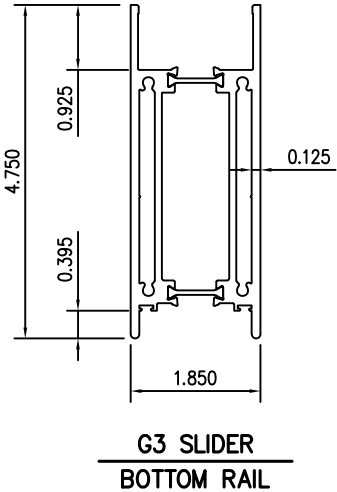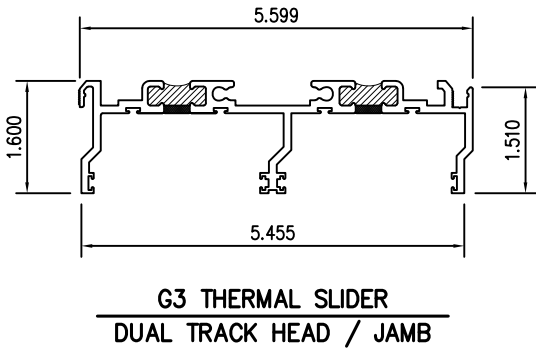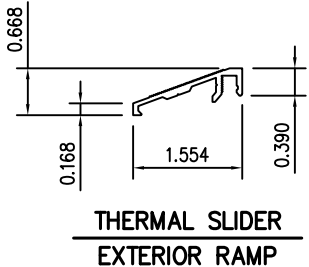

SOLAR INNOVATIONS, INC.

31 ROBERTS RD
PINE GROVE, PA 17963

SERIES SI8000 G-3 MULTI TRACK
ALUMINUM SLIDING GLASS DOOR NON-IMPACT
COMPONENTS

DRAWN:
N.G.

DWG NO.
08-02620

REV
F

SCALE
NTS

DATE
01/27/15


SHEET
11 OF 11

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/16/2026

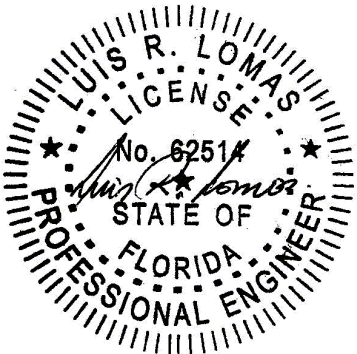

Luis R. Lomas P.E.
FL No.: 62514