





5200 W. CENTURY BLVD.
LOS ANGELES, CA 90045

OPAQUE FIBERGLASS DOORS SINGLES w/ or w/o SIDELITES INSWING / OUTSWING "NON-IMPACT"


GENERAL NOTES

- This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
- Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
- When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
- For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
- Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details
3	Sidelite panel details
4	Elevations
5	Horizontal cross sections
6	Horizontal & Vertical Cross Sections (2X Buck)
7	Horizontal & Vertical Cross Sections (1X Buck)
8	Horizontal & Vertical Cross Sections (Direct to Masonry)
9	Vertical Cross Sections (Thresholds)
10	Horizontal & Vertical Cross Sections (Direct to Masonry)
11	Buck anchoring
12	Frame anchoring & hardware details
13	Lite frame glazing details
14	Bill of materials and components

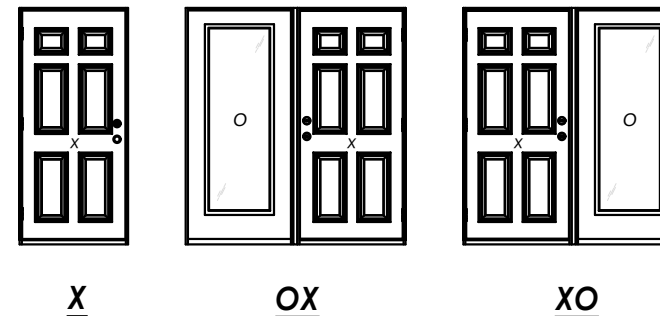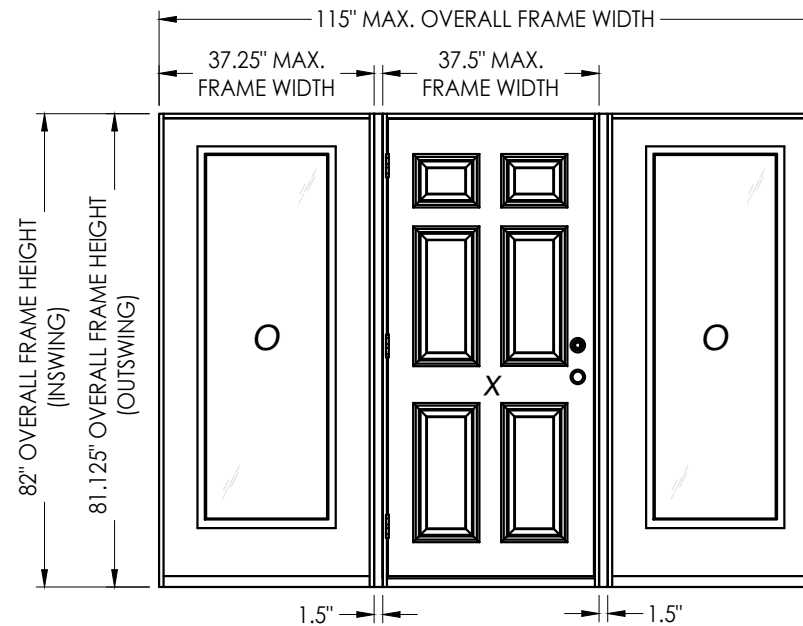

CONFIGURATION	MAX. FRAME DIMENSION	JAMB REINFORCEMENT	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
			POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	37.5" x 82.0"	N/A	+60.0	-65.0	+60.0	-60.0
OX/XO	74.75" x 82.0"	N/A	+47.0	-47.0	+47.0	-47.0
	75.5" x 82.0"	1X	+47.0	-47.0	+47.0	-47.0
	76.25" x 82.0"	2X	+47.0	-47.0	+47.0	-47.0
OXO	112.0" x 82.0"	N/A	+47.0	-47.0	+47.0	-47.0
	113.5" x 82.0"	1X	+47.0	-47.0	+47.0	-47.0
	115.0" x 82.0"	2X	+47.0	-47.0	+47.0	-47.0

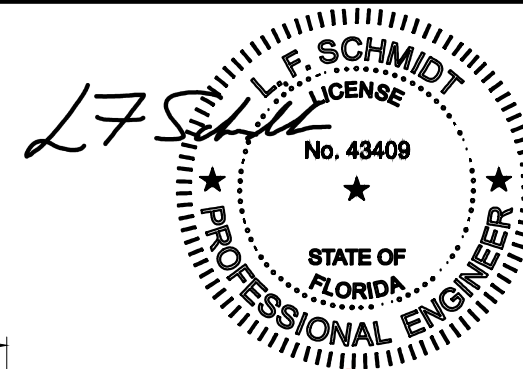

Digitally signed by Lyndon F Schmidt
Date: 2023.08.16 11:43:54 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-17347.9

SHEET 1 OF 14


REVISIONS

NO.	DATE	BY
4	8/10/23	LFS
3	8/05/20	DAC
2	7/27/17	JK
1	04/14/15	JK


Building Consultants, Inc.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2014 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Plastpro\FL-17347 R6\FL-17347.9-10.dwg

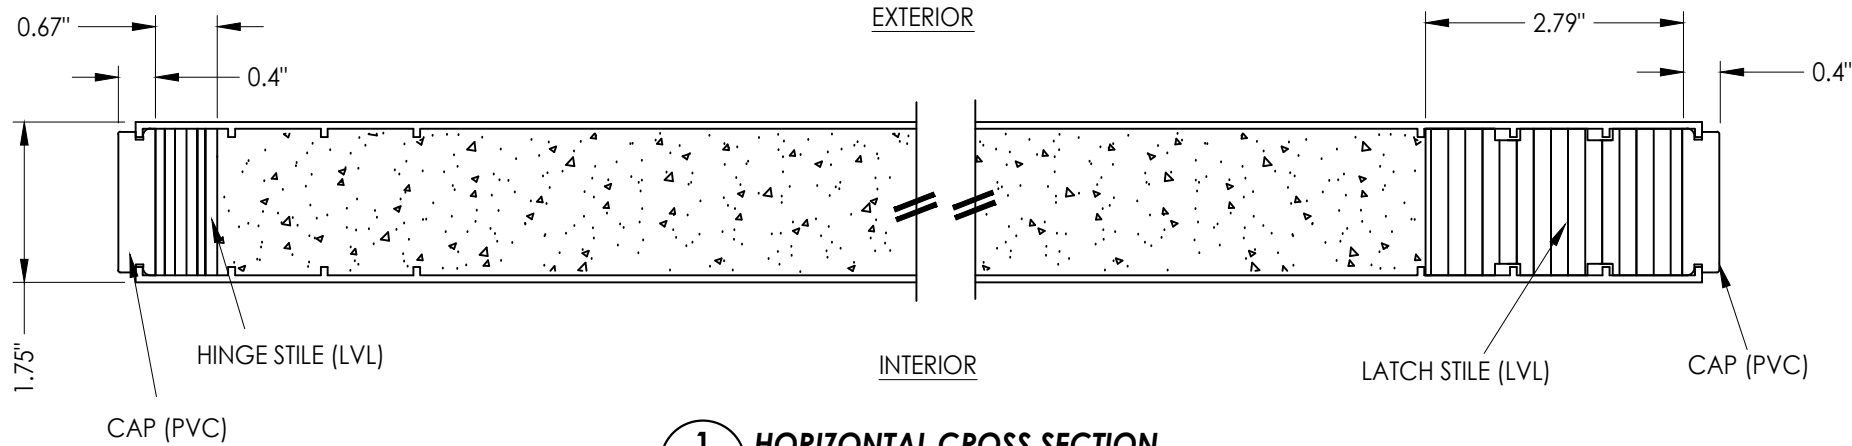


1
2 **HORIZONTAL CROSS SECTION**

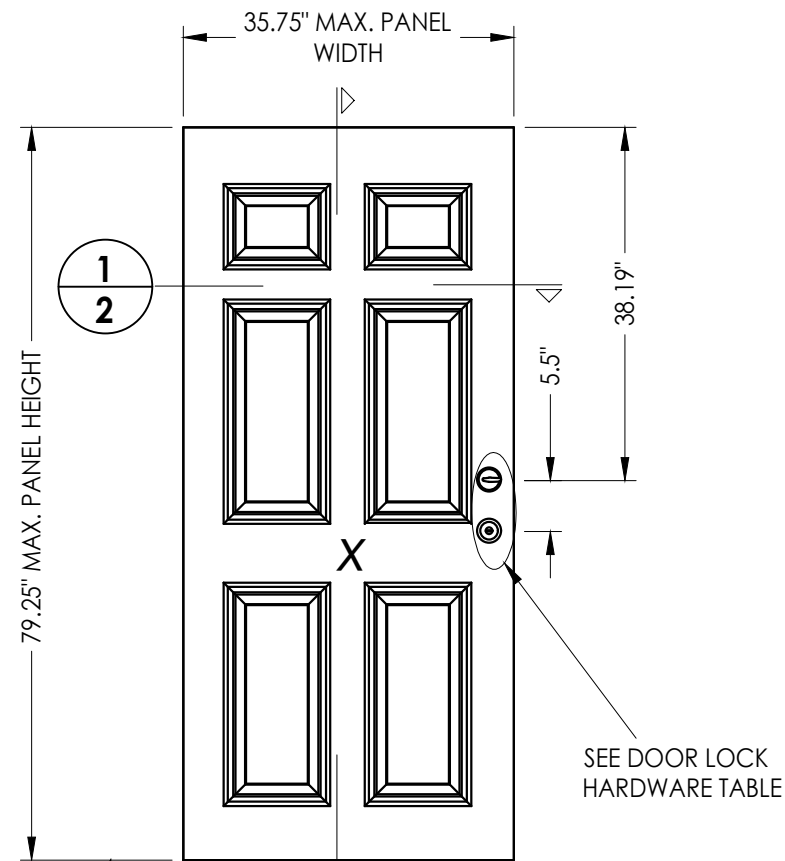

2
2 **PLASTPRO DOOR PANEL**
40



DOOR LOCK HARDWARE TABLE		
MANUFACTURER	MODEL	
KWIKSET	KNOB:	SERIES (400)
	DEADBOLT:	SERIES (660)
SCHLAGE	HANDLE SET:	"F" SERIES (F60)
	DEADBOLT:	"F" SERIES (F60)
SCHLAGE	KNOB:	"F" SERIES (F10)
	DEADBOLT:	"B" SERIES (B60/62)
YALE	KNOB:	CIRRUS 100 C
	DEADBOLT:	820 SINGLE CYLINDER
DEXTER BY SCHLAGE	KNOB:	J54
	DEADBOLT:	JD60

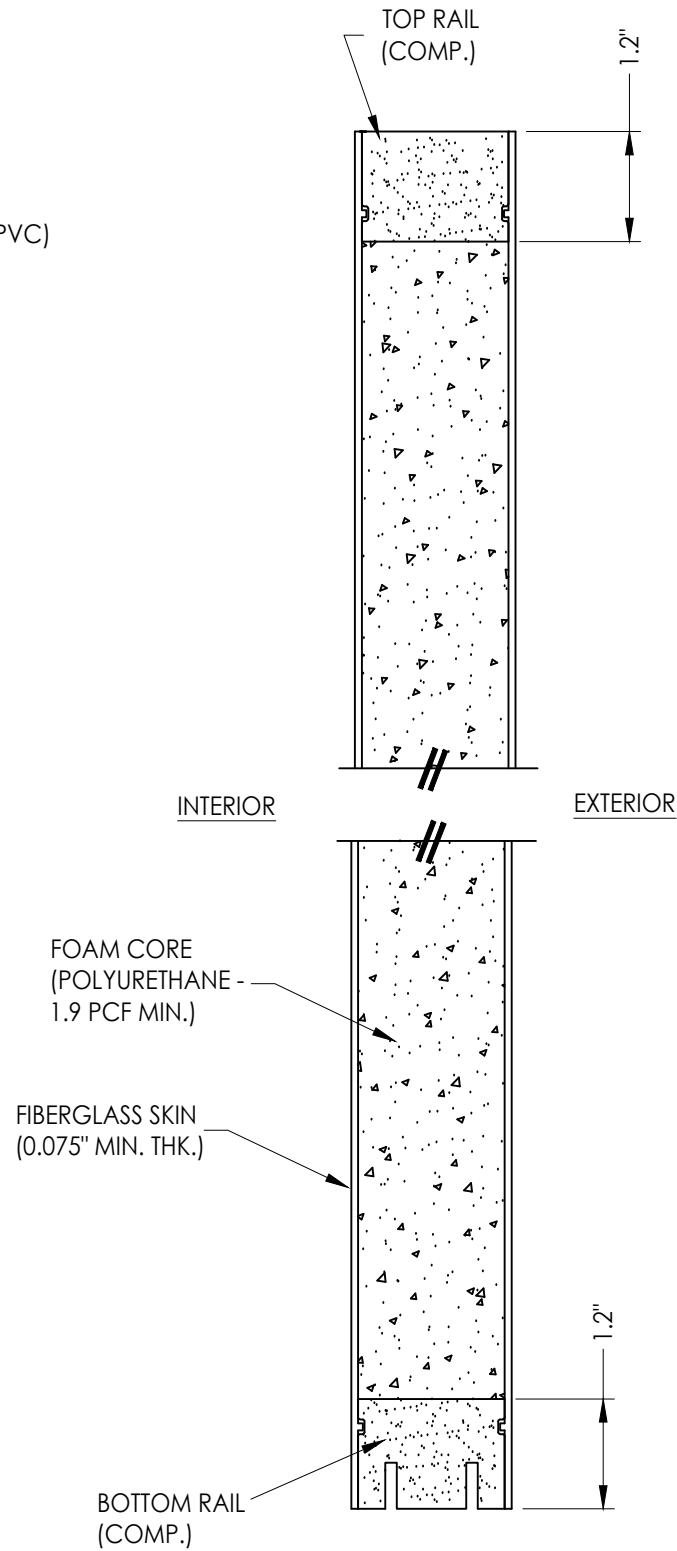


2
2 **VERTICAL CROSS SECTION**

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: PLASTPRO IND FIBERGLASS DOOR		PART OR ASSEMBLY: DOOR PANEL DETAILS		REVISONS			
4	8/10/23	UPDATE TO 8TH ED. (2023)	FBC	LFS			
3	8/05/20	UPDATE TO 7TH ED. (2020)	FBC	DAC			
2	7/27/17	UPDATE TO 6TH ED. (2017)	FBC	JK			
1	04/14/15	UPDATE TO 5TH ED. (2014)	FBC	JK			
	NO.	DATE		BY			
DATE: 10/08/14							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-17347.9							
SHEET 2 OF 14							



Z:\2023 FBC Drawings\Plastpro\FL-17347 R6\FL-17347.9-10.dwg

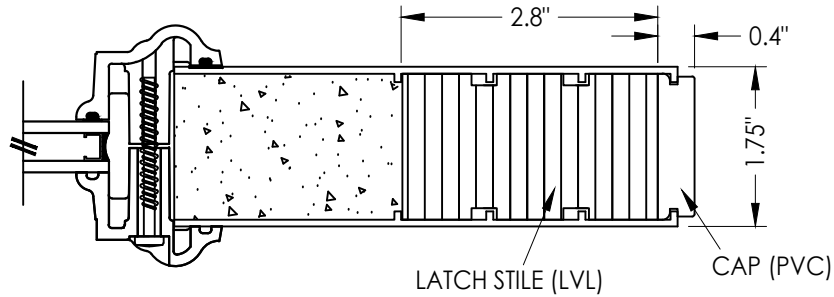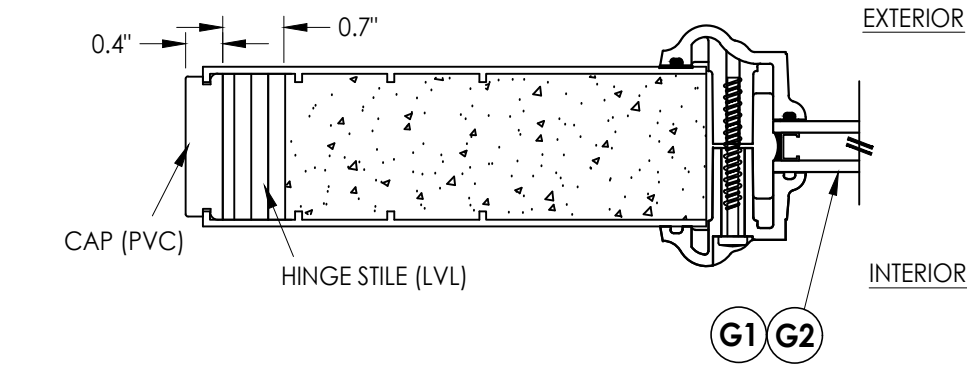

1
3 HORIZONTAL CROSS SECTION

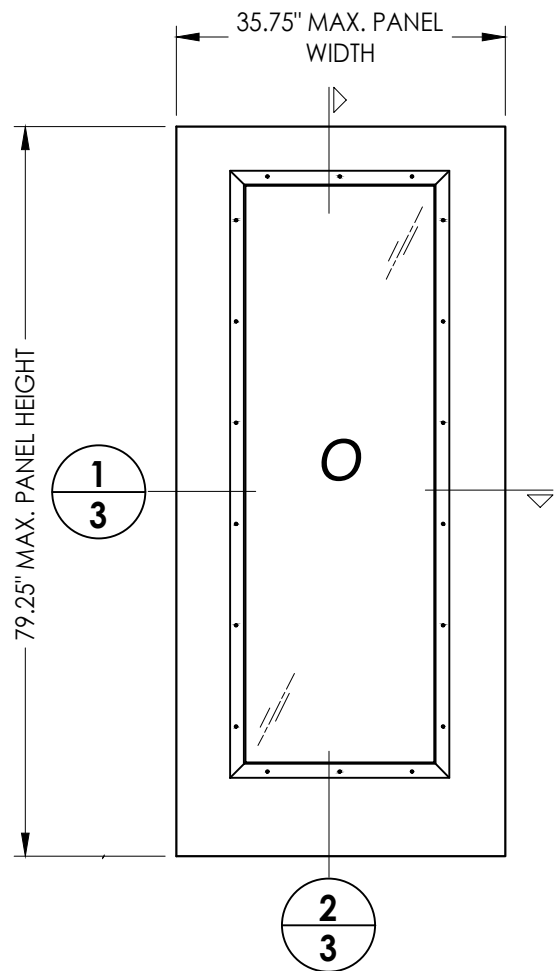

50 PLASTPRO SIDELITE PANEL

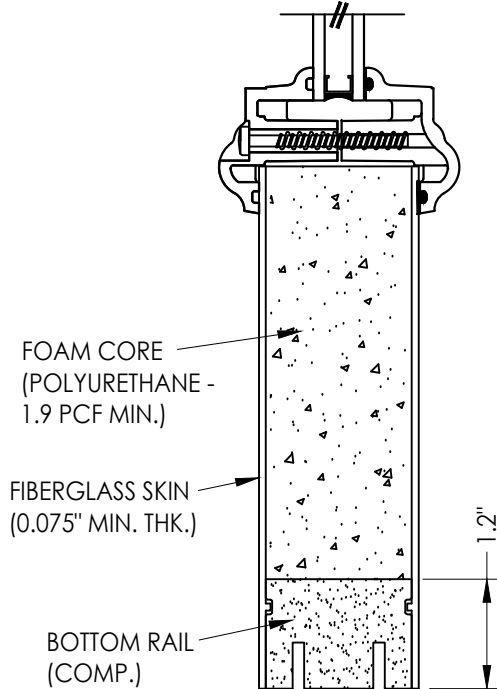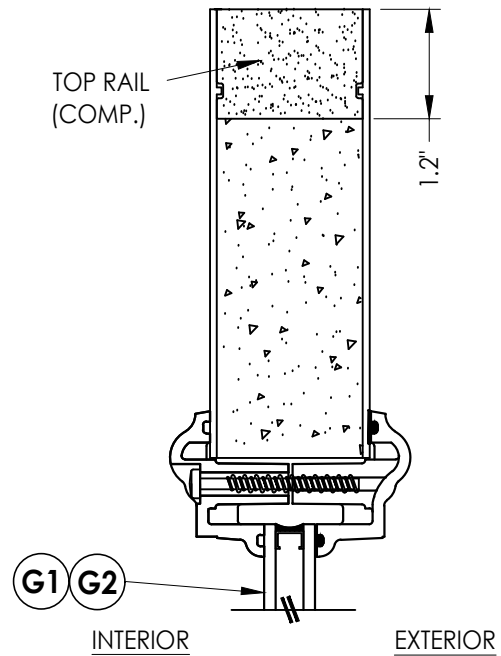

2
3 VERTICAL CROSS SECTION

NO.	DATE	REVISIONS
4	8/10/23	UPDATE TO 8TH ED. (2023) FBC
3	8/05/20	UPDATE TO 7TH ED. (2020) FBC
2	7/27/17	UPDATE TO 6TH ED. (2017) FBC
1	04/14/15	UPDATE TO 5TH ED. (2014) FBC
NO.	DATE	BY

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-17347.9

SHEET 3 OF 14

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


PRODUCT:
PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:


SIDELITE
PANEL DETAILS

RW BUILDING CONSULTANTS, INC.


P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

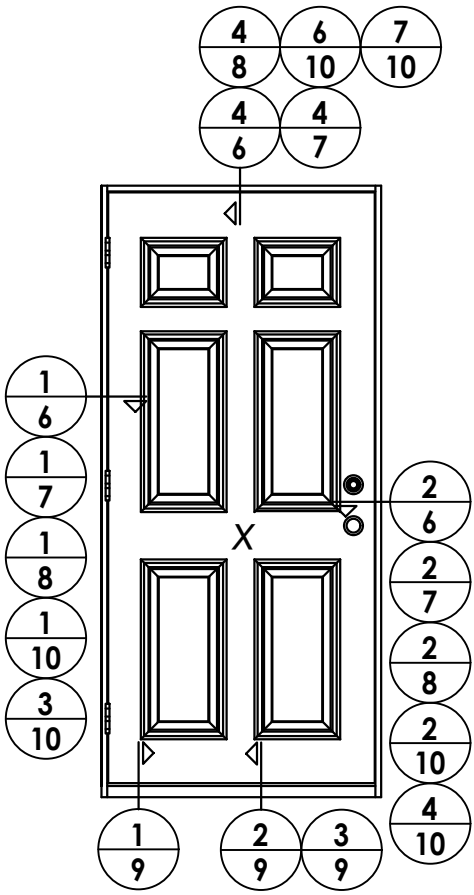

ELEVATION
X

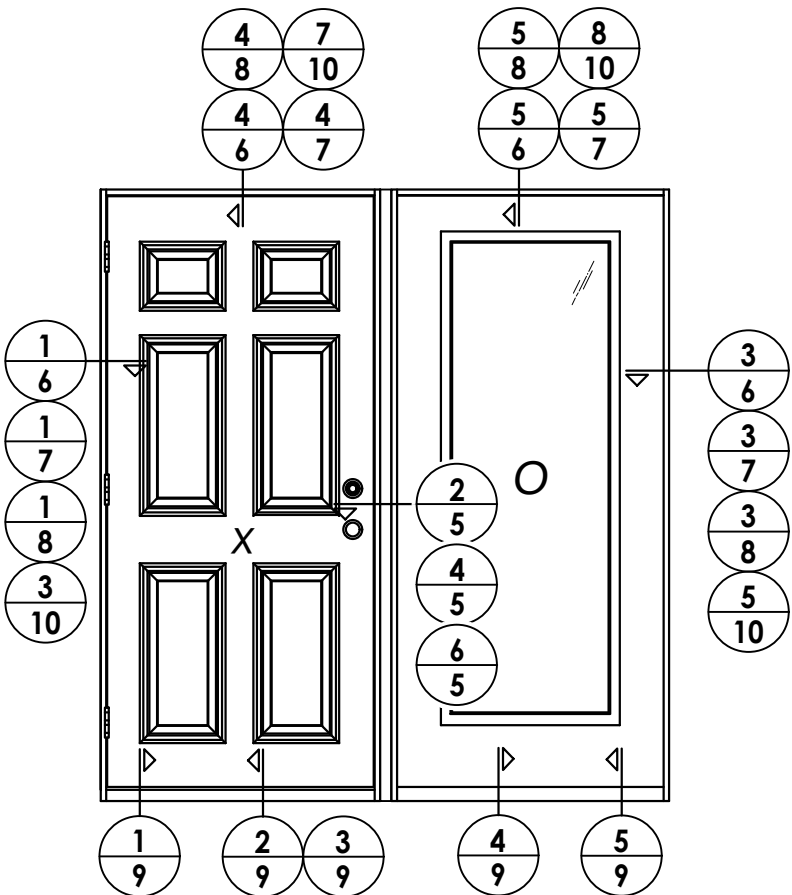

ELEVATION
XO / OX

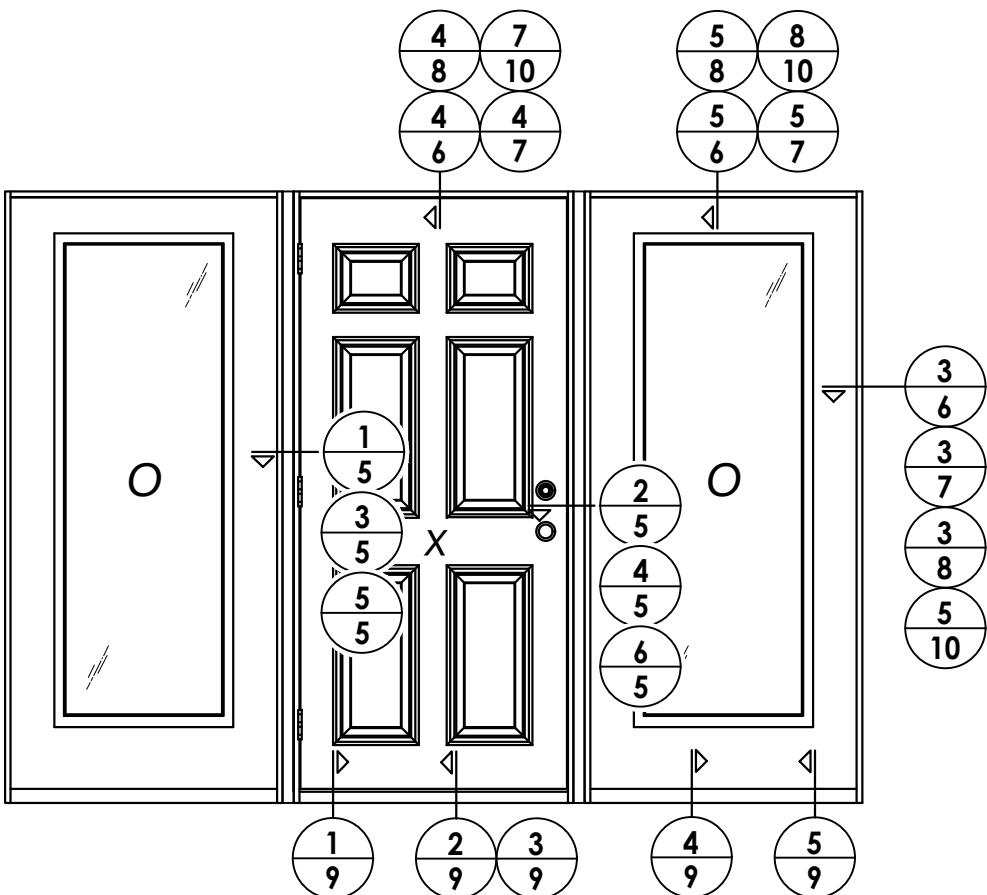

ELEVATION
OXO

NO.	DATE	REVISIONS
4	8/10/23	UPDATE TO 8TH ED. (2023) FBC
3	8/05/20	UPDATE TO 7TH ED. (2020) FBC
2	7/27/17	UPDATE TO 6TH ED. (2017) FBC
1	04/14/15	UPDATE TO 5TH ED. (2014) FBC
		BY JK

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-17347.9

SHEET 4 OF 14


PRODUCT:
PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
ELEVATIONS



Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Plastpro\FL-17347 R6\FL-17347.9-10.dwg

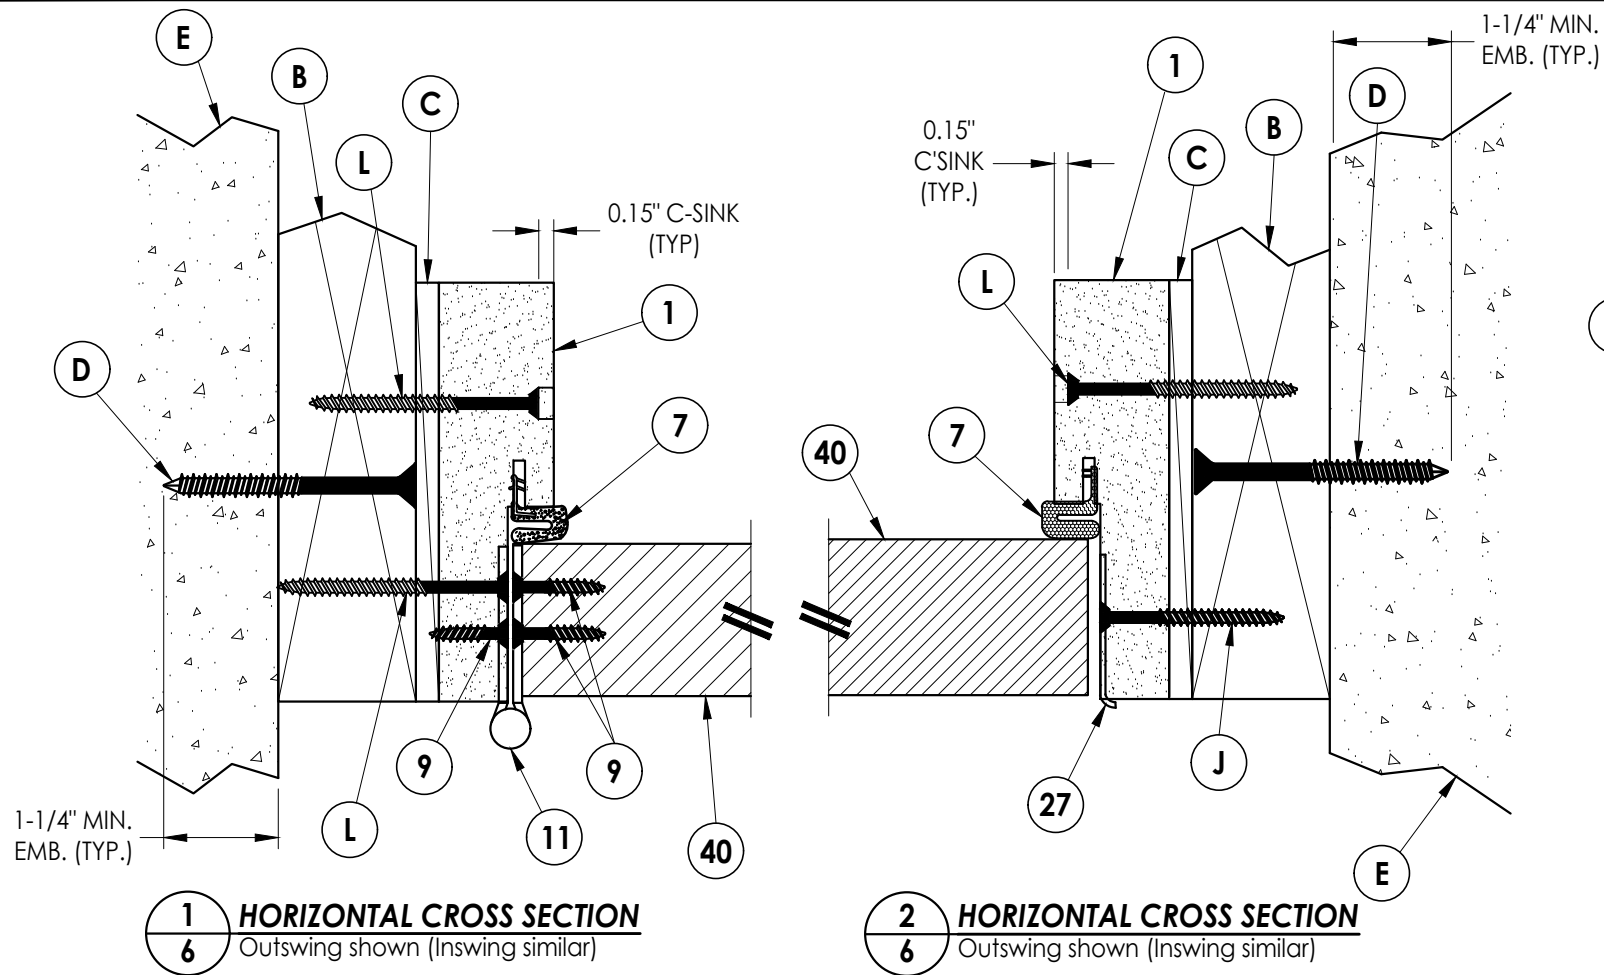

- NOTE:
- Spacing for item L: 6" from each end and 3 more equally spaced along sidelite jamb (5 total).
 - Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

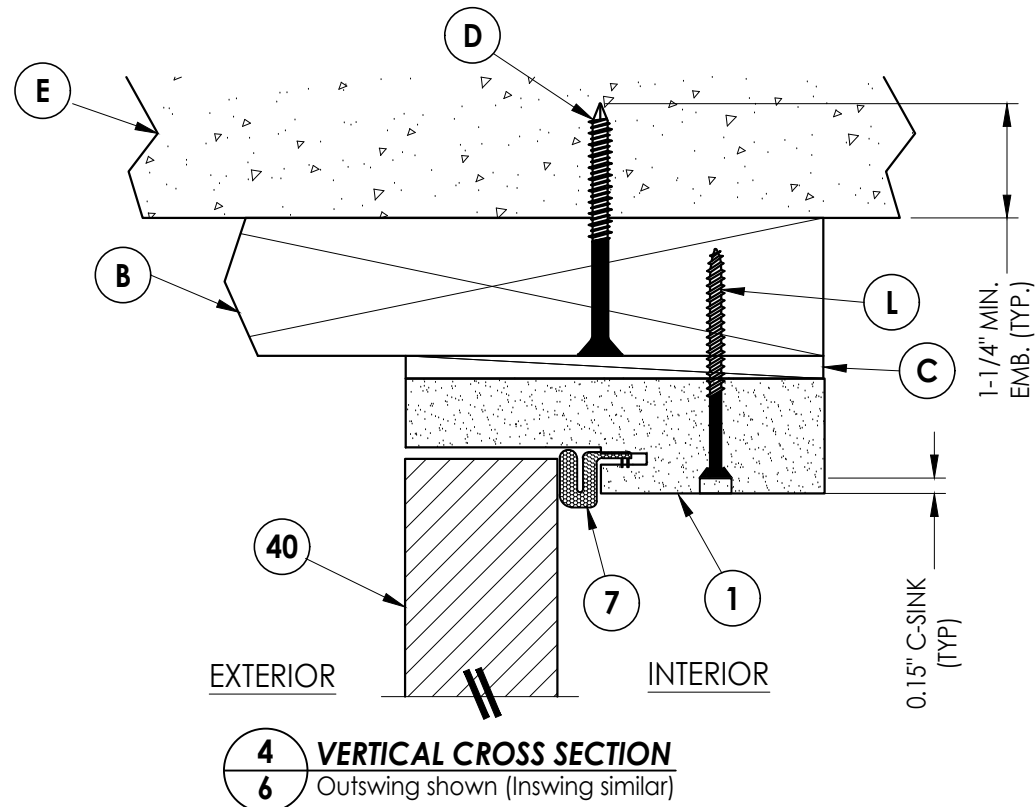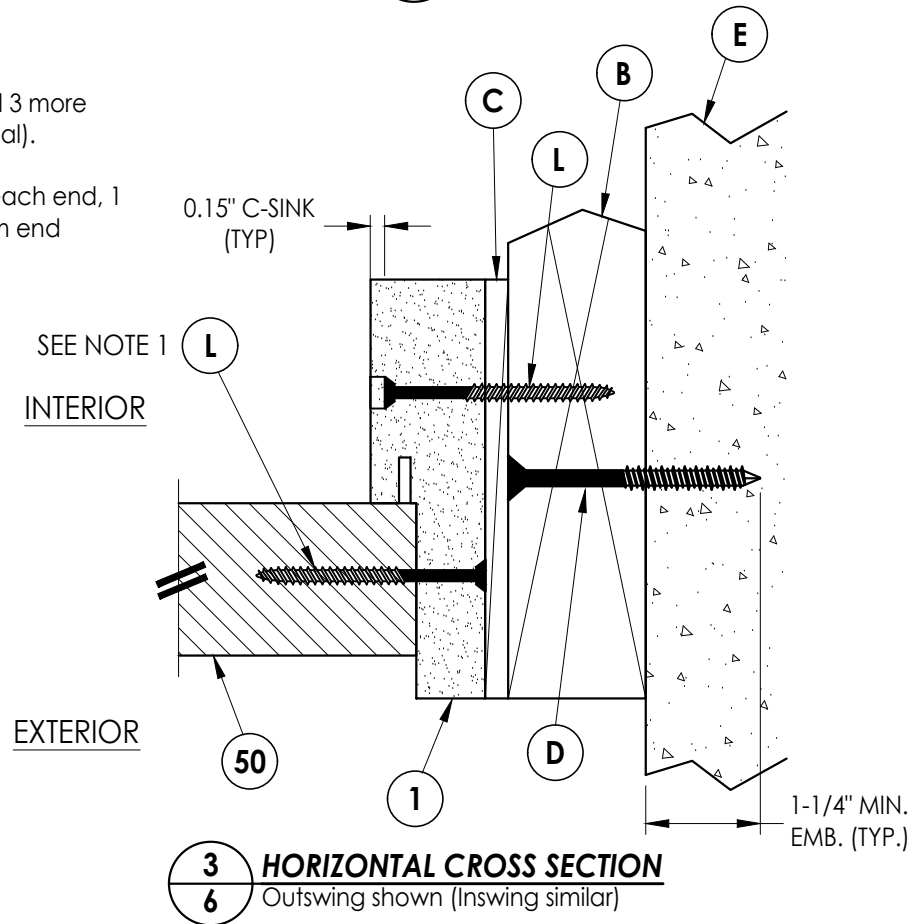

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

NO.	DATE	REVISIONS			
		DATE	BY	CHK	APP
4	8/10/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
3	8/05/20	UPDATE TO 7TH ED. (2020)	FBC	DAC	
2	7/27/17	UPDATE TO 6TH ED. (2017)	FBC	JK	
1	04/14/15	UPDATE TO 5TH ED. (2014)	FBC	JK	

DATE: 10/08/14

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-17347.9

SHEET 6 OF 14


Z:\2023 FBC Drawings\Plastpro\FL-17347 R6\FL-17347.9-10.dwg

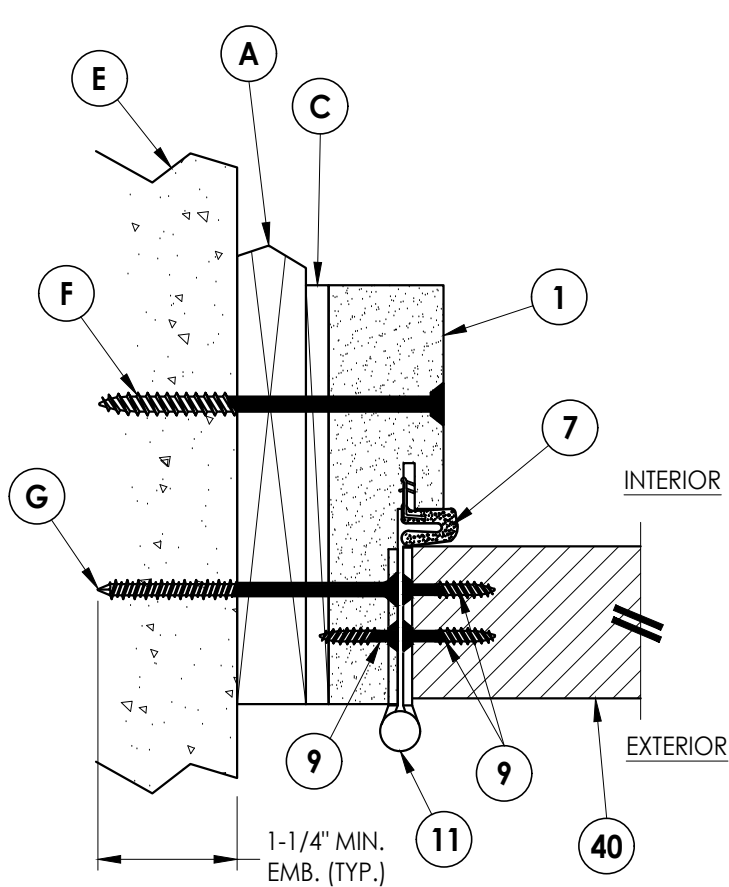


1
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

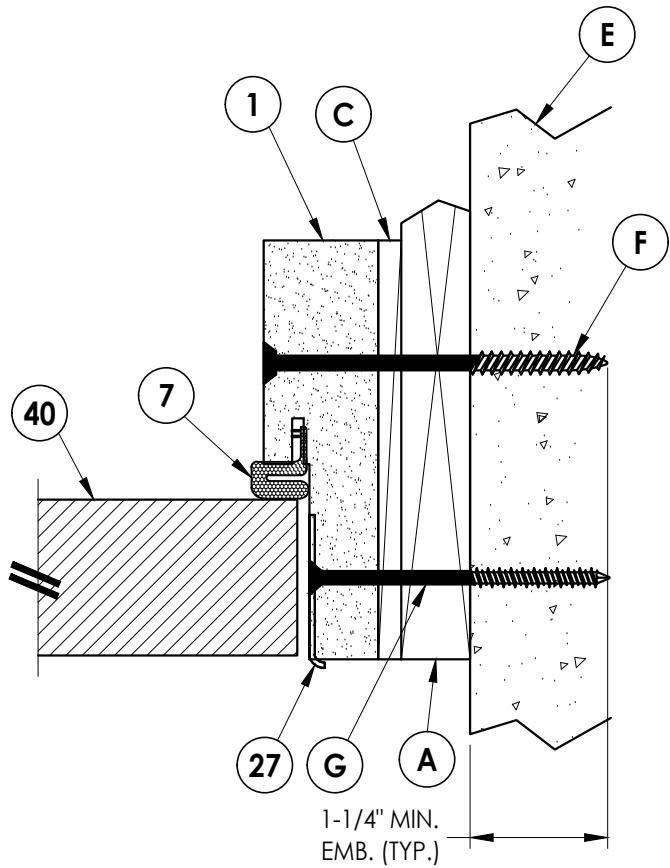


2
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

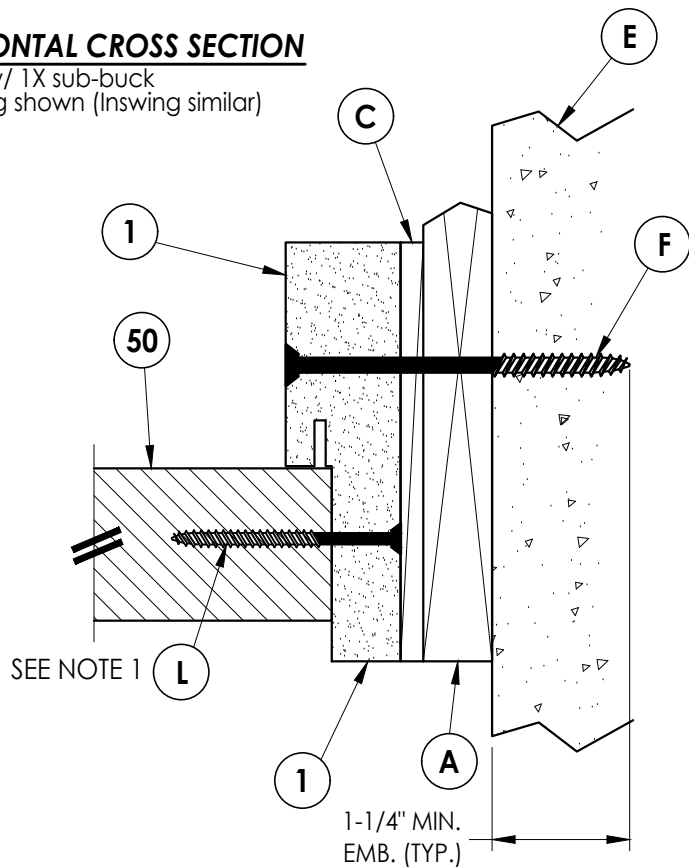

3
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

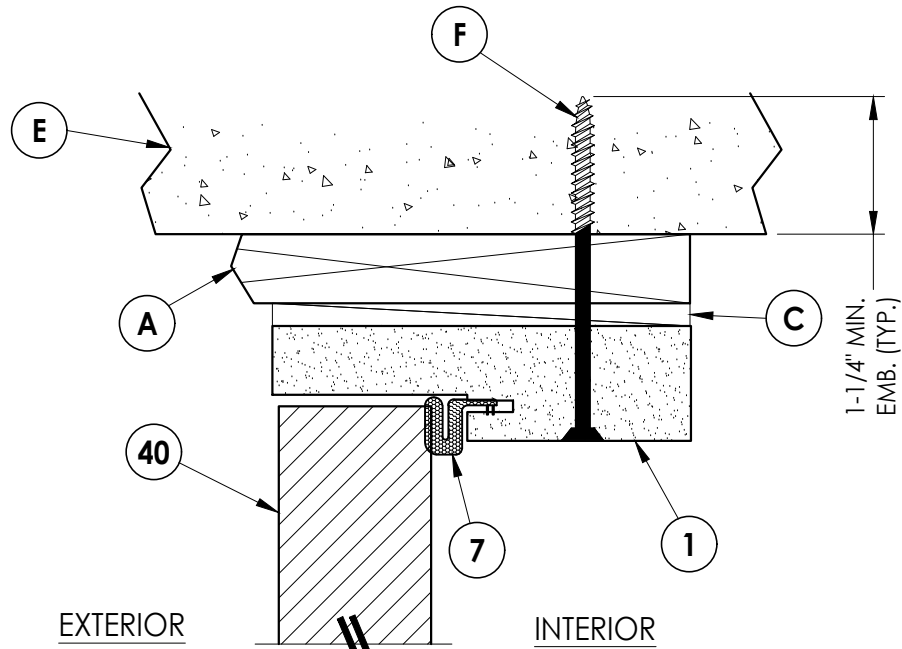

4
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

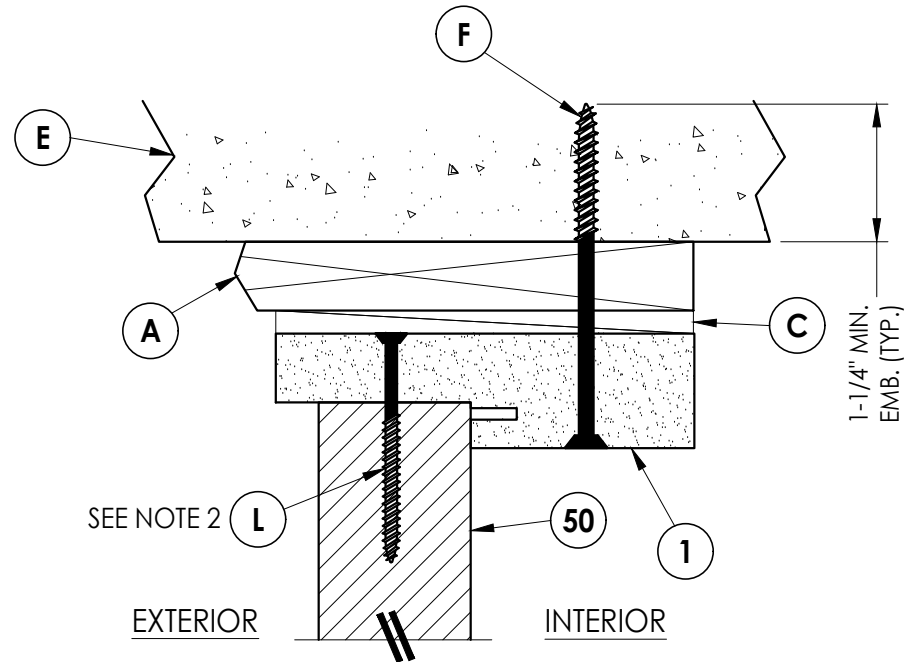

5
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

- NOTE:
1. Spacing for item L: 6" from each end and 3 more equally spaced along sidelite jamb (5 total).
 2. Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS
4	8/10/23	UPDATE TO 8TH ED. (2023) FBC
3	8/05/20	UPDATE TO 7TH ED. (2020) FBC
2	7/27/17	UPDATE TO 6TH ED. (2017) FBC
1	04/14/15	UPDATE TO 5TH ED. (2014) FBC

DATE: 10/08/14

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:
FL-17347.9

SHEET 7 OF 14


Z:\2023 FBC Drawings\Plastpro\FL-17347 R6\FL-17347.9-10.dwg

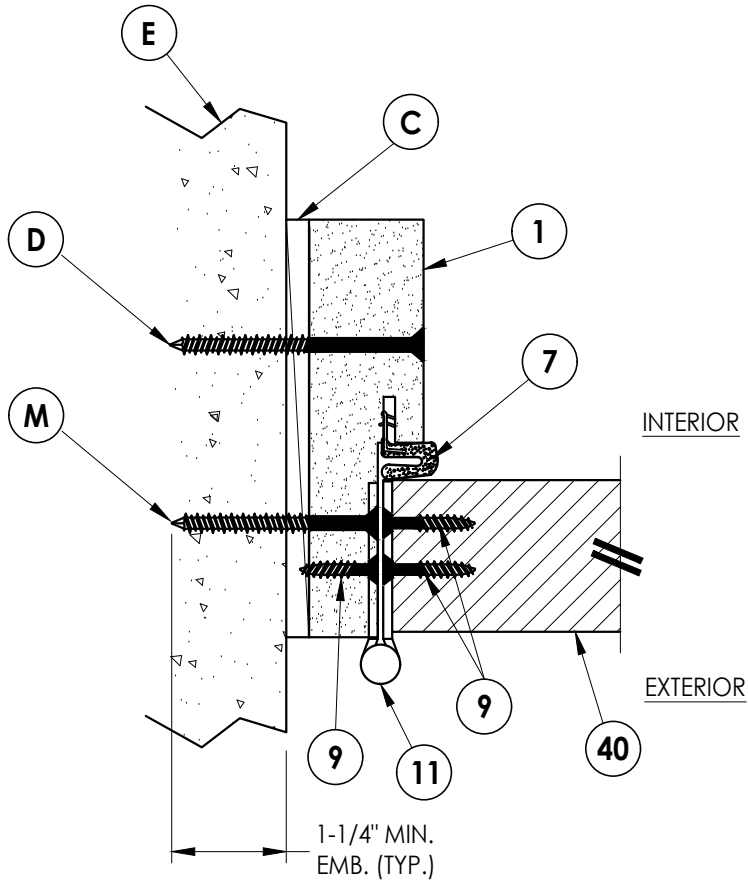


1
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

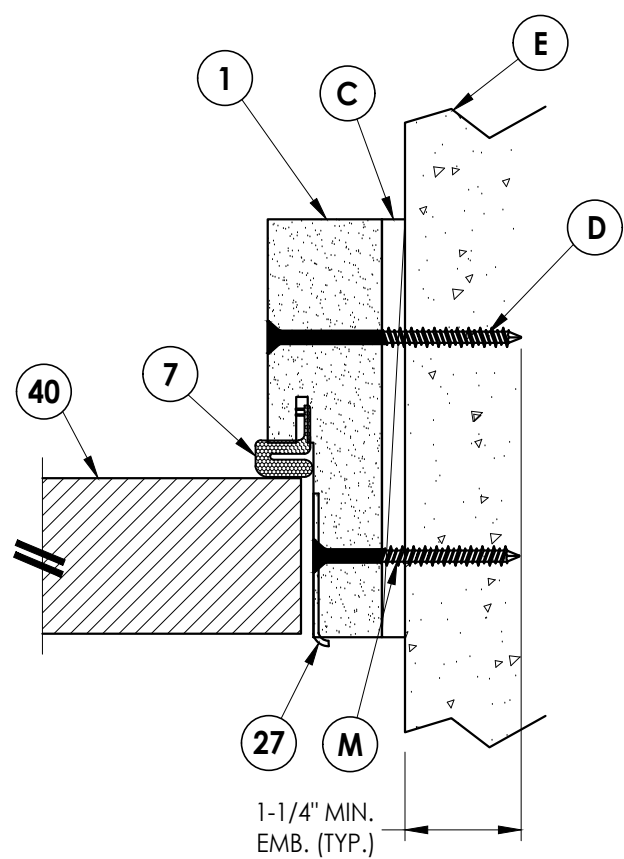


2
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

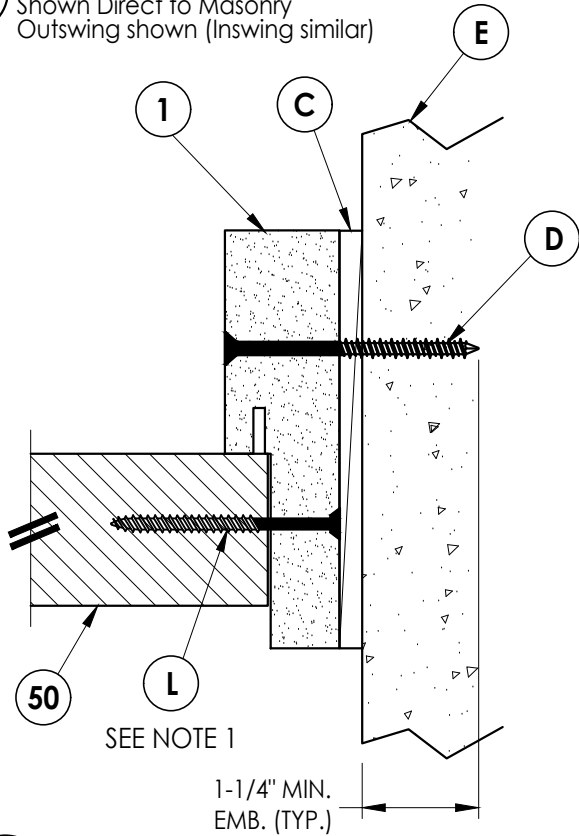

3
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

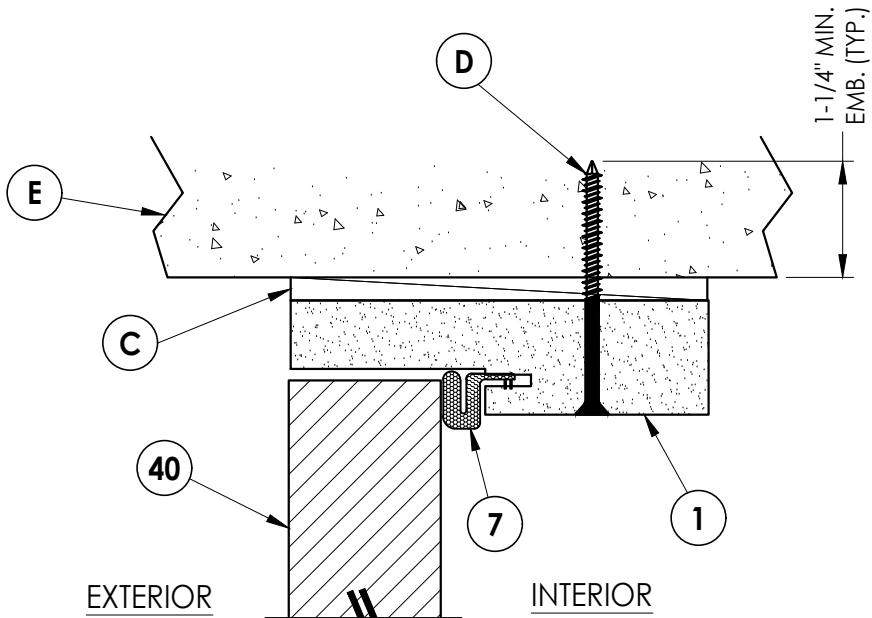

4
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

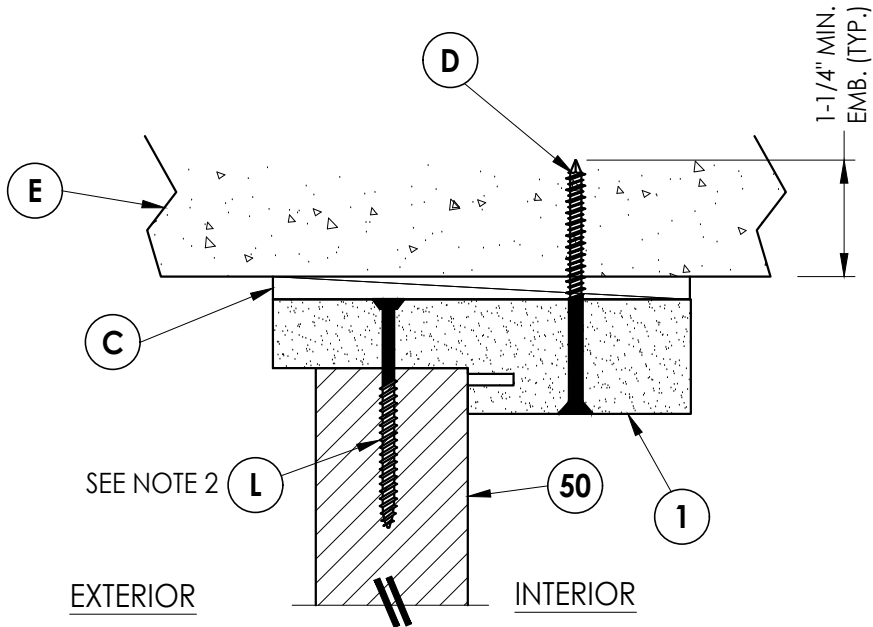

5
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

NOTE:

1. Spacing for item L: 6" from each end and 3 more equally spaced along sidelite jamb (5 total).
2. Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL CROSS
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS			
		DATE	BY	CHK	APP
4	8/10/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
3	8/05/20	UPDATE TO 7TH ED. (2020)	FBC	DAC	
2	7/27/17	UPDATE TO 6TH ED. (2017)	FBC	JK	
1	04/14/15	UPDATE TO 5TH ED. (2014)	FBC	JK	

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-17347.9

SHEET 8 OF 14


Z:\2023 FBC Drawings\Plastpro\FL-17347 R6\FL-17347.9-10.dwg

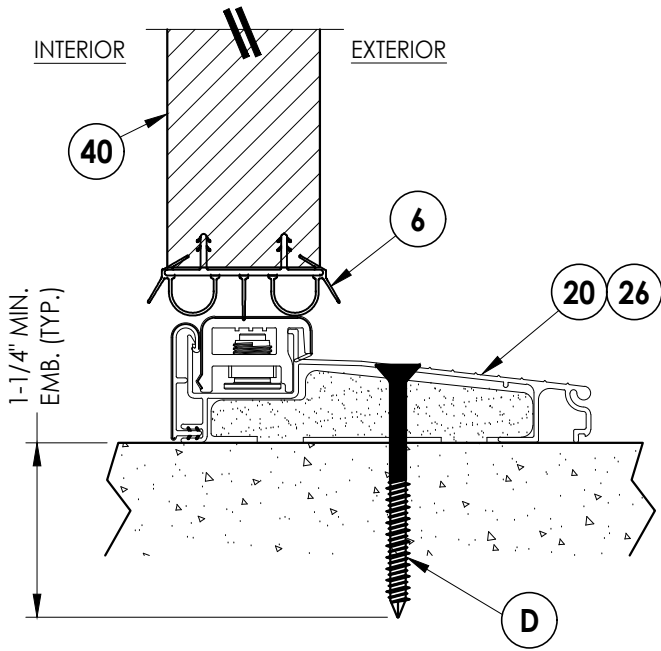


1
9 **VERTICAL CROSS SECTION**
Inswing sill

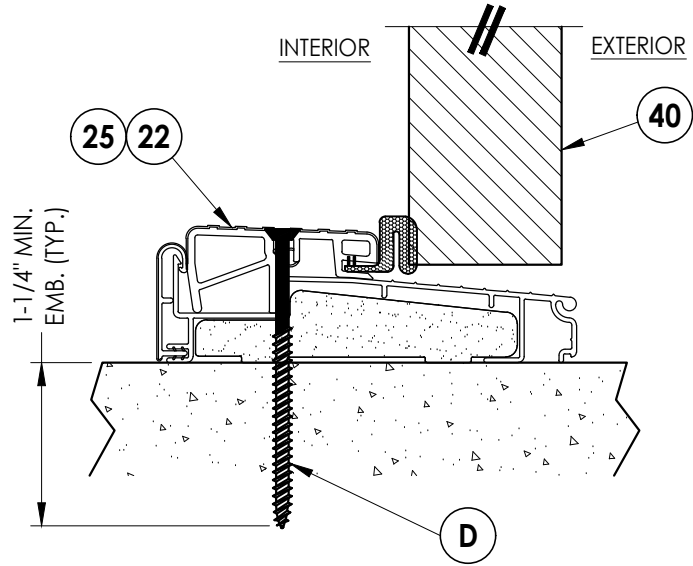


2
9 **VERTICAL CROSS SECTION**
Outswing sill

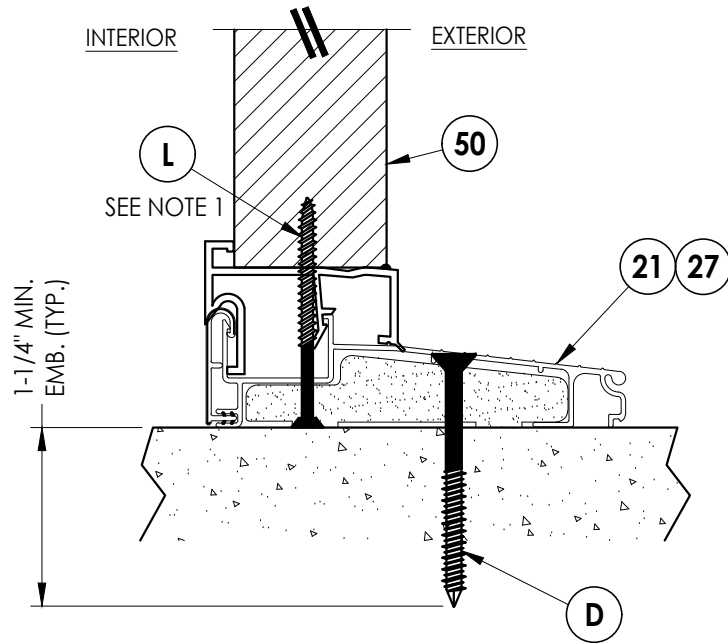

4
9 **VERTICAL CROSS SECTION**
Inswing sill

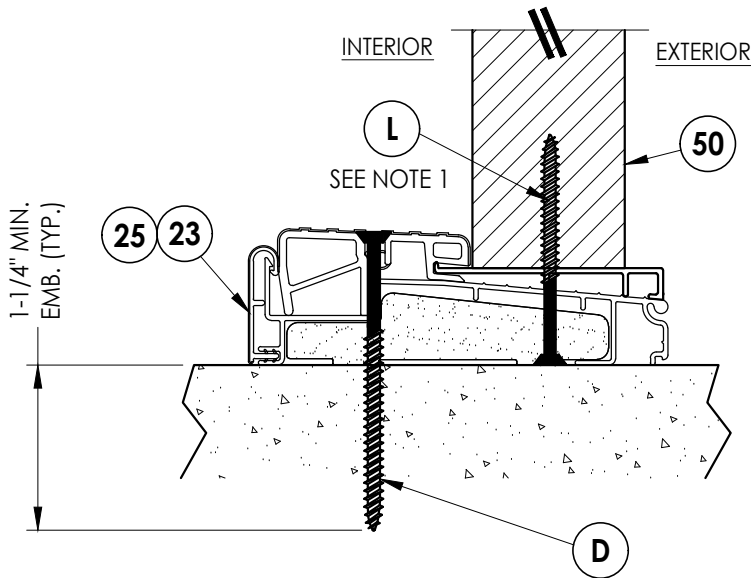

5
9 **VERTICAL CROSS SECTION**
Inswing sill

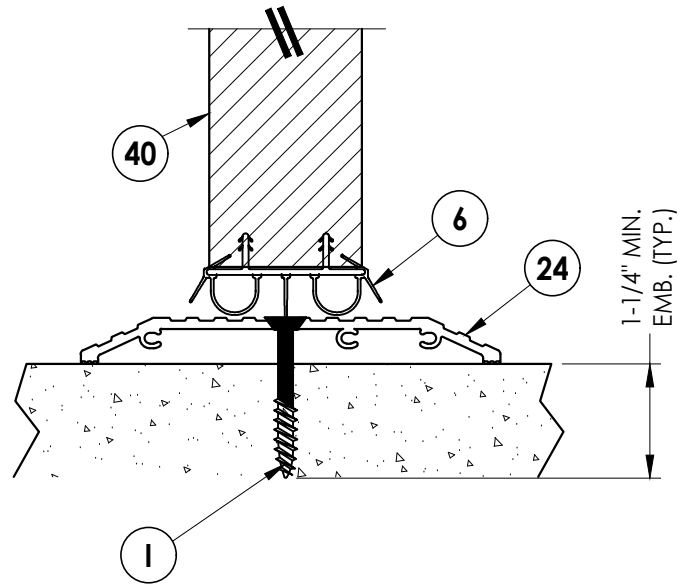

3
9 **VERTICAL CROSS SECTION**
ADA Sill

NOTE:
1. Spacing for item L @ head & sill: 6" from each end,
1 @ centerline, 2 additional at 3" & 4.5" from end
adjacent to door.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS				
		BY	JK	JK	DAC	LFS
4	8/10/23	UPDATE TO 8TH ED.	(2023)	FBC		
3	8/05/20	UPDATE TO 7TH ED.	(2020)	FBC		
2	7/27/17	UPDATE TO 6TH ED.	(2017)	FBC		
1	04/14/15	UPDATE TO 5TH ED.	(2014)	FBC		

DATE: 10/08/14


SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-17347.9

SHEET 9 OF 14

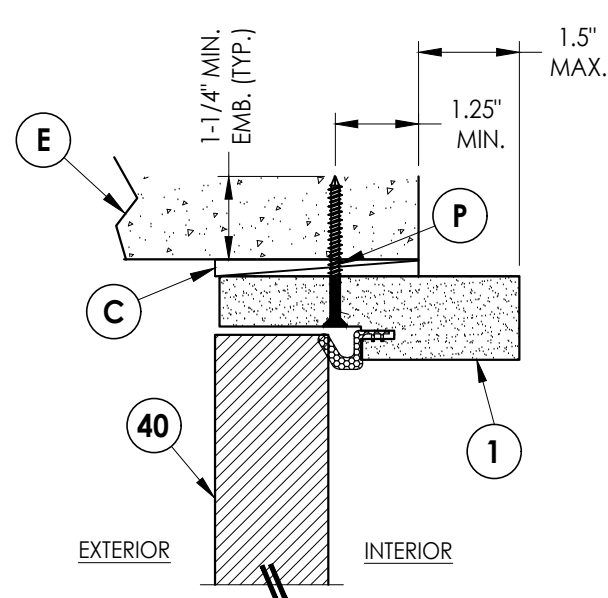


6 VERTICAL CROSS SECTION

10 Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb
Single door only (N/A W/ Sidelites)


NOTE:

1. Spacing for item L: 6" from each end and 3 more equally spaced along sidelite jamb (5 total).


2. Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

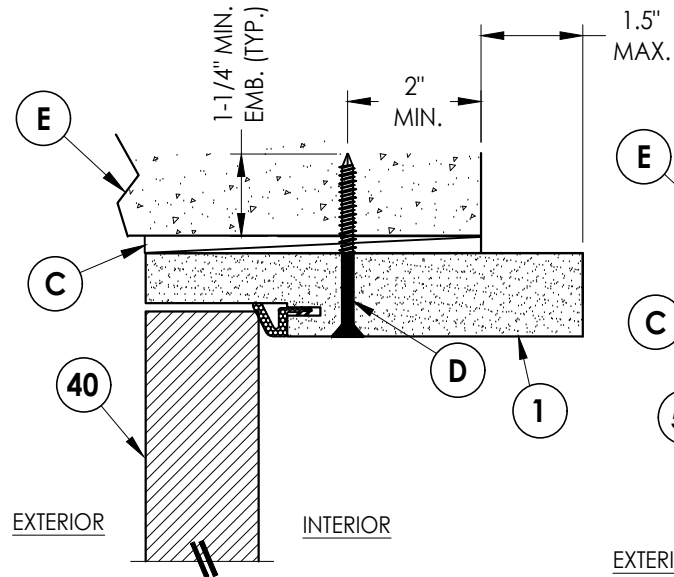


7 VERTICAL CROSS SECTION

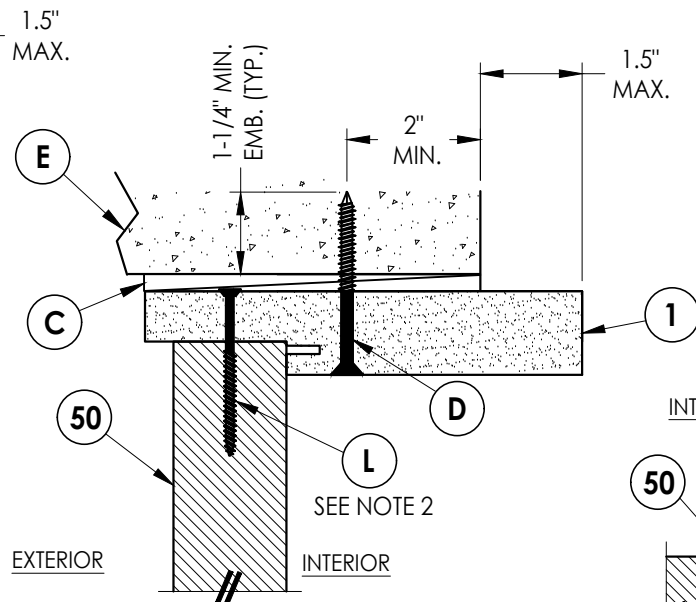


6 VERTICAL CROSS SECTION

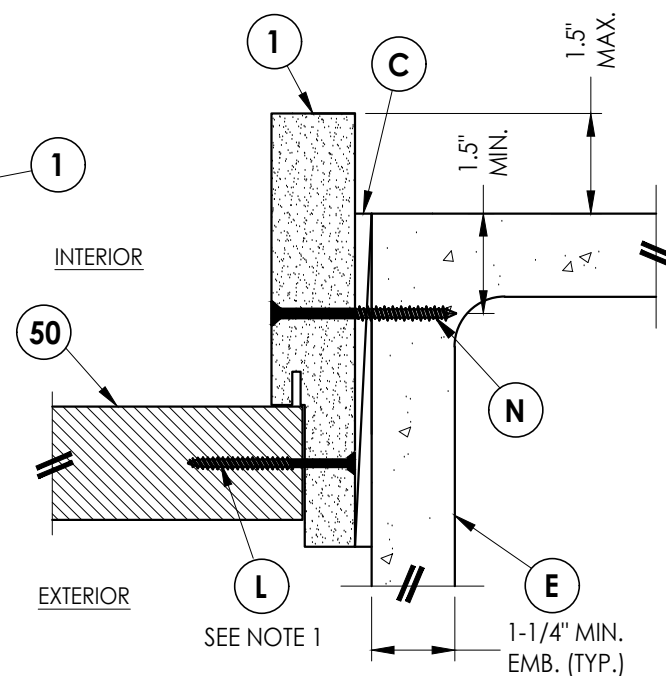


5 HORIZONTAL CROSS SECTION

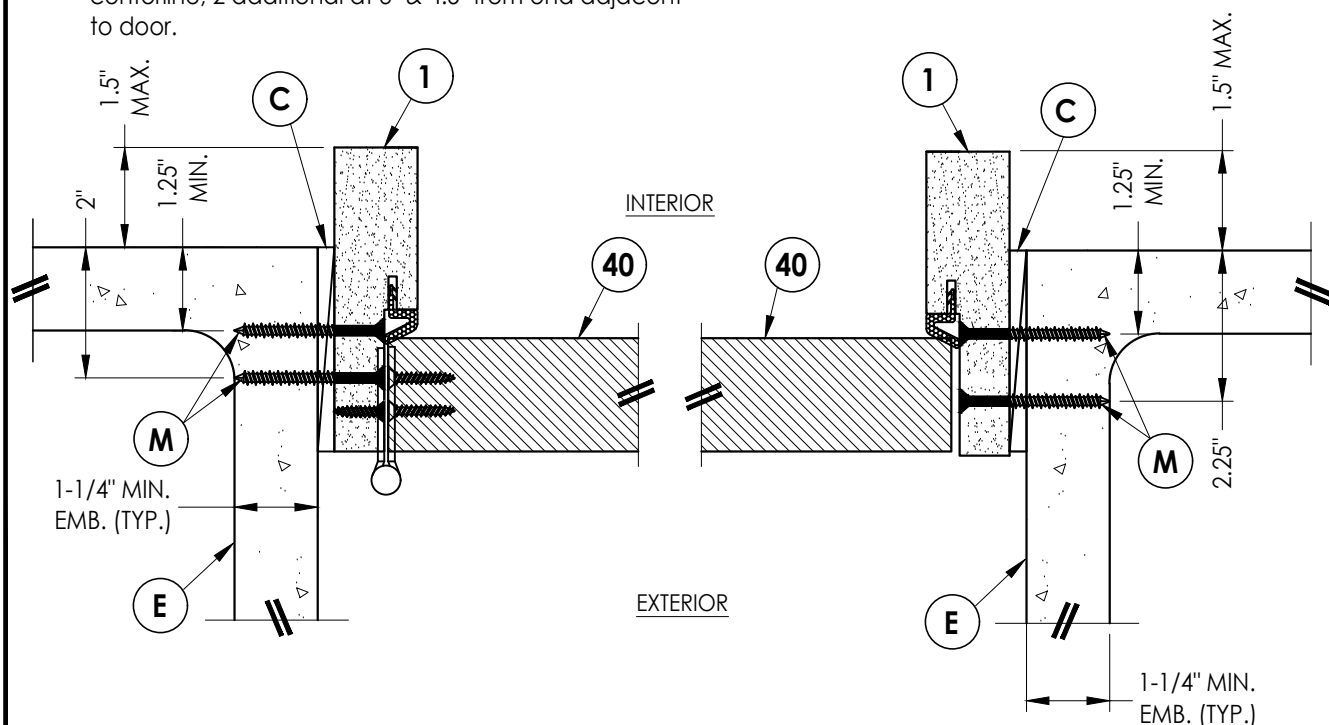


1 HORIZONTAL CROSS SECTION

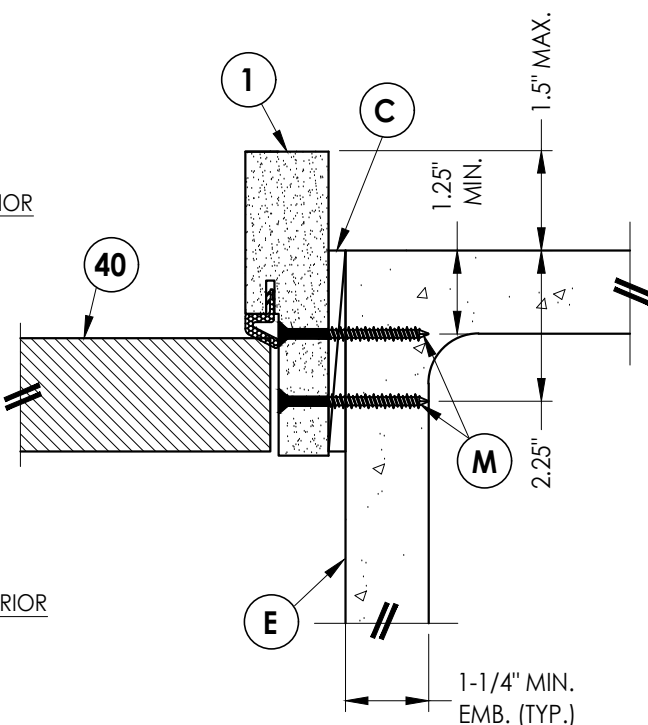

2 HORIZONTAL CROSS SECTION

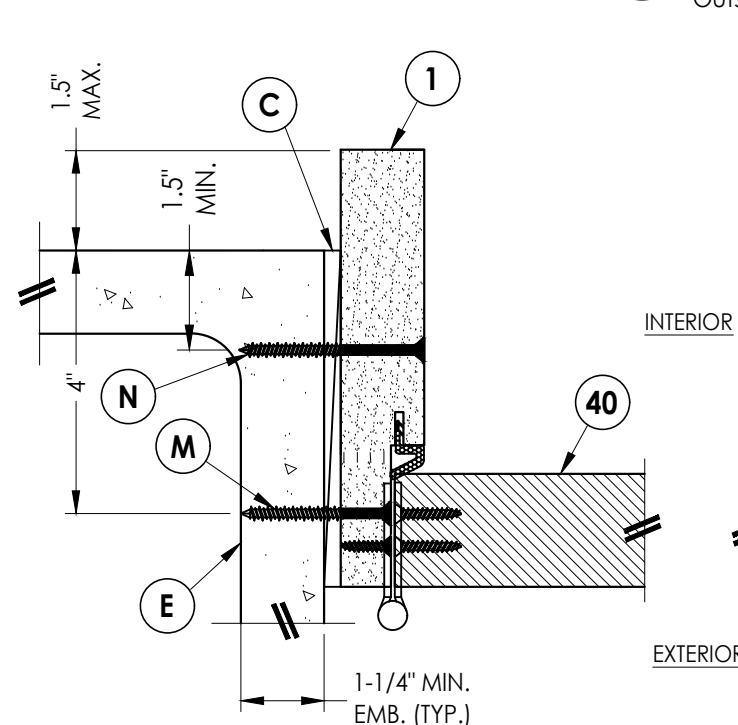


3 HORIZONTAL CROSS SECTION

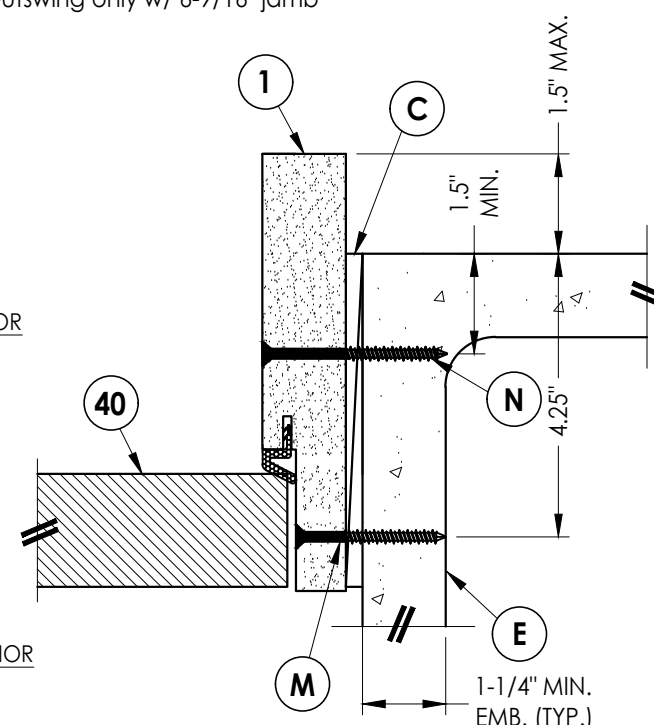


4 HORIZONTAL CROSS SECTION
10 Shown Direct to Masonry

												Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409	
												BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
												<i>RW</i>	
												PLASTPRO IND FIBERGLASS DOOR	
												PART OR ASSEMBLY: HORIZONTAL & VERTICAL SECTIONS (DIRECT TO MASONRY)	
4	8/10/23	UPDATE TO 8TH ED. (2023)	FBC	LFS									
3	8/05/20	UPDATE TO 7TH ED. (2020)	FBC	DAC									
2	7/27/17	UPDATE TO 6TH ED. (2017)	FBC	JK									
1	04/14/15	UPDATE TO 5TH ED. (2014)	FBC	JK									
NO.	DATE												
													REVISIONS
DATE: 10/08/14													
SCALE: N.T.S.													
DWG. BY: JK													
CHK. BY: LFS													
DRAWING NO.: FL-17347.9													
SHEET 10 OF 14													


Z:\2023 FBC Drawings\Plastpro\FL-17347 R6\FL-17347.9-10.dwg

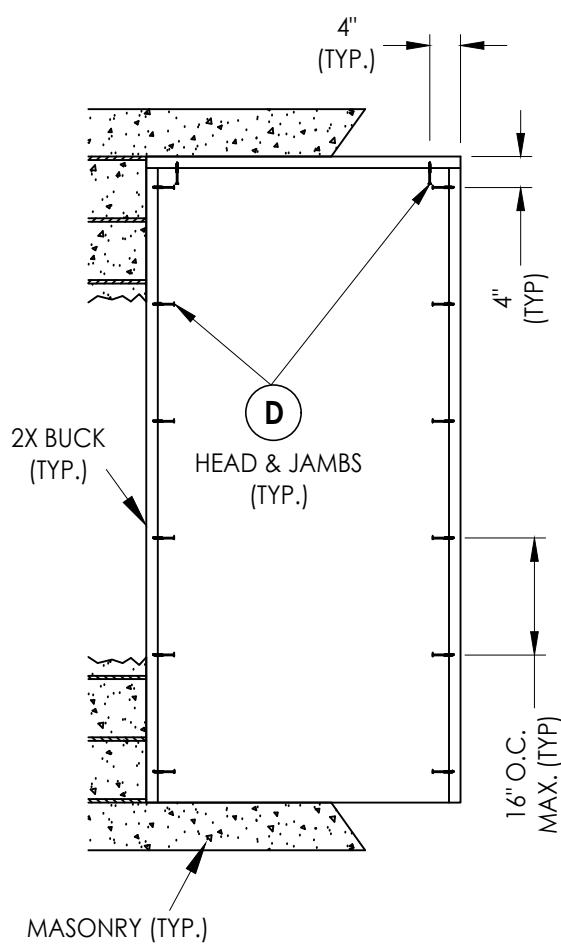

X

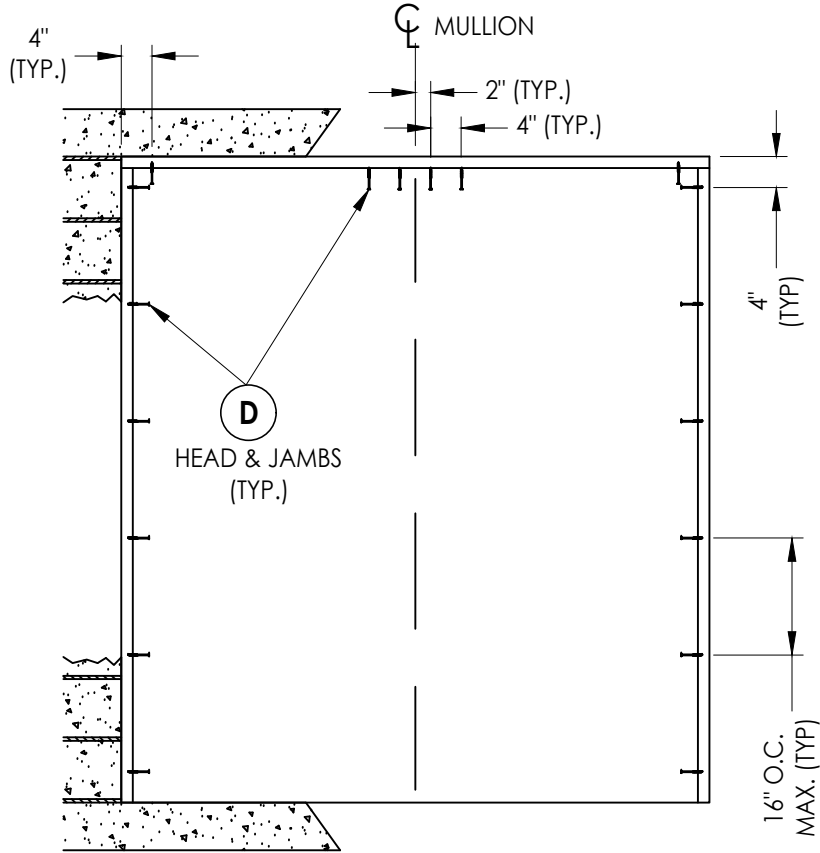

XO / OX

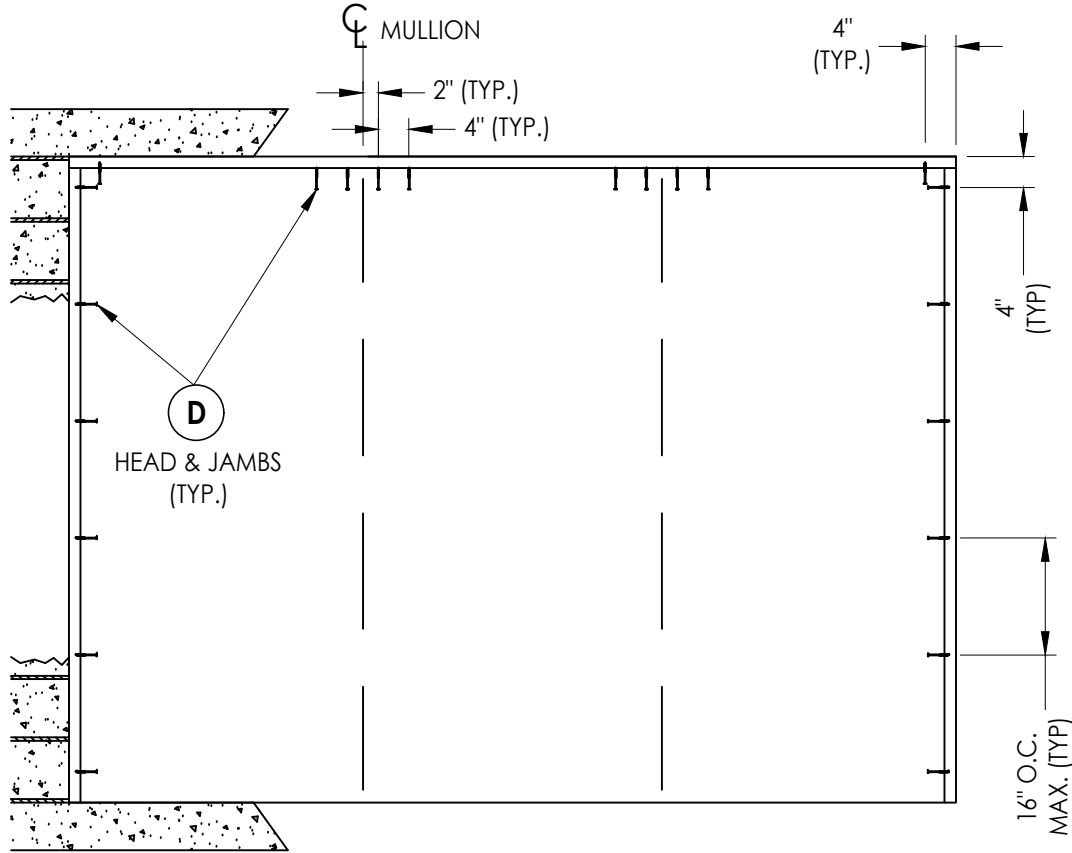

OXO

2X BUCK ANCHORING

NO.	DATE	REVISIONS			
		JK	FBC	DAC	LFS
4	8/10/23	UPDATE TO 8TH ED. (2023)	FBC		
3	8/05/20	UPDATE TO 7TH ED. (2020)	FBC		
2	7/27/17	UPDATE TO 6TH ED. (2017)	FBC		
1	04/14/15	UPDATE TO 5TH ED. (2014)	FBC		

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-17347.9

SHEET 11 OF 14

PRODUCT:

PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:

BUCK ANCHORING

Documents Prepared By:

Lyndon F. Schmidt
P.E. No. 43409

RW

BUILDING CONSULTANTS, INC.



P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197

FBPE Registry No. 9813




X

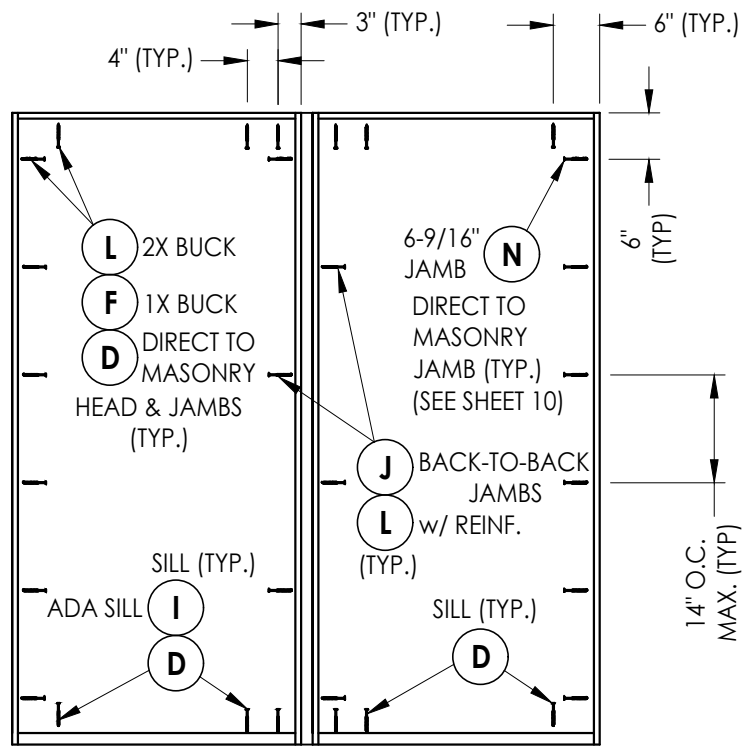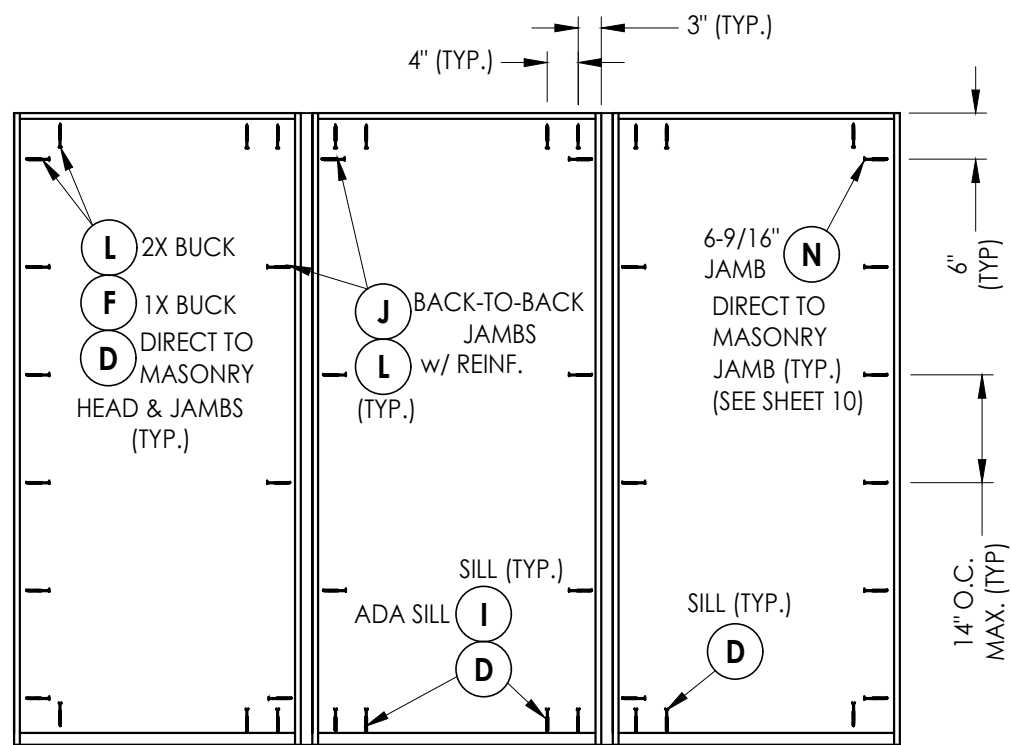
XO / OX

OXO


FRAME ANCHORING

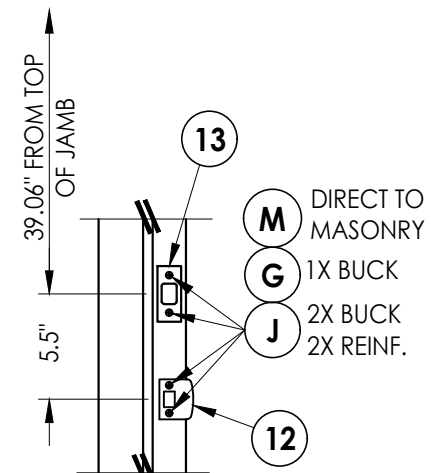


LATCH AND DEADBOLT DETAILS

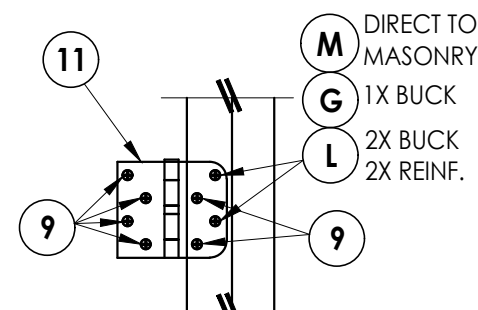

HINGE DETAIL 1

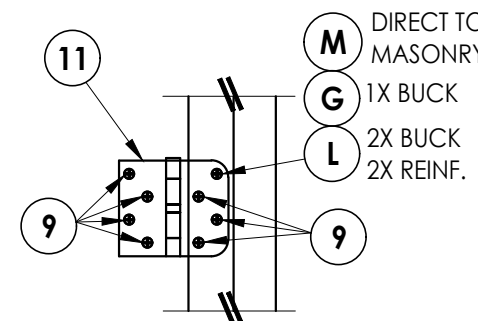

HINGE DETAIL 2

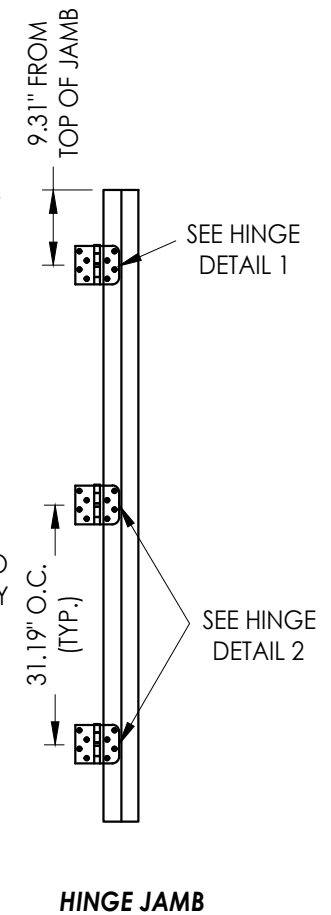


HINGE JAMB


HARDWARE DETAILS

[illegible]


Z:\2023 FBC Drawings\Plastpro\FL-17347 R6\FL-17347.9-10.dwg

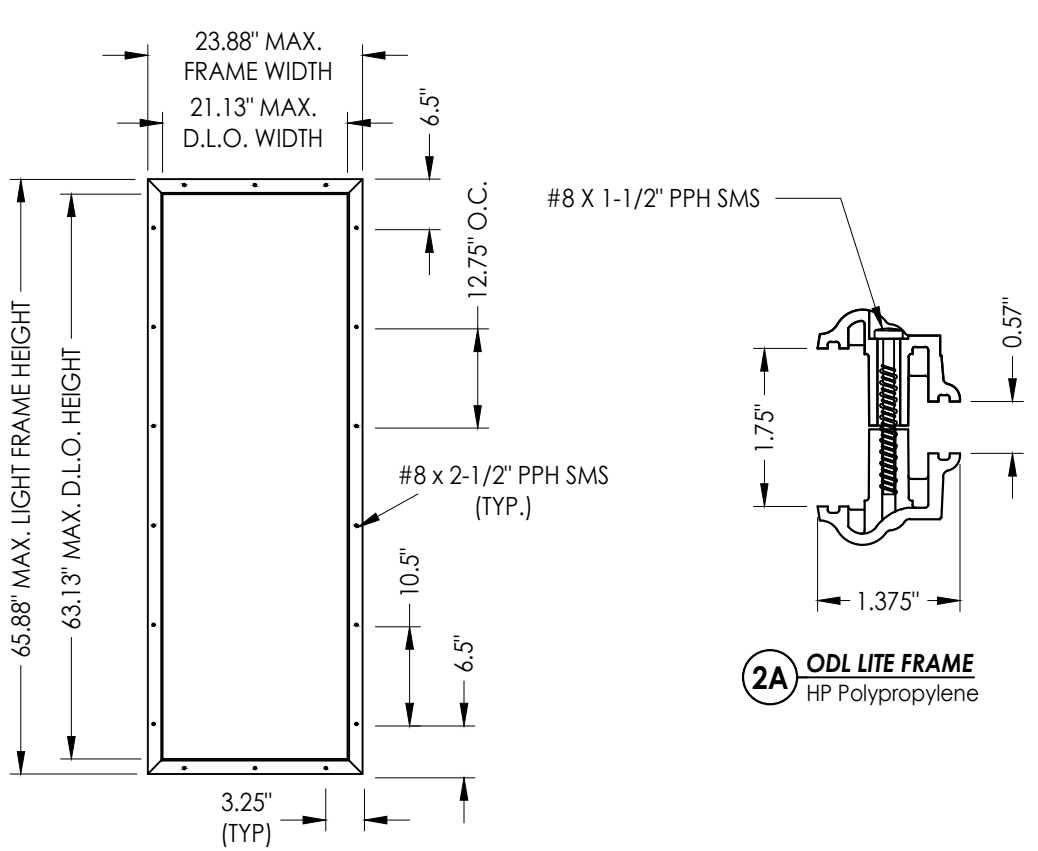


ODL LITE FRAME

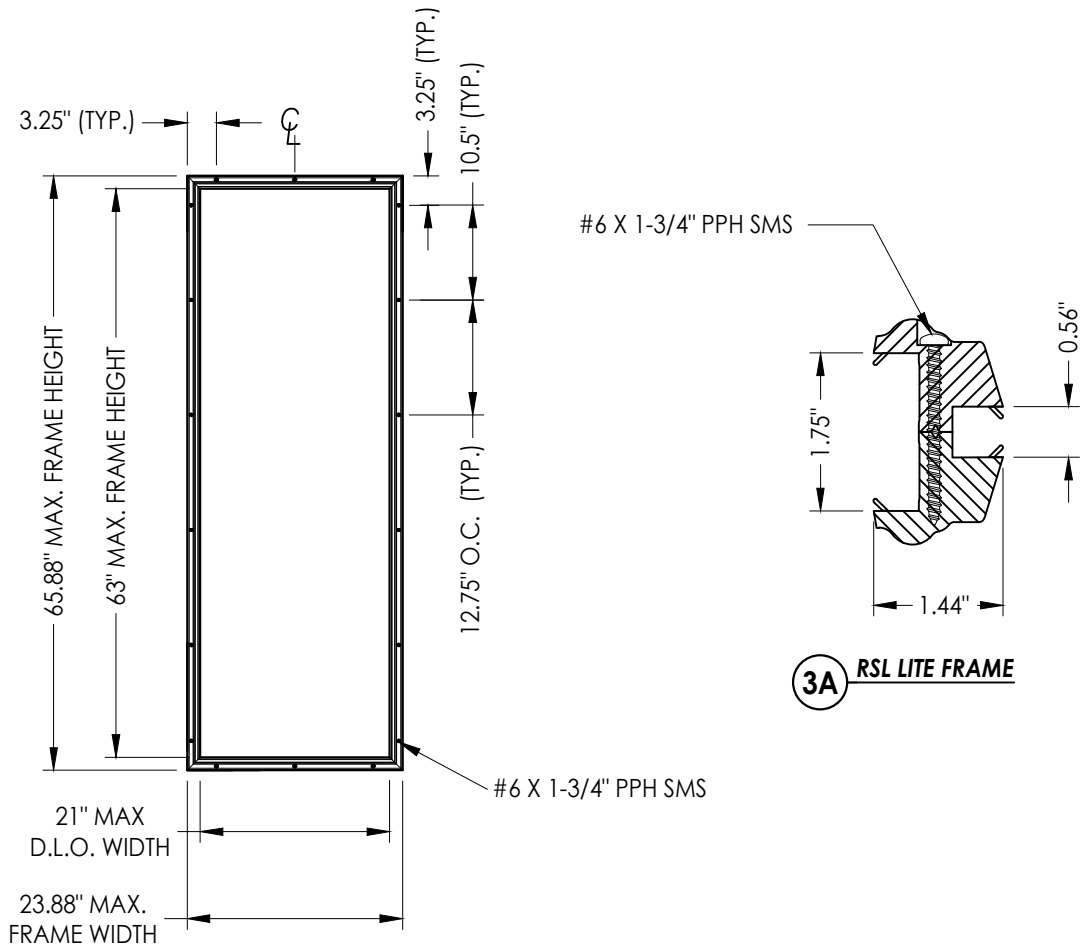

RSL LITE FRAME

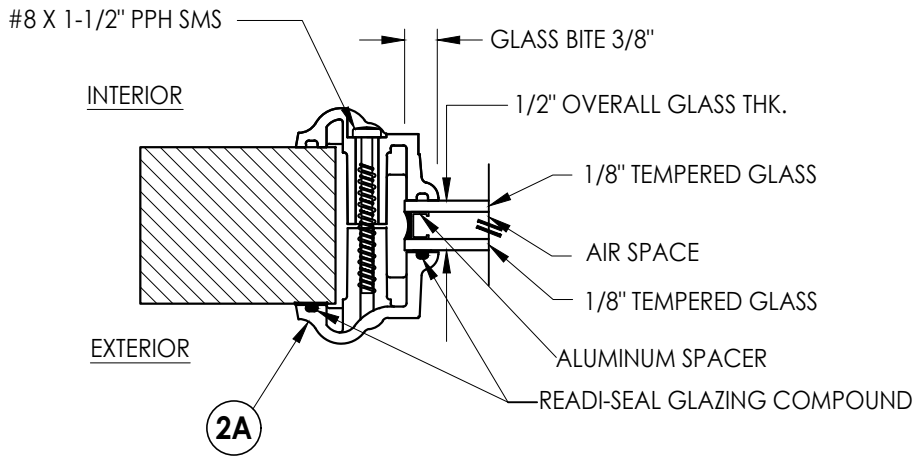

G1 GLAZING DETAIL

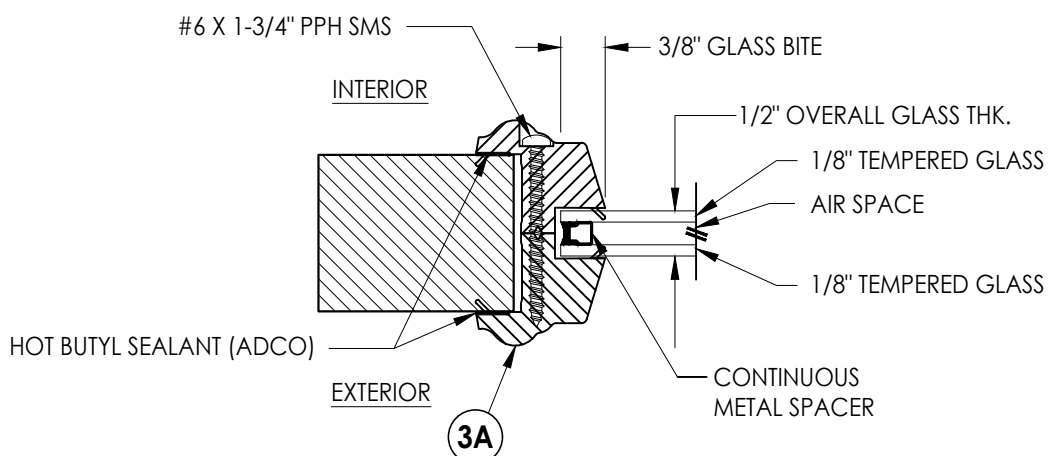

G2 GLAZING DETAIL

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
LITE FRAME
GLAZING DETAILS

NO.	DATE	REVISIONS
4	8/10/23	UPDATE TO 8TH ED. (2023) FBC
3	8/05/20	UPDATE TO 7TH ED. (2020) FBC
2	7/27/17	UPDATE TO 6TH ED. (2017) FBC
1	04/14/15	UPDATE TO 5TH ED. (2014) FBC

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-17347.9

SHEET 13 OF 14

Z:\2023 FBC Drawings\Plastpro\FL-17347 R6\FL-17347.9-10.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.42)	WOOD
B	2X BUCK (G >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" x 3-1/4" PFH ITW CONCRETE SCREW	STEEL
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
J	#10 X 2" PFH WOOD SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMB.)	STEEL
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL
P	1/4" X 2-1/4" PFH DeWALT CONCRETE SCREW	STEEL
1	POLY FIBER JAMB	COMP.
4	1X REINFORCEMENT (G >= 0.55)	WOOD
5	2X REINFORCEMENT (G >= 0.55)	WOOD
6	DOOR SWEEP	PVC
7	WEATHERSTRIP (ENDURA FORCE 5)	FOAM
9	#9 x 3/4" PFH WOOD SCREW	STEEL
11	4" X 4" HINGE	STEEL
12	LATCH STRIKE PLATE	STEEL
13	DEADBOLT STRIKE PLATE	STEEL
20	INSWING THRESHOLD	ALUM/COMP
21	INSWING THRESHOLD w/ SIDELITE ADAPTER	ALUM/COMP
22	OUTSWING THRESHOLD	ALUM/COMP
23	OUTSWING THRESHOLD w/ SIDELITE ADAPTER	ALUM/COMP
24	ADA THRESHOLD	ALUM
25	OUTSWING THRESHOLD	ALUM/COMP
26	INSWING THRESHOLD	ALUM/COMP
40	DOOR PANEL	-
50	SIDELITE PANEL	-



CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

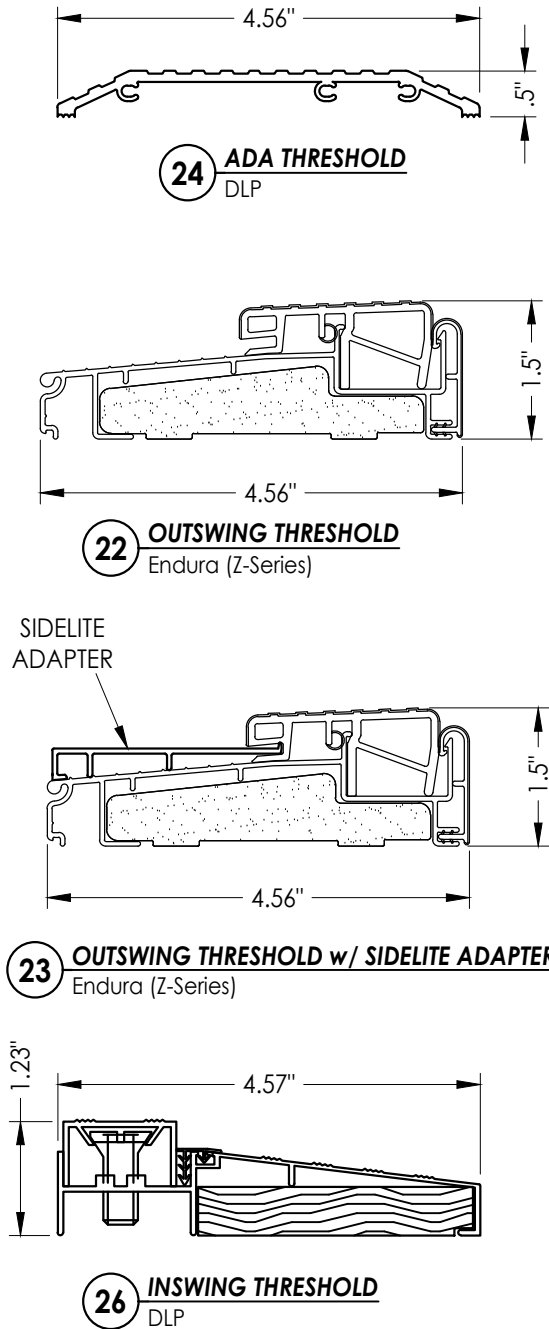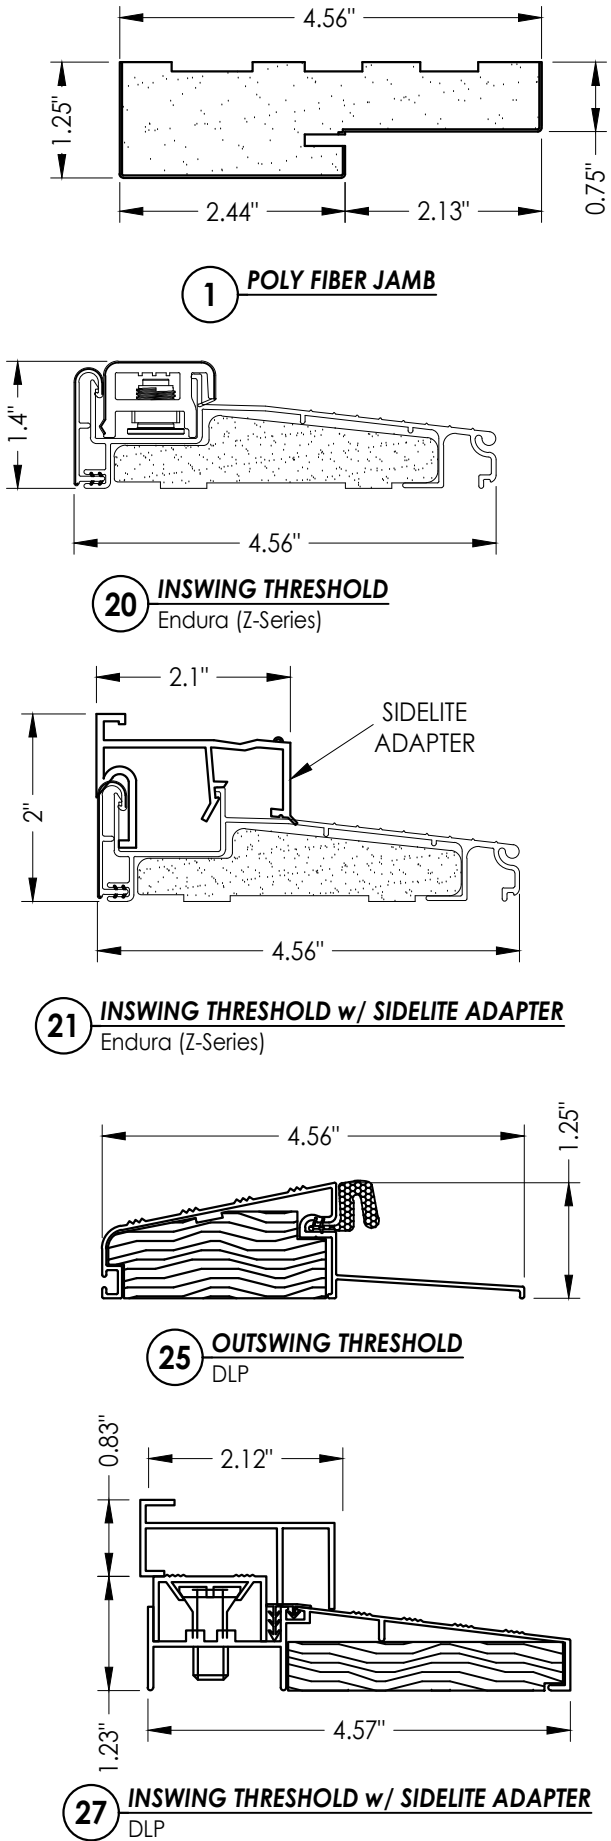

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND FIBERGLASS DOOR

PART OR ASSEMBLY:
BILL OF MATERIALS & COMPONENTS

		LFS	DAC	JK	JK	BY
		UPDATE TO 8TH ED. (2023) FBC	UPDATE TO 7TH ED. (2020) FBC	UPDATE TO 6TH ED. (2017) FBC	UPDATE TO 5TH ED. (2014) FBC	
4	8/10/23					
3	8/05/20					
2	7/27/17					
1	04/14/15					
NO.	DATE					

REVISIONS

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-17347.9

SHEET 14 OF 14