





5200 W. CENTURY BLVD.
LOS ANGELES, CA 90045

OPAQUE FIBERGLASS DOORS
SINGLES
w/ or w/o SIDELITES
INSWING / OUTSWING
"IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Section 1609.1.2 of the FBC and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details
3	Sidelite panel details
4	Elevations
5	Horizontal cross sections
6	Horizontal & Vertical Cross Sections (2X Buck)
7	Horizontal & Vertical Cross Sections (1X Buck)
8	Horizontal & Vertical Cross Sections (Direct to Masonry)
9	Vertical Cross Sections (Thresholds)
10	Horizontal & Vertical Cross Sections (Direct to Masonry)
11	Buck anchoring
12	Frame anchoring & hardware details
13	Lite frame glazing details
14	Bill of materials and components

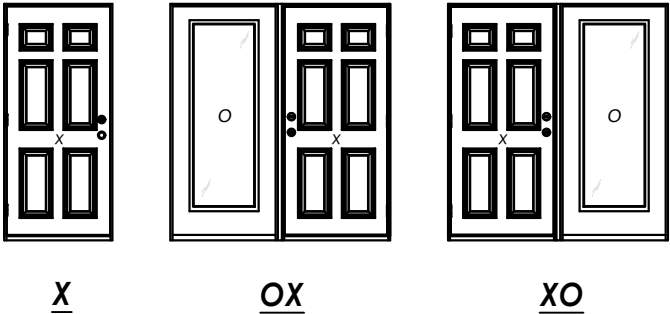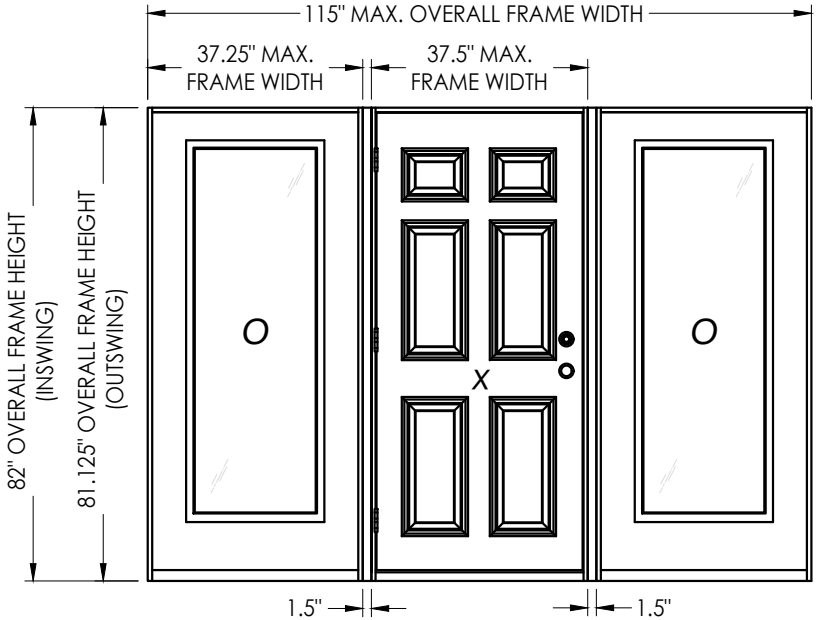

CONFIGURATION	MAX. FRAME DIMENSION	JAMB REINFORCEMENT	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
			POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	37.5" x 82.0"	N/A	+50.0	-50.0	+50.0	-50.0
OX/XO	74.75" x 82.0"	N/A	+35.0	-40.0	+50.0	-50.0
	75.5" x 82.0"	1X	+40.0	-45.0	+50.0	-50.0
	76.25" x 82.0"	2X	+50.0	-50.0	+50.0	-50.0
OXO	112.0" x 82.0"	N/A	+35.0	-35.0	+50.0	-50.0
	113.5" x 82.0"	1X	+50.0	-50.0	+50.0	-50.0
	115.0" x 82.0"	2X	+50.0	-50.0	+50.0	-50.0

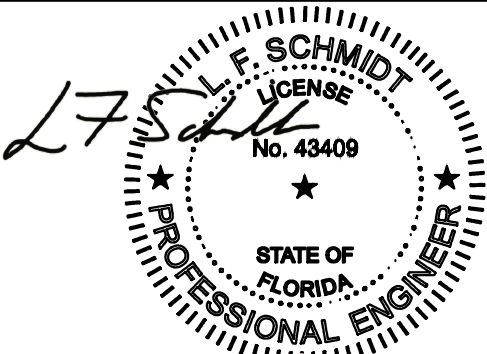

Digitally signed by Lyndon F Schmidt
Date: 2026.08.04 12:47:45 -04'00'
This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.
THIS PRODUCT APPROVAL IS VALID ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES


REVISIONS

DATE: 10/08/14
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17347.13
SHEET 1 OF 14


Building Consultants, Inc.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

5 7/02/26 UPDATE TO 9TH ED. (2026) FBC
4 8/10/23 UPDATE TO 8TH ED. (2023) FBC
3 8/05/20 UPDATE TO 7TH ED. (2020) FBC
NO. DATE BY

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

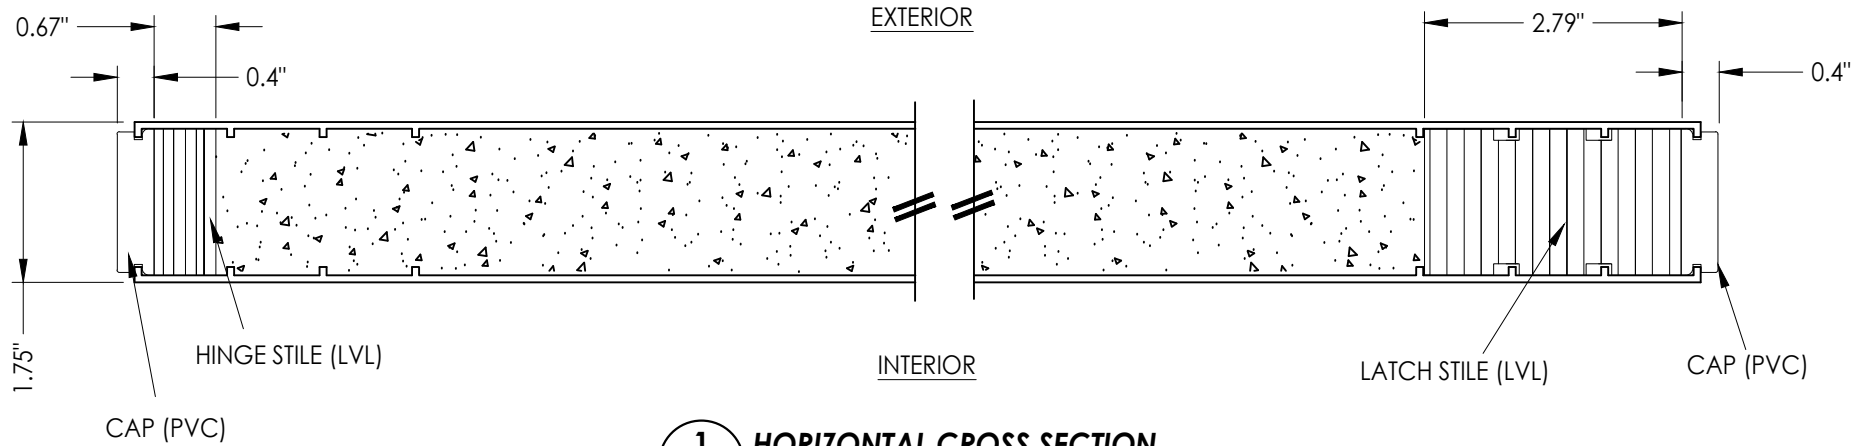


1
2 HORIZONTAL CROSS SECTION

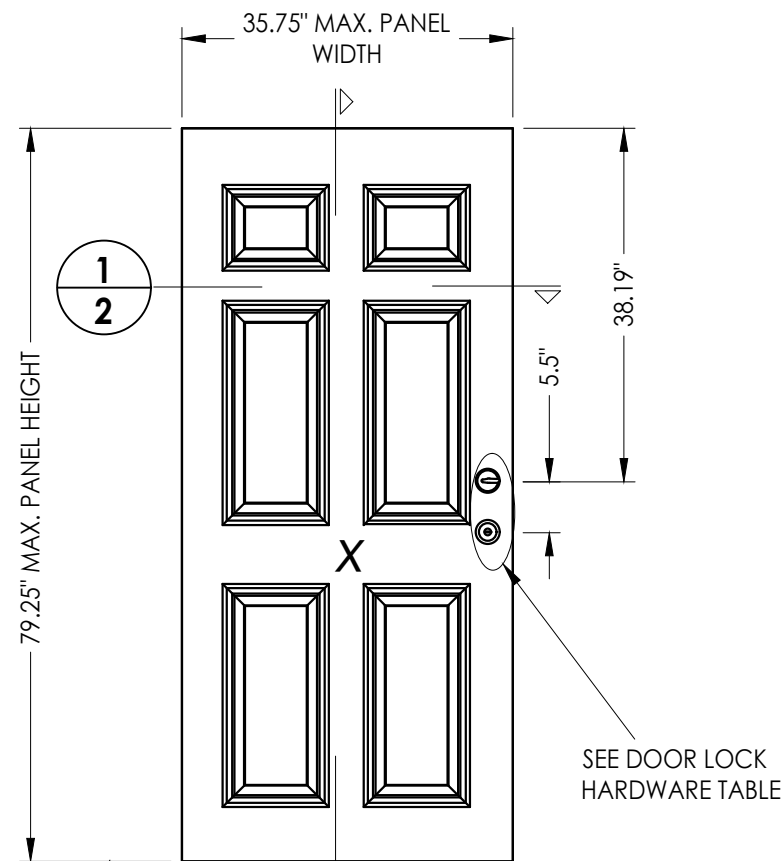

2
2
40 PLASTPRO DOOR PANEL


DOOR LOCK HARDWARE TABLE		
MANUFACTURER	MODEL	
KWIKSET	KNOB:	SERIES (400)
	DEADBOLT:	SERIES (660)
SCHLAGE	HANDLE SET:	"F" SERIES (F60)
	DEADBOLT:	"F" SERIES (F60)
SCHLAGE	KNOB:	"F" SERIES (F10)
	DEADBOLT:	"B" SERIES (B60/62)
YALE	KNOB:	CIRRUS 100 C
	DEADBOLT:	820 SINGLE CYLINDER
DEXTER BY SCHLAGE	KNOB:	J54
	DEADBOLT:	JD60

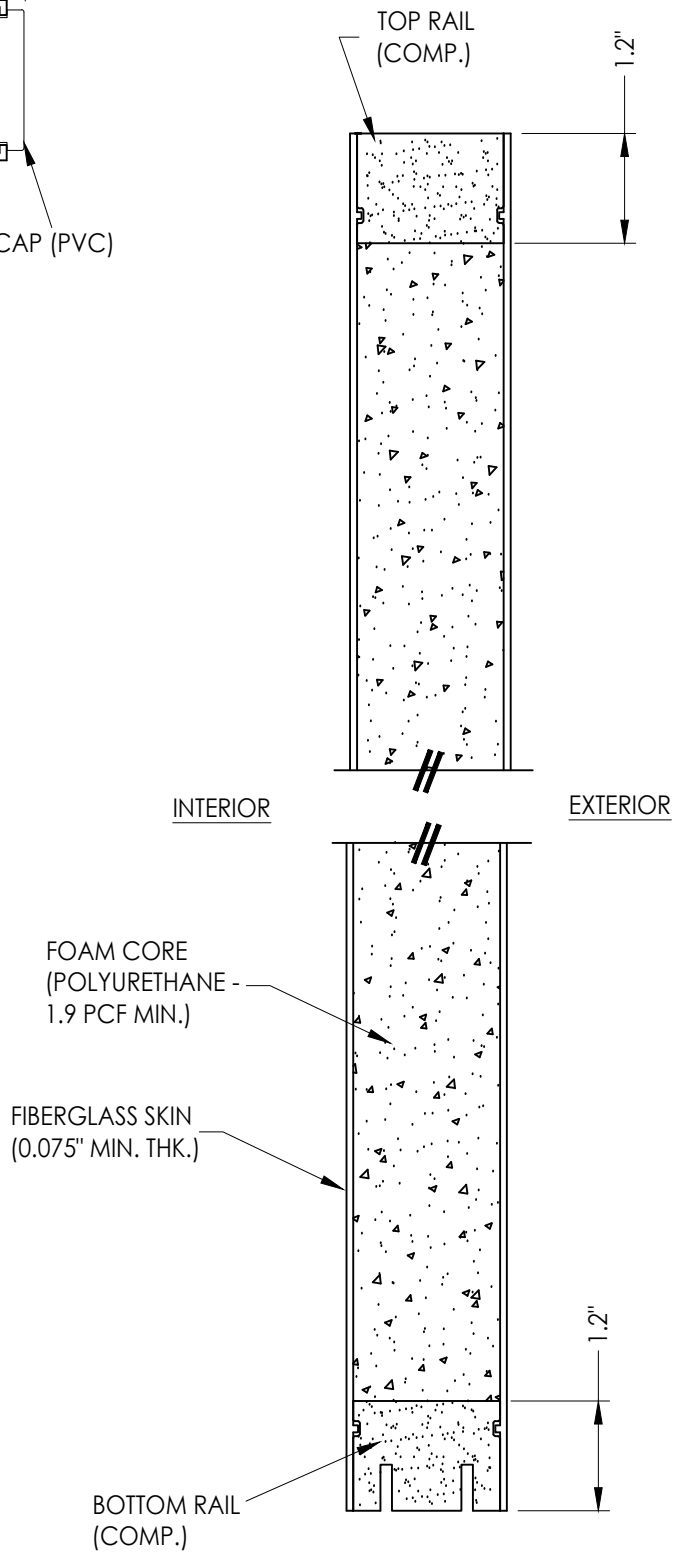


2
2 VERTICAL CROSS SECTION

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: PLASTPRO IND FIBERGLASS DOOR		PART OR ASSEMBLY: DOOR PANEL DETAILS	
5 7/02/26 UPDATE TO 9TH ED. (2026) FBC		LFS	
4 8/10/23 UPDATE TO 8TH ED. (2023) FBC		LFS	
3 8/05/20 UPDATE TO 7TH ED. (2020) FBC		DAC	
NO. DATE		BY	
REVISIONS			
DATE: 10/08/14			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-17347.13			
SHEET 2 OF 14			


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

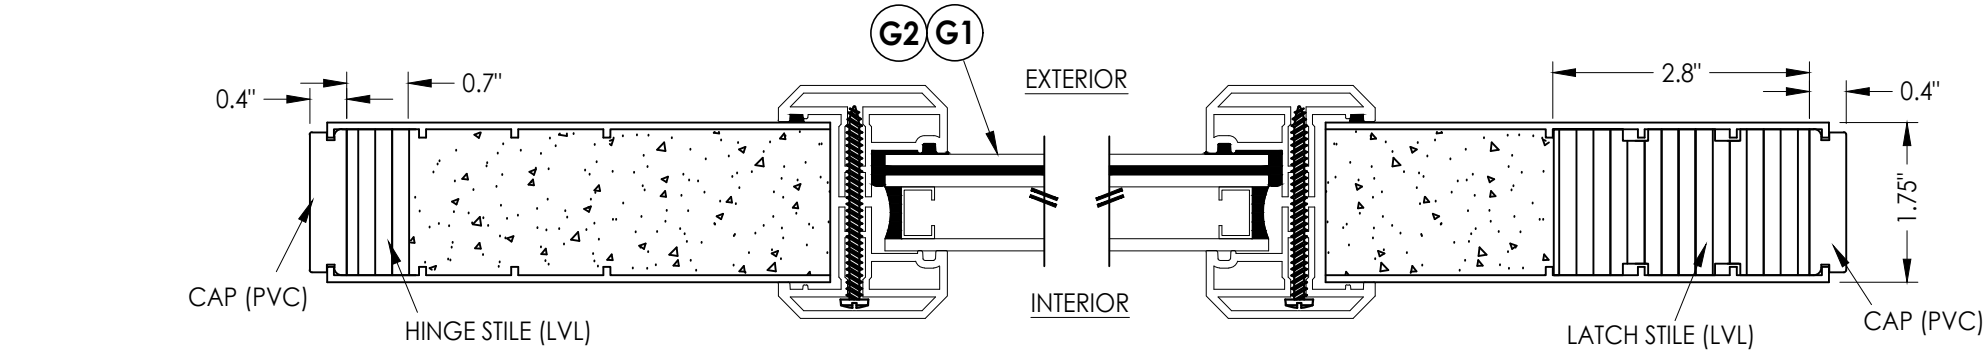

1
3 HORIZONTAL CROSS SECTION

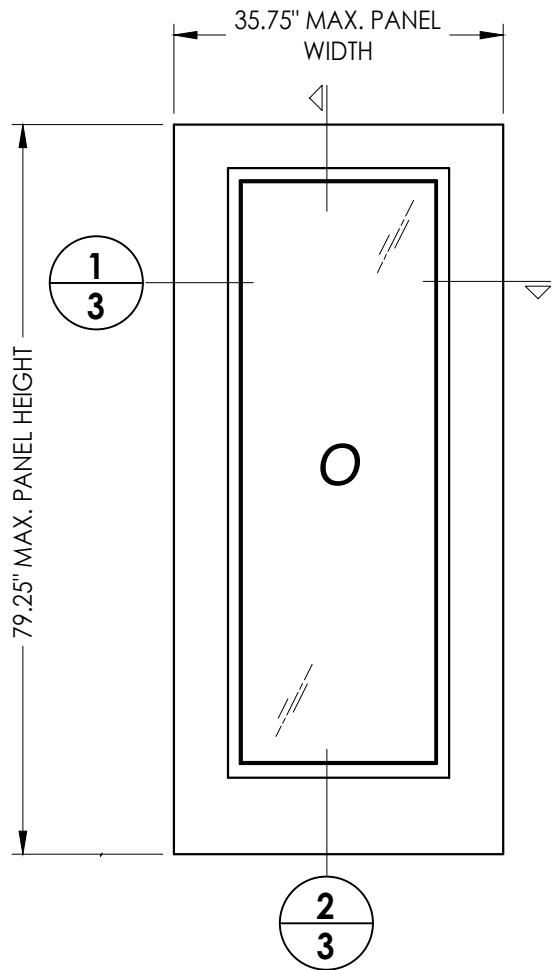


50 PLASTPRO SIDELITE PANEL

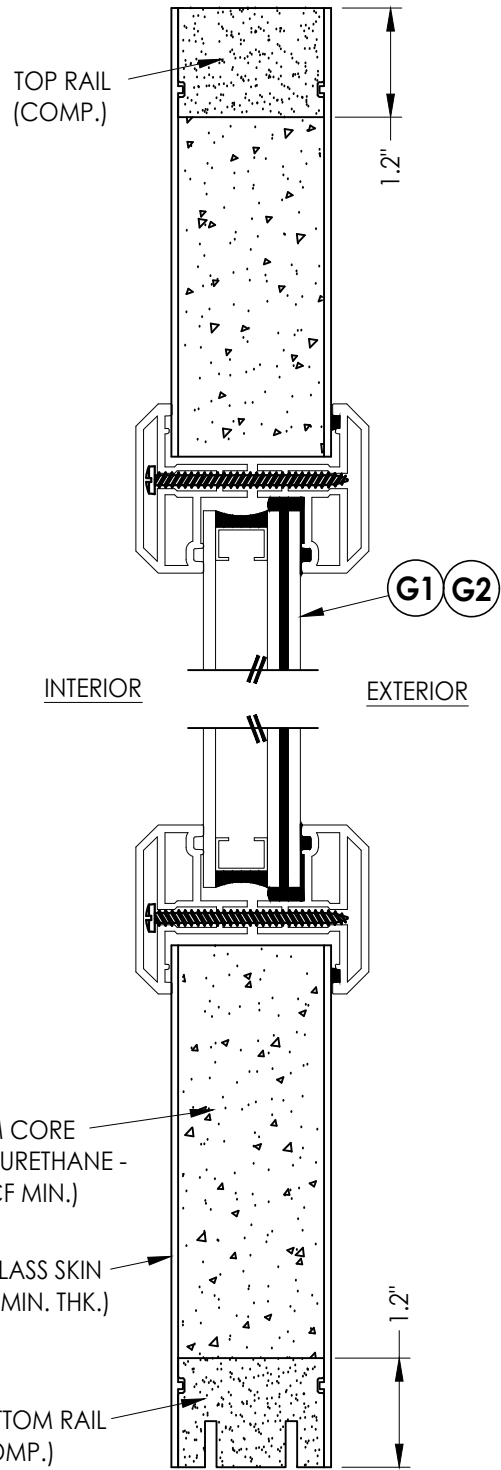


2
3 VERTICAL CROSS SECTION

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: PLASTPRO IND FIBERGLASS DOOR		PART OR ASSEMBLY: SIDELITE PANEL DETAILS					
			LFS				
		5 7/02/26	UPDATE TO 9TH ED. (2026) FBC				
		4 8/10/23	UPDATE TO 8TH ED. (2023) FBC				
		3 8/05/20	UPDATE TO 7TH ED. (2020) FBC				
		NO.	DATE				
				REVISIONS			
DATE: 10/08/14							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-17347.13							
SHEET 3 OF 14							


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

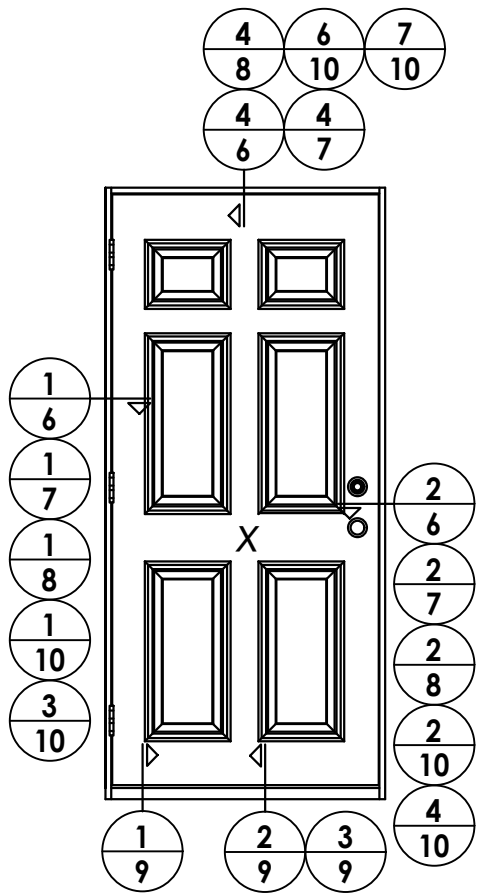

ELEVATION
X

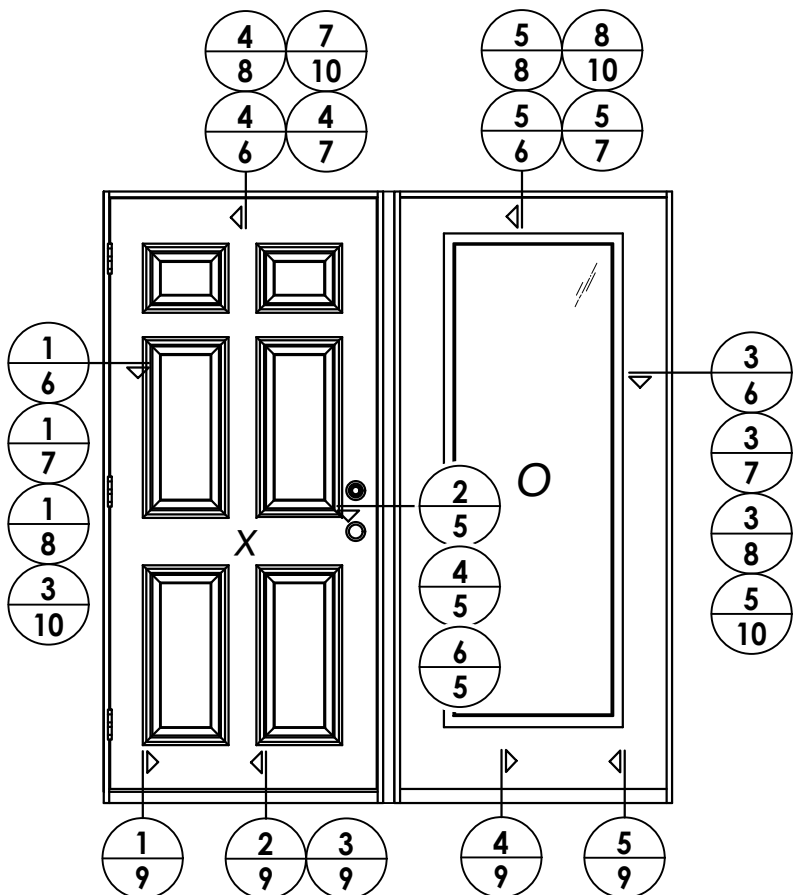

ELEVATION
XO / OX

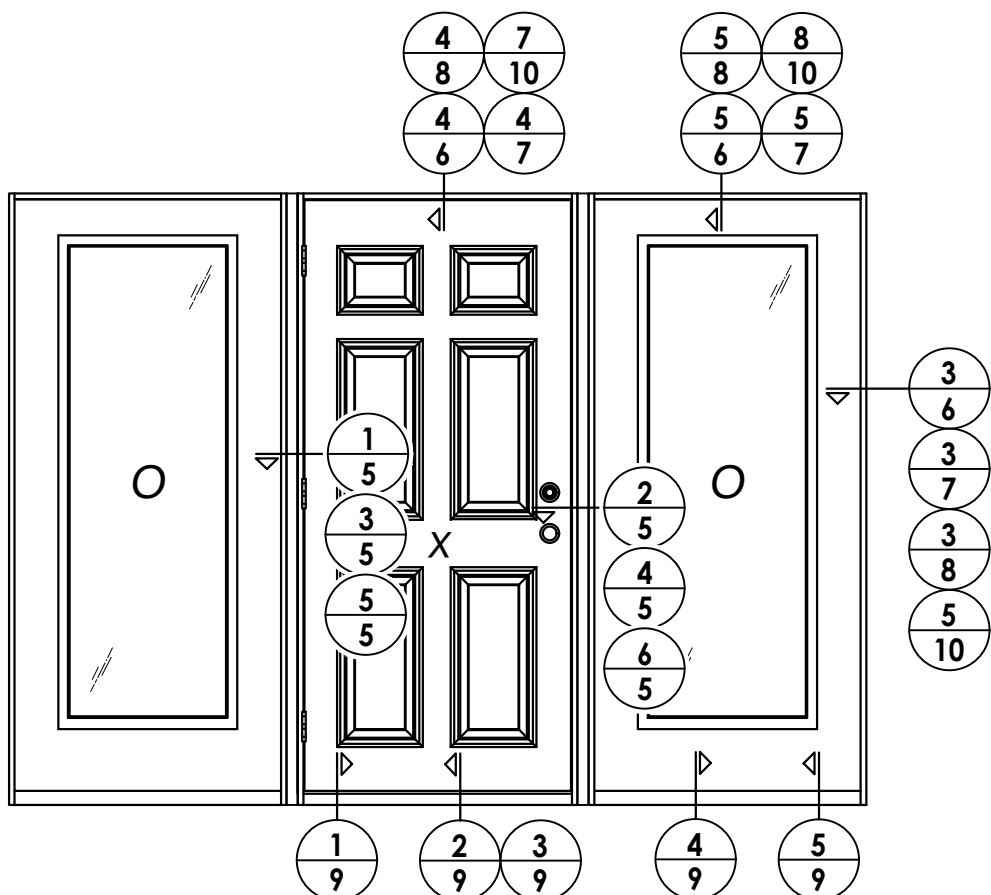

ELEVATION
OXO

REVISIONS	
NO.	DATE
5	7/02/26
4	8/10/23
3	8/05/20



DATE: 10/08/14
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17347.13
SHEET 4 OF 14

PRODUCT: PLASTPRO IND FIBERGLASS DOOR
PART OR ASSEMBLY: ELEVATIONS


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

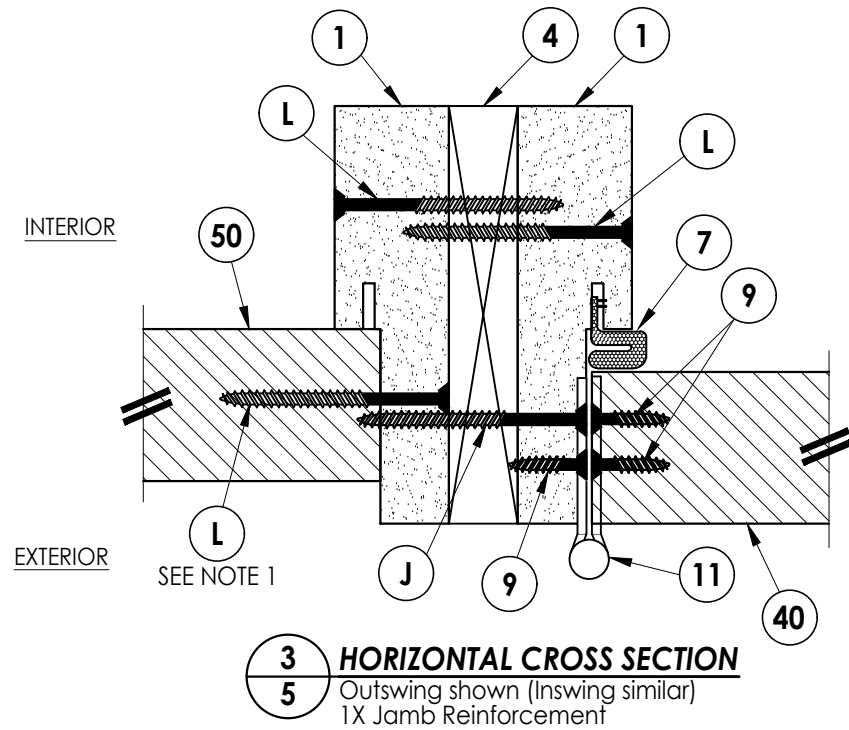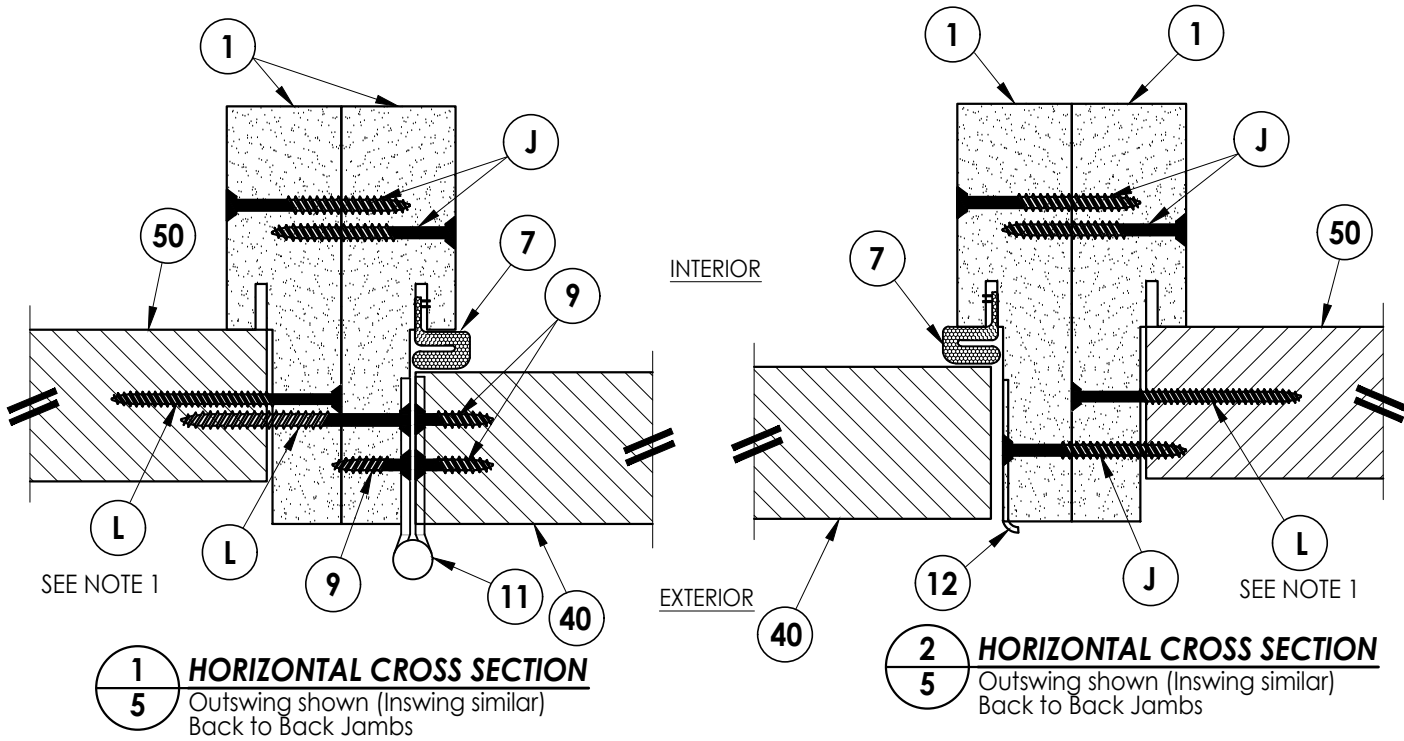

NOTE:
1. Spacing for item L: 6" from each end and 3 more equally spaced along sidelite jamb (5 total).

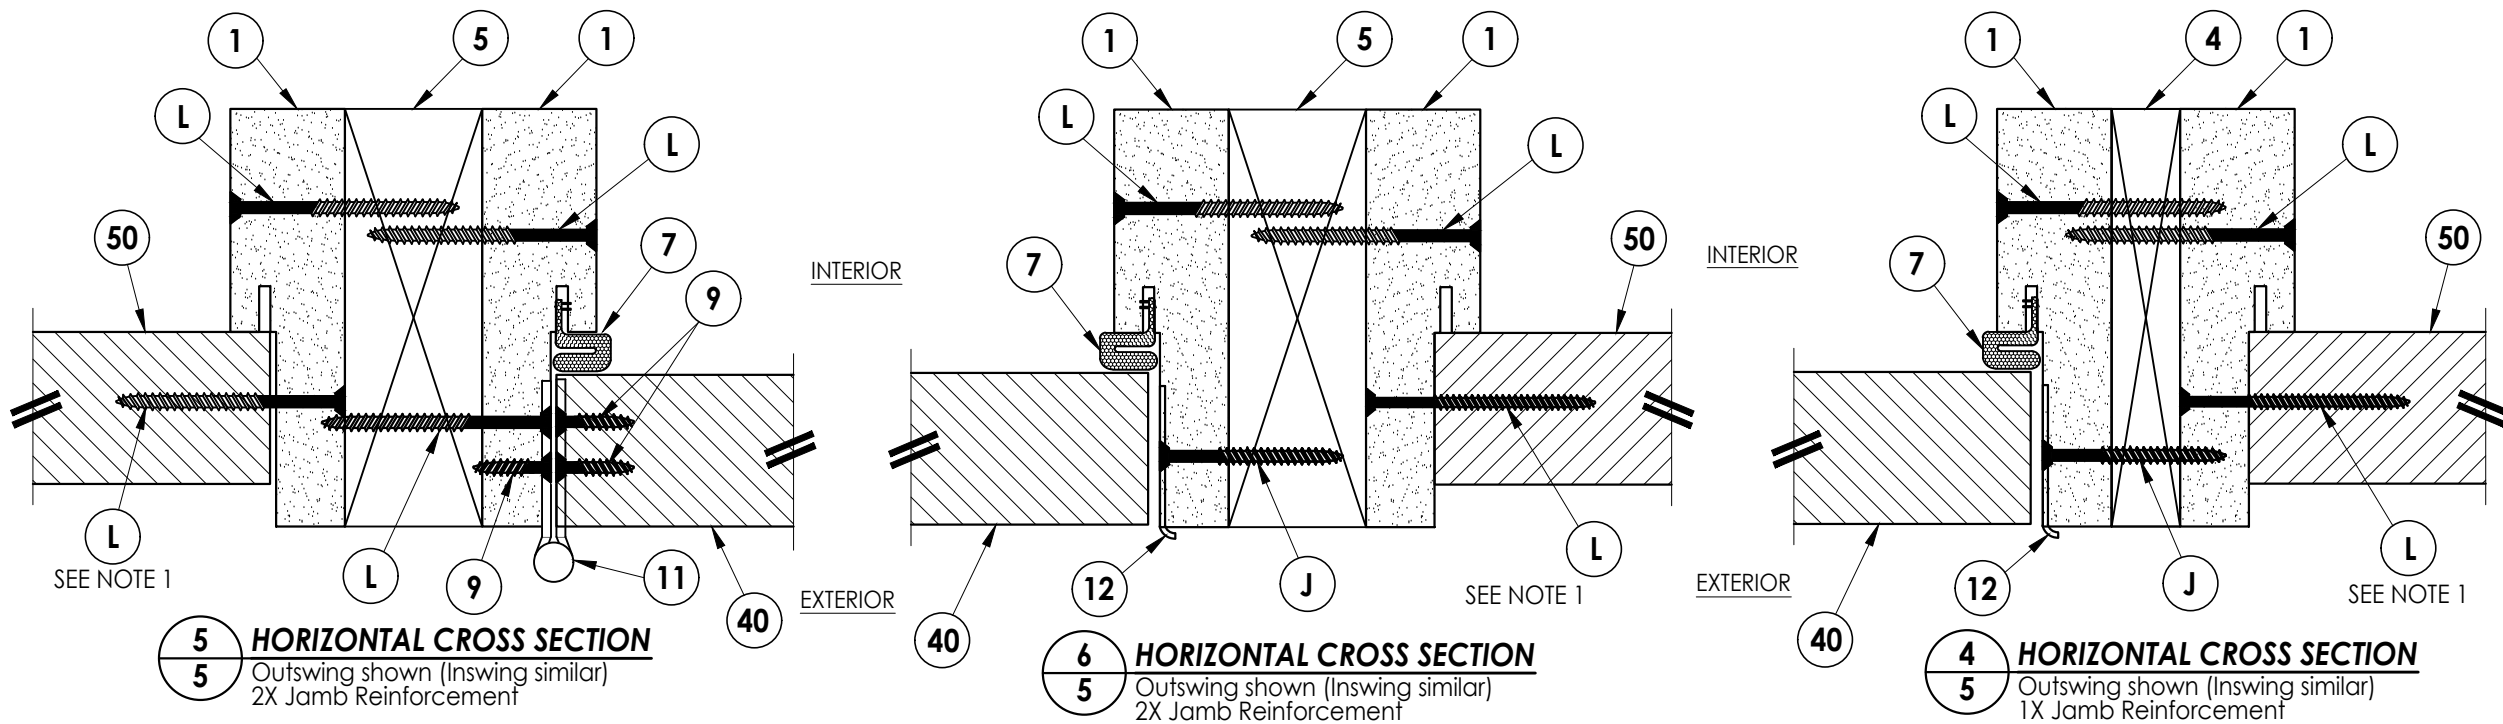

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT: PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL
CROSS SECTIONS



NO.	DATE	REVISIONS
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC
4	8/10/23	UPDATE TO 8TH ED. (2023) FBC
3	8/05/20	UPDATE TO 7TH ED. (2020) FBC
2		
1		

DATE: 10/08/14
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.:
FL-17347.13
SHEET 5 OF 14

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

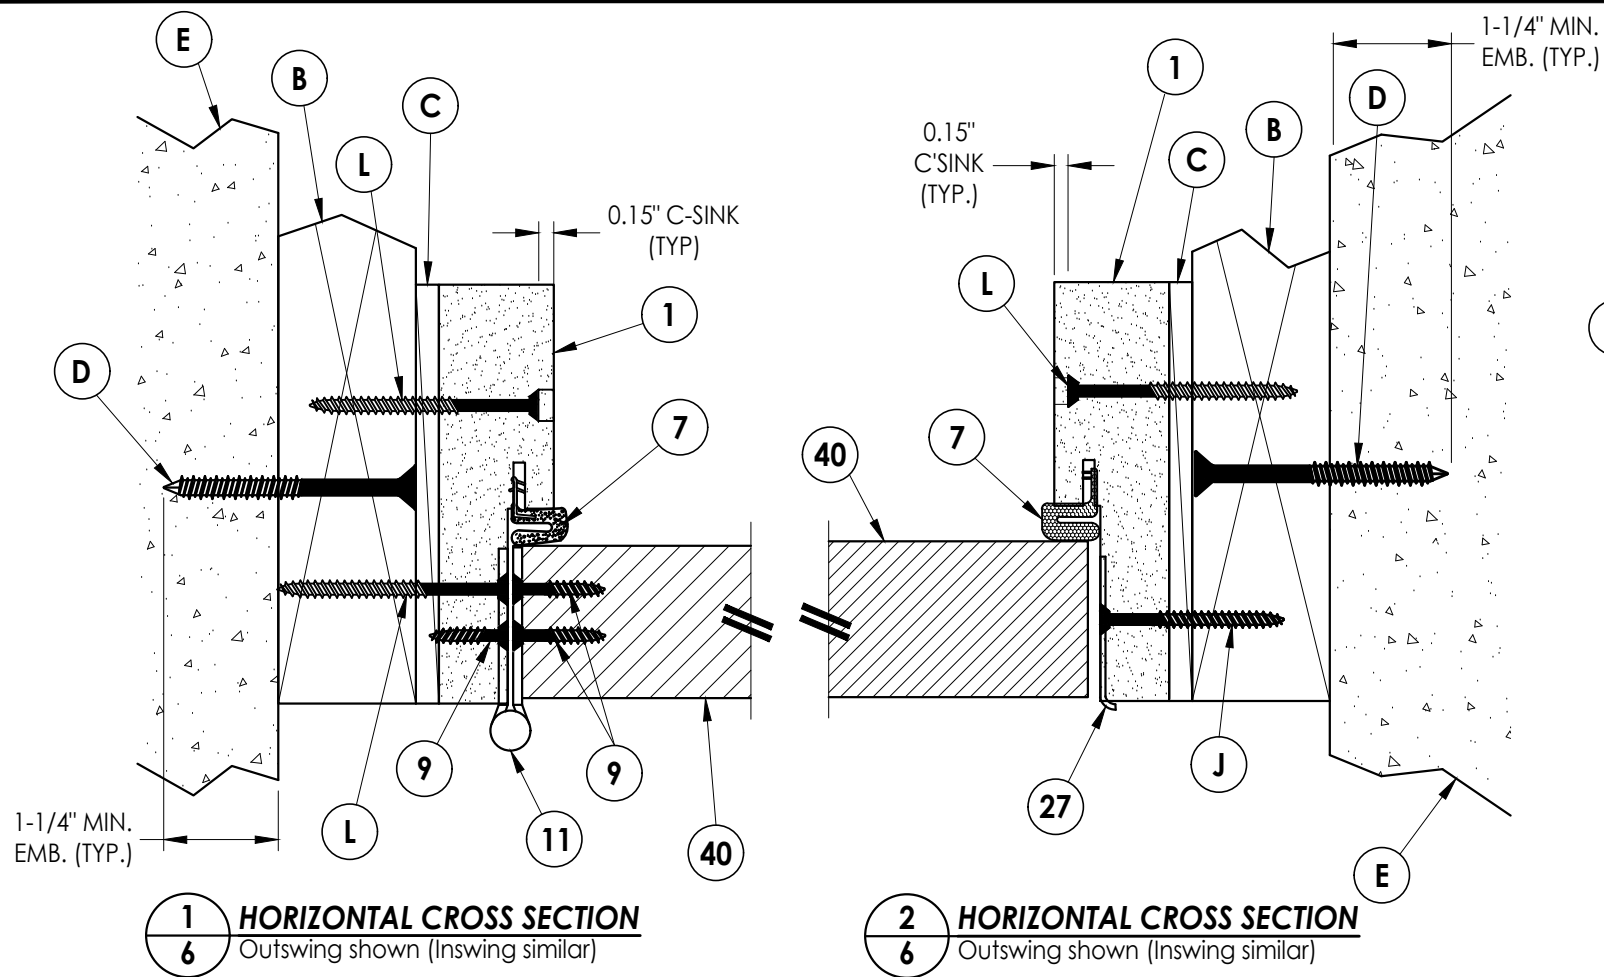

- NOTE:
- Spacing for item L: 6" from each end and 3 more equally spaced along sidelite jamb (5 total).
 - Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

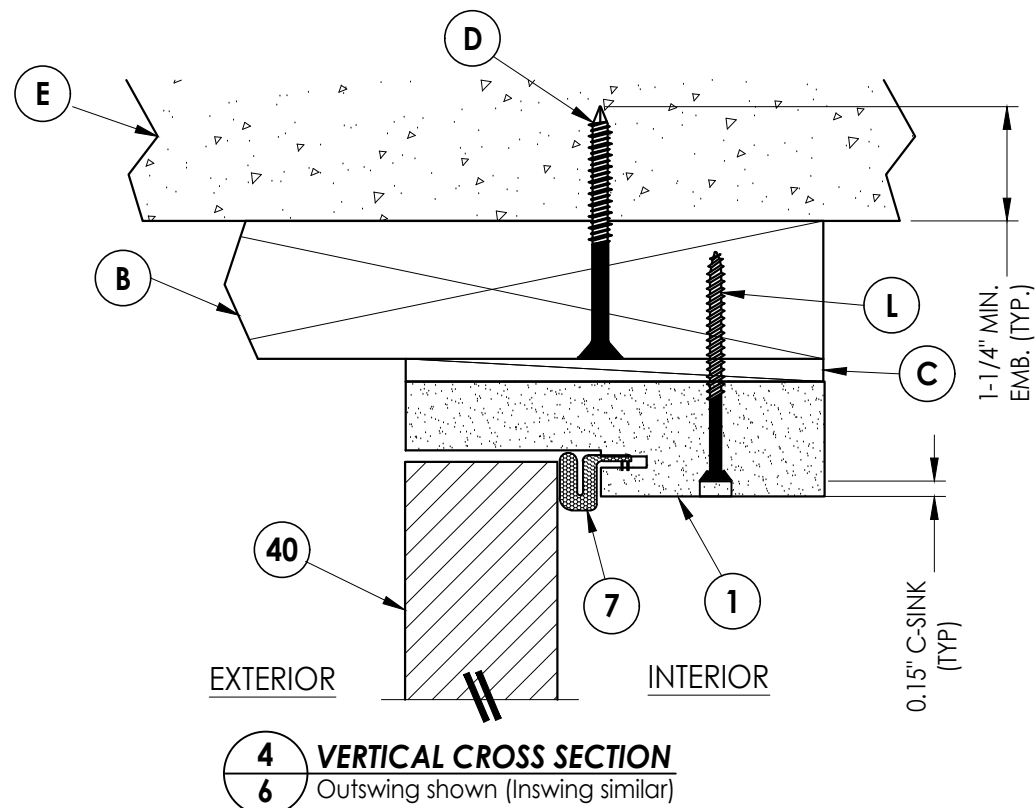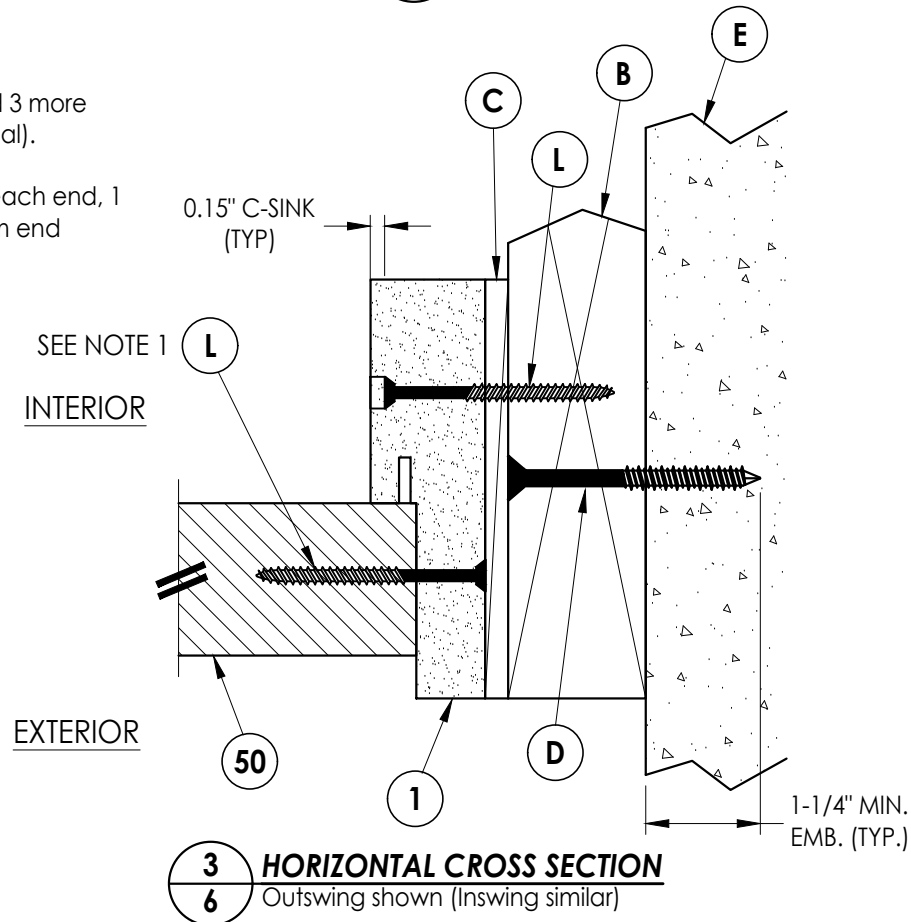

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

NO.	DATE	REVISIONS			
		BY	DAC	LFS	FBC
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
4	8/10/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
3	8/05/20	UPDATE TO 7TH ED. (2020)	FBC	DAC	

DATE: 10/08/14

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-17347.13

SHEET 6 OF 14


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

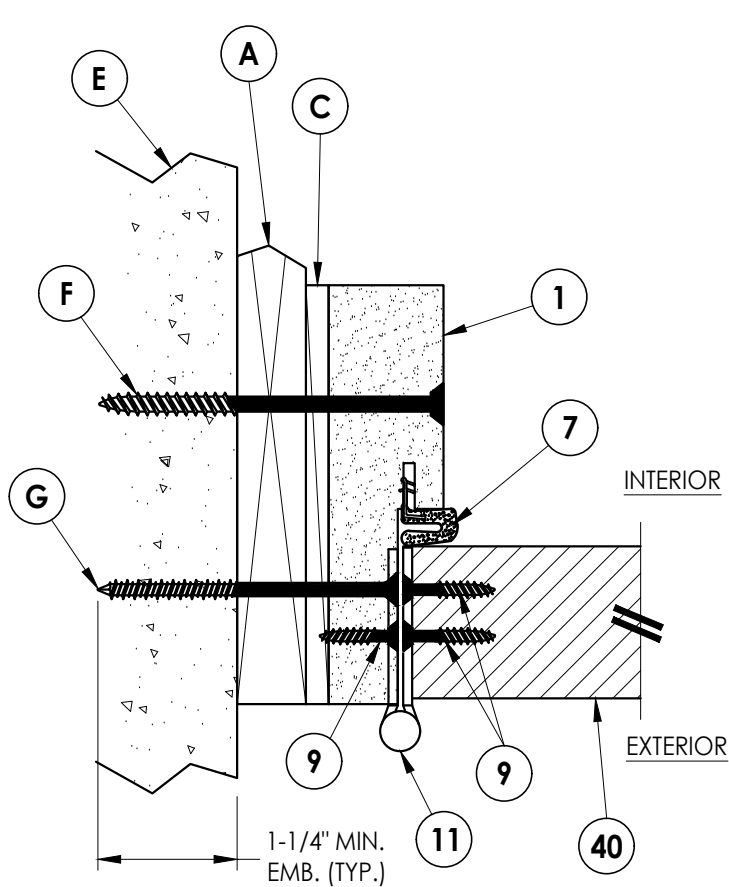


1
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

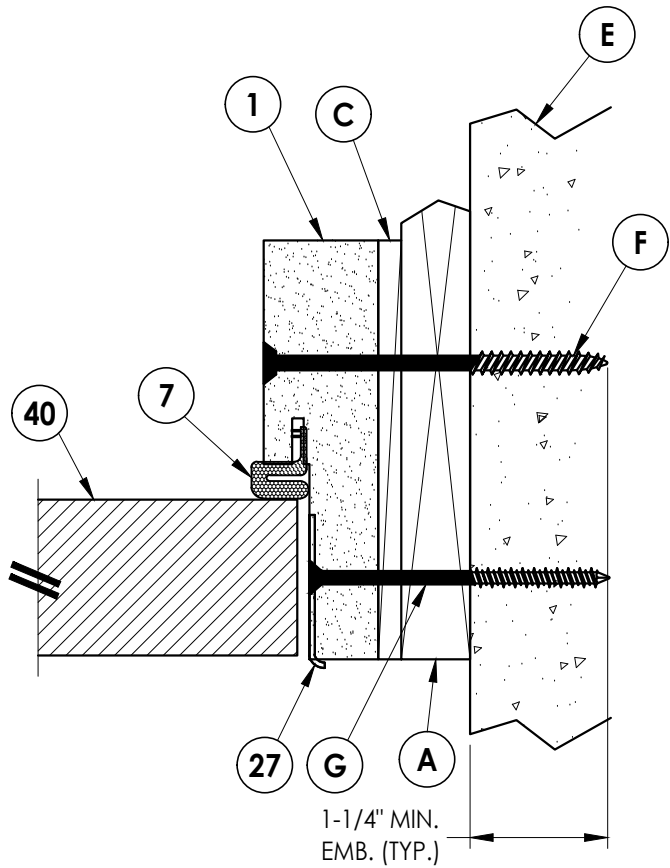


2
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

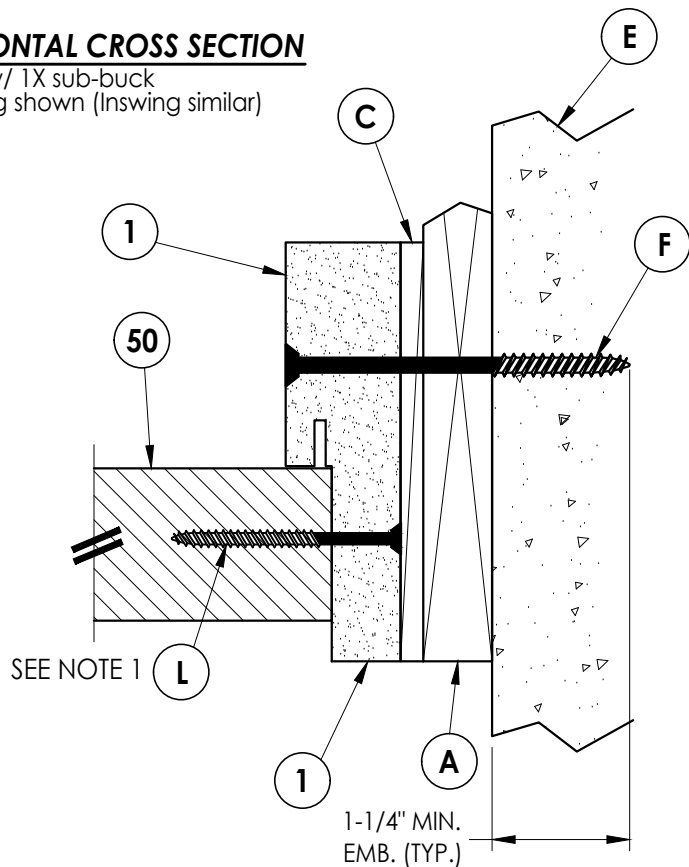

3
7 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

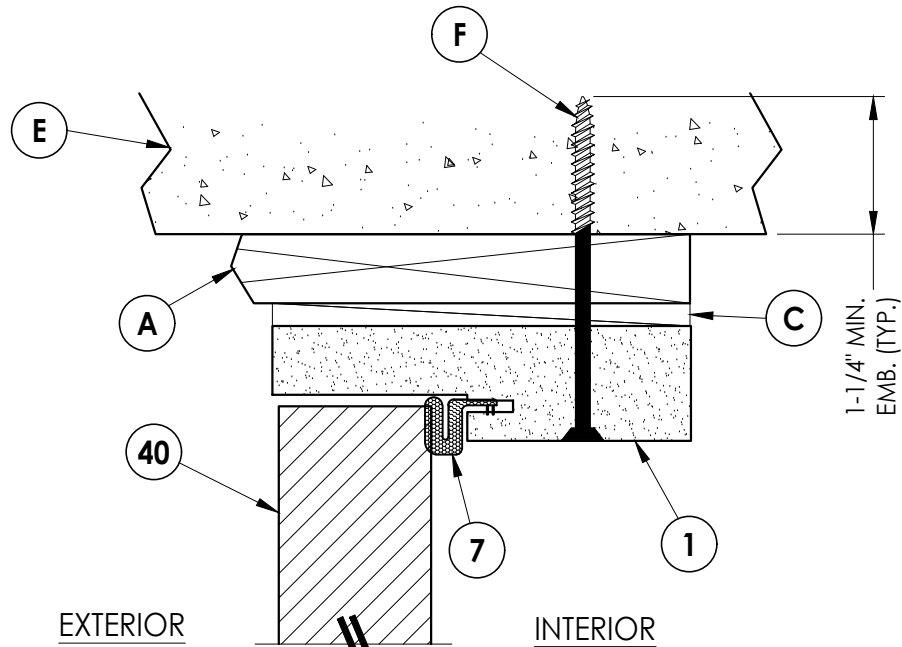

4
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

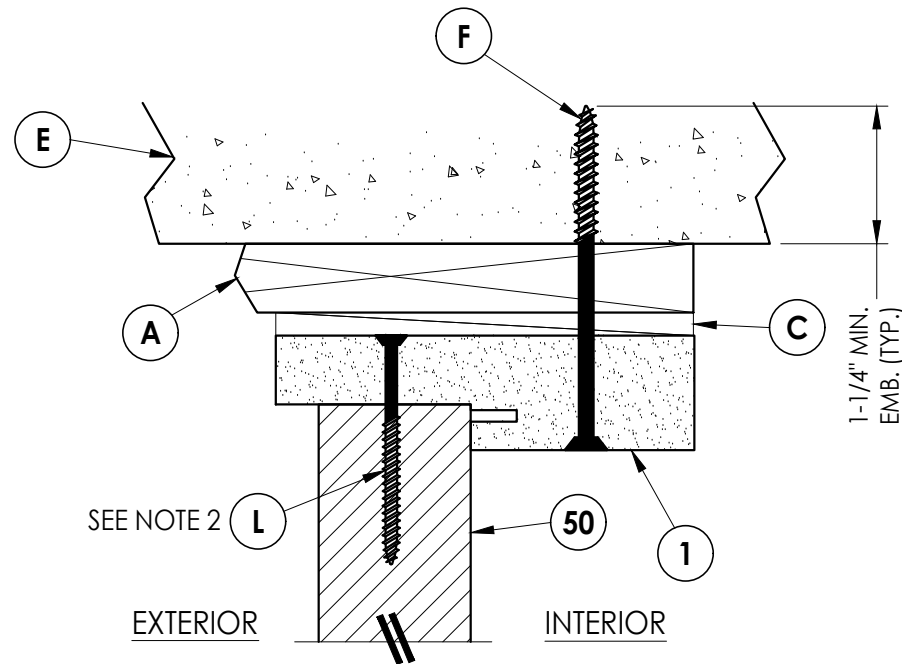

5
7 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

- NOTE:**
1. Spacing for item L: 6" from each end and 3 more equally spaced along sidelite jamb (5 total).
 2. Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS	BY
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
4	8/10/23	UPDATE TO 8TH ED. (2023) FBC	LFS
3	8/05/20	UPDATE TO 7TH ED. (2020) FBC	DAC

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-17347.13

SHEET 7 OF 14


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

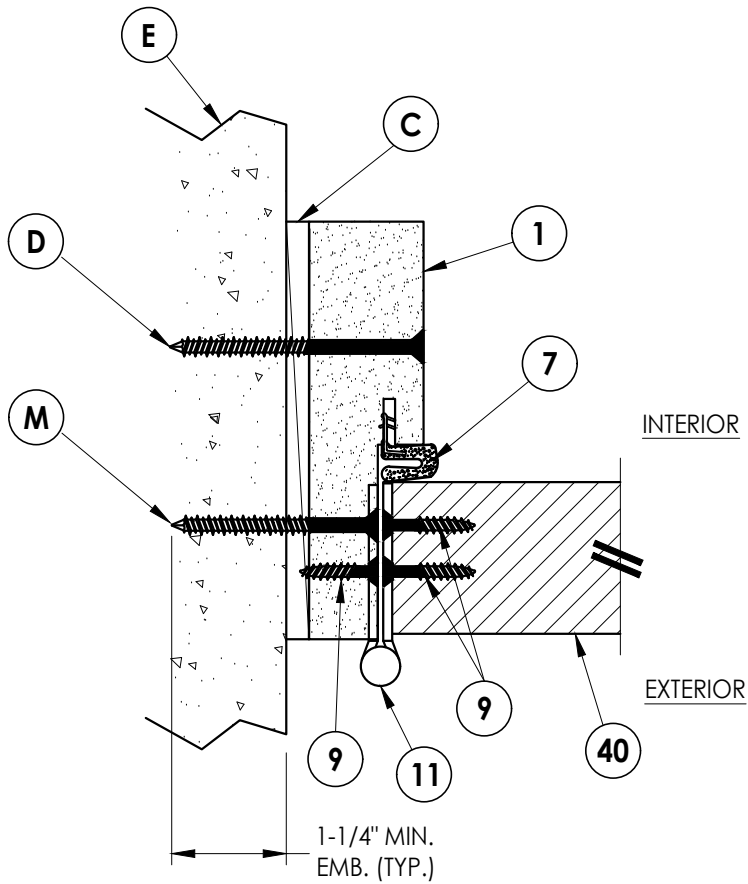


1
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

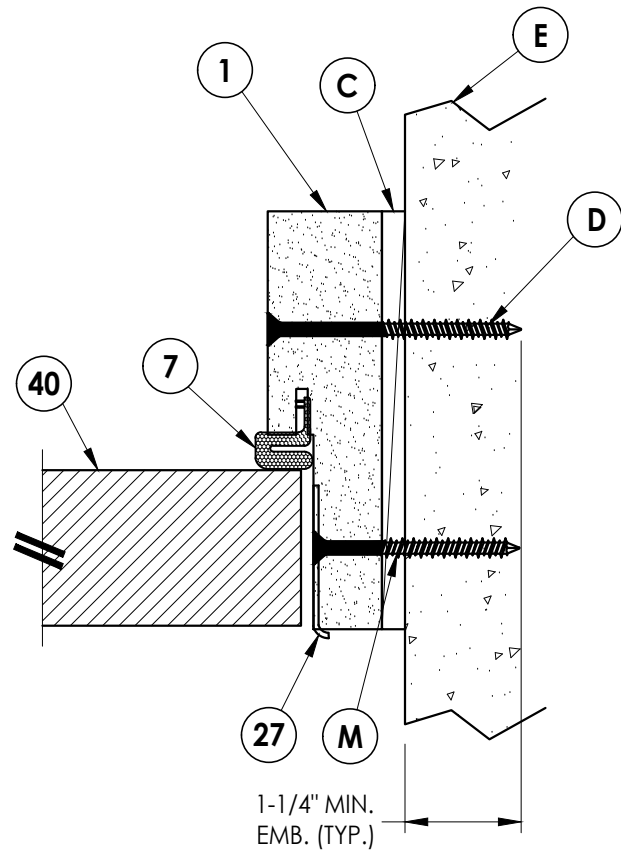


2
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

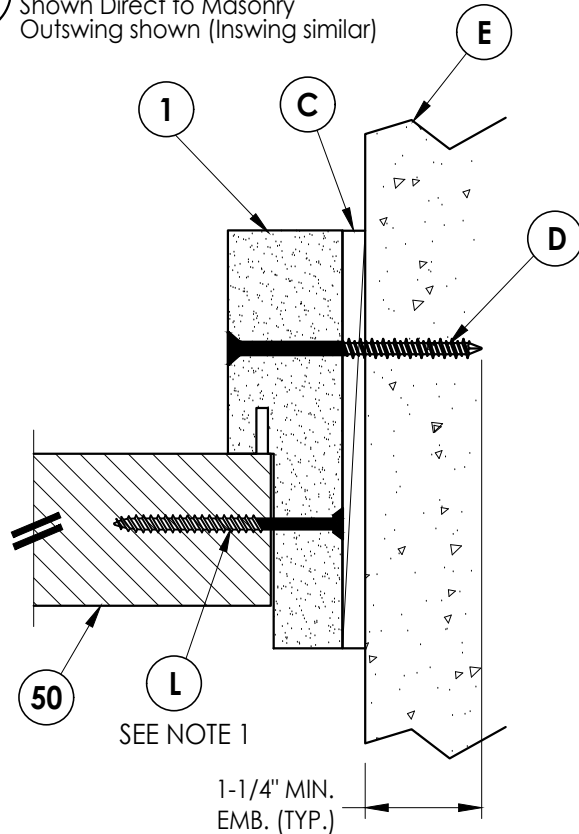

3
8 **HORIZONTAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

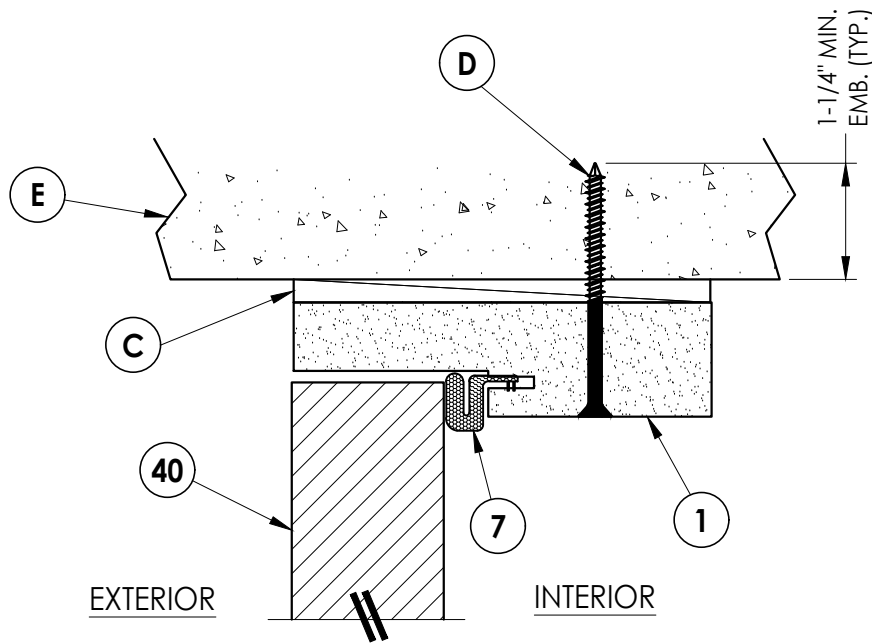

4
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

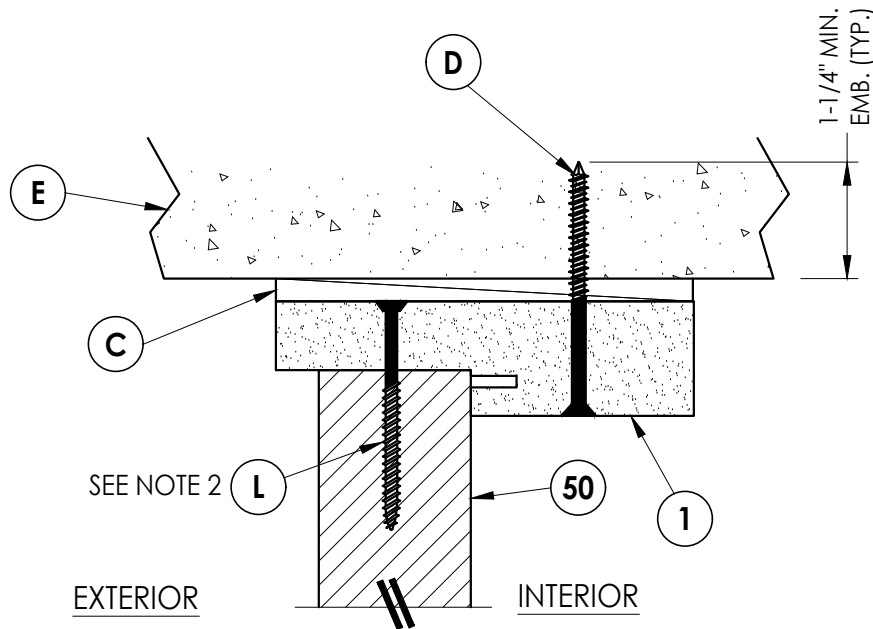

5
8 **VERTICAL CROSS SECTION**
Shown Direct to Masonry
Outswing shown (Inswing similar)

NOTE:

1. Spacing for item L: 6" from each end and 3 more equally spaced along sidelite jamb (5 total).
2. Spacing for item L @ head & sill: 6" from each end, 1 @ centerline, 2 additional at 3" & 4.5" from end adjacent to door.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND FIBERGLASS DOOR
PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC
4	8/10/23	UPDATE TO 8TH ED. (2023) FBC
3	8/05/20	UPDATE TO 7TH ED. (2020) FBC

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-17347.13

SHEET 8 OF 14


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

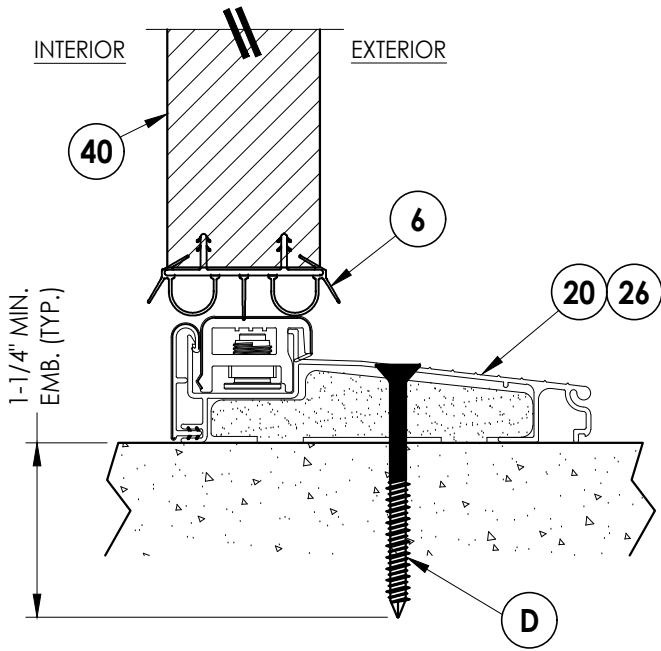


1
9 VERTICAL CROSS SECTION
Inswing sill

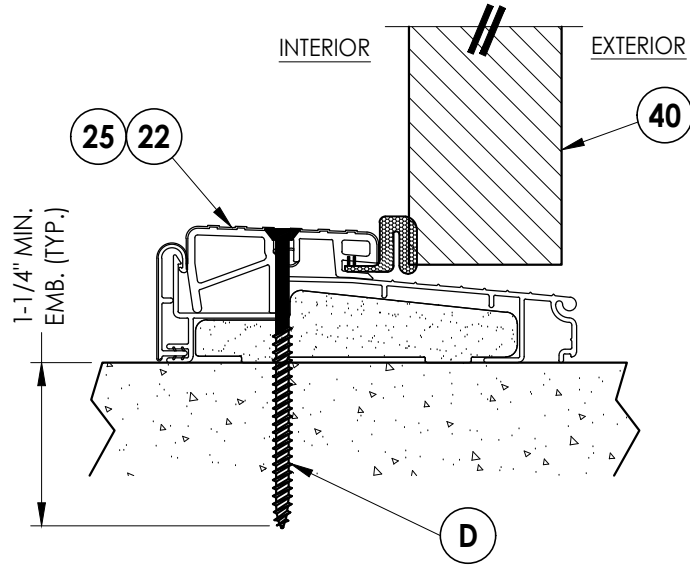


2
9 VERTICAL CROSS SECTION
Outswing sill

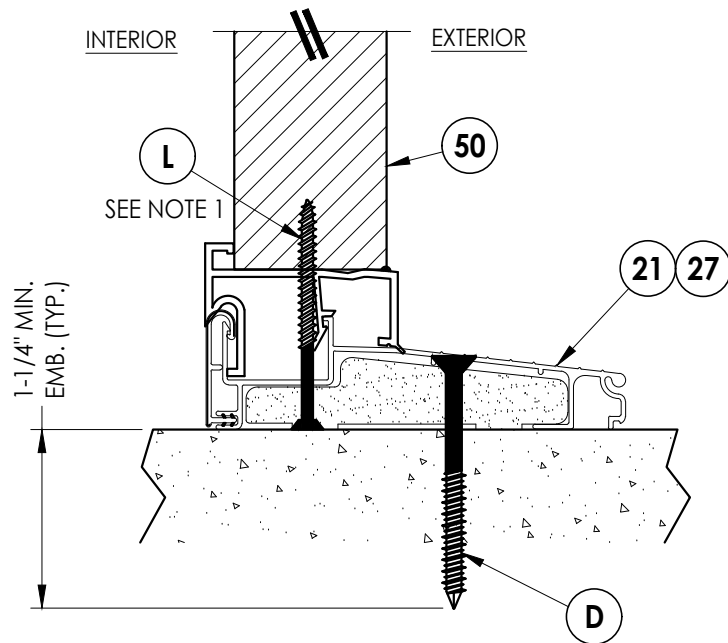

4
9 VERTICAL CROSS SECTION
Inswing sill

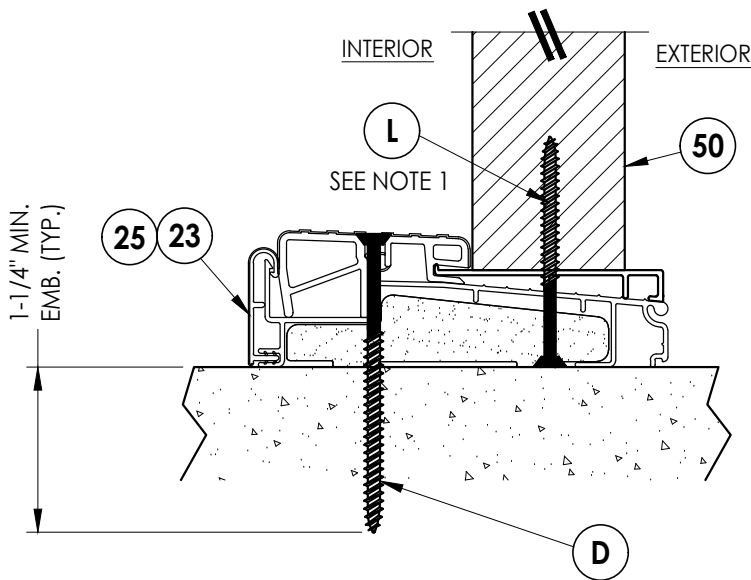

5
9 VERTICAL CROSS SECTION
Inswing sill

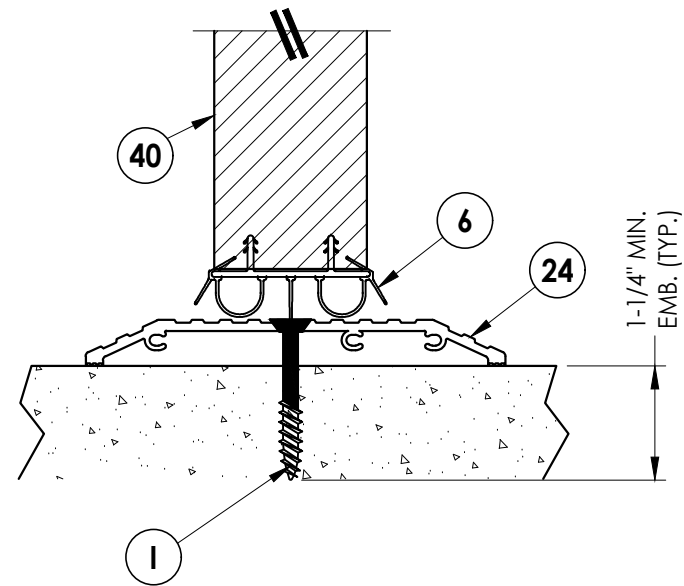


3
9 VERTICAL CROSS SECTION
ADA Sill

NOTE:
1. Spacing for item L @ head & sill: 6" from each end,
1 @ centerline, 2 additional at 3" & 4.5" from end
adjacent to door.


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: PLASTPRO IND FIBERGLASS DOOR		PART OR ASSEMBLY: VERTICAL CROSS SECTIONS (THRESHOLDS)	
		LFS	
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC	
4	8/10/23	UPDATE TO 8TH ED. (2023) FBC	
3	8/05/20	UPDATE TO 7TH ED. (2020) FBC	
NO.	DATE		
REVISIONS			
DATE: 10/08/14			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-17347.13			
SHEET 9 OF 14			

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

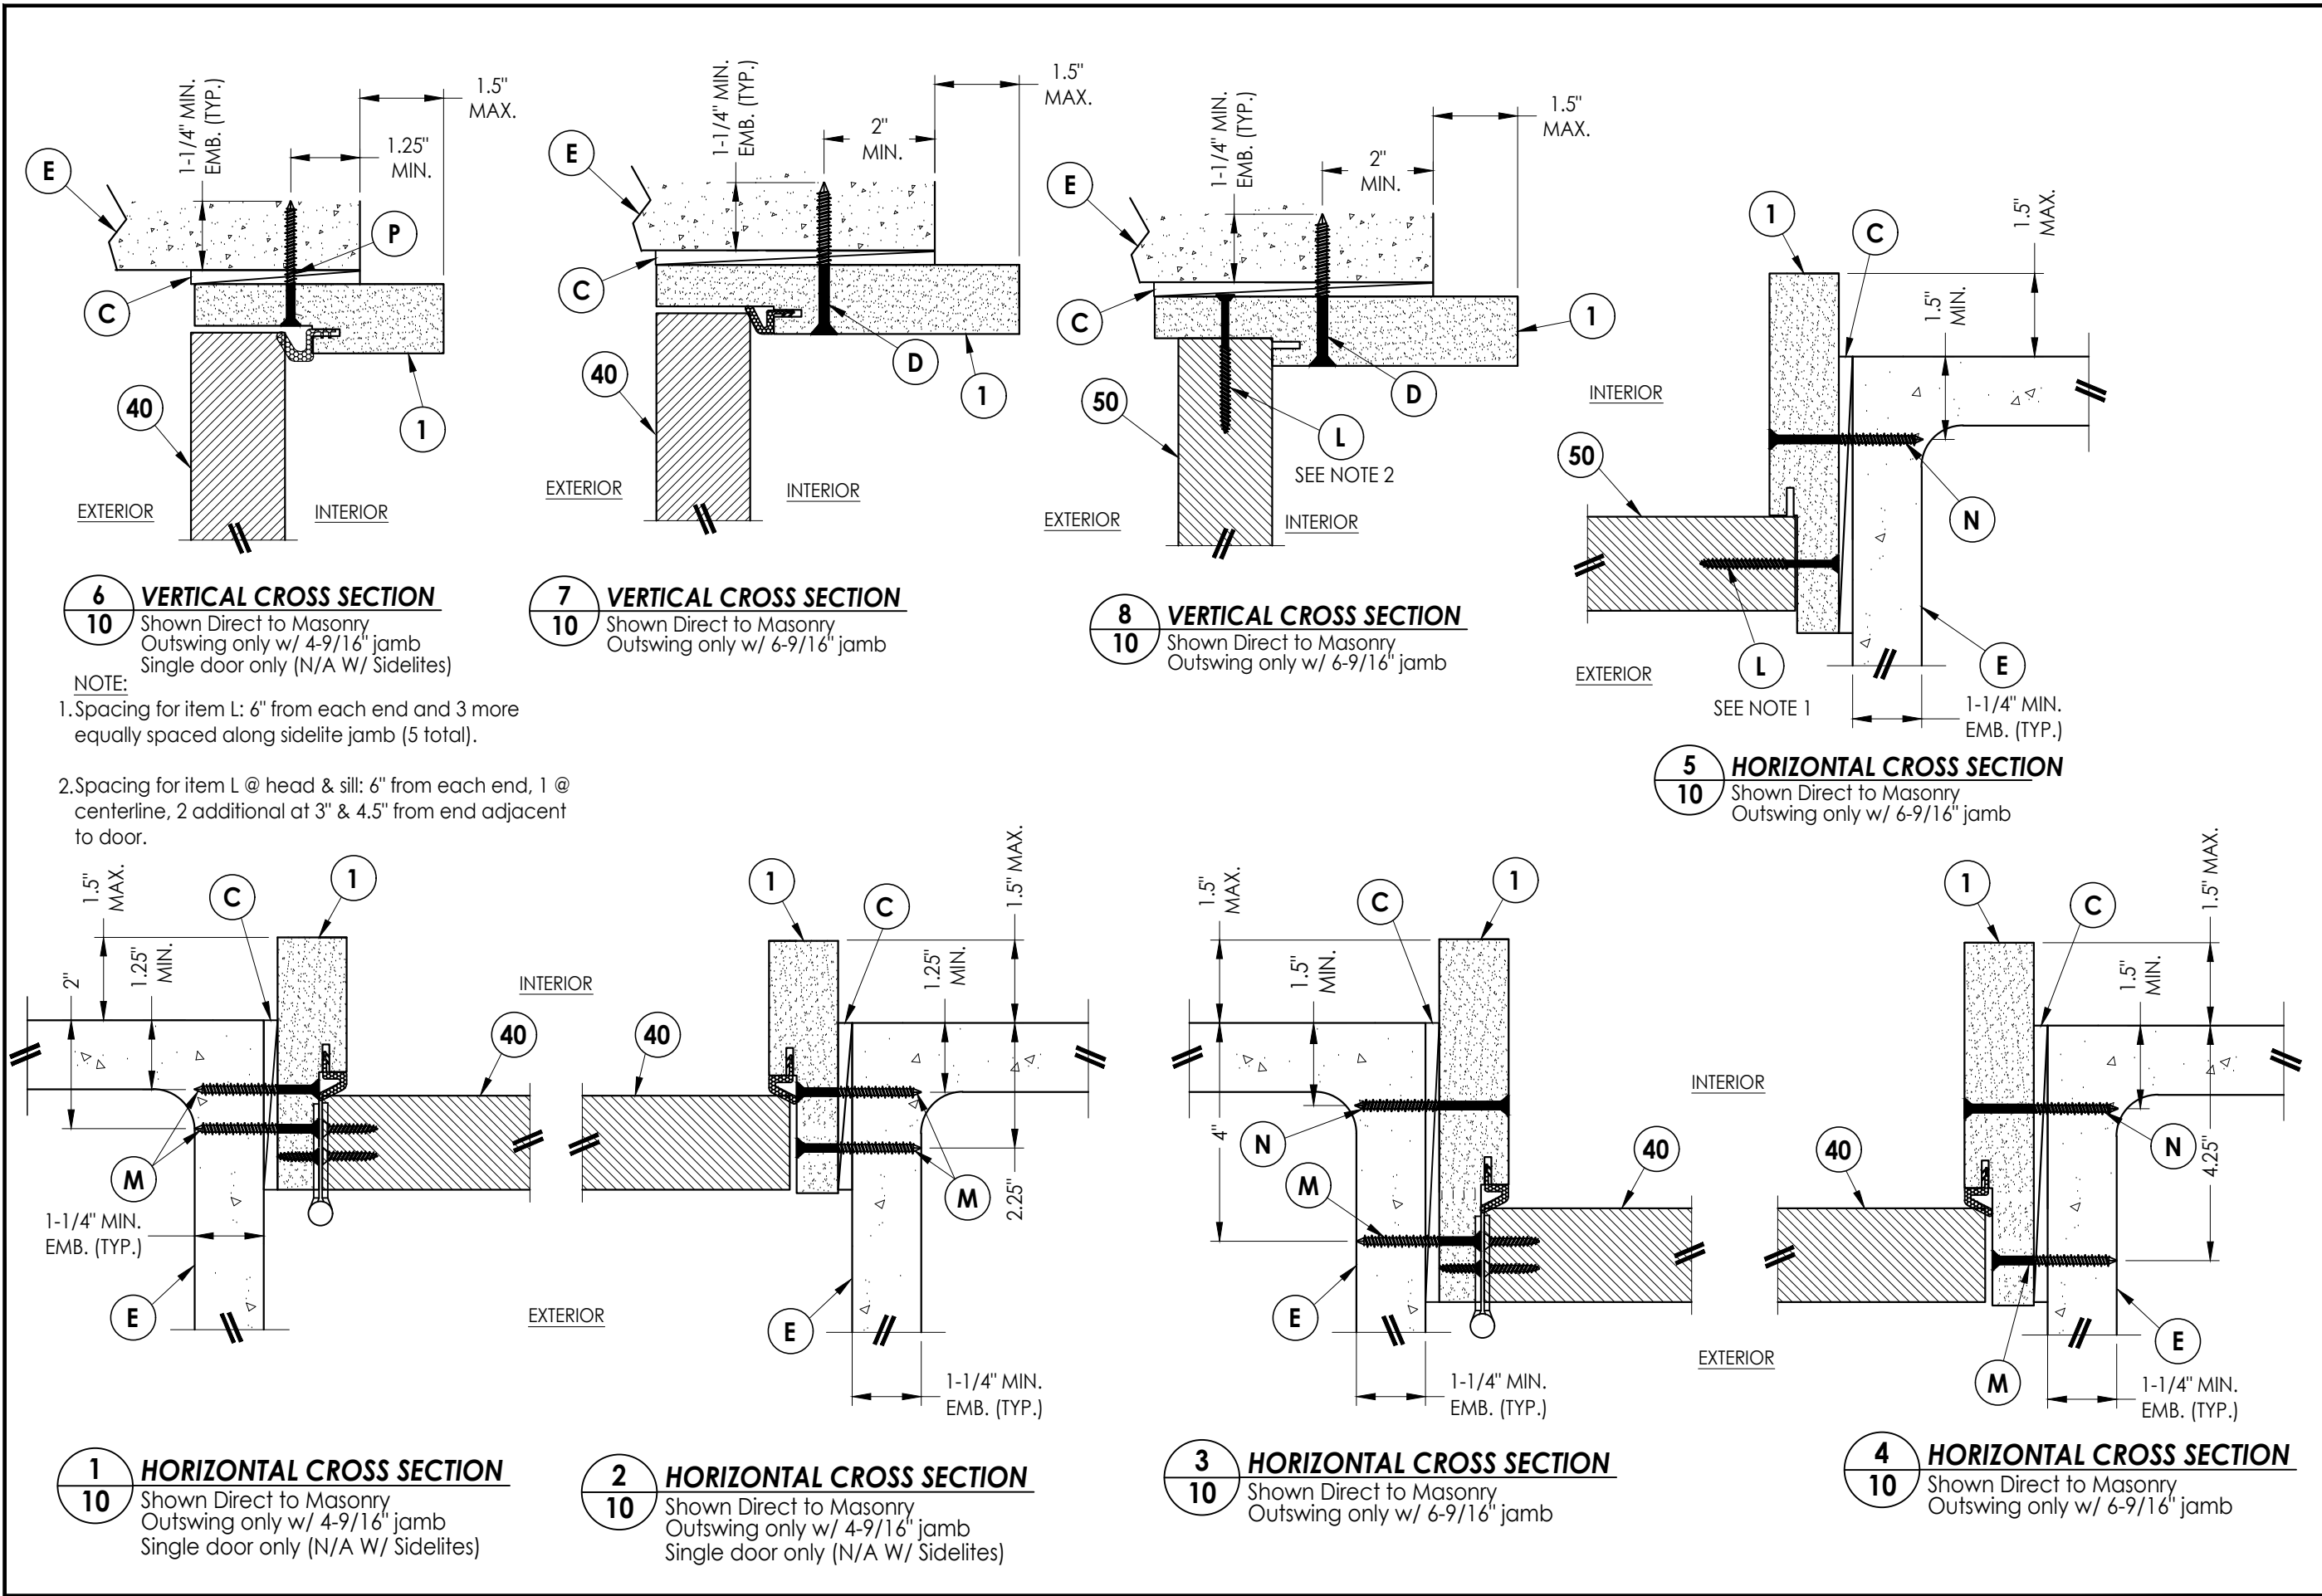


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: PLASTPRO IND FIBERGLASS DOOR				PART OR ASSEMBLY: HORIZONTAL & VERTICAL SECTIONS (DIRECT TO MASONRY)			
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS			
4	8/10/23	UPDATE TO 8TH ED. (2023)	FBC	LFS			
3	8/05/20	UPDATE TO 7TH ED. (2020)	FBC	DAC			
NO.	DATE			BY			
				REVISIONS			
DATE: 10/08/14							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-17347.13							
SHEET 10 OF 14							


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

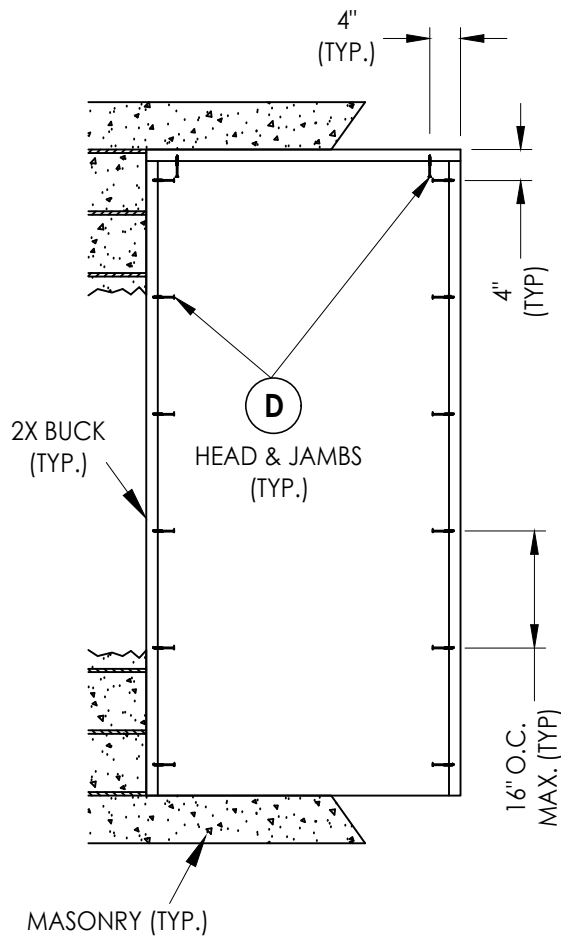

X

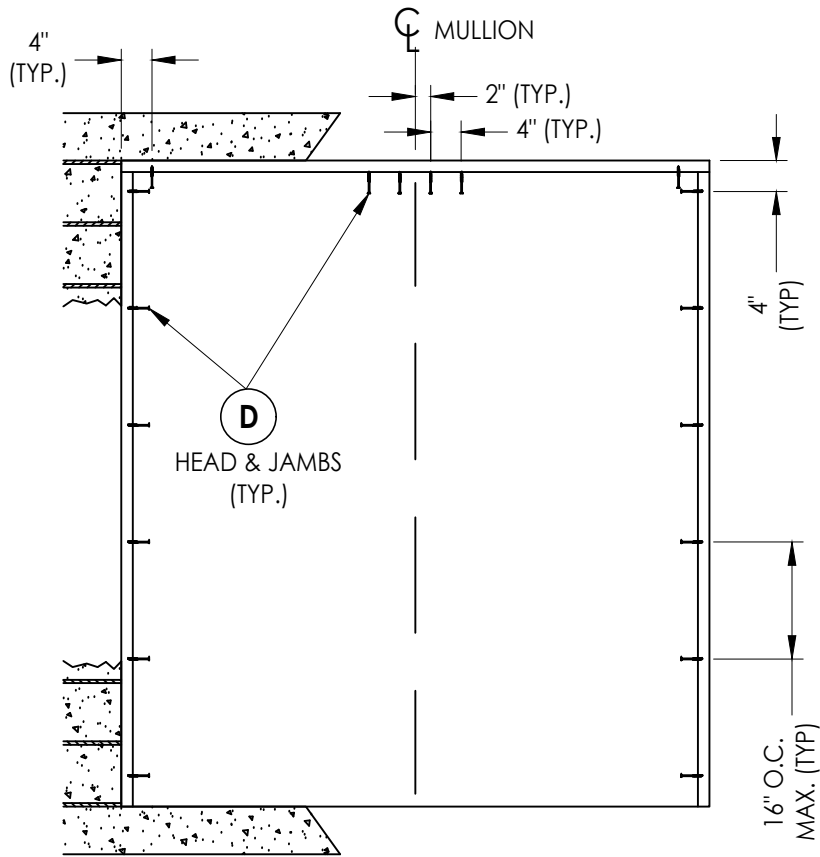

XO / OX

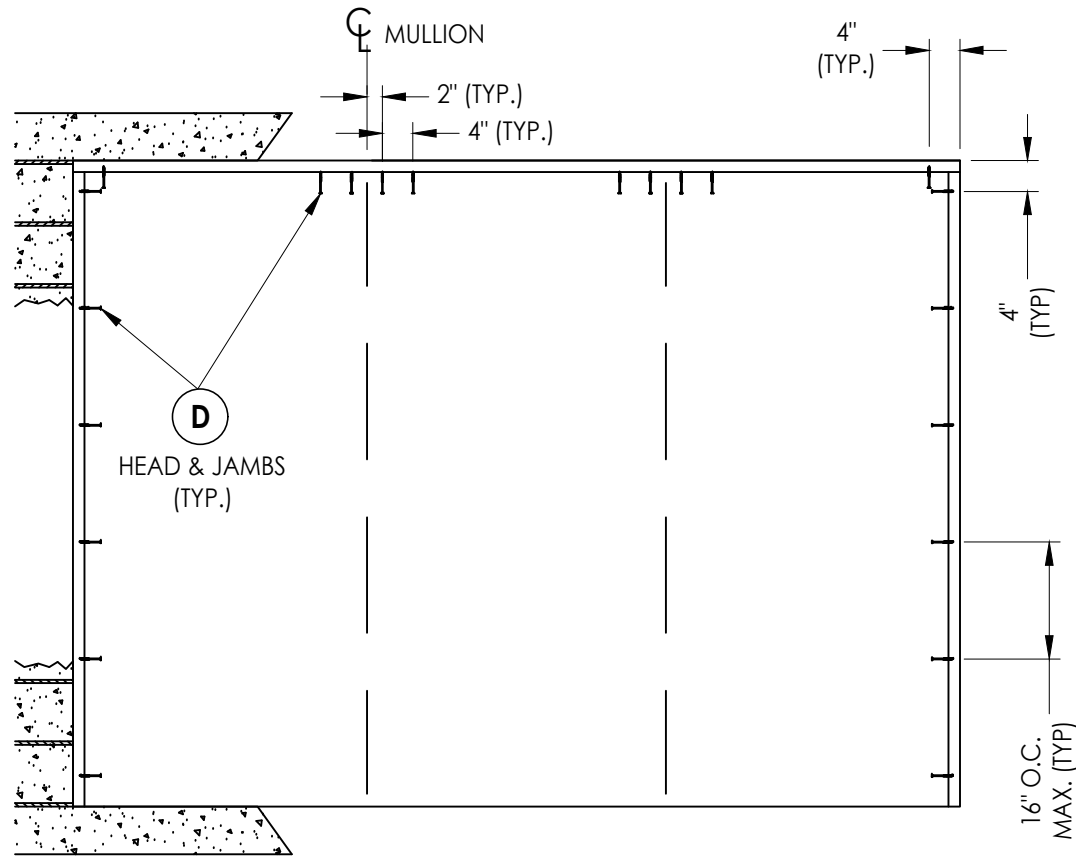

OXO

2X BUCK ANCHORING


PRODUCT:		PART OR ASSEMBLY:	
PLASTPRO IND FIBERGLASS DOOR		BUCK ANCHORING	
		LFS	LFS
		UPDATE TO 9TH ED. (2026) FBC	UPDATE TO 8TH ED. (2023) FBC
		8/10/23	8/05/20
		NO.	DATE
		BY	BY

DATE: 10/08/14
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17347.13
SHEET 11 OF 14


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

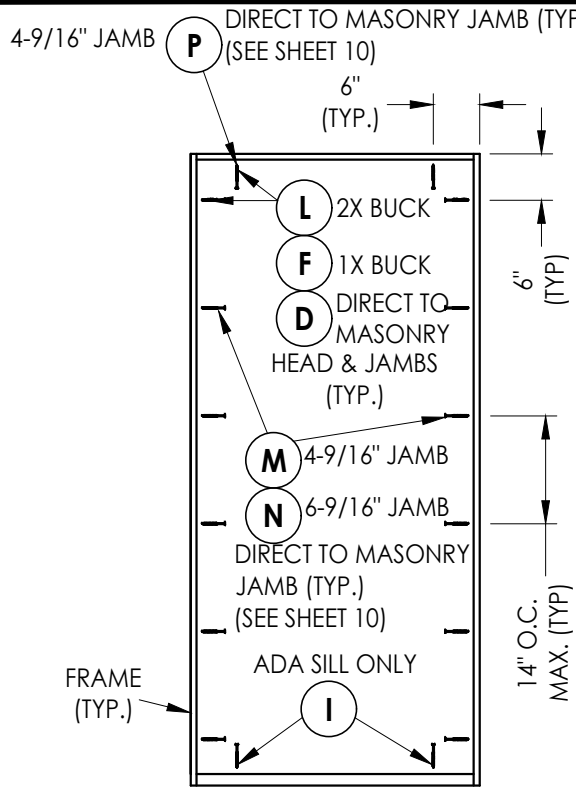

X

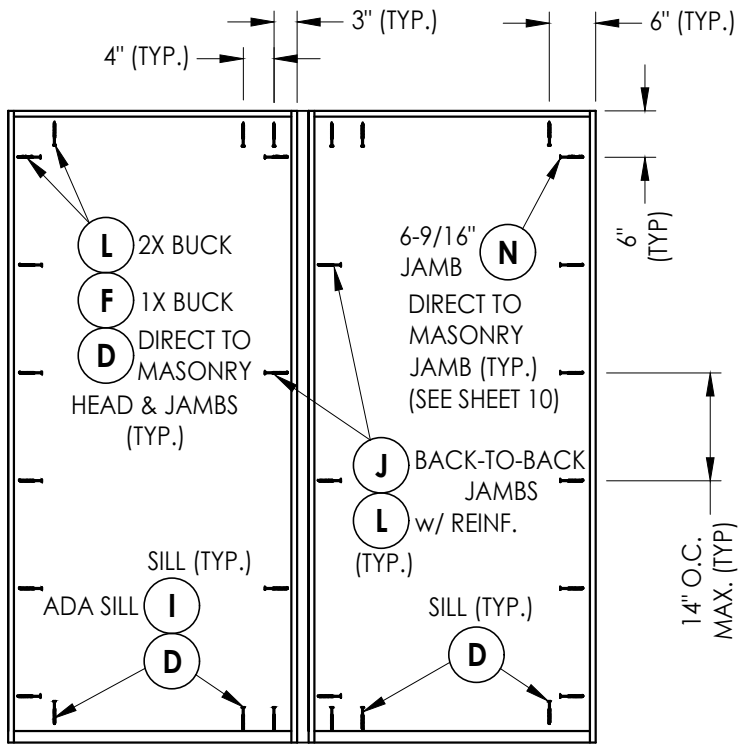

XO / OX

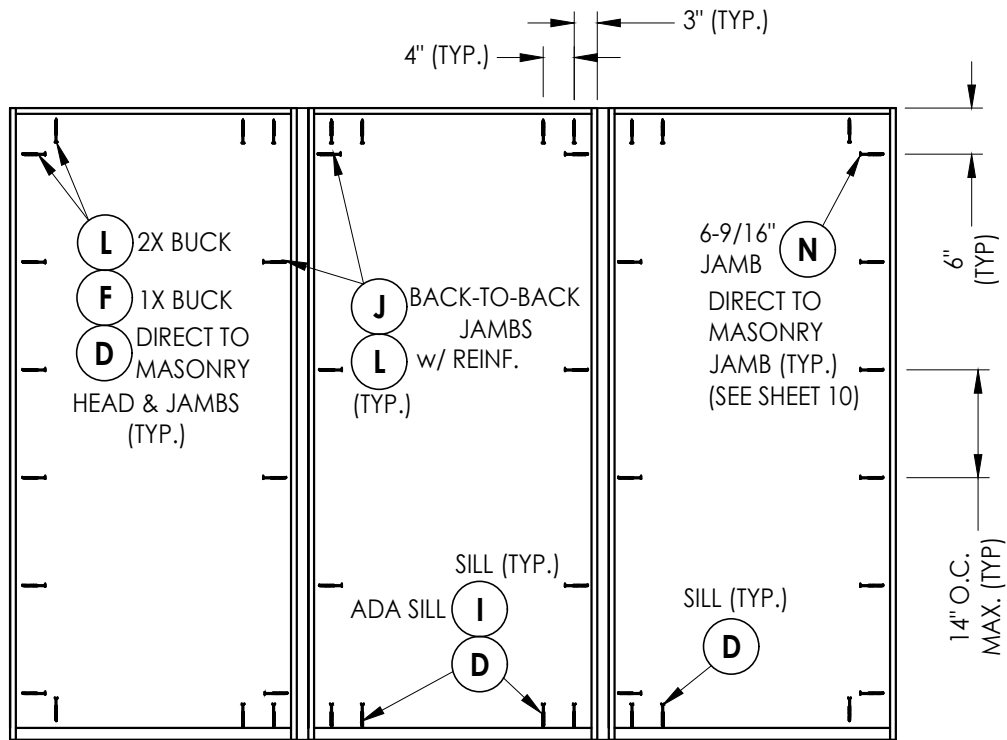


OXO


FRAME ANCHORING

CORROSION RESISTANCE - SALTWATER ENVIRONMENT


Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

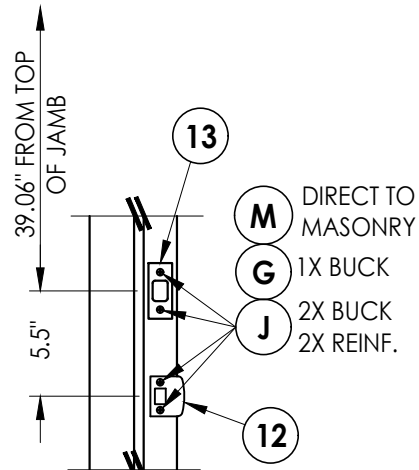


LATCH AND DEADBOLT DETAILS

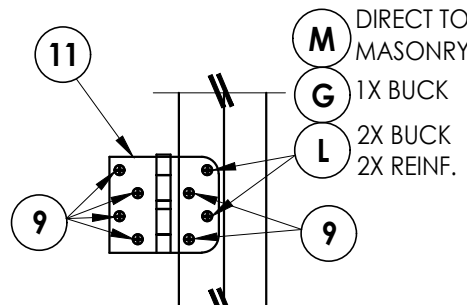

HINGE DETAIL 1

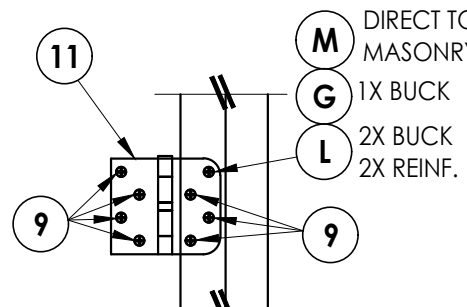

HINGE DETAIL 2

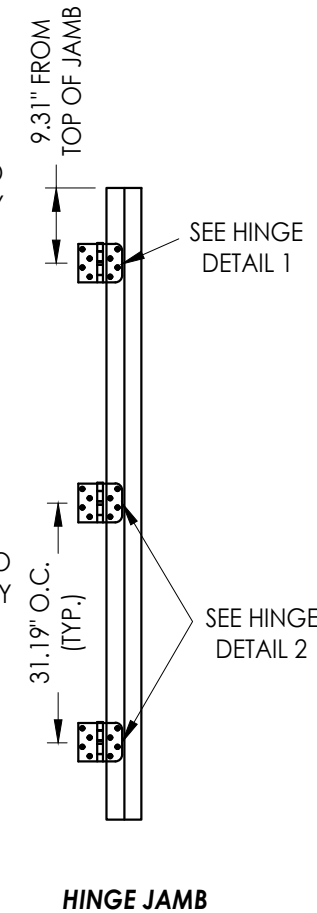

HINGE JAMB

HARDWARE DETAILS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
FRAME ANCHORING
& HARDWARE DETAILS

NO.	DATE	REVISIONS
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC
4	8/10/23	UPDATE TO 8TH ED. (2023) FBC
3	8/05/20	UPDATE TO 7TH ED. (2020) FBC
2		
1		

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-17347.13

SHEET 12 OF 14


G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

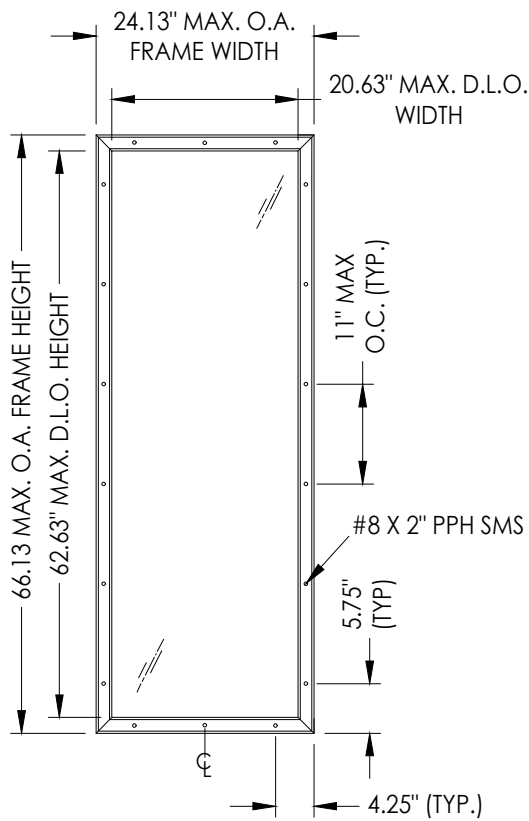


ODL LITE FRAME DETAIL
"FLAT FRAME" PROFILE

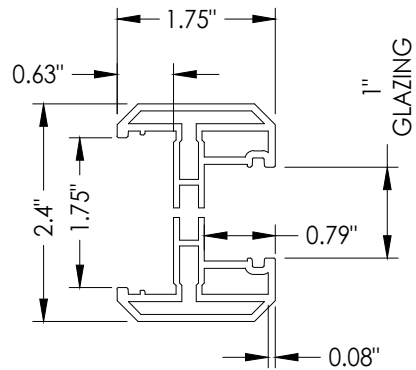



3A ODL LITE FRAME
"FLAT FRAME" PROFILE
(6063-T5 ALUM)

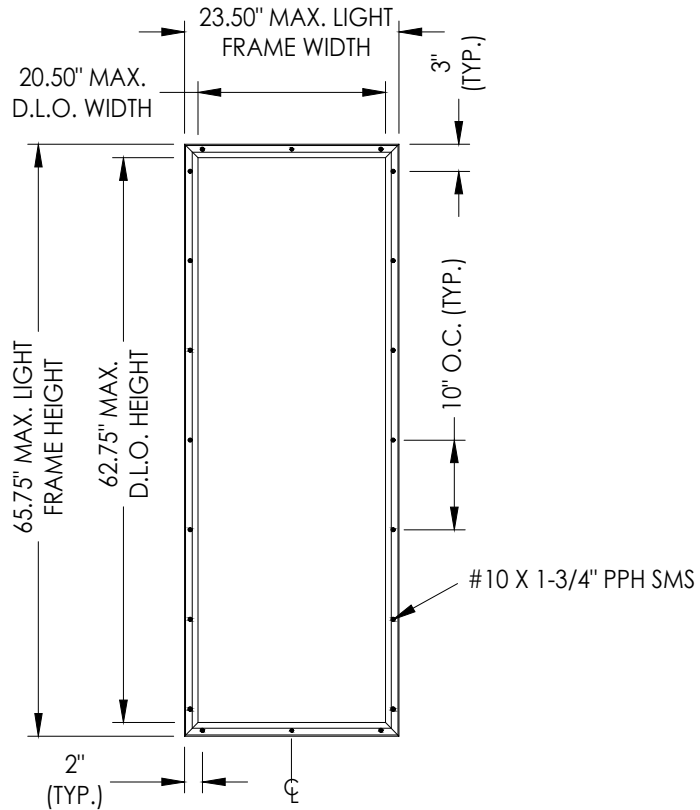

RSL LITE FRAME

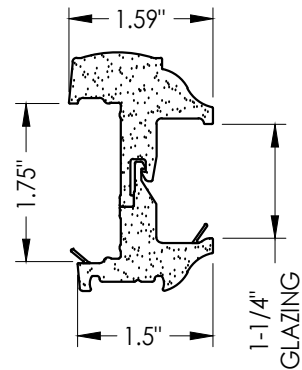

3B RSL LITE FRAME
PVC

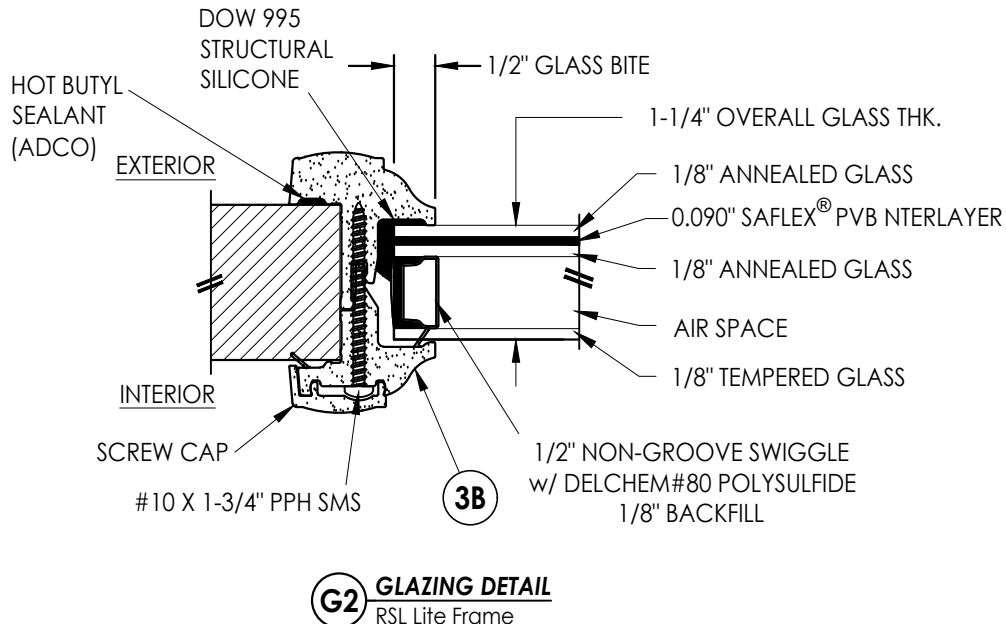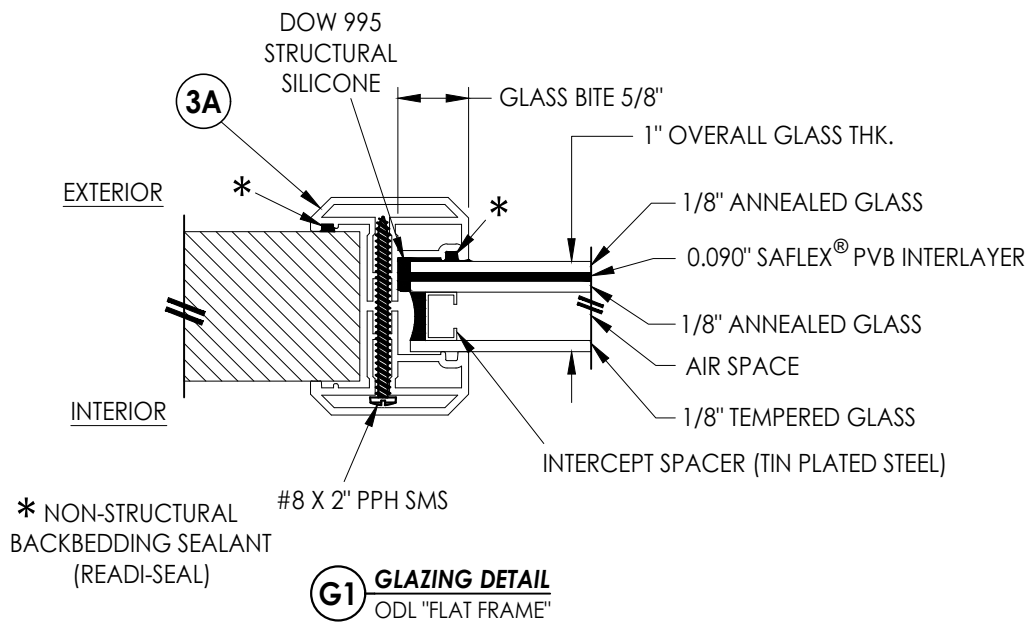

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
PLASTPRO IND
FIBERGLASS DOOR

PART OR ASSEMBLY:
LITE FRAME
GLAZING DETAILS

NO.	DATE	BY	REVISIONS
5	7/02/26	LFS	UPDATE TO 9TH ED. (2026) FBC
4	8/10/23	LFS	UPDATE TO 8TH ED. (2023) FBC
3	8/05/20	DAC	UPDATE TO 7TH ED. (2020) FBC

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-17347.13

SHEET 13 OF 14

G:\2023 FBC DRAWINGS 7-27-26\Plastpro\FL-17347 R7\FL-17347.13-14.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.42)	WOOD
B	2X BUCK (G >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" x 3-1/4" PFH ITW CONCRETE SCREW	STEEL
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
J	#10 X 2" PFH WOOD SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMB.)	STEEL
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL
P	1/4" X 2-1/4" PFH DeWALT CONCRETE SCREW	STEEL
1	POLY FIBER JAMB	COMP.
4	1X REINFORCEMENT (G >= 0.55)	WOOD
5	2X REINFORCEMENT (G >= 0.55)	WOOD
6	DOOR SWEEP	PVC
7	WEATHERSTRIP (ENDURA FORCE 5)	FOAM
9	#9 x 3/4" PFH WOOD SCREW	STEEL
11	4" X 4" HINGE	STEEL
12	LATCH STRIKE PLATE	STEEL
13	DEADBOLT STRIKE PLATE	STEEL
20	INSWING THRESHOLD	ALUM/COMP
21	INSWING THRESHOLD w/ SIDELITE ADAPTER	ALUM/COMP
22	OUTSWING THRESHOLD	ALUM/COMP
23	OUTSWING THRESHOLD w/ SIDELITE ADAPTER	ALUM/COMP
24	ADA THRESHOLD	ALUM
25	OUTSWING THRESHOLD	ALUM/COMP
26	INSWING THRESHOLD	ALUM/COMP
40	DOOR PANEL	-
50	SIDELITE PANEL	-



CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

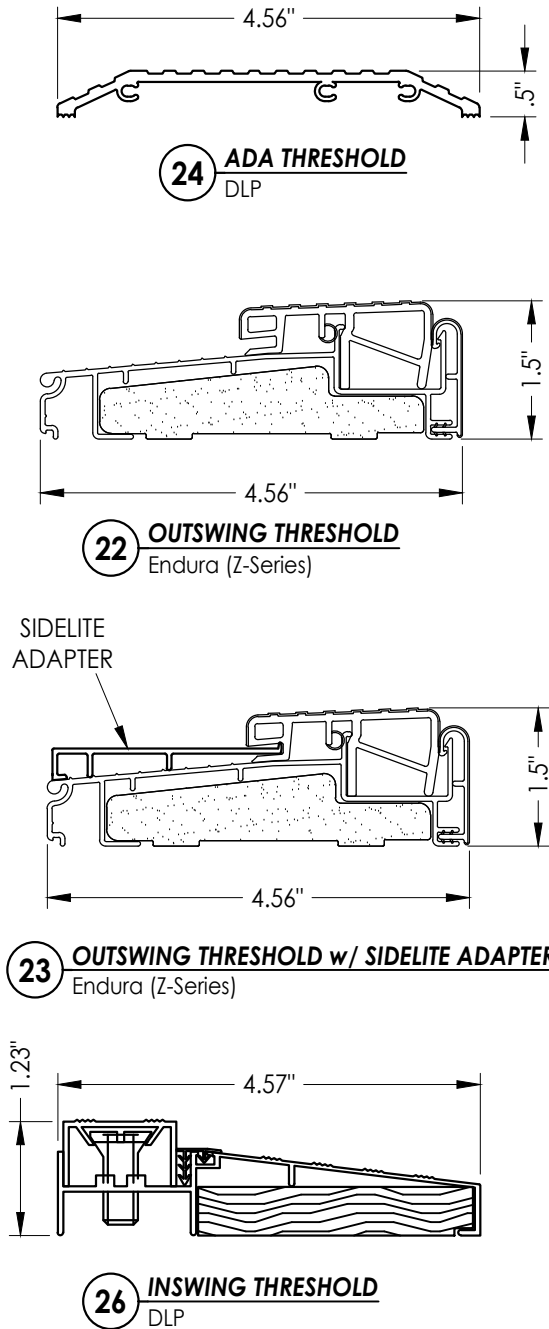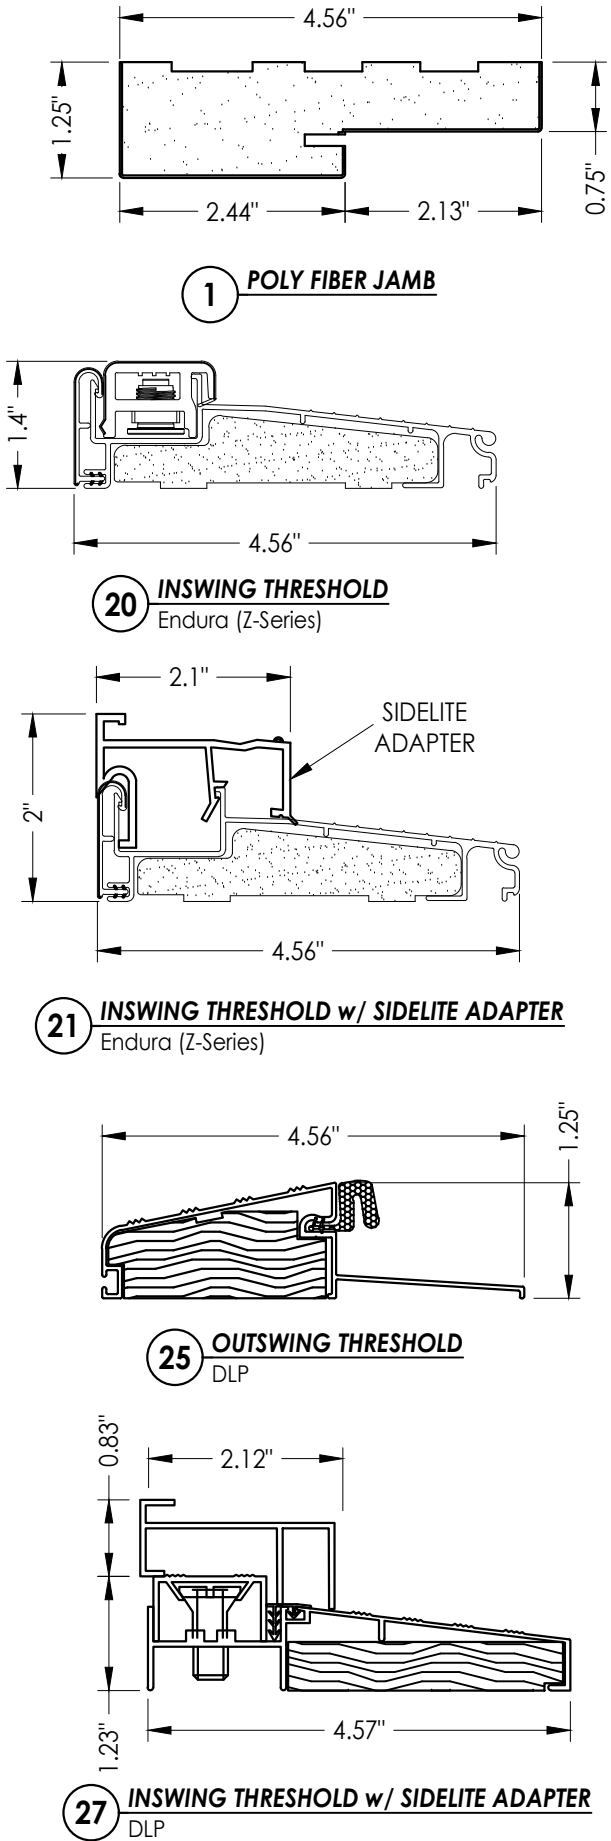

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: PLASTPRO IND FIBERGLASS DOOR

PART OR ASSEMBLY:
BILL OF MATERIALS & COMPONENTS

			LFS	LFS	DAC	BY
			UPDATE TO 9TH ED. (2026) FBC	UPDATE TO 8TH ED. (2023) FBC	UPDATE TO 7TH ED. (2020) FBC	
5	7/02/26					
4	8/10/23					
3	8/05/20					
	NO.	DATE				
REVISIONS						

DATE: 10/08/14

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-17347.13

SHEET 14 OF 14