



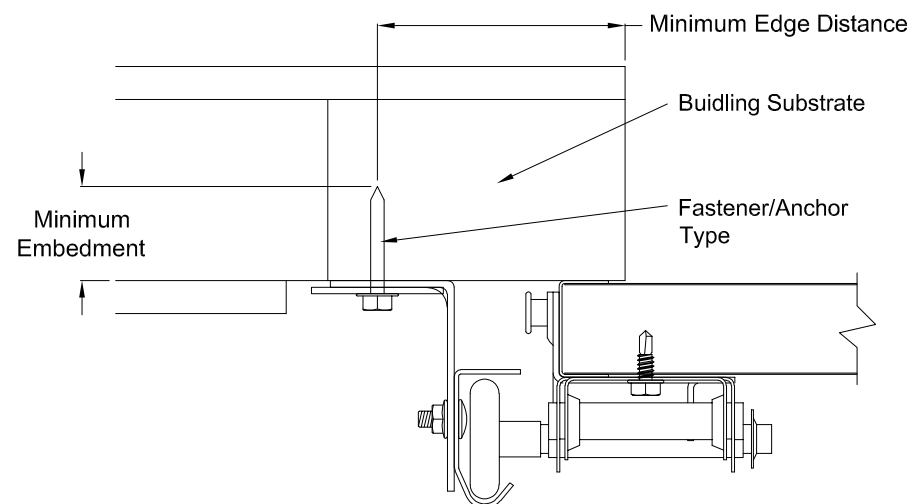

Direct Mounting Detail

DIRECT MOUNTING					
Building Substrate	Fastener Type	Minimum Embedment	Minimum Fastener Length	Minimum Edge Distance	Minimum on Center Spacing
Southern Pine (SYP)	5/16" Dia. Lag Screw w/1-1/8" OD Flat Washer (shall conform to ANSI/ASME standard B18.2.1)	-	1-5/8"	1/2"	-
Spruce-Pine-Fur (SPF)	5/16" Dia. Lag Screw w/1-1/8" OD Flat Washer (shall conform to ANSI/ASME standard B18.2.1)	-	2-1/4"	1/2"	-
Min. 2500 PSI Concrete	3/8" Dia. Ankr-Tite CCAT w/1-1/8" OD Flat Washer (by Wej-It Fastening Systems)	2-3/8"	-	2-1/2"	6"
Min. 2500 PSI Concrete	1/4" Dia. Tapcon+ by ITW w/1-1/8" OD Flat Washer	2"	-	2-1/2"	5"
Min. 2500 PSI Concrete	1/4" Dia. Wedge-Bolt+ by Powers Fasteners w/1-1/8" OD Flat Washer	1-3/4"	-	2-1/2"	5"
Min. 2500 PSI Concrete	1/4" Dia. Red Head TruBolt wedge anchor by ITW w/1-1/8" OD Flat Washer	1-3/4"	-	2-1/2"	5"
1/8" GA Steel Minimum	5/16"-12 Tek Self-Drilling Screw w/1-1/8" OD Flat Washer	-	1"	-	-
3/16" GA Steel	Fillet Weld	See DASMA Technical Data Sheet TDS-161, section G			

NOTE: Doors are available with jamb brackets or commercial full angle. In either case the the maximum spacing noted on sheet 1 should be maintained for the brackets, clips and fasteners for direct mount.

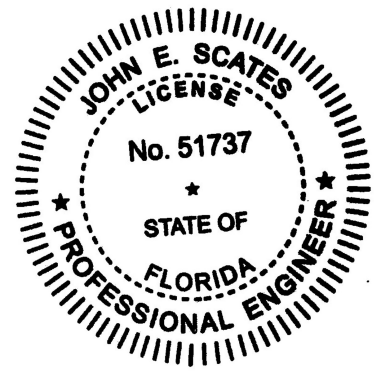

John E. Scates, P.E.
8811 Teel Pkwy Ste 100 #5175
Frisco, Texas 75036
Florida P.E. # 51737

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

IMPACT RESISTANT

FL #17430.1



320 Sycamore
Wauseon, Ohio 43567
© Copyright 2014

REVISIONS				
REV.	ZONE	BY	DESCRIPTION	DATE
A		MVS	SEE DRAWING LOG SHEET FOR CHANGES	2/5/15
B		MVS	SEE DRAWING LOG SHEET FOR CHANGES	6/5/15
C		MVS	SEE DRAWING LOG SHEET FOR CHANGES	8/8/16
D		MVS	SEE DRAWING LOG SHEET FOR CHANGES	9/11/17
E		MVS	SEE DRAWING LOG SHEET FOR CHANGES	7/23/19
F		MVS	SEE DRAWING LOG SHEET FOR CHANGES	10/7/21
G		MVS	SEE DRAWING LOG SHEET FOR CHANGES	8/23/23
H		MVS	SEE DRAWING LOG SHEET FOR CHANGES	1/20/25

DESCRIPTION: 9' 2" HT 600, 700, 2000, 800 & 9000 SERIES HVHZ WIND LOAD SECTIONAL DOOR DESIGN PRESSURE +65.0/-65.0 PSF			
DRAWING NO.: WL-0600-0110-08-65-65HVHZ			REV. H
DRAWN BY: MVS	DATE DRAWN: 12/1/14	REV. DATE: 1/20/25	
MODEL(S): See Sheet 3			SHEET: 4 OF 4