


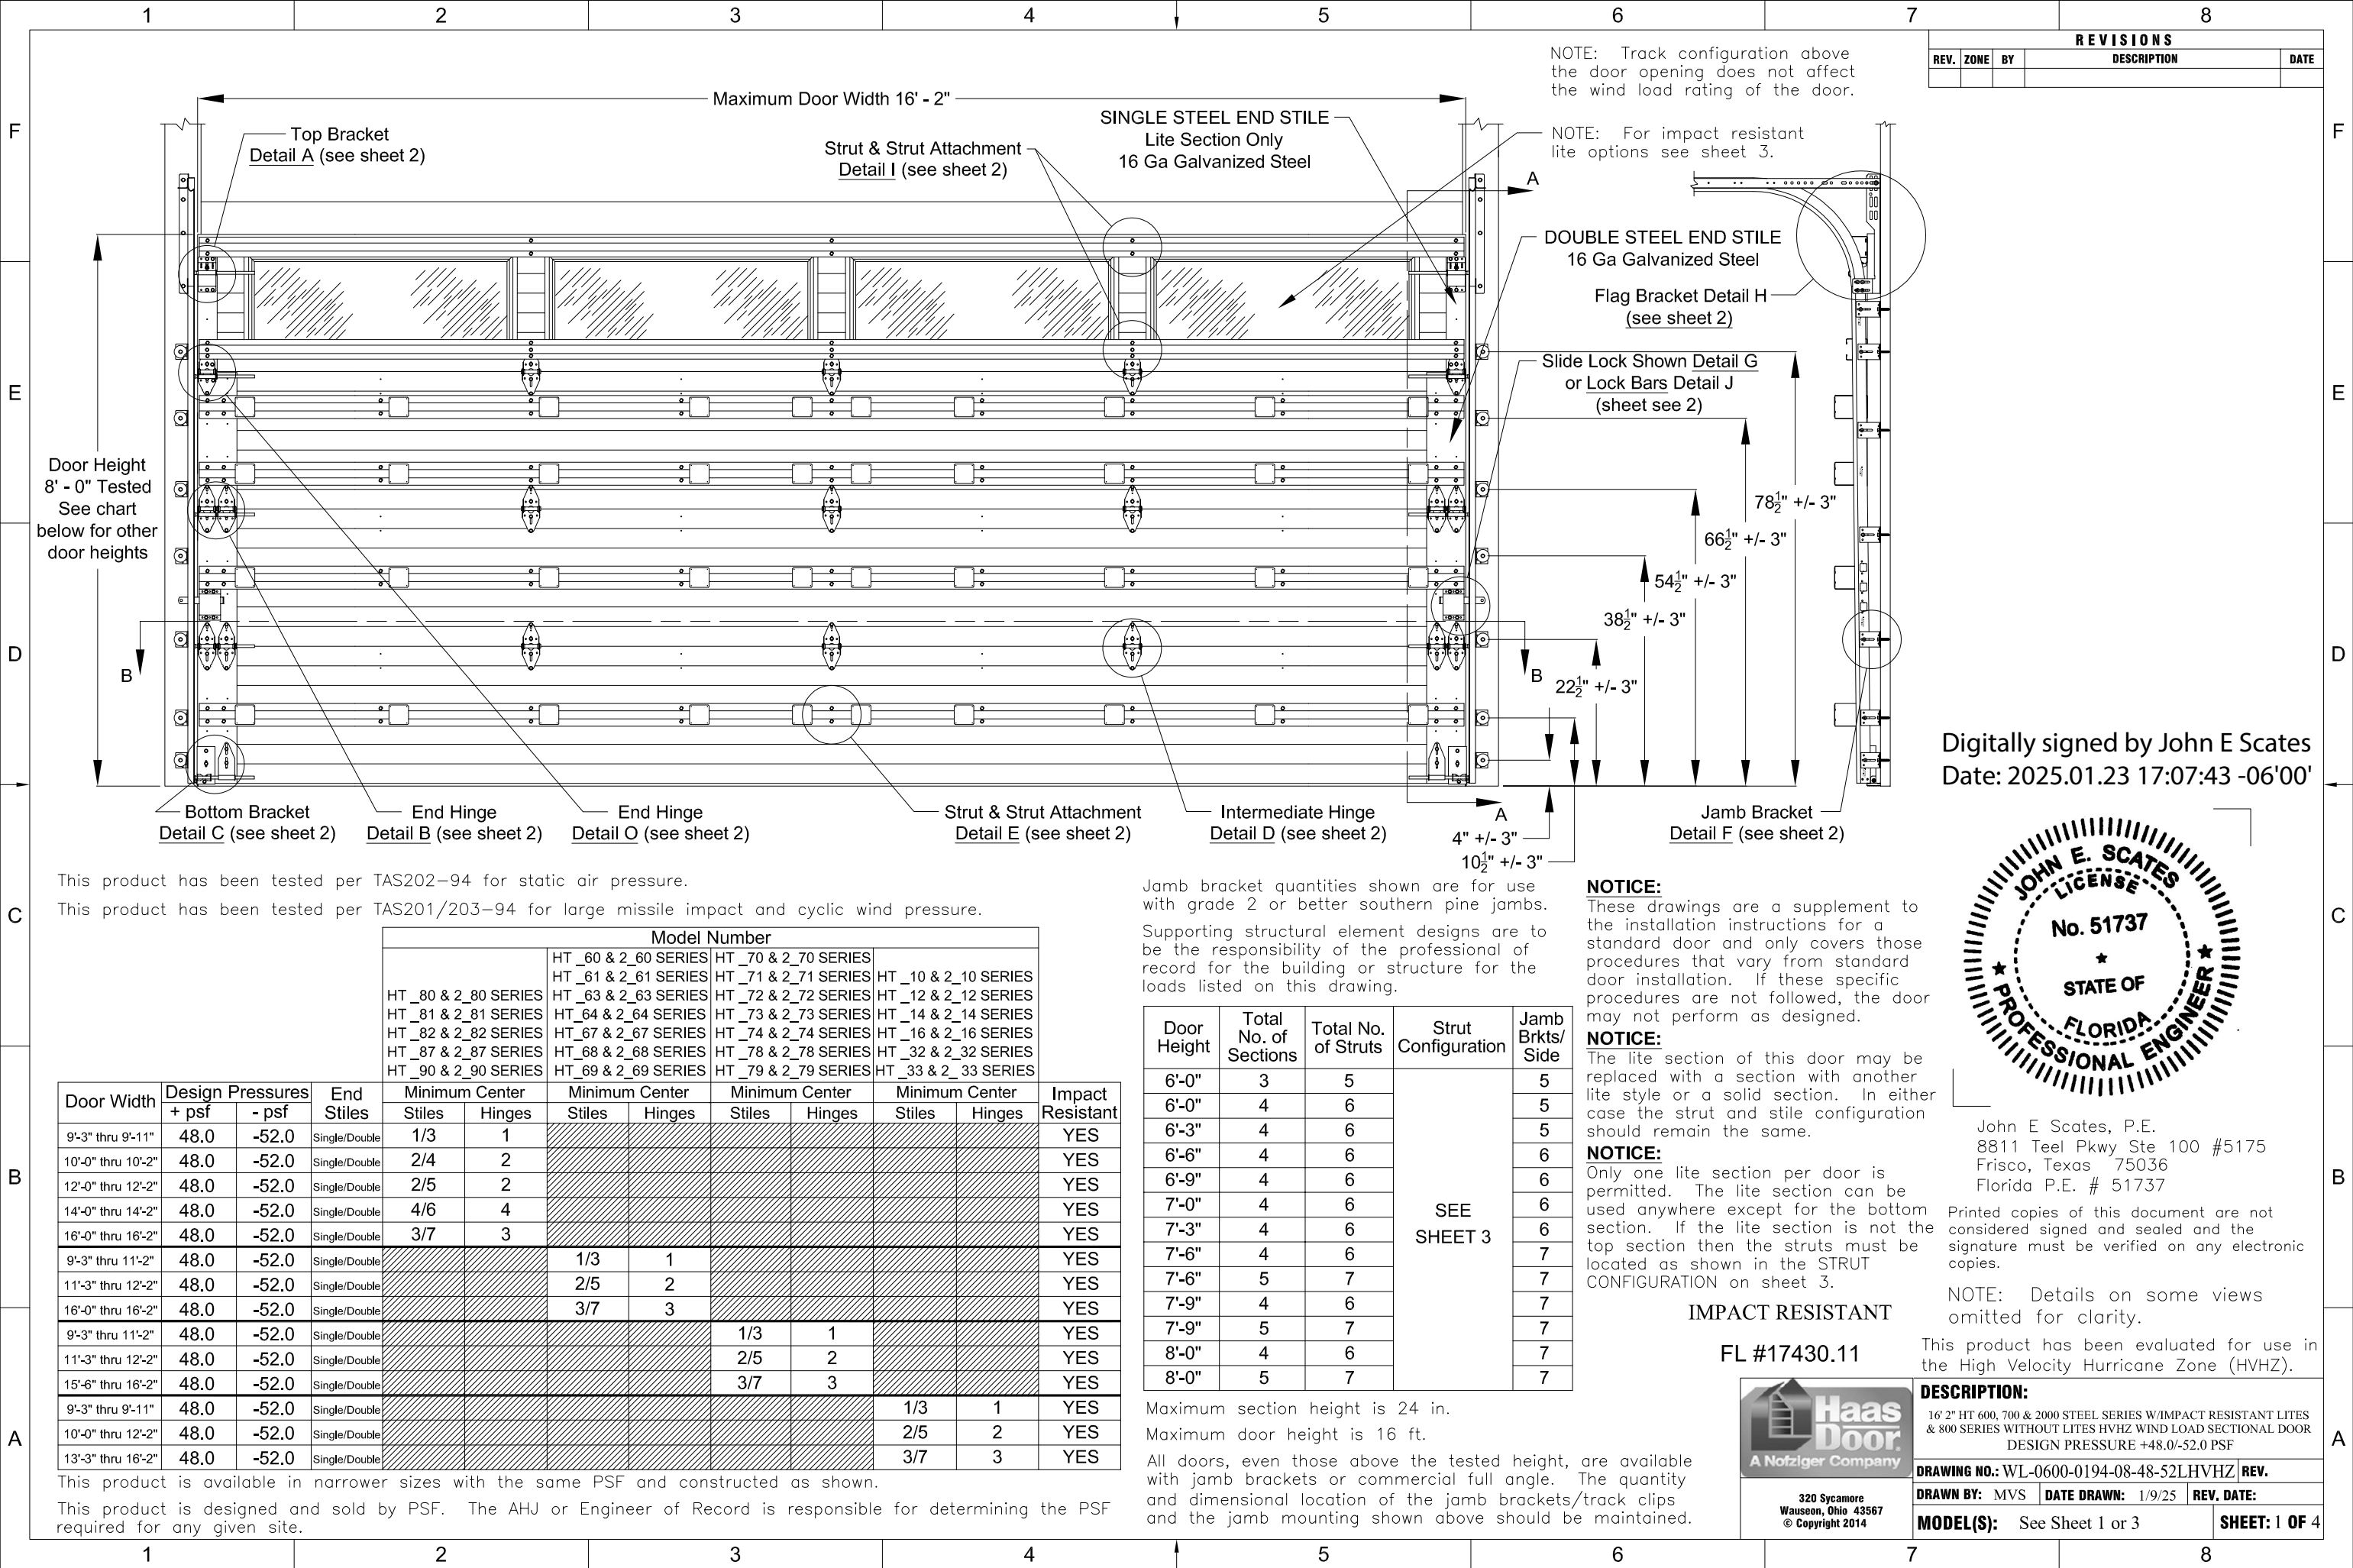

IMPACT RESISTANT

FL #17430.11

Haas Door
A Nofziger Company

320 Sycamore
Wauseon, Ohio 43567
© Copyright 2014

DESCRIPTION:

16' 2" HT 600, 700 & 2000 STEEL SERIES W/IMPACT RESISTANT LITES & 800 SERIES WITHOUT LITES HVHZ WIND LOAD SECTIONAL DOOR DESIGN PRESSURE +48.0/-52.0 PSF

DRAWING NO.: WL-0600-0194-08-48-52LHVHZ


DRAWN BY: MVS

DATE DRAWN: 1/9/25


REV. DATE:

MODEL(S): See Sheet 1 or 3

SHEET: 1 OF 4

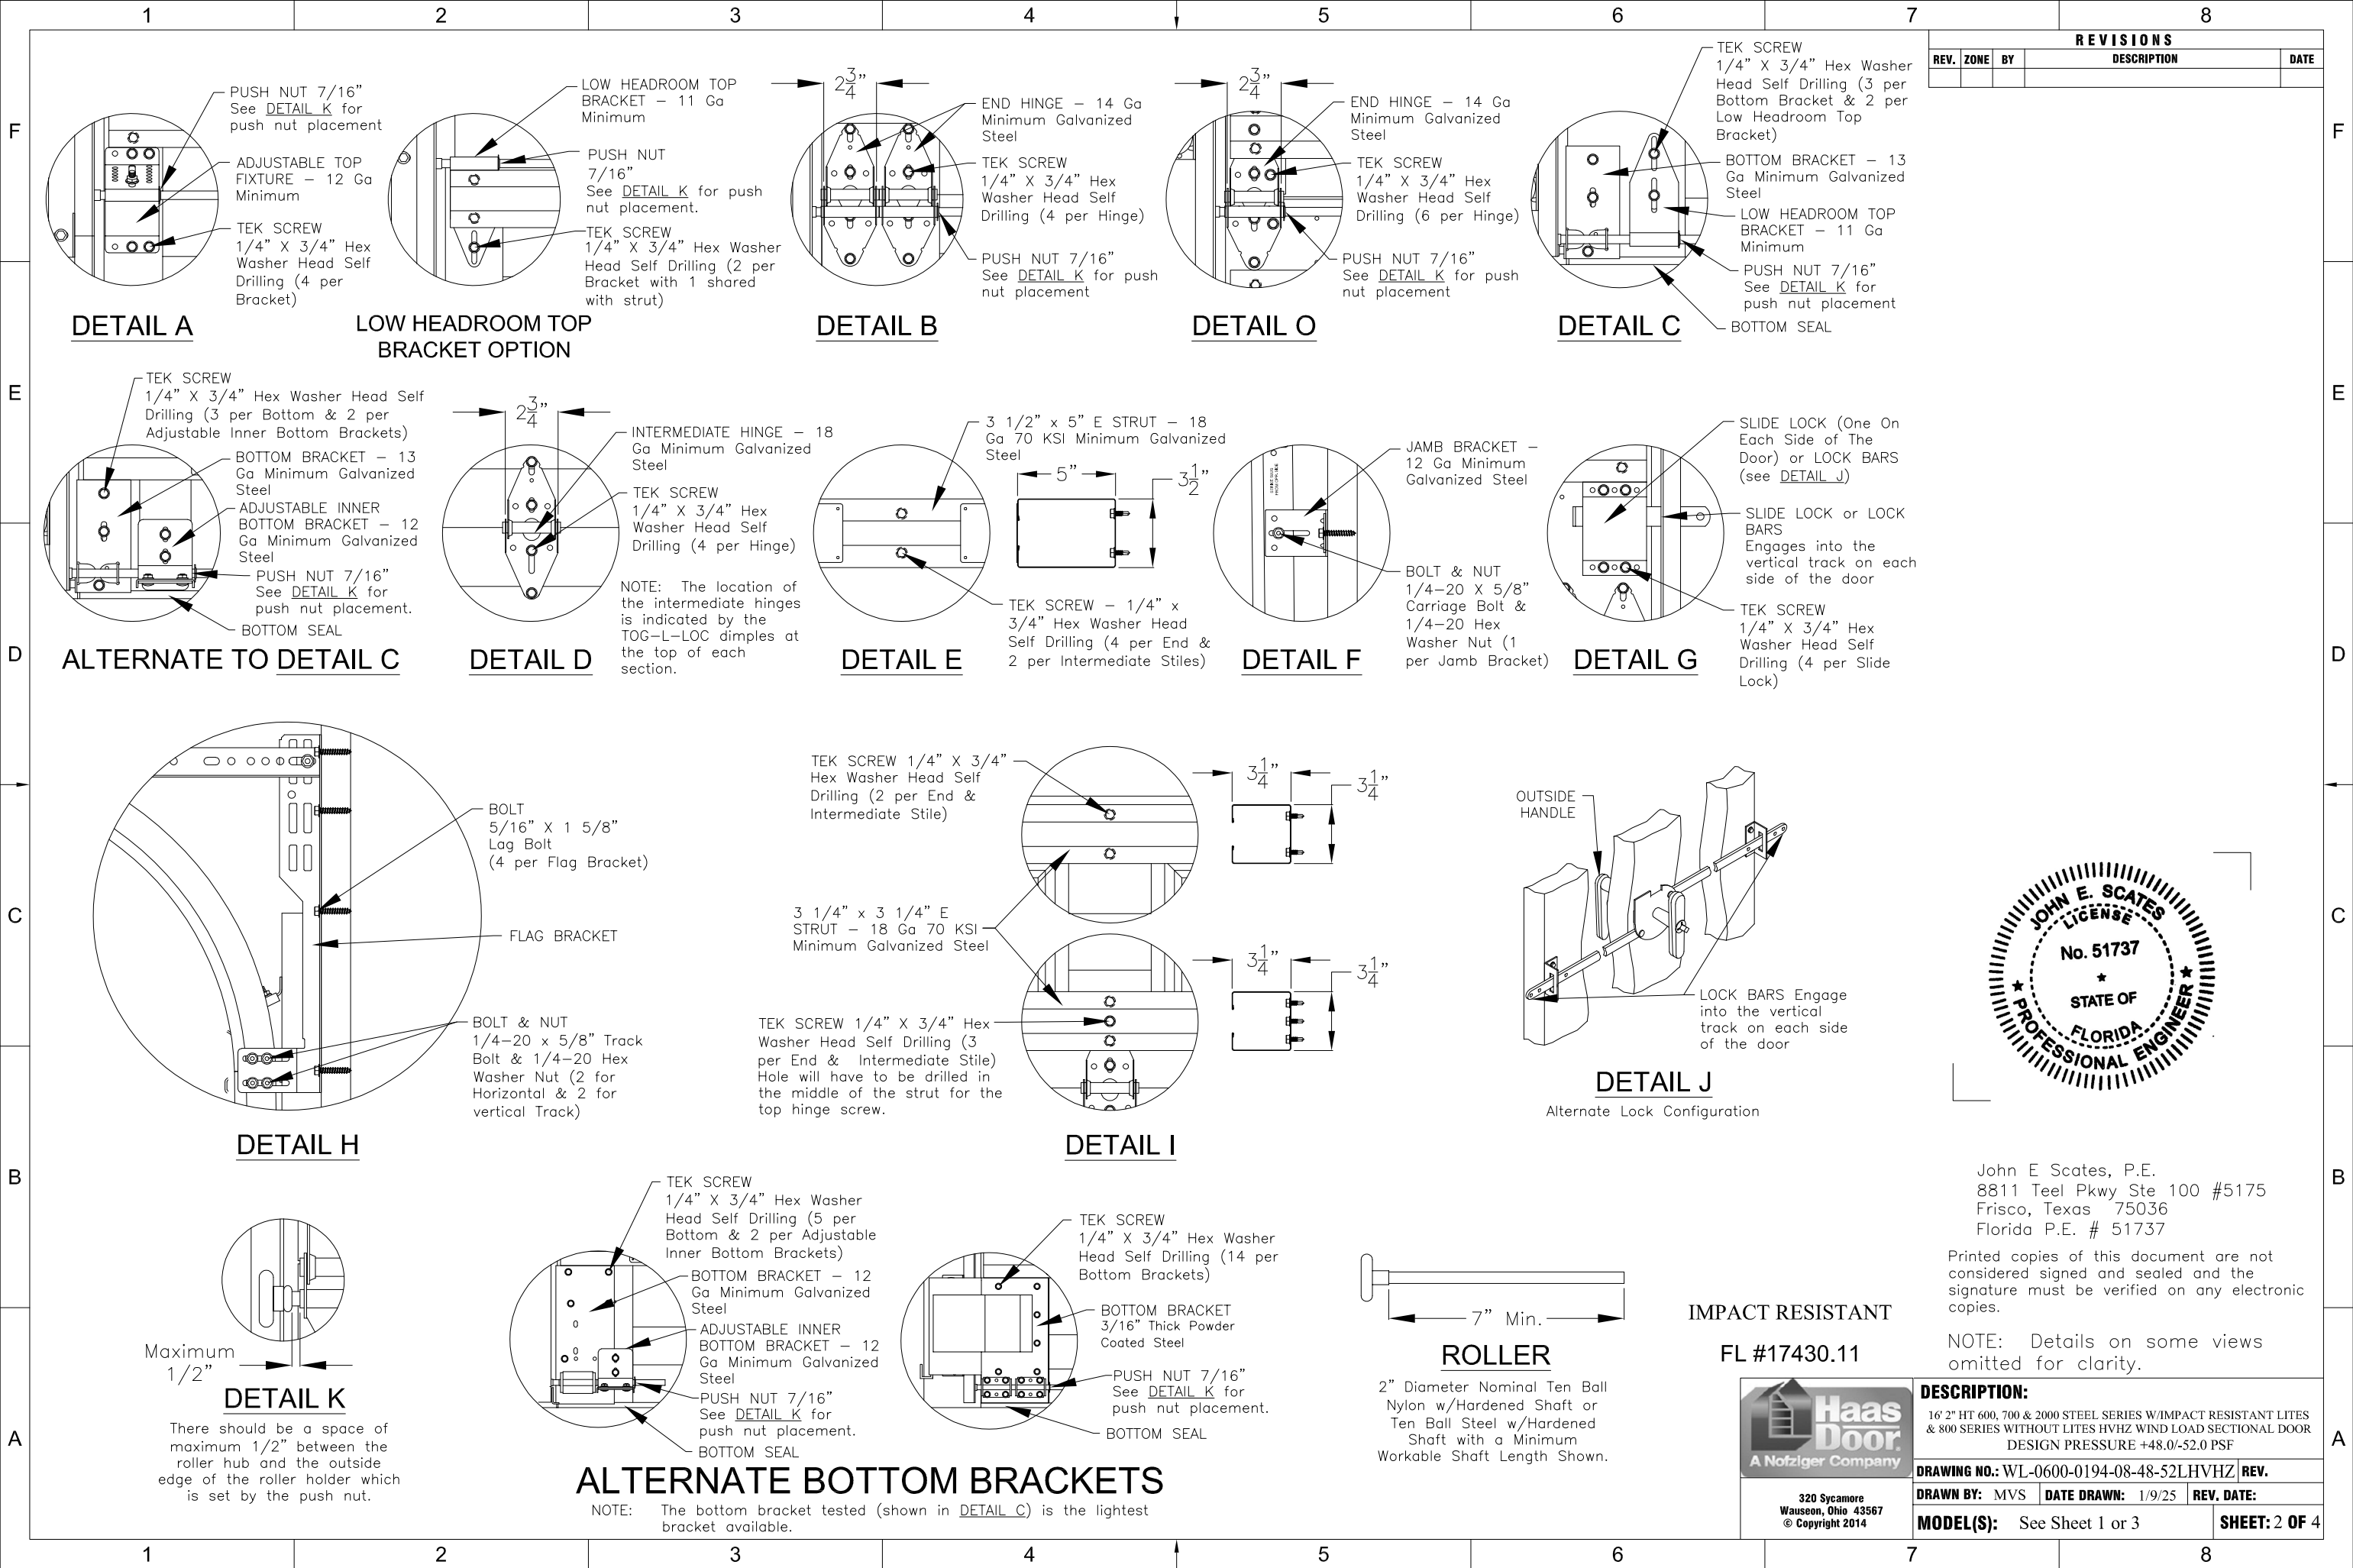

REVISIONS				
REV.	ZONE	BY	DESCRIPTION	DATE

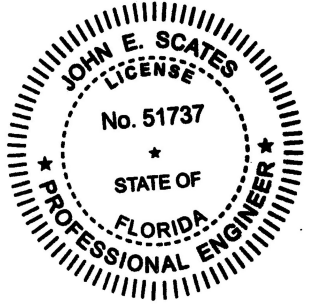


John E Scates, P.E.
8811 Teel Pkwy Ste 100 #5175
Frisco, Texas 75036
Florida P.E. # 51737

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

NOTE: Details on some views omitted for clarity.

DESCRIPTION: 16' 2" HT 600, 700 & 2000 STEEL SERIES W/IMPACT RESISTANT LITES & 800 SERIES WITHOUT LITES HVHZ WIND LOAD SECTIONAL DOOR DESIGN PRESSURE +48.0/-52.0 PSF	
DRAWING NO.: WL-0600-0194-08-48-52LHVHZ	REV.
DRAWN BY: MVS	DATE DRAWN: 1/9/25
MODEL(S): See Sheet 1 or 3	REV. DATE:
SHEET: 2 OF 4	



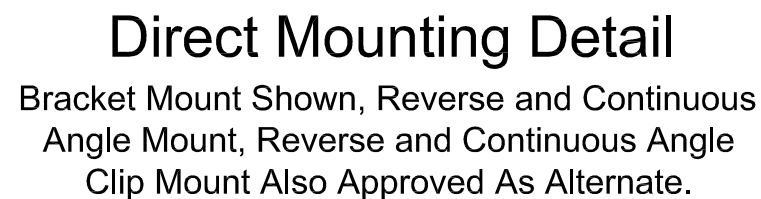

NOTE: Doors are available with jamb brackets or commercial full angle. In either case the the maximum spacing noted on sheet 1 should be maintained for the brackets, clips and fasteners for direct mount.

FASTENER TO CONTINUE PAST HEADER

2 X 6 GRADE 2 OR BETTER SOUTHERN PINE JAMBS.
(SEE CHART BELOW FOR WOOD JAMB ATTACHMENT TO BUILDING STRUCTURE.)

OPENING WIDTH

OPENING HEIGHT



WOOD JAMB ATTACHMENT						
Building Structure	Fastener Type	Minimum Embedment	Minimum Edge Distance	Minimum on Center Spacing	Maximum on Center Spacing	Allowable Tension Load
Min. 2500 PSI to 4000 PSI Concrete	1/4" Tapcon + (PLUS) w/ 1-1/4" OD washer	2"	2.50"	5.00"	16"	551
	1/4" POWERS Wedge-Bolt + or 1/4" ITW TruBolt w/1-1/4" OD washer	1.75"				
Southern Pine	3/8" Lag w/ 1 1/8" OD washer	1.50"	1.50"	1.50"	18"	620
Spruce Pine Fir	3/8" Lag w/ 1 1/8" OD washer	1.50"	1.50"	1.50"	14"	482

Wood jambs can be counter bored up to 3/8" deep at fastener location to provide flush mounting.

MAXIMUM ON CENTER SPACING

FIRST FASTENER 4" to 10" ABOVE THE FLOOR

NOTE: 2X6 mounted to the wall must be Southern Pine Grade 2 or better.

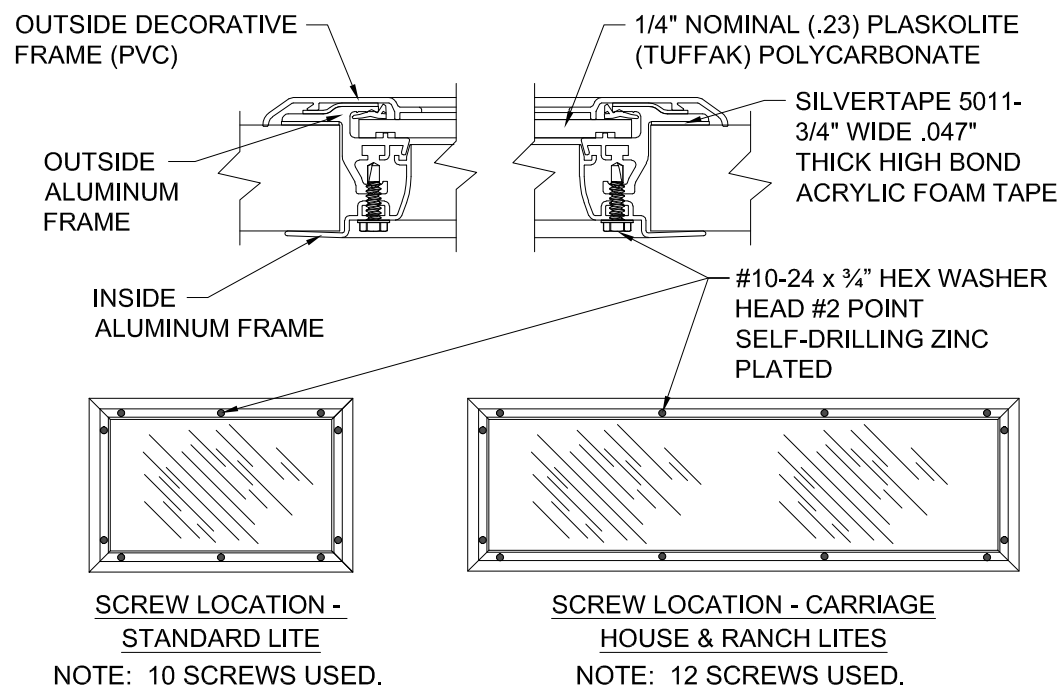

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

NOTE: Details on some views omitted for clarity.

NOTE: ALL GLAZING IS IMPACT RESISTANT
PLASKOLITE (TUFFAK) GENERAL PURPOSE OR
UV RESISTANT POLYCARBONATE WITH A $\frac{1}{4}$
NOMINAL (.23) THICKNESS.

IMPACT RESISTANT

FL #17430.11

**DESCRIPTION:**

16' 2" HT 600, 700 & 2000 STEEL SERIES W/IMPACT RESISTANT LITES
& 800 SERIES WITHOUT LITES HVHZ WIND LOAD SECTIONAL DOOR
DESIGN PRESSURE +48.0/-52.0 PSF

DRAWING NO.: WL-0600-0194-08-48-52LHVHZ **REV.**

DRAWN BY: MVS	DATE DRAWN: 1/9/25	REV. DATE:
----------------------	---------------------------	-------------------

MODEL(S): See Sheet 1 or 3	SHEET: 4 OF 4
-----------------------------------	----------------------

320 Sycamore
Wauseon, Ohio 43567
© Copyright 2014