


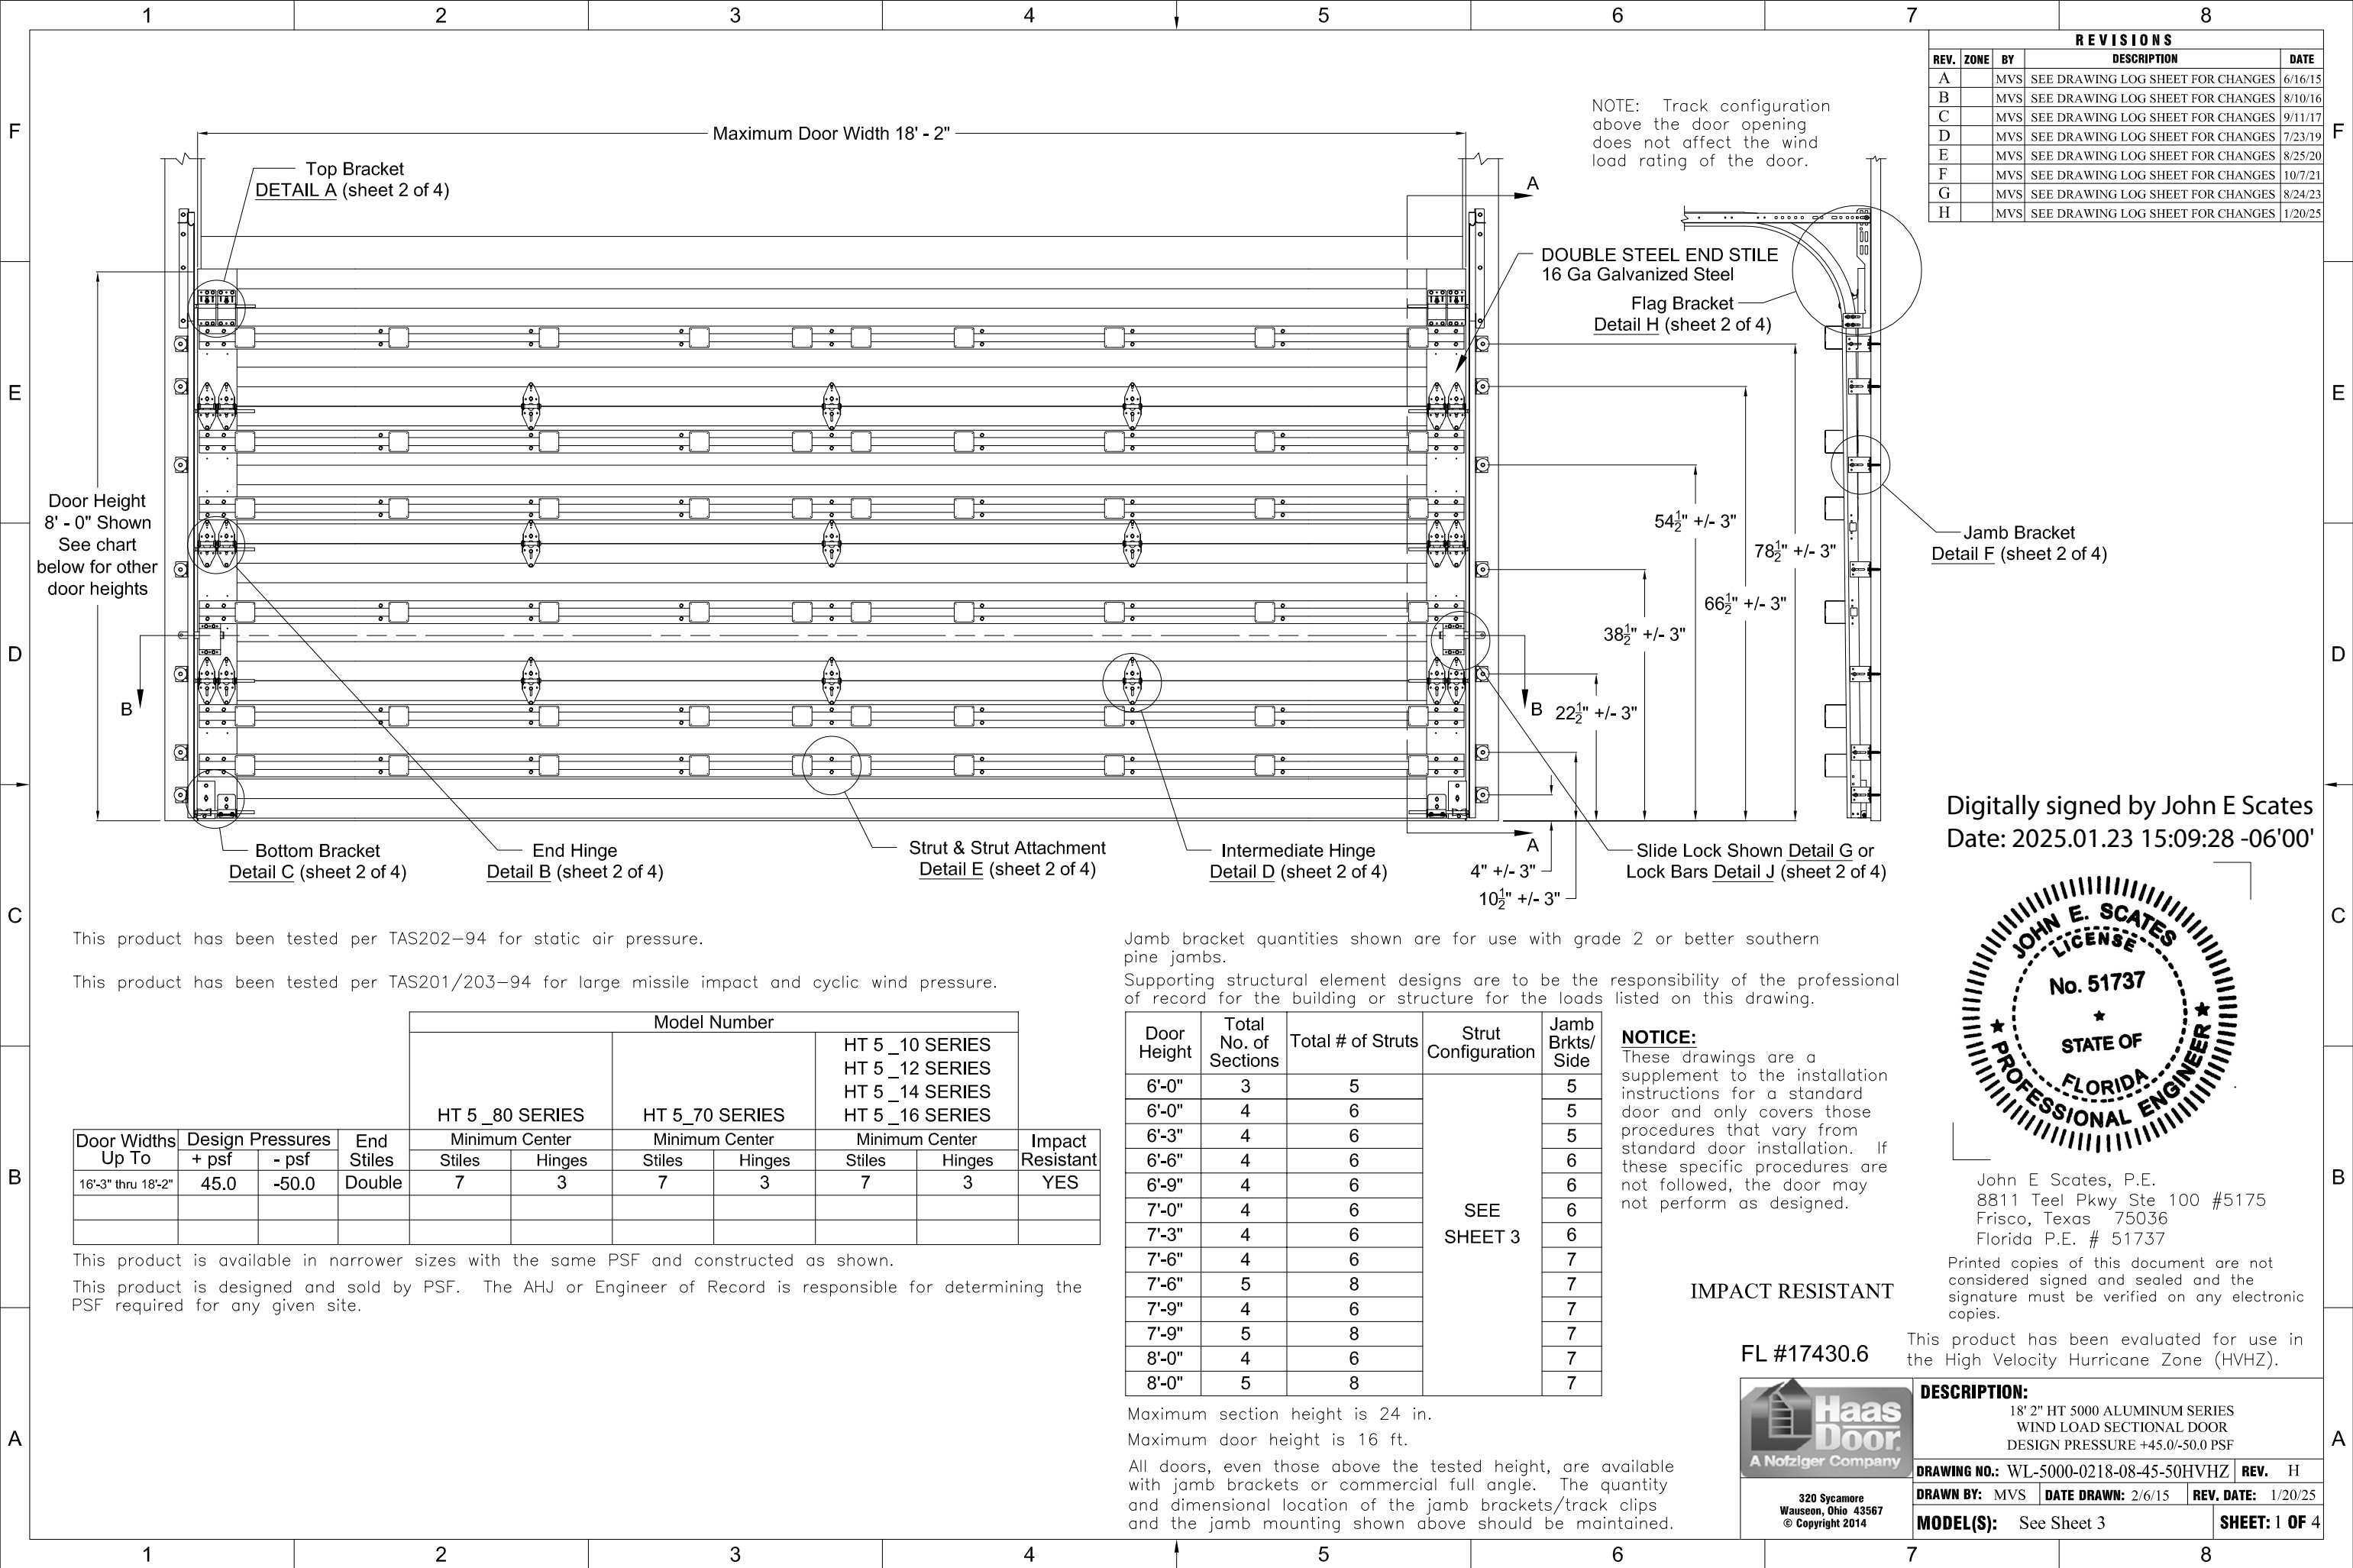

REVISIONS				
REV.	ZONE	BY	DESCRIPTION	DATE
A		MVS	SEE DRAWING LOG SHEET FOR CHANGES	6/16/15
B		MVS	SEE DRAWING LOG SHEET FOR CHANGES	8/10/16
C		MVS	SEE DRAWING LOG SHEET FOR CHANGES	9/11/17
D		MVS	SEE DRAWING LOG SHEET FOR CHANGES	7/23/19
E		MVS	SEE DRAWING LOG SHEET FOR CHANGES	8/25/20
F		MVS	SEE DRAWING LOG SHEET FOR CHANGES	10/7/21
G		MVS	SEE DRAWING LOG SHEET FOR CHANGES	8/24/23
H		MVS	SEE DRAWING LOG SHEET FOR CHANGES	1/20/25

This product has been tested per TAS202-94 for static air pressure.

This product has been tested per TAS201/203-94 for large missile impact and cyclic wind pressure.

				Model Number						
				HT 5 _80 SERIES		HT 5 _70 SERIES		HT 5 _10 SERIES HT 5 _12 SERIES HT 5 _14 SERIES HT 5 _16 SERIES		
Door Widths Up To	Design Pressures		End Stiles	Minimum Center		Minimum Center		Minimum Center		Impact Resistant
	+ psf	- psf		Stiles	Hinges	Stiles	Hinges	Stiles	Hinges	
16'-3" thru 18'-2"	45.0	-50.0	Double	7	3	7	3	7	3	YES

This product is available in narrower sizes with the same PSF and constructed as shown.

This product is designed and sold by PSF. The AHJ or Engineer of Record is responsible for determining the PSF required for any given site.

Jamb bracket quantities shown are for use with grade 2 or better southern pine jambs.

Supporting structural element designs are to be the responsibility of the professional of record for the building or structure for the loads listed on this drawing.

Door Height	Total No. of Sections	Total # of Struts	Strut Configuration	Jamb Brkts/ Side
6'-0"	3	5	SEE SHEET 3	5
6'-0"	4	6		5
6'-3"	4	6		5
6'-6"	4	6		6
6'-9"	4	6		6
7'-0"	4	6		6
7'-3"	4	6		6
7'-6"	4	6		7
7'-6"	5	8		7
7'-9"	4	6		7
7'-9"	5	8		7
8'-0"	4	6		7
8'-0"	5	8		7

Maximum section height is 24 in.

Maximum door height is 16 ft.

All doors, even those above the tested height, are available with jamb brackets or commercial full angle. The quantity and dimensional location of the jamb brackets/track clips and the jamb mounting shown above should be maintained.

NOTICE:

These drawings are a supplement to the installation instructions for a standard door and only covers those procedures that vary from standard door installation. If these specific procedures are not followed, the door may not perform as designed.

IMPACT RESISTANT


FL #17430.6



A Notziger Company

320 Sycamore
Wauseon, Ohio 43567
© Copyright 2014


DESCRIPTION:			
18' 2" HT 5000 ALUMINUM SERIES WIND LOAD SECTIONAL DOOR DESIGN PRESSURE +45.0/-50.0 PSF			
DRAWING NO.: WL-5000-0218-08-45-50HVHZ		REV. H	
DRAWN BY: MVS	DATE DRAWN: 2/6/15	REV. DATE: 1/20/25	
MODEL(S): See Sheet 3			SHEET: 1 OF 4

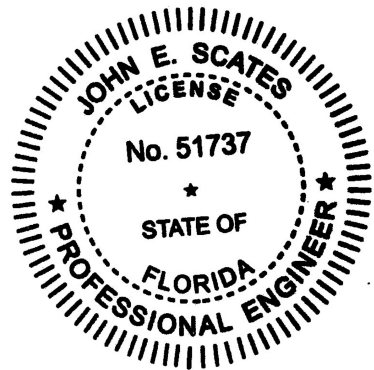

John E Scates, P.E.
8811 Teel Pkwy Ste 100 #5175
Frisco, Texas 75036
Florida P.E. # 51737

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



Digitally signed by John E Scates
Date: 2025.01.23 15:09:28 -06'00'

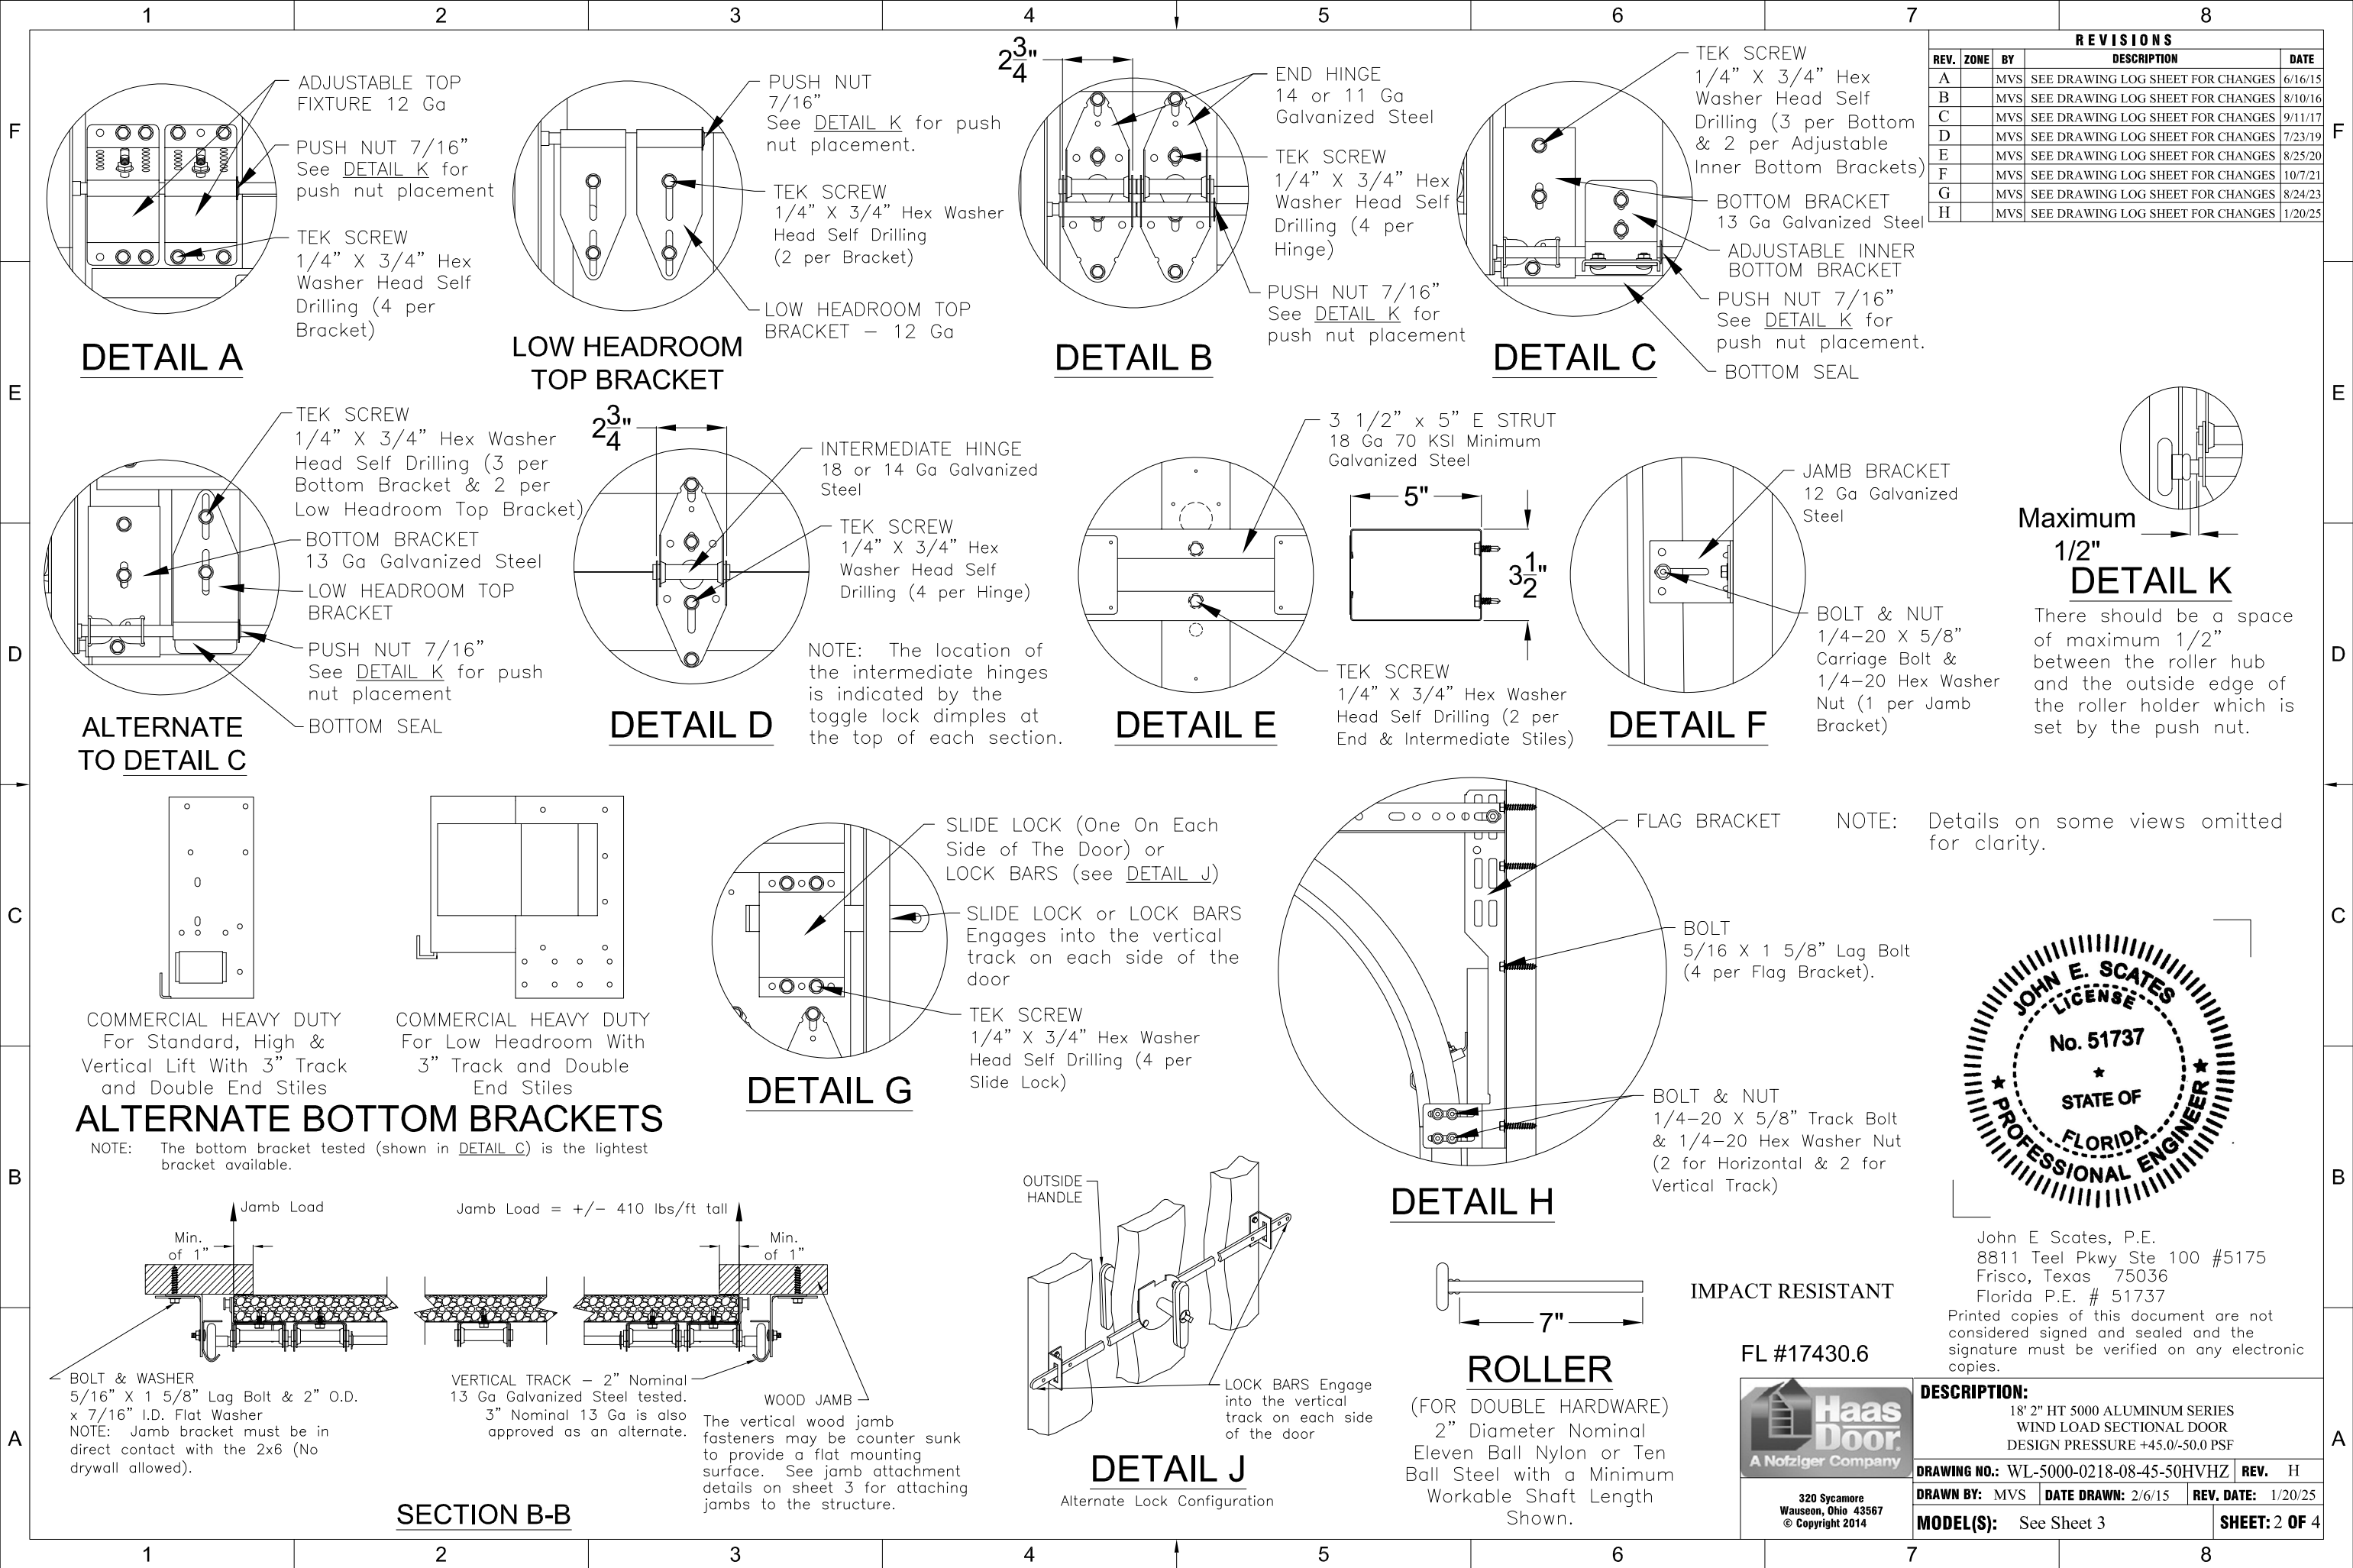



REVISIONS				
REV.	ZONE	BY	DESCRIPTION	DATE
A		MVS	SEE DRAWING LOG SHEET FOR CHANGES	6/16/15
B		MVS	SEE DRAWING LOG SHEET FOR CHANGES	8/10/16
C		MVS	SEE DRAWING LOG SHEET FOR CHANGES	9/11/17
D		MVS	SEE DRAWING LOG SHEET FOR CHANGES	7/23/19
E		MVS	SEE DRAWING LOG SHEET FOR CHANGES	8/25/20
F		MVS	SEE DRAWING LOG SHEET FOR CHANGES	10/7/21
G		MVS	SEE DRAWING LOG SHEET FOR CHANGES	8/24/23
H		MVS	SEE DRAWING LOG SHEET FOR CHANGES	1/20/25

MODEL NUMBERS AVAILABLE
HT 5 _10 SERIES
HT 5 _12 SERIES
HT 5 _14 SERIES
HT 5 _16 SERIES
HT 5 _70 SERIES
HT5 _80 SERIES

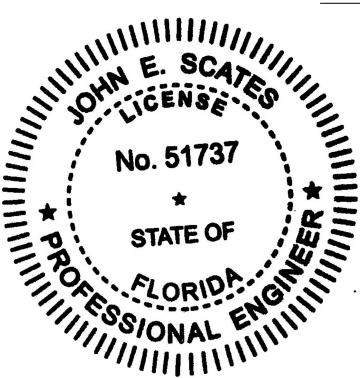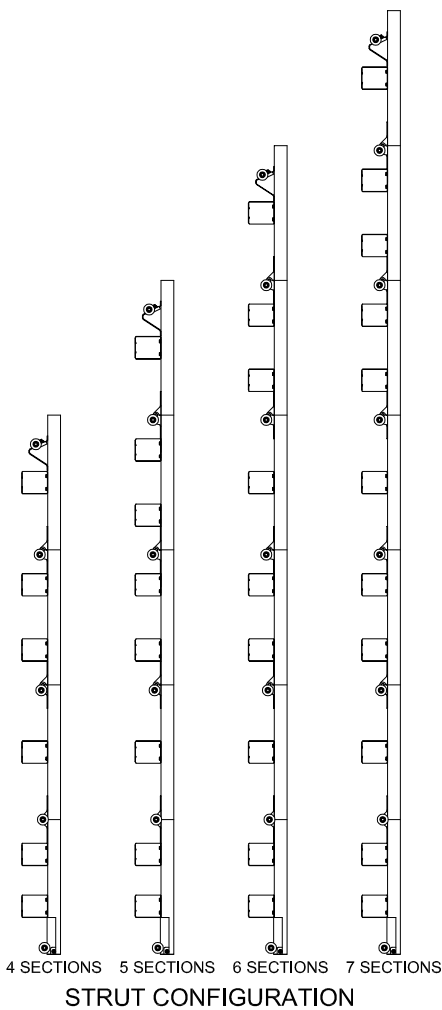


IMPACT RESISTANT

FL #17430.6



DESCRIPTION:
18' 2" HT 5000 ALUMINUM SERIES
WIND LOAD SECTIONAL DOOR
DESIGN PRESSURE +45.0/-50.0 PSF

DRAWING NO.: WL-5000-0218-08-45-50HVHZ		REV. H
DRAWN BY: MVS	DATE DRAWN: 2/6/15	REV. DATE: 1/20/25
MODEL(S): See Sheet 3		SHEET: 3 OF 4

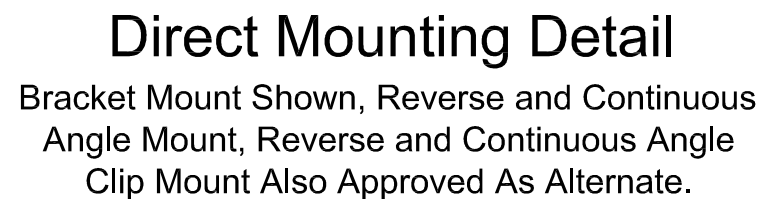

NOTE: Doors are available with jamb brackets or commercial full angle. In either case the the maximum spacing noted on sheet 1 should be maintained for the brackets, clips and fasteners for direct mount.

IMPACT RESISTANT

FL #17430.6

