


**Monument Clad Sliding 2-Wide Window
Nail Fin Installation / WDMA Instructions / Non-Impact**

TEST REPORT SUMMARY:


- SINGLE UNIT, MAXIMUM BASIC UNIT FRAME SIZE:
71.50" (1816mm) x 71.50" (1816mm)
- OVERALL DESIGN PRESSURE: **+/- 35 psf**
- STRUCTURAL TEST PRESSURE: **+52.63/-52.63 psf**
- RATING: **CW-PG35**

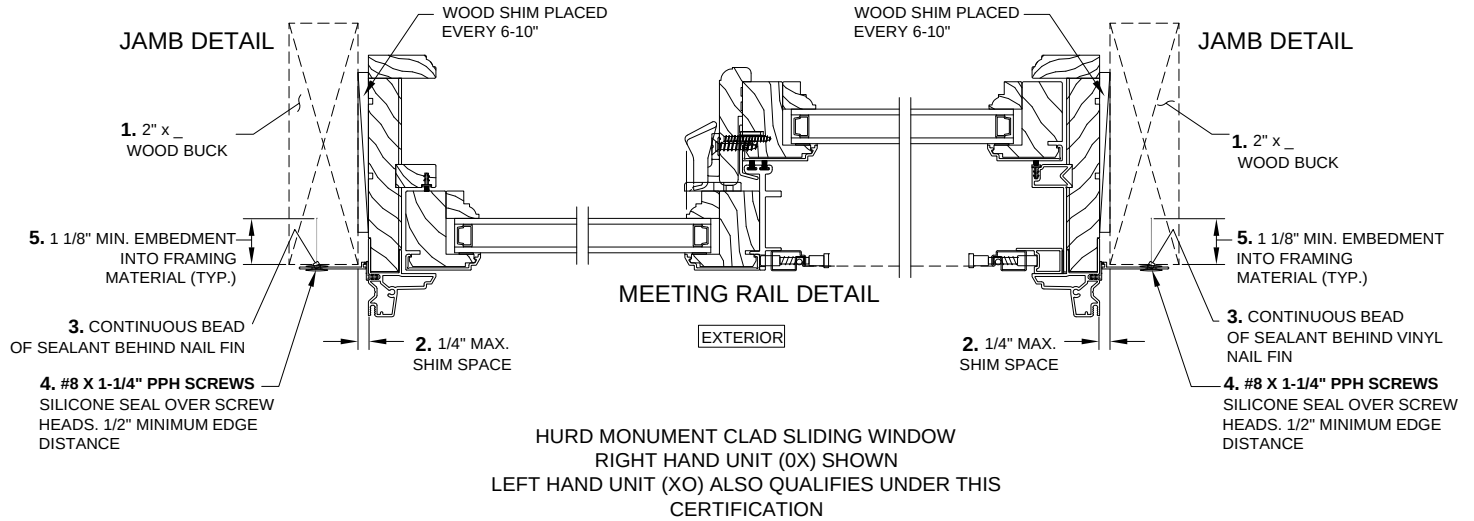

INSTALLATION NOTES:

1. USE 2" x _ WOOD BUCK
2. 1/4" MAXIMUM SHIM SPACE AT HEAD, SILL, JAMB
- PLACE WOOD SHIM EVERY 6-10" AT HEAD AND JAMBS. NO SHIMS AT SILL.
3. APPLY A CONTINUOUS BEAD OF SEALANT BETWEEN THE VINYL NAIL FIN AND THE BUCK AT THE HEAD, SILL AND SIDE JAMBS
4. INSTALL #8 X 1 1/4" PPH SCREWS SPACED APPROXIMATELY 1" TO 3" FROM EACH CORNER AND 7" ON CENTER THEREAFTER INTO THE FRAMING MATERIAL.
5. 1 1/8" MINIMUM FASTENER EMBEDMENT INTO FRAMING MATERIAL, SILICONE SEAL OVER SCREW HEADS
6. MAXIMUM WINDOW FRAME SIZE: **71.50" (1816mm) x 71.50" (1816mm)**
7. THIS INFORMATION APPLIES TO SINGLE SLIDE (2 SASH) UNITS LEFT OR RIGHT HAND OPERATING

- Check rough opening for proper size, plumb, level and square.
- Make all necessary adjustments to ensure rough opening is plumb, level & square.
- Sill must be flat, level and capable of supporting the weight of the unit.
- Opening should allow a maximum of 1/4" shim space at head, sill and jambs.
- Consult full installation instructions found on the Hurd web site, www.hurd.com, for all recommended installation procedures.
- Wood buck, framing, fasteners, sealant and all wall system materials are provided by others.

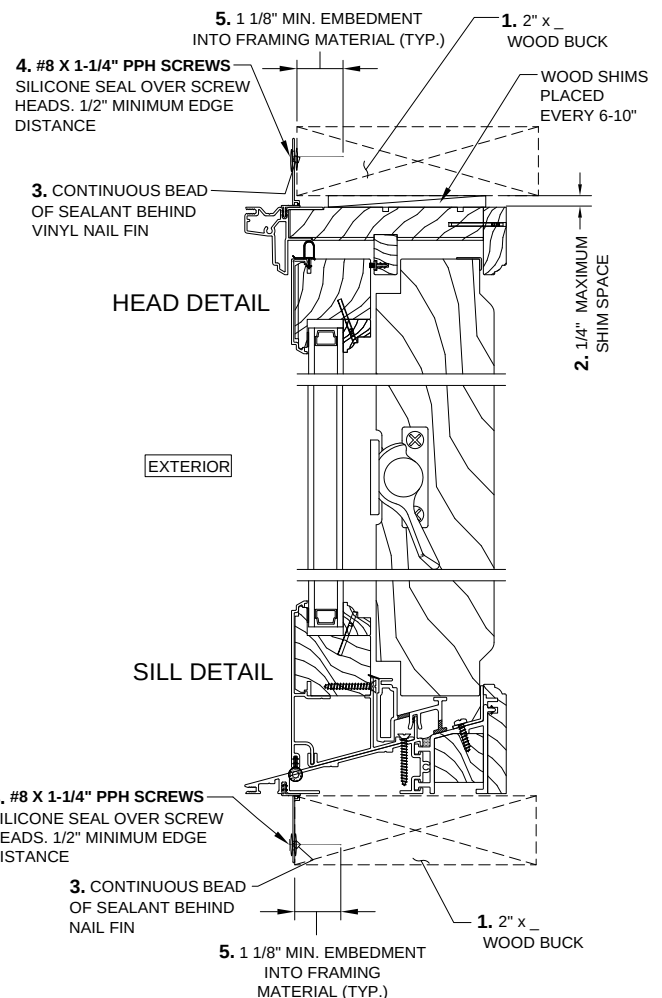



**Monumnet Clad
XO or OX Sliding Operating Window
Vinyl Nail Fin Installation / Non-Impact**

TEST REPORT SUMMARY:

- SINGLE UNIT, MAXIMUM BASIC UNIT FRAME SIZE:
71.50" (1816mm) x 71.50" (1816mm)
- OVERALL DESIGN PRESSURE: **+/- 35 psf**
- STRUCTURAL TEST PRESSURE: **+52.63/-52.63 psf**
- RATING: **CW-PG35**

CCL Listing# 436-H-666.12

Intertek ATI Test Reoirt #: D8476.01-602-44

**Monument Clad Sliding 2-Wide Window
Nail Fin Installation / WDMA Instructions / Non-Impact**


SHEET: 2 OF 2

CERTIFICATION DATE: 02/14/2015 THRU 09/03/2024

DRAWN BY: H.W.D.

NAIL FIN ANCHOR REQUIREMENTS TABLE			
THROUGH NAIL FIN with SCREWS			
OPENING TYPE (SUBSTRATE)	JAMB TO OPENING FASTENER TYPE, FASTENER SPACING	MINIMUM EMBED	MINIMUM EDGE DIST.
2X_ FRAME OR BUCK	#8 X 1 1/4" PPH SCREWS SPACED 1" TO 3" FROM EACH CORNER & 7" ON CENTER THEREAFTER.	1 1/8"	1/2"
ANCHORS MUST BE INTO A MIN. 2X_ WOOD MEMBER. IF SPACE BETWEEN WALL FRAME & WINDOW FRAME IS GREATER THAN THAT REQUIRED FOR A 2X_ WOOD MEMBER AND A SPACE EXISTS, THE SPACE MUST BE FILLED WITH A WOOD MEMBER OF EQUAL DEPTH TO THE WINDOW FRAME MEMBER OR BUCK AND OF LENGTH = MIN. 20". THE FRAME ANCHOR MUST THEN BE RUN THROUGH THE FRAME & WOOD SHIM AND INTO THE OPENING.			

HURD MONUMENT CLAD SLIDING WINDOW
RIGHT HAND UNIT (OX) SHOWN
LEFT HAND UNIT (XO) ALSO QUALIFIES UNDER THIS
CERTIFICATION

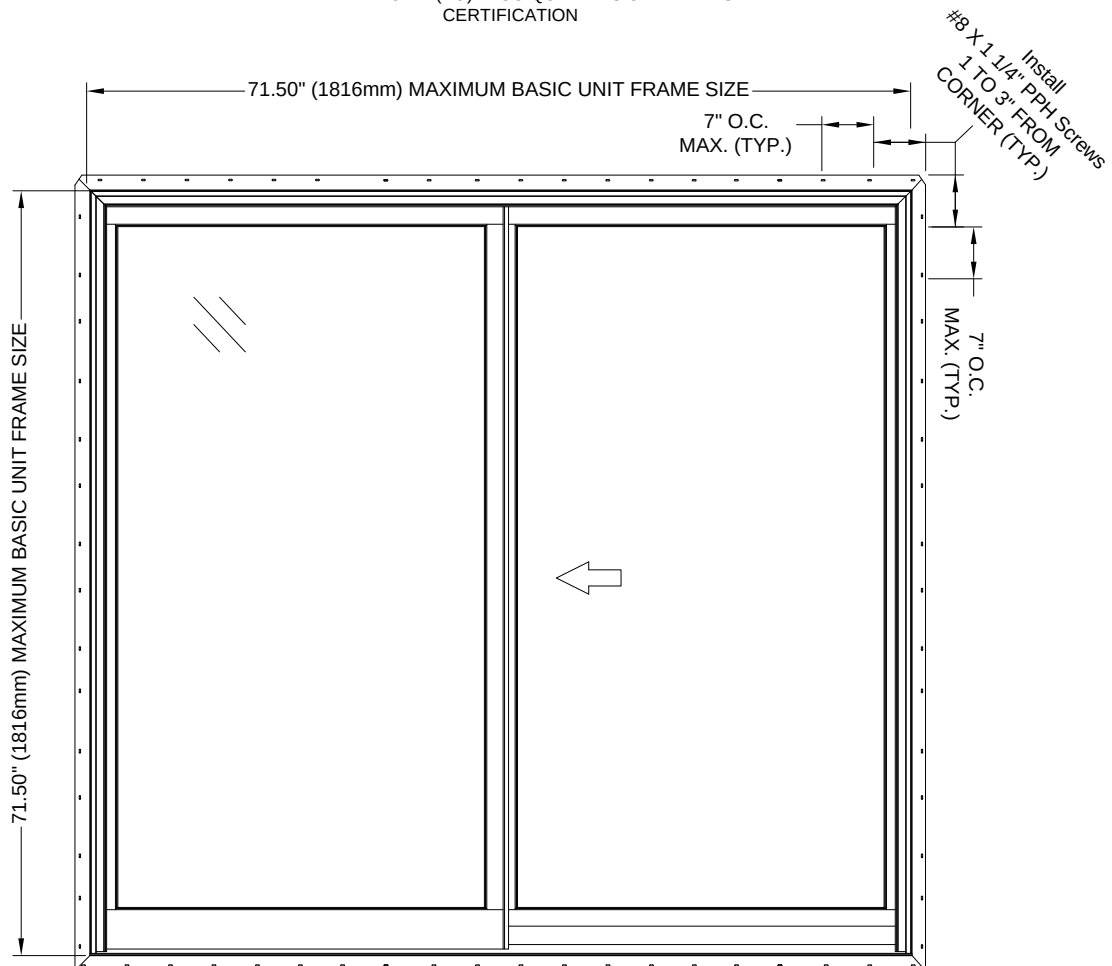

**ELEVATION SHOWING
FASTENER LOCATION & SPACING
VIEWED FROM EXTERIOR**

**MAX. WINDOW SIZE
BASIC UNIT FRAME = 71.50" (1816mm) x 71.50" (1816mm)**