

SH 2100 ALUMINUM SINGLE HUNG WINDOW

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 7TH EDITION (2020)/ 8TH EDITION (2023) INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WINDOWS RATED FOR LARGE AND SMALL MISSILE IMPACT AND DO NOT REQUIRE SHUTTERS.

GLASS CAPACITY BASED ON ASTM E1300-09 (3 SEC. GUSTS)

ULTIMATE DESIGN LOAD OBTAINED FROM ASCE 7-16/ASCE 7-22, MULTIPLY BY 0.6 SHALL BE LESS THAN OR EQUAL TO DESIGN LOAD IN THIS DOCUMENT.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE

ANCHORS SHALL BE LISTED, SPACED AS SHOWN IN DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.



MATERIAL:
ALL ALUMINUM EXTRUSION TO BE 6063 T6 ALLOY

SEALANT:
- ALL FRAME PERIMETER CAULKING USING DOWSIL 995
- JOINT AND SEAM TO BE SEALED WITH DOWSIL 995

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 7TH EDITION (2020)/ 8TH EDITION (2023) .


MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE LABELING TO COMPLY WITH SECTION 1709.9.2.

ADDITIONAL ANCHORS
FOR MULLION ARE REQUIRED
SEE SEPARATE MULLION APPROVAL.

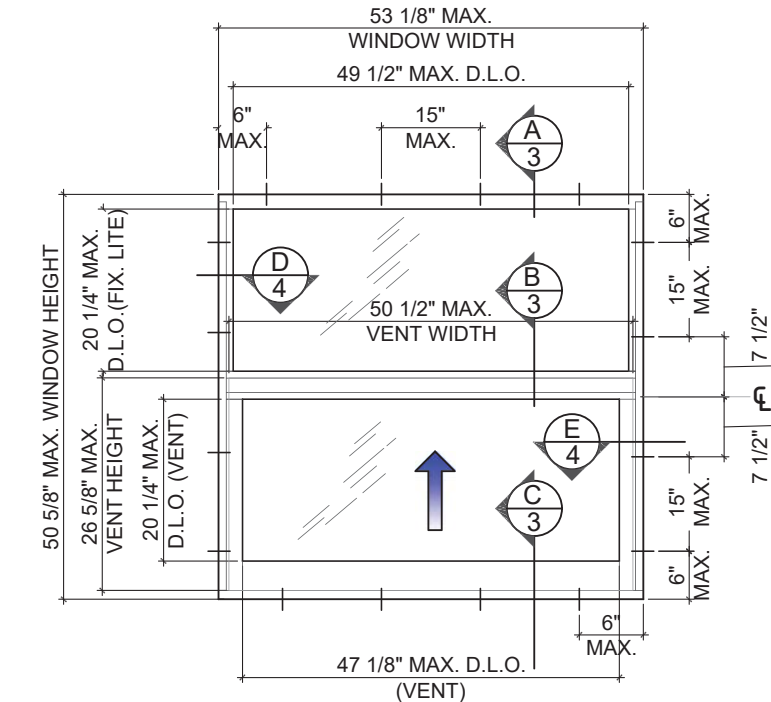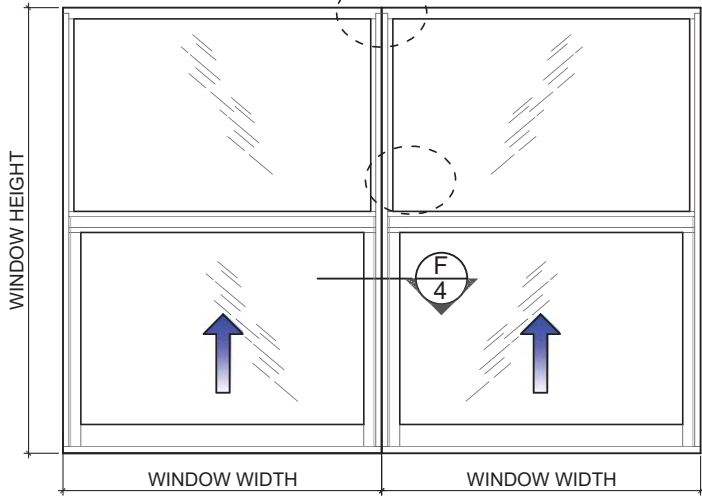

TYPICAL ELEVATION (WITHOUT JAMB ANCHORS)

SINGLE HUNG WINDOW WITHOUT JAMB ANCHORS
FOR WINDOW SIZE 53 1/8" X 50 5/8" OR SMALLER WITHOUT JAMB ANCHOR MAX. DESIGN LOAD ±70 PSF.

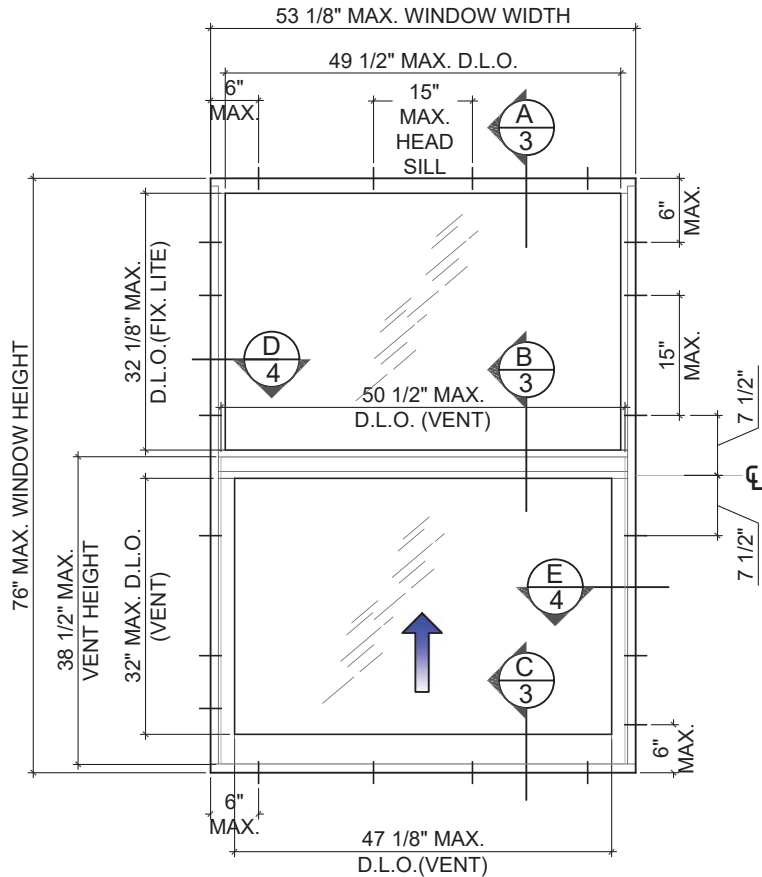

TYPICAL ELEVATION (WITH JAMB ANCHORS)

SINGLE HUNG WINDOW WITH JAMB ANCHORS

FOR DESIGN LOAD SEE CHART ON SHEET 2 OF 5.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WINDOW WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING FLORIDA APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

LIMITATIONS OF USE

A- THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; i.e. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.

B- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.

C- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.

D- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D.

E- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

PROFESSIONAL ENGINEER
YONG WANG P.E.
FLORIDA REGISTRATION
PE #55983
CA#15528677
September 26th, 2023

REVISIONS		
NO.	DATE	DESCRIPTION
03	09.25.2023	FBC 2023

MCY

ENGINEERING, INC.

GLAZING CONSULTANTS

12781 MIRAMAR PKWY. STE. 301
MIRAMAR, FL. 33027
P: 305.271.0117
www.MCYEngineering.com


SERIES SH2100 ALUMINUM SINGLE HUNG WINDOW - LMI & SMI

EMC WINDOWS AND DOORS, LLC.
455 E. 10TH AVE.
HIALEAH, FL. 33010
P: (305) 283 - 6280 EMCWindowsDoors@gmail.com


FL #17597	
DATE	09.25.2023
SCALE	AS NOTED
DRAWN	James
PROJECT	15-025
DRAWING NO. AD15-15	
1 OF 5	

SINGLE HUNG WINDOW WITH JAMB ANCHORS					
DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE "A"		GLASS TYPE "B"	
HEIGHT (H)	WIDTH (W)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
26" *(2)	19 1/8"	90.00	100.00	90.00	100.00
	26 1/2"	90.00	100.00	90.00	100.00
	37"	90.00	100.00	90.00	100.00
	53 1/8"	90.00	100.00	90.00	100.00
38-3/8" *(4)	19 1/8"	90.00	100.00	90.00	100.00
	26 1/2"	90.00	100.00	90.00	100.00
	37"	90.00	100.00	90.00	100.00
	53 1/8"	90.00	100.00	90.00	100.00
50-5/8" *(4)	19 1/8"	90.00	100.00	90.00	100.00
	26 1/2"	90.00	100.00	90.00	100.00
	37"	90.00	100.00	90.00	100.00
	53 1/8"	90.00	100.00	90.00	100.00
63" *(5)	19 1/8"	90.00	100.00	90.00	100.00
	26 1/2"	90.00	100.00	90.00	100.00
	37"	90.00	100.00	90.00	100.00
	53 1/8"	70.00	90.00	70.00	90.00
76" *(6)	19 1/8"	90.00	100.00	90.00	100.00
	26 1/2"	90.00	100.00	90.00	100.00
	37"	70.00	90.00	70.00	90.00
	53 1/8"	70.00	80.60	70.00	83.00

*() NUMBER OF ANCHORS PER JAMB

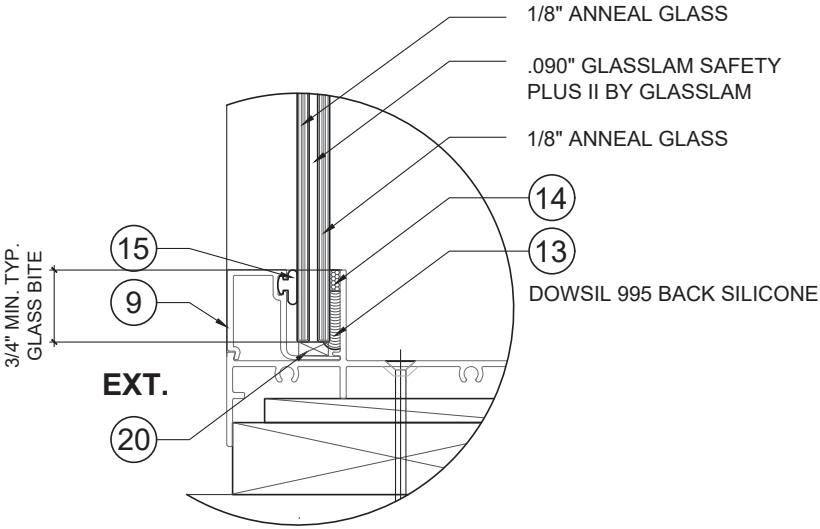


GLASS TYPE "A"
5/16" OVERALL LAMINATED GLASS

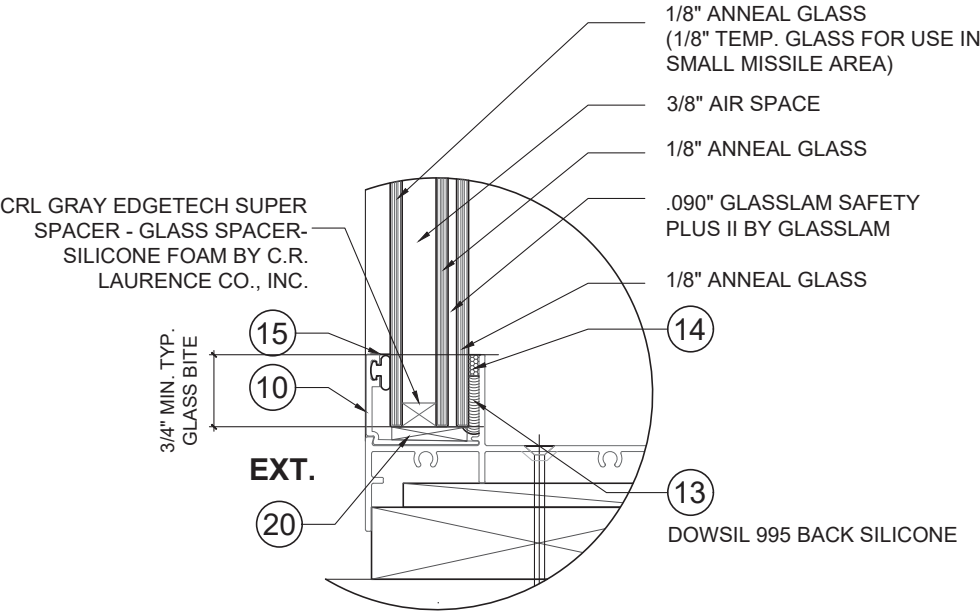

GLASS TYPE "B"
13/16" OVERALL INSULATED LAMINATED GLASS

NOTE:
GLASS COMPLIES WITH ASTM E1300-09
(3 SEC.GUSTS)

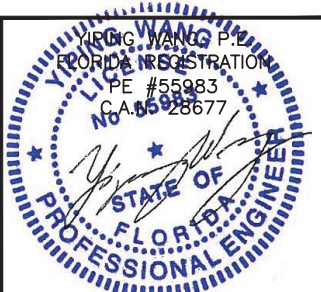

September 26th, 2023

REVISIONS	
NO.	DATE DESCRIPTION
03	09.25.2023 FBC 2023

MCY

ENGINEERING, INC.

GLAZING CONSULTANTS



12781 MIRAMAR PKWY, STE. 301
MIRAMAR, FL. 33027
P: 305.271.0117
www.MCYEngineering.com

SERIES SH2100 ALUMINUM SINGLE HUNG WINDOW - LMI & SMI

EMC WINDOWS AND DOORS, LLC.

455 E. 10TH AVE.
HIALEAH, FL. 33010
P: (305) 283 - 6280 EMCWindowsDoors@gmail.com

FL #17597	
DATE	09.25.2023
SCALE	AS NOTED
DRAWN	James
PROJECT	15-025
DRAWING NO. AD15-15	
2 OF 5	

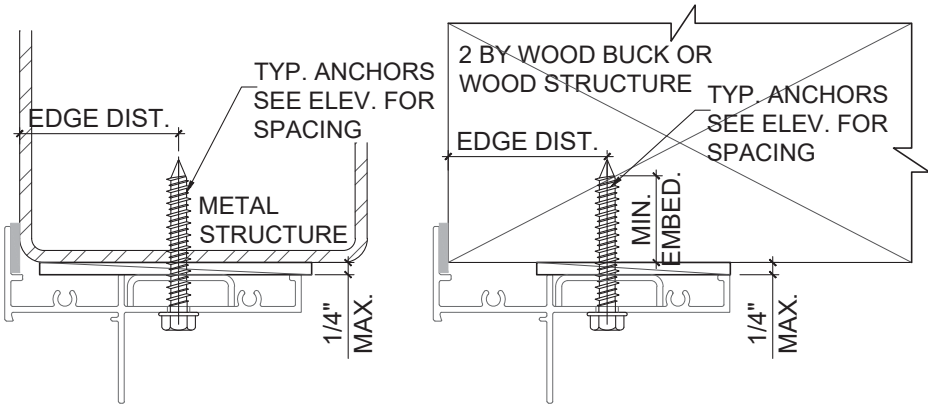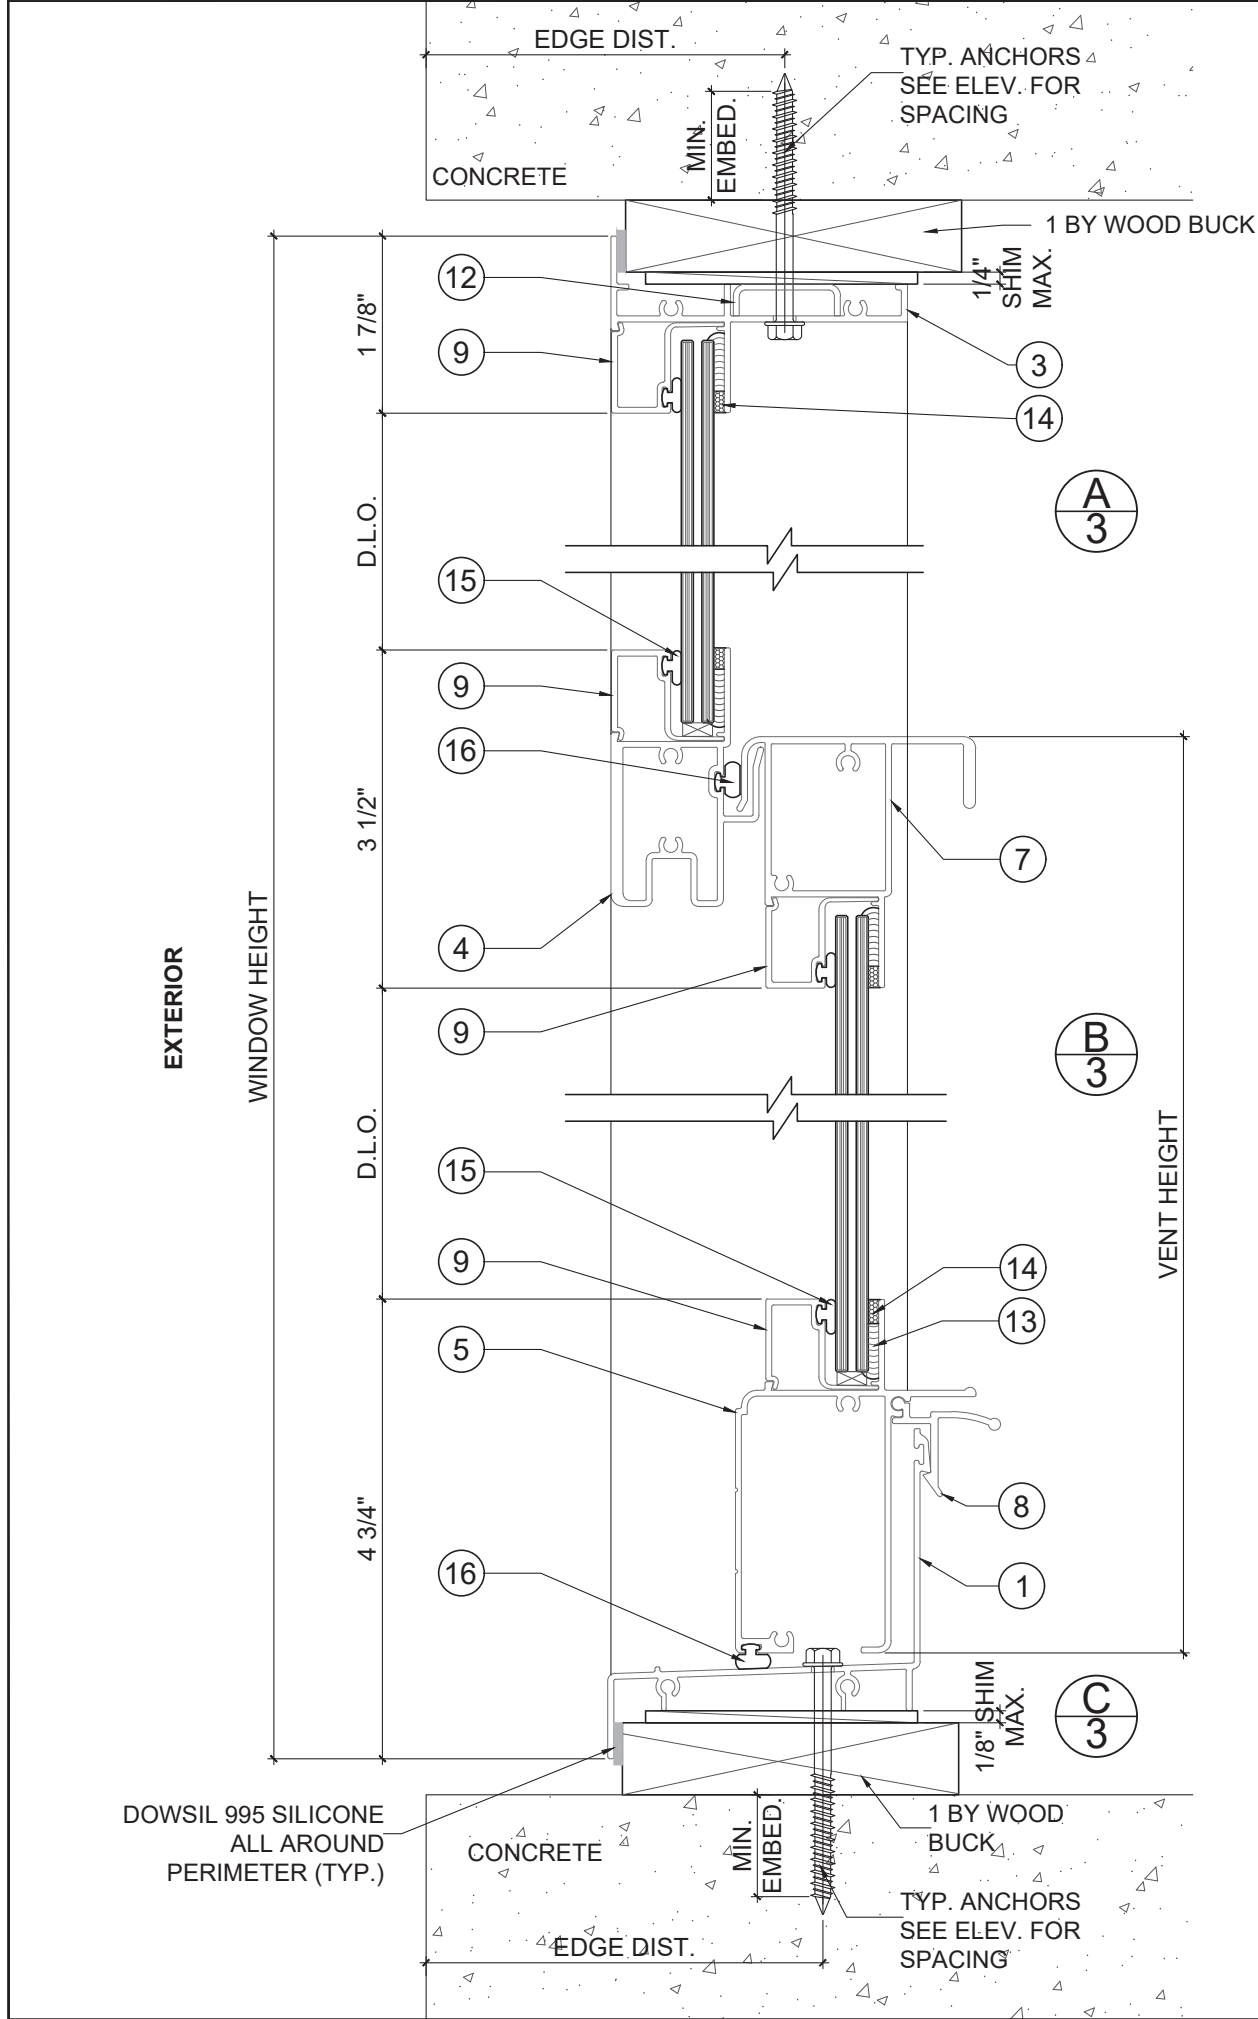

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' - **1/4" ULTRACON+ BY 'DEWALT'** (Fu = 164 KSI, Fy = 148 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
1-1/2" MIN. PENETRATION INTO WOOD
THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY
DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

TYPE 'B' - **1/4" TEKS OR SELFDRILLING SCREWS (GRADE 5 CRS)**
INTO METAL STRUCTURES

TYPE 'C' - **#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)**
INTO FLORIDA STATE APPROVED MULLIONS


STEEL : 16 GA THK MIN (Fy = 36KSI MIN.)
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

MASONRY
ASTM C90 GROUT FILLED CONCRETE BLOCK
ASTM C90 HOLLOW CONCRETE BLOCK

CONCRETE
fc= 3,000 PSI MIN.

ANCHOR EDGE DISTANCES
INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCURE = 3/4" MIN.

ALL ANCHOR OPTIONS CAN APPLY TO HEAD, SILL
AND JAMB ANCHORS.

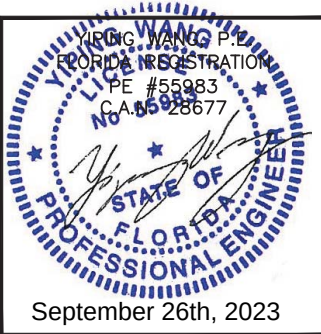

REVISIONS	
NO.	DESCRIPTION
01	09.25.2023 FBC 2023

MCY




MCY ENGINEERING, INC.
GLAZING CONSULTANTS

12781 MIRAMAR PKWY. STE. 301
MIRAMAR, FL. 33027
P: 305.271.0117
www.MCYEngineering.com MCY@mcycyengineering.com

SERIES SH2100 ALUMINUM SINGLE HUNG WINDOW - LMI & SMI


EMC WINDOWS AND DOORS, LLC.
455 E. 10TH AVE.
HIALEAH, FL. 33010
P: (305) 283 - 6280 EMCWindowsDoors@gmail.com

FL #17597	
DATE	09.25.2023
SCALE	AS NOTED
DRAWN	James
PROJECT	15-025
DRAWING NO. AD15-15	
3 OF 5	

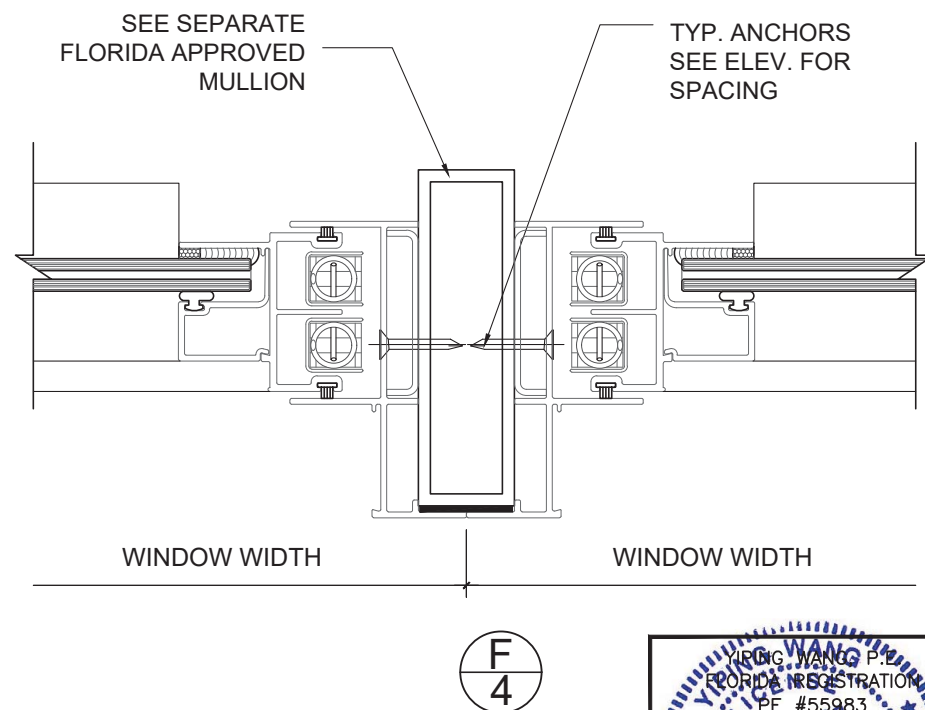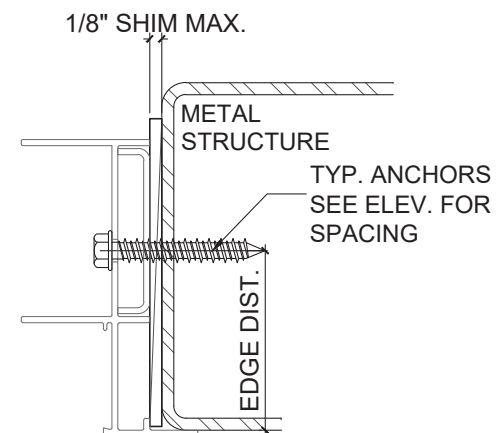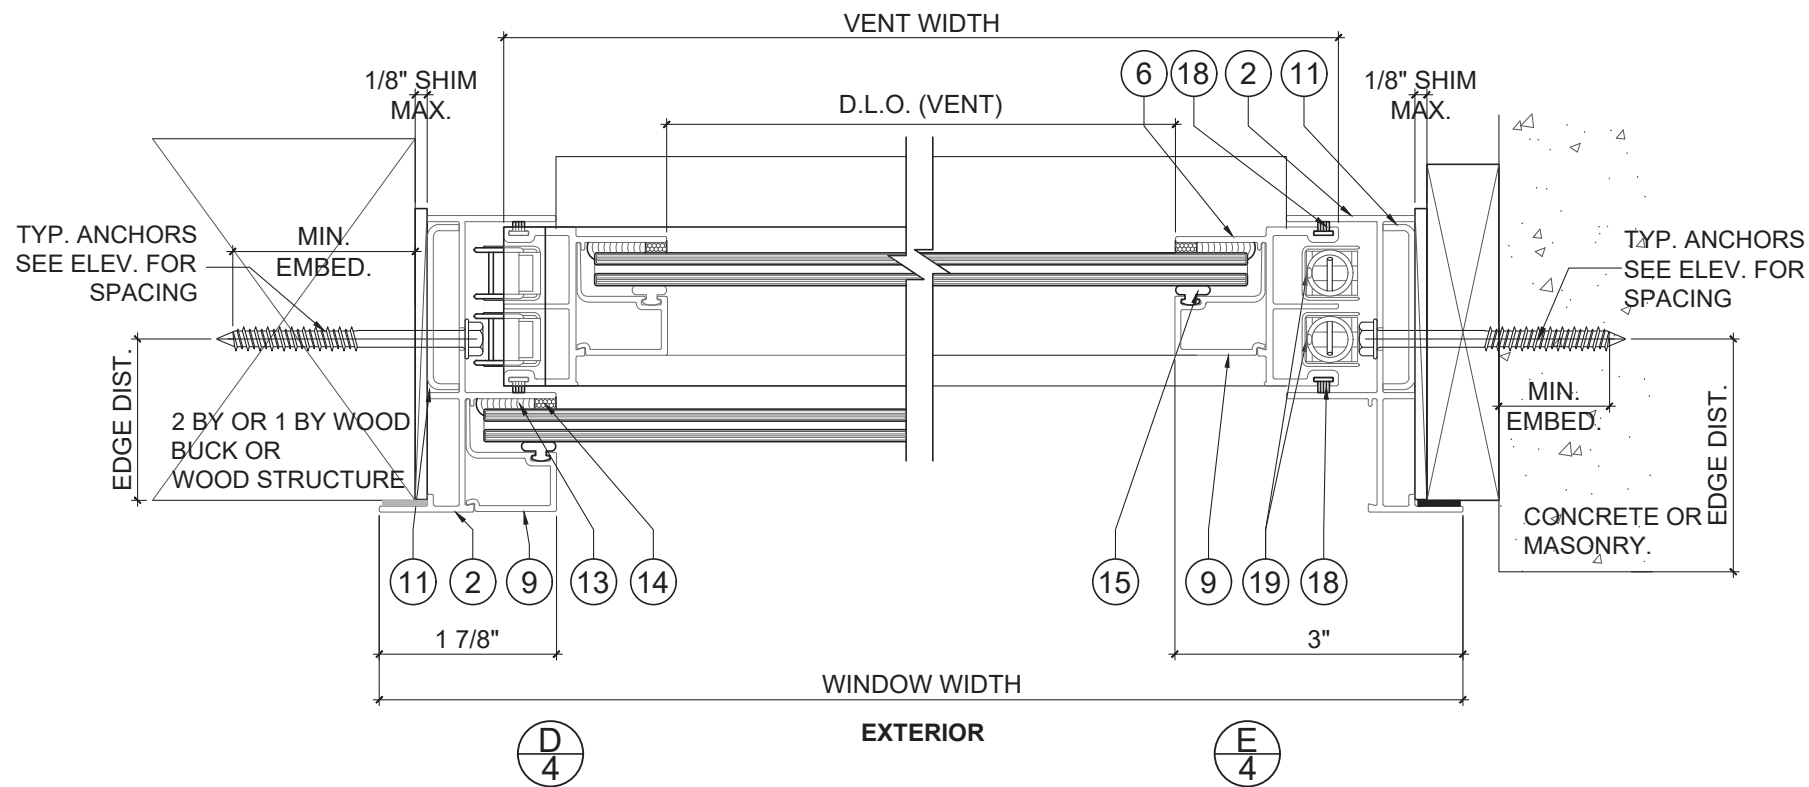


BILL OF MATERIALS

ITEM #	QTY.	PROFILE	DESCRIPTION	MATERIAL	MANUFACTURER/REMARKS
1	2	E101	FRAME SILL, PC WHITE	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
2	2	E102	FRAME JAMB, PCWHITE	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
3	2	E103	FRAME HEAD, PCWHITE	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
4	2	E104	FRAME INTERLOCK, PCWHITE	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
5	2	E105	VENT SILL, PCWHITE	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
6	2	E106	VENT JAMB, PCWHITE	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
7	2	E107	VENT TOP, PCWHITE	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
8	2	E108	LOCK EXTRUSION, PCWHITE	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
9	8	E110	GLAZING CHANNEL, PC WHITE	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
10	8	E121	ALUM. INSULATED GLAZING CHANNEL	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
11	AS REQD.	E127	ANCHOR CLIP 16 GA	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
12	AS REQD.	E128	ANCHOR CLIP 16 GA	ALUM. 6063-T6	EMC WINDOWS AND DOORS, LLC.
13	AS REQD.	SEAL01-1	DOWSIL 995 BACK SILICONE	SILICONE	DOWSIL
14	AS REQD.	W0019	.125 X .25 GLAZNG TAPE, 2 SIDED	TAPE	FRANK LOWED
15	AS REQD.	V0021	E202 VINYL BULB, GLAZING STOP	VINYL	FENESTRATION GLASS PRODUCTS
16	AS REQD.	V0020	E708 VINYL BULB, FRAME	VINYL	FENESTRATION GLASS PRODUCTS
17	AS REQD.	#8 X 1	FRAME ASSEMBLY SCREWS	STEEL	SPH SHEET METAL SCREW
18	AS REQD.	Q23	WOOL PILE FRAME	WOOL	ULTRAFAB
19	AS REQD.	BL100	100 SERIES BALANCE	METAL	BSI
20	AS REQD.	-	SETTING BLOCK	EPDM +/- 65	-

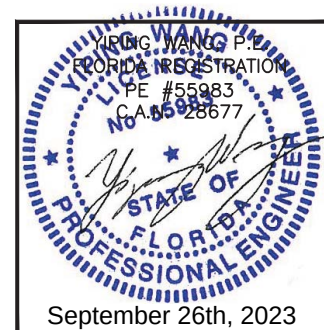

REVISIONS	
NO.	DESCRIPTION
RS	09.25.2023 FBC 2023



MCY ENGINEERING, INC.
GLAZING CONSULTANTS

12781 MIRAMAR PKWY. STE. 301
MIRAMAR, FL. 33027
P: 305.271.0117
www.MCYEngineering.com MCY@mcyengineering.com













SERIES SH2100 ALUMINUM SINGLE HUNG WINDOW - LMI & SMI
EMC WINDOWS AND DOORS, LLC.
455 E. 10TH AVE.
HIALEAH, FL. 33010
P: (305) 283 - 6280 EMCWindowsDoors@gmail.com


FL #17597


DATE	09.25.2023
SCALE	AS NOTED
DRAWN	James
PROJECT	15-025

DRAWING NO.
AD15-15

4 OF 5

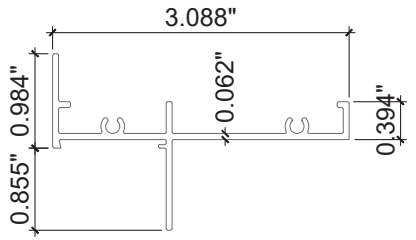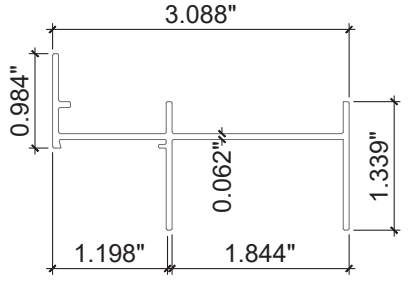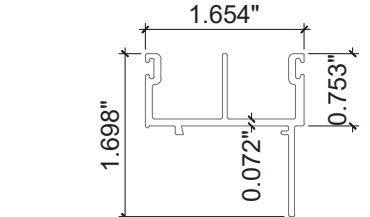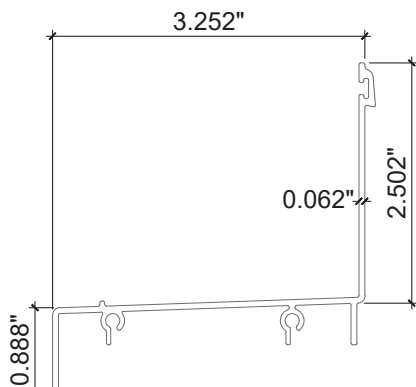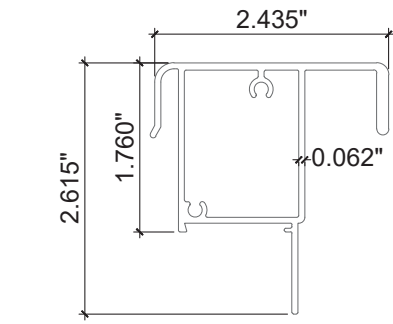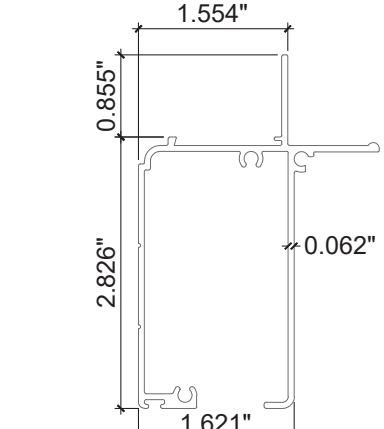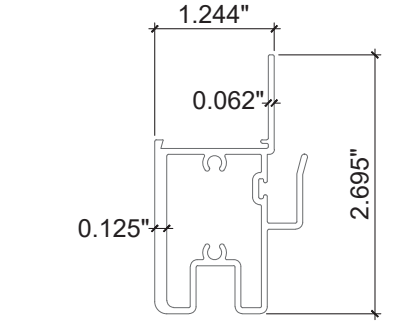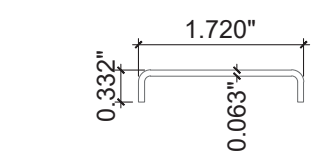 3 E103 FRAME HEAD	 9 E110 GLAZING CHANNEL	 8 E103 LOCK EXTRUSION
 2 E102 FRAME JAMB	 6 E106 VENT JAMB	
 1 E101 FRAME SILL	 7 E107 VENT TOP	
 5 E105 VENT SILL	 4 E104 FRAME INTERLOCK	
 11 E127 ANCHOR CLIP	 12 E128 ANCHOR CLIP	 10 E121 GLAZING CHANNEL

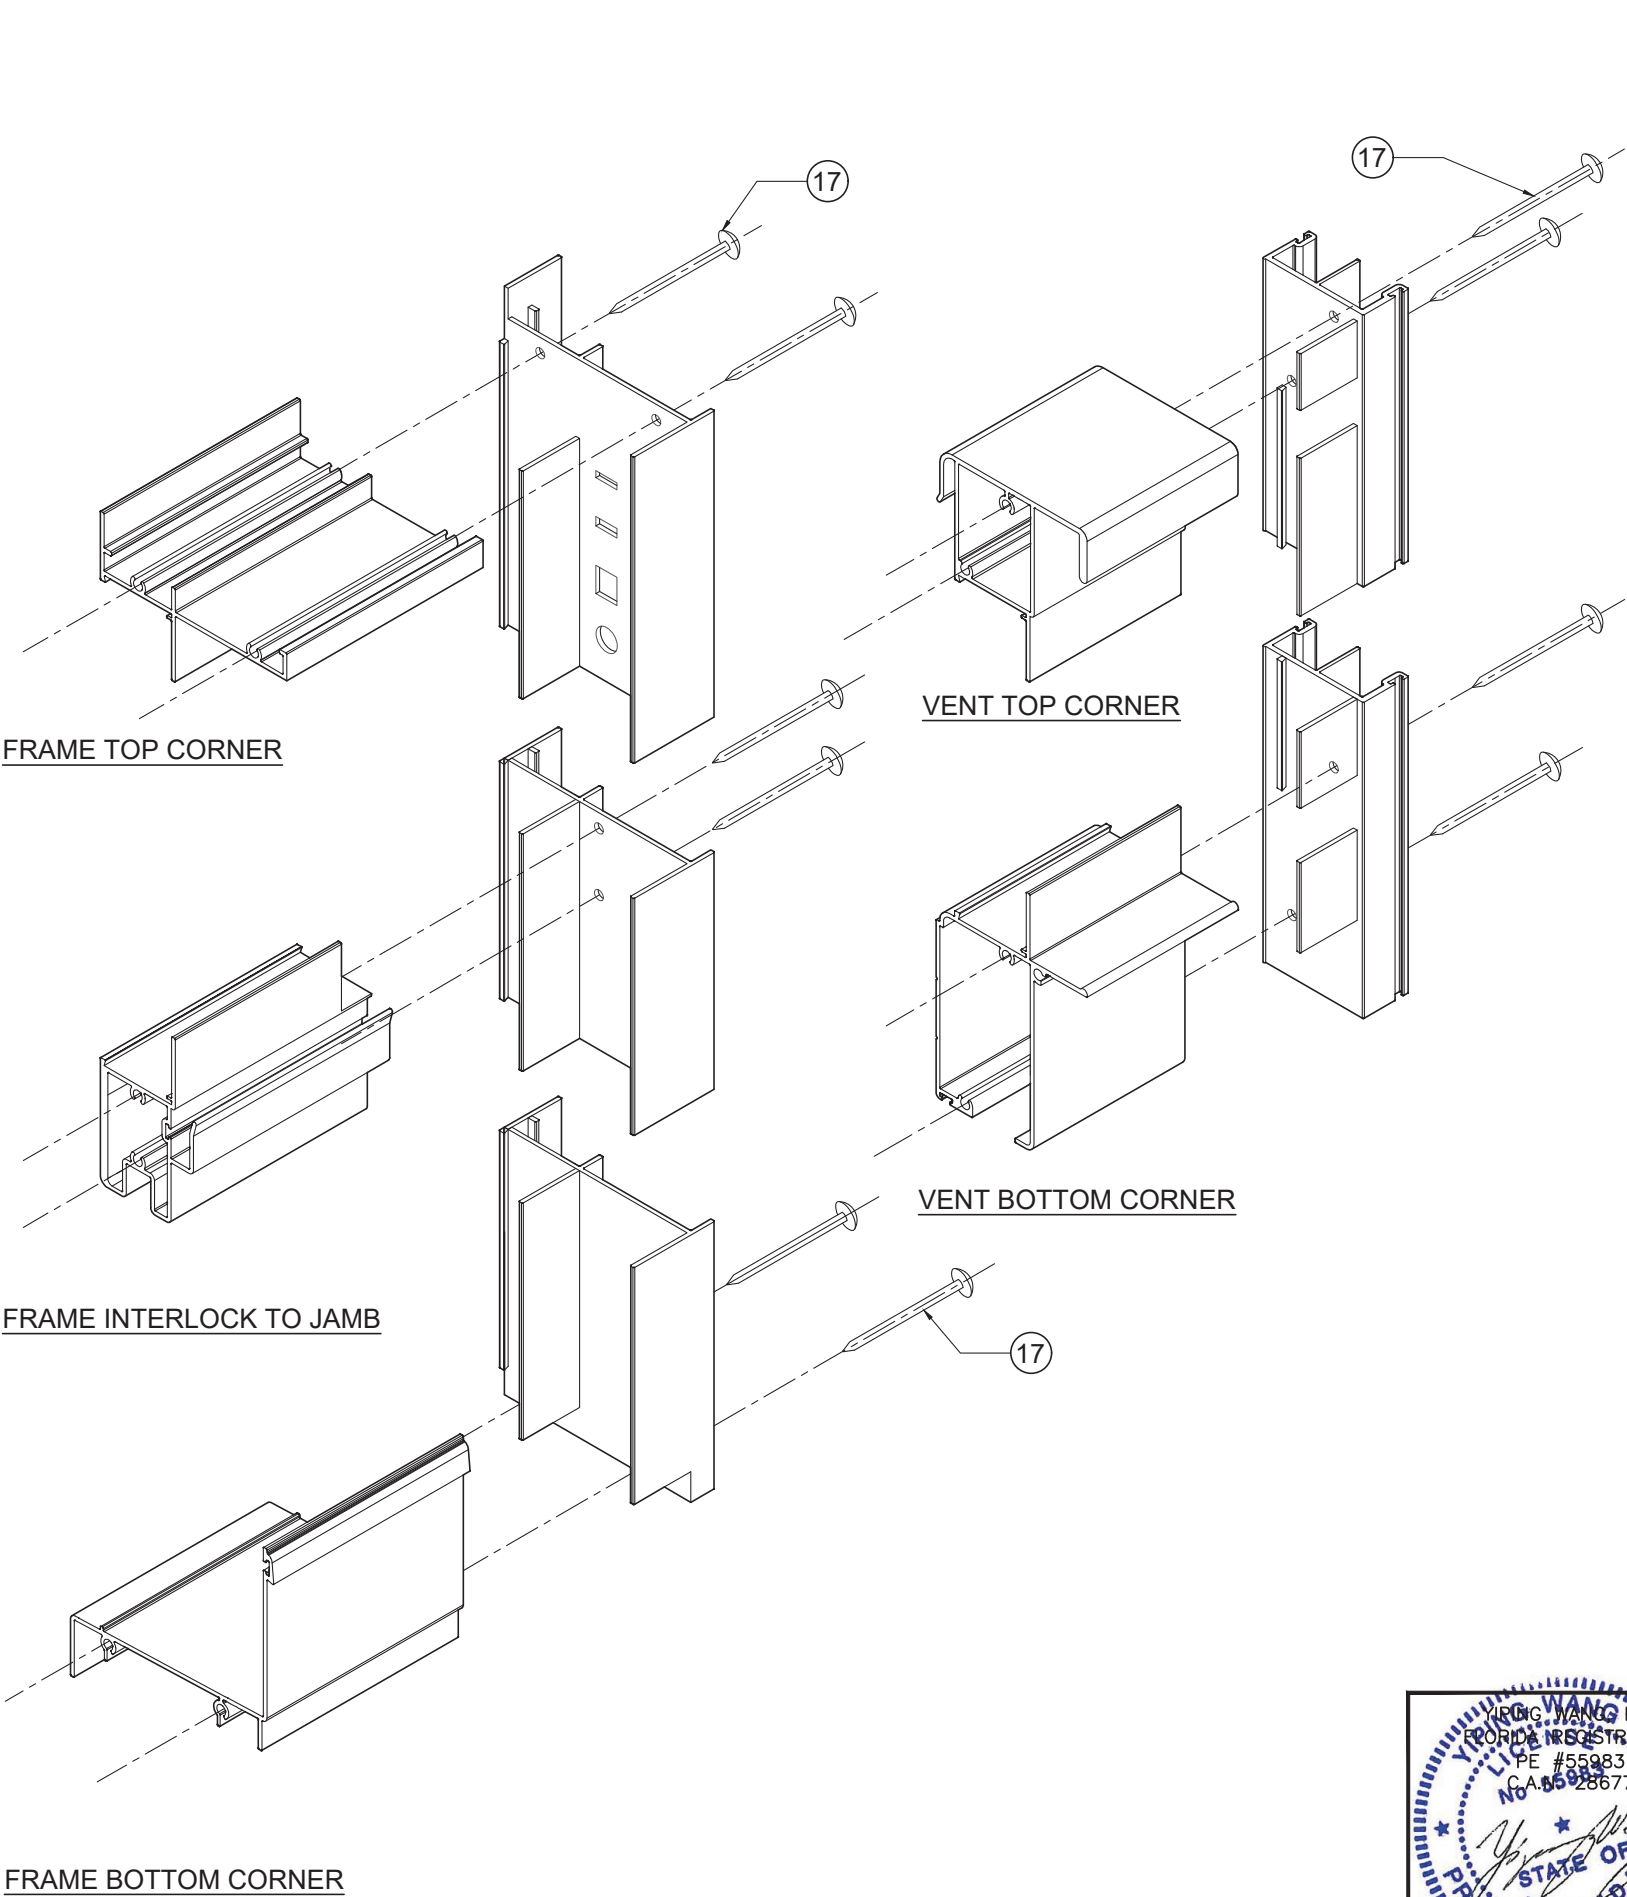

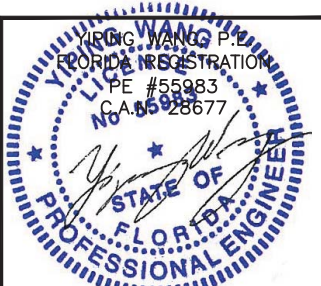

September 26th, 2023

REVISIONS		
NO.	DATE	DESCRIPTION
R3	09.25.2023	FBC 2023

M

C

Y

www.MCYEngineering.com

MCY ENGINEERING, INC.

GLAZING CONSULTANTS

12781 MIRAMAR PKWY. STE. 301

MIRAMAR, FL. 33027

P: 305.271.0117

www.MCYEngineering.com

MCY@mcyengineering.com

SERIES SH2100 ALUMINUM SINGLE HUNG WINDOW - LMI & SMI

EMC WINDOWS AND DOORS, LLC.

455 E. 10TH AVE.

HIALEAH, FL. 33010

P: (305) 283 - 6280 EMCWindowsDoors@gmail.com

FL #17597

DATE	09.25.2023
SCALE	AS NOTED
DRAWN	James
PROJECT	15-025

DRAWING NO.

AD15-15

5 OF 5