

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW TESTING	01/08/14	R.L.
B	REVISED INSTALLATION DETAILS	09/15/15	R.L.
C	REVISED PER NEW REQUIREMENTS	08/06/19	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1–1/2” WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1–1/2” OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. SHIM AS REQUIRED AT WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.
9. SHIMS SHALL BE MADE FROM MATERIALS CAPABLE OF SUSTAINING APPLICABLE LOADS, LOCATED AND APPLIED IN A THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300–04/09.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16” TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. ALL FASTENERS TO BE CORROSION RESISTANT.
18. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42

B. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.

C. MASONRY – STRENGTH CONFORMANCE TO ASTM C–90, GRADE N, TYPE 1 (OR GREATER).

D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063–T5 .048” THICK MINIMUM
19. GEOMETRIC SHAPES ARE ALSO APPROVED. APPROVED GEOMETRIC SHAPES DIMENSIONS SHALL NOT EXCEED INSCRIBED DIMENSIONS OF APPROVED RECTANGULAR ASSEMBLY SHOWN IN SHEET 2.

SIGNED: 08/06/2019

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3 – 5	INSTALLATION DETAILS
6	COMPONENTS

MI WINDOWS AND DOORS, LLC.

650 WEST MARKET STREET
GRATZ, PA 17030–0370

SERIES 3240/3540 FINLESS PVC SINGLE HUNG
STEEL REINFORCED NON–IMPACT 44” X 72”
NOTES

DRAWN:
TJH

DWG NO.
08–01247


REV
C

SCALE NTS

DATE 05/23/11


SHEET 1 OF 6

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

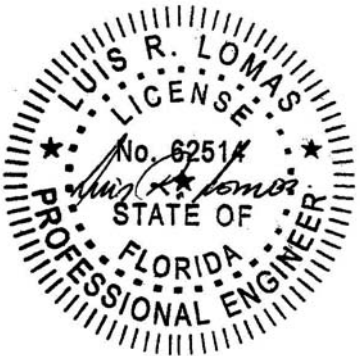

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW TESTING	01/08/14	R.L.
B	REVISED INSTALLATION DETAILS	09/15/15	R.L.
C	REVISED PER NEW REQUIREMENTS	08/06/19	R.L.

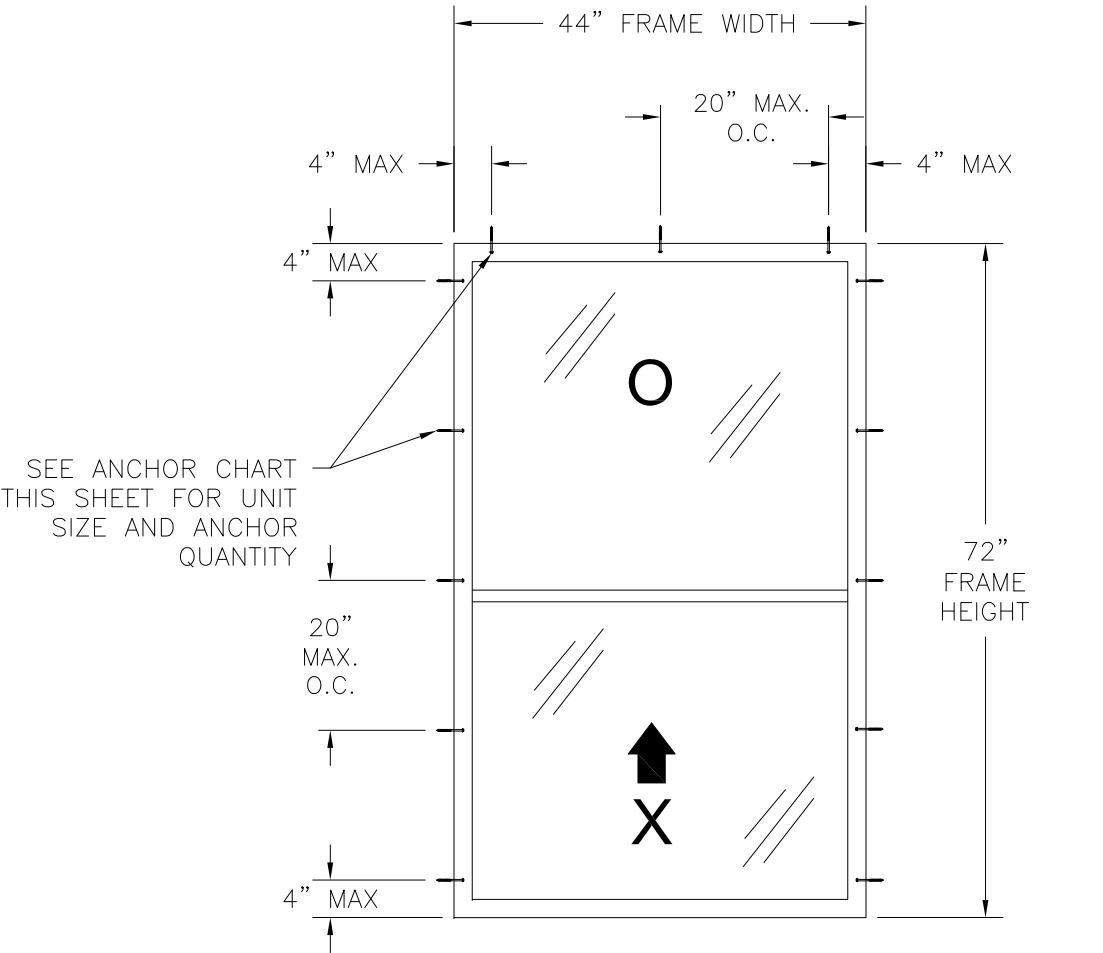

SERIES 3240/3540 FINLESS PVC SINGLE HUNG WINDOW
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
+35.0/-47.0PSF	NONE

44" X 72" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS
FRAME AREA DOES NOT EXCEED 22.0 FT²

- NOTES:
- SASH SIZE: 42 1/16" X 35 7/16"
 - D.L.O.: 40 1/8" X 32 5/8"

HARDWARE SCHEDULE	
A.	(2) METAL CAM LOCK, 7" FROM EACH END AT INTERIOR MEETING RAIL WITH KEEPERS
B.	(2) PVC SURFACE MOUNT TILT LATCH AT INTERIOR MEETING RAIL ENDS
C.	(2) COIL BALANCES AT EACH JAMB
D.	(2) METAL PIVOT BAR AT BOTTOM RAIL ENDS
E.	STEEL REINFORCEMENT (GVL-451-020) AT SASH RAILS AND STILES
F.	STEEL REINFORCEMENT (RF-104S-020) AT FIXED MEETING RAIL

NUMBER OF ANCHOR LOCATIONS REQUIRED												
Frame Height (in)	Frame Width (in)											
	18.00		24.00		30.00		36.00		42.00		44.00	
	Head	Jamb	Head	Jamb	Head	Jamb	Head	Jamb	Head	Jamb	Head	Jamb
24.00	2	2	2	2	3	2	3	2	3	2	3	2
30.00	2	3	2	3	3	3	3	3	3	3	3	3
36.00	2	3	2	3	3	3	3	3	3	3	3	3
42.00	2	3	2	3	3	3	3	3	3	3	3	3
48.00	2	3	2	3	3	3	3	3	3	3	3	3
54.00	2	4	2	4	3	4	3	4	3	4	3	4
60.00	2	4	2	4	3	4	3	4	3	4	3	4
66.00	2	4	2	4	3	4	3	4	3	4	3	4
72.00	2	5	2	5	3	5	3	5	3	5	3	5

MI WINDOWS AND DOORS, LLC.
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 3240/3540 FINLESS PVC SINGLE HUNG
STEEL REINFORCED NON-IMPACT 44" X 72"
ELEVATION

DRAWN:
TJH

DWG NO.
08-01247

REV
C

SCALE NTS

DATE 05/23/11




SHEET 2 OF 6

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/06/2019




Luis R. Lomas P.E.
FL No.: 62514

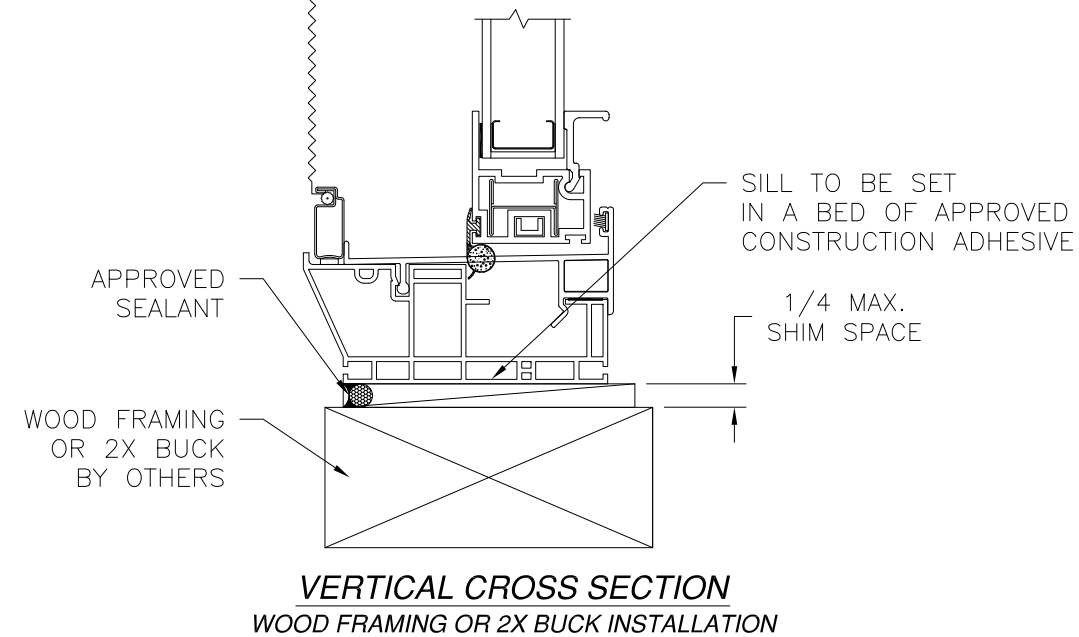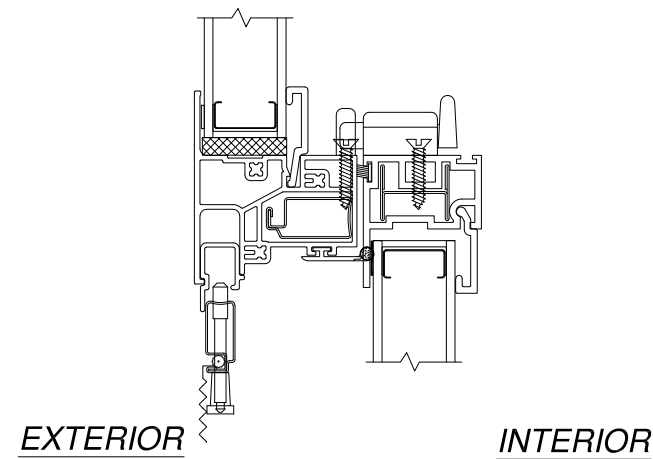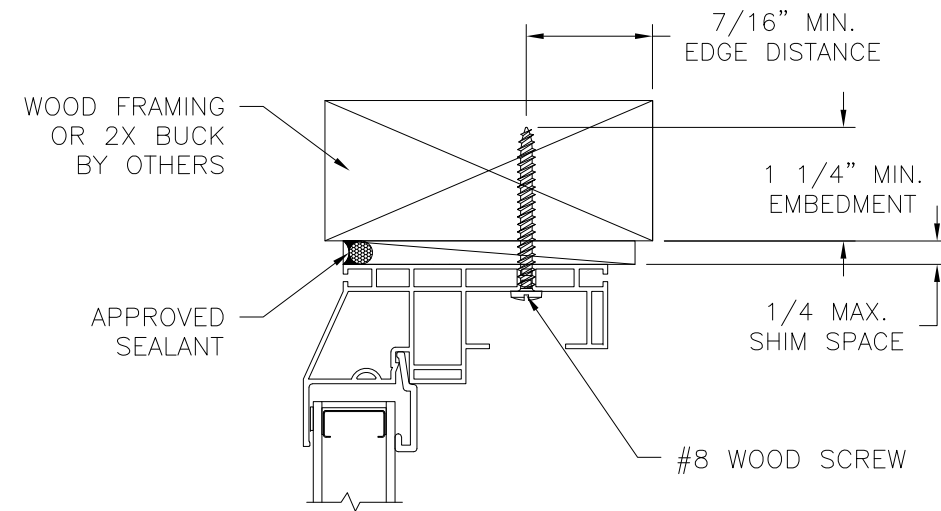

NOTES:
 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW TESTING	01/08/14	R.L.
B	REVISED INSTALLATION DETAILS	09/15/15	R.L.
C	REVISED PER NEW REQUIREMENTS	08/06/19	R.L.

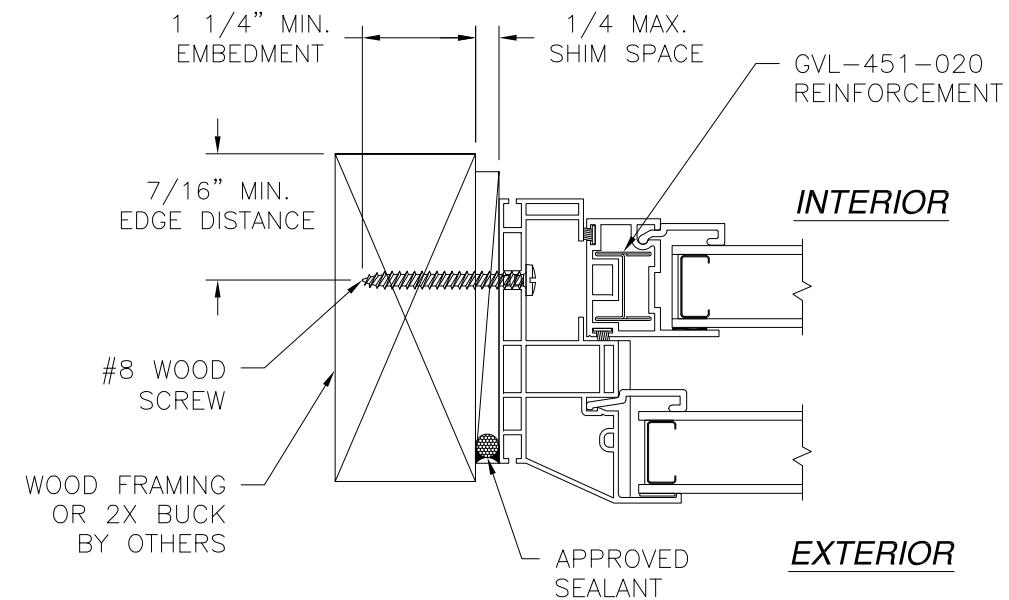

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION


MI WINDOWS AND DOORS, LLC.
 650 WEST MARKET STREET
 GRATZ, PA 17030-0370

SERIES 3240/3540 FINLESS PVC SINGLE HUNG
 STEEL REINFORCED NON-IMPACT 44" X 72"
 INSTALLATION DETAILS


DRAWN: TJH	DWG NO. 08-01247	REV C
SCALE NTS	DATE 05/23/11	SHEET 3 OF 6

L. ROBERTO LOMAS P.E.
 1432 WOODFORD RD LEWISVILLE, NC 27023
 434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/06/2019

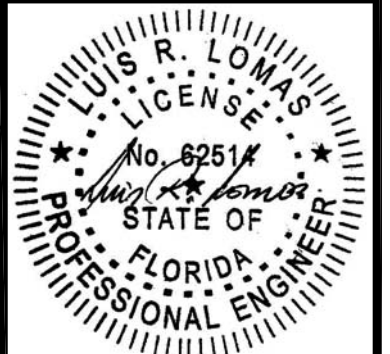


Luis R. Lomas P.E.
 FL No.: 62514

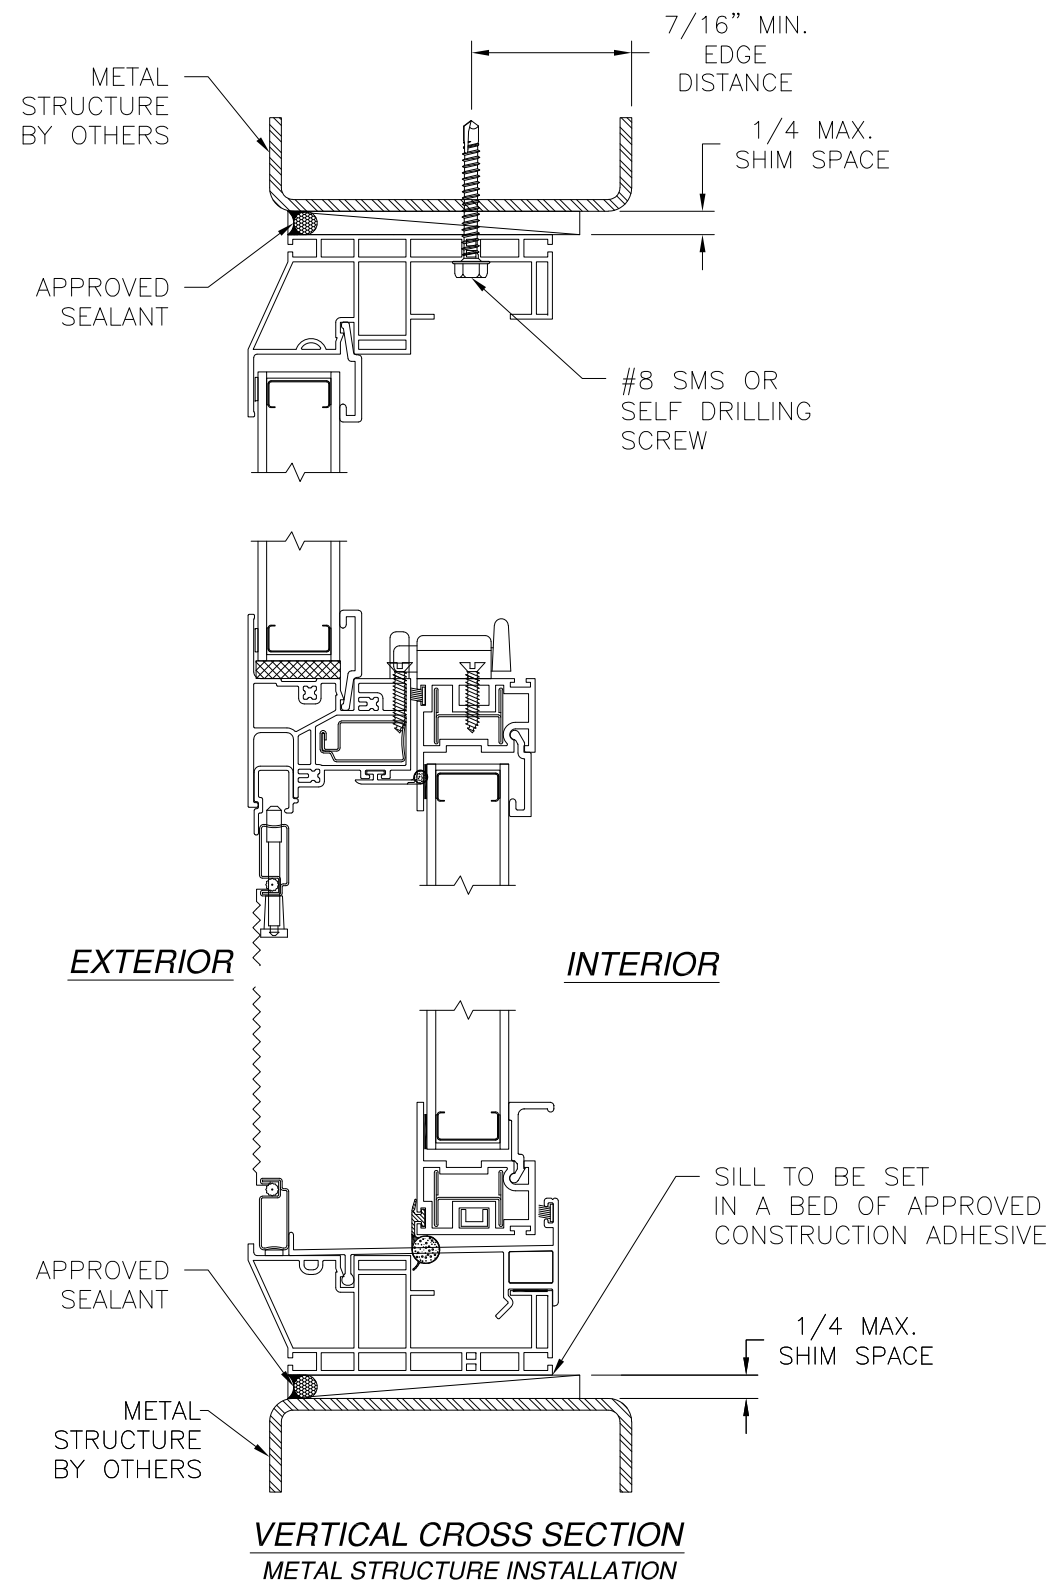


NOTES:
 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW TESTING	01/08/14	R.L.
B	REVISED INSTALLATION DETAILS	09/15/15	R.L.
C	REVISED PER NEW REQUIREMENTS	08/06/19	R.L.



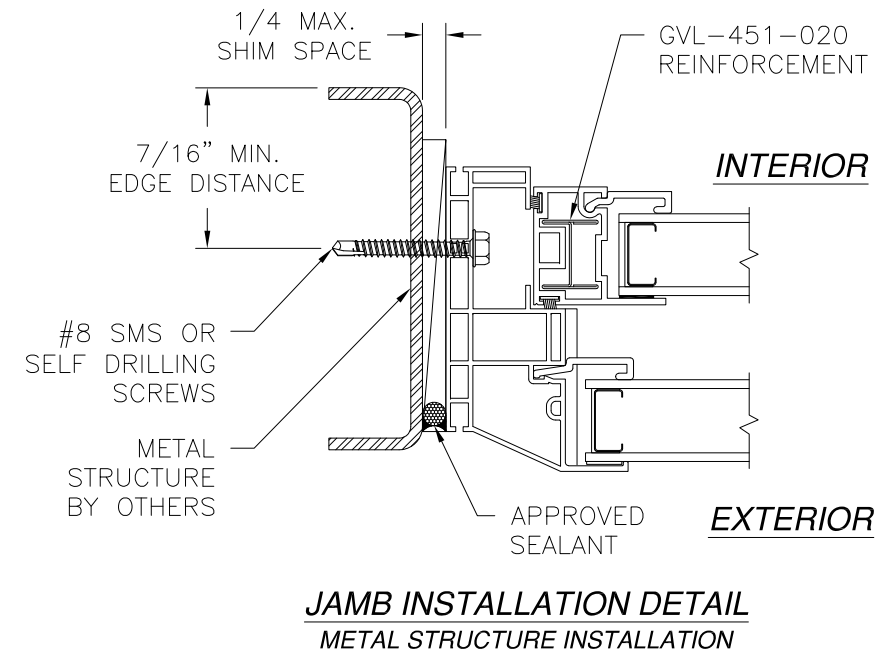


MI WINDOWS AND DOORS, LLC. 650 WEST MARKET STREET GRATZ, PA 17030-0370		
SERIES 3240/3540 FINLESS PVC SINGLE HUNG STEEL REINFORCED NON-IMPACT 44" X 72" INSTALLATION DETAILS		
DRAWN: TJH	DWG NO. 08-01247	REV C
SCALE NTS	DATE 05/23/11	SHEET 4 OF 6
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		


SIGNED: 08/06/2019

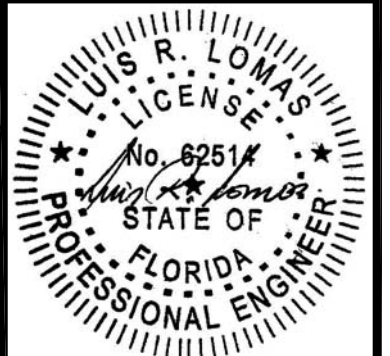

Luis R. Lomas P.E.
FL No.: 62514

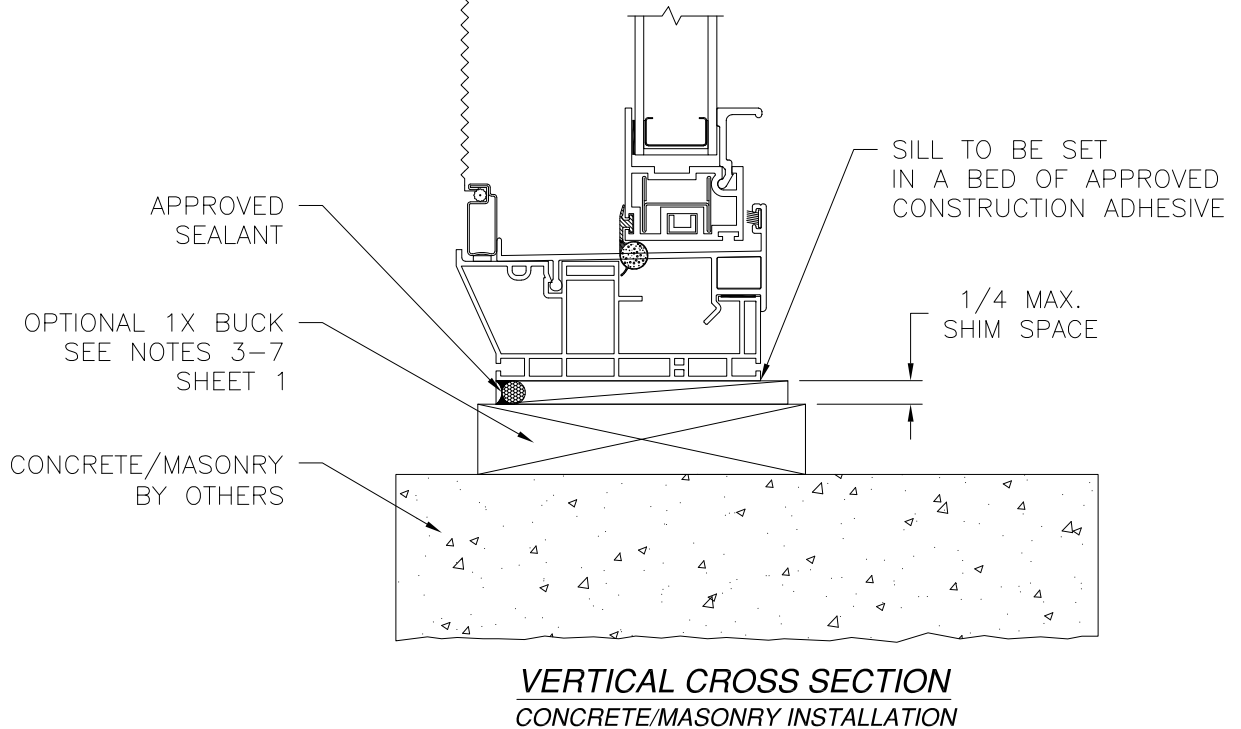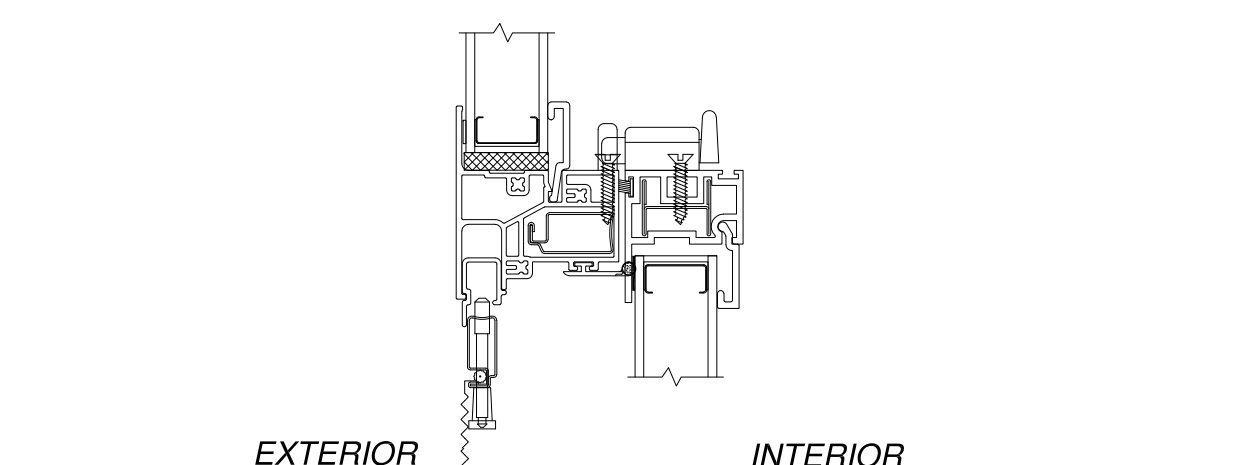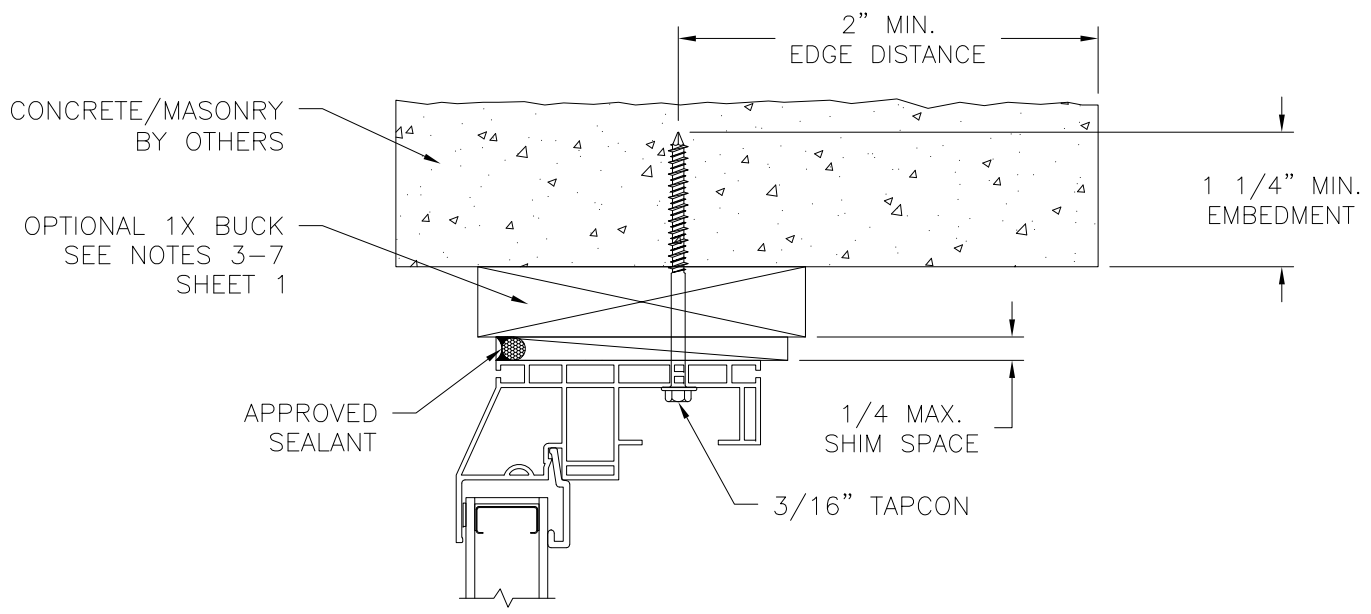

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW TESTING	01/08/14	R.L.
B	REVISED INSTALLATION DETAILS	09/15/15	R.L.
C	REVISED PER NEW REQUIREMENTS	08/06/19	R.L.

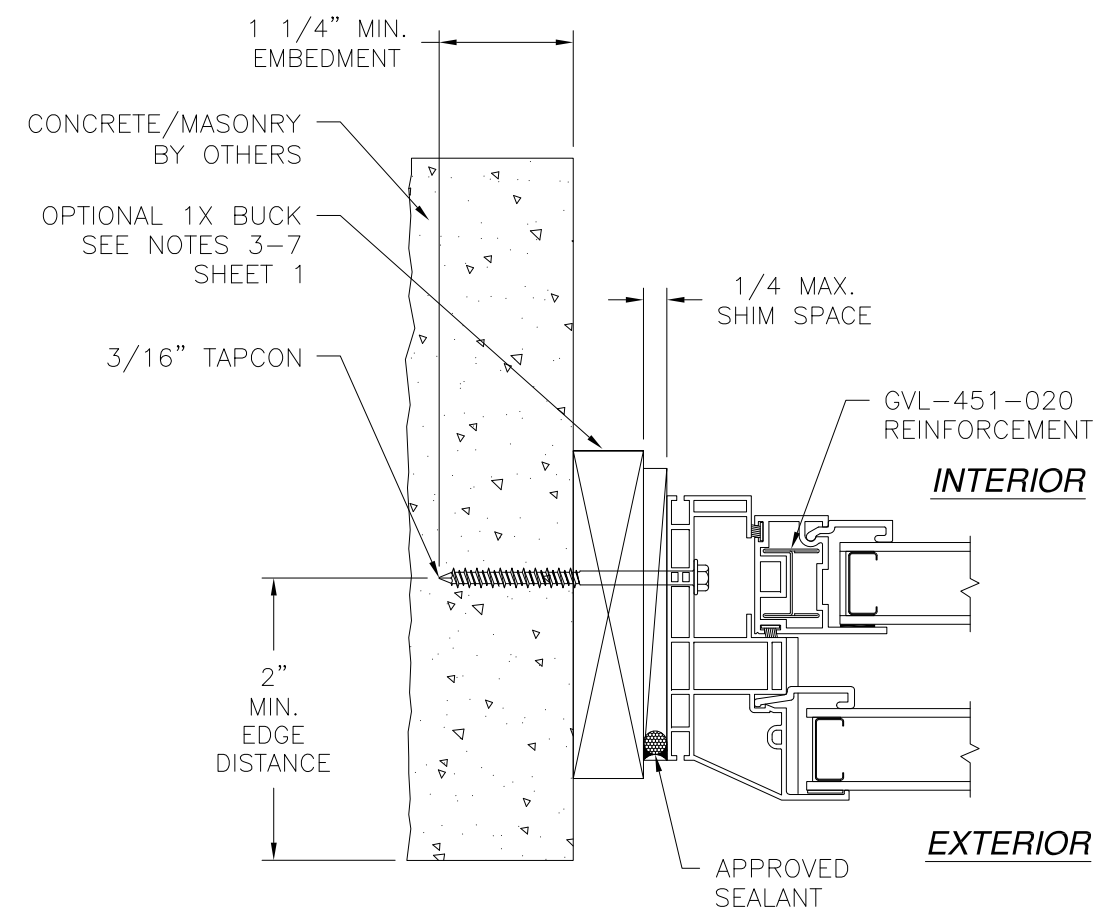

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/06/2019

MI WINDOWS AND DOORS, LLC.
650 WEST MARKET STREET
GRATZ, PA 17030-0370









SERIES 3240/3540 FINLESS PVC SINGLE HUNG
STEEL REINFORCED NON-IMPACT 44" X 72"
INSTALLATION DETAILS

DRAWN: TJH	DWG NO. 08-01247	REV C
SCALE NTS	DATE 05/23/11	SHEET 5 OF 6

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW TESTING	01/08/14	R.L.
B	REVISED INSTALLATION DETAILS	09/15/15	R.L.
C	REVISED PER NEW REQUIREMENTS	08/06/19	R.L.

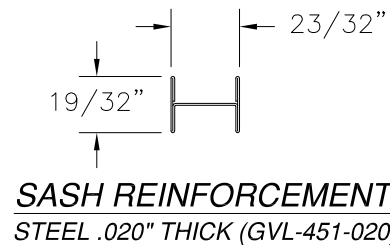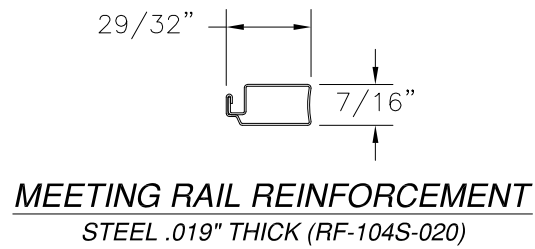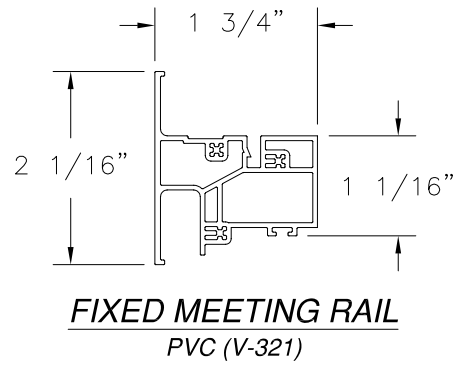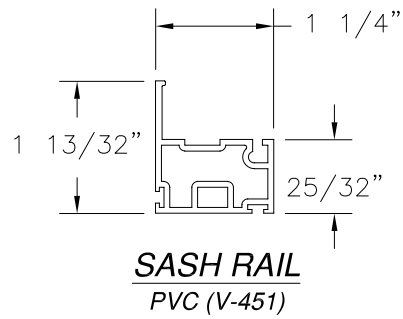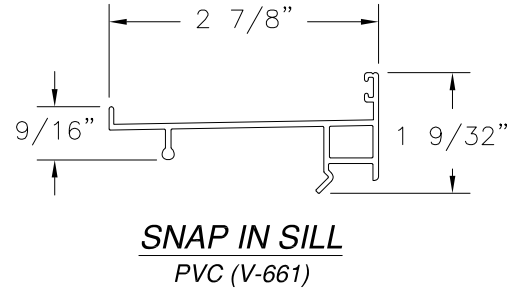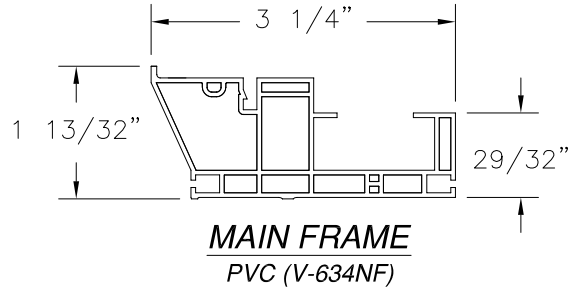


MI WINDOWS AND DOORS, LLC.
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 3240/3540 FINLESS PVC SINGLE HUNG
STEEL REINFORCED NON-IMPACT 44" X 72"
COMPONENTS

DRAWN: TJH	DWG NO. 08-01247	REV C
SCALE NTS	DATE 05/23/11	SHEET 6 OF 6

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/06/2019

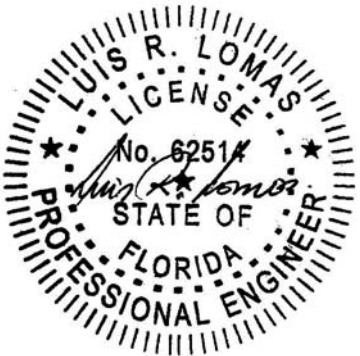

Luis R. Lomas P.E.
FL No.: 62514