

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED NOTES	08/07/19	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. SHIM AS REQUIRED AT WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE MADE FROM MATERIALS CAPABLE OF SUSTAINING APPLICABLE LOADS, LOCATED AND APPLIED IN A THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300-04/09.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #6 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/2" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING THROUGH FIN INTO METAL STRUCTURE USE #6 SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. ALL FASTENERS TO BE CORROSION RESISTANT.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .048" THICK MINIMUM
18. GEOMETRIC SHAPES ARE ALSO APPROVED. APPROVED GEOMETRIC SHAPES DIMENSIONS SHALL NOT EXCEED INSCRIBED DIMENSIONS OF APPROVED RECTANGULAR ASSEMBLY SHOWN IN SHEET 2.

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3 – 6	INSTALLATION DETAILS
7	COMPONENTS

MI WINDOWS & DOORS, LLC
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 3540 PVC SINGLE HUNG WINDOW
REINFORCED NON-IMPACT 40" X 66"
NOTES

DRAWN:
A.R.

DWG NO.
08-03349

REV
A


SCALE NTS

DATE 11/07/18

SHEET 1 OF 7


L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/07/2019

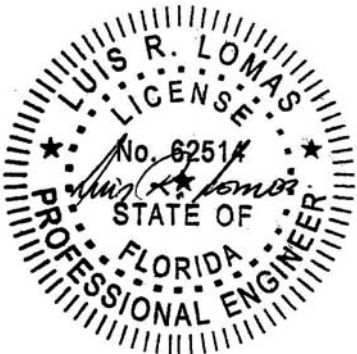

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED NOTES	08/07/19	R.L.

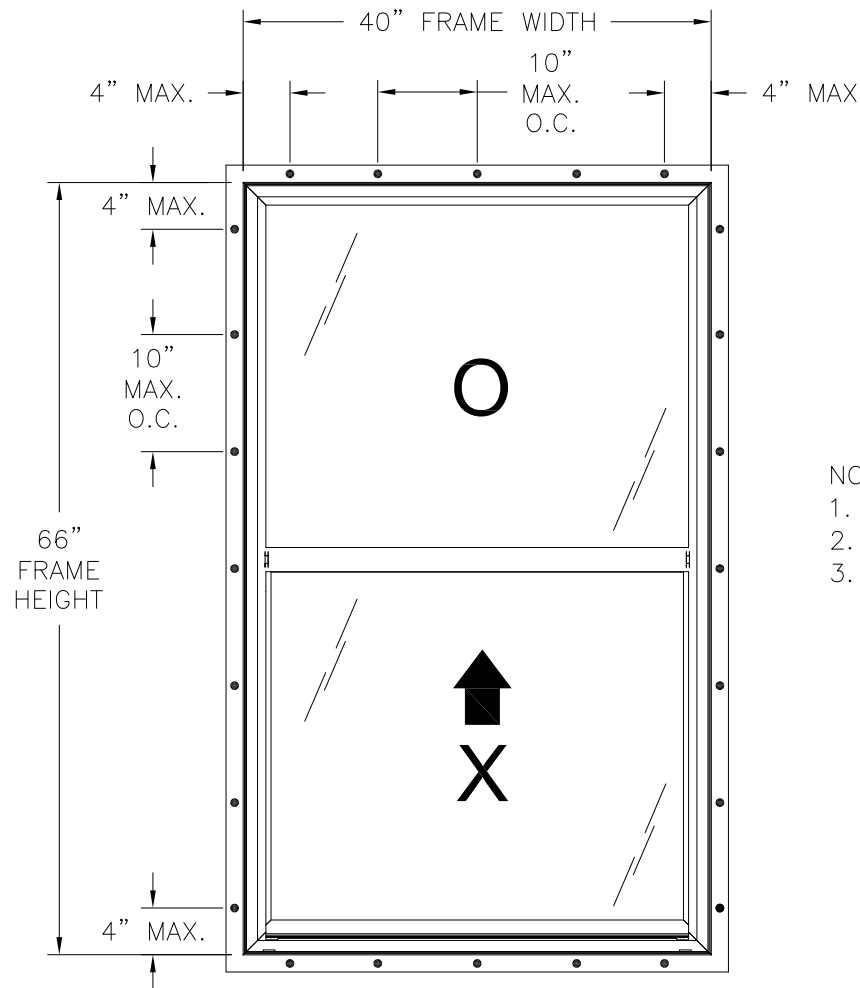

- NOTES:
1. SASH SIZE: 38 1/8" X 32 3/8"
 2. FIXED SASH D.L.O.: 36 1/8" X 29 1/4"
 3. OPERABLE SASH D.L.O.: 35 1/4" X 29 1/2"

SERIES 3540 PVC SINGLE HUNG WINDOW
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
+40.0/-45.0PSF	NONE

FOR AREAS WHERE WATER INFILTRATION
RESISTANCE IS NOT REQUIRED

DESIGN PRESSURE RATING	IMPACT RATING
+35.0/-45.0PSF	NONE


FOR AREAS WHERE WATER INFILTRATION
RESISTANCE IS REQUIRED

40" X 66" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS
FRAME AREA DOES NOT EXCEED 18.33 FT²

HARDWARE SCHEDULE	
A.	(2 PER SASH) METAL CAM LOCK WITH KEEPER AT INTERIOR MEETING RAIL, 7" FROM EACH END
B.	(2 PER SASH) PVC SURFACE MOUNT TILT LATCH AT INTERIOR MEETING RAIL ENDS
C.	(2 PER SASH) COIL BALANCES, ONE IN EACH JAMB
D.	(2 PER SASH) METAL PIVOT BAR AT BOTTOM RAIL ENDS
E.	STEEL REINFORCEMENT (GVL-451-020) AT SASH RAILS AND STILES
F.	STEEL REINFORCEMENT (RF-104S-020) AT FIXED MEETING RAIL




MI WINDOWS & DOORS, LLC 650 WEST MARKET STREET GRATZ, PA 17030-0370		
SERIES 3540 PVC SINGLE HUNG WINDOW REINFORCED NON-IMPACT 40" X 66" ELEVATION		
DRAWN: A.R.	DWG NO. 08-03349	REV A
SCALE NTS	DATE 11/07/18	SHEET 2 OF 7
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 08/07/2019

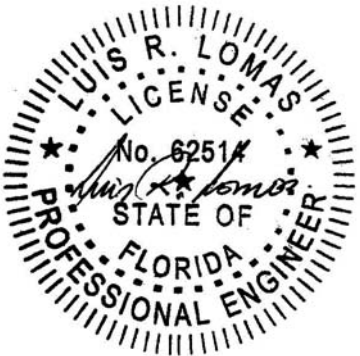

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED NOTES	08/07/19	R.L.

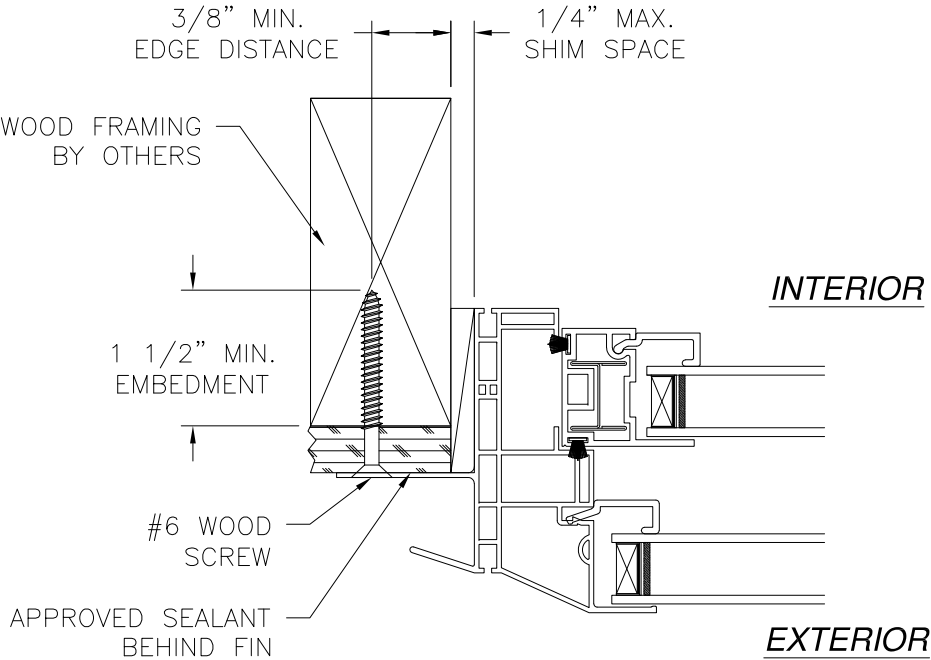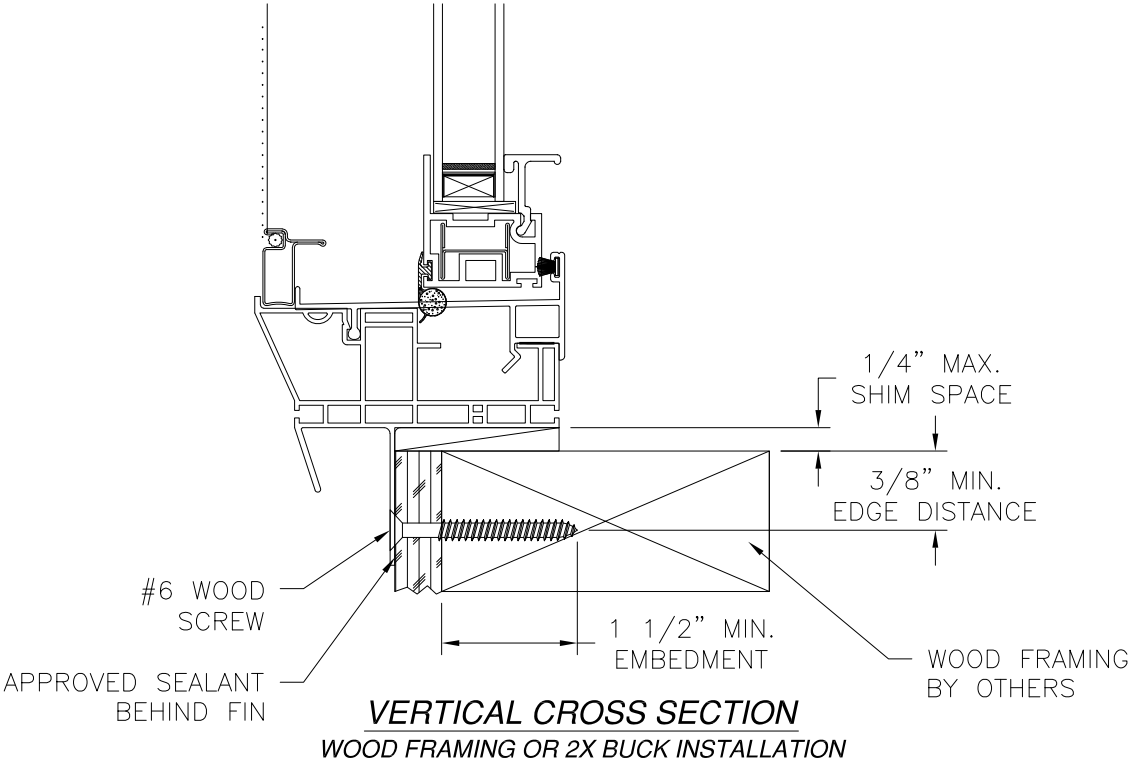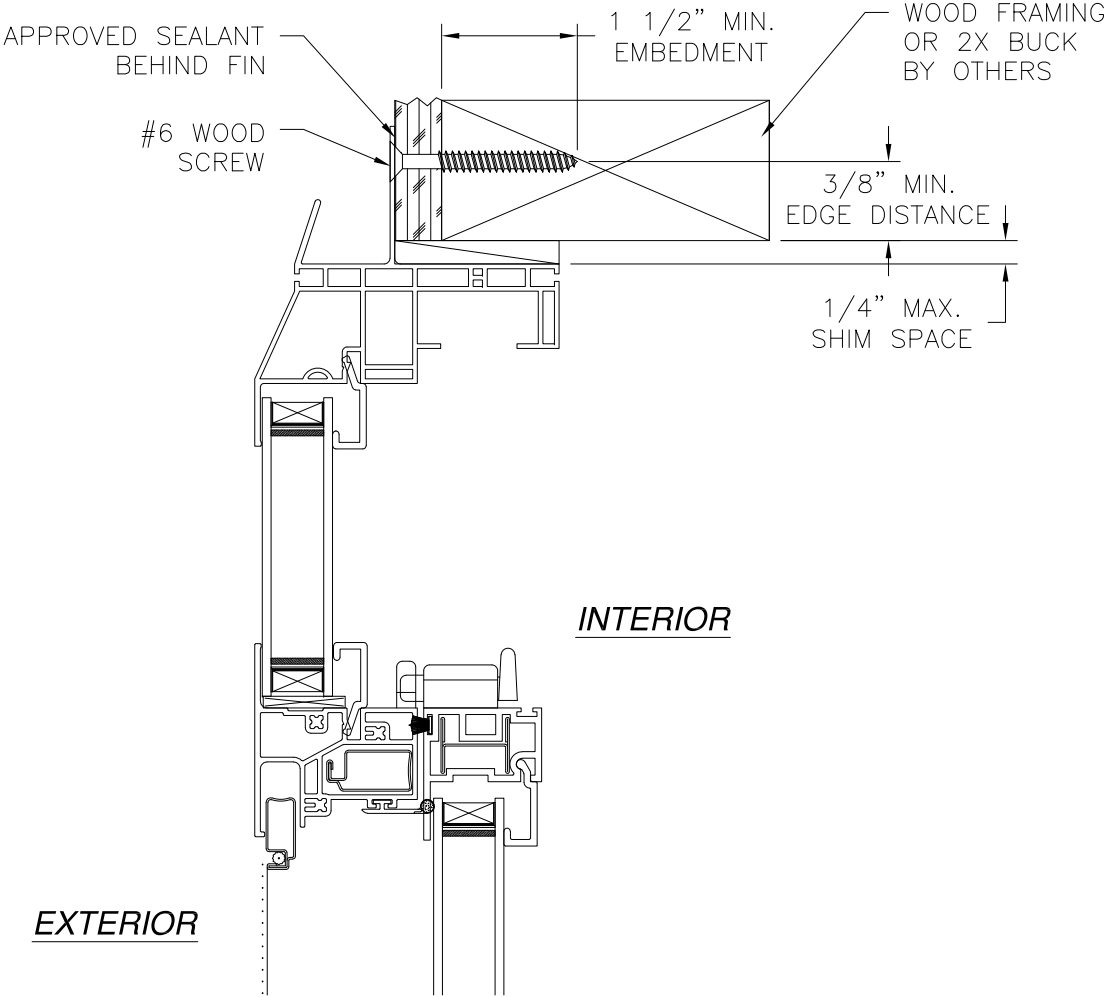

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/07/2019

MI WINDOWS & DOORS, LLC
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 3540 PVC SINGLE HUNG WINDOW
REINFORCED NON-IMPACT 40" X 66"
INSTALLATION DETAILS WITH "J" CHANNEL

DRAWN:
A.R.

DWG NO.
08-03349

REV
A

SCALE
NTS

DATE
11/07/18


SHEET
3 OF 7

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com




Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED NOTES	08/07/19	R.L.

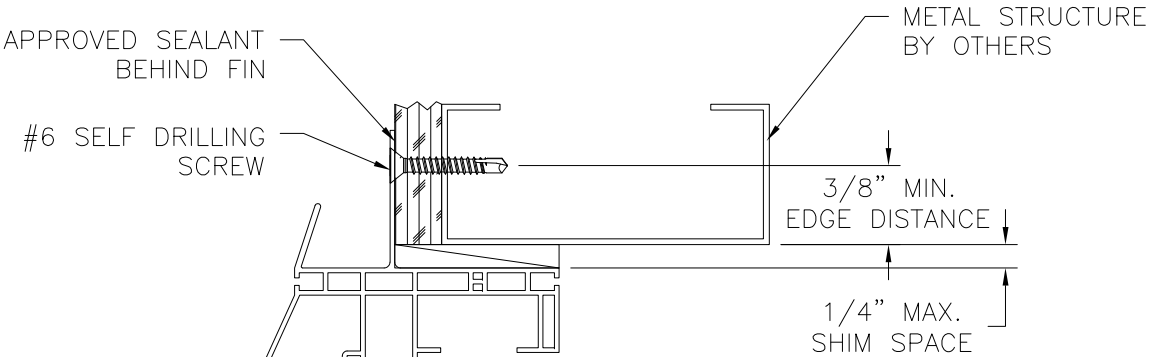


INTERIOR

EXTERIOR

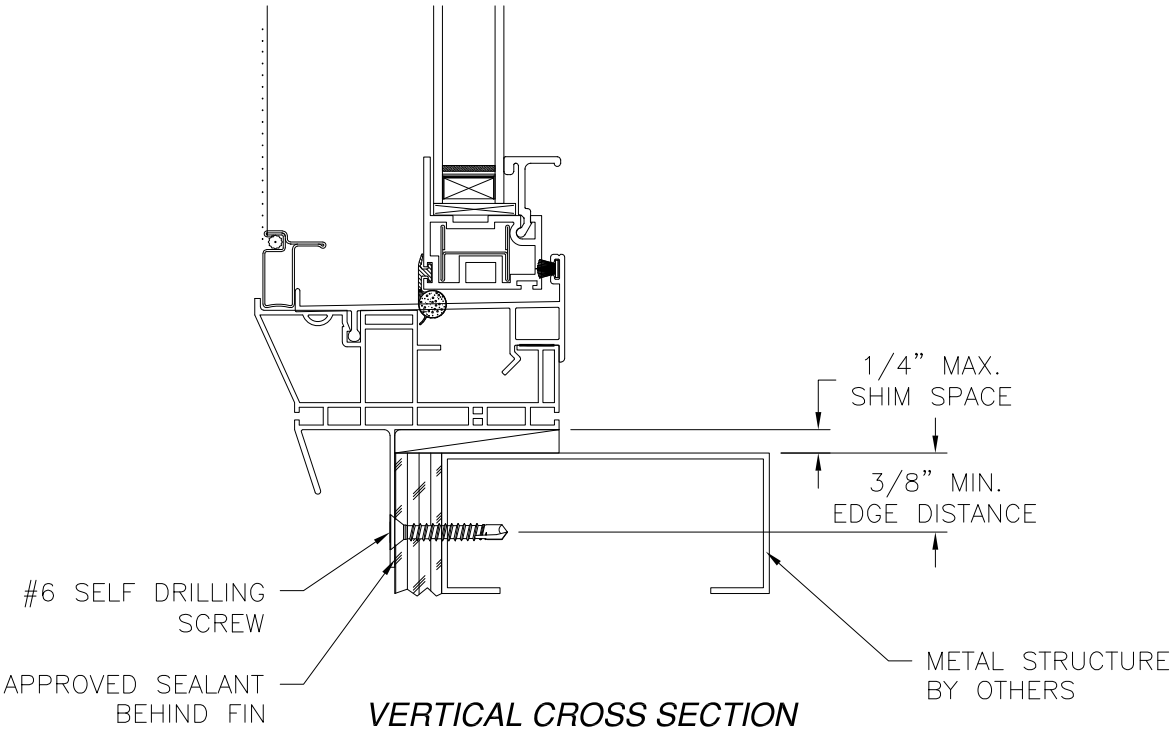

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

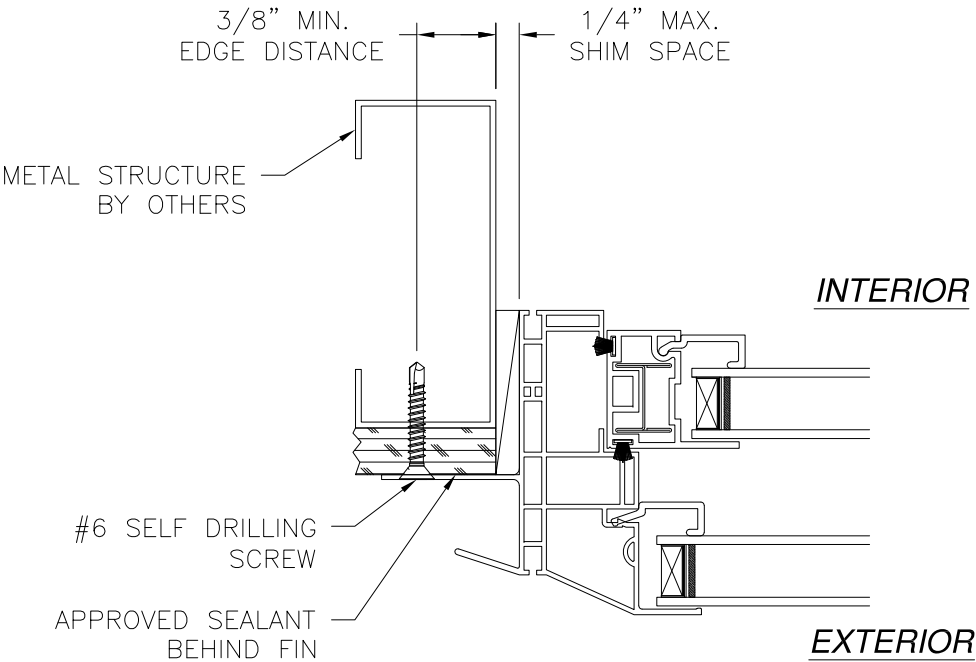


JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112




SIGNED: 08/07/2019

MI WINDOWS & DOORS, LLC 650 WEST MARKET STREET GRATZ, PA 17030-0370		
SERIES 3540 PVC SINGLE HUNG WINDOW REINFORCED NON-IMPACT 40" X 66" INSTALLATION DETAILS WITH "J" CHANNEL		
DRAWN: A.R.	DWG NO. 08-03349	REV A
SCALE NTS	DATE 11/07/18	SHEET 4 OF 7
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

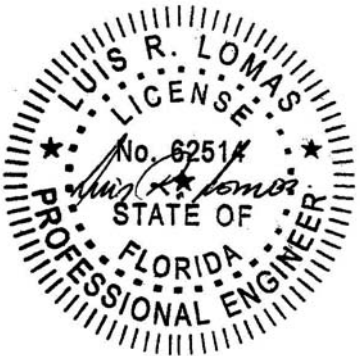

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED NOTES	08/07/19	R.L.

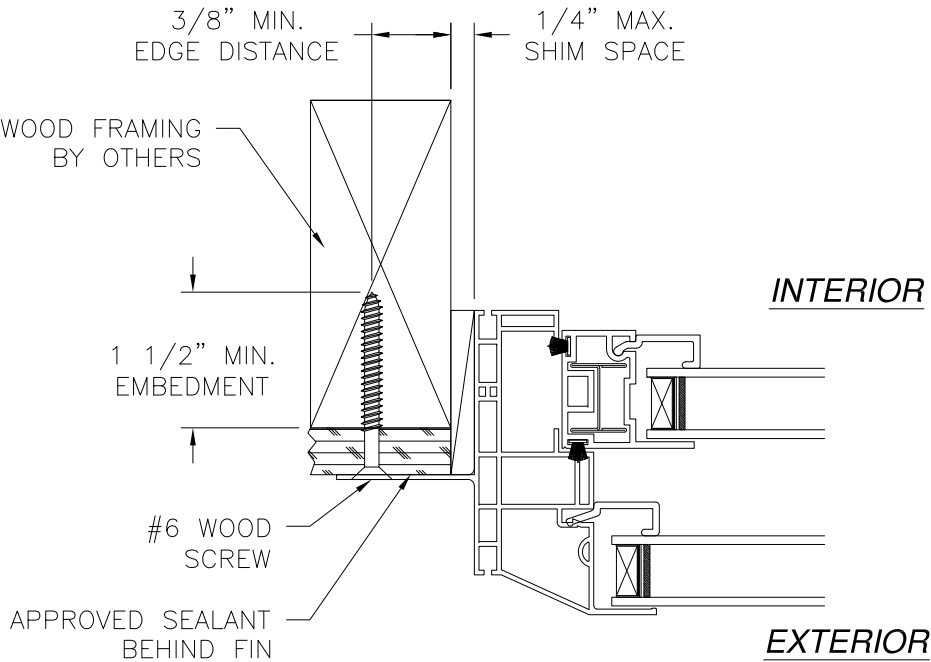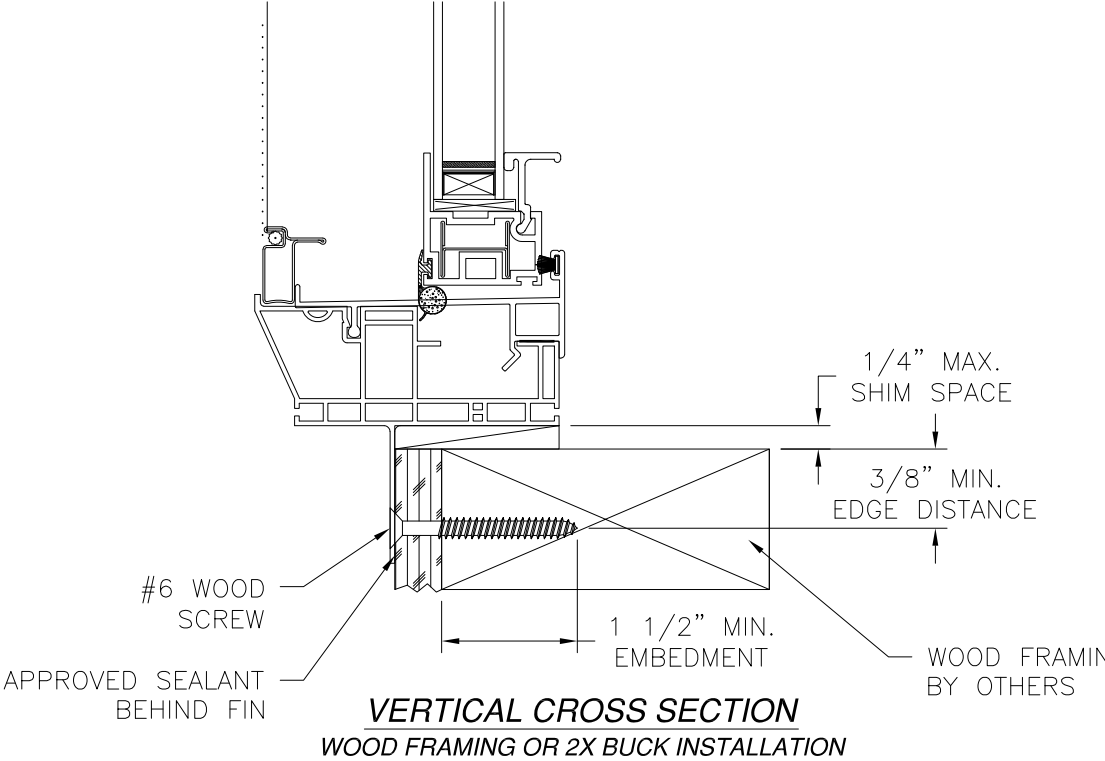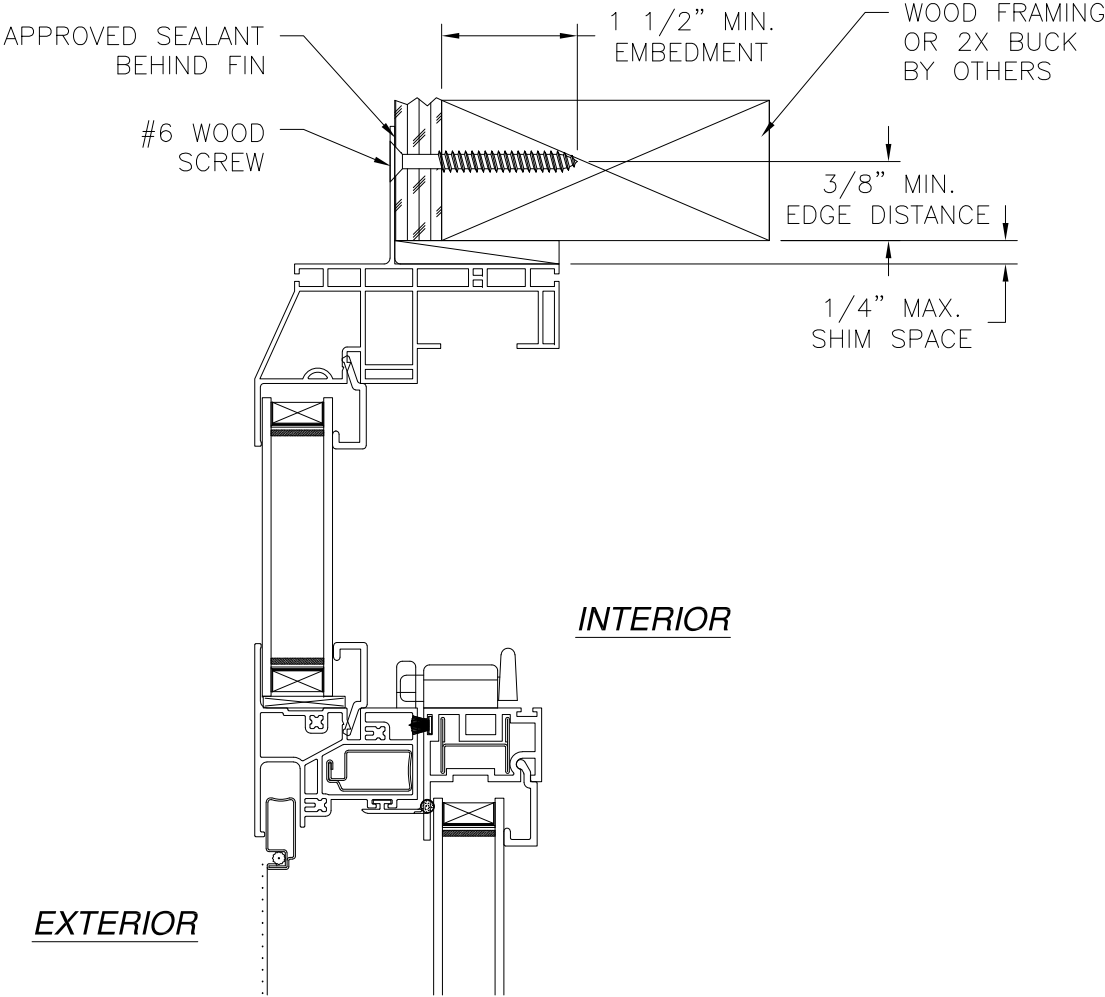

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/07/2019

MI WINDOWS & DOORS, LLC
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 3540 PVC SINGLE HUNG WINDOW
REINFORCED NON-IMPACT 40" X 66"
INSTALLATION DETAILS STANDARD FRAME

DRAWN:
A.R.

DWG NO.
08-03349


REV
A

SCALE
NTS

DATE
11/07/18


SHEET
5 OF 7

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

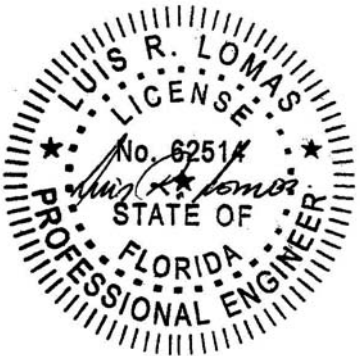


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED NOTES	08/07/19	R.L.

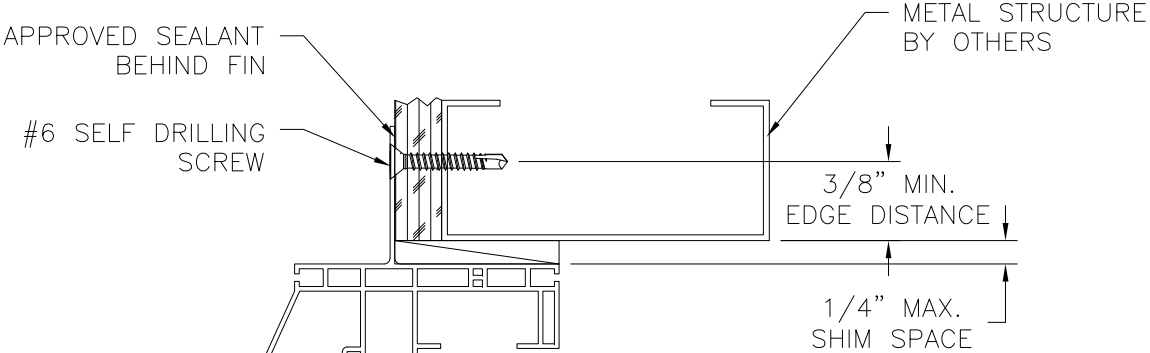


INTERIOR

EXTERIOR

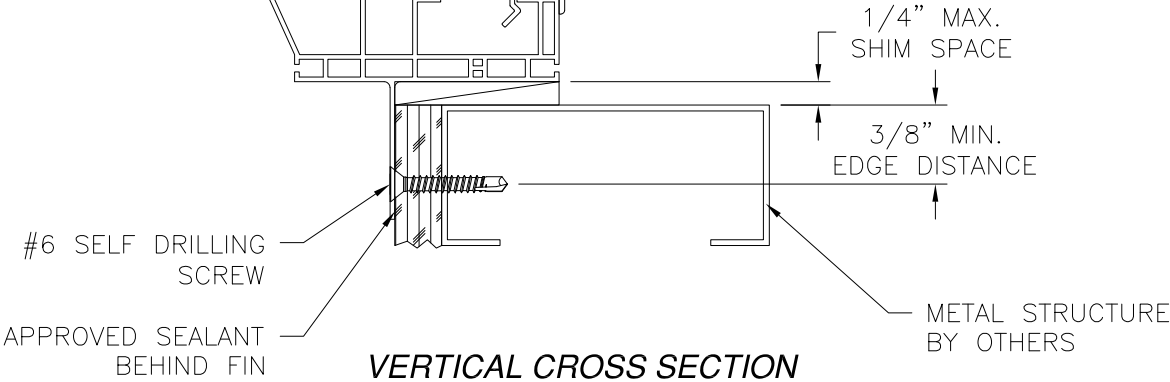

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

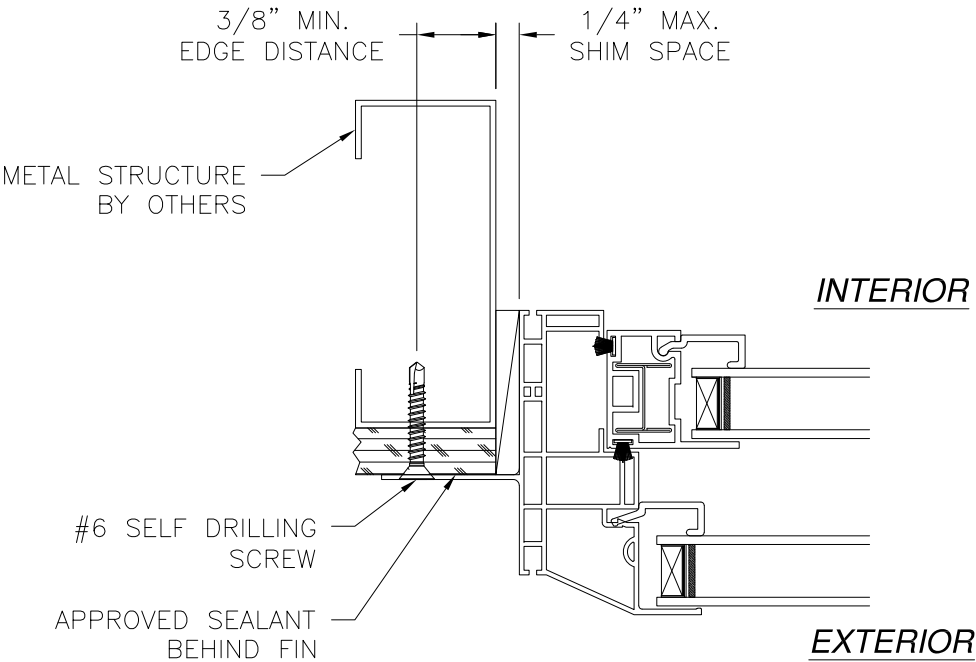

INTERIOR

EXTERIOR

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION











- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 08/07/2019

MI WINDOWS & DOORS, LLC 650 WEST MARKET STREET GRATZ, PA 17030-0370		
SERIES 3540 PVC SINGLE HUNG WINDOW REINFORCED NON-IMPACT 40" X 66" INSTALLATION DETAILS STANDARD FRAME		
DRAWN: A.R.	DWG NO. 08-03349	REV A
SCALE NTS	DATE 11/07/18	SHEET 6 OF 7
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		



Luis R. Lomas P.E.
FL No.: 62514

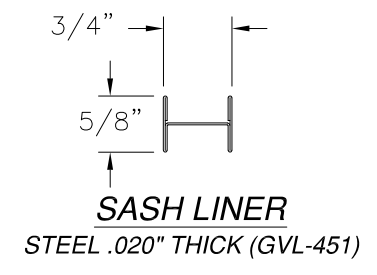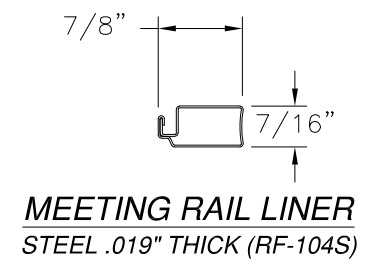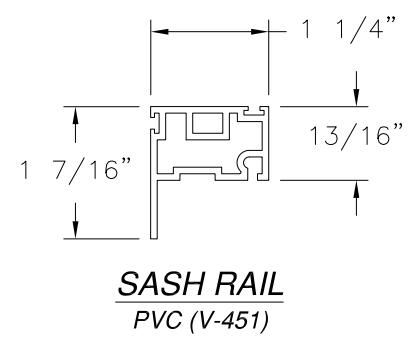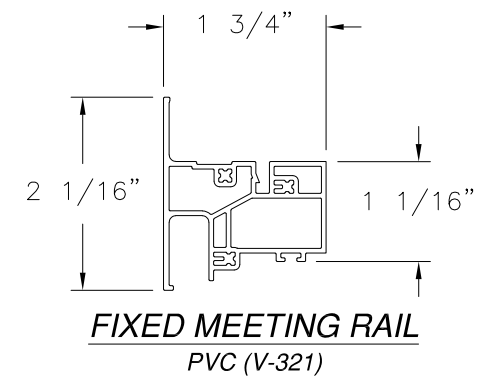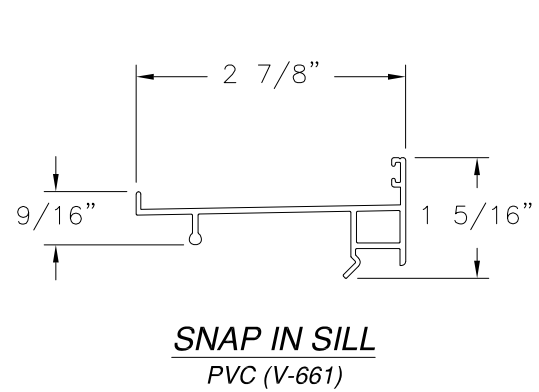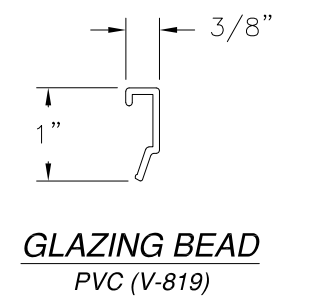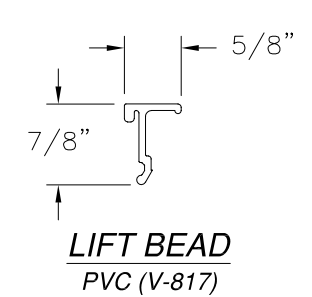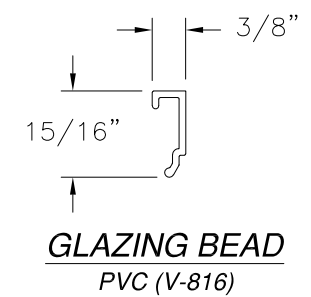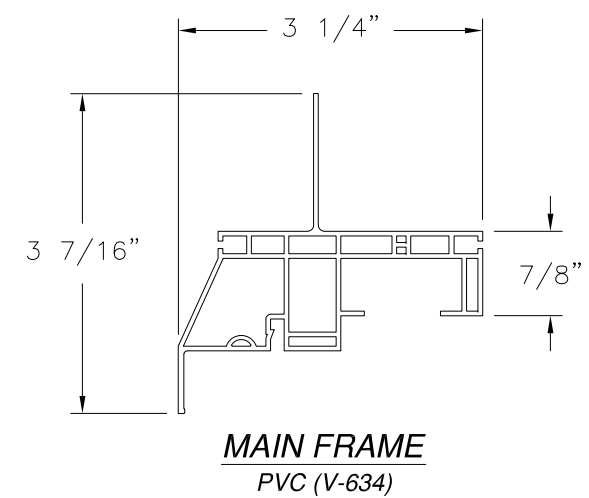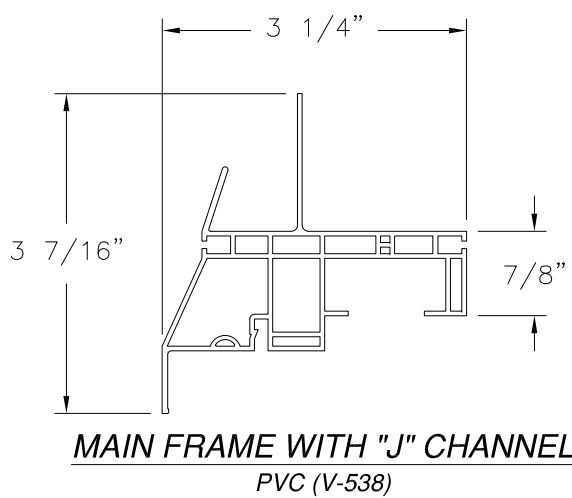

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED NOTES	08/07/19	R.L.

SIGNED: 08/07/2019

MI WINDOWS & DOORS, LLC
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 3540 PVC SINGLE HUNG WINDOW
REINFORCED NON-IMPACT 40" X 66"
COMPONENTS

DRAWN: A.R.	DWG NO. 08-03349	REV A
SCALE NTS	DATE 11/07/18	SHEET 7 OF 7

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

Luis R. Lomas P.E.
FL No.: 62514