
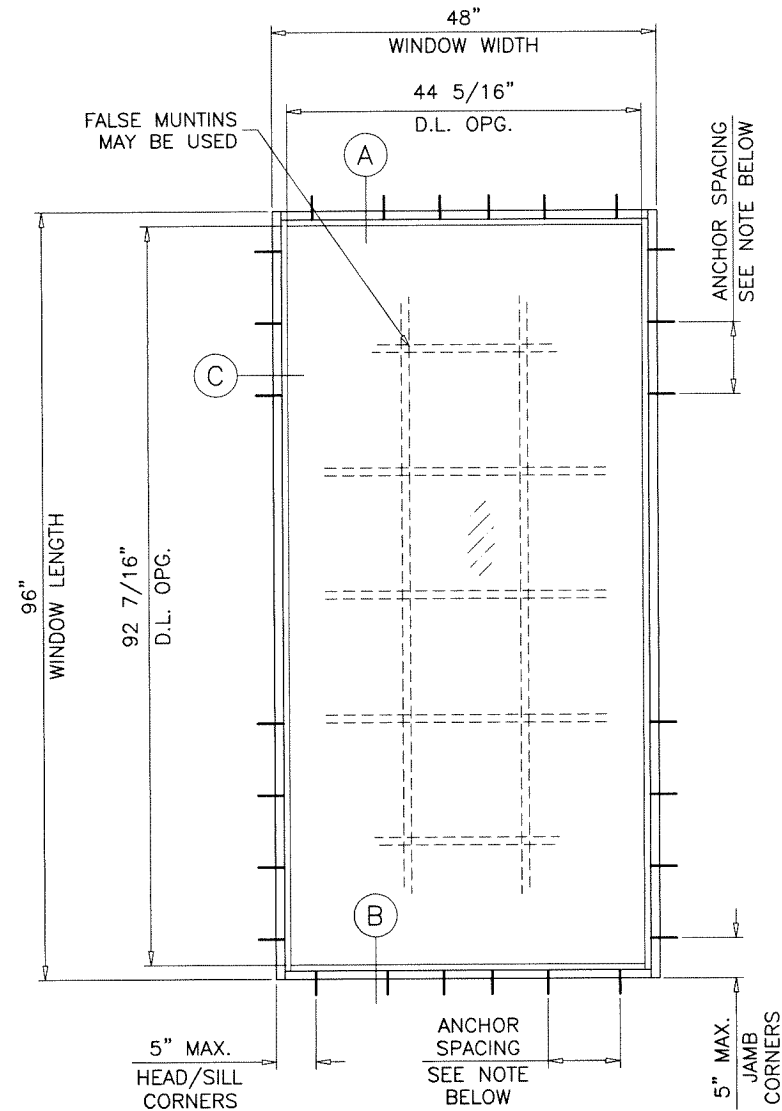


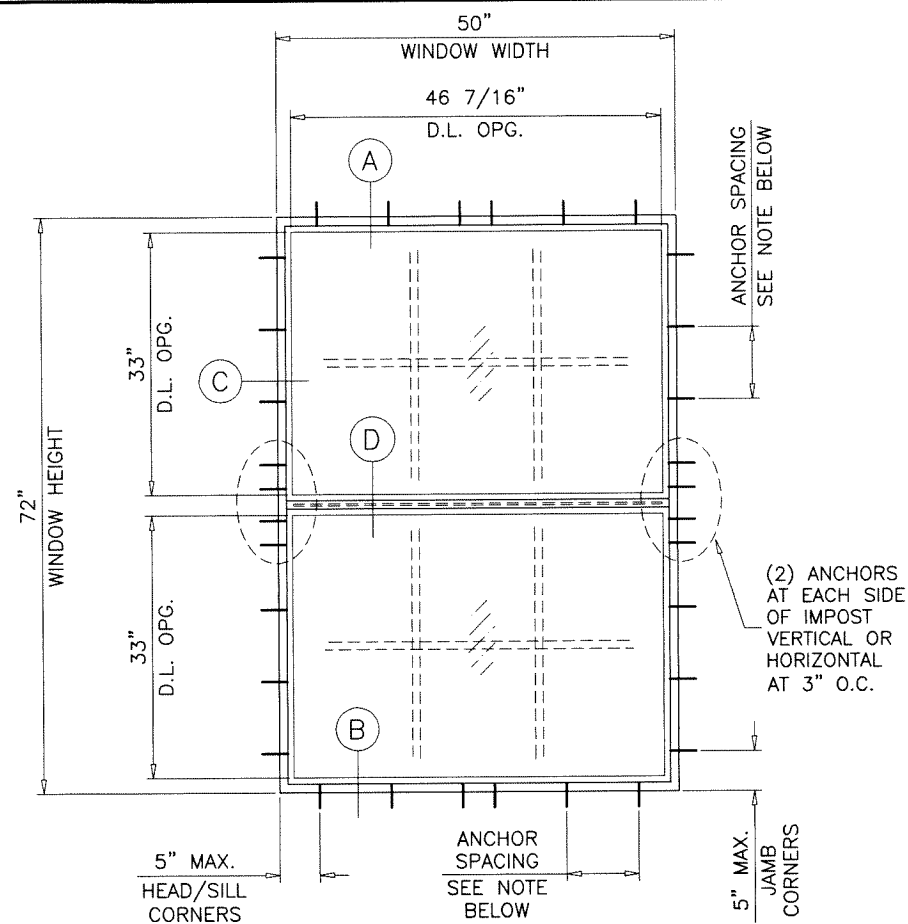

TYPICAL ELEVATIONS

ANCHOR SPACING:
9" MAX. FOR LOADS UP TO 100 PSF
8" MAX. FOR LOADS ABOVE 100 PSF

SERIES-3062/3000 ALUMINUM FIXED WINDOW

DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHRTS SHOWN ON SHEETS 3 & 3.1.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF FIXED/FIXED OR FIXED WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING F.B.C. APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY. ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

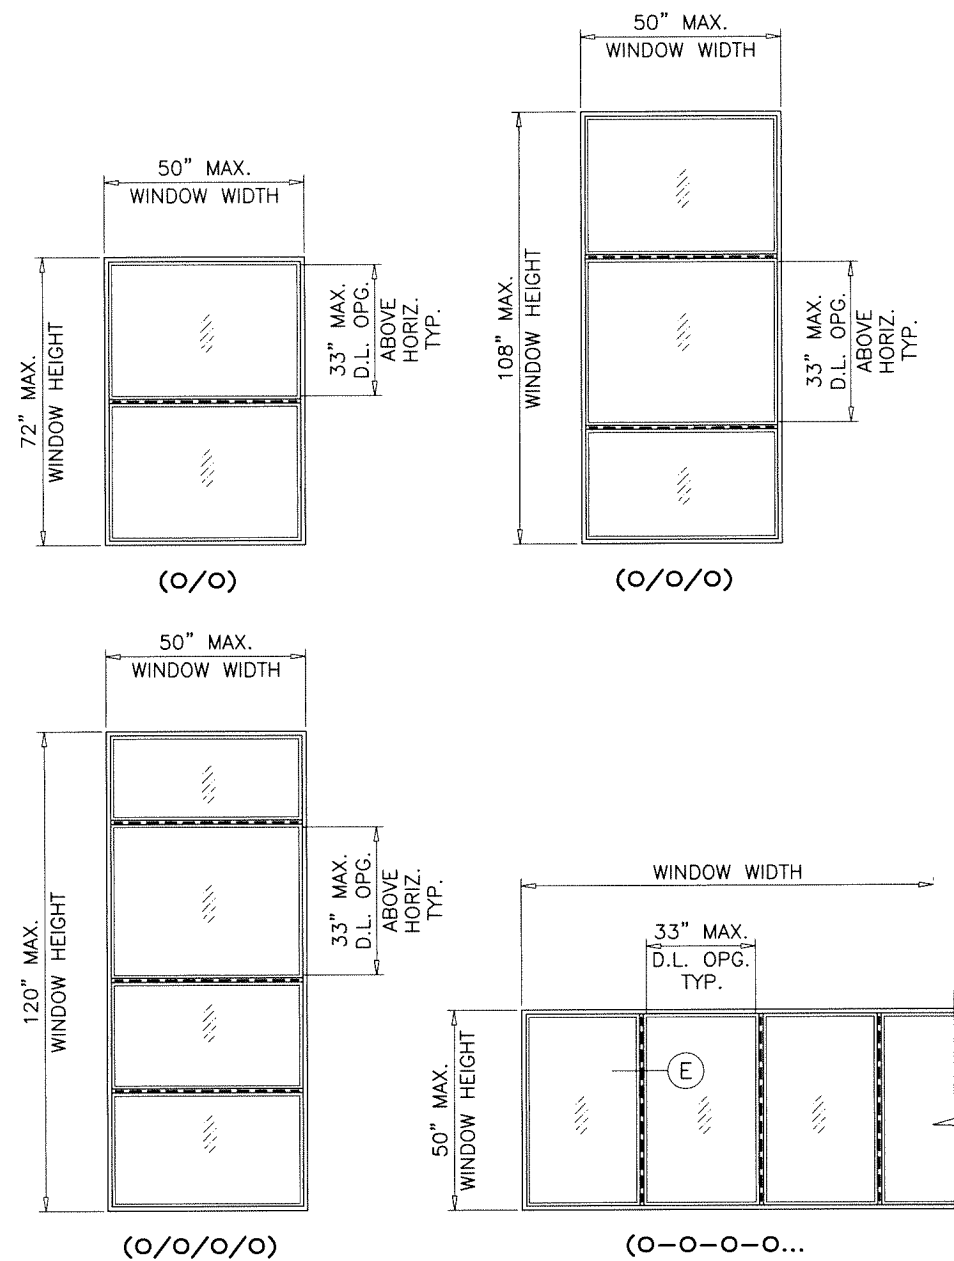

APPROVED CONFIGURATIONS


MAXIMUM DESIGN LOADS FOR WINDOWS WITH IMPOSTS IS +80.0, -90.0 PSF FOR GLASS CAPACITY SEE CHART ON SHEETS 3 & 3.1
LESSER VALUES FROM THE ABOVE WILL APPLY TO ENTIRE SYSTEM.

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Sealed: 12/11/2024

FL #17762

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

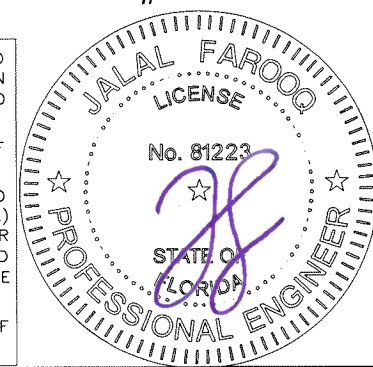


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035


revisions:				
no	date	by	description	
A	10.27.23		UPDATED TO 2023 FBC	
B	11.19.24		GLASS OPTIONS ADDED	

date: 04-30-15	scale: 1/2"=1'-0"	dr. by: TARIQ	chk. by:


drawing no.
W15-19
sheet 1 of 6

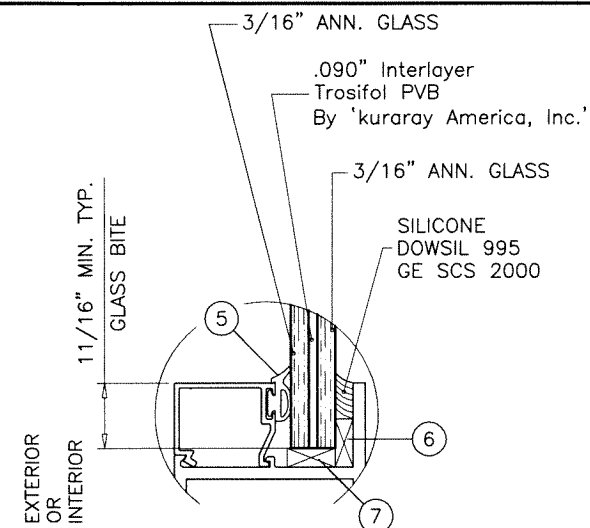


GLASS TYPE 'A'

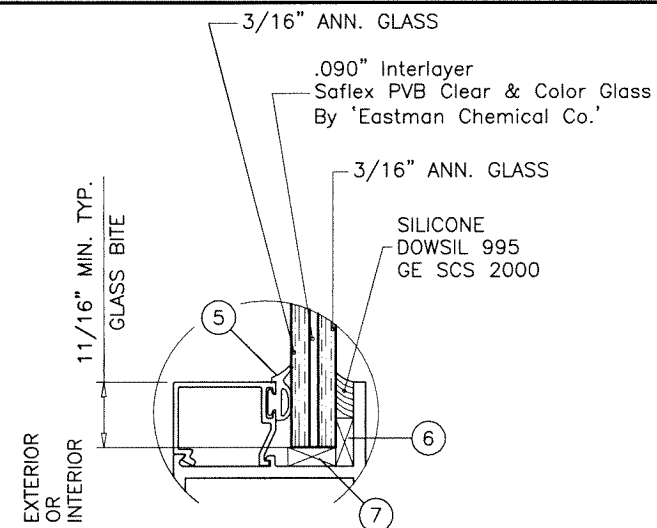


GLASS TYPE 'B'

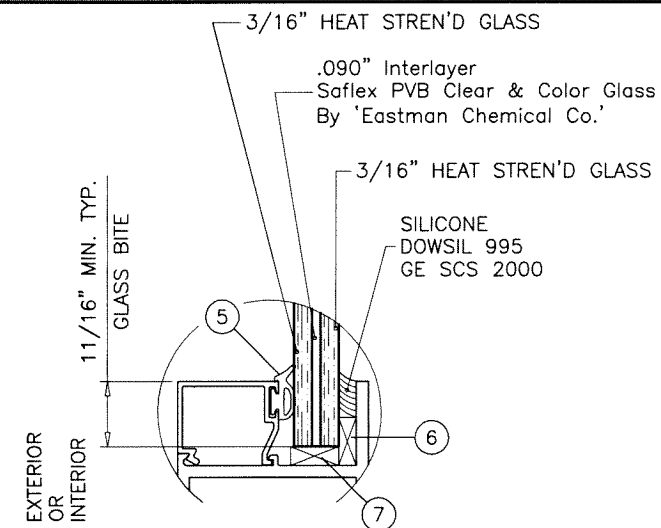


GLASS TYPE 'C'

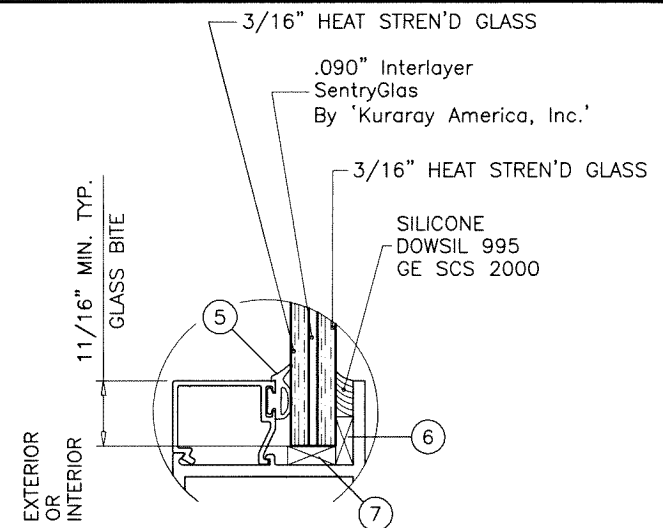


GLASS TYPE 'D'

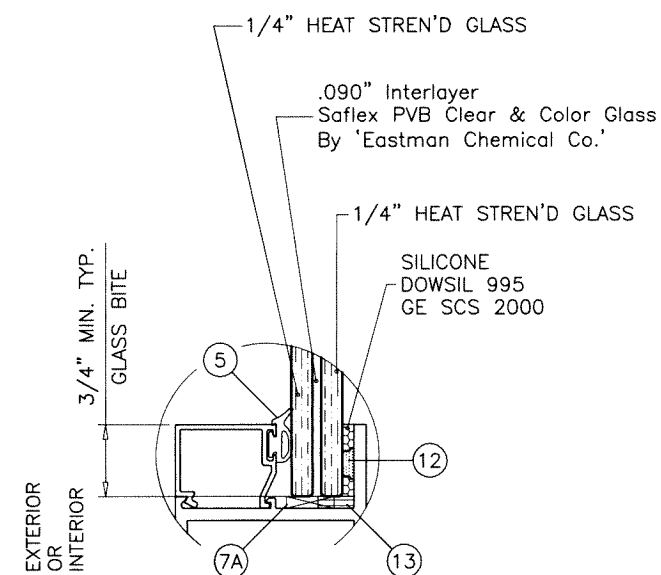


GLASS TYPE 'E'

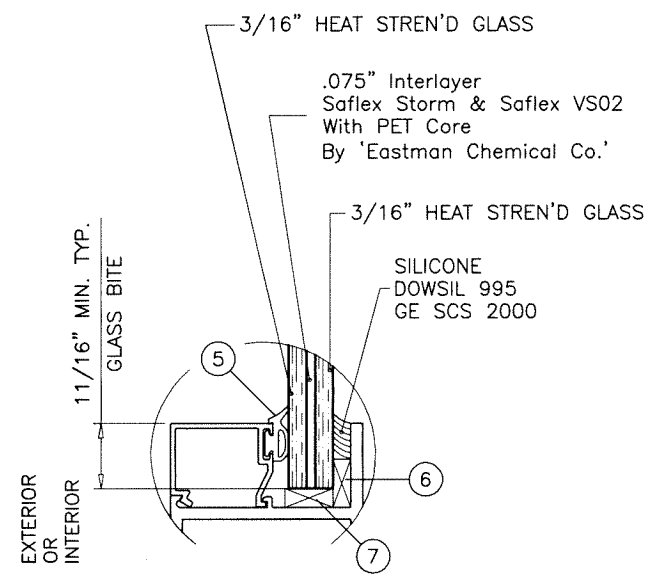


GLASS TYPE 'F'

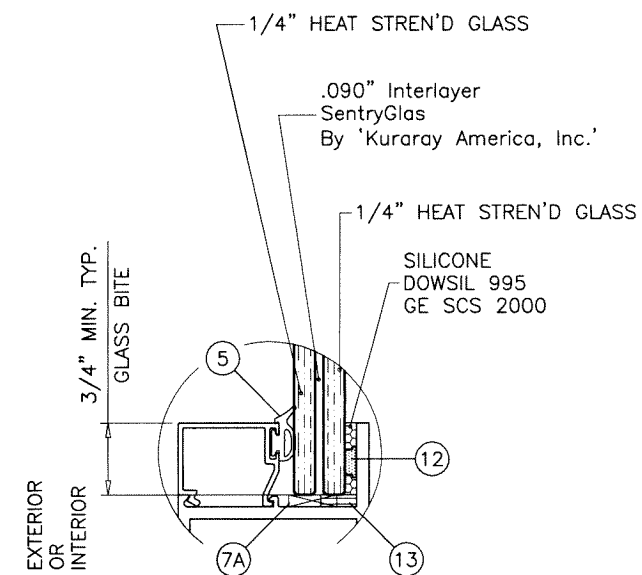


GLASS TYPE 'G'

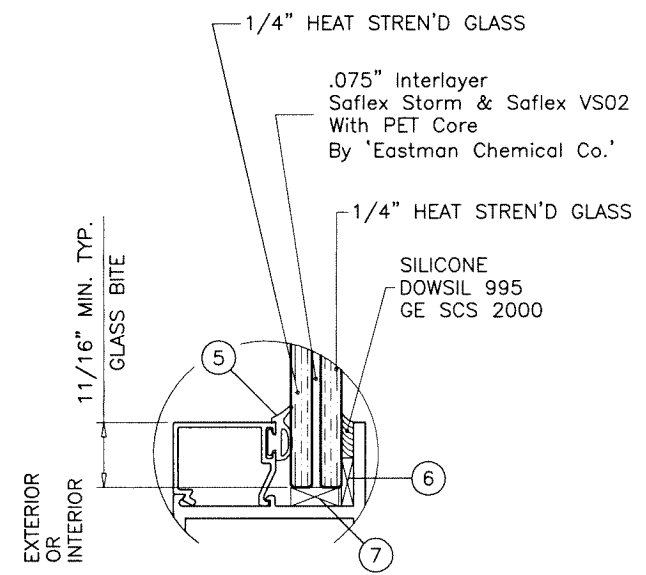

GLASS TYPE 'H'

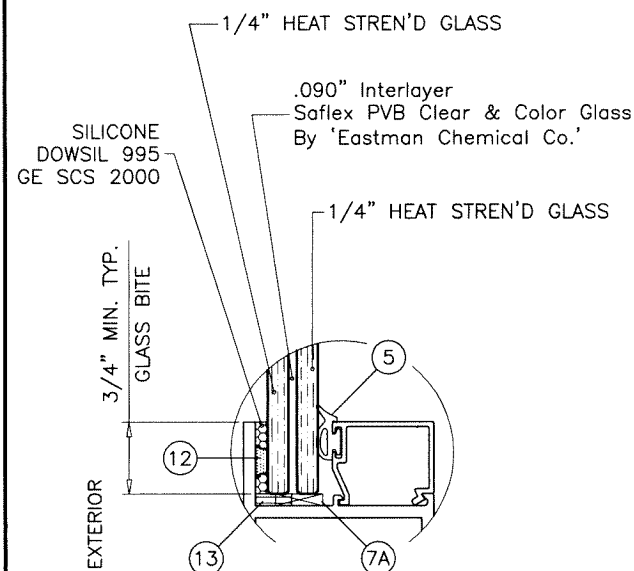

GLASS TYPE 'E'

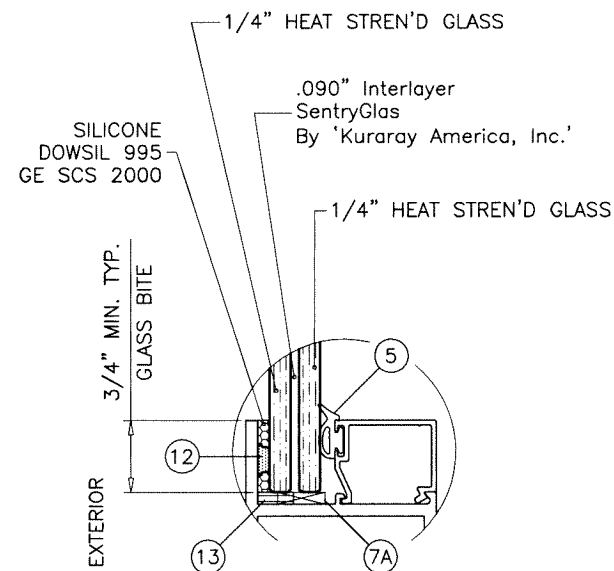


GLASS TYPE 'G'

GLAZING OPTIONS

Sealed: 12/11/2024

FL #17762

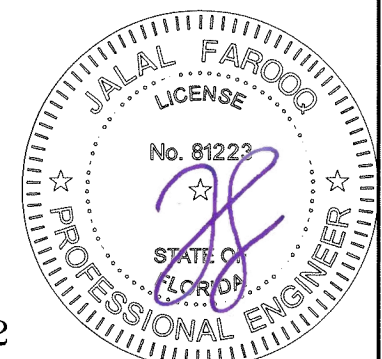


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)

SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035

date: 04-30-15		revisions:	
scale: 1/2" = 1"	no	date	by description
dr. by: TARIQ			
chk. by:			
drawing no. W15-19			
sheet 2 of 6			

DESIGN LOAD CAPACITY - PSF															
WINDOW DIMS.		GLASS TYPE 'A' & 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'		GLASS TYPE 'E'		GLASS TYPE 'F'		GLASS TYPE 'G'		GLASS TYPE 'H'	
WIDTH (W)	LENGTH (L)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
26-1/2"		80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
37"		80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
53-1/8"		80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
19-1/8"	38-3/8"	80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
26-1/2"		80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
37"		80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
53-1/8"		-	-	80.0	80.0	100.0	100.0	80.0	80.0	80.0	90.0	80.0	110.0	-	-
19-1/8"	50-5/8"	80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
26-1/2"		80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
37"		80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
53-1/8"		-	-	80.0	80.0	100.0	100.0	75.9	75.9	-	-	80.0	104.3	-	-
19-1/8"	63"	80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
26-1/2"		80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
37"		-	-	80.0	80.0	100.0	100.0	80.0	80.0	-	-	80.0	110.0	-	-
53-1/8"		-	-	-	-	-	-	72.3	72.3	-	-	80.0	99.4	-	-
19-1/8"	74-1/4"	80.0	80.0	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	75.0	95.0
26-1/2"		-	-	80.0	80.0	100.0	100.0	80.0	80.0	100.0	100.0	80.0	110.0	-	-
37"		-	-	80.0	80.0	100.0	100.0	80.0	80.0	-	-	80.0	110.0	-	-
53-1/8"		-	-	-	-	-	-	72.3	72.3	-	-	80.0	99.4	-	-

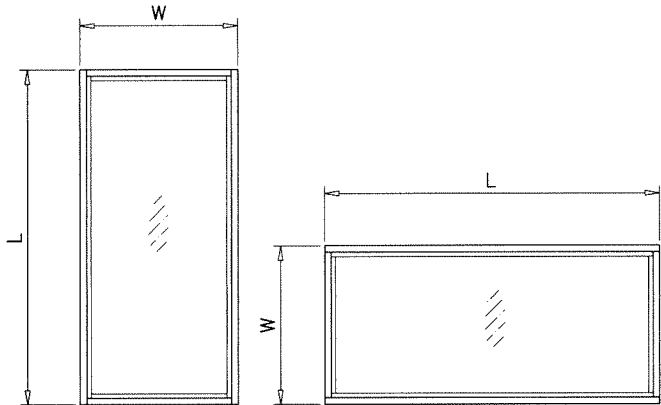


NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).

Sealed: 12/11/2024

FL #17762

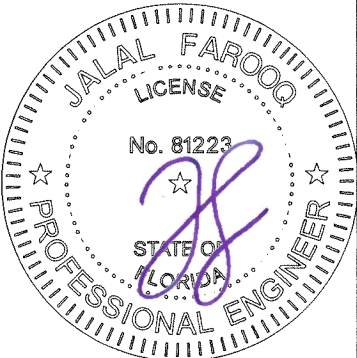

**AL-FAROOQ CORPORATION**
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035

revisions:
no date by description

date: 04-30-15
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W15-19


sheet 3 of 6

COMP-ANL\W15-19SAT

DESIGN LOAD CAPACITY - PSF											
WINDOW DIMS.		GLASS TYPE 'A' & 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'		GLASS TYPE 'F'		GLASS TYPE 'H'	
WIDTH (W)	LENGTH (L)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)
24"	36"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
42"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
48"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
54"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	-	-
24"	42"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
42"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
48"		-	-	80.0	80.0	100.0	100.0	100.0	100.0	-	-
54"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
24"	48"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
42"		-	-	80.0	80.0	100.0	100.0	100.0	100.0	-	-
48"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
54"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
24"	54"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	-	-
42"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
48"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
54"		-	-	77.0	77.0	96.3	96.3	-	-	-	-
24"	60"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
36"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
42"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
48"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
54"		-	-	77.0	77.0	96.3	96.3	-	-	-	-
24"	66"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		-	-	80.0	80.0	100.0	100.0	100.0	100.0	-	-
36"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
42"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
48"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
24"	72"	80.0	80.0	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
36"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
42"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
24"	76"	-	-	80.0	80.0	100.0	100.0	100.0	100.0	75.0	95.0
30"		-	-	80.0	80.0	100.0	100.0	80.0	90.0	-	-
36"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
42"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
24"	84"	-	-	80.0	80.0	100.0	100.0	100.0	100.0	-	-
30"		-	-	80.0	80.0	100.0	100.0	-	-	-	-
36"		-	-	80.0	80.0	100.0	100.0	-	-	-	-

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).


DESIGN LOAD CAPACITY - PSF											
WINDOW DIMS.		GLASS TYPE 'E'		GLASS TYPE 'G'							
WIDTH (W)	LENGTH (L)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)						
24"	48"	80.0	80.0	80.0	110.0						
30"		80.0	80.0	80.0	110.0						
36"		80.0	80.0	80.0	110.0						
42"		80.0	80.0	80.0	110.0						
48"		80.0	80.0	80.0	110.0						
54"		80.0	80.0	80.0	110.0						
24"	76"	80.0	80.0	80.0	110.0						
30"		80.0	80.0	80.0	110.0						
36"		80.0	80.0	80.0	110.0						
42"		80.0	80.0	80.0	110.0						
48"		80.0	80.0	80.0	110.0						
54"		71.1	71.1	80.0	97.8						
24"	84"	80.0	80.0	80.0	110.0						
30"		80.0	80.0	80.0	110.0						
36"		80.0	80.0	80.0	110.0						
42"		80.0	80.0	80.0	110.0						
48"		80.0	80.0	80.0	110.0						
54"		71.1	71.1	80.0	97.8						
24"	90"	80.0	80.0	80.0	110.0						
30"		80.0	80.0	80.0	110.0						
36"		80.0	80.0	80.0	110.0						
42"		80.0	80.0	80.0	110.0						
48"		80.0	80.0	80.0	110.0						
24"	96"	80.0	80.0	80.0	110.0						
30"		80.0	80.0	80.0	110.0						
36"		80.0	80.0	80.0	110.0						
42"		80.0	80.0	80.0	110.0						
24"	108"	80.0	80.0	80.0	110.0						
30"		80.0	80.0	80.0	110.0						
36"		80.0	80.0	80.0	110.0						
24"	120"	80.0	80.0	80.0	110.0						
30"		80.0	80.0	80.0	110.0						
36"		80.0	80.0	80.0	110.0						

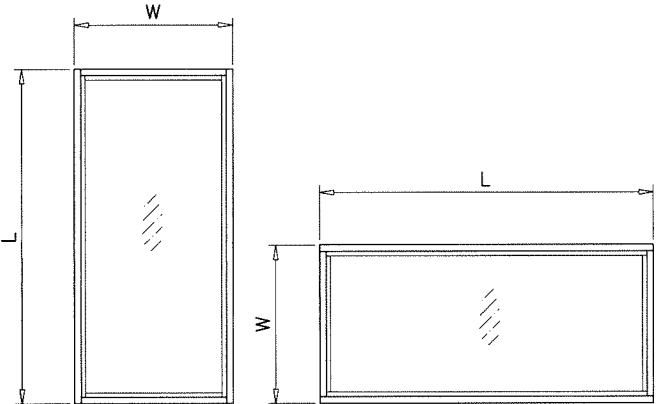

NOTE:
WIDTH AND LENGTH DIMENSIONS CAN BE ORIENTED
VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

Sealed: 12/11/2024

FL #17762

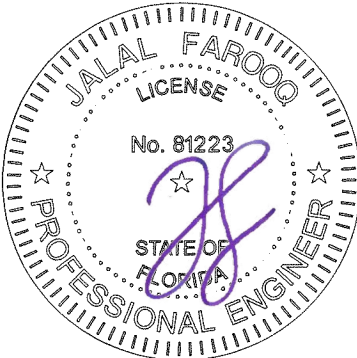



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)


SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035

revisions:
no date by description

date: 04-30-15
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W15-19
sheet 3.1 of 6

COMP-ANL\W15-19SAT

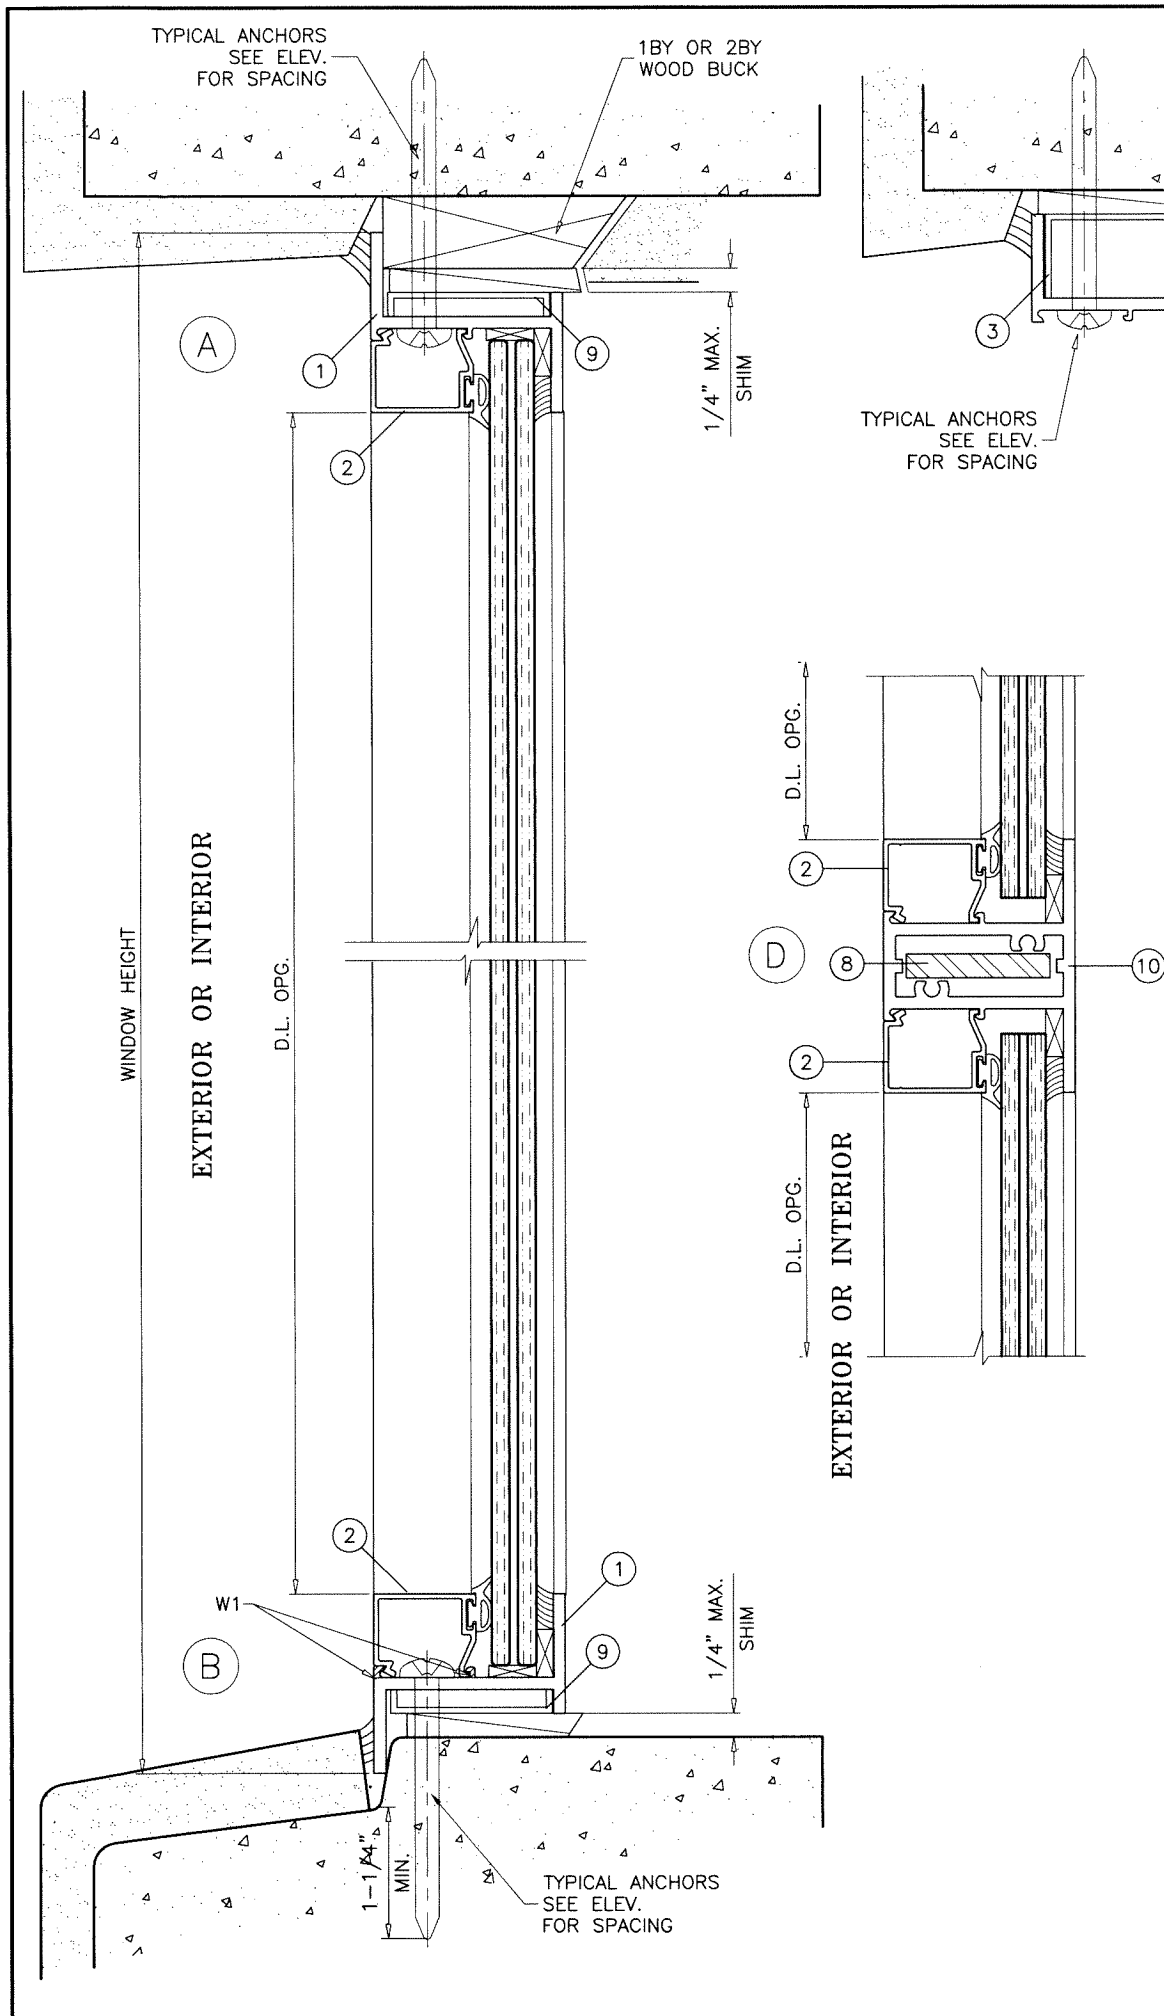

SEALANTS:

ALL FRAME AND VENT CORNERS SEALED WITH JOINT SEALANT.

WEEPHOLES:

W1 = 3/8" NOTCH AT 7" FROM EACH END

FLANGE AND EQUAL LEG FRAMES CAN BE USED AT ALL ANCHORAGE CONDITIONS.

WOOD BUCKS AND METAL STRUCTURE NOT BY 'SOL-A-TROL' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)
 THRU 1BY OR 2BY BUCKS INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)
 DIRECTLY INTO CONCRETE OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)


#14 SMS OR SELF-DRILLING SCREWS (GRADE 2 CRS)

INTO F.B.C. APPROVED MULLIONS AND
 INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
 (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

CRITICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 1-1/4" MIN.
 INTO WOOD STRUCTURE = 7/16" MIN. (AT FLANGE FRAMES)
 INTO WOOD STRUCTURE = 1" MIN. (AT EQUAL LEG FRAMES)
 INTO METAL STRUCTURE = 7/16" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

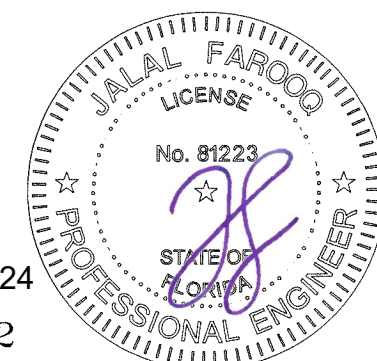

Sealed: 12/11/2024

FL #17762

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 C.A.N. 3538

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
 4101 N.W. 132ND STREET
 MIAMI, FL. 33054
 TEL. (305) 681-2020 FAX. (305) 681-2035







revisions:	no	date	by	description

date: 04-30-15
 scale: 1/2" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.

W15-19

sheet 4 of 6

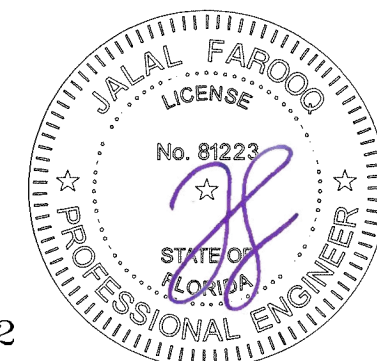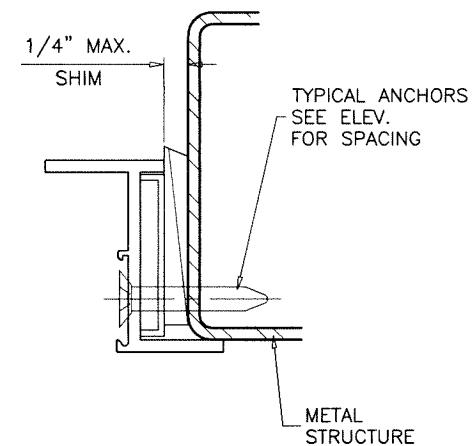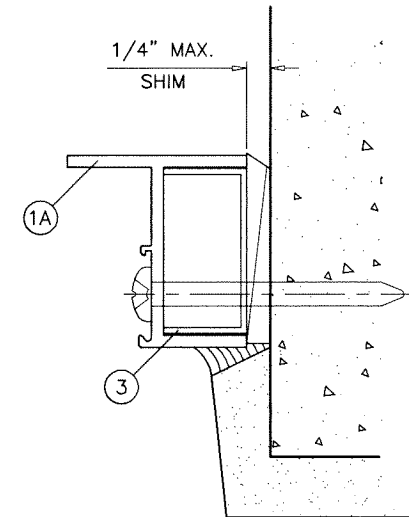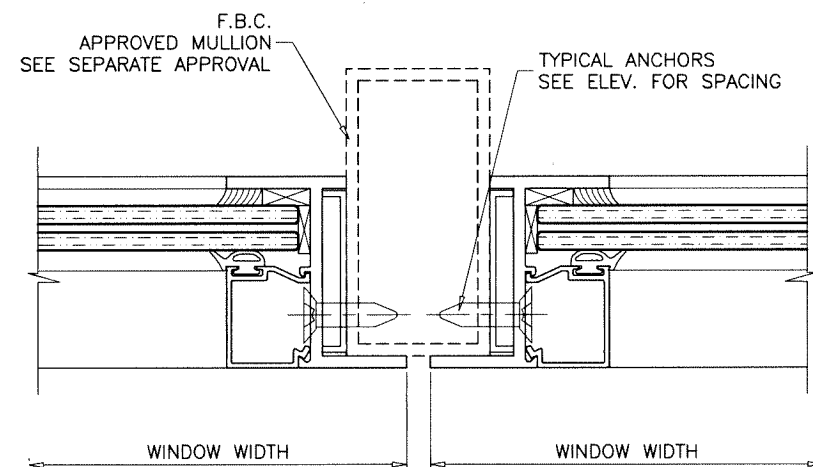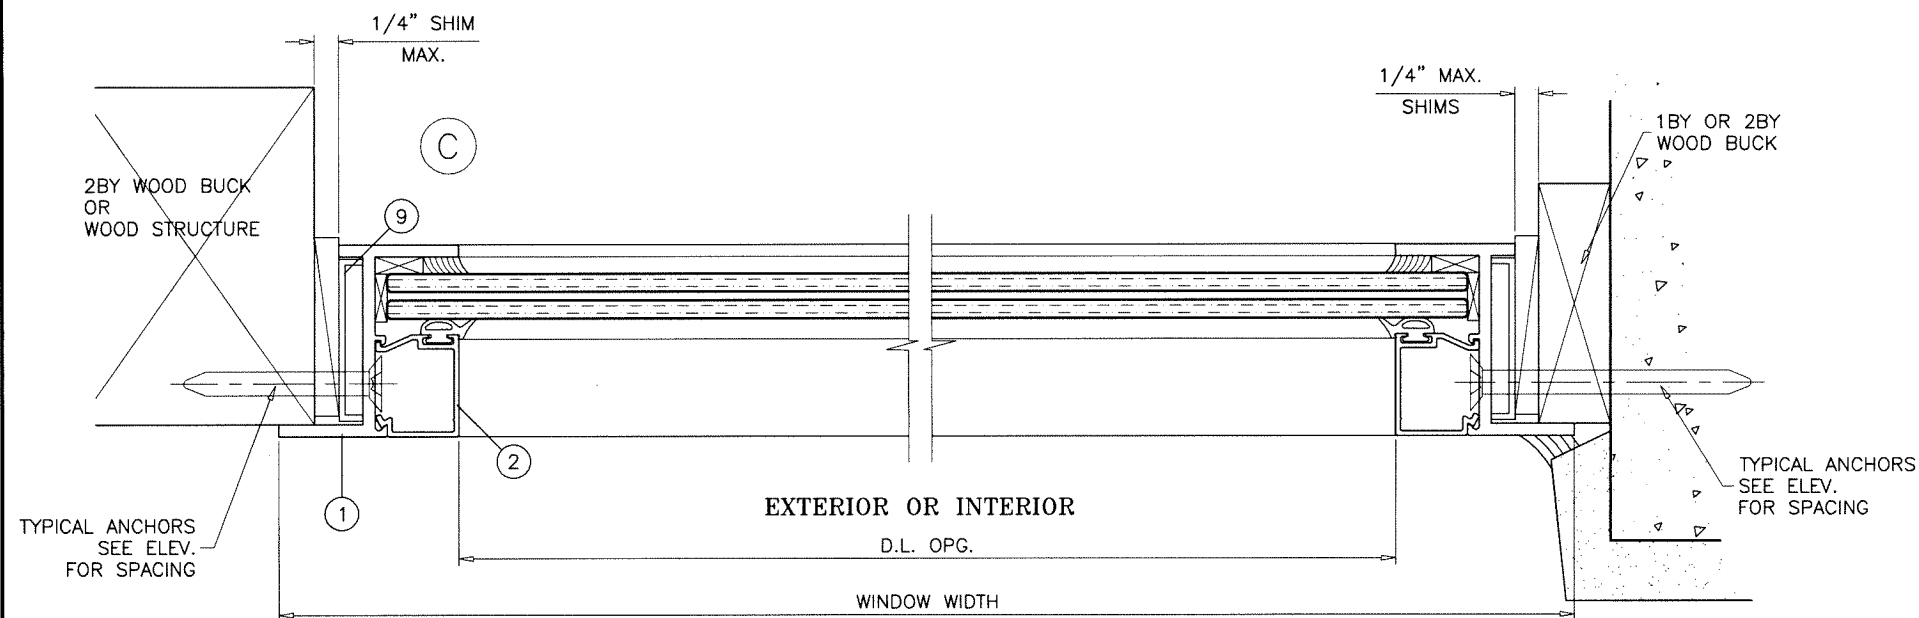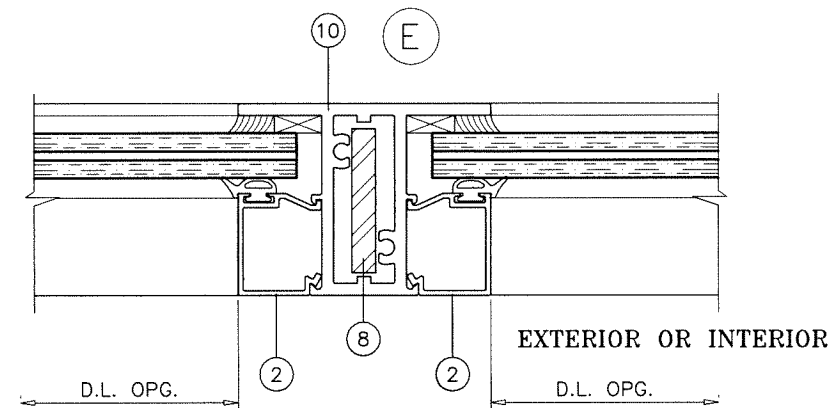

FLANGE AND EQUAL LEG FRAMES CAN BE USED AT ALL ANCHORAGE CONDITIONS.

Sealed: 12/11/2024

FL #17762

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL W15-19SAT

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)












SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035

revisions:

no	date	by description

date: 04-30-15
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:


drawing no.
W15-19
sheet 5 of 6

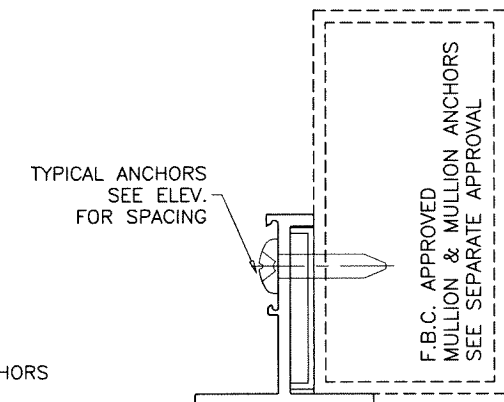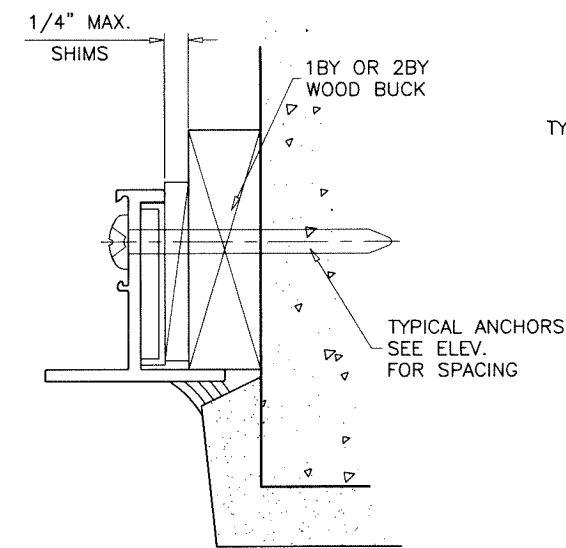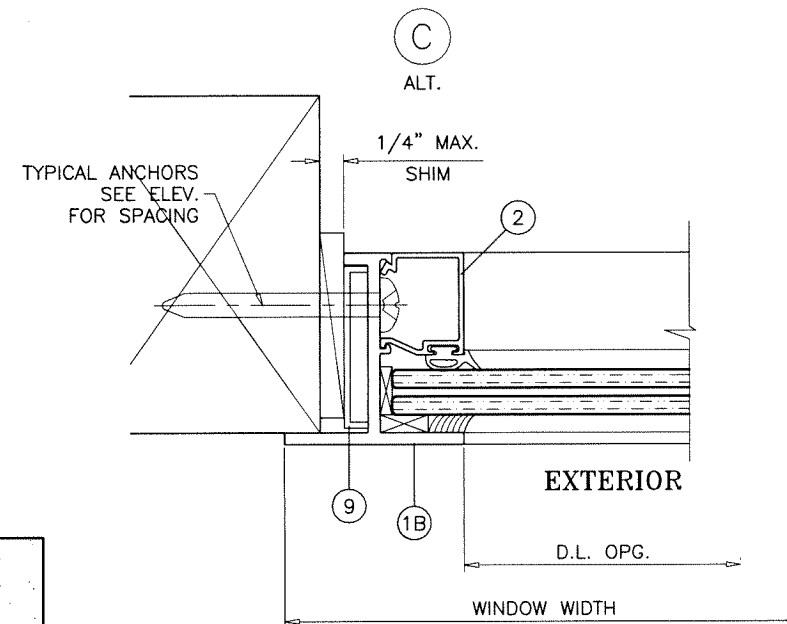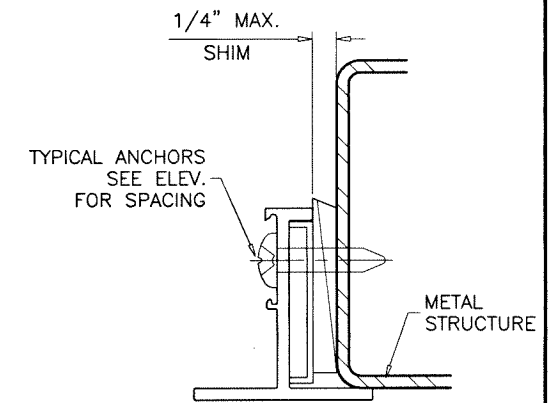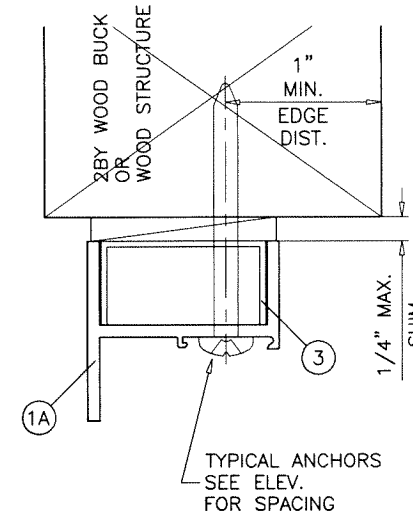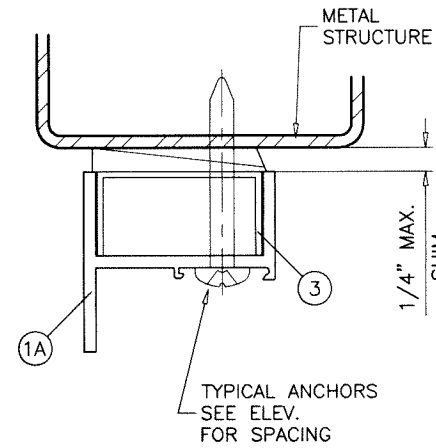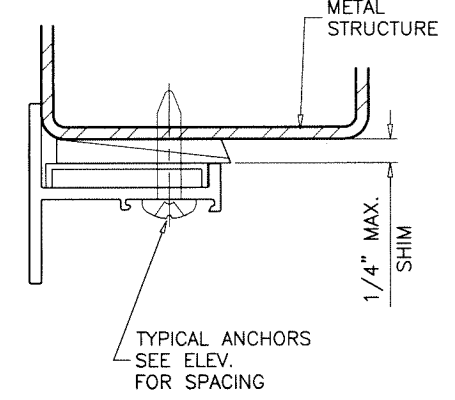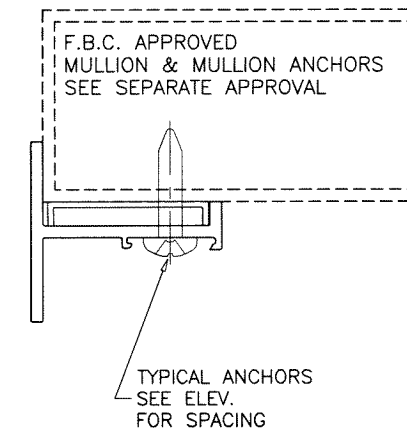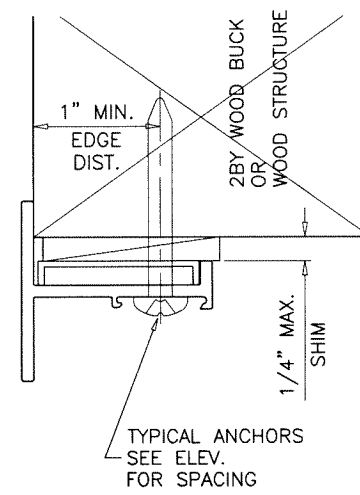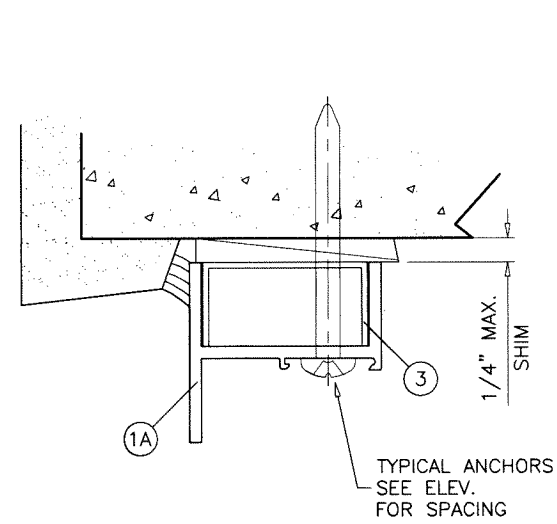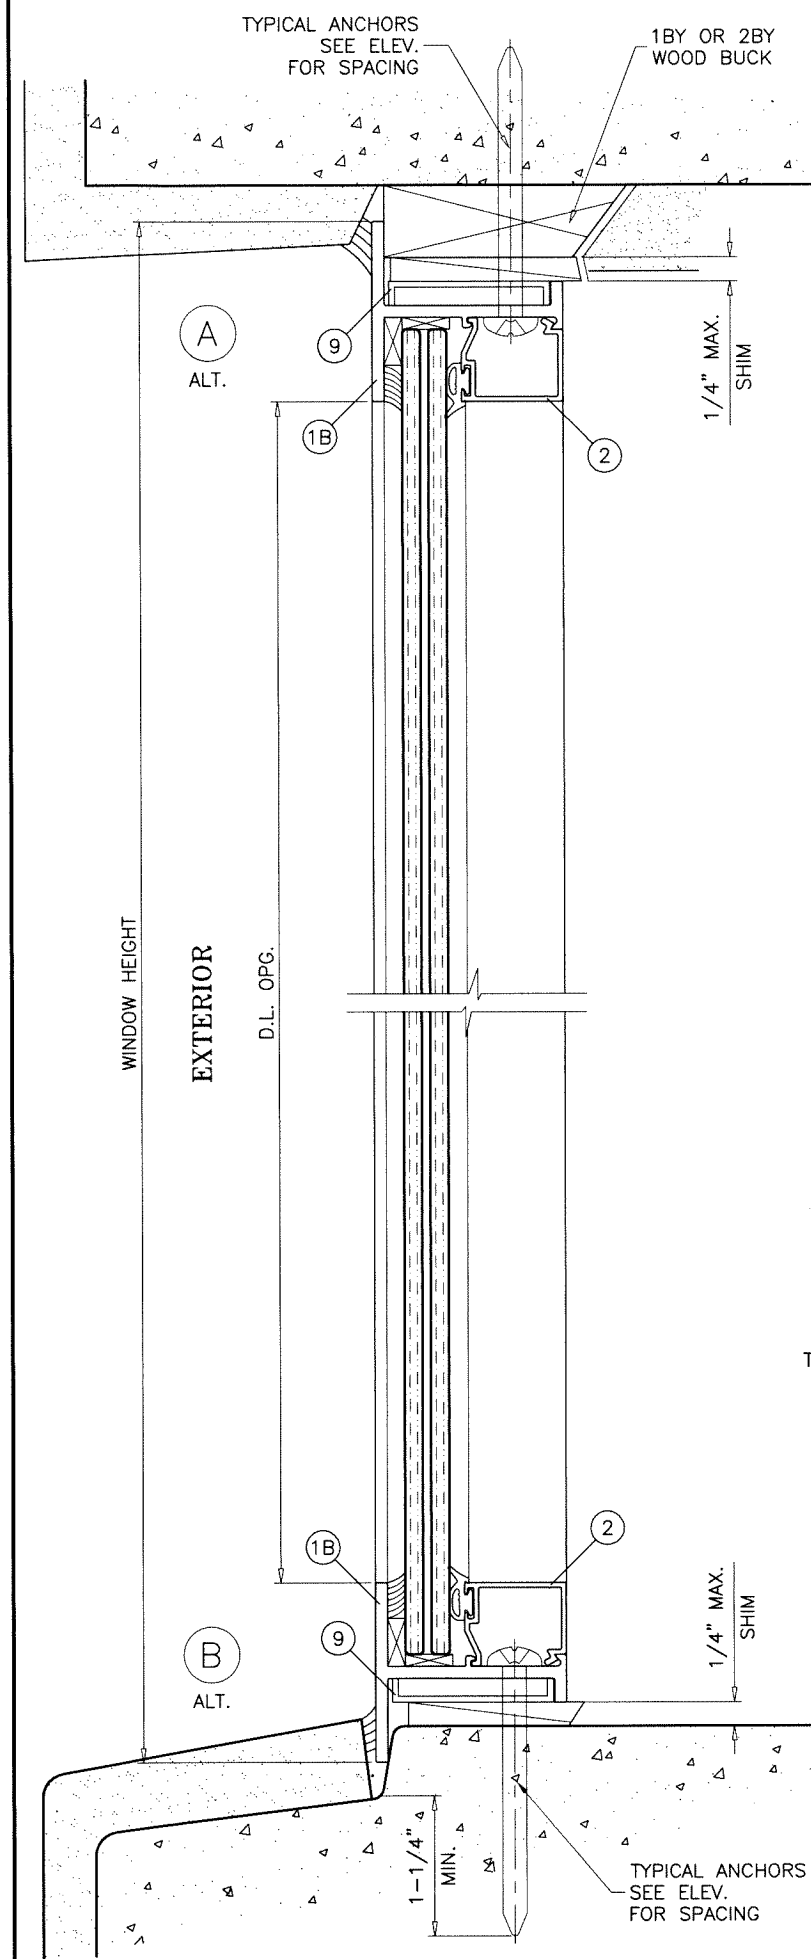

FLANGE AND EQUAL LEG FRAMES CAN BE
USED AT ALL ANCHORAGE CONDITIONS.

Sealed: 12/11/2024

FL #17762

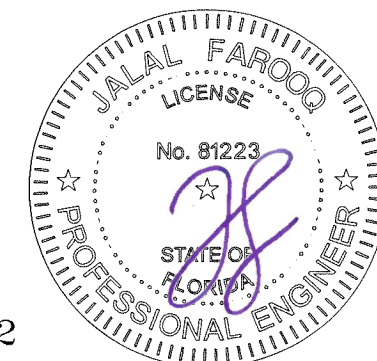

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)

SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054



TEL. (305) 681-2020 FAX. (305) 681-2035

[illegible]


date: 04-30-15
scale: $1/2" = 1"$
dr. by: TARIQ
chk. by:

drawing no.
W15-19

sheet 5.1 of 6

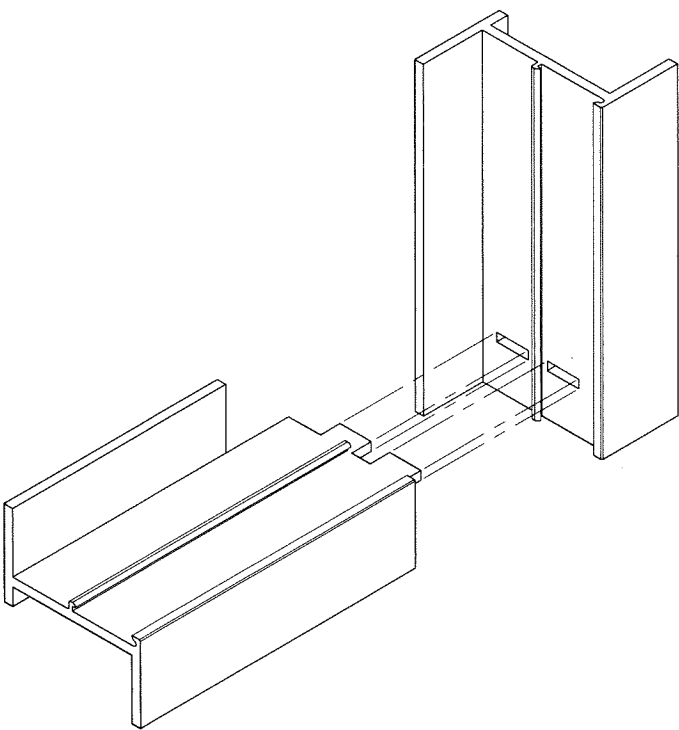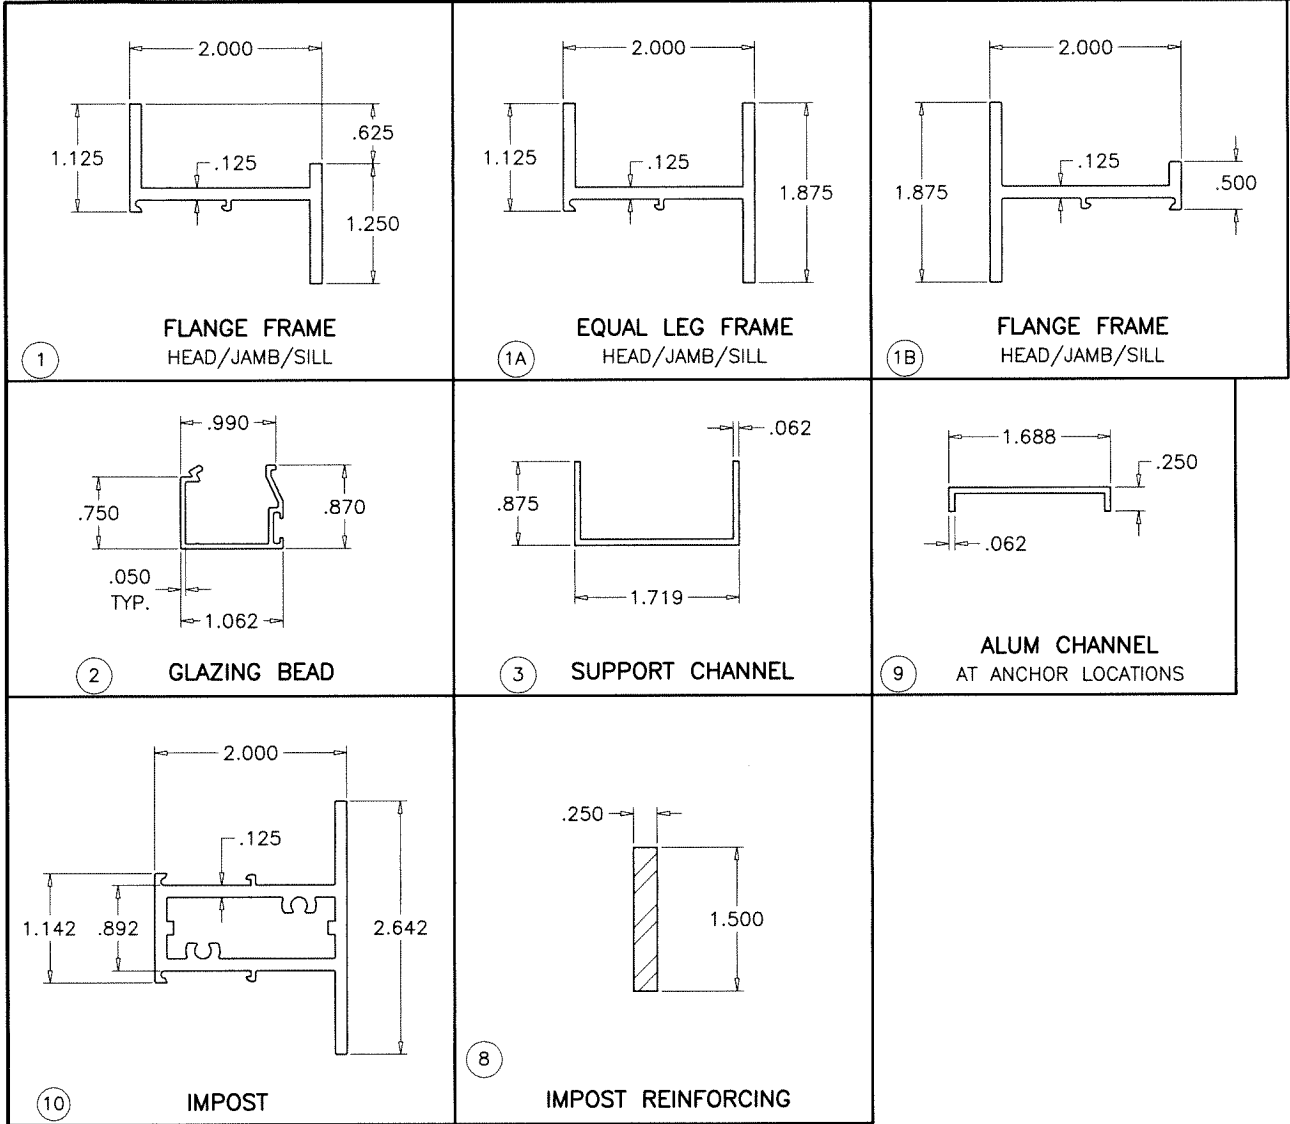

FRAME CORNERS
STAKED MORTISE AND TENON FABRICATION

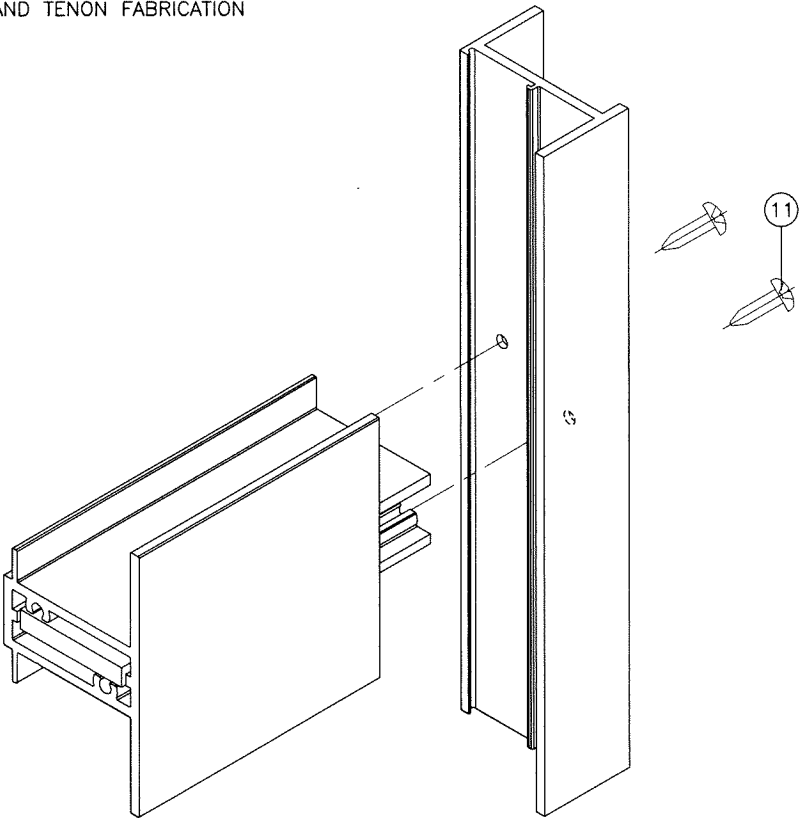

IMPOST CORNERS

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ARSO-114	4	FLANGE FRAME (HEAD/JAMB/SILL)	6063-T5	-
1A	ARSO-934	4	EQUAL LEG FRAME (HEAD/JAMB/SILL)	6063-T5	-
1B	ARSO-101	4	FLANGE FRAME (HEAD/JAMB/SILL)	6063-T5	-
2	ARSO-169	4	GLAZING BEAD	6063-T5	-
3	-	AS REQD.	SUPPORT CHANNEL, 3" LONG	3003-H14	AT ANCHOR LOCATIONS
5	TR8384E	AS REQD.	GLAZING GASKET	EPDM	TREMCO, DUROMETER 60±5 SHORE A
6	326-RP-142B	2/ VENT	SETTING BLOCK (1/2" X 1/4" X FULL LENGTH)	EPDM	PROTOTYPE PLASTICS, DUROMETER 80±5 SHORE A
7	326-FP-808B	AS REQD.	SETTING BLOCK (1/2" X 1/4" X 2") AT 6" FROM ENDS	EPDM	PROTOTYPE PLASTICS, DUROMETER 80±5 SHORE A
7A	-	AS REQD.	SETTING BLOCK (1/2" X 1/8" X 2") AT 6" FROM ENDS	EPDM	PROTOTYPE PLASTICS, DUROMETER 80±5 SHORE A
8	-	AS REQD.	IMPOST/MULLION REINFORCING	GALV. STEEL	ASTM A36, Fy 36 KSI
9	-	AS REQD.	ALUMINUM CHANNEL, 3" LONG	3003-H14	AT ANCHOR LOCATIONS
10	ARSO-984	AS REQD.	IMPOST	6063-T6	-
11	#10 X 1-1/2"	2/ CORNER	IMPOST ASSEMBLY SCREWS	-	PH DRILLFLEX SCREWS
12	-	AS REQD.	3M BUMPON SPACERS AT 5" FROM ENDS & 10" O.C.	SILICONE	-
13	-	AS REQD.	DOUBLE FACE GLAZING TAPE (3/16" X 1/2")	PE FOAM	-

Sealed: 12/11/2024

FL #17762



af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W15-19SAT

SERIES 3000/3062 ALUM FIXED WDW. (L.M.I.)
SOL-A-TROL ALUMINUM PRODUCTS INC.
4101 N.W. 132ND STREET
MIAMI, FL. 33054
TEL. (305) 681-2020 FAX. (305) 681-2035

revisions:
no. date by description
1 04-30-15
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:
drawing no. **W15-19**
sheet 6 of 6