

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW REQUIREMENTS	02/21/18	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1–1/2” WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1–1/2” OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER’S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16” OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4”.
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300–04/09, WITH SAFETY GLASS.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4” MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16” TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4” MINIMUM EMBEDMENT INTO SUBSTRATE WITH 1 1/2” MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. ALL FASTENERS TO BE CORROSION RESISTANT.
18. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER’S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
 - C. MASONRY – STRENGTH CONFORMANCE TO ASTM C–90, GRADE N, TYPE 1 (OR GREATER).
 - D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063–T5 .048” THICK MINIMUM
19. APPROVED CONFIGURATIONS: O/OX, O/XO, OX/O, & XO/O.

SIGNED: 02/21/2018

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2 – 3	ELEVATIONS
4 – 8	INSTALLATION DETAILS

MI WINDOWS & DOORS, LLC.
650 WEST MARKET STREET
GRATZ, PA 17030–0370

SERIES 910 PVC SLIDING GLASS DOOR
143” x 80” NON–IMPACT
NOTES

DRAWN:
J.L.

DWG NO.
08–02492


REV
A

SCALE NTS

DATE 09/22/14


SHEET 1 OF 7

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

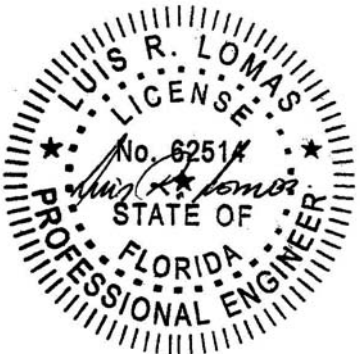

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW REQUIREMENTS	02/21/18	R.L.

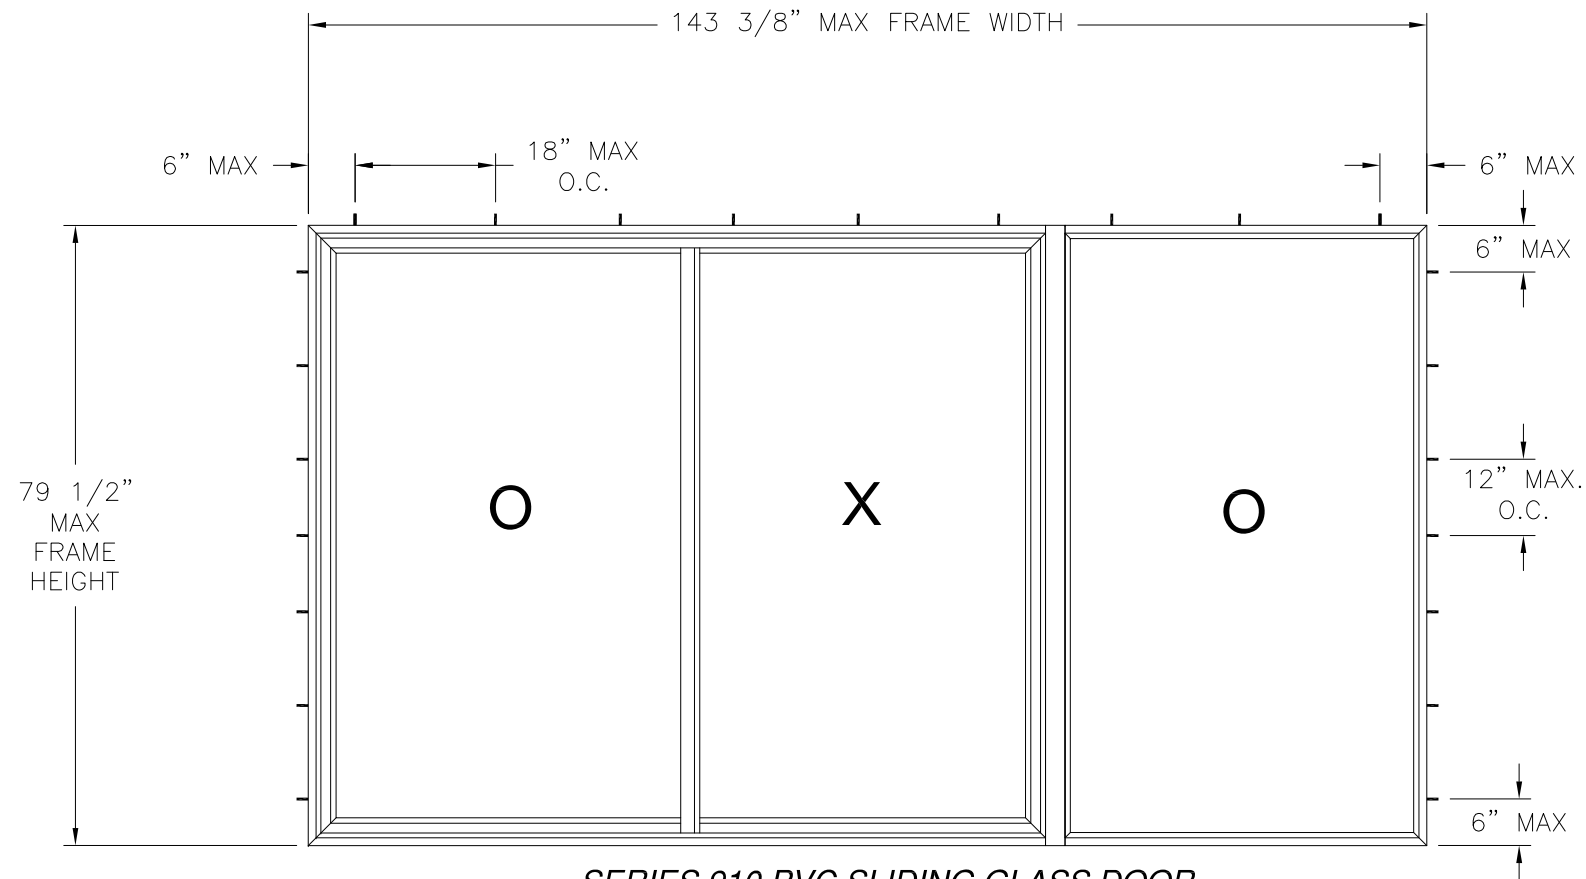

SERIES 910 PVC SLIDING GLASS DOOR
EXTERIOR VIEW
FRAME INSTALLATION

DESIGN PRESSURE RATING	IMPACT RATING
±30.0PSF	NONE

48 3/4" x 77 1/4" PANEL SIZE SHOWN. OTHER SIZES ARE APPROVED AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 26.15 FT²

NOTES:

1. SASH SIZE: 48 3/4" X 77 1/4"
2. FIXED LITE D.L.O.: 44" X 72 1/2"
3. SASH D.L.O.: 43 7/8" X 72 1/2"
4. UNIT USES A 1" X 1" STEEL TUBE REINFORCEMENT IN FIXED AND OPERABLE MEETING STILES.
5. UNIT USES A 99-20 910 STEEL HANDLE LINER AT LOCK STILE.


WEEP HOLE LOCATIONS:

1. (2) 1/8" X 1/2" HOLES LOCATED 1" FROM EACH END OF SILL.
2. (2) 3/16" X 1/2" HOLES LOCATED AT EACH END SILL.
3. (2) 1/8" X 1" HOLES LOCATED 1" FROM EACH END OF SILL.

HARDWARE SCHEDULE	
A.	(1) METAL DOOR LOCK, AT LOCK STILE, 40" FROM SILL
B.	(2) METAL ROLLERS, AT OPERABLE PANEL BOTTOM RAIL, 4" FROM EACH END
C.	1 X 1 STEEL TUBE REINFORCEMENT, AT FIXED AND OPERABLE MEETING STILES
D.	99-20 910 STEEL HANDLE LINER REINFORCEMENT, AT LOCK STILE


MI WINDOWS & DOORS, LLC. 650 WEST MARKET STREET GRATZ, PA 17030-0370		
SERIES 910 PVC SLIDING GLASS DOOR 143" x 80" NON-IMPACT ELEVATION		
DRAWN: J.L.	DWG NO. 08-02492	REV A
SCALE NTS	DATE 09/22/14	SHEET 2 OF 7
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 02/21/2018

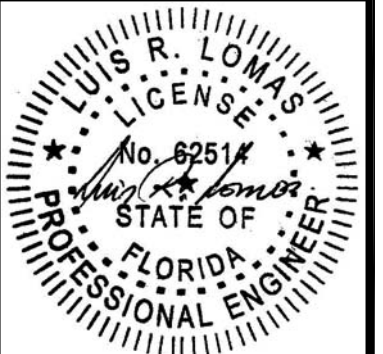


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW REQUIREMENTS	02/21/18	R.L.

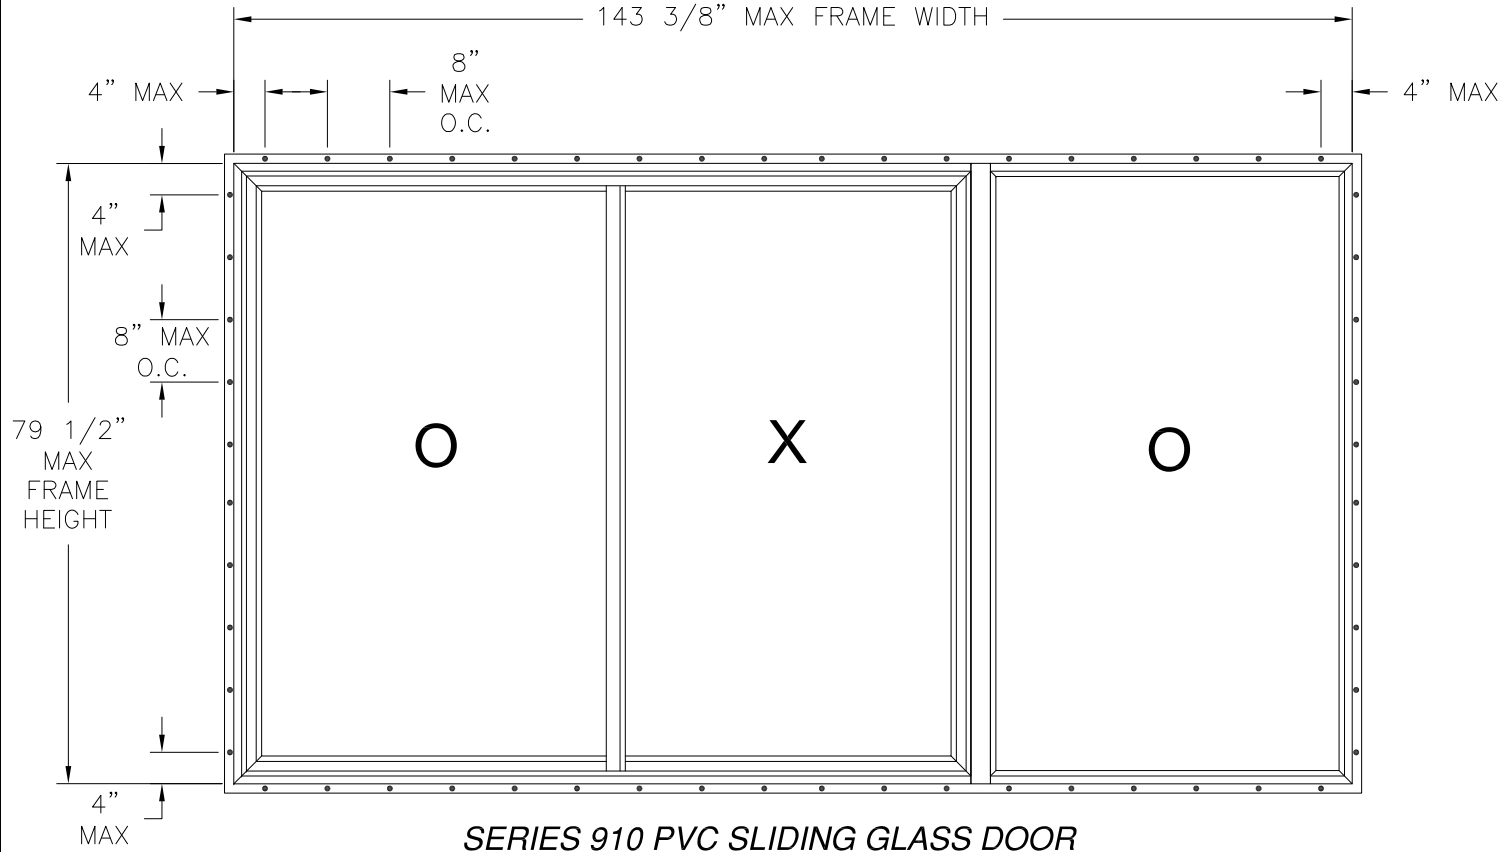

SERIES 910 PVC SLIDING GLASS DOOR
EXTERIOR VIEW
FIN INSTALLATION

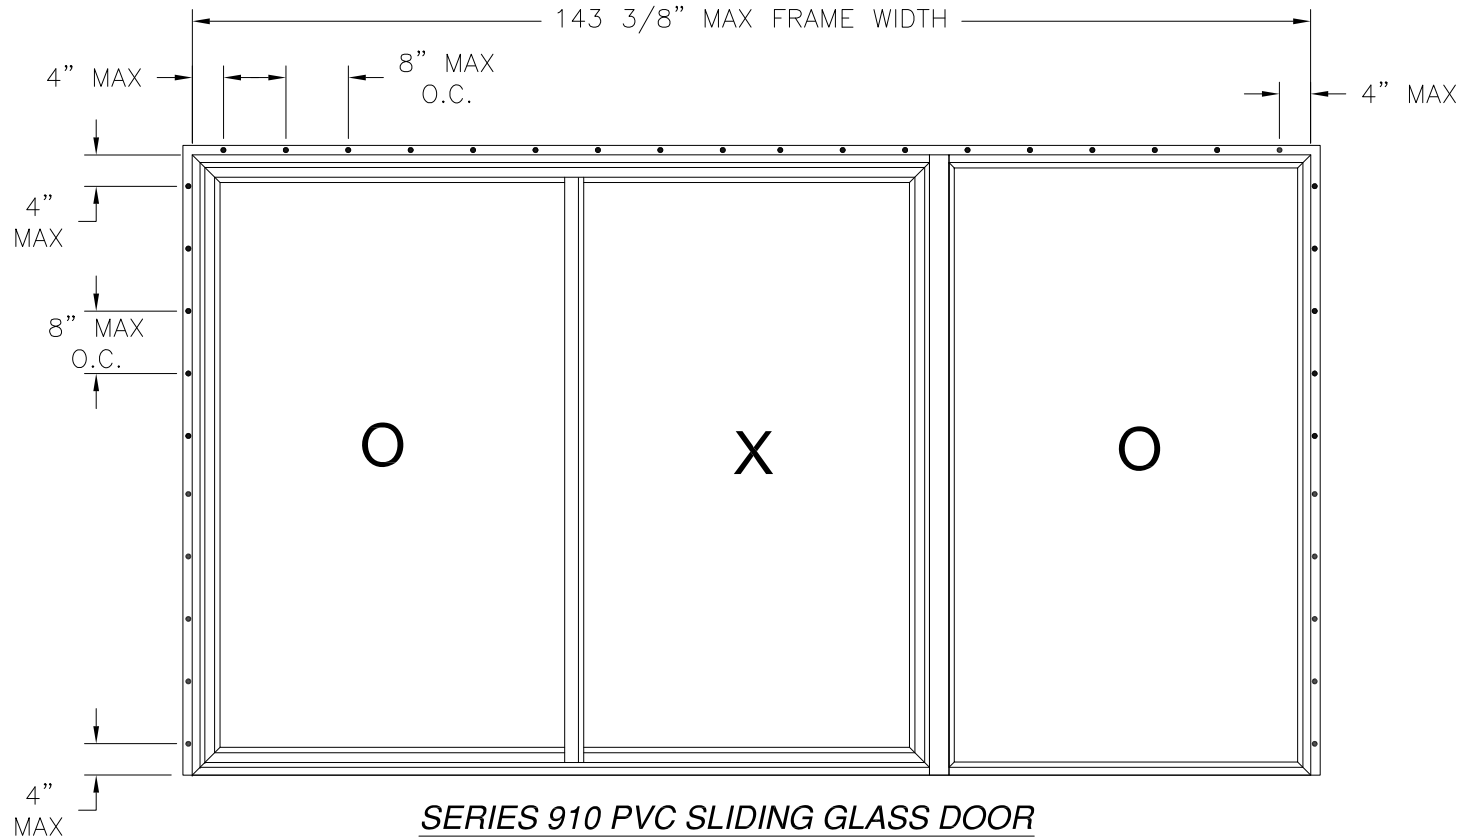

SERIES 910 PVC SLIDING GLASS DOOR
EXTERIOR VIEW
FIN INSTALLATION NO SILL ANCHORS

DESIGN PRESSURE RATING	IMPACT RATING
±30.0PSF	NONE

48 3/4" x 77 1/4" PANEL SIZE SHOWN. OTHER SIZES ARE APPROVED AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 26.15 FT²

MI WINDOWS & DOORS, LLC.
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 910 PVC SLIDING GLASS DOOR
143" x 80" NON-IMPACT
ELEVATIONS


DRAWN: J.L.	DWG NO. 08-02492	REV A
SCALE NTS	DATE 09/22/14	SHEET 3 OF 7

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 02/21/2018




Luis R. Lomas P.E.
FL No.: 62514

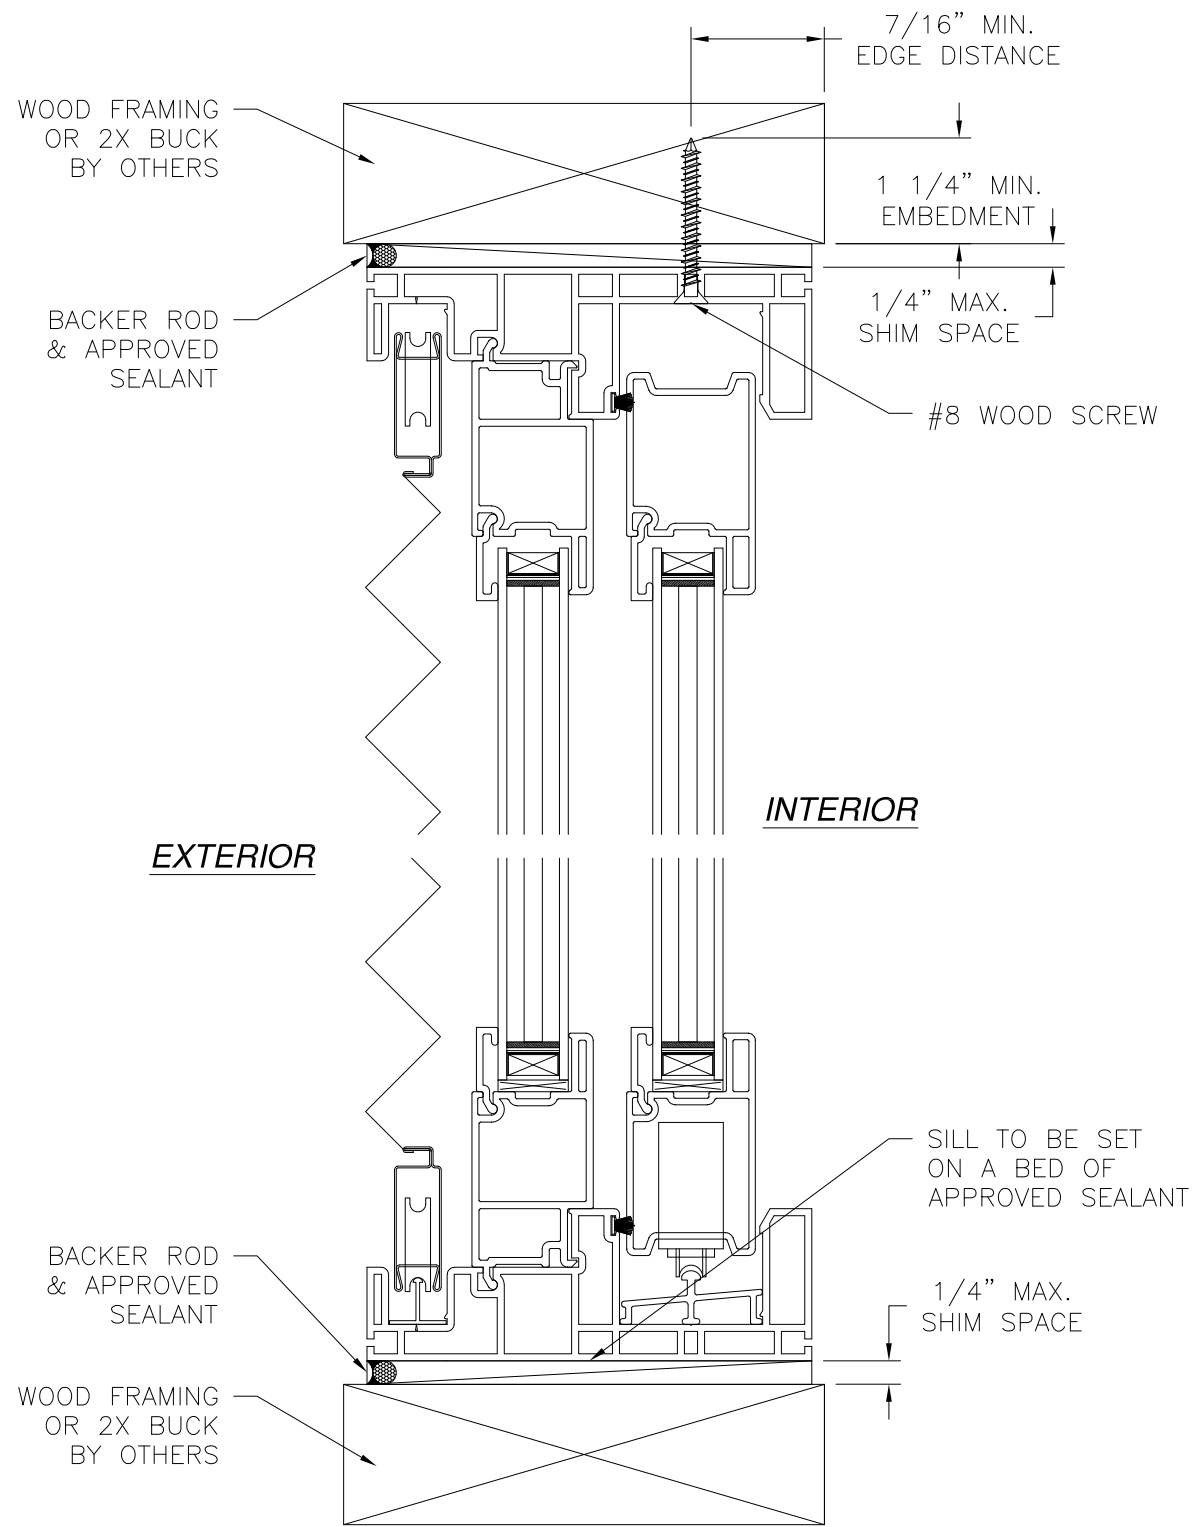

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,
NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE
DESIGNED IN ACCORDANCE WITH ASTM E2112

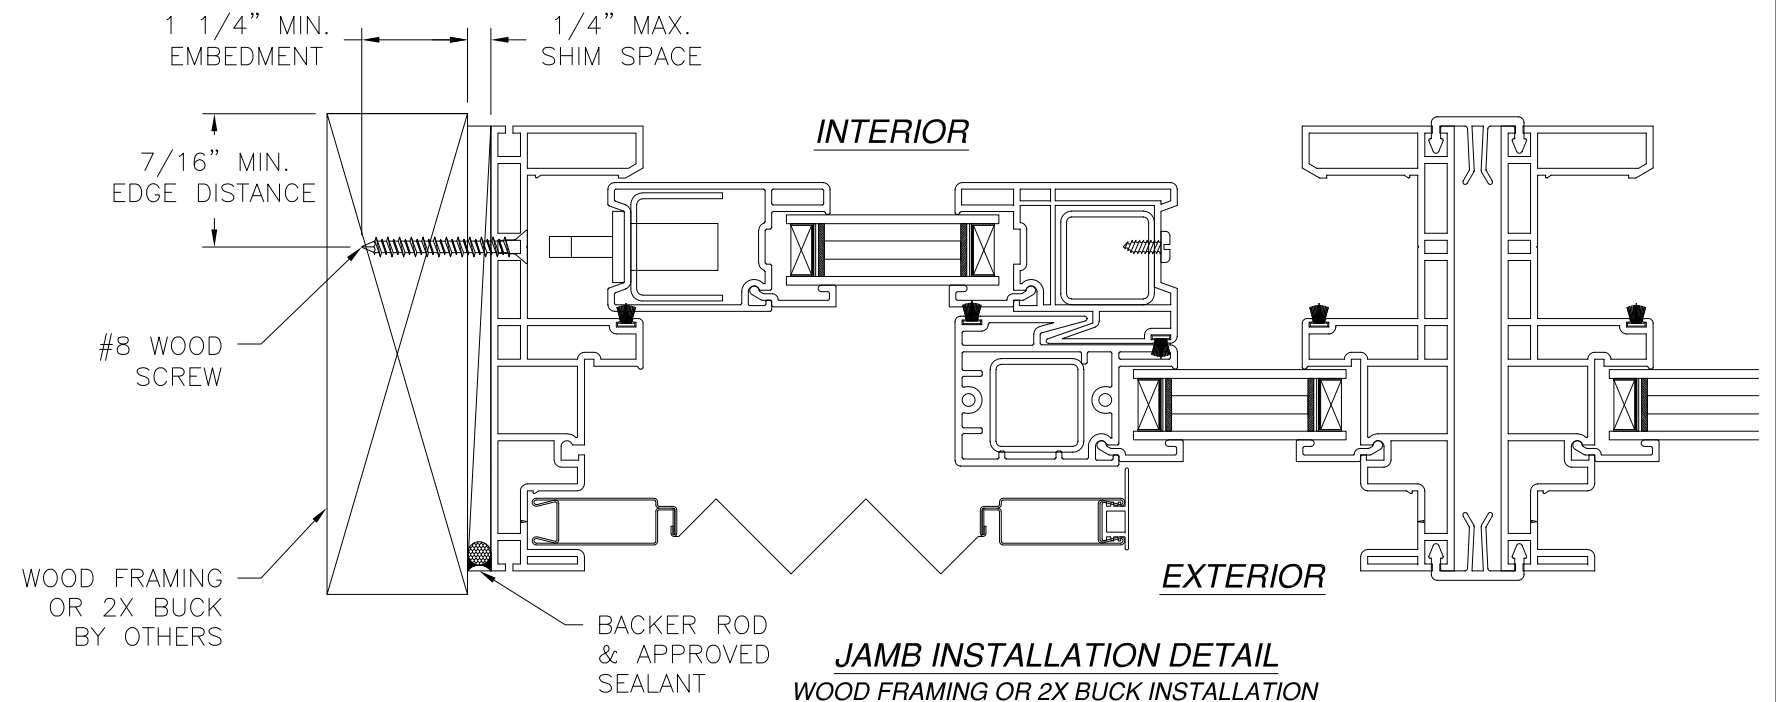

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW REQUIREMENTS	02/21/18	R.L.


MI WINDOWS & DOORS, LLC.
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 910 PVC SLIDING GLASS DOOR
143" x 80" NON-IMPACT
INSTALLATION DETAILS

DRAWN: J.L.	DWG NO. 08-02492	REV A
SCALE NTS	DATE 09/22/14	SHEET 4 OF 7



L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 02/21/2018

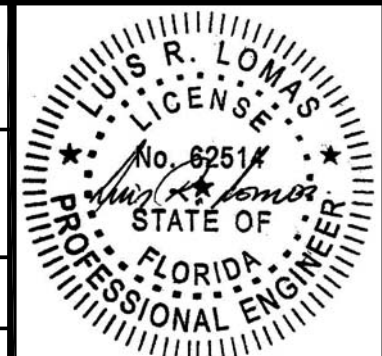

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW REQUIREMENTS	02/21/18	R.L.

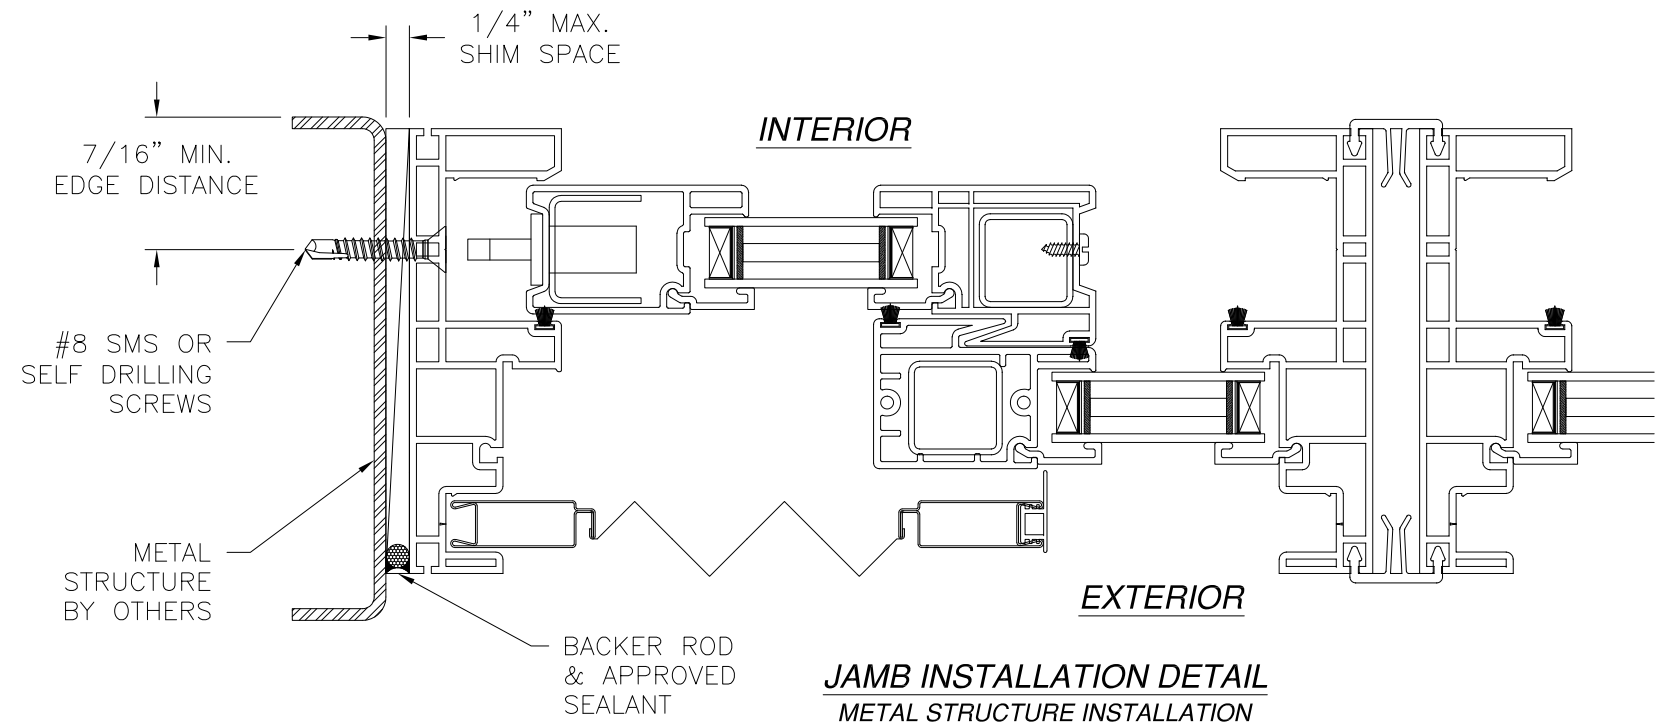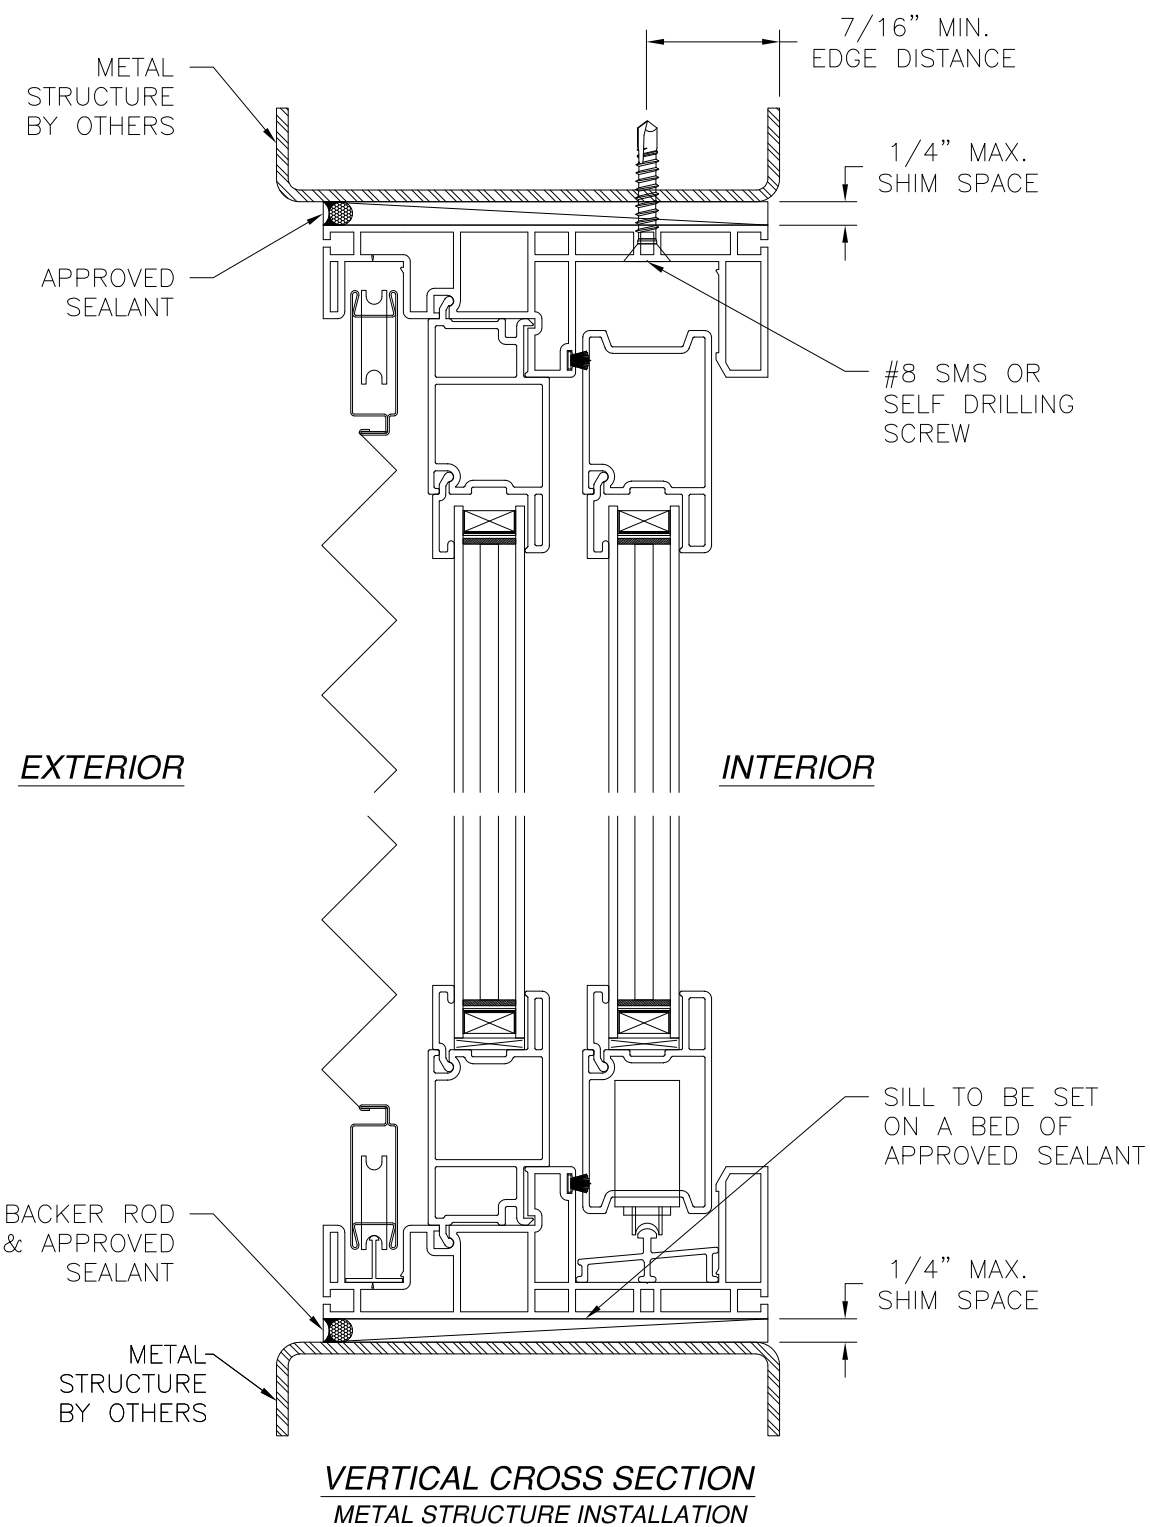

NOTES:
 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

MI WINDOWS & DOORS, LLC.
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 910 PVC SLIDING GLASS DOOR
143" x 80" NON-IMPACT
INSTALLATION DETAILS

DRAWN:
J.L.

DWG NO.
08-02492

REV
A

SCALE
NTS


DATE
09/22/14

SHEET
5 OF 7

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 02/21/2018

Luis R. Lomas P.E.
FL No.: 62514

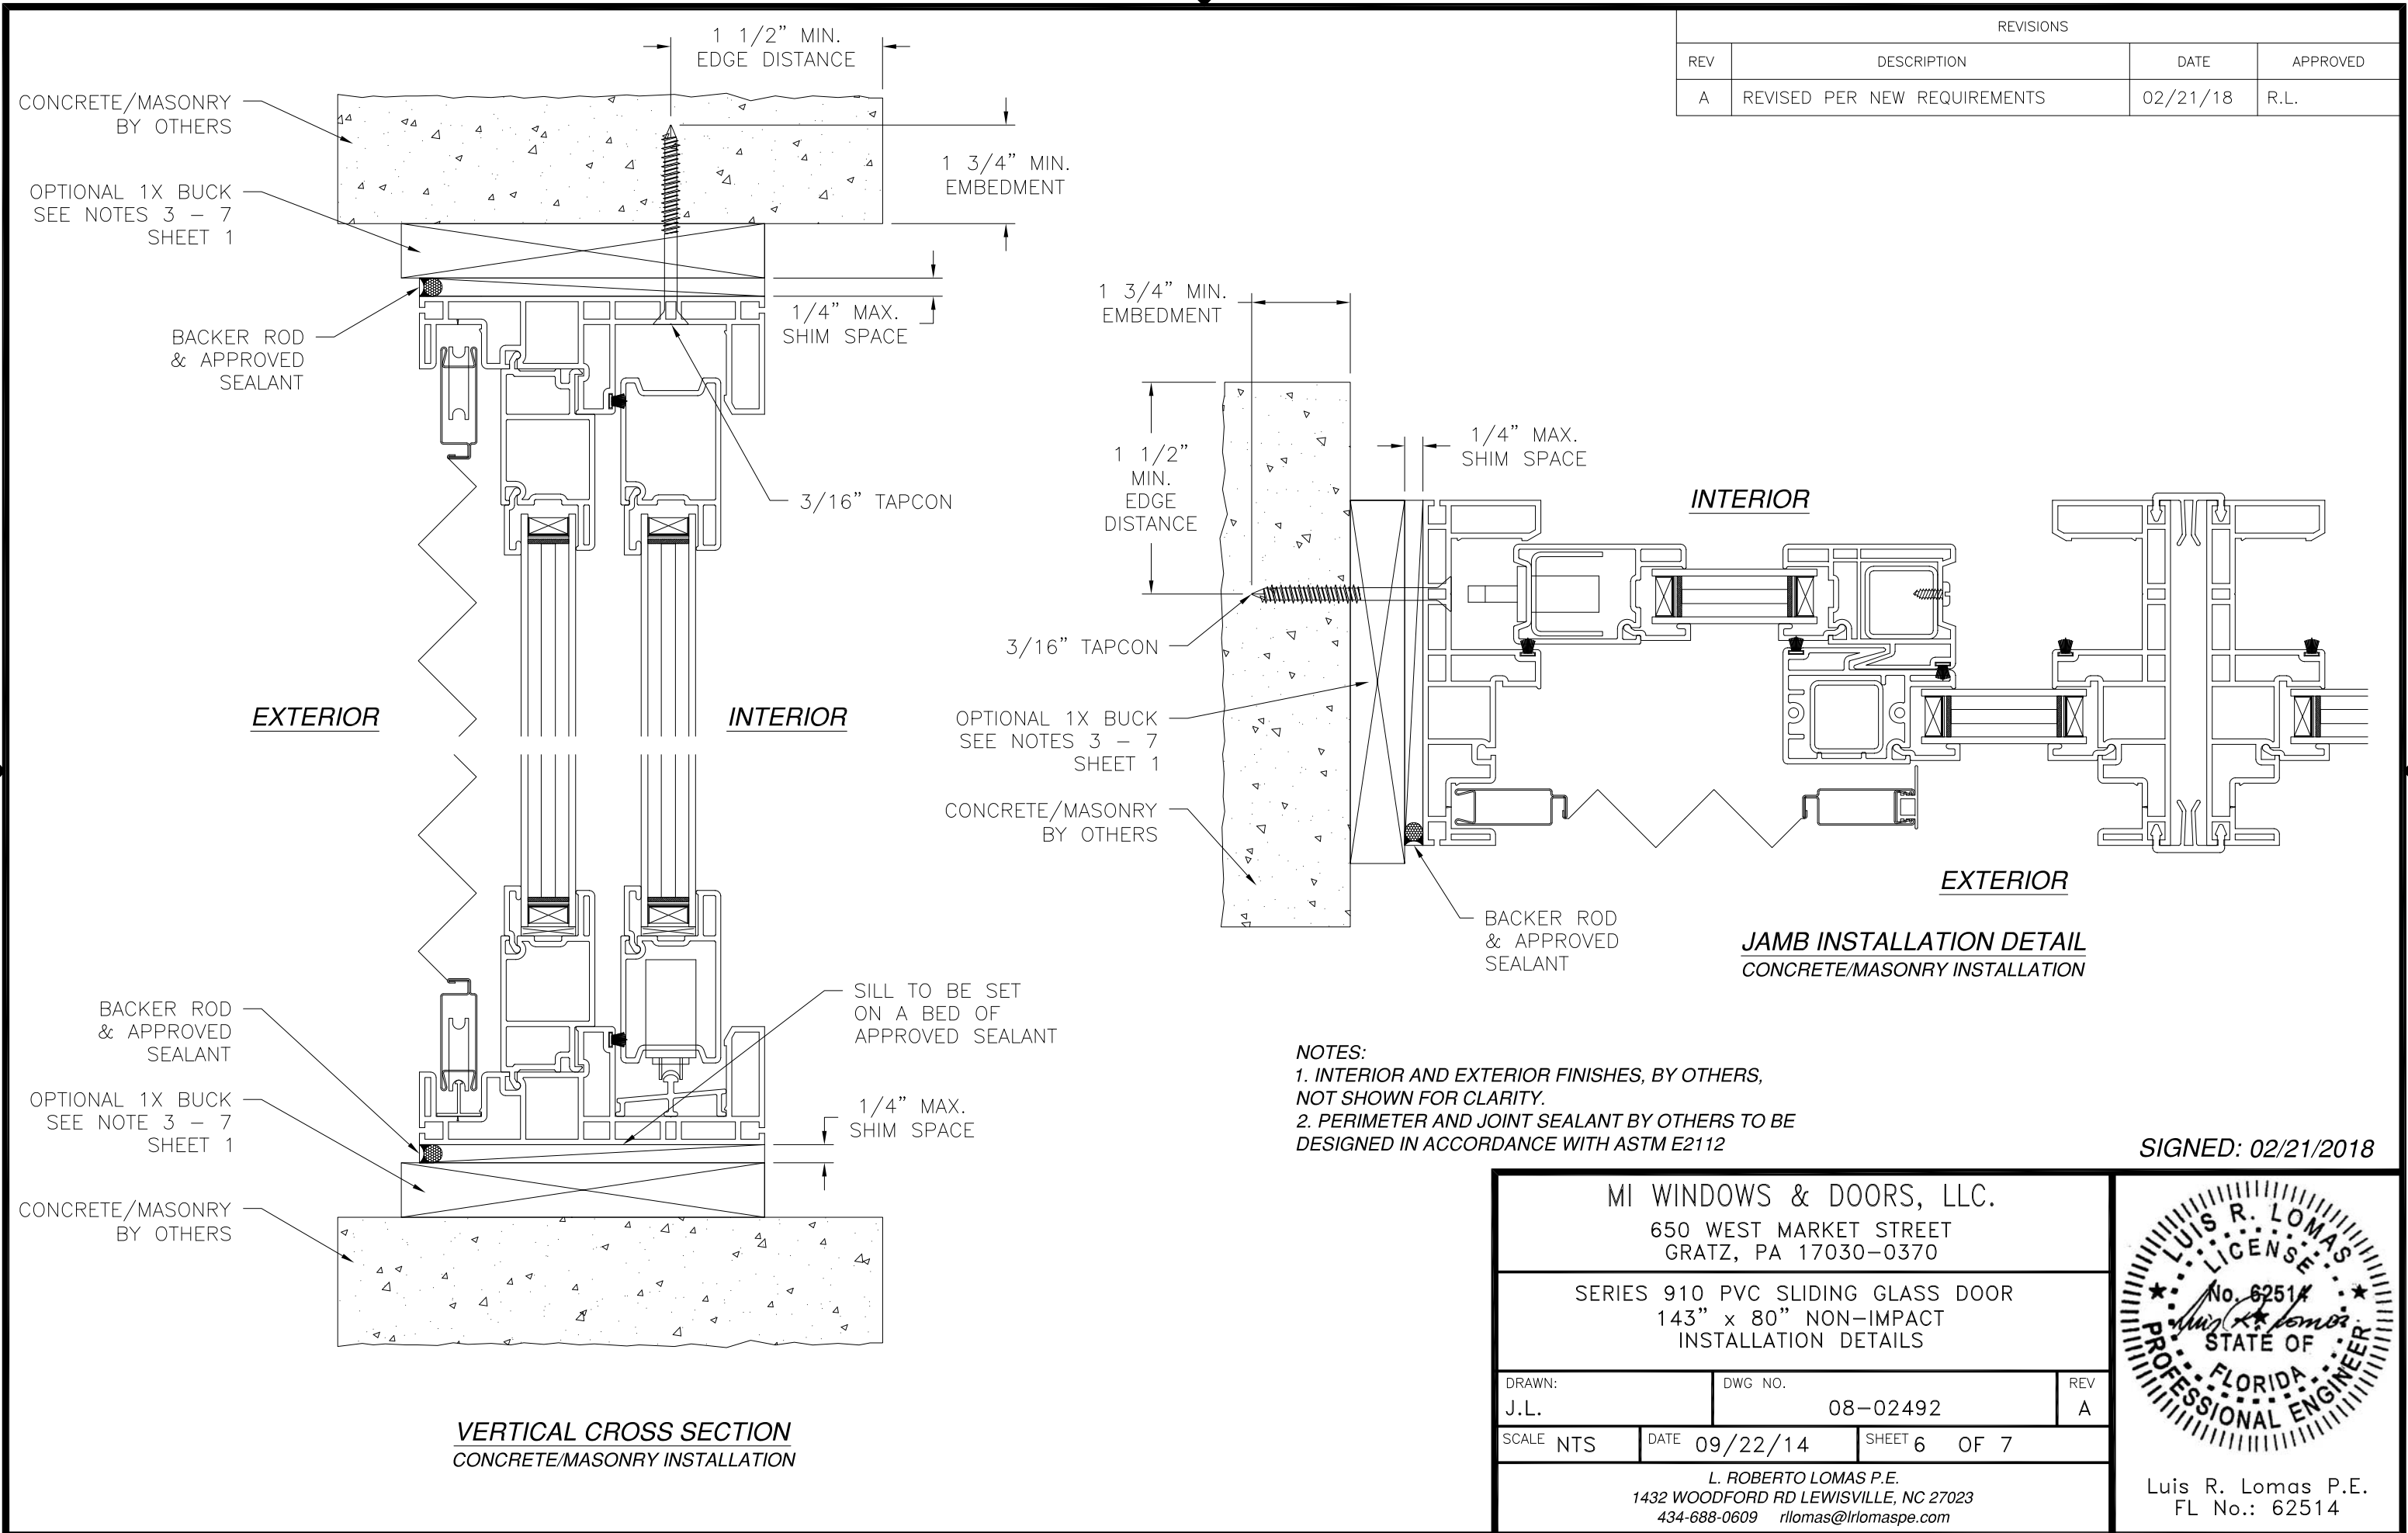

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW REQUIREMENTS	02/21/18	R.L.

NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 02/21/2018



MI WINDOWS & DOORS, LLC.
650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 910 PVC SLIDING GLASS DOOR
143" x 80" NON-IMPACT
INSTALLATION DETAILS

DRAWN: J.L.	DWG NO. 08-02492	REV A
SCALE NTS	DATE 09/22/14	SHEET 6 OF 7


L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

Luis R. Lomas P.E.
FL No.: 62514

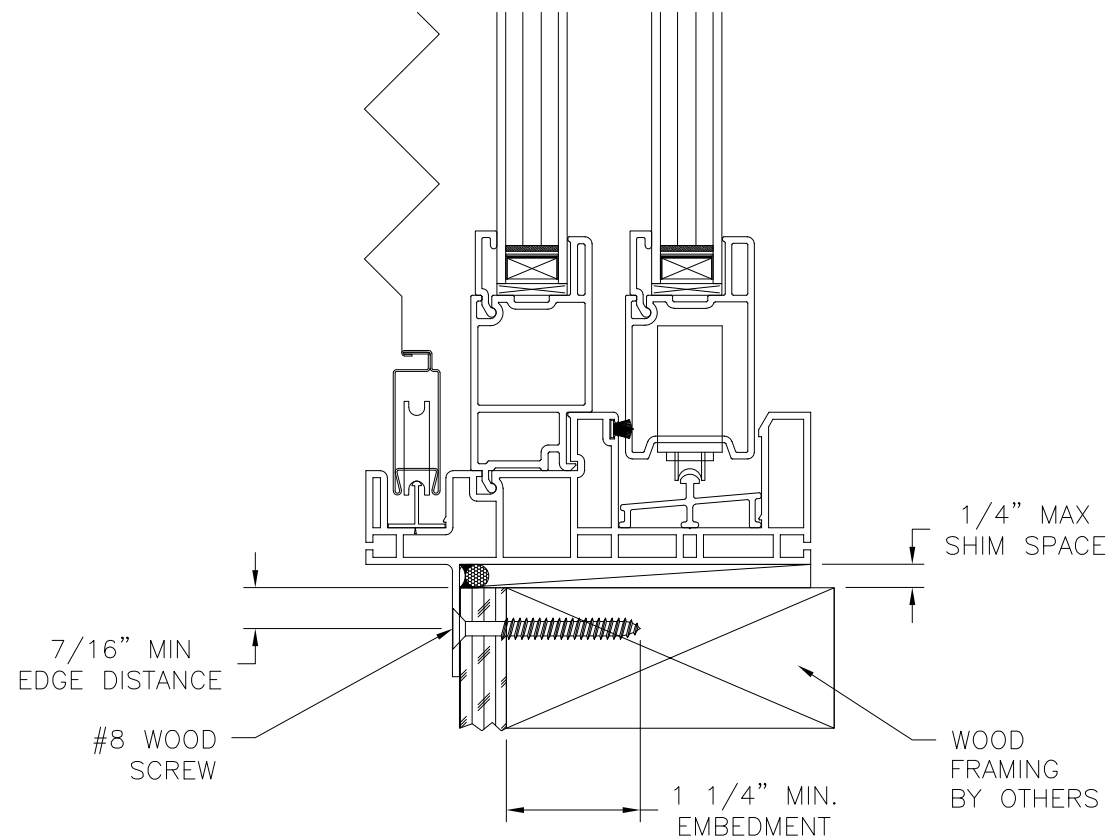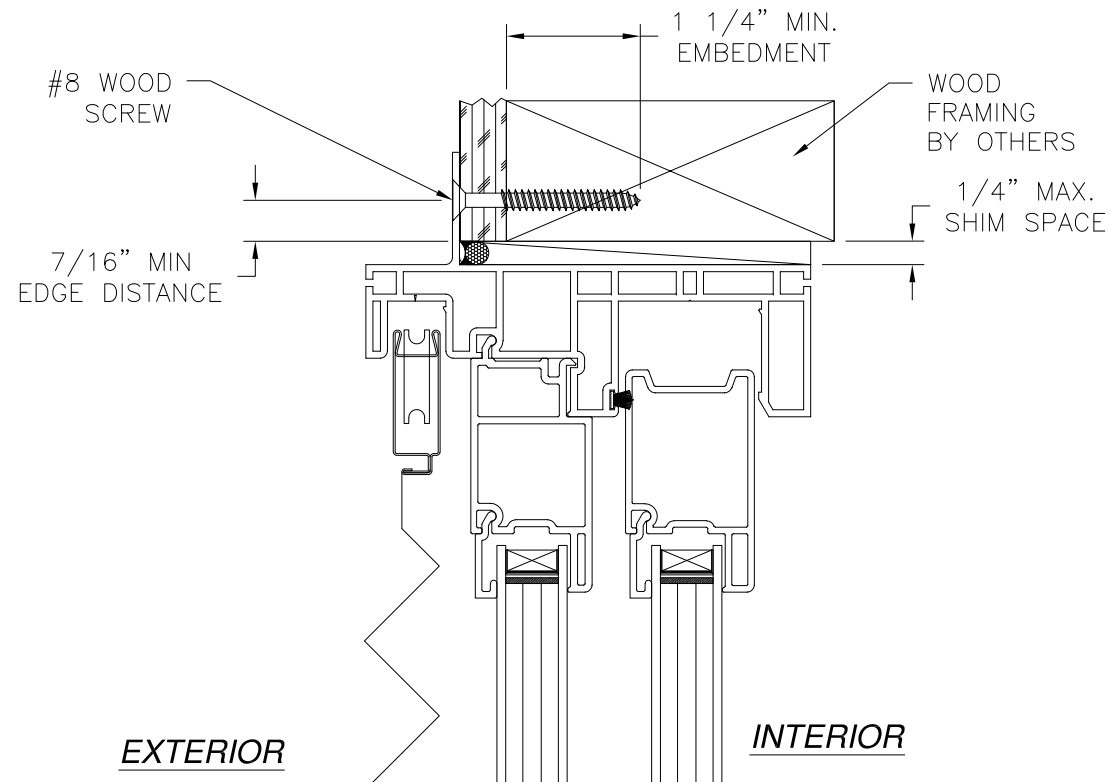


VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

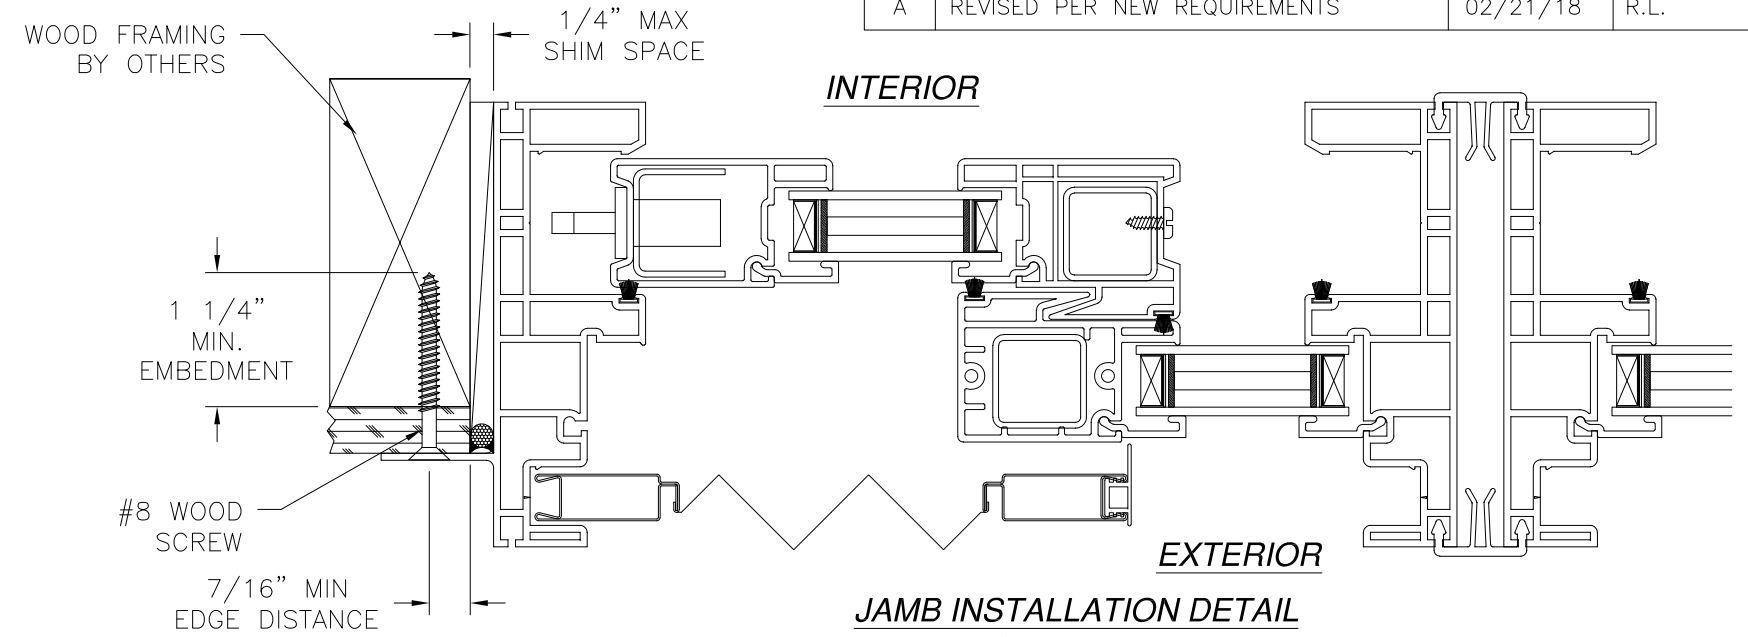

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

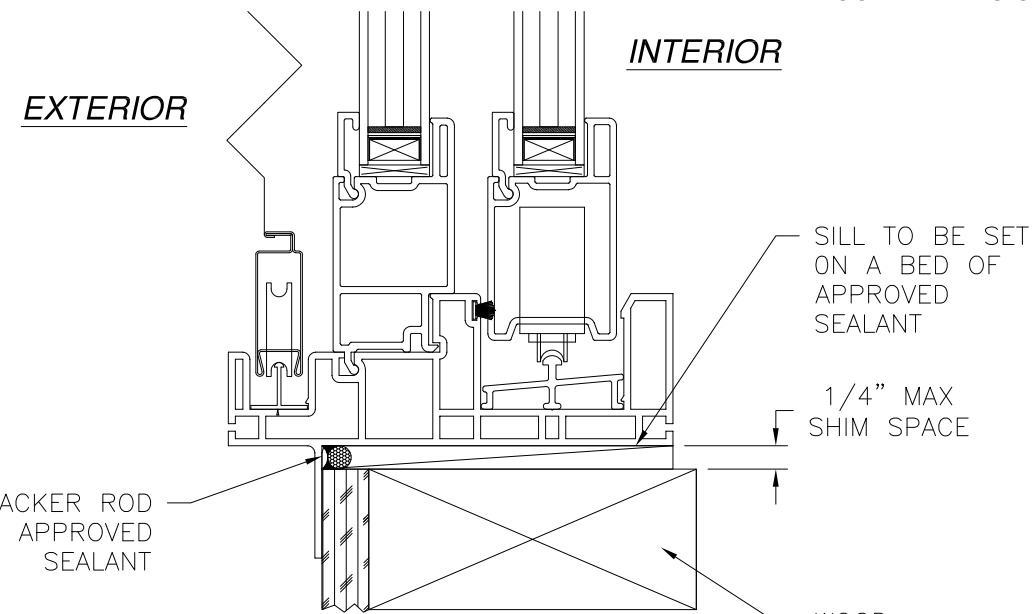

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION
NO SILL ANCHORS

SILL TO BE SET
ON A BED OF
APPROVED
SEALANT

1/4" MAX
SHIM SPACE

WOOD
FRAMING
BY OTHERS

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW REQUIREMENTS	02/21/18	R.L.

MI WINDOWS & DOORS, LLC.


650 WEST MARKET STREET
GRATZ, PA 17030-0370

SERIES 910 PVC SLIDING GLASS DOOR
143" x 80" NON-IMPACT
INSTALLATION DETAILS

DRAWN: J.L.	DWG NO. 08-02492	REV A
SCALE NTS	DATE 09/22/14	SHEET 7 OF 7

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 02/21/2018

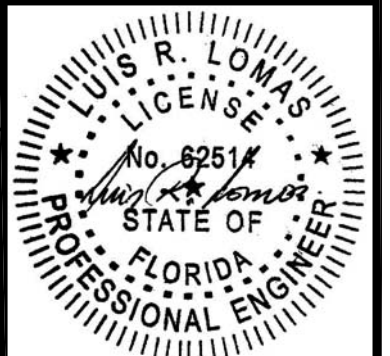

Luis R. Lomas P.E.
FL No.: 62514