




STEVES AND SONS
203 Humble Ave.
San Antonio, TX 78225

OPAQUE FIBERGLASS DOOR
INSWING / OUTSWING
"IMPACT"


GENERAL NOTES

1. This product anchoring drawing has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) excluding the "High Velocity Hurricane Zone" (HVHZ). See the Certification Agency Certificate for sizes, specifications & ratings.
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel construction details
3	Horizontal cross sections
4	Vertical cross sections
5	Buck and frame anchoring - 2X buck masonry construction
6	Frame anchoring - 1X buck masonry construction
7	Bill of materials & components

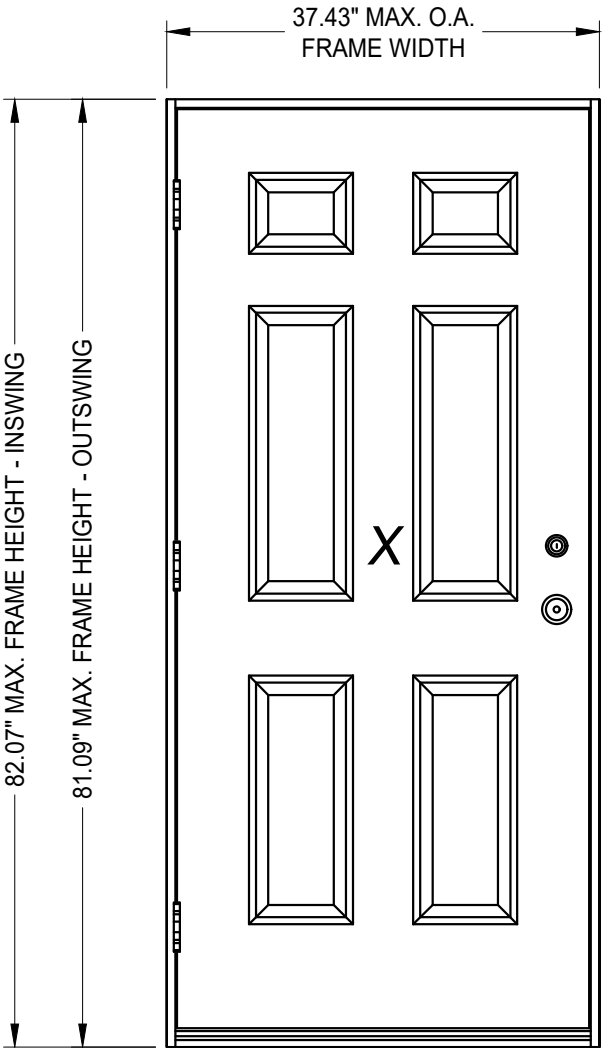

SWING	MAX. FRAME DIMENSION	DESIGN PRESSURE (PSF)	
		POSITIVE	NEGATIVE
INSWING	37.43" x 82.07"	+55.0	-60.0
OUTSWING	37.43" x 81.09"	+55.0	-55.0

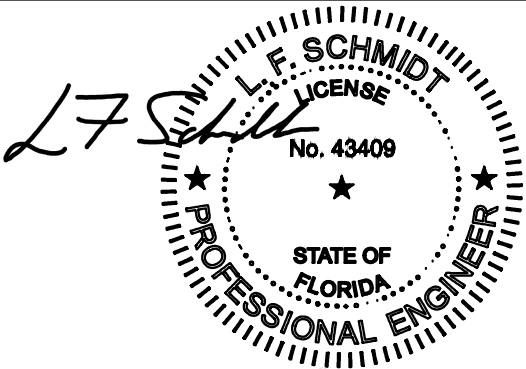

Digitally signed by Lyndon F Schmidt
Date: 2026.07.07 15:05:08 -04'00'
This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.
THIS PRODUCT APPROVAL IS VALID ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

STEVES AND SONS

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES

4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
3	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
2	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS
1	10/08/17	UPDATE TO 6TH ED. (2017)	FBC	JK
NO.	DATE			BY

REVISIONS

DATE: 7/17/15

SCALE: N.T.S.

DWG. BY: JK




CHK. BY: LFS

DRAWING NO.: FL-17901.1

SHEET 1 OF 7

© 2015 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.1-5.dwg

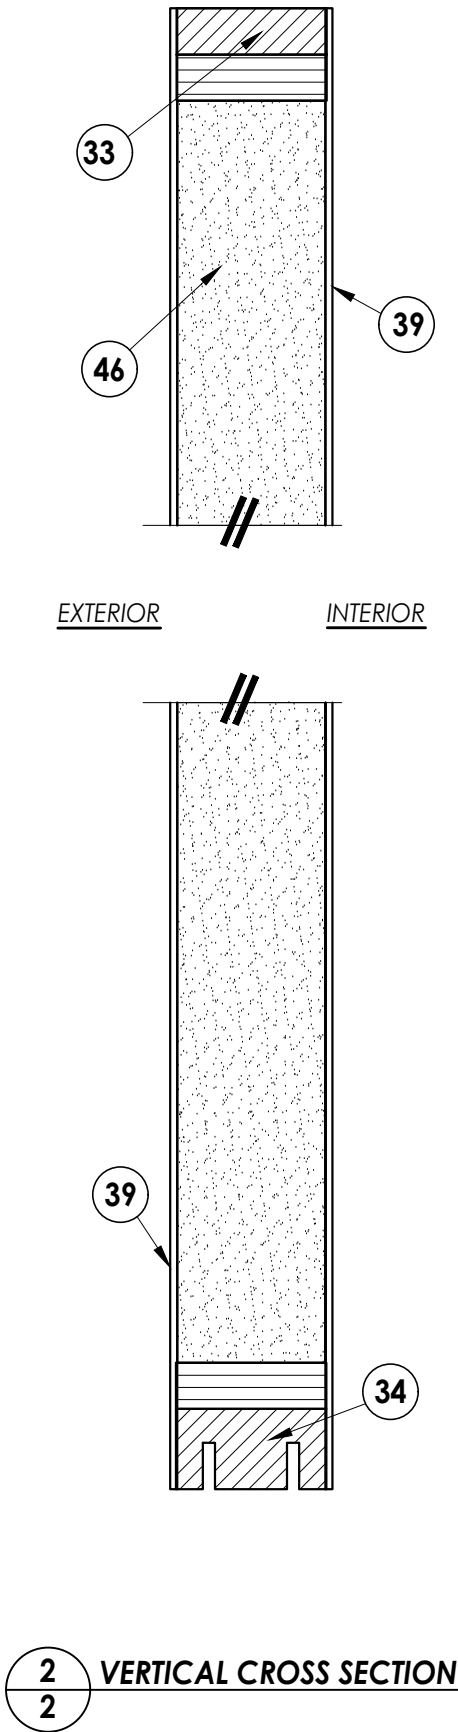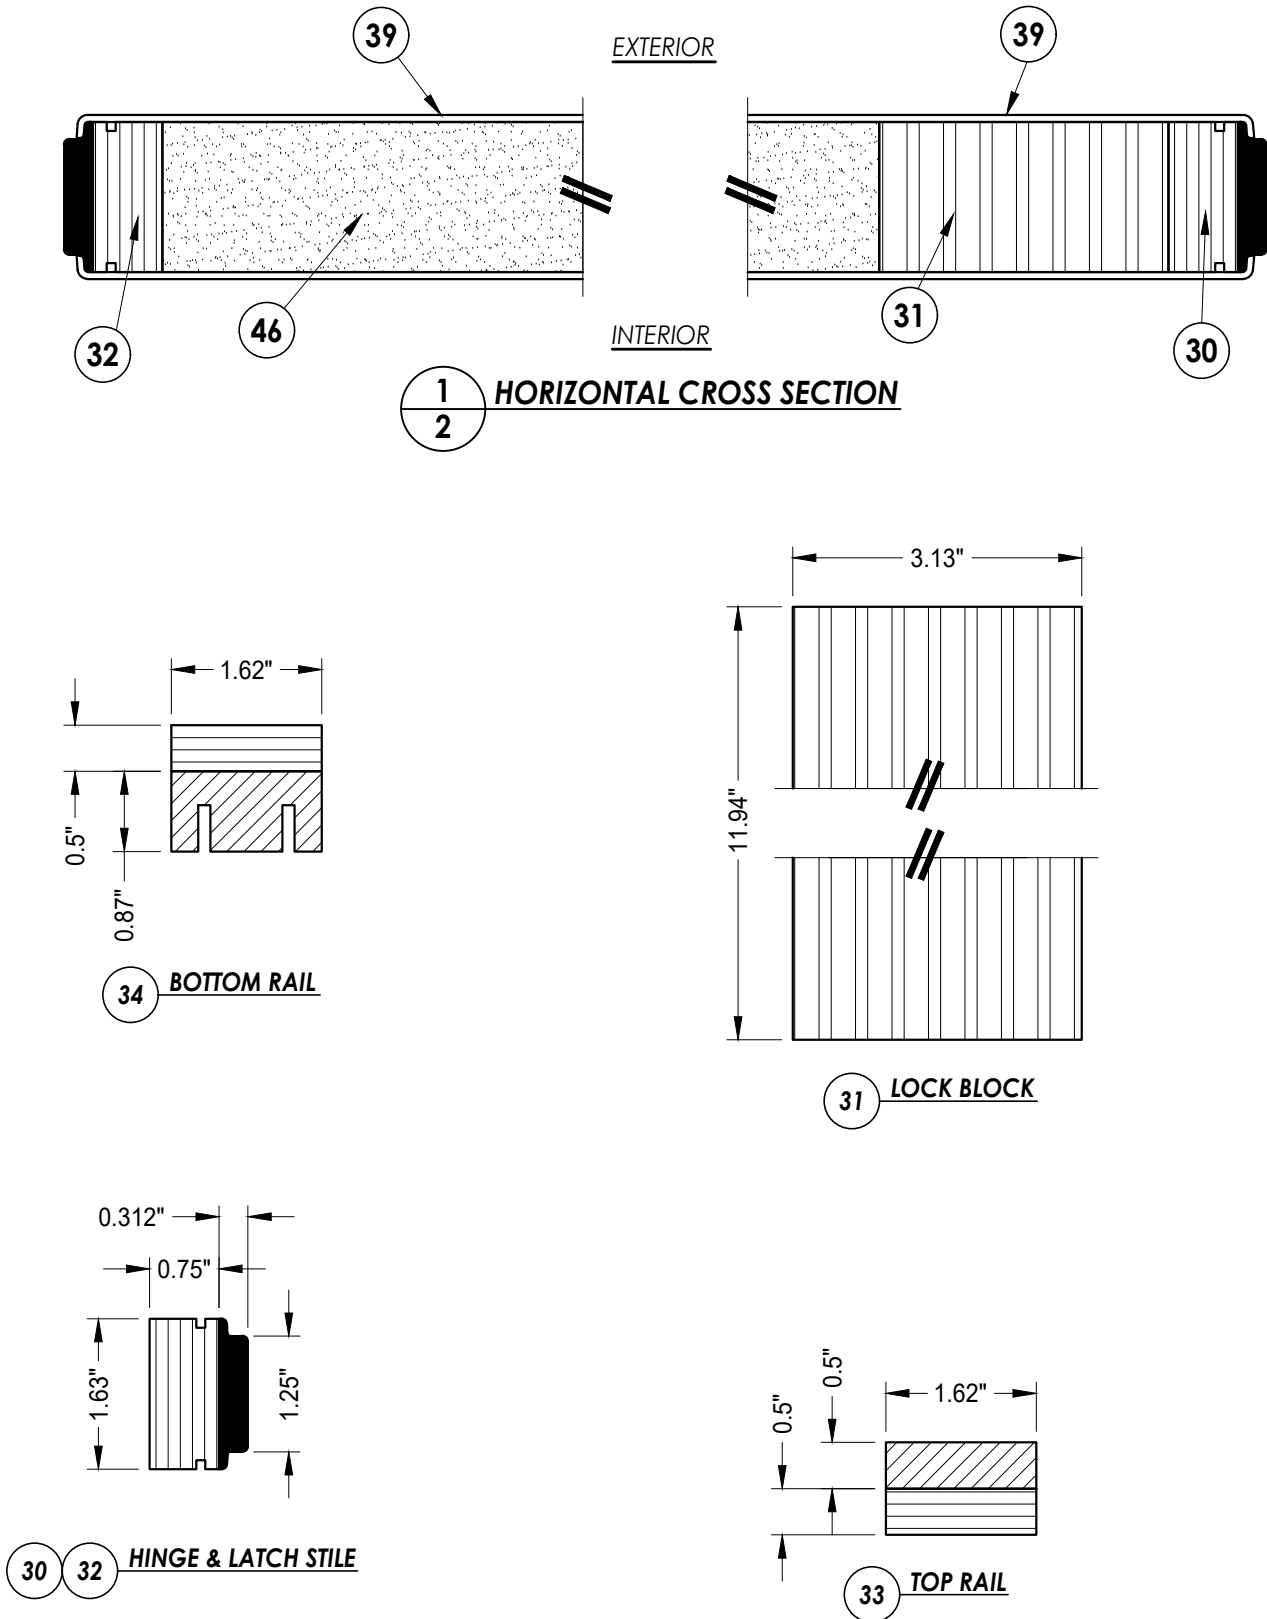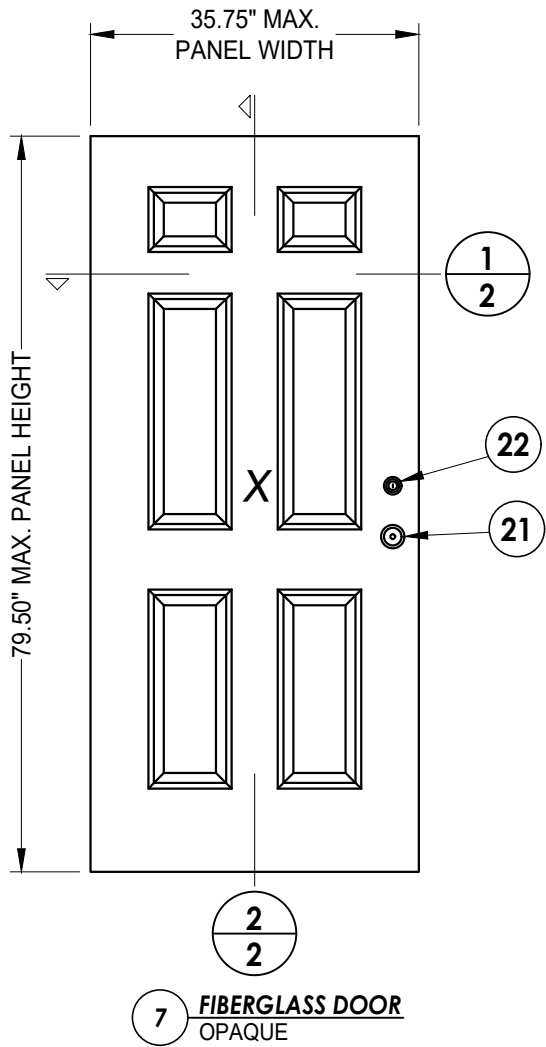

NO.		DATE	REVISIONS	
4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
3	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
2	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS
1	10/08/17	UPDATE TO 6TH ED. (2017)	FBC	JK



DATE:	7/17/15
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-17901.1
SHEET	2 OF 7

PRODUCT:	STEVE'S AND SONS
PART OR ASSEMBLY:	DOOR PANEL CONSTRUCTION DETAILS



Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.1-5.dwg

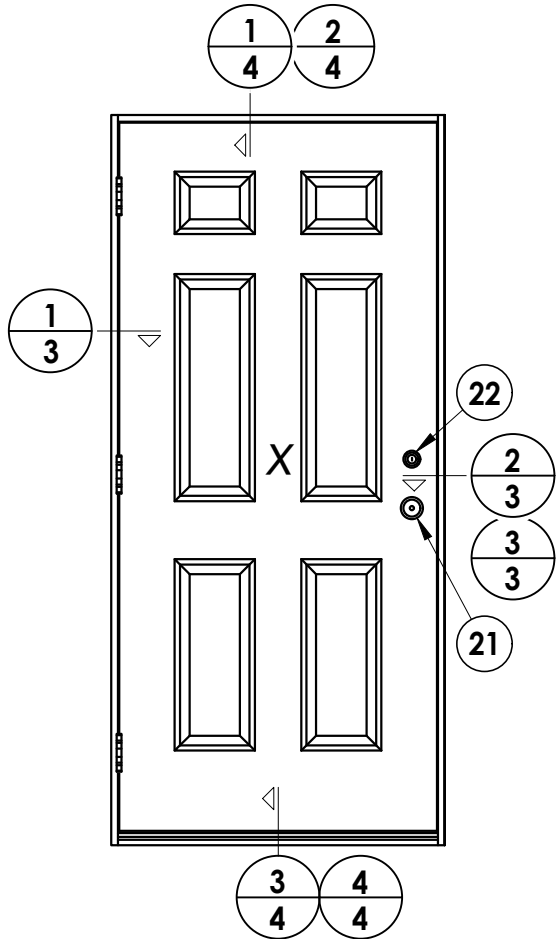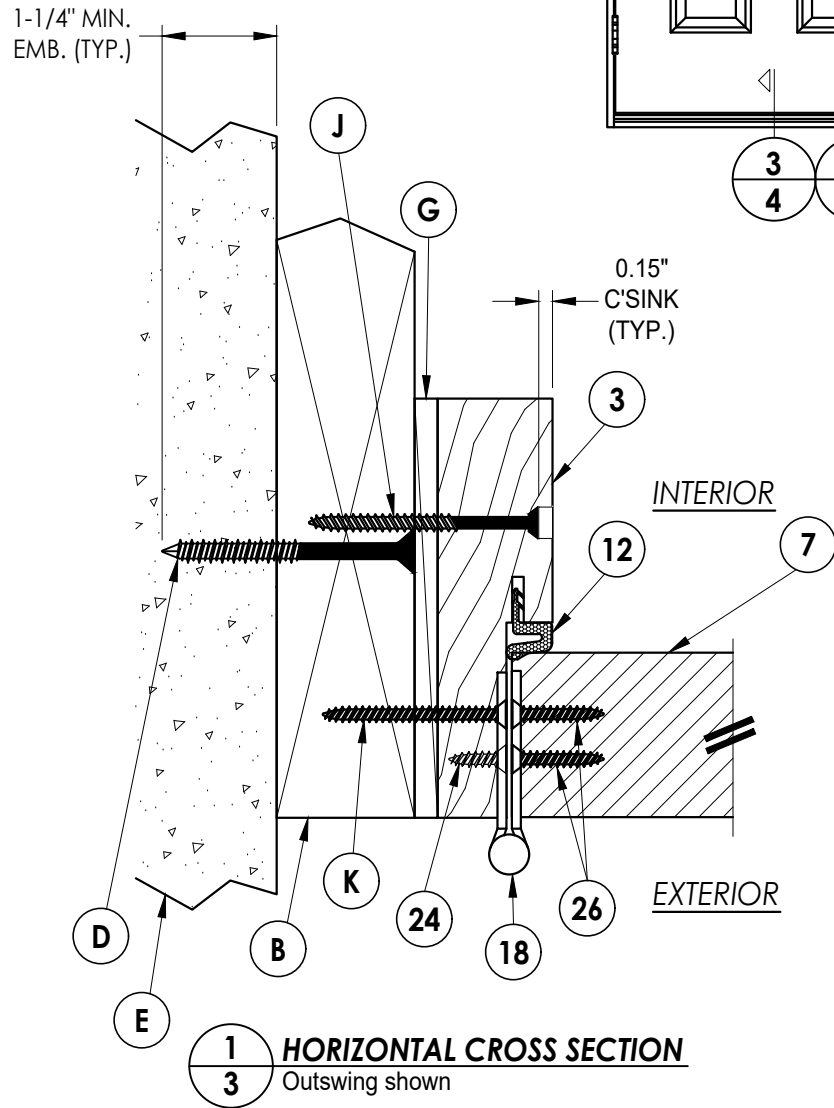

3/3 HORIZONTAL CROSS SECTION
Shown w/1X sub-buck

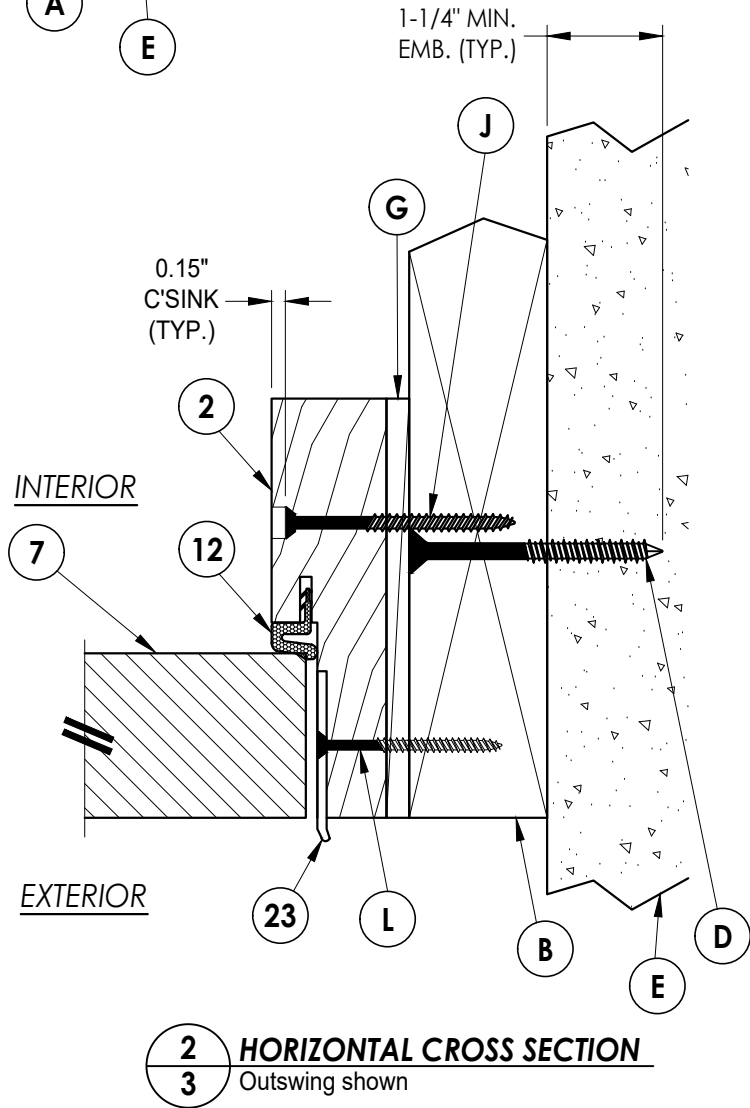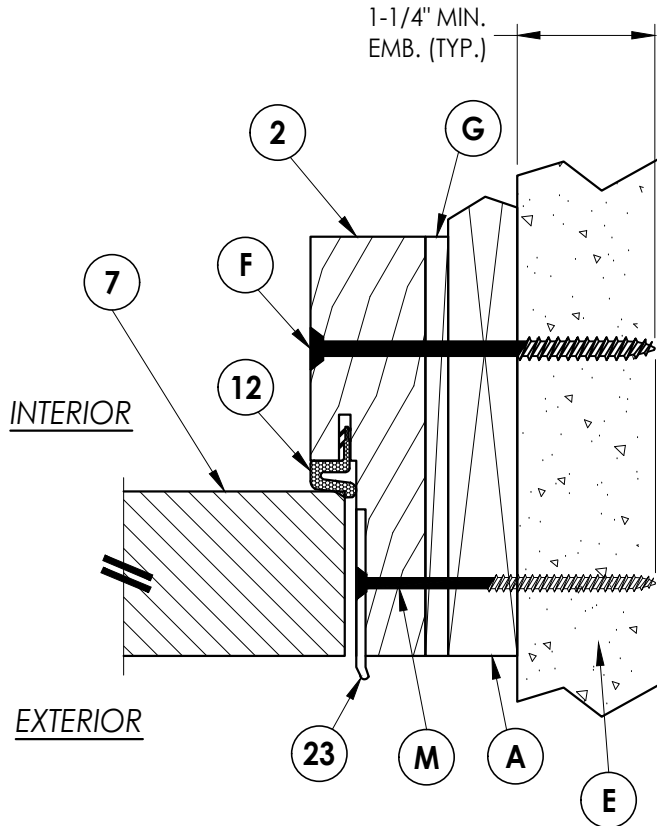

PRODUCT:		STEVE'S AND SONS		PART OR ASSEMBLY:		HORIZONTAL CROSS SECTIONS	
NO.	DATE	REVISIONS	BY	DATE	REVISIONS	BY	DATE
4	7/01/26	UPDATE TO 9TH ED. (2026) FBC	LFS				
3	8/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS				
2	9/16/20	UPDATE TO 7TH ED. (2020) FBC	LFS				
1	10/08/17	UPDATE TO 6TH ED. (2017) FBC	JK				

DATE: 7/17/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17901.1
SHEET 3 OF 7

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Technical cross-section diagram of a window assembly. The diagram shows the exterior and interior components. Key labels include:


- A**: Points to the exterior frame or sash.
- E**: Points to the exterior weatherstripping or seal.
- F**: Points to the exterior glazing or pane.
- G**: Points to the interior frame or sash.
- 4**: Points to the interior weatherstripping or seal.
- 7**: Points to the interior frame or sash.
- 12**: Points to the interior glazing or pane.

A vertical dimension line on the right indicates a minimum depth of 1-1/4" MIN. EMB. (TYP.) for the interior frame/sash assembly.

EXTERIOR INTERIOR


© 2015 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.1-5.dwg

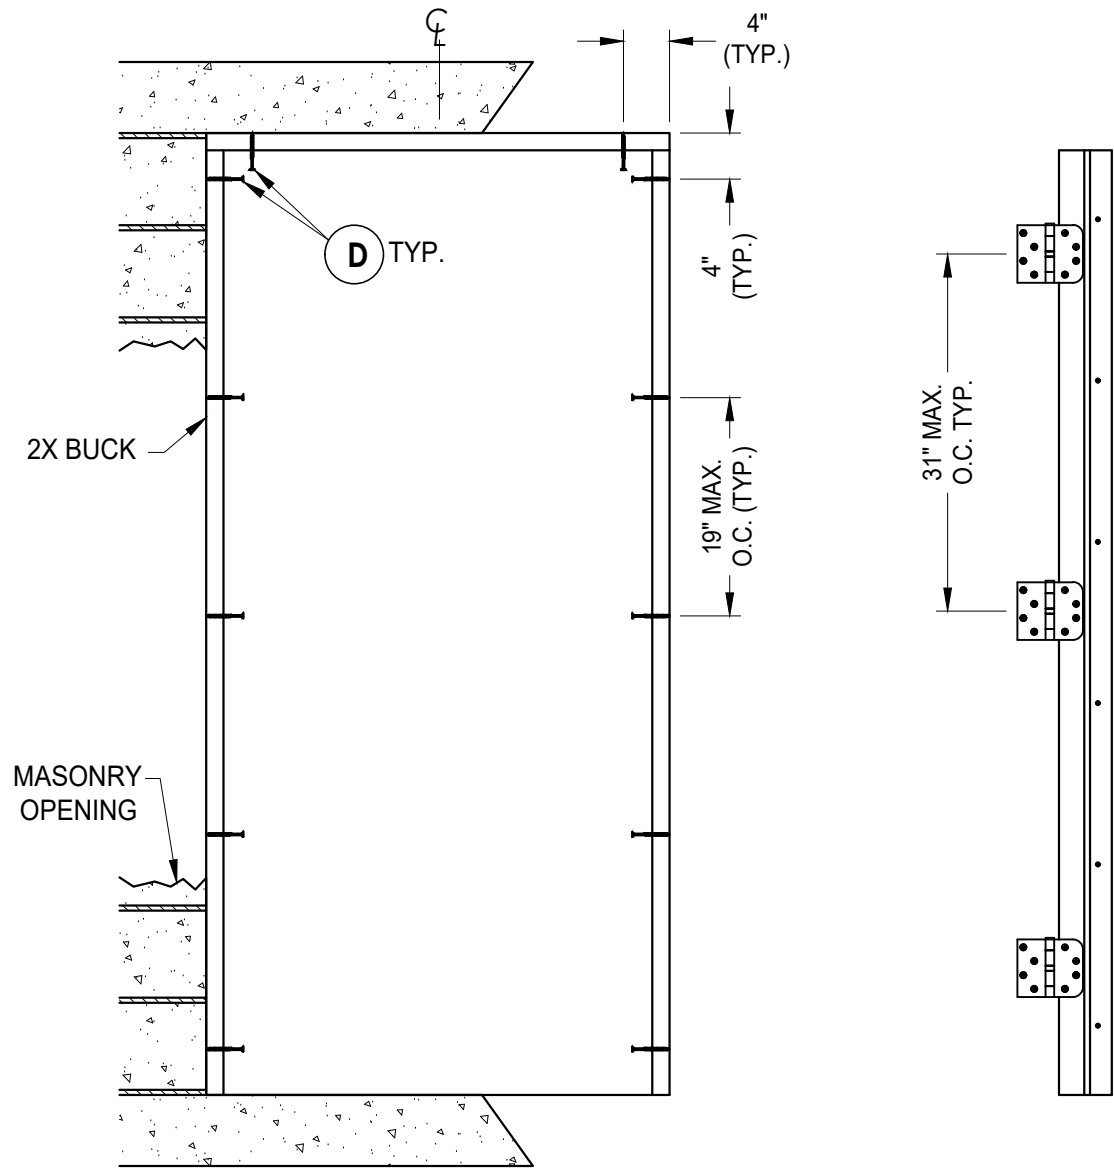


BUCK ANCHORING

HINGE JAMB

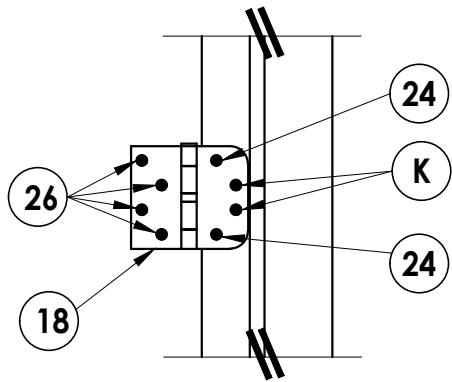


HINGE DETAIL

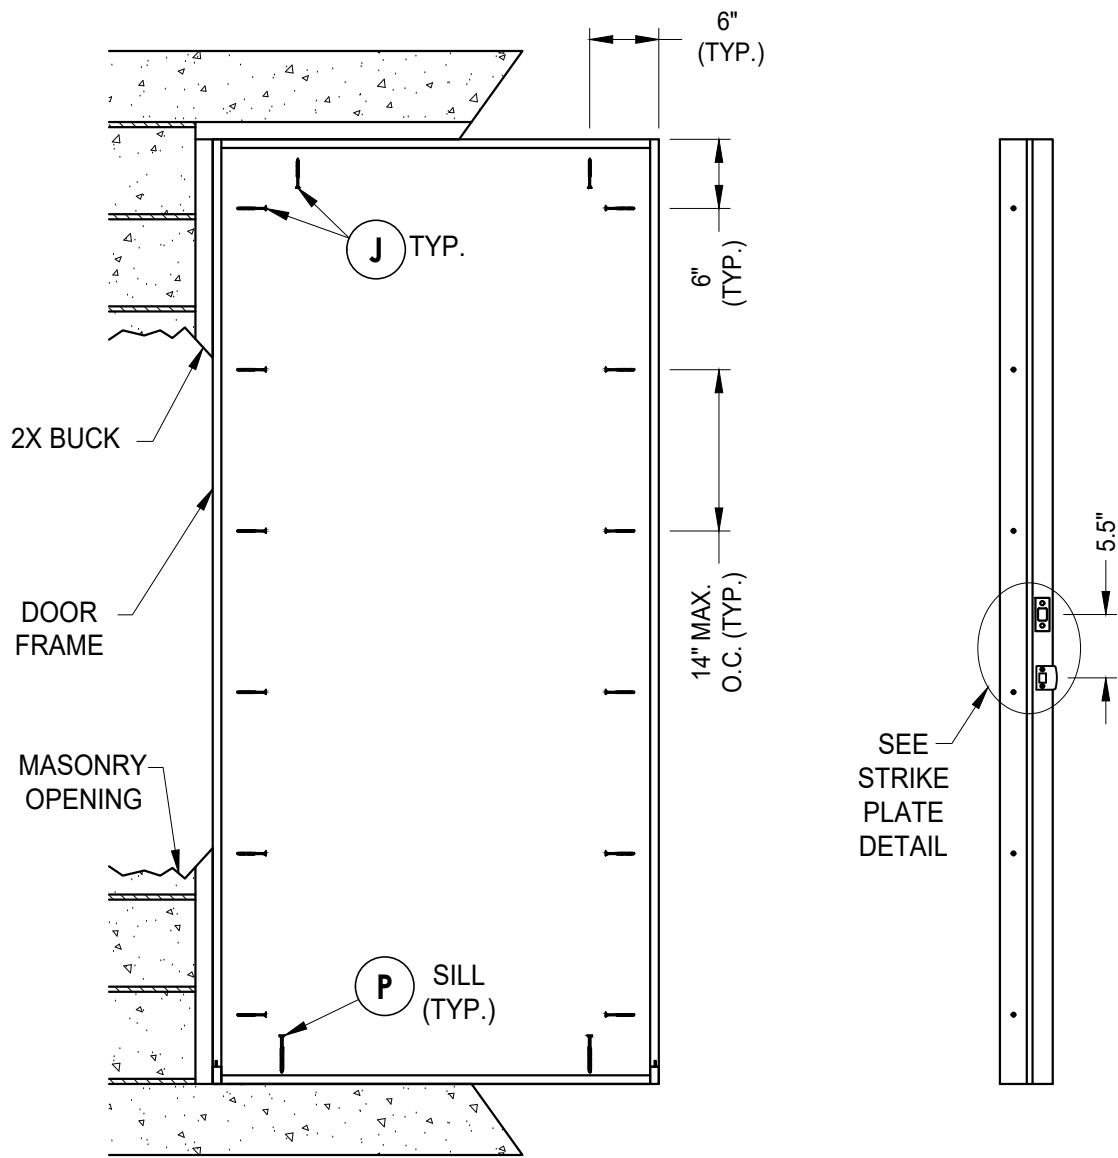

FRAME ANCHORING
Masonry 2X buck construction

STRIKE JAMB

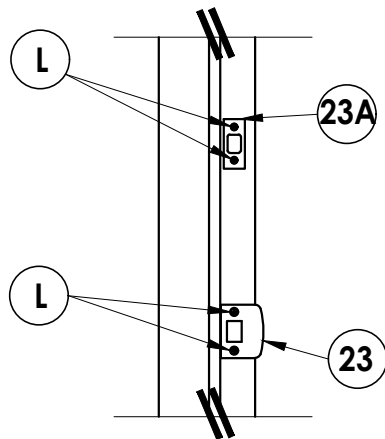

STRIKE PLATE DETAIL


NO.	DATE	REVISIONS
4	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
3	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	9/16/20	UPDATE TO 7TH ED. (2020) FBC LFS
1	10/08/17	UPDATE TO 6TH ED. (2017) FBC JK
		BY

DATE: 7/17/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17901.1
SHEET 5 OF 7


PRODUCT: STEVES AND SONS
PART OR ASSEMBLY: BUCK AND FRAME ANCHORING
2X BUCK MASONRY CONSTRUCTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.1-5.dwg

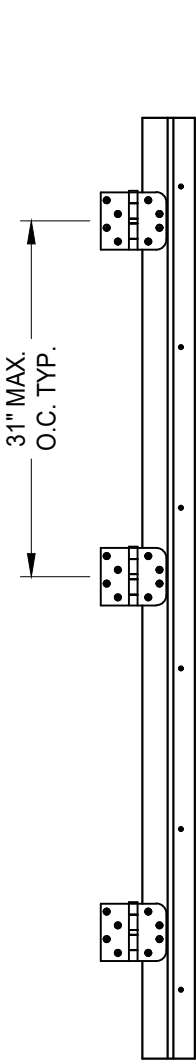


HINGE JAMB

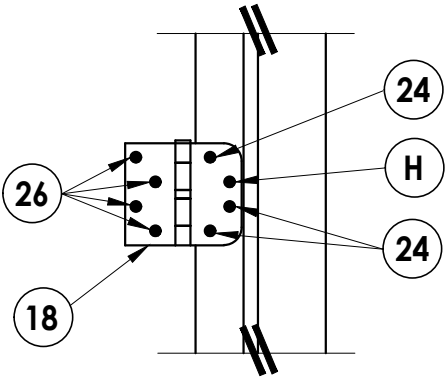


HINGE DETAIL

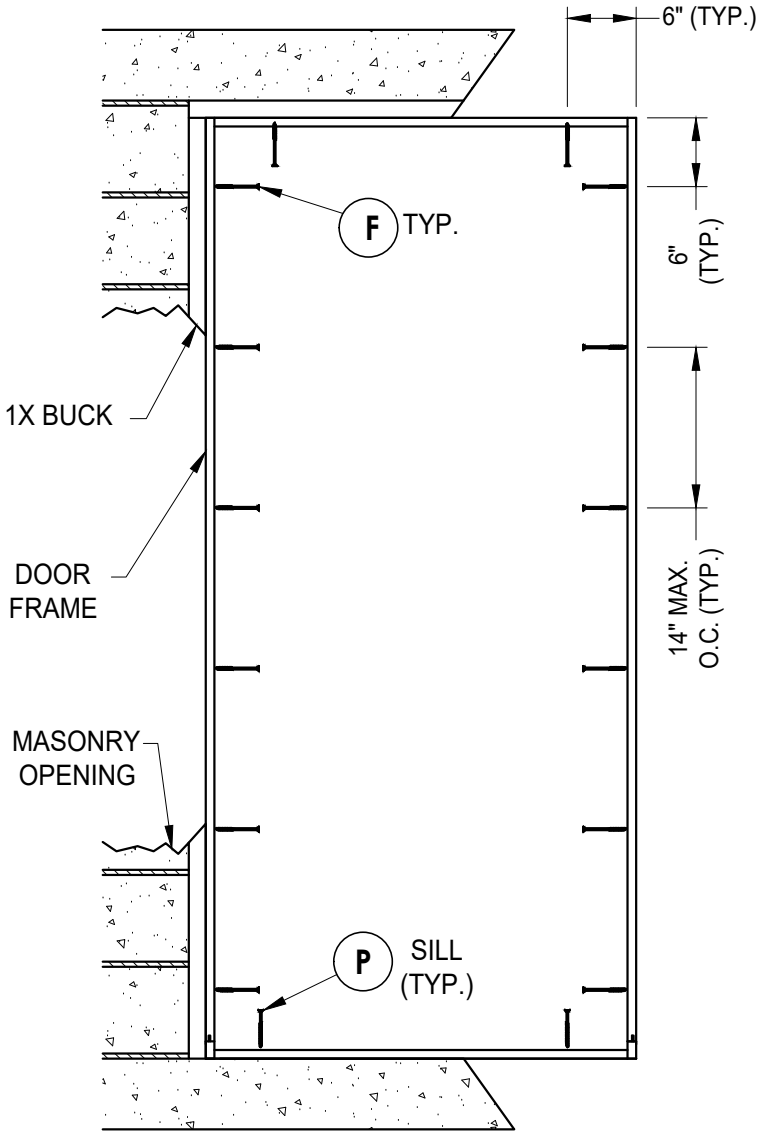

FRAME ANCHORING
Masonry 1X buck construction

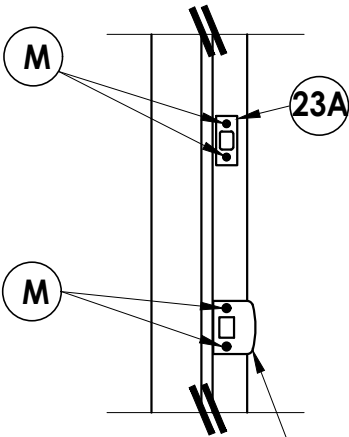

STRIKE PLATE DETAIL

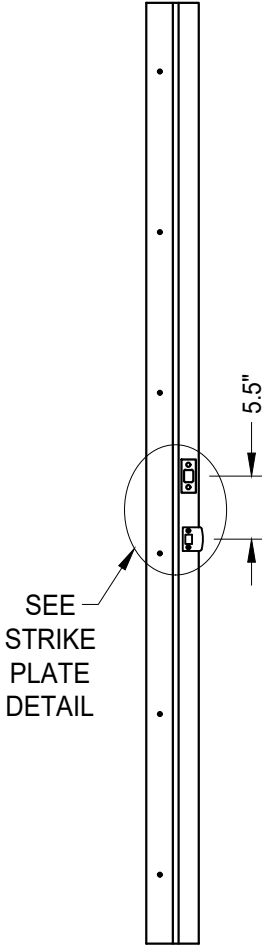

STRIKE JAMB

DATE: 7/17/15	
SCALE: N.T.S.	
DWG. BY: JK	
CHK. BY: LFS	
DRAWING NO.: FL-17901.1	
SHEET 6	OF 7

NO.		DATE	REVISIONS	
4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
3	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
2	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS
1	10/08/17	UPDATE TO 6TH ED. (2017)	FBC	JK


PRODUCT:	
STEVES AND SONS	
PART OR ASSEMBLY:	
FRAME ANCHORING	
1X BUCK MASONRY CONSTRUCTION	

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.1-5.dwg


BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	WOOD
D	1/4" X 2-3/4" DeWALT OR ITW PFH CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" ITW PFH CONCRETE SCREW	STEEL
G	MAX. 1/4" SHIM SPACE	-
H	1/4" X 3-1/4" ITW PFH CONCRETE SCREW	STEEL
J	#10 X 2-1/2" PFH WS (1-1/8" MIN. EMBEDMENT)	STEEL
K	#9 X 2" PFH WS	STEEL
L	#8 X 2-1/2" PFH WS	STEEL
M	3/16" X 3-1/4" ITW PFH CONCRETE SCREW	STEEL
P	1/4" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
2	STRIKE JAMB - FINGER-JOINT PINE - SG >= 0.42	WOOD
3	HINGE JAMB - FINGER-JOINT PINE - SG >= 0.42	WOOD
4	HEAD - FINGER-JOINT PINE - SG >= 0.42	WOOD
5	INSWING THRESHOLD ALUMINUM W/ COMPOSITE SUBSTRATE	ALUM/COMP.
6	DOOR BOTTOM SWEEP	PVC
7	DOOR PANEL - SEE DOOR PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
12	WEATHER STRIP QEBD650 Q-LON	-
18	3.983" X 4.0" HINGE MIN 0.098" THICK	STEEL
21	PASSAGE LOCK - KWIKSET SERIES	STEEL
22	DEADBOLT - KWIKSET SERIES (660)	STEEL
23	STRIKE PLATE	STEEL
23A	DEADBOLT STRIKE	STEEL
24	#9 X 5/8" PFH WS	STEEL
25	OUTSWING THRESHOLD ALUMINUM W/ COMPOSITE SUBSTRATE	ALUM./ COMP.
26	#9 X 1" PFH WS	STEEL
30	LATCH STILE - SG >= 0.42	LVL/PVC
31	LVL LOCK BLOCK	POPLAR
32	HINGE STILE - SG >= 0.42	LVL/PVC
33	TOP RAIL - POPLAR LVL & WPC COMBINATION	POPLAR/WPC
34	BOTTOM RAIL - POPLAR LVL & WPC COMBINATION	POPLAR/WPC
39	FIBERGLASS SKIN 0.079" MIN. THICKNESS (Fy = 5,200 PSI MIN.)	FIBERGLASS
46	DOOR PANEL FOAMED CORE	POLYSTYRENE




6 SWEEP

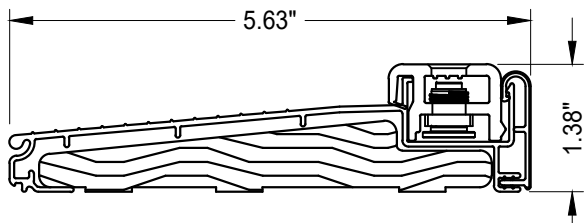

5 INSWING THRESHOLD

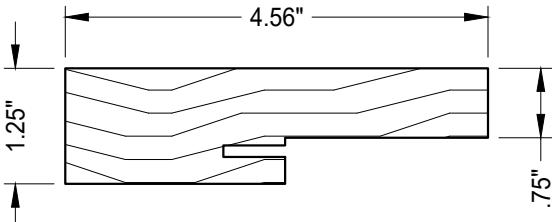

4 3 2 SIDE & HEAD JAMBS

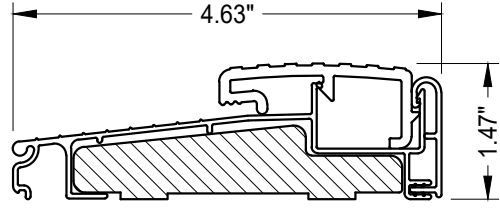

25 OUTSWING THRESHOLD

CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Vairico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:

STEVES AND SONS

PART OR ASSEMBLY:

BILL OF MATERIALS
& COMPONENTS

DATE: 7/17/15

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-17901.1

SHEET 7 OF 7