



STEVE'S AND SONS


203 Humble Ave.
San Antonio, TX 78225

GLAZED FIBERGLASS DOOR
IN swing / OUT swing
"NON-IMPACT"

GENERAL NOTES

1. This product anchoring drawing has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) excluding the "High Velocity Hurricane Zone" (HVHZ). See the Certification Agency Certificate for sizes, specifications & ratings.
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2..
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.


TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel construction details & glazing detail
3	Sidelite panel construction details & glazing detail
4	Horizontal cross sections
5	Vertical cross sections
6	Vertical cross sections
7	Buck and frame anchoring - 2X buck masonry construction
8	Frame anchoring - 1X buck masonry construction
9	Bill of materials & components

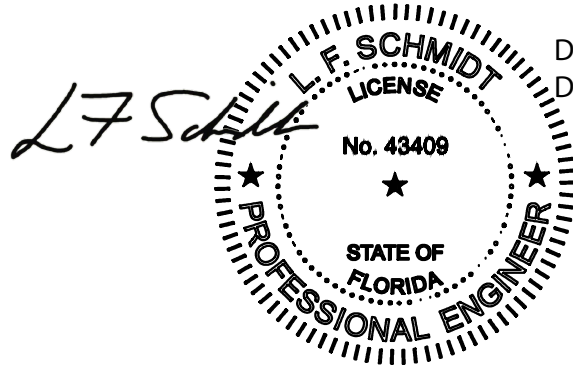

Digitally signed by Lyndon F Schmidt
Date: 2026.07.07 15:16:44 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

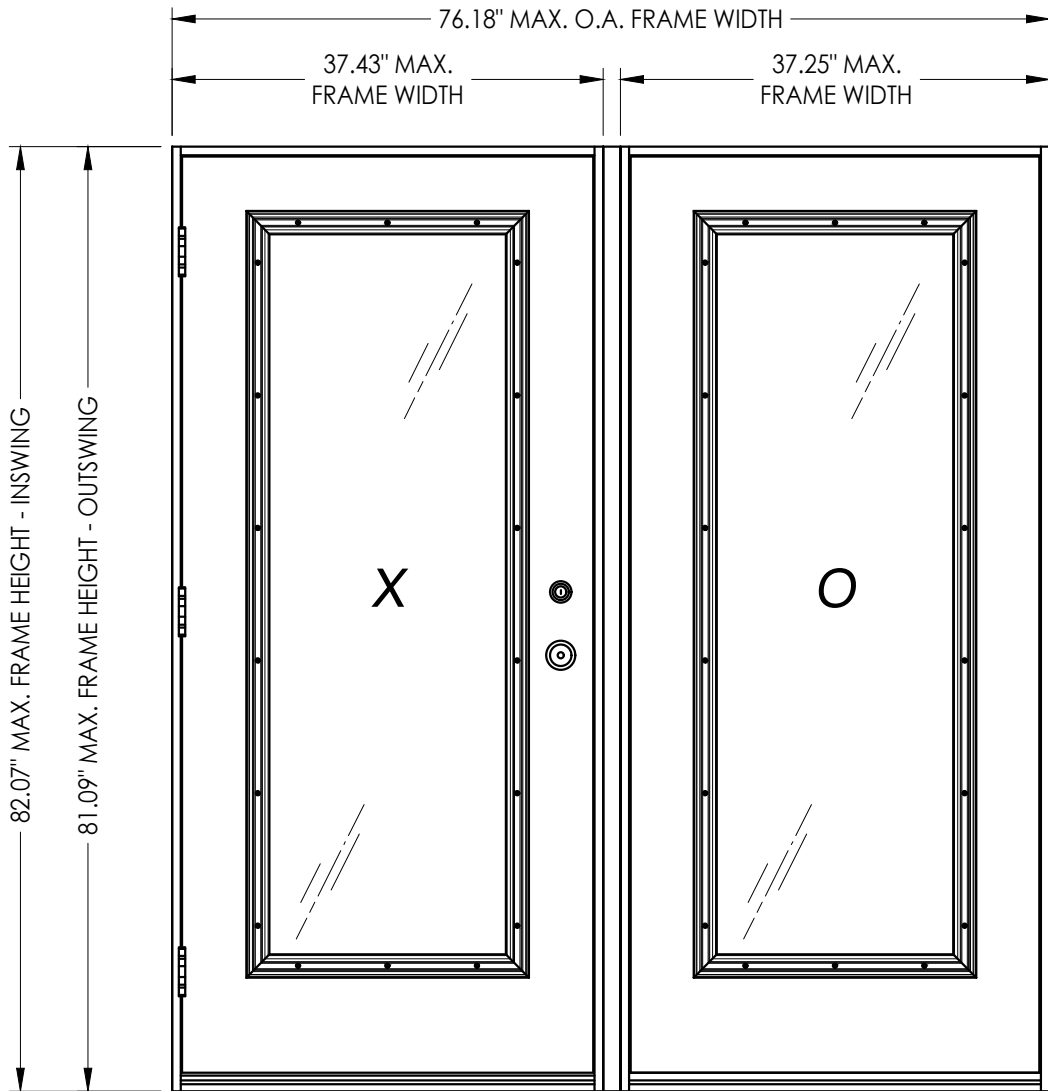

SWING	MAX. FRAME DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
			POSITIVE	NEGATIVE
IN swing	76.18" x 82.07"	G1	+47.0	-47.0
OUT swing	76.18" x 81.09"		+47.0	-47.0

Documents Prepared By:		Lyndon F. Schmidt P.E. No. 43409		BUILDING CODE P.O. Box 233 Phone No.: FBPE Register	
PRODUCT:		STEVES AND SONS		PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES	
4	7/01/26	UPDATE TO 9TH ED. (2026) FBC	LFS		
3	8/07/23	UPDATE TO 8TH ED. (2023) FBC	LFS		
2	9/16/20	UPDATE TO 7TH ED. (2020) FBC	LFS		
1	10/08/17	UPDATE TO 6TH ED. (2017) FBC	JK		
NO.	DATE		BY		
			REVISIONS		
DATE: 7/18/15					
SCALE: N.T.S.					
DWG. BY: JK					
CHK. BY: LFS					
DRAWING NO.: FL-17901.12					
SHEET 1 OF 9					

0.73"


1.63"

Technical drawing of a 1/2 inch diameter ball bearing. The drawing shows the bearing's profile with the following dimensions: 0.31 inch (width of the outer ring), 0.75 inch (width of the inner ring), 1.63 inch (total height), and 1.25 inch (height of the outer ring).

[illegible]

SHEET 2 OF 9

Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.11-15.dwg

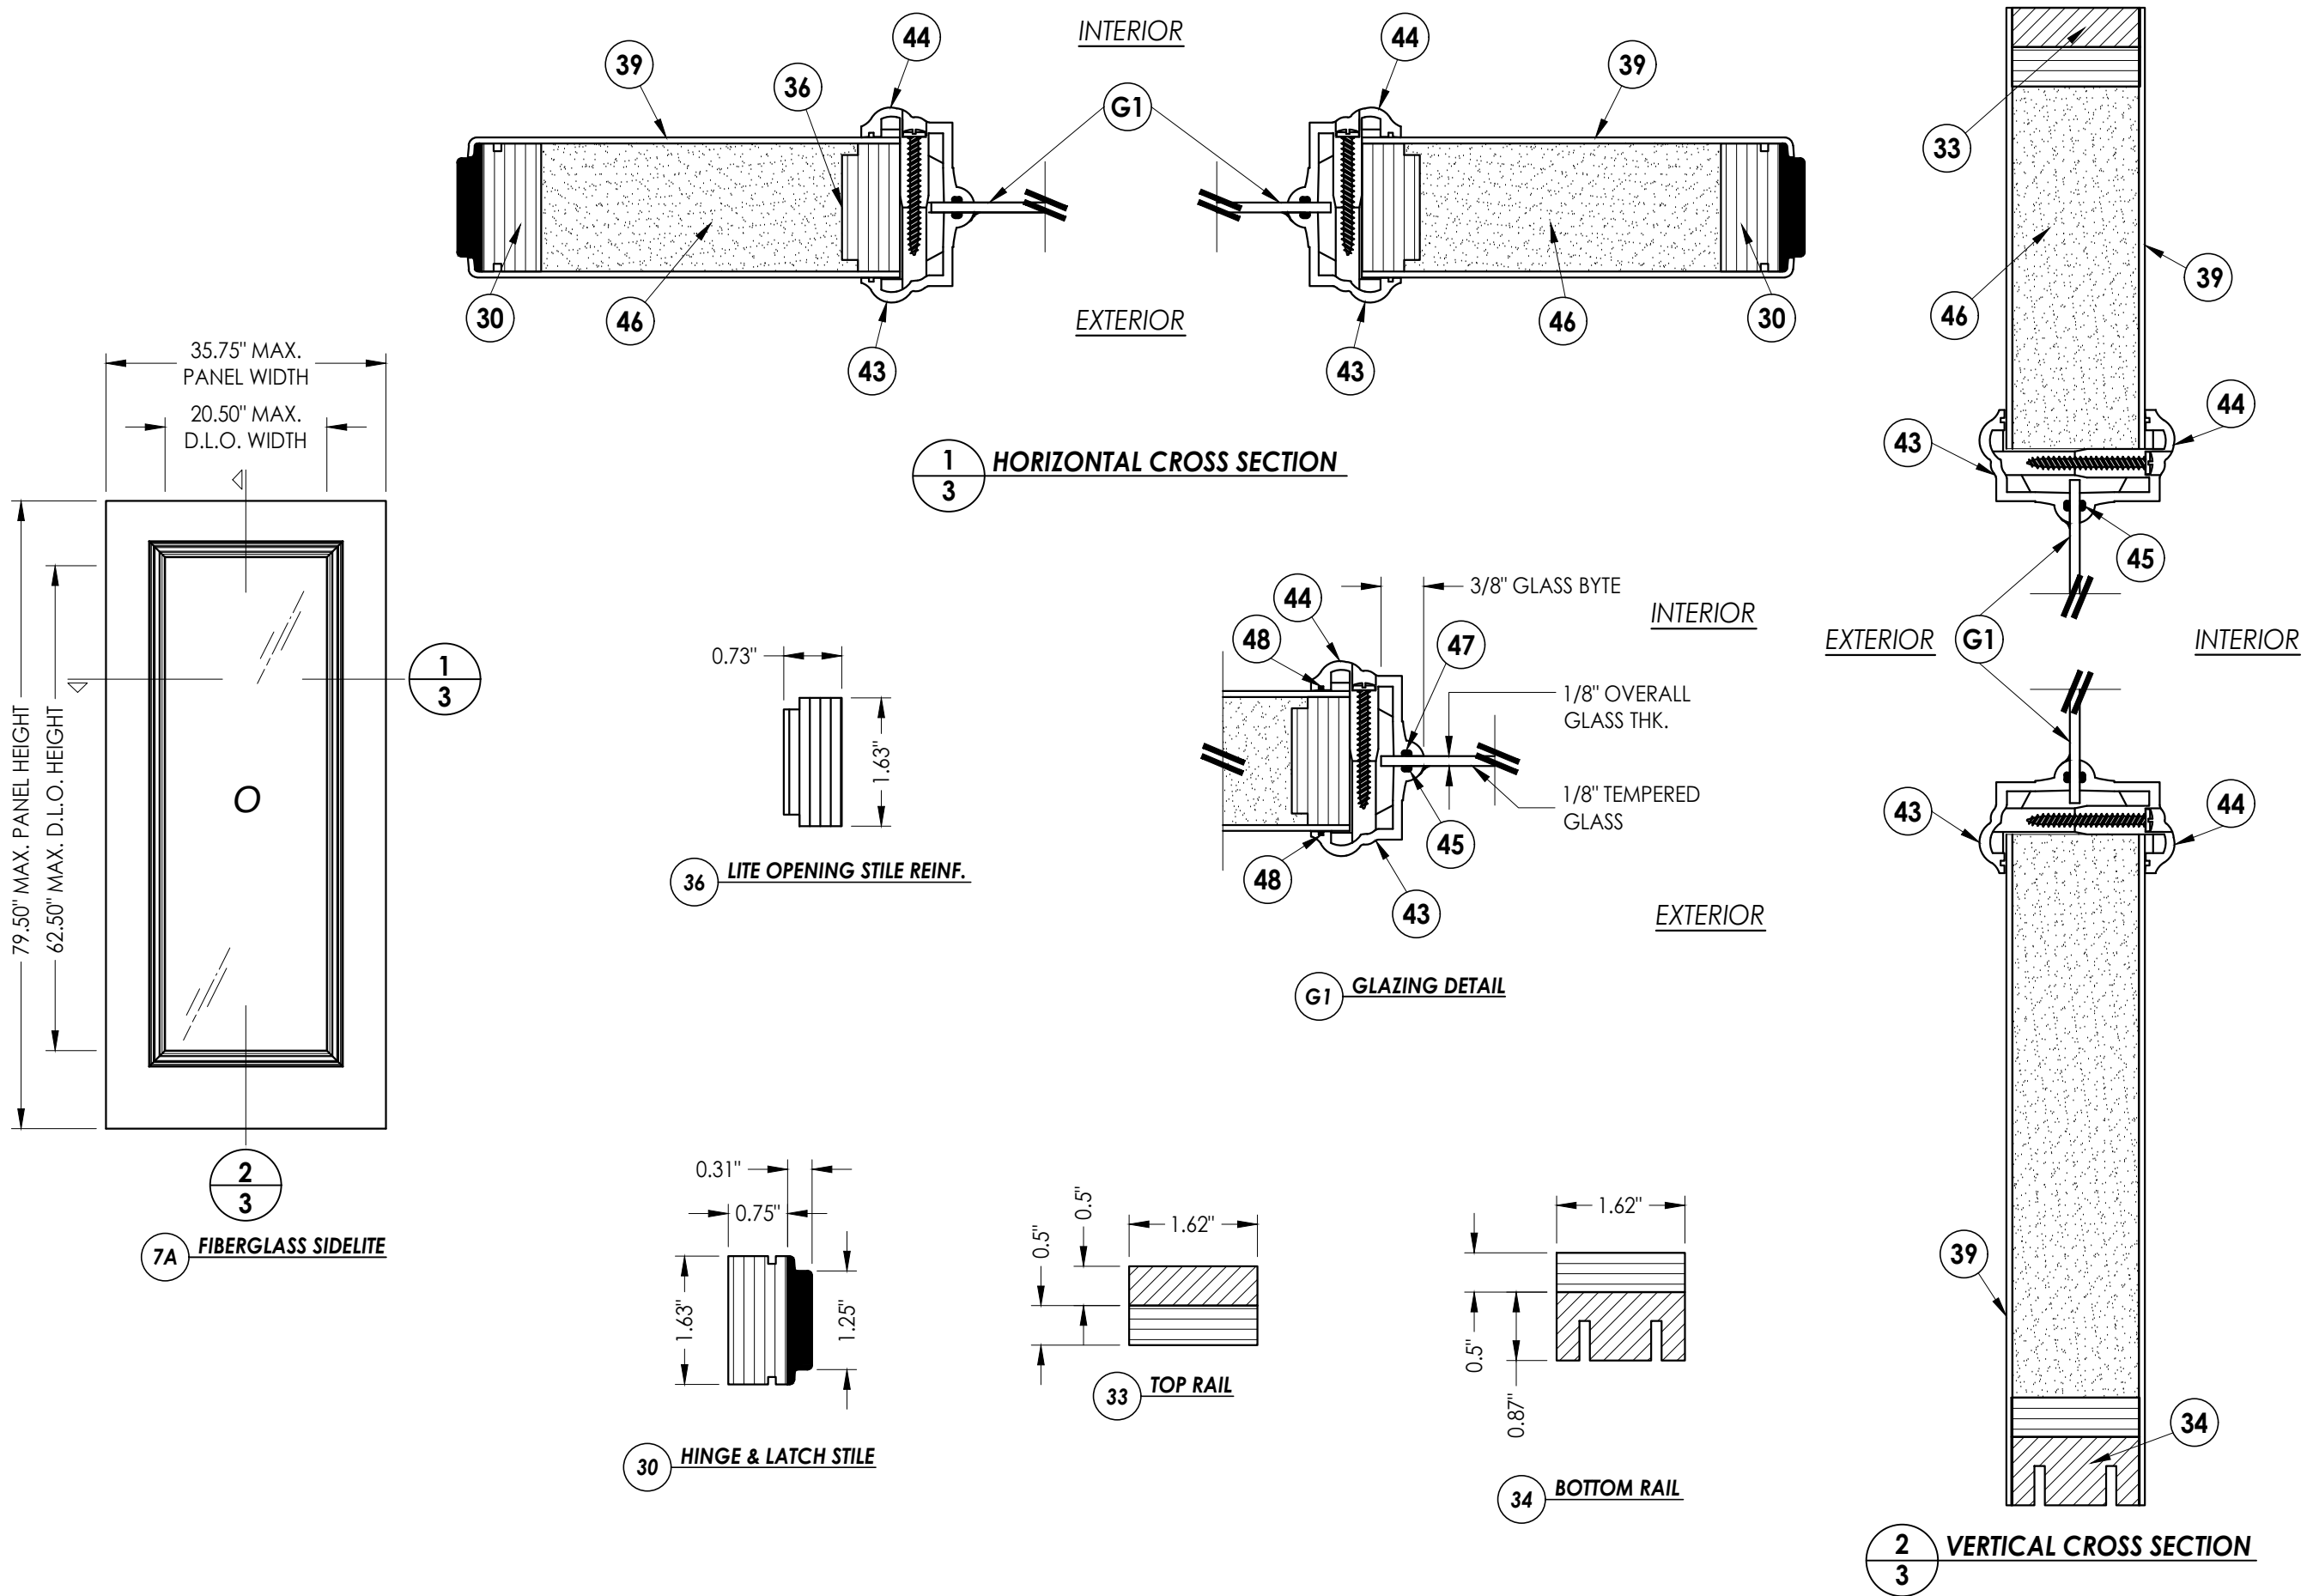

	4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
	3	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
	2	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS
	1	10/08/17	UPDATE TO 6TH ED. (2017)	FBC	JK
	NO. DATE		BY		
REVISIONS					
DATE: 7/18/15					
SCALE: N.T.S.					
DWG. BY: JK					
CHK. BY: LFS					
DRAWING NO.: FL-17901.12					
SHEET 3 OF 9					

DATE: 7/18/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17901.12
SHEET 3 OF 9



Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.11-15.dwg

NOTE:


1. Sidelite ass'y fastener; 6" from each end and 6 more screws equally spaced between. (8 screws total per jamb.)

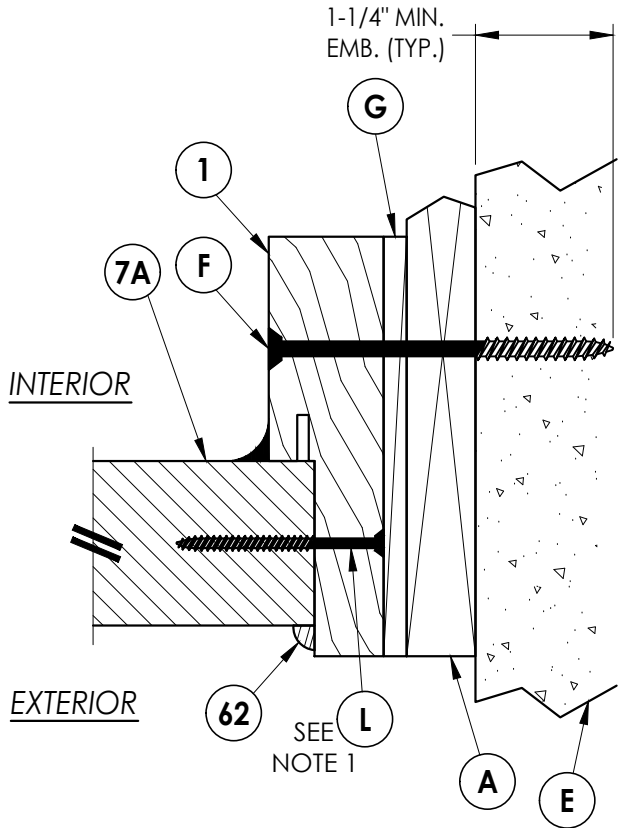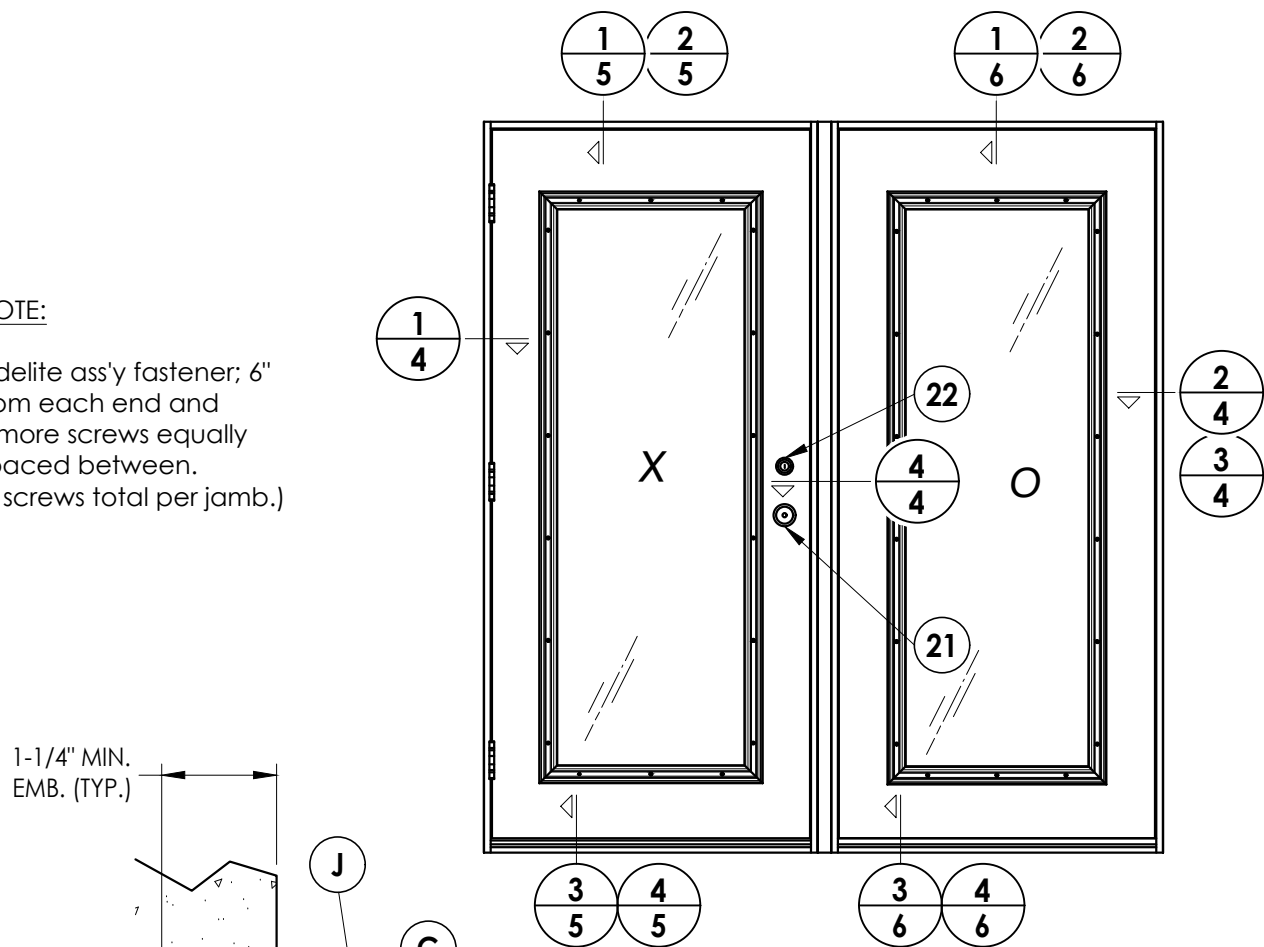


3
4 **HORIZONTAL CROSS SECTION**
Shown w/1X sub-buck

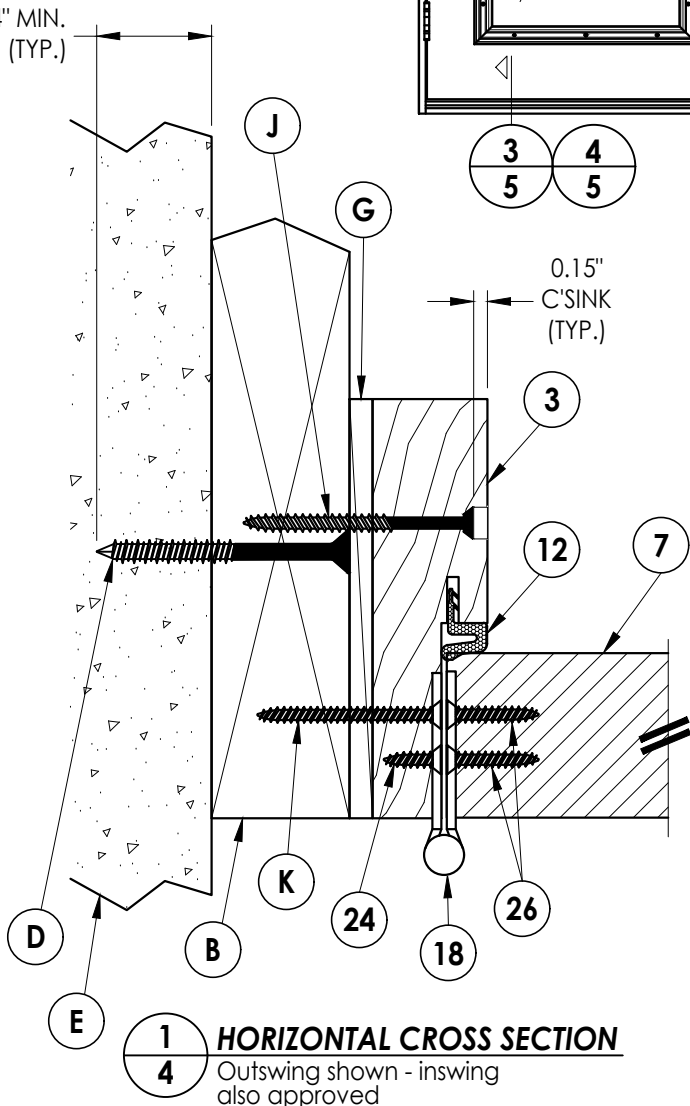

1
4 **HORIZONTAL CROSS SECTION**
Outswing shown - inswing also approved

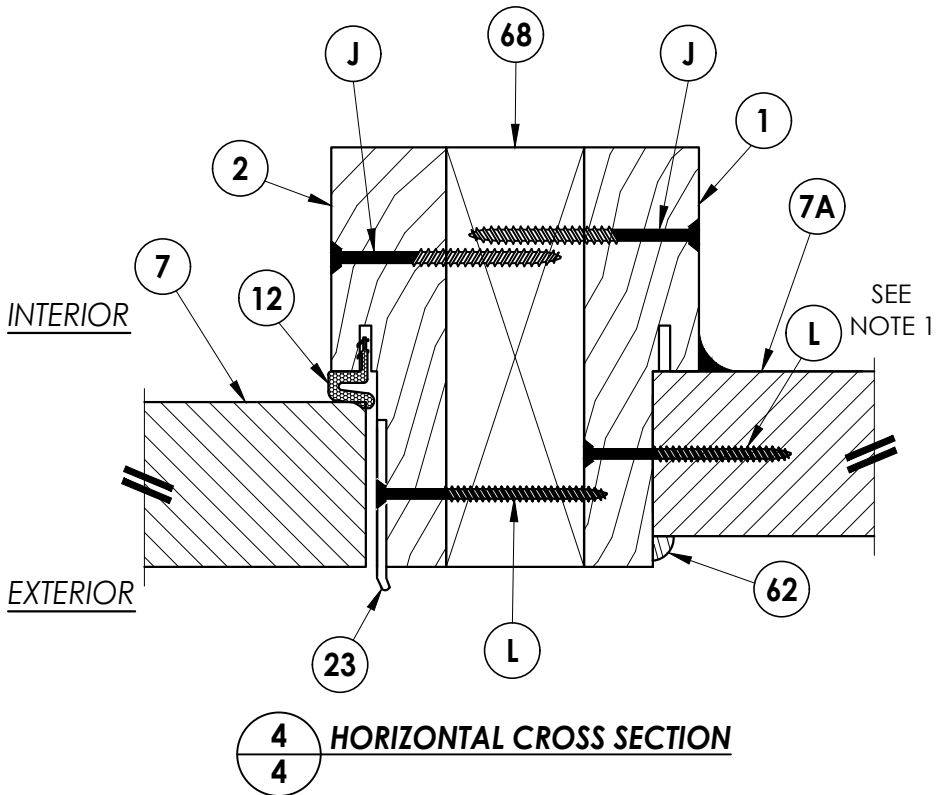


4
4 **HORIZONTAL CROSS SECTION**

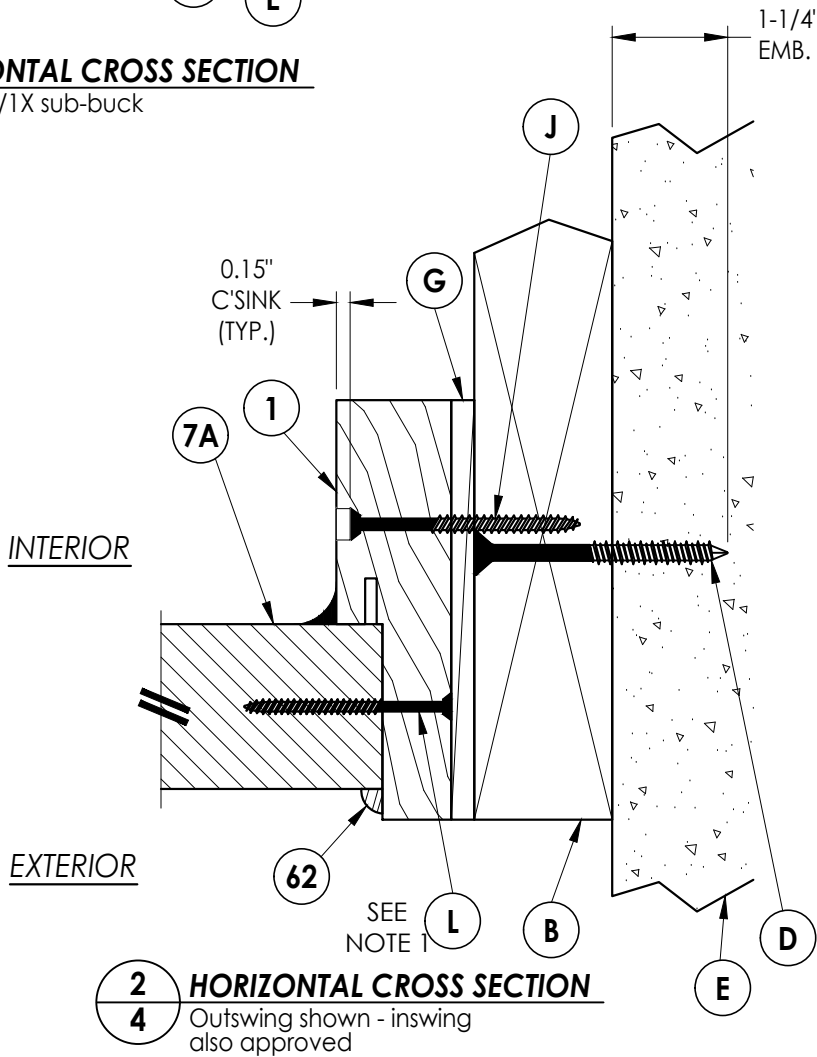


2
4 **HORIZONTAL CROSS SECTION**
Outswing shown - inswing also approved

Documents Prepared By:		STEVES AND SONS		BUILDING CONSULTANTS, INC.	
Lyndon F. Schmidt				P.O. Box 230, Valrico, FL 33595	
P.E. No. 43409				Phone No.: 813.659.9197	
				FBPE Registry No. 9813	
PRODUCT:		PART OR ASSEMBLY:		REVISIONS	
		HORIZONTAL CROSS SECTIONS			
				NO.	DATE
4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
3	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
2	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS	
1	10/08/17	UPDATE TO 6TH ED. (2017)	FBC	JK	
DATE: 7/18/15		SCALE: N.T.S.			
DWG. BY: JK		CHK. BY: LFS			
DRAWING NO.: FL-17901.12					
SHEET 4 OF 9					


Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.11-15.dwg

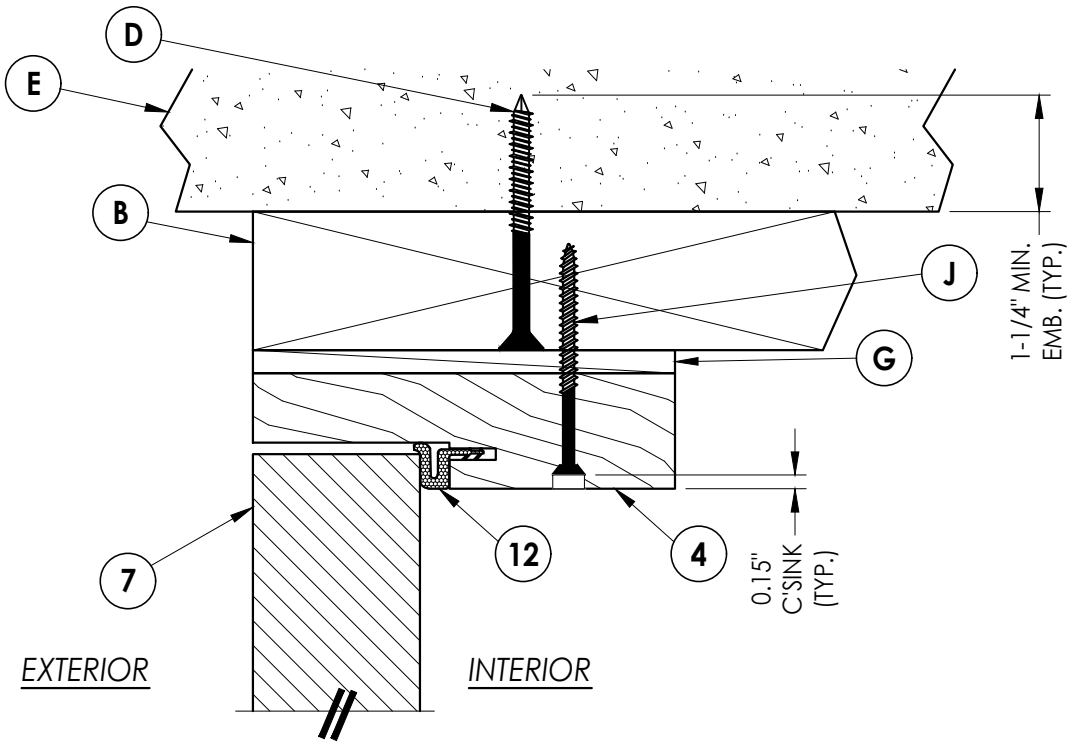


1
5 **VERTICAL CROSS SECTION**
Outswing shown - inswing
also approved

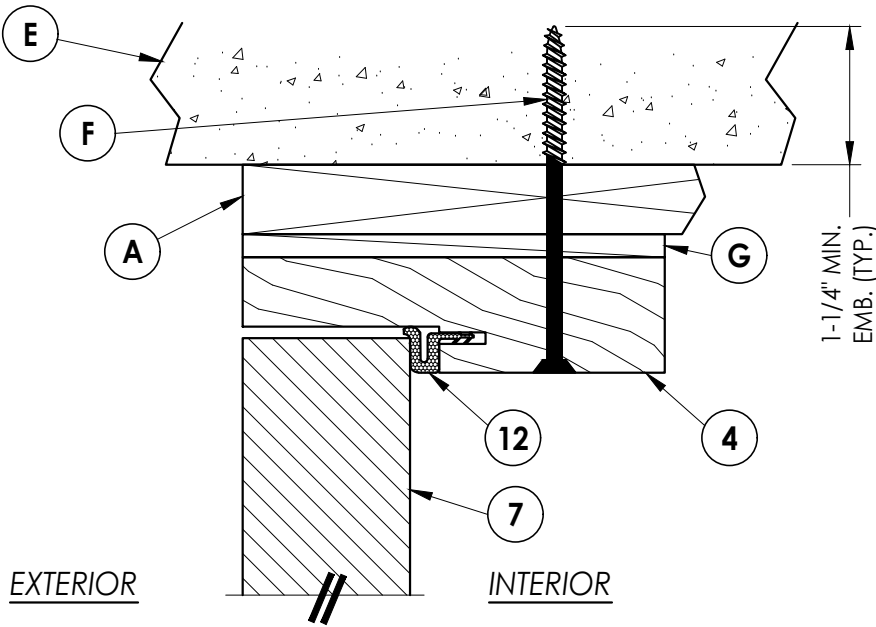

2
5 **VERTICAL CROSS SECTION**
Shown w/1X sub-buck

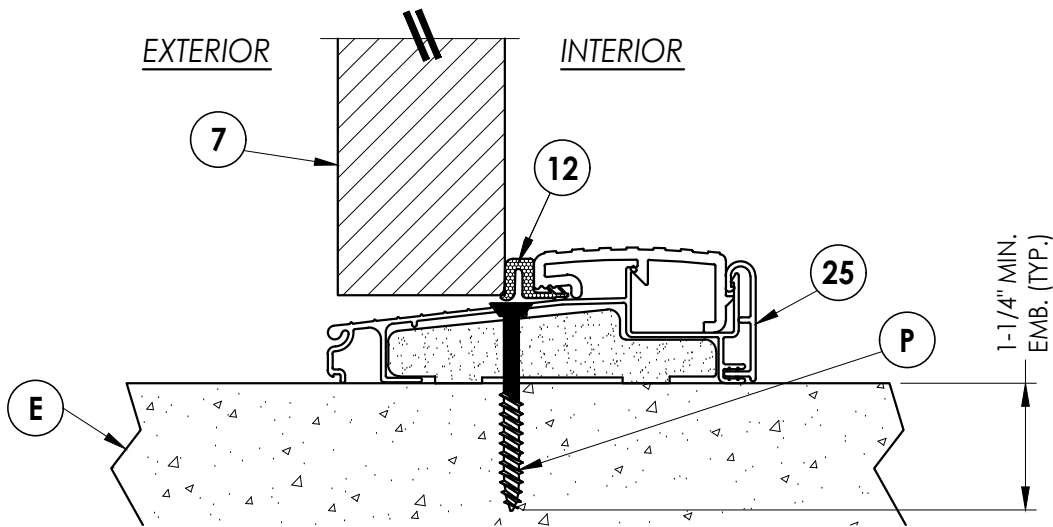

3
5 **VERTICAL CROSS SECTION**
Outswing sill

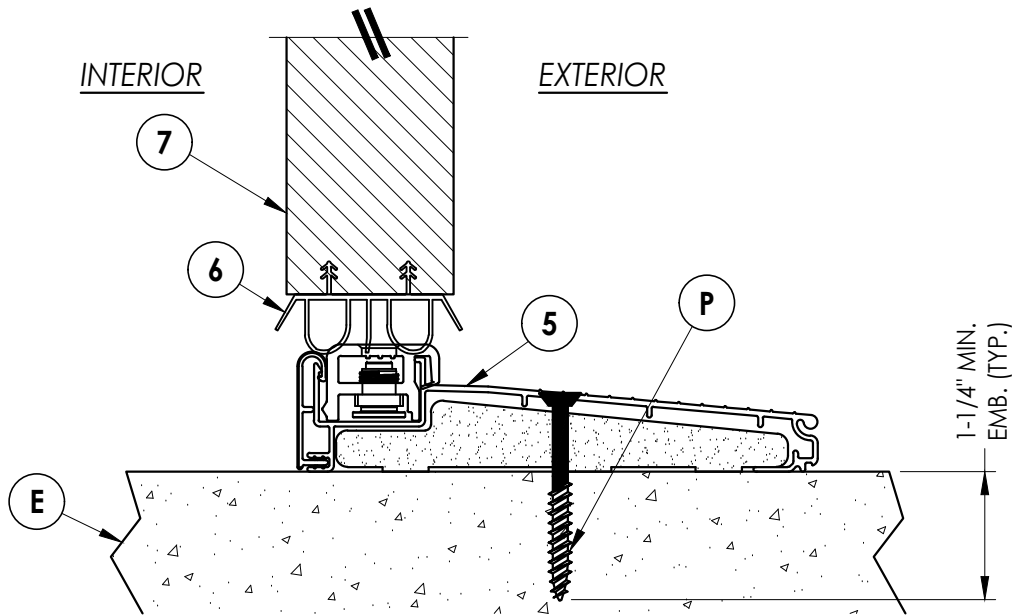

4
5 **VERTICAL CROSS SECTION**
Inswing sill

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: STEVES AND SONS

PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS

NO.	DATE	REVISIONS
4	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
3	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	9/16/20	UPDATE TO 7TH ED. (2020) FBC LFS
1	10/08/17	UPDATE TO 6TH ED. (2017) FBC JK

DATE: 7/18/15

SCALE: N.T.S.





DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-17901.12

SHEET 5 OF 9

Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.11-15.dwg

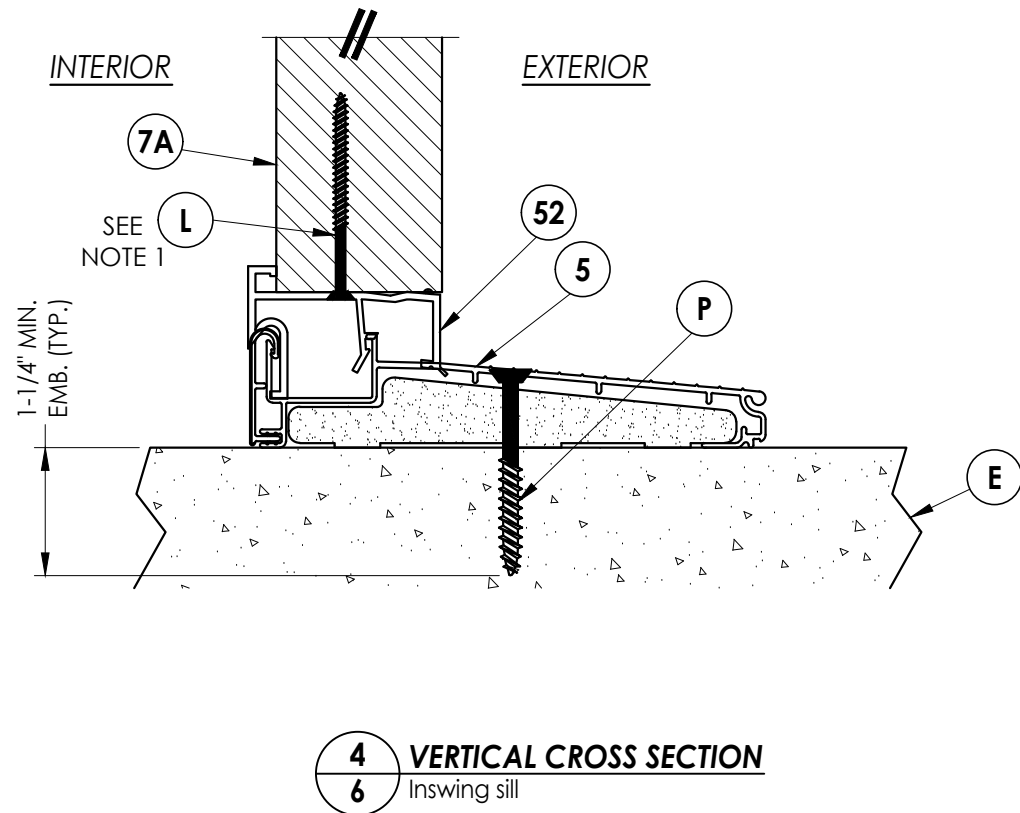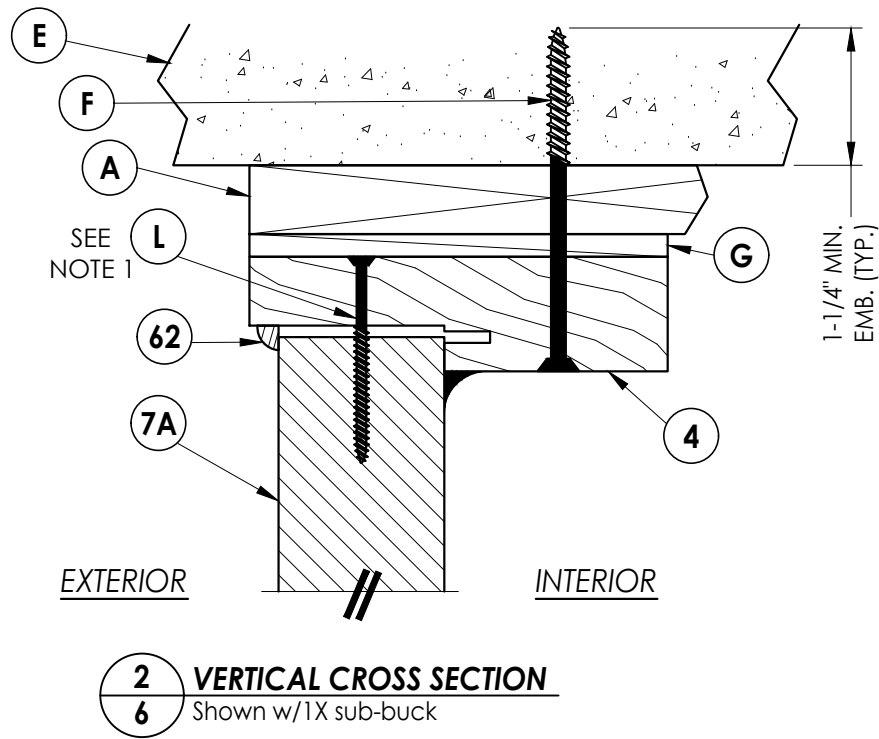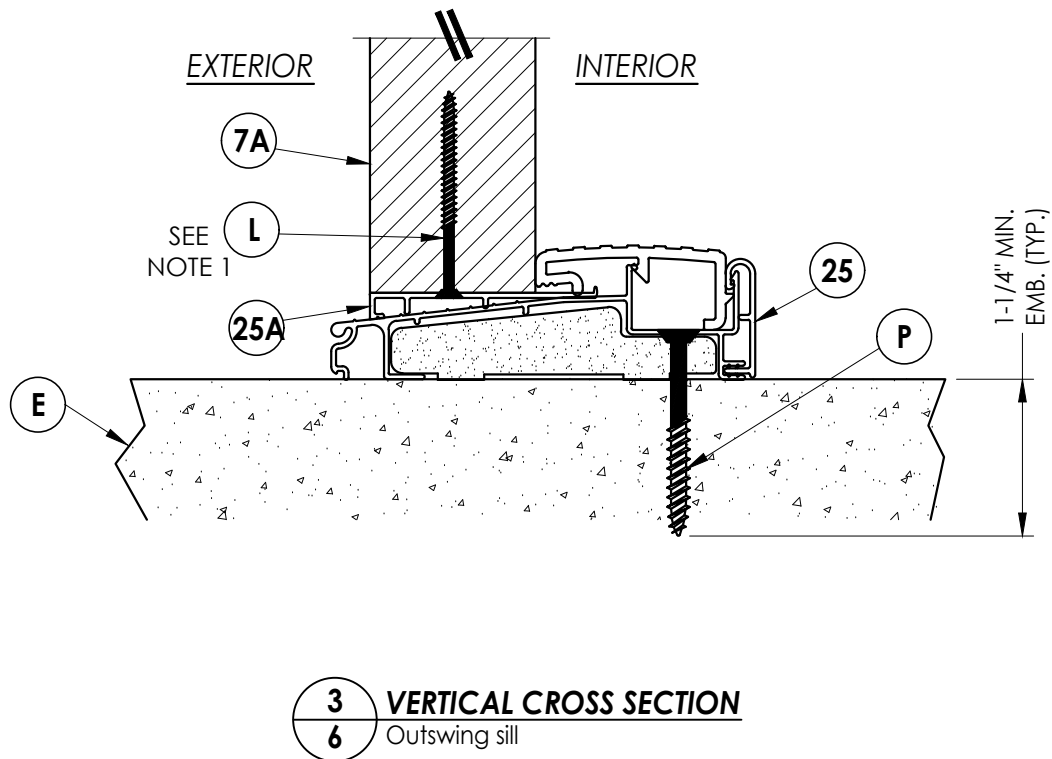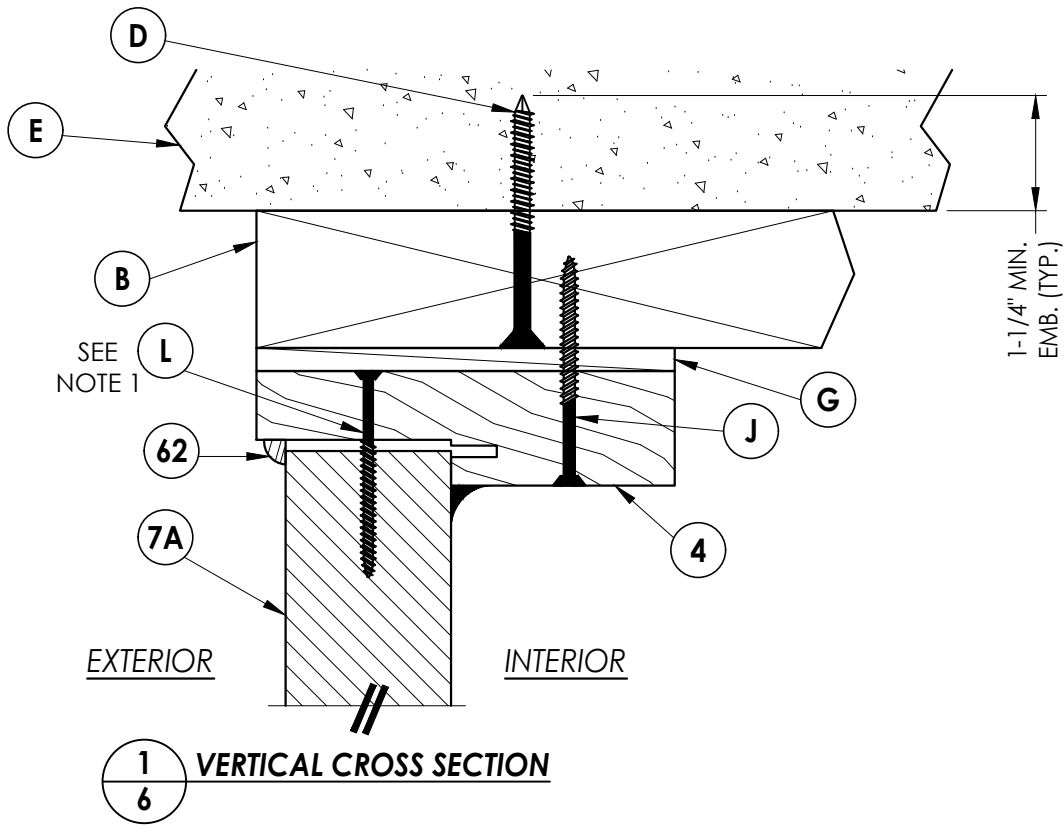

NOTE:

1. Screws thru head and sill jamb located 3" from each end and on centerline.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT:
STEVES AND SONS

PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS

NO.	DATE	REVISIONS
4	7/01/26	UPDATE TO 9TH ED. (2026) FBC
3	8/07/23	UPDATE TO 8TH ED. (2023) FBC
2	9/16/20	UPDATE TO 7TH ED. (2020) FBC
1	10/08/17	UPDATE TO 6TH ED. (2017) FBC


DATE: 7/18/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17901.12
SHEET 6 OF 9

Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.11-15.dwg

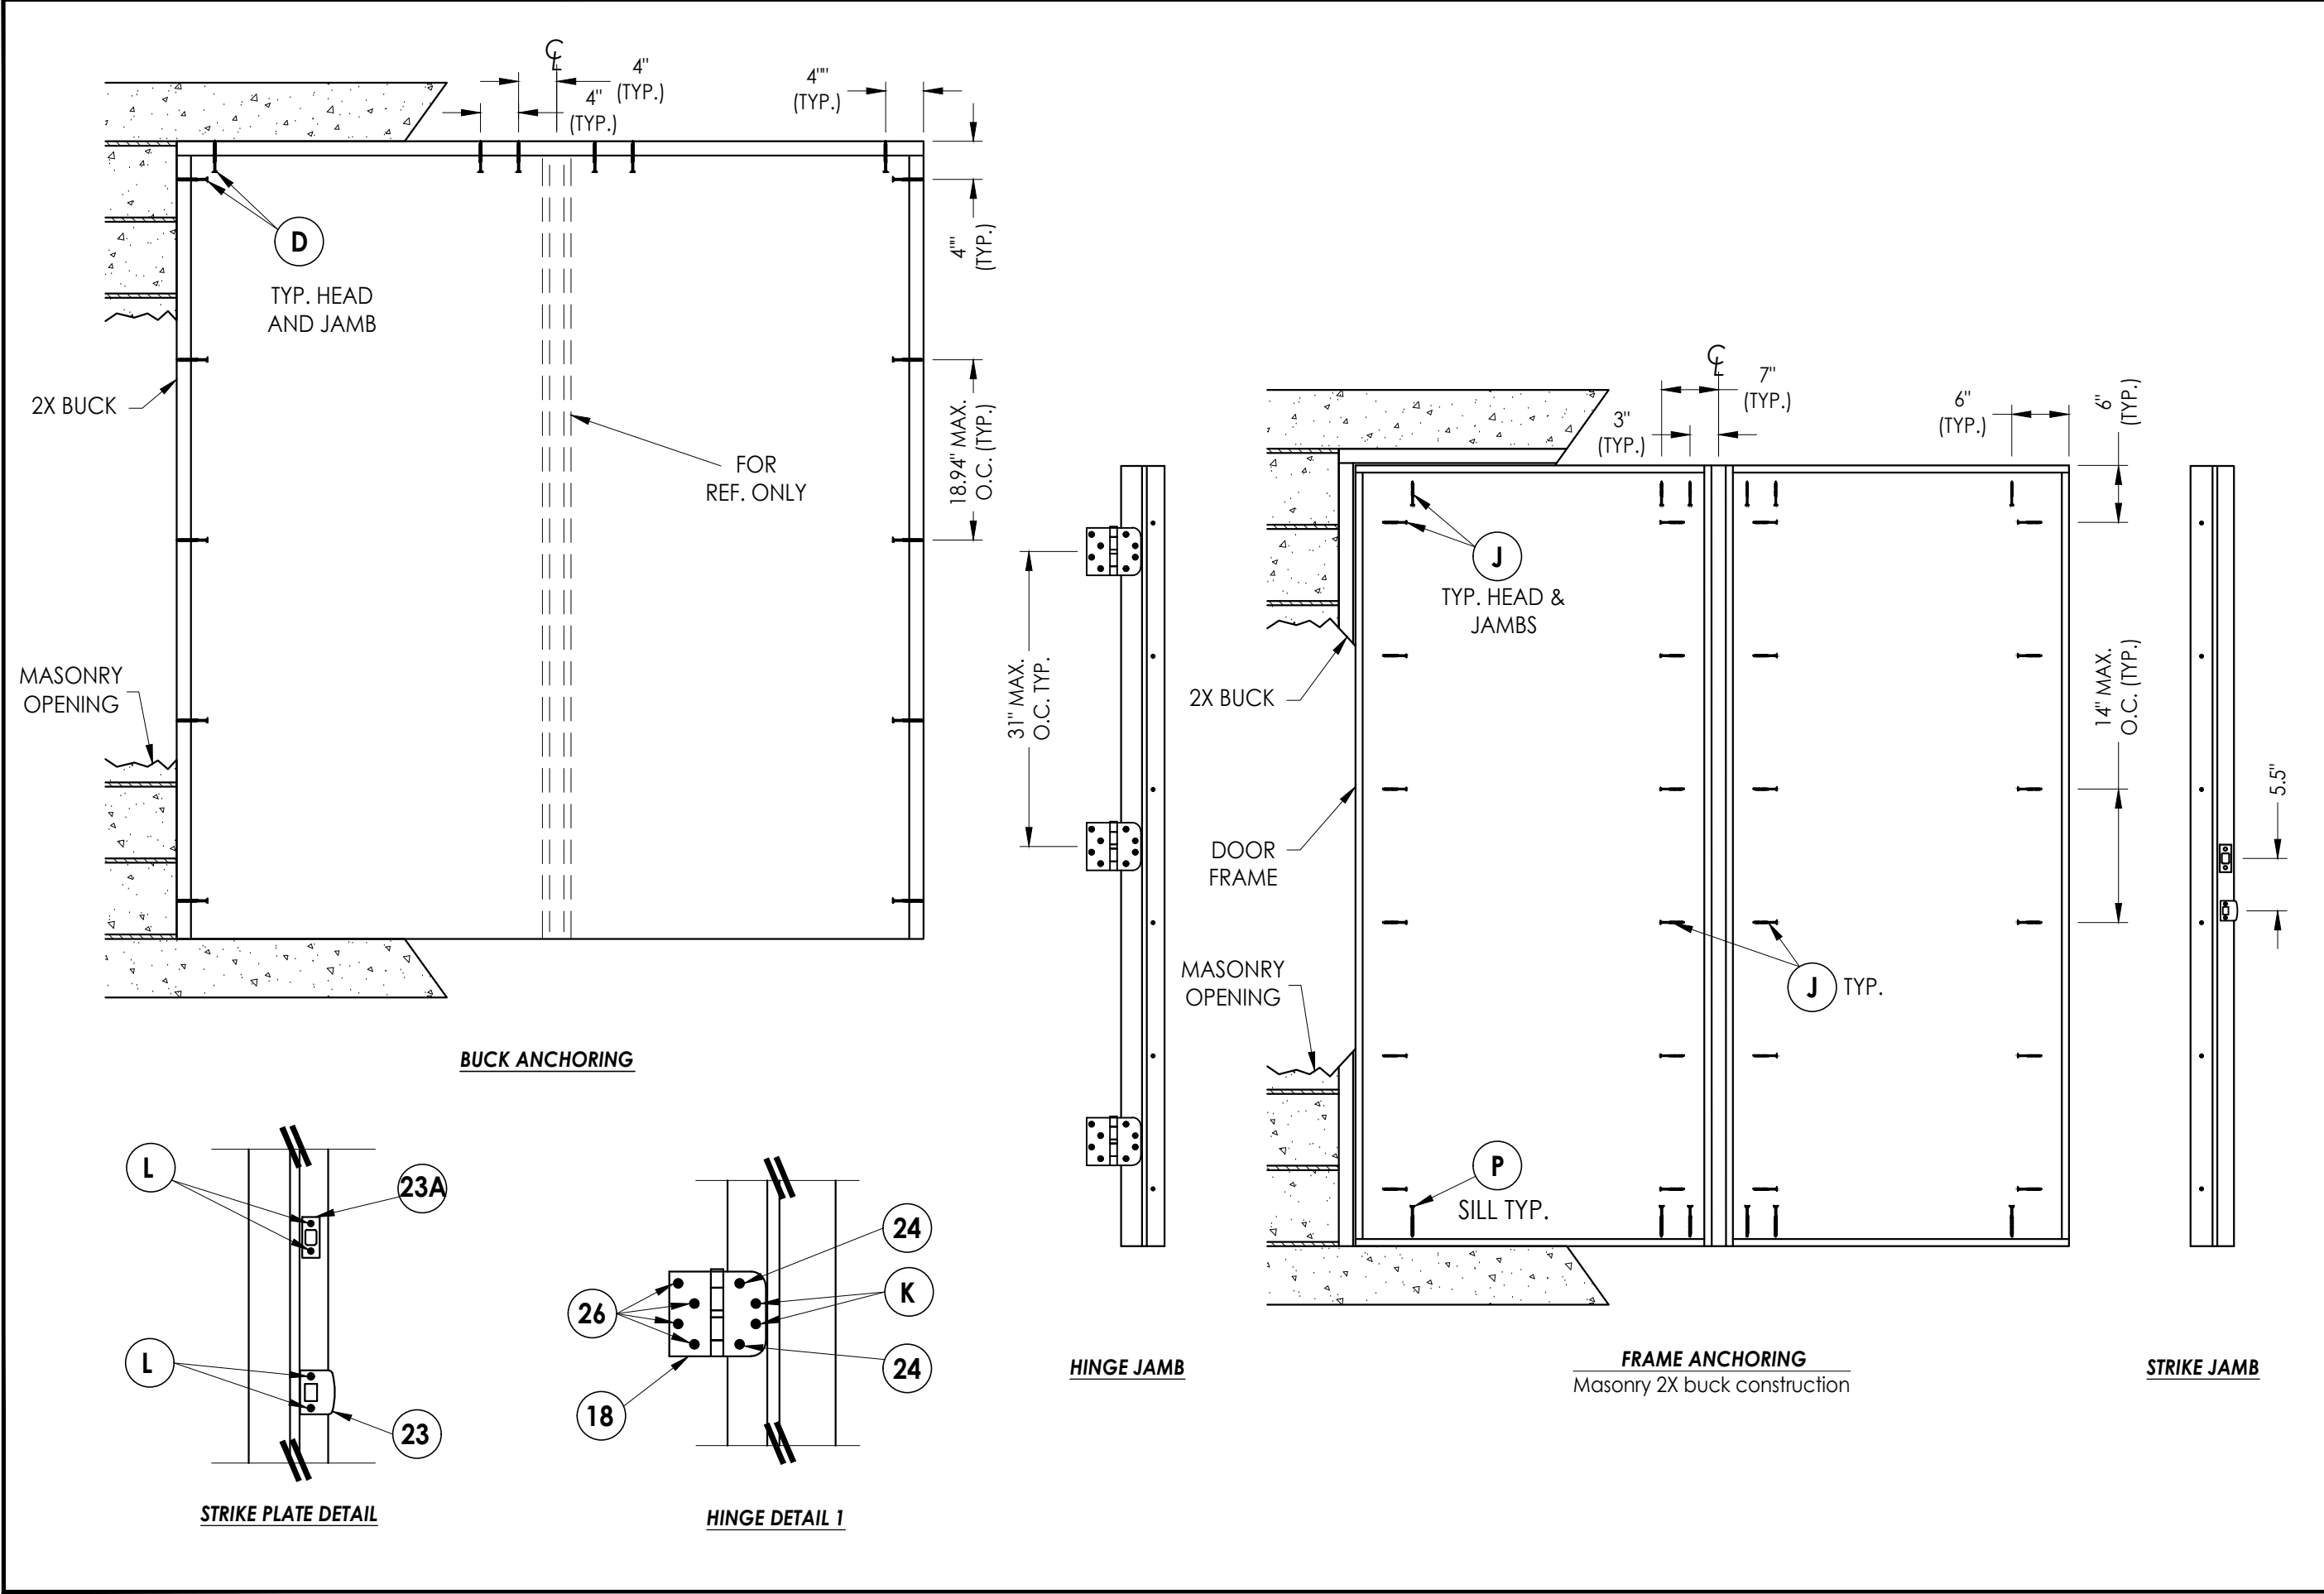


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: STEVES AND SONS				PART OR ASSEMBLY: BUCK AND FRAME ANCHORING 2X BUCK MASONRY CONSTRUCTION			
4	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	LFS	LFS	BY
3	8/07/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	LFS	JK	BY
2	9/16/20	UPDATE TO 7TH ED. (2020)	FBC	LFS	JK	BY	BY
1	10/08/17	UPDATE TO 6TH ED. (2017)	FBC	JK	BY	BY	BY
NO.				DATE			
				REVISIONS			
DATE: 7/18/15							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-17901.12							
SHEET 7 OF 9							


Z:\2023 FBC Drawings\Steves & Sons\FL-17901 R6\FL-17901.11-15.dwg

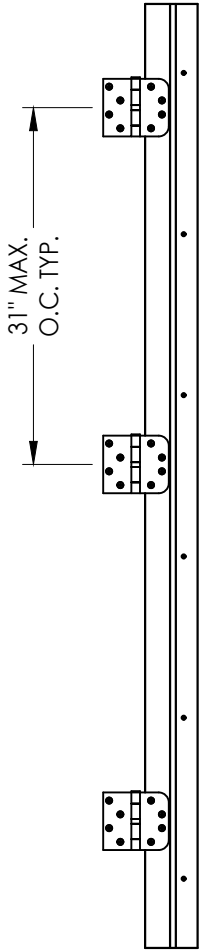


HINGE JAMB

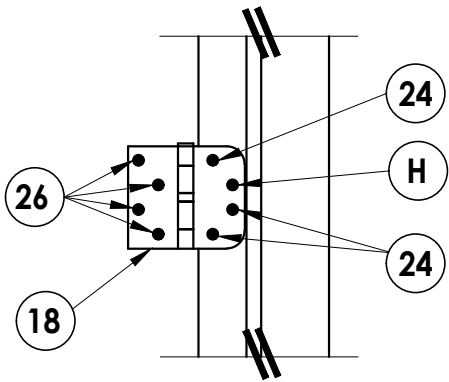


HINGE DETAIL

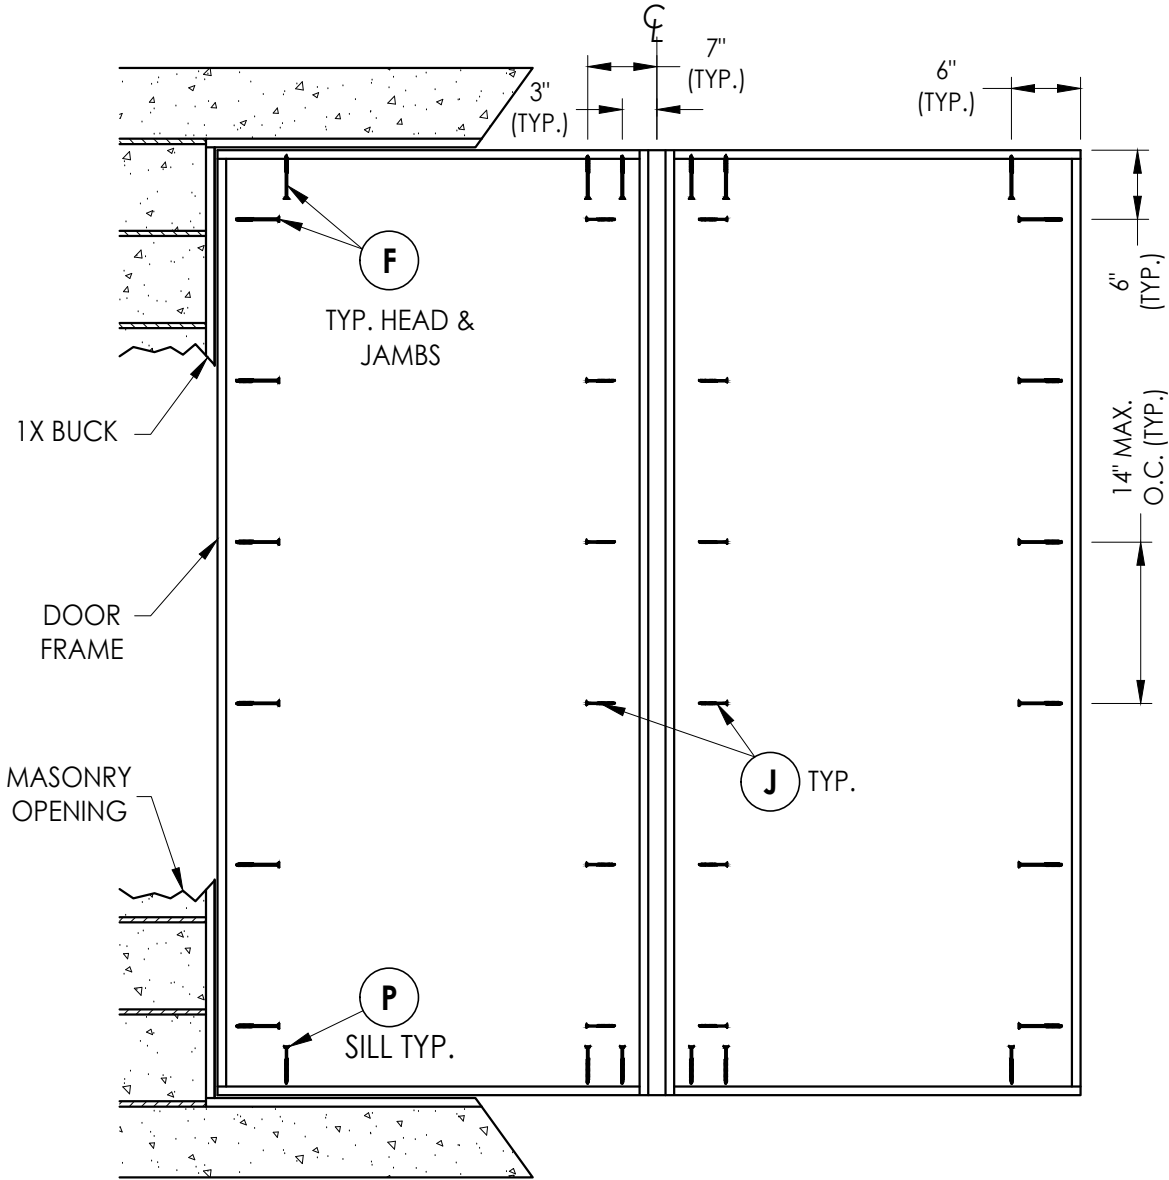

FRAME ANCHORING
Masonry 1X buck construction

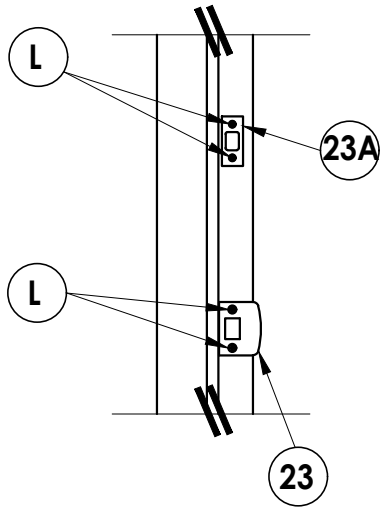

STRIKE PLATE DETAIL

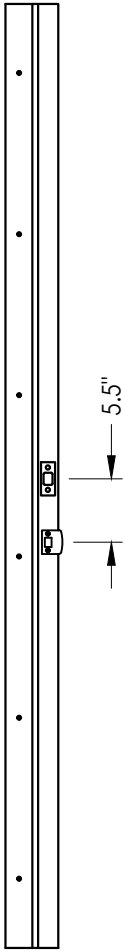

STRIKE JAMB

DATE: 7/18/15	
SCALE: N.T.S.	
DWG. BY: JK	
CHK. BY: LFS	
DRAWING NO.: FL-17901.12	
SHEET 8	OF 9


PRODUCT:	STEVES AND SONS
	PART OR ASSEMBLY:
	FRAME ANCHORING 1X BUCK MASONRY CONSTRUCTION

NO.	DATE	REVISIONS
4	7/01/26	UPDATE TO 9TH ED. (2026) FBC LFS
3	8/07/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	9/16/20	UPDATE TO 7TH ED. (2020) FBC LFS
1	10/08/17	UPDATE TO 6TH ED. (2017) FBC JK
		BY

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

**BUILDING CONSULTANTS, INC.**
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	WOOD
D	1/4" X 2-3/4" DeWALT PFH CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" ITW PFH CONCRETE SCREW	STEEL
G	MAX. 1/4" SHIM SPACE	WOOD
H	1/4" X 3-1/4" ITW PFH CONCRETE SCREW	STEEL
J	#10 X 2-1/2" PFH WS (1-1/8" MIN. EMBEDMENT)	STEEL
K	#9 X 2" PFH WS	STEEL
L	#8 X 2-1/2" PFH WS	STEEL
P	1/4" X 2-1/4" ITW PFH CONCRETE SCREW	STEEL
1	SIDELITE JAMB - FINGER-JOINT PINE - SG >= 0.42	WOOD
2	STRIKE JAMB - FINGER-JOINT PINE - SG >= 0.42	WOOD
3	HINGE JAMB - FINGER-JOINT PINE - SG >= 0.42	WOOD
4	HEAD - FINGER-JOINT PINE - SG >= 0.42	WOOD
5	INSWING THRESHOLD ALUMINUM W/ COMPOSITE SUBSTRATE	ALUM/COMP.
6	DOOR BOTTOM SWEEP	PVC
7	DOOR PANEL - SEE DOOR PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
7A	SIDELITE PANEL - SEE SIDELITE PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-
12	WEATHER STRIP QEBD650 Q-LON	-
18	4" HINGE	STEEL
21	KWIKSET LOCK -SERIES 200 PASSAGE	STEEL
22	KWIKSET DEADBOLT -SERIES 600	STEEL
23	STRIKE PLATE	STEEL
23A	DEADBOLT STRIKE	STEEL
24	#9 X 5/8" PFH WS	STEEL
25	OUTSWING THRESHOLD ALUMINUM W/ COMPOSITE SUBSTRATE	ALUM./ COMP.
25A	SIDELITE SPACER -OUTSWING	PVC
26	#9 X 1" PFH WS	STEEL
30	LATCH AND HINGE STILE - SG >= 0.42	LVL/PVC
31	LOCK BLOCK	WOOD
33	TOP RAIL - POPLAR LVL & WPC COMBINATION	POPLAR/WPC
34	BOTTOM RAIL - POPLAR LVL & WPC COMBINATION	POPLAR/WPC
36	LITE OPENING STILE REINF. - SG>= 0.42	WOOD
39	FIBERGLASS SKIN 0.079" MIN. THICKNESS (Fy = 5,200 PSI MIN.)	FIBERGLASS
40	#8 X 1-1/2" PANHEAD SMS (LIGHT FRAME SCREW)	STEEL
43	FEMALE LITE FRAME	PC/ASA
44	MALE LITE FRAME	PC/ASA
45	HOT MELT SEALANT	BUTYL
46	INSULATING FOAM CORE	POLYURETHANE
47	SILICONE SEALANT	SILICONE
48	PL PREMIUM POLYURETHANE ADHESIVE	POLYURETHANE
52	SIDELITE SPACER - INSWING	PVC
62	QUARTER ROUND	WOOD
68	2X MULLION REINFORCEMENT - SG>= 0.42	WOOD

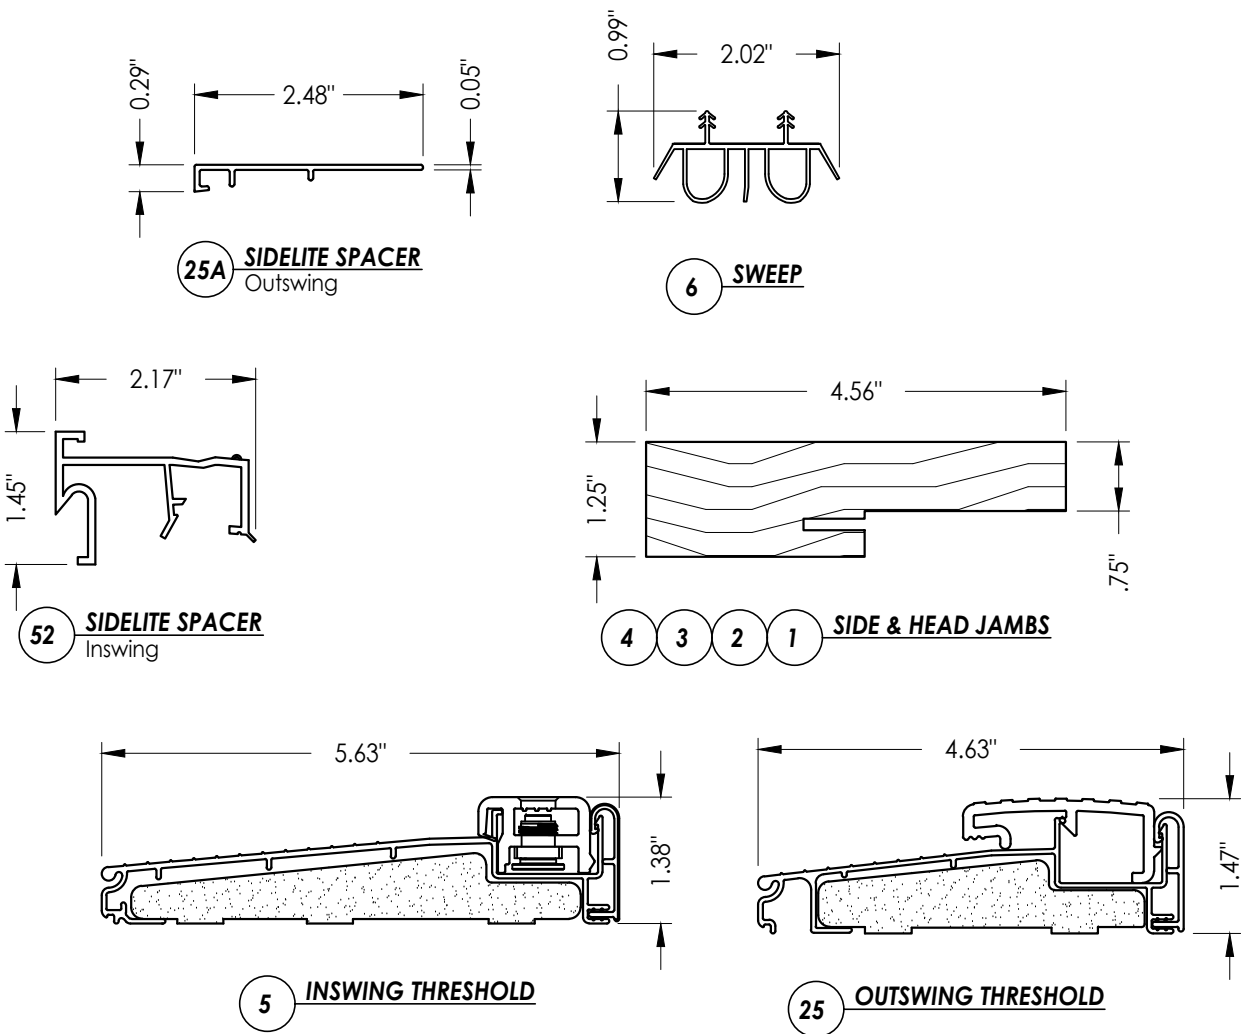

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

[illegible]