



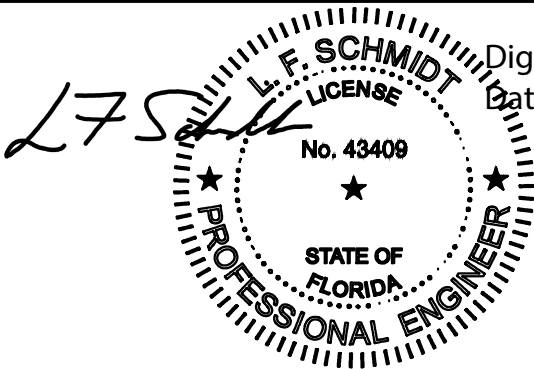

Series 3900-T
Aluminum Side Hinged Double Door
Inswing/Outswing
"IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. This product meets water infiltration requirements for "HVHZ".
8. Aluminum components, including fasteners, shall meet the requirements of FBC Section 2003.
9. Gaskets shall comply with FBC Section 2411.3.4.

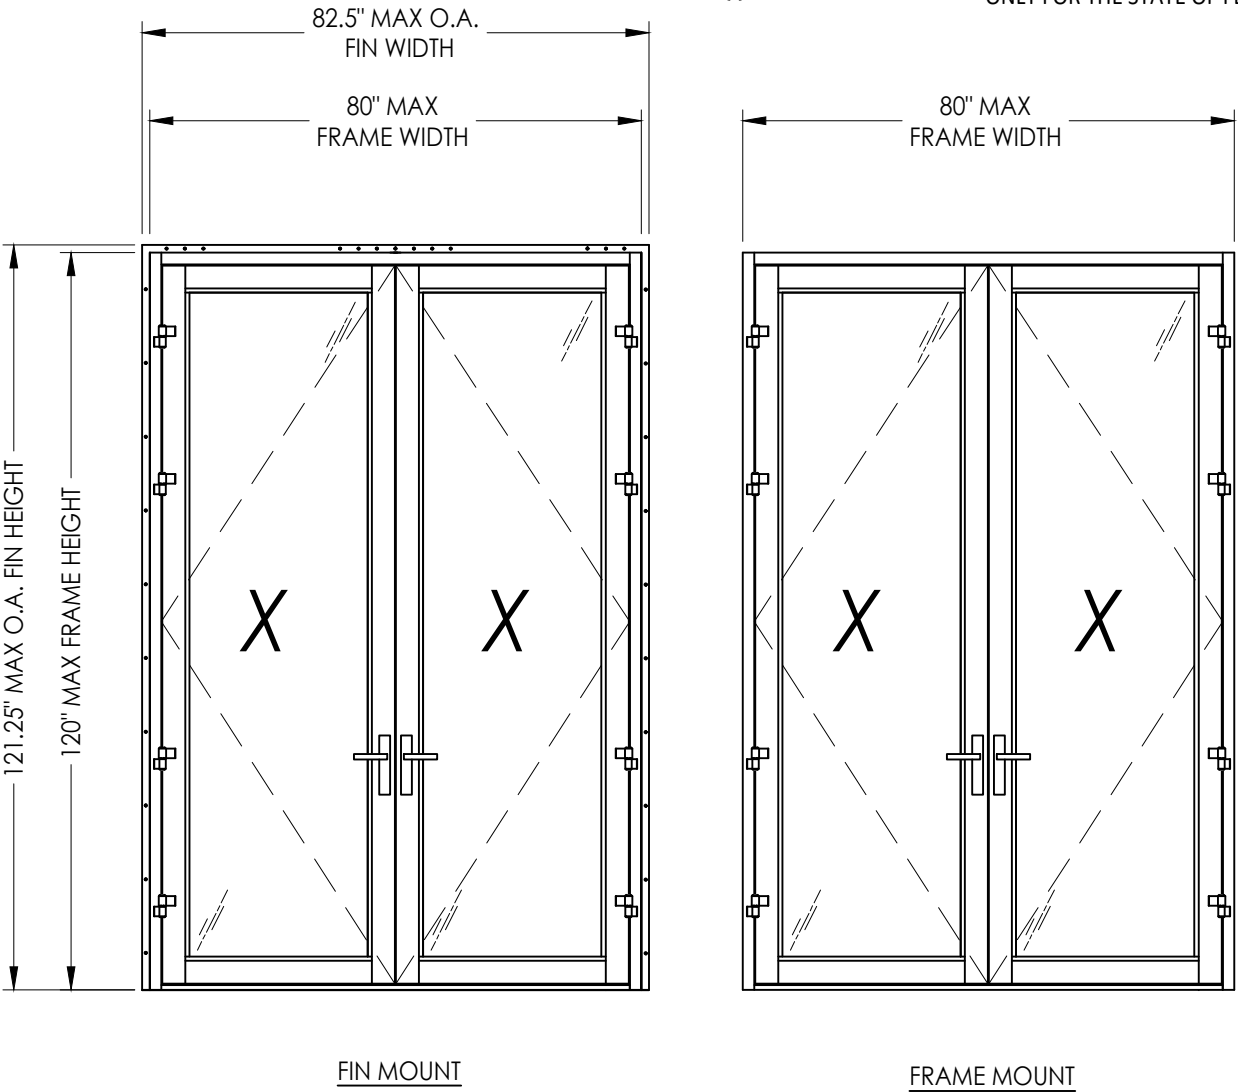

Digitally signed by Lyndon F Schmidt
Date: 2023.07.11 16:00:24 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: FLEETWOOD WINDOWS AND DOORS
PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES

NO.	DATE	REVISIONS			
		DATE	BY	JK	LFS
4	7/11/23	UPDATE TO 8TH ED. (2023) FBC	LFS		
3	8/11/20	UPDATE TO 7TH ED. (2020) FBC	DAC		
2	08/07/17	UPDATE TO 6TH ED. (2017) FBC	LFS		
1	11/2/15	REVISE DESIGN PRESSURES	JK		

DATE: 7/22/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17954.2
SHEET 1 OF 9

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures and general notes
2	Door panel details
3	Elevations
4	Horizontal cross sections
5	Vertical cross sections
6	Fin vertical and horizontal cross sections
7	Buck and frame anchoring
8	Glazing details
9	Bill of materials and components

SWING	MAX O.A. FIN DIMENSION	MAX O.A. FRAME DIMENSION	MAX DOOR D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
					POSITIVE	NEGATIVE
OUTSWING	82.5" X 121.25"	80.0" X 120.0"	29.0" X 108.0"	G1, G2, G3, G4	+55.0*	-55.0*
INSWING	82.5" X 121.25"	80.0" X 120.0"	29.0" X 108.0"	G1, G2, G3, G4	+55.0*	-65.0*

*Requires welded shoot bolts for Design Pressure > 50 PSF




116.875" MAX PANEL HEIGHT

14" D.L.O. HEIGHT


108" D.L.O. HEIGHT

116.875"

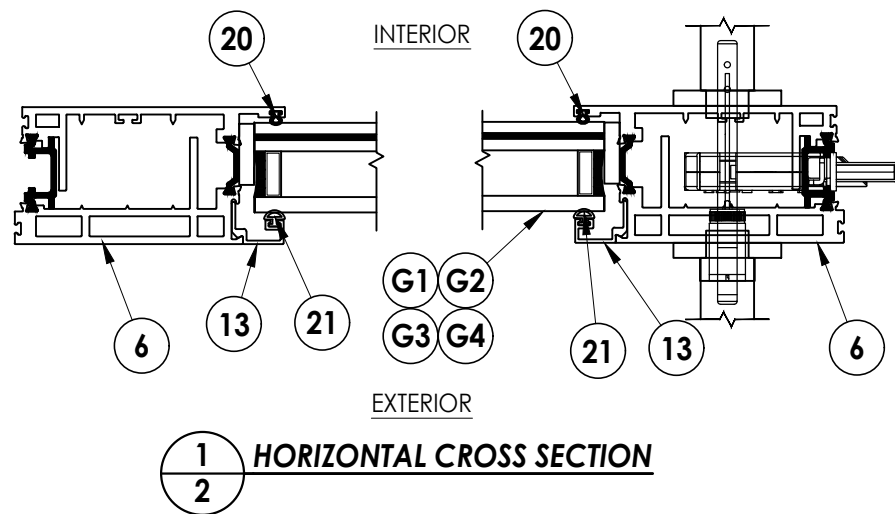


HORIZONTAL CROSS SECTION


HARDWARE TABLE	
MANUFACTURER	MODEL
TRUTH	MULTI-POINT LOCK: 5 POINT LOCK

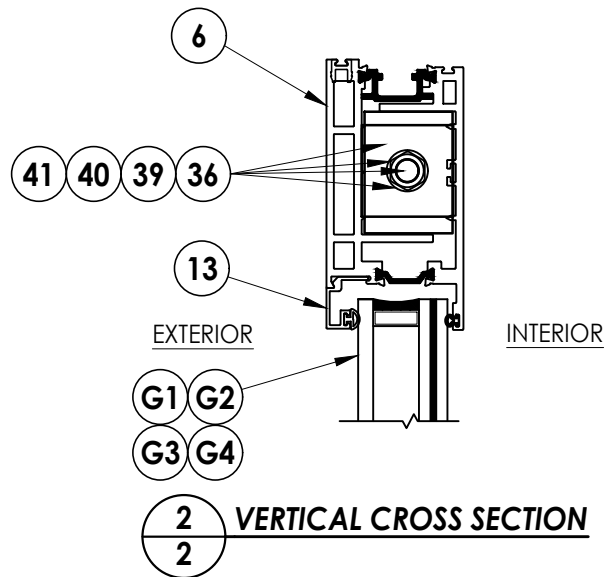

VERTICAL CROSS SECTION

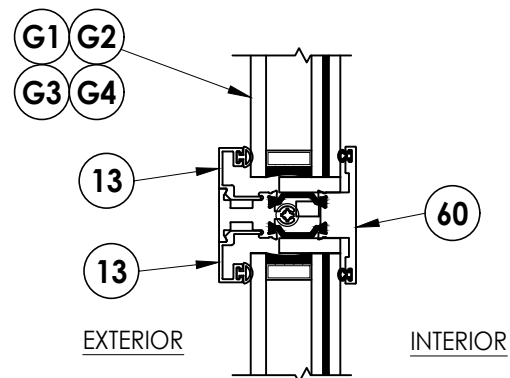

VERTICAL CROSS SECTION

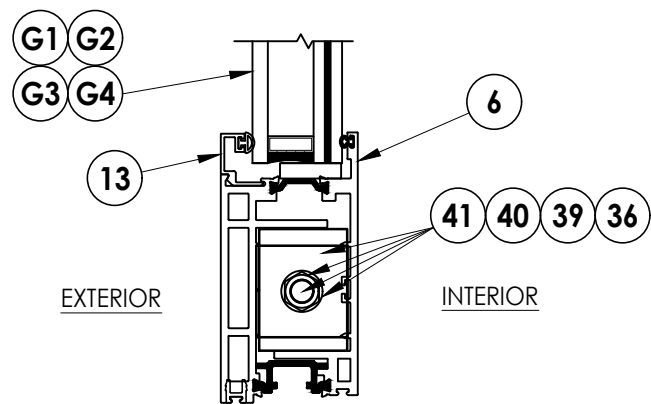

VERTICAL CROSS SECTION

4	7/11/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
3	8/11/20	UPDATE TO 7th ED. (2020)	FBC	DAC	
2	08/07/17	UPDATE TO 6TH ED. (2017)	FBC	LFS	
1	11/2/15	REVISE DESIGN PRESSURES		JK	
NO.	DATE			BY	
					REVISIONS

DATE: 7/22/15

SCALE: *N.T.S.*

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:


FL-17954.2

SHEET 2 OF 9


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2015 R.W. BUILDING CONSULTANTS INC.

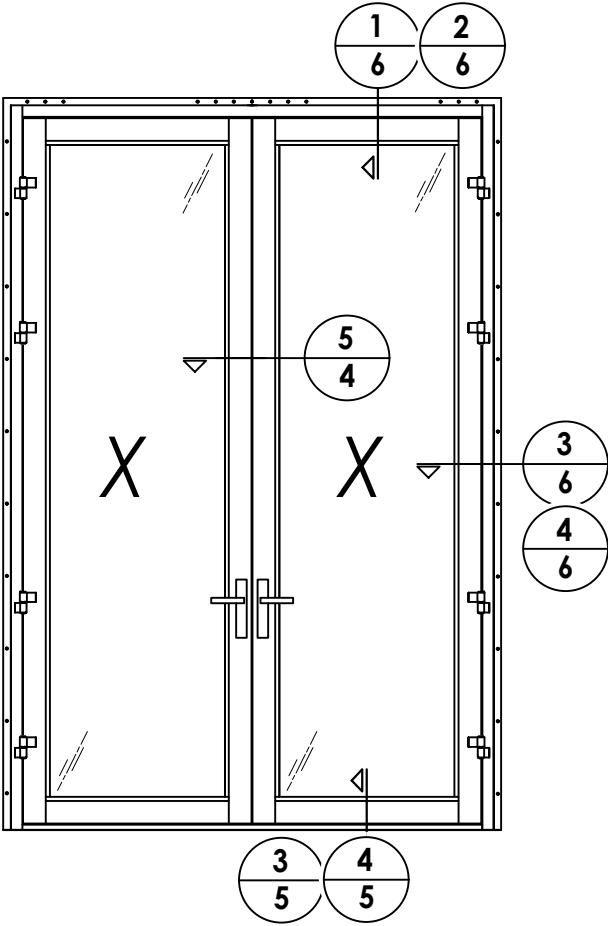

FIN MOUNT

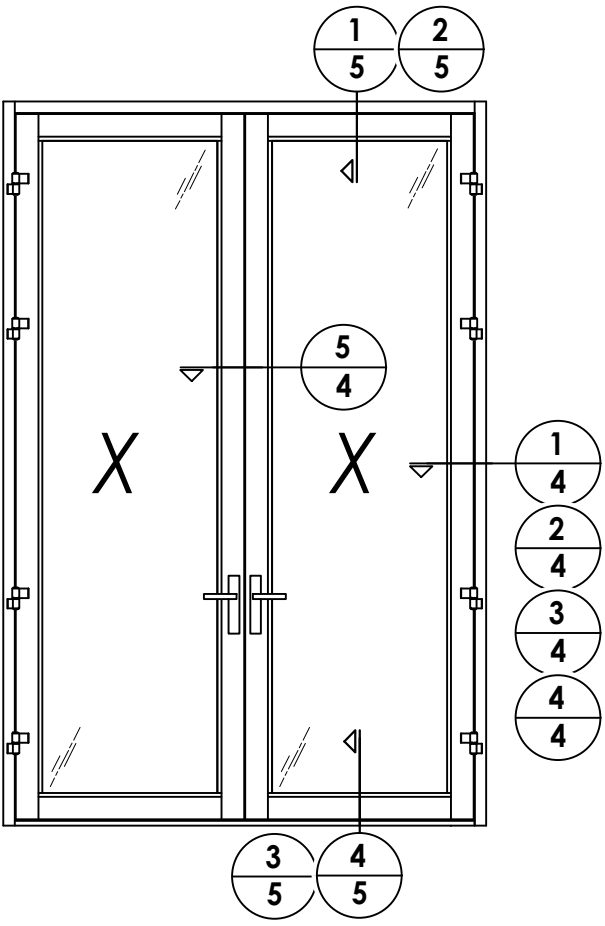

FRAME MOUNT

DATE: 7/22/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17954.2
SHEET 3 OF 9

4	7/11/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
3	8/11/20	UPDATE TO 7th ED. (2020)	FBC	DAC
2	08/07/17	UPDATE TO 6TH ED. (2017)	FBC	LFS
1	11/2/15	REVISE DESIGN PRESSURES		JK
NO.	DATE			BY






© 2015 R.W. BUILDING CONSULTANTS INC.

PRODUCT:	FLEETWOOD WINDOWS AND DOORS
PART OR ASSEMBLY:	ELEVATIONS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Fleetwood Windows & Doors\FL-17954 R8 Side Hinged Door\FL-17954.2.5.dwg

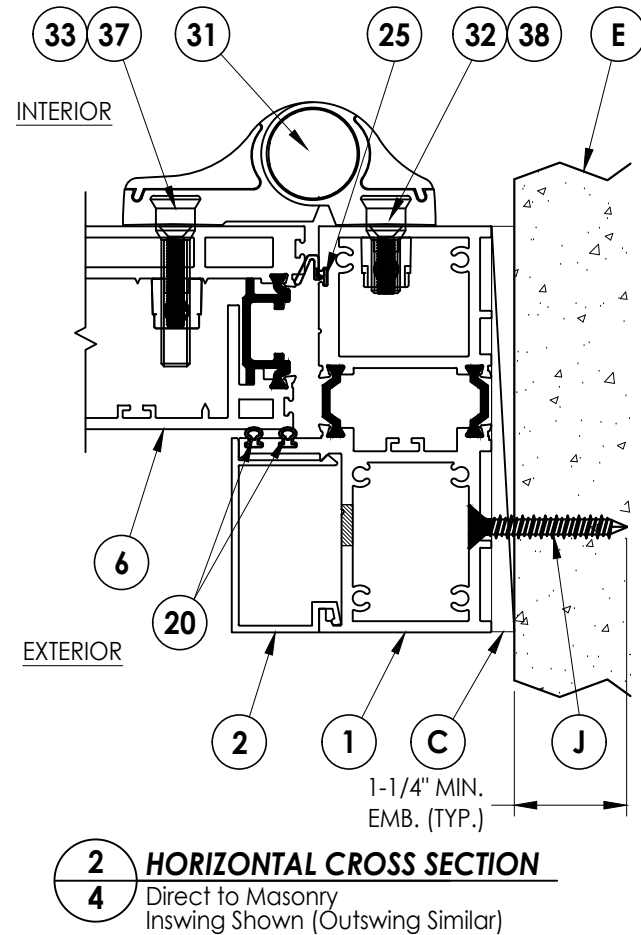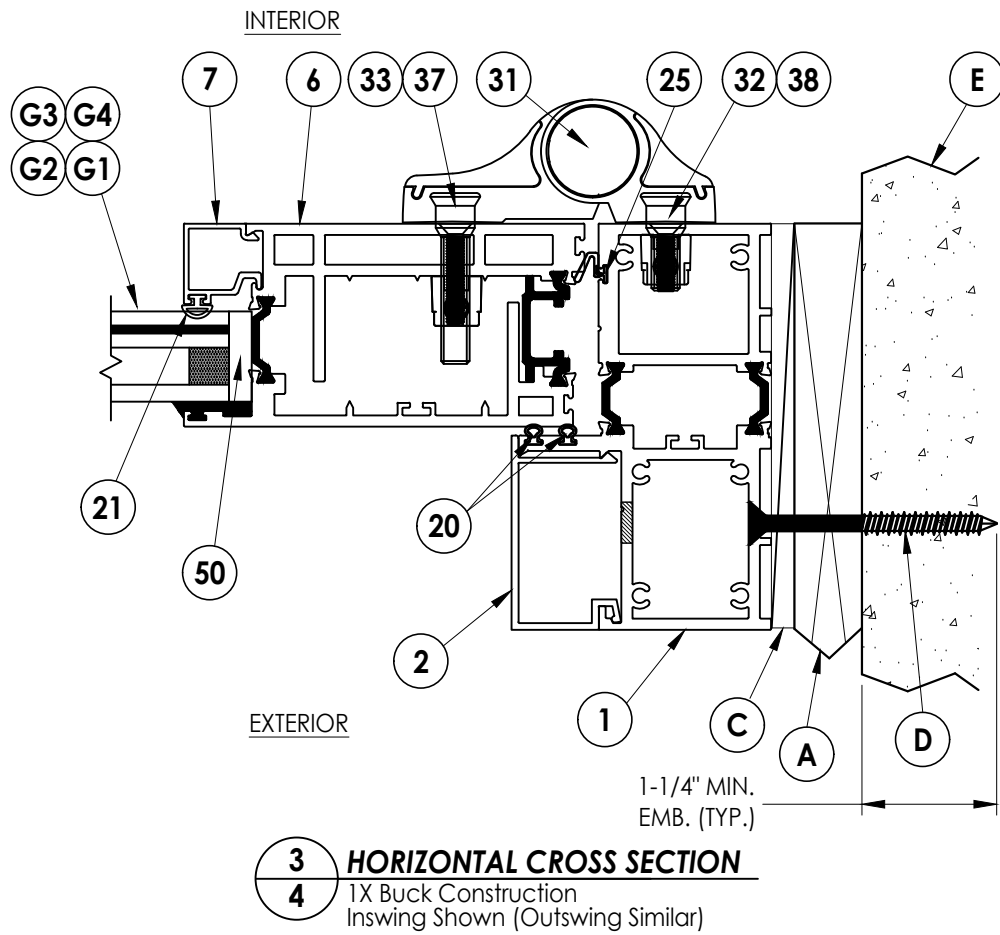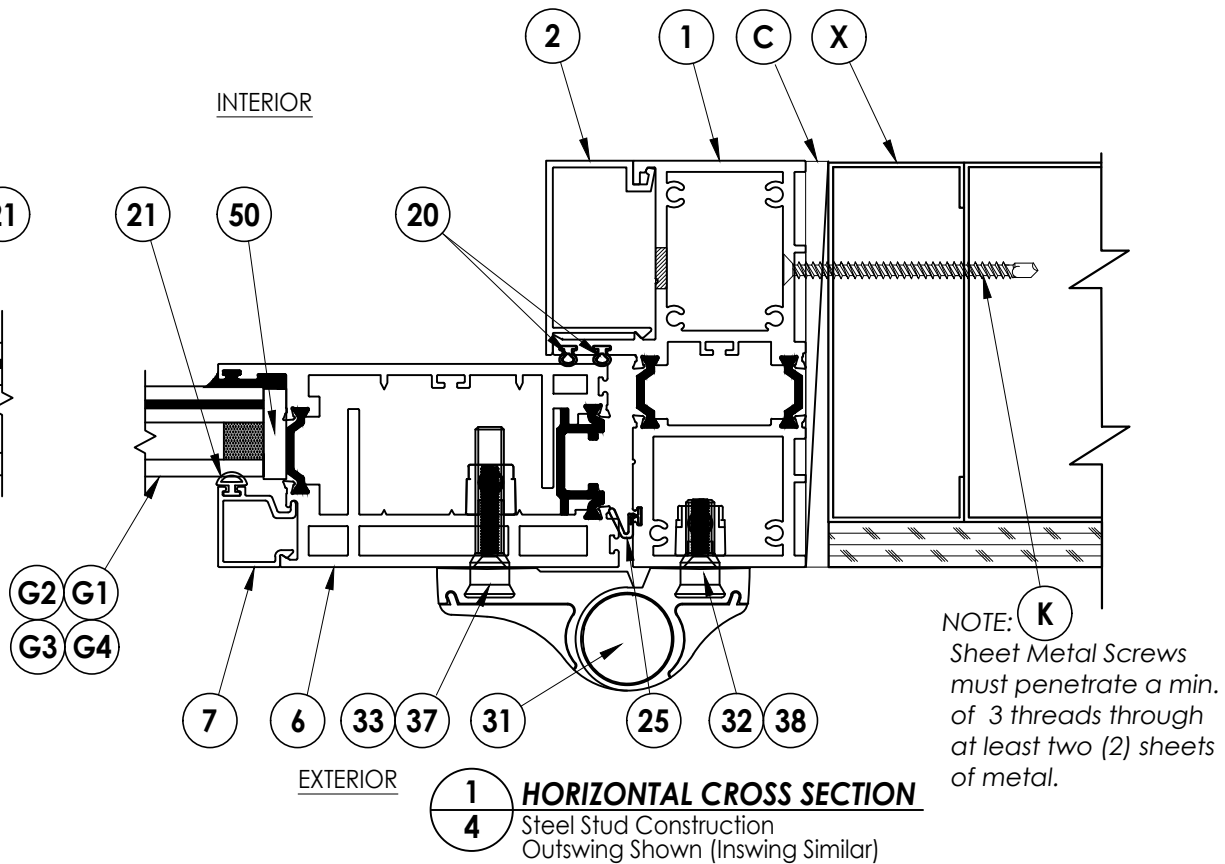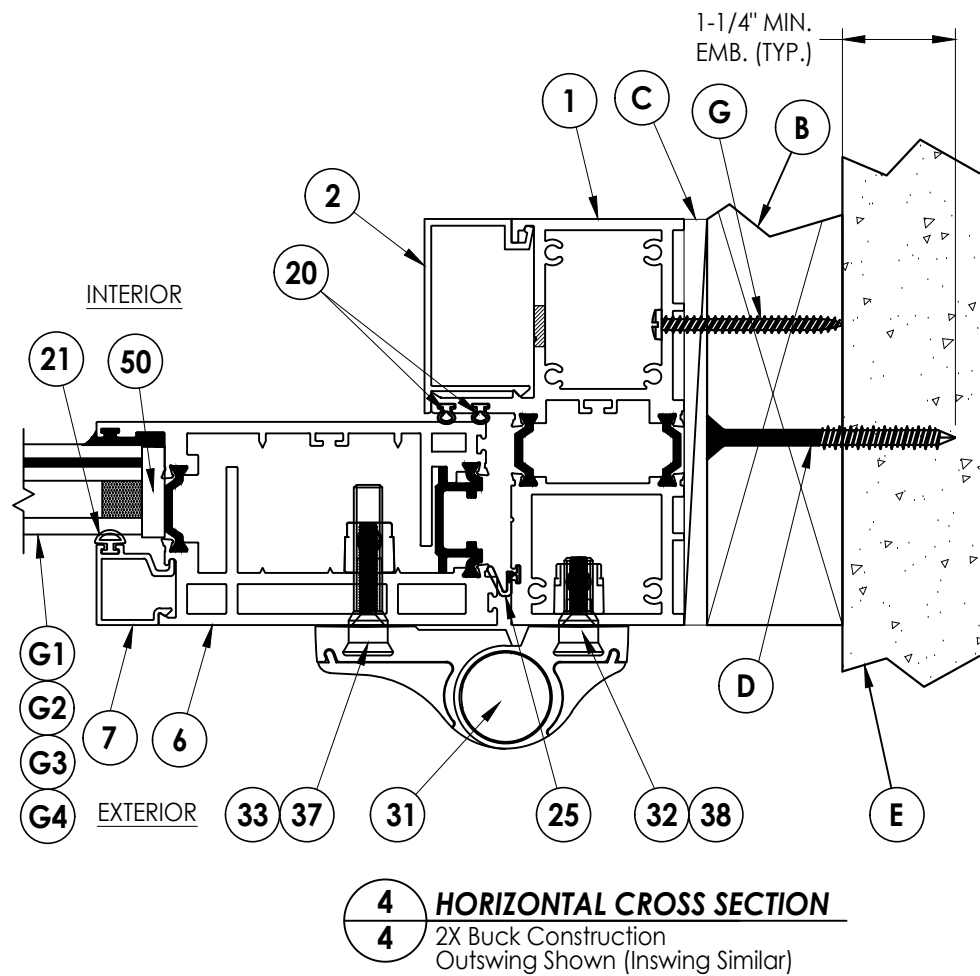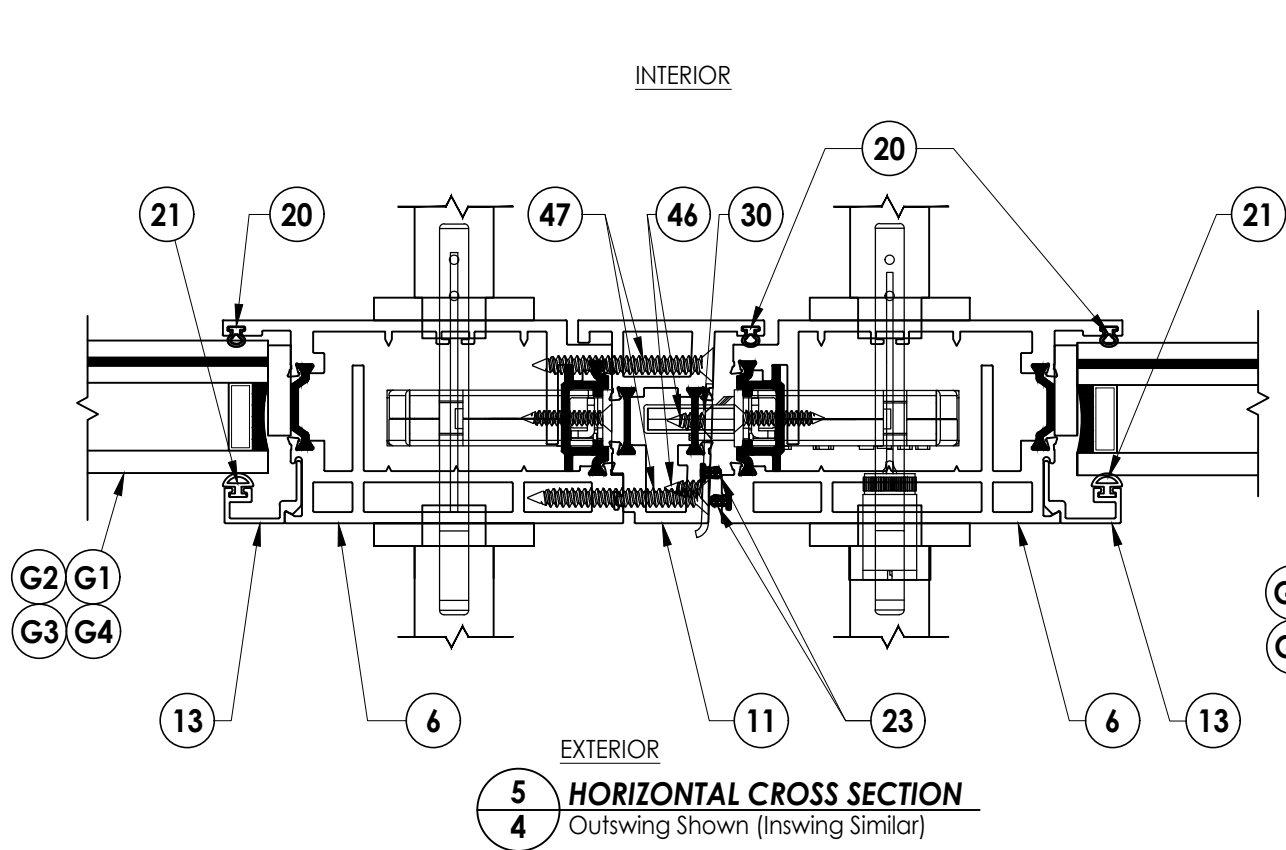

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: FLEETWOOD WINDOWS AND DOORS
PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

NO.	DATE	REVISIONS
4	7/11/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	8/11/20	UPDATE TO 7TH ED. (2020) FBC DAC
2	08/07/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	11/2/15	REVISE DESIGN PRESSURES JK

DATE: 7/22/15


SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:
FL-17954.2

SHEET 4 OF 9

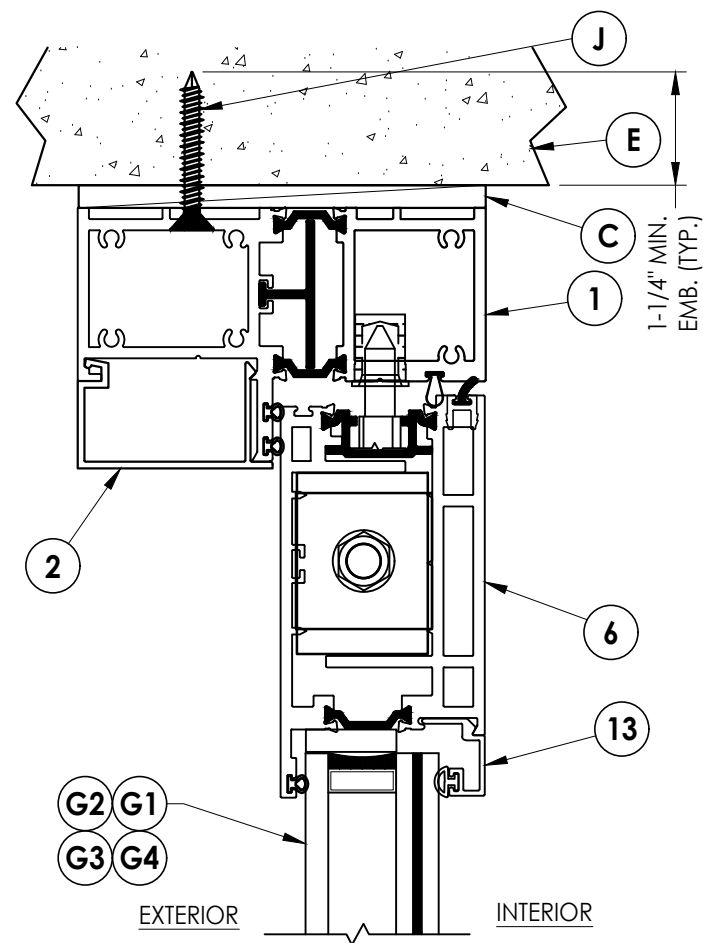


1 VERTICAL CROSS SECTION

5 Inswing Shown

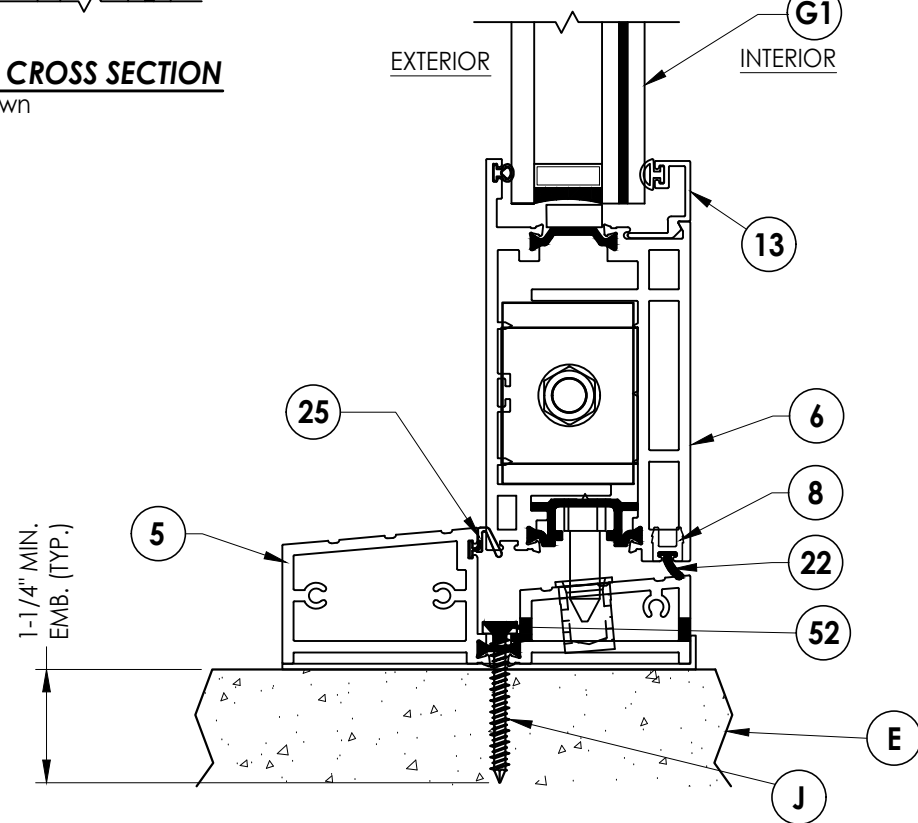


3 VERTICAL CROSS SECTION 5 Inswing Shown

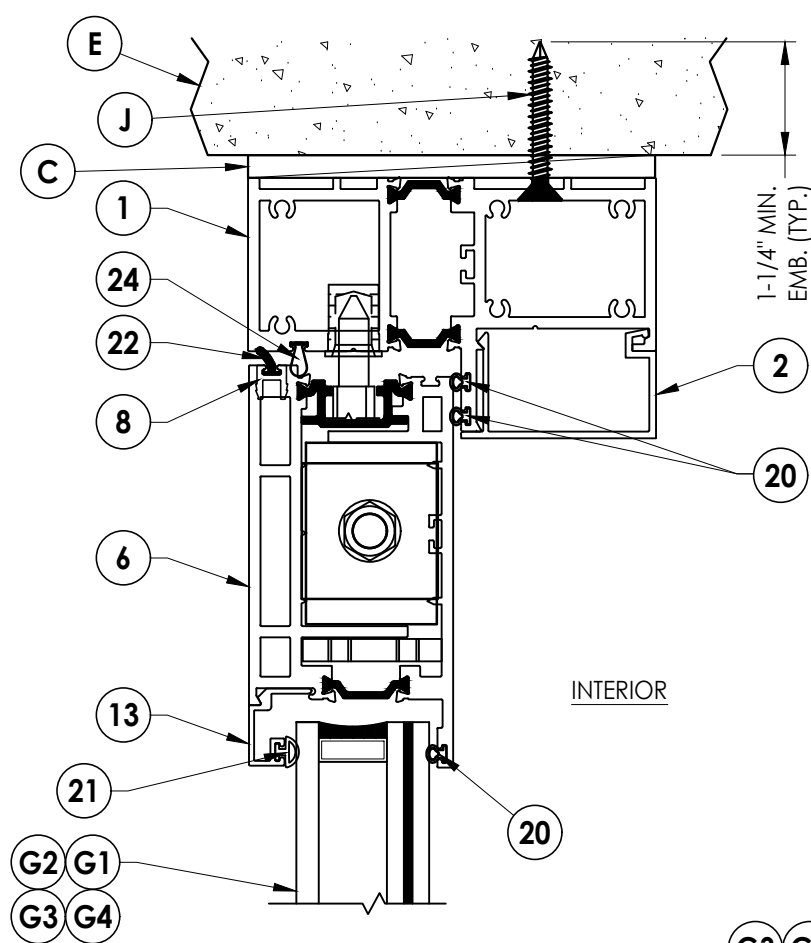

2 VERTICAL CROSS SECTION

5 Outswing Shown

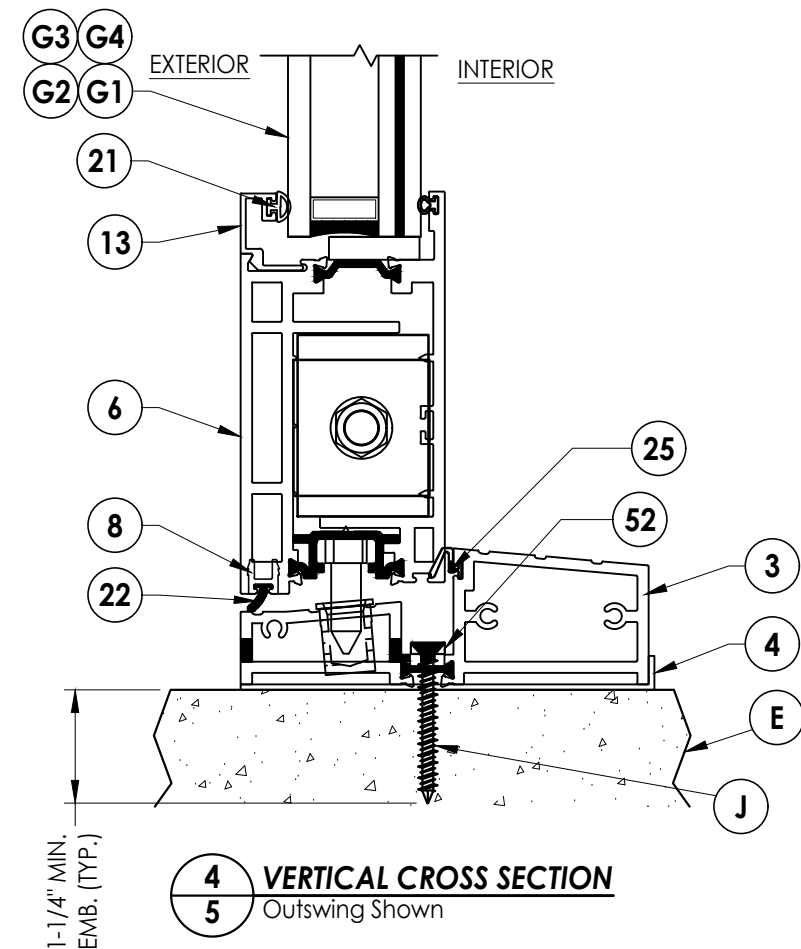

4 VERTICAL CROSS SECTION

5 Outswing Shown


[illegible]

FLEETWOOD WINDOWS AND DOORS	PART OR ASSEMBLY:	VERTICAL CROSS SECTIONS
-----------------------------	-------------------	-------------------------


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Fleetwood Windows & Doors\FL-17954 R8 Side Hinged Door\FL-17954.2.5.dwg

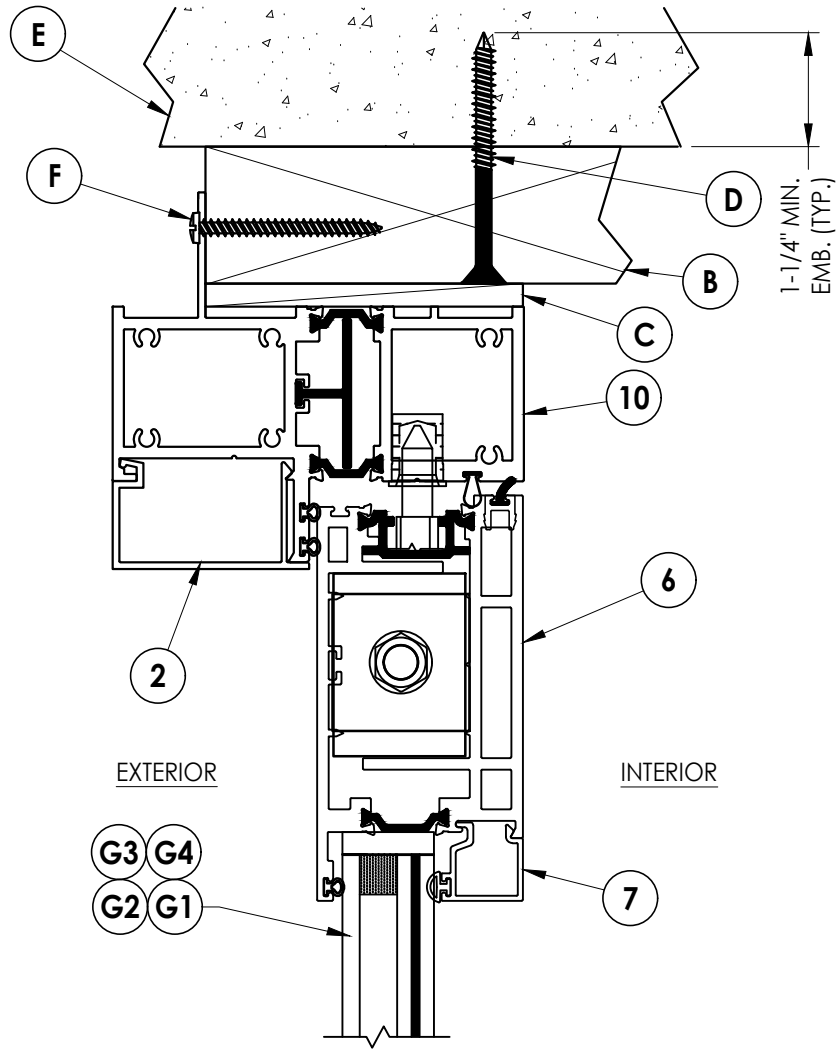


1 VERTICAL CROSS SECTION
6 Inswing shown

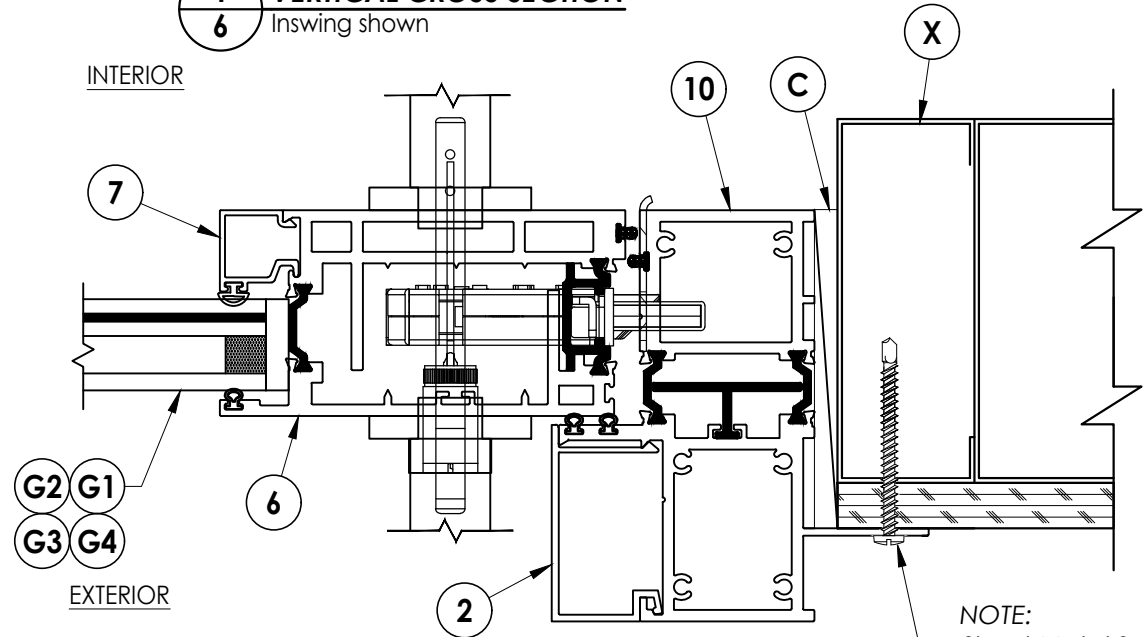

3 HORIZONTAL CROSS SECTION
6 Steel Stud Construction
Inswing shown

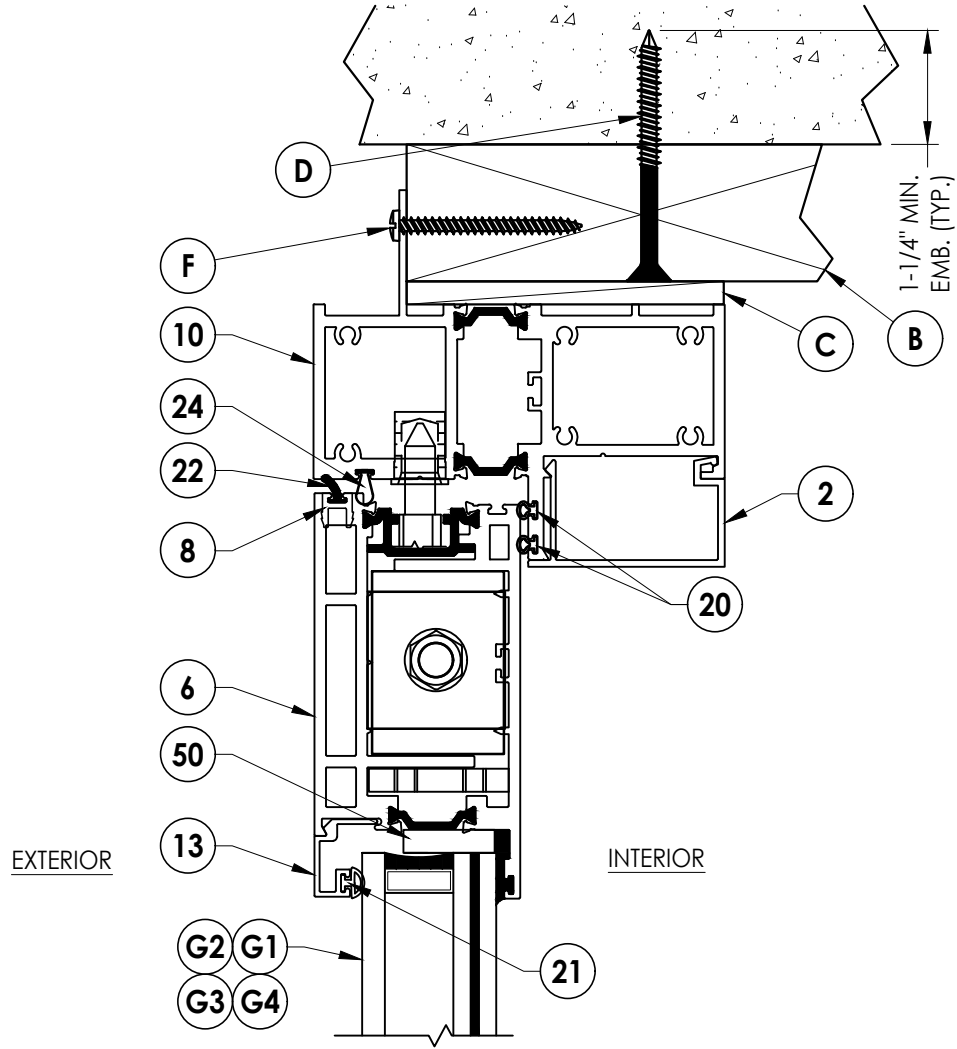

2 VERTICAL CROSS SECTION
6 Outswing shown

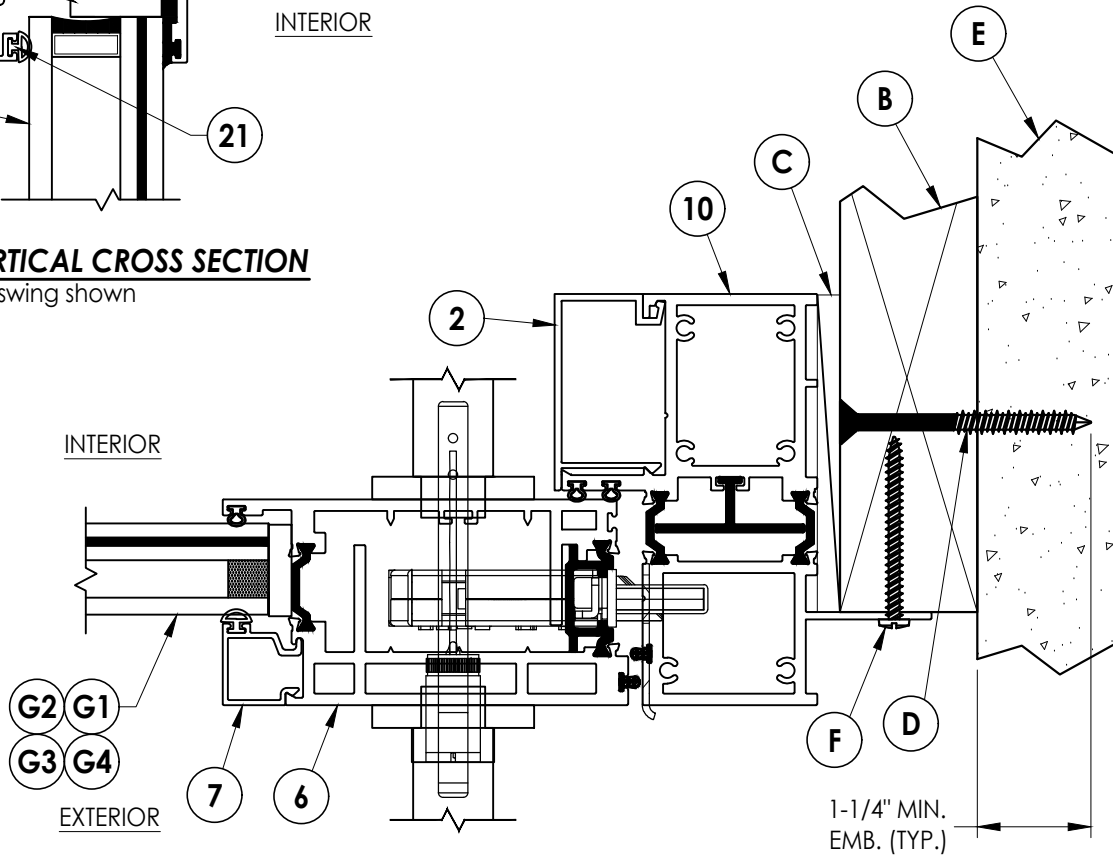

4 HORIZONTAL CROSS SECTION
6 2X Buck Construction
Outswing shown

NOTE:
Sheet Metal Screws must
penetrate a min. of 3 threads
through metal stud.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

FLEETWOOD WINDOWS AND DOORS

PART OR ASSEMBLY:
FIN HORIZONTAL AND VERTICAL
CROSS SECTIONS

NO.	DATE	REVISIONS
4	7/11/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	8/11/20	UPDATE TO 7th ED. (2020) FBC DAC
2	08/07/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	11/2/15	REVISE DESIGN PRESSURES JK

DATE: 7/22/15

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-17954.2

SHEET 6 OF 9



DATE: 7/22/15

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-17954.

SHEET 7 OF 5

PRODUCT:

PRODUCT:
FLEETWOOD WINDOWS AND DOORS

PART OR ASSEMBLY:

BUCK AND FRAME ANCHORING









REVISIONS

Documents Prepared By:

Lyndon F. Schmidt

Lyndon F. Schm

R²W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

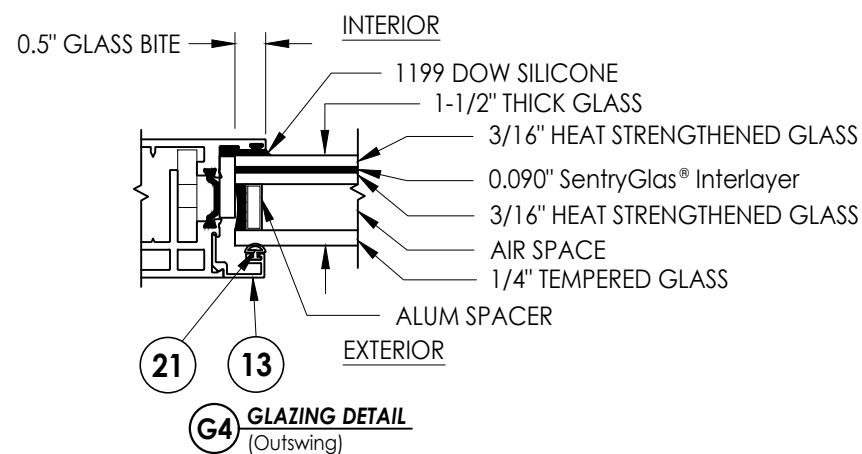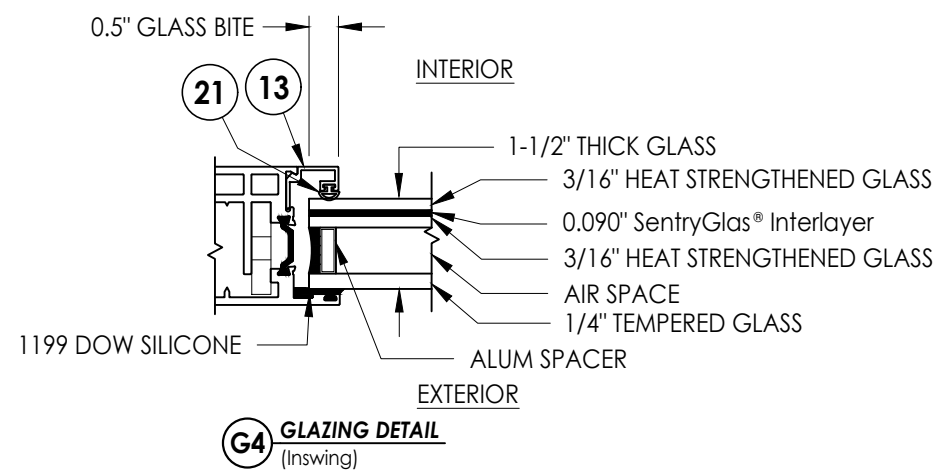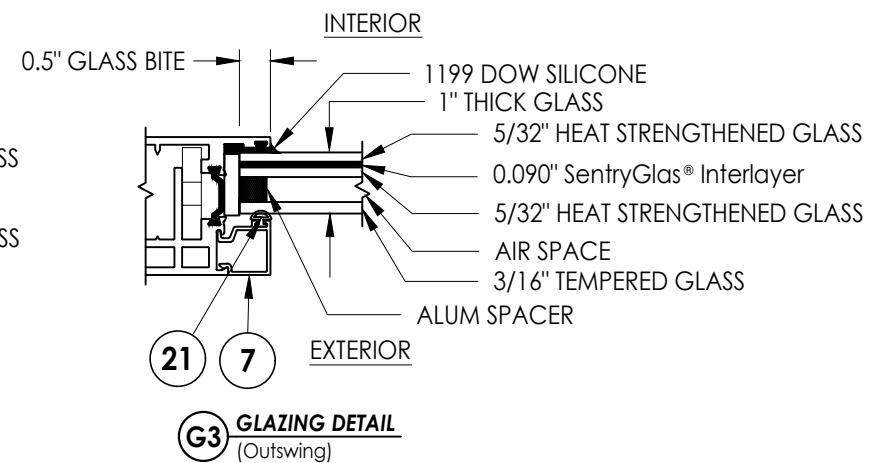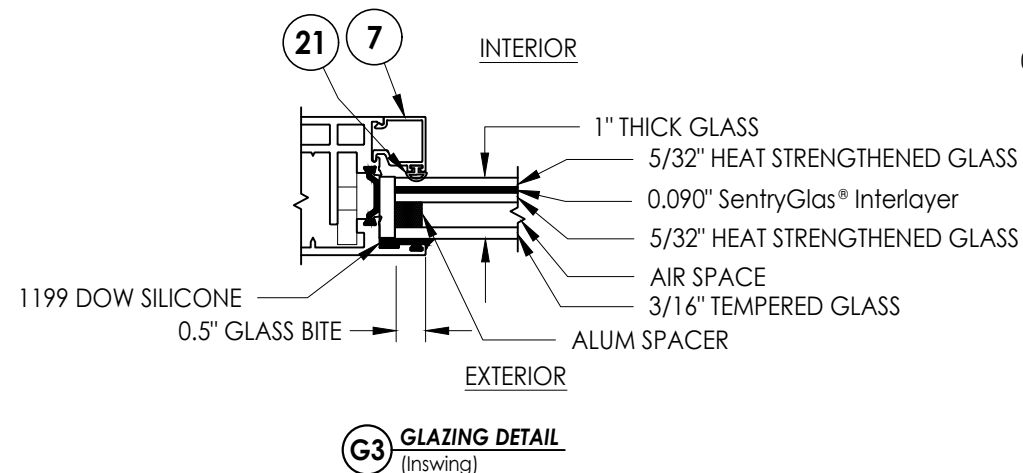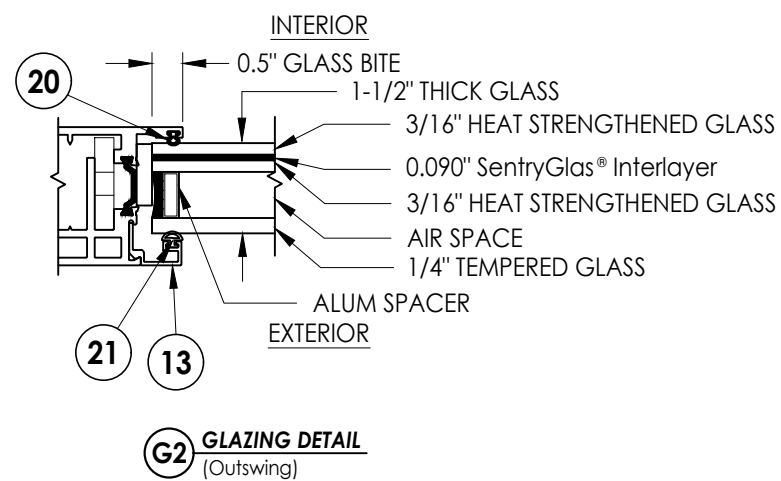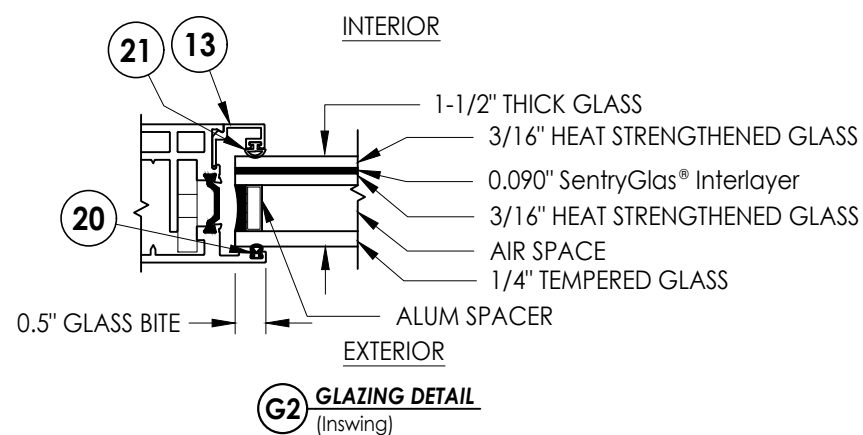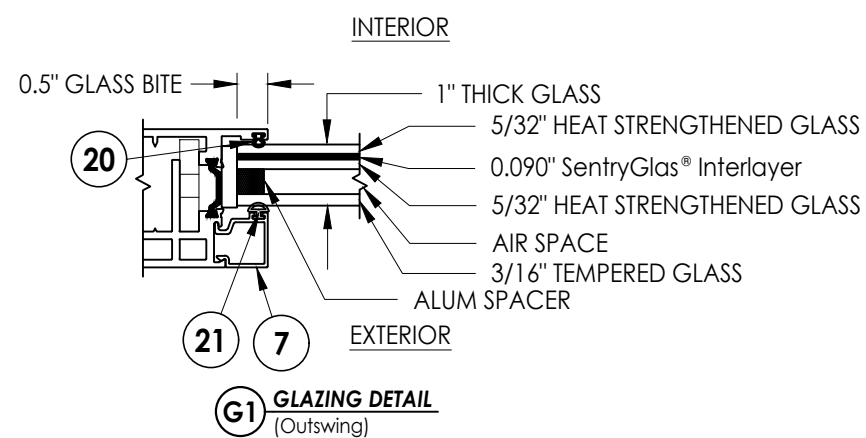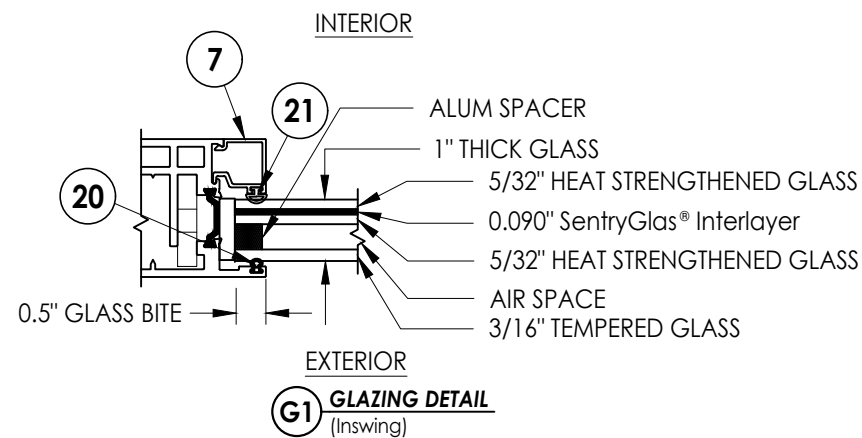

NOTE: GLAZING > 36" WIDE REQUIRES AT LEAST TWO (2) SETTING BLOCKS CONFORMING TO FBC SECTION 2411.3.3.1.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT: FLEETWOOD WINDOWS AND DOORS

[illegible]


DATE:	7/22/15
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-17954.2
SHEET	8 OF 9

R^{gW} BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


© 2015 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Fleetwood Windows & Doors\FL-17954 R8 Side Hinged Door\FL-17954.2.5.dwg


BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL - MANUFACTURER
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" DeWALT OR ITW PFH CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	#10 x 1-3/4" PPH WOOD SCREW (1-1/2" MIN. EMBEDMENT)	STEEL
G	#10 x 2" PPH WOOD SCREW (1-1/2" MIN. EMBEDMENT)	STEEL
J	1/4" X 2-1/4" ITW PFH CONCRETE SCREW	STEEL
K	#10 FH SELF-DRILLING SMS	STEEL
X	STEEL STUD Min. Thk .033" (ASTM A653 GRADE 33 Fy=33 Ksi Min, Fu=45 Ksi Min)	STEEL
1	FRAME	6063-T6 ALUM
2	FRAME SNAP-IN	6063-T6 ALUM
3	OUTSWING SILL	6063-T6 ALUM
4	SILL PAN	6063-T6 ALUM
5	INSWING SILL	6063-T6 ALUM
6	SASH	6063-T6 ALUM
7	1" GLASS STOP	6063-T6 ALUM
8	ATLANTIC SEAL CLIP	6063-T6 ALUM
10	FRAME (FIN)	6063-T6 ALUM
11	ASTRAGAL	6063-T6 ALUM
13	1.5" GLASS STOP	6063-T6 ALUM
20	BULB VINYL - MINI (EPDM 70 Durometer)	TREMCO, # TX20801E
21	BULB VINYL - LARGE (EPDM 70 Durometer)	TREMCO, # TX19638E
22	FOAM SEAL	EMESBURY, # 32390
23	Q-LON FOAM SEAL	SCHLEGEL CORP., # Q225T190
24	Q-LON FOAM SEAL	SCHLEGEL CORP., # Q375T190
25	Q-LON FOAM SEAL	SCHLEGEL CORP., # QEZ 376
31	BUTT HINGE	SAVIO
32	BACK UP KIT	SAVIO
33	HINGE BOLT, 8M X 48MM (FOR PANEL)	SAVIO
36	BACK UP PLATE FOR CORNER BLOCK	-
37	MACHINE SCREW NO 10-32, FHP 1.125"	STAINLESS STEEL
38	MACHINE SCREW NO 10-32, FHP .75"	STAINLESS STEEL
39	HEX HEAD CAP SCREW .375-16, 2.250"	STAINLESS STEEL
40	.375-16 SS. HEX NUT	STAINLESS STEEL
41	.375 SPLIT LOCK WASHER	STAINLESS STEEL
46	#10 X 1/2" PFH SMS	STAINLESS STEEL
47	#10 X 2" PFH SMS	STAINLESS STEEL
50	4" LONG SETTING BLOCK	-
56	LATCH AND DEADBOLT STRIKE PLATE	STAINLESS STEEL
57	STRIKE PLATE	STAINLESS STEEL
60	TDL BAR	6063-T6 ALUM

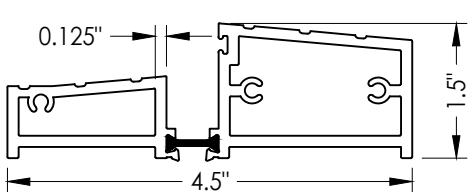


3 OUT-SWING SILL

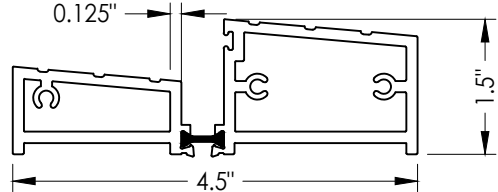


5 INSWING SILL




2 FRAME SNAP-IN

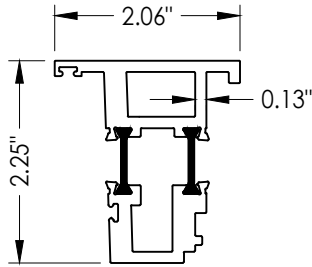


11 ASTRAGAL

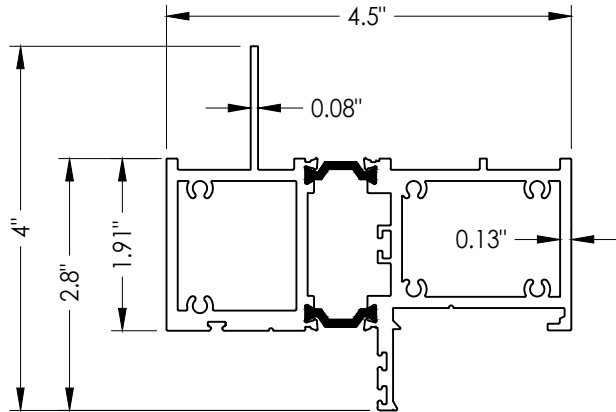


10 FRAME (FIN)

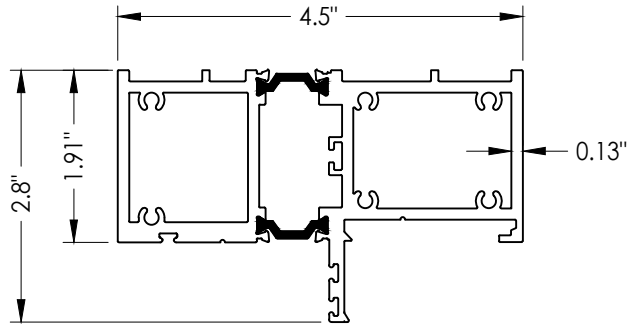


1 FRAME

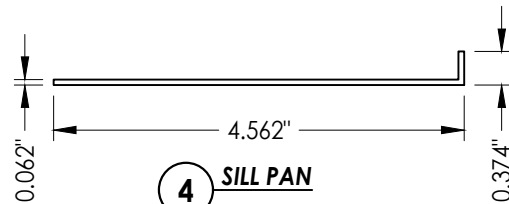


4 SILL PAN



7 1" GLASS STOP



13 1.5" GLASS STOP

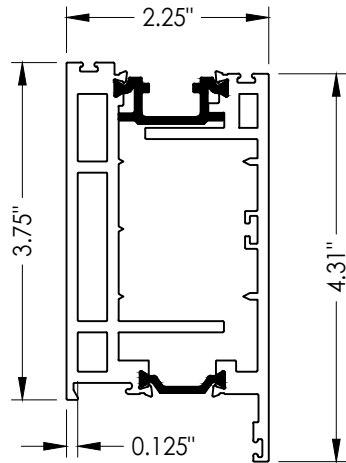

6 SASH

CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA CON+®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Documents Prepared By:

Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:

FLEETWOOD WINDOWS AND DOORS

R^W BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197

FBPE Registry No. 9813

PART OR ASSEMBLY:

BILL OF MATERIALS
AND COMPONENTS

DATE: 7/22/15

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-17954.2

SHEET 9 OF 9