

Series 3900-T

Aluminum Side Hinged Double Door


Inswing/Outswing

"IMPACT"

GENERAL NOTES


1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. This product meets water infiltration requirements for "HVHZ".
8. Aluminum components, including fasteners, shall meet the requirements of FBC Section 2003.
9. Gaskets shall comply with FBC Section 2411.3.4.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures and general notes
2	Door panel details
3	Elevations
4	Horizontal cross sections
5	Vertical cross sections
6	Fin vertical and horizontal cross sections
7	Buck and frame anchoring
8	Glazing details
9	Bill of materials and components

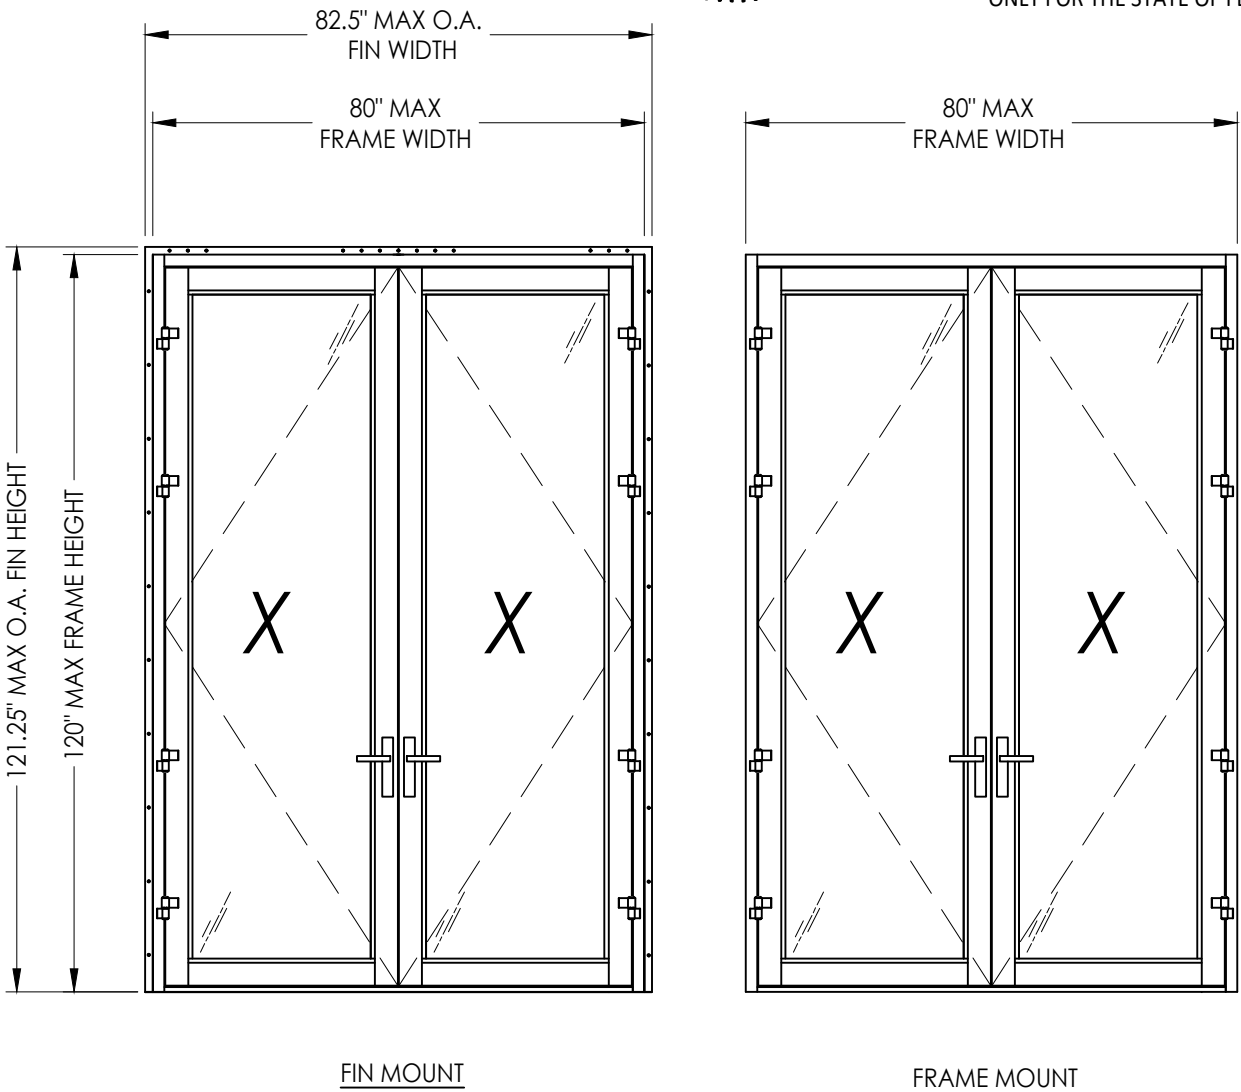

SWING	MAX O.A. FIN DIMENSION	MAX O.A. FRAME DIMENSION	MAX DOOR D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
					POSITIVE	NEGATIVE
OUTSWING	82.5" X 121.25"	80.0" X 120.0"	29.0" X 108.0"	G1, G2, G3, G4	+55.0*	-55.0*
INSWING	82.5" X 121.25"	80.0" X 120.0"	29.0" X 108.0"	G1, G2, G3, G4	+55.0*	-65.0*

*Requires welded shoot bolts for Design Pressure > 50 PSF

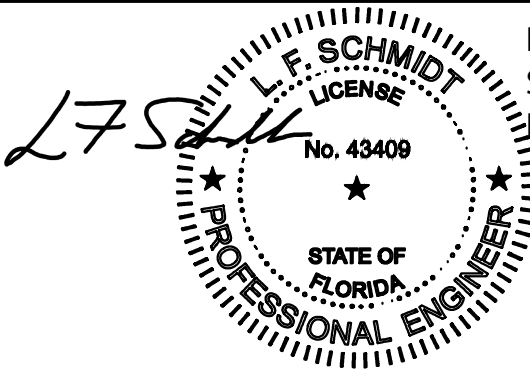

Digitally signed by Lyndon F Schmidt


Date: 2026.07.06 07:39:07 -04'00'

This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.


THIS PRODUCT APPROVAL IS VALID ONLY FOR THE STATE OF FLORIDA

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: FLEETWOOD WINDOWS AND DOORS		PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES	
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
4	7/11/23	UPDATE TO 8TH ED. (2023) FBC	LFS
3	8/11/20	UPDATE TO 7TH ED. (2020) FBC	DAC
2	08/07/17	UPDATE TO 6TH ED. (2017) FBC	LFS
1	11/2/15	REVISE DESIGN PRESSURES	JK
NO.	DATE		
REVISIONS			
DATE: 7/22/15			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-17954.2			
SHEET 1 OF 9			


Z:\2023 FBC Drawings\Fleetwood Windows & Doors\FL-17954 R8 Side Hinged Door\FL-17954.2 5.dwg

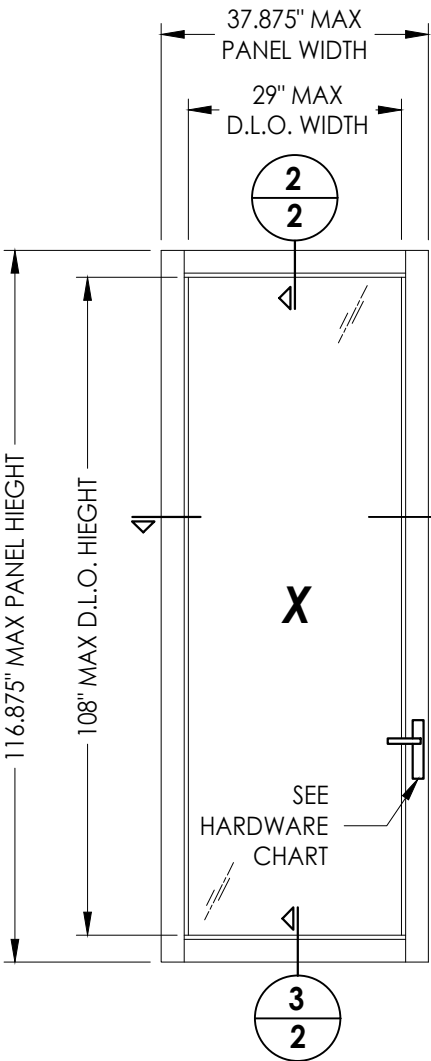


Glazed Door

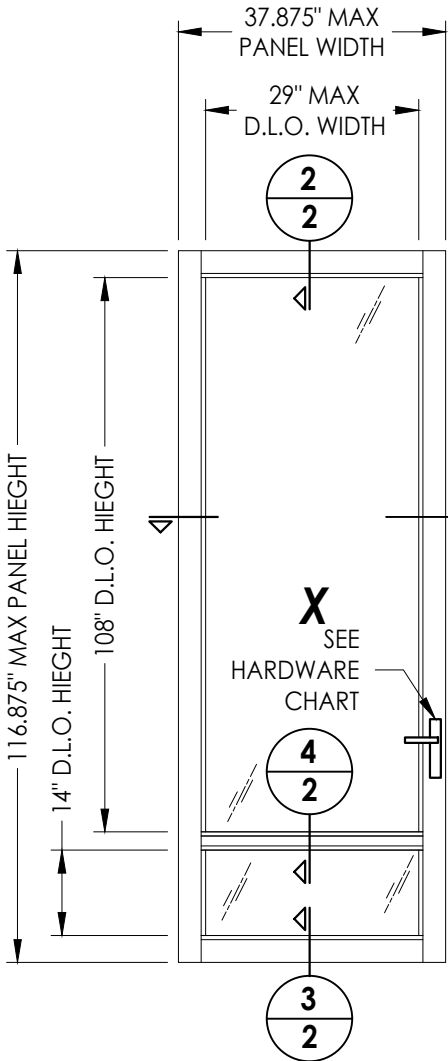


Glazed Door with TDL Bar

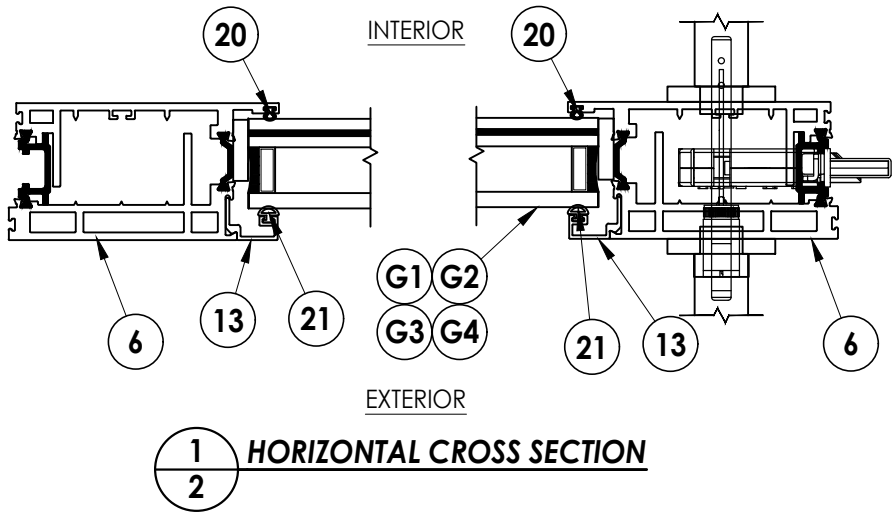


HORIZONTAL CROSS SECTION

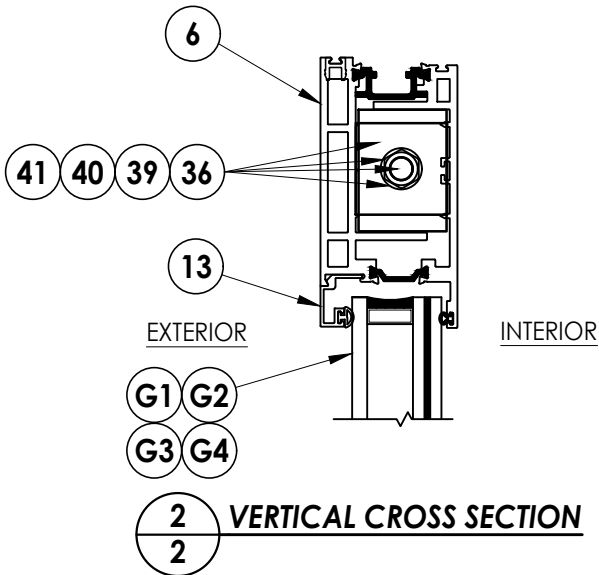

VERTICAL CROSS SECTION

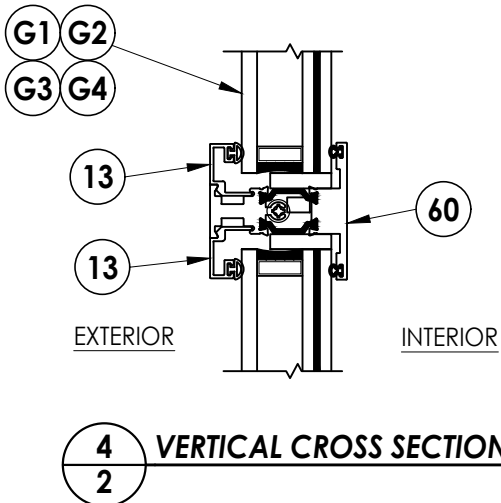

VERTICAL CROSS SECTION

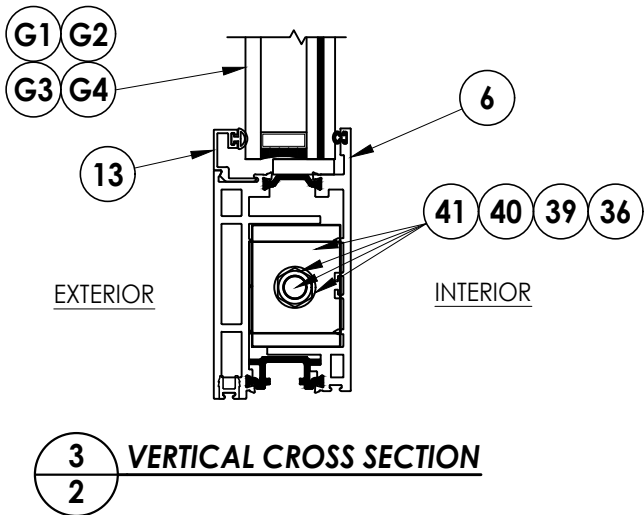

VERTICAL CROSS SECTION

HARDWARE TABLE	
MANUFACTURER	MODEL
TRUTH	MULTI-POINT LOCK: 5 POINT LOCK

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
FLEETWOOD WINDOWS AND DOORS

5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
4	7/11/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
3	8/11/20	UPDATE TO 7th ED. (2020)	FBC	DAC
2	08/07/17	UPDATE TO 6TH ED. (2017)	FBC	LFS
1	11/2/15	REVISE DESIGN PRESSURES	JK	JK
NO.	DATE	REVISIONS		

DATE: 7/22/15

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:

FL-17954.2


SHEET 2 OF 9

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PART OR ASSEMBLY:
DOOR PANEL
DETAILS

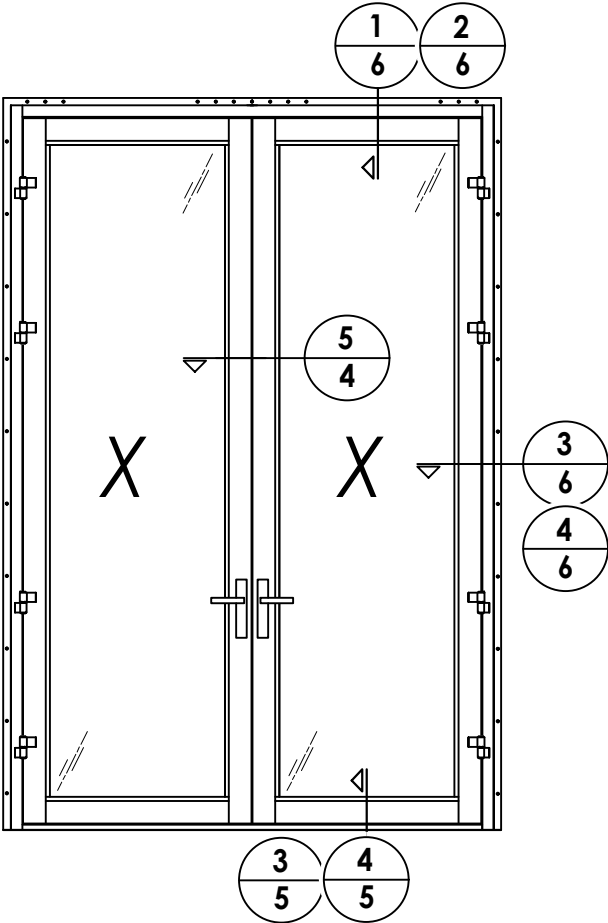

FIN MOUNT

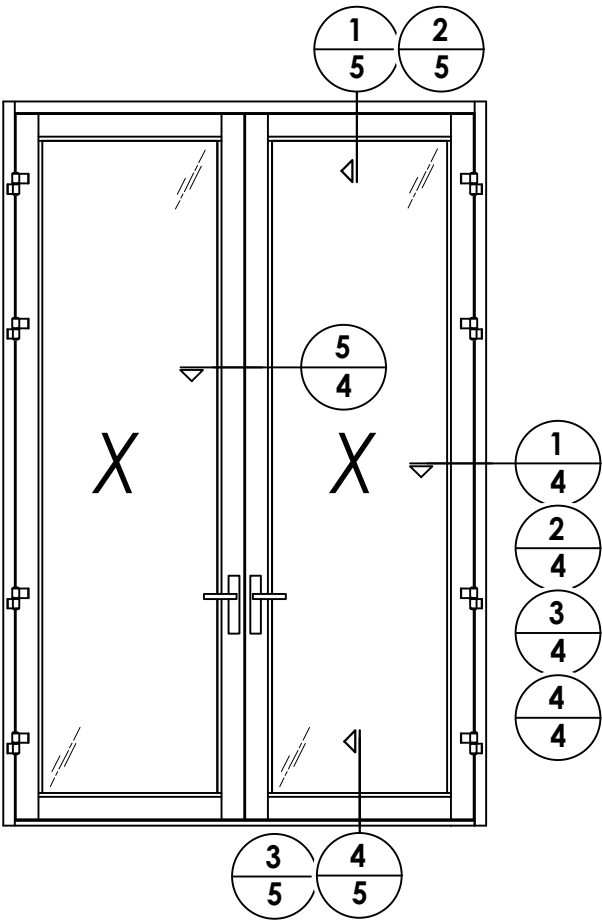

FRAME MOUNT


DATE: 7/22/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17954.2
SHEET 3 OF 9

NO.	DATE	REVISIONS
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	7/11/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	8/11/20	UPDATE TO 7th ED. (2020) FBC DAC
2	08/07/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	11/2/15	REVISE DESIGN PRESSURES JK
		BY


PRODUCT:	FLEETWOOD WINDOWS AND DOORS
PART OR ASSEMBLY:	ELEVATIONS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

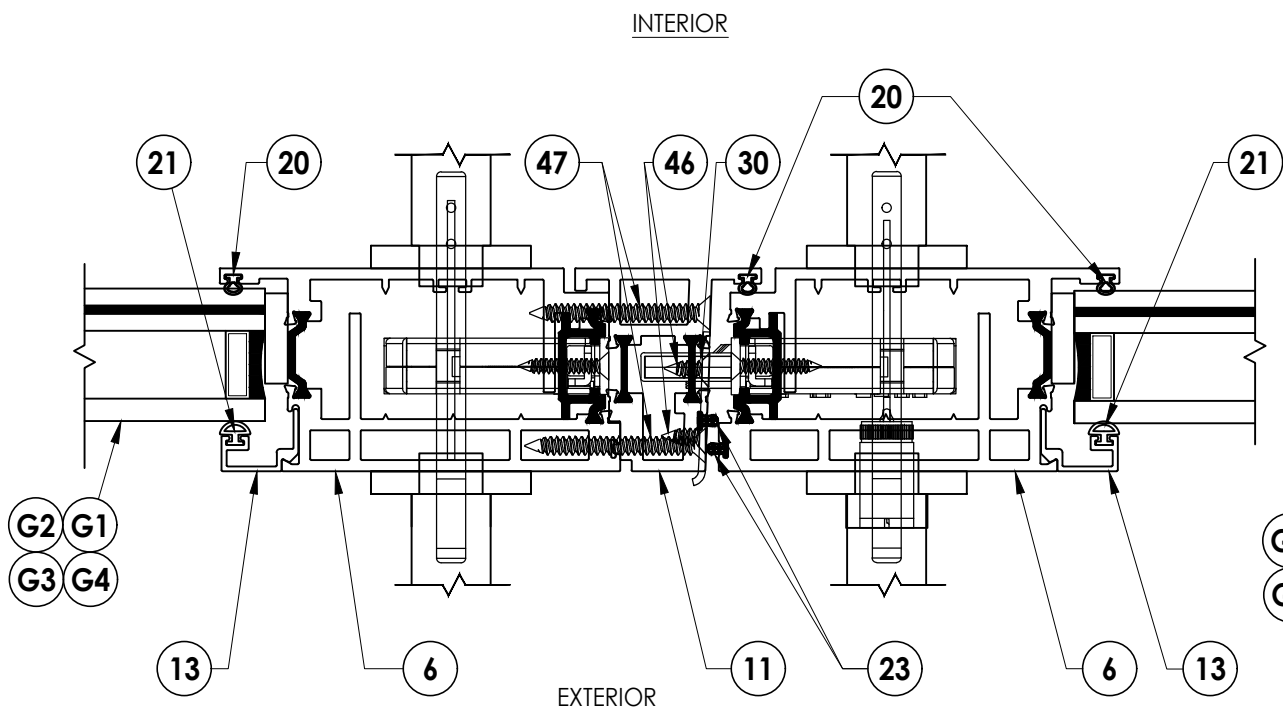


5 HORIZONTAL CROSS SECTION
4 Outswing Shown (Inswing Similar)

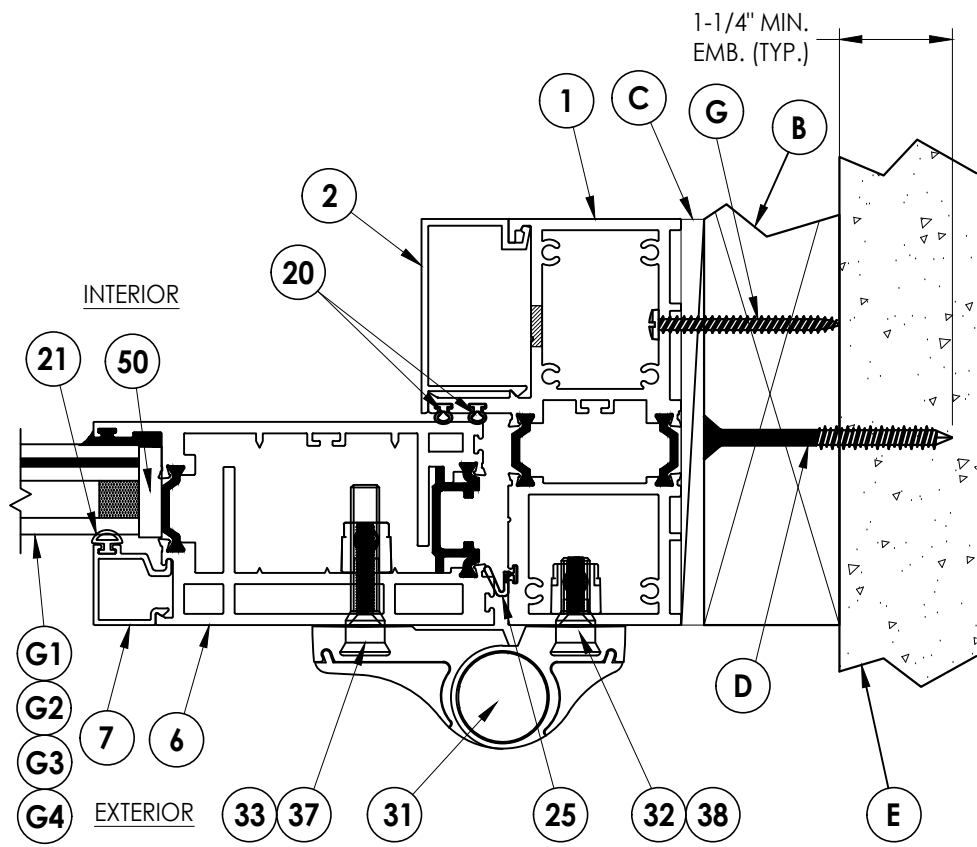


4 HORIZONTAL CROSS SECTION
4 2X Buck Construction
Outswing Shown (Inswing Similar)

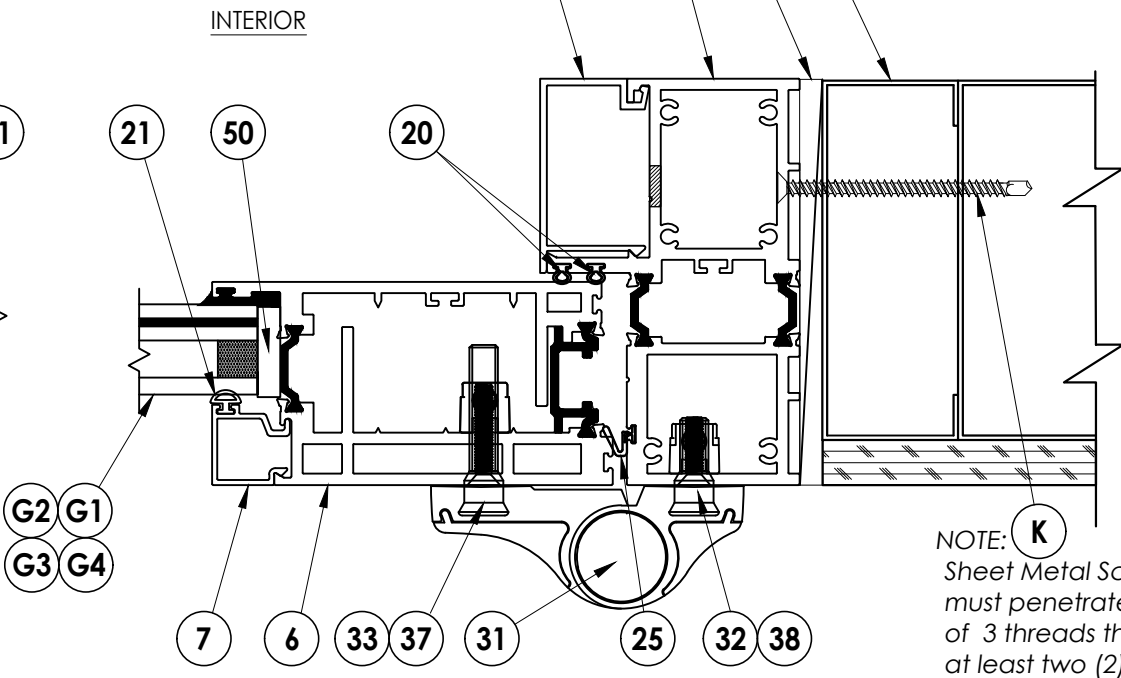

1 HORIZONTAL CROSS SECTION
4 Steel Stud Construction
Outswing Shown (Inswing Similar)

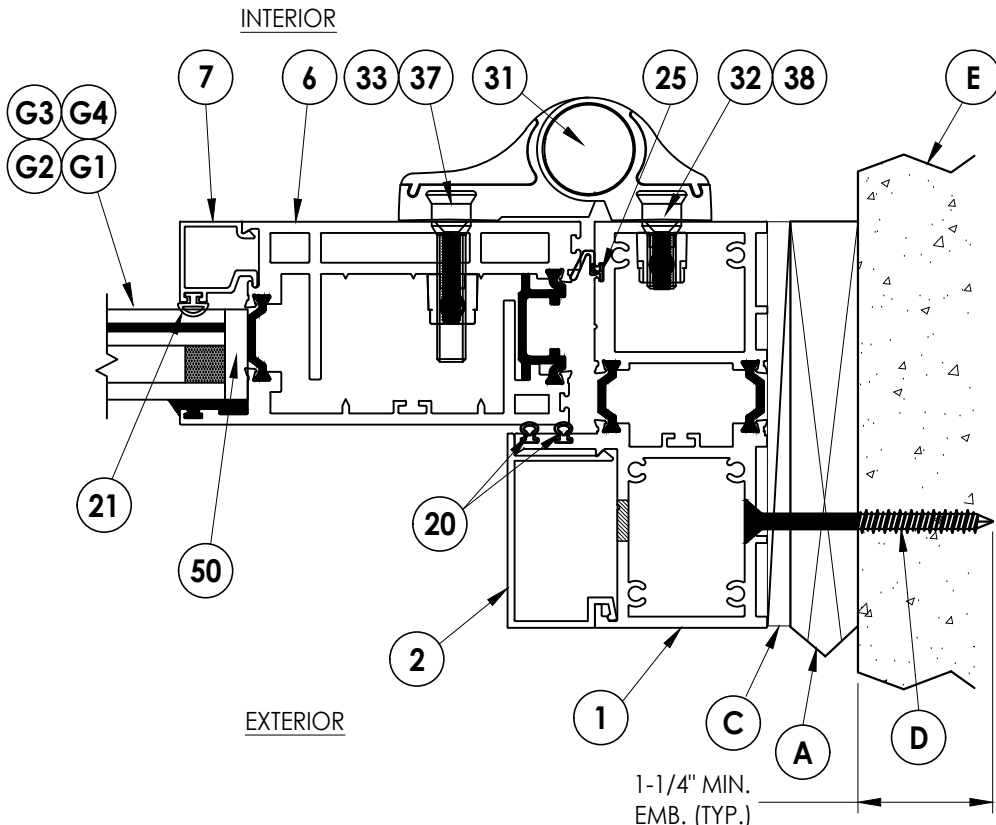

3 HORIZONTAL CROSS SECTION
4 1X Buck Construction
Inswing Shown (Outswing Similar)

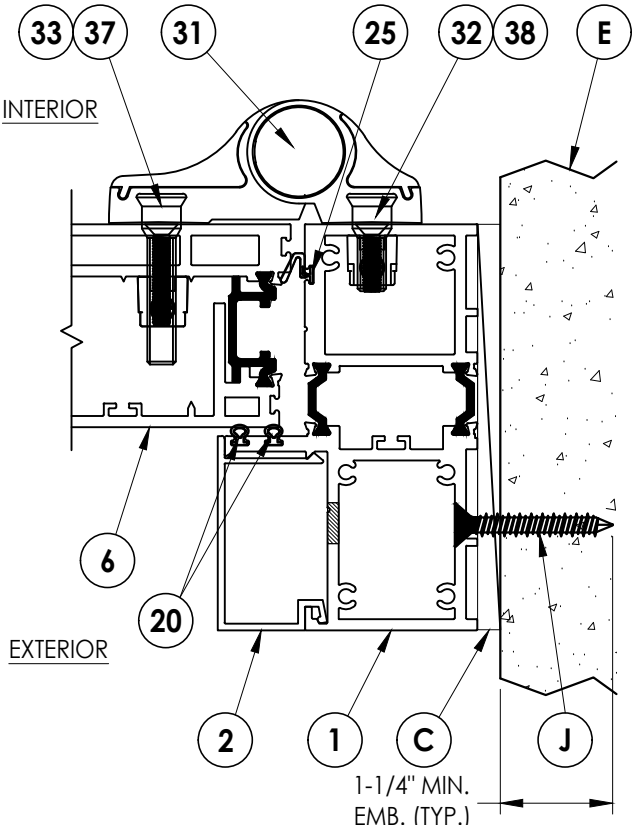

2 HORIZONTAL CROSS SECTION
4 Direct to Masonry
Inswing Shown (Outswing Similar)

NOTE: **K**
Sheet Metal Screws
must penetrate a min.
of 3 threads through
at least two (2) sheets
of metal.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
FLEETWOOD WINDOWS AND DOORS


NO.	DATE	REVISIONS
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC
4	7/11/23	UPDATE TO 8TH ED. (2023) FBC
3	8/11/20	UPDATE TO 7TH ED. (2020) FBC
2	08/07/17	UPDATE TO 6TH ED. (2017) FBC
1	11/2/15	REVISE DESIGN PRESSURES
		JK
		BY

DATE: 7/22/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-17954.2


SHEET 4 OF 9

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Fleetwood Windows & Doors\FL-17954 R8 Side Hinged Door\FL-17954.2.5.dwg

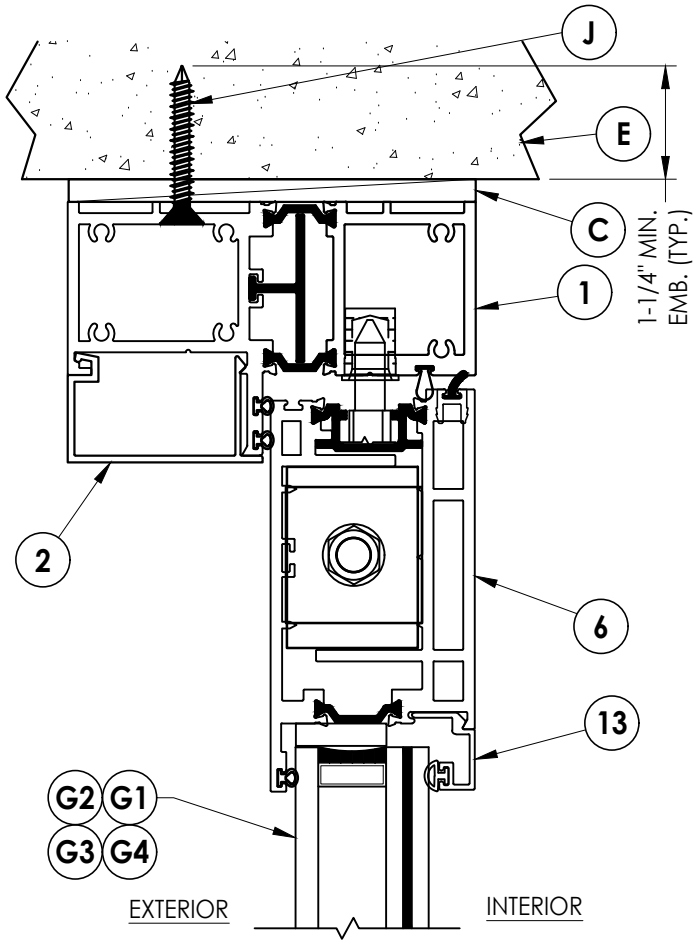


1
5 VERTICAL CROSS SECTION
Inswing Shown

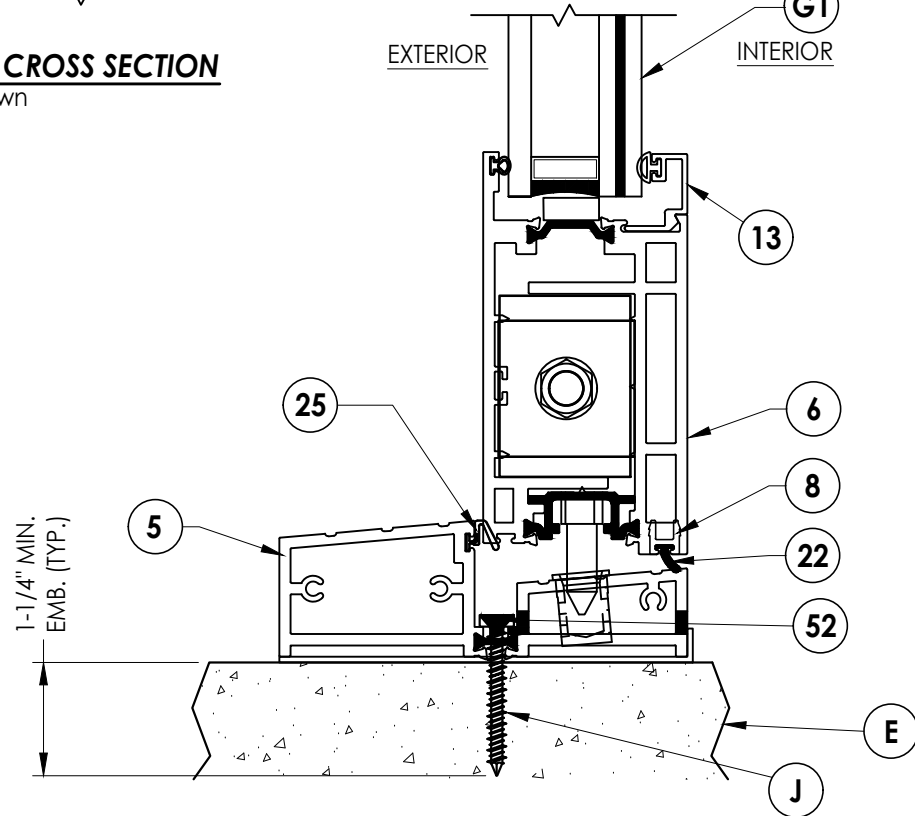

3
5 VERTICAL CROSS SECTION
Inswing Shown

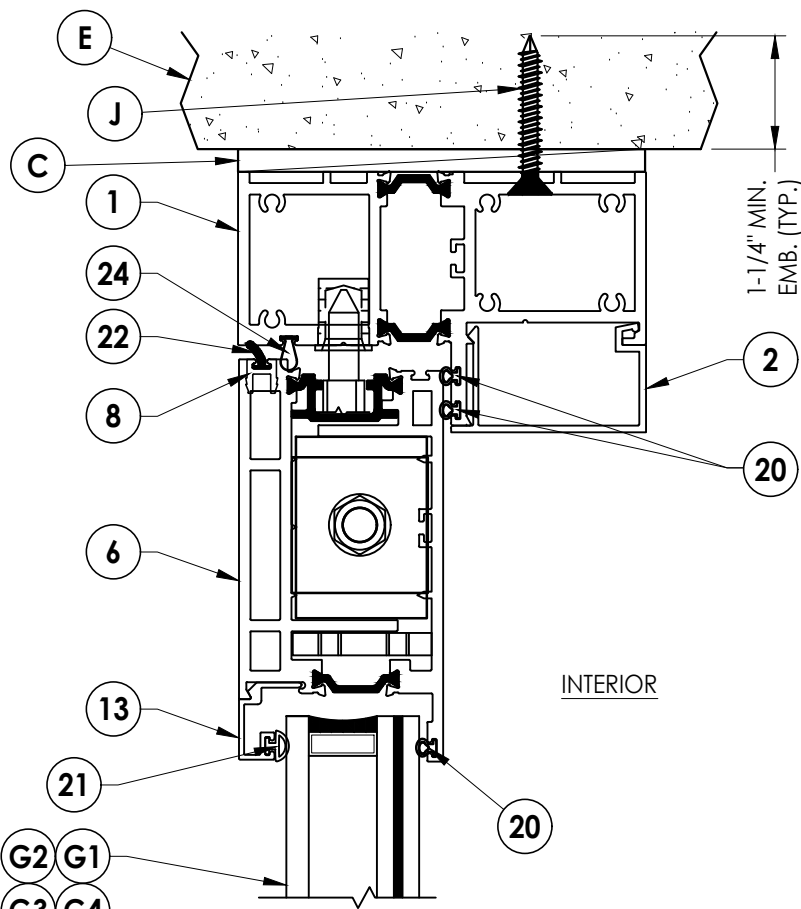


2
5 VERTICAL CROSS SECTION
Outswing Shown

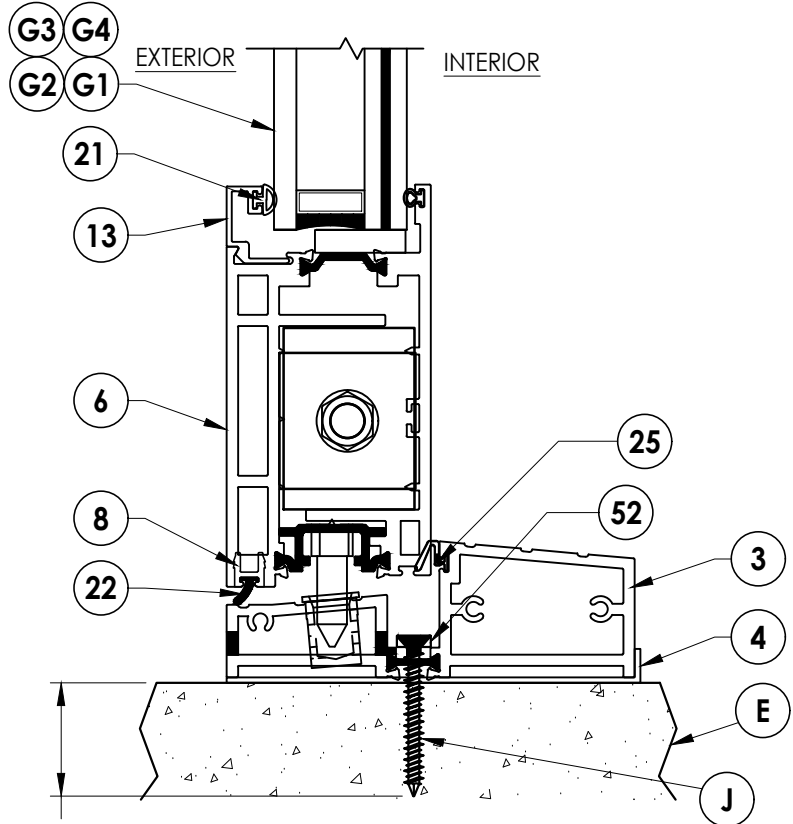


4
5 VERTICAL CROSS SECTION
Outswing Shown

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
FLEETWOOD WINDOWS AND DOORS				PART OR ASSEMBLY: VERTICAL CROSS SECTIONS			
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	REVISIONS		
4	7/11/23	UPDATE TO 8TH ED. (2023)	FBC	LFS			
3	8/11/20	UPDATE TO 7th ED. (2020)	FBC	DAC			
2	08/07/17	UPDATE TO 6TH ED. (2017)	FBC	LFS			
1	11/2/15	REVISE DESIGN PRESSURES		JK			
NO.		DATE					
DATE: 7/22/15							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-17954.2							
SHEET 5 of 9							

Z:\2023 FBC Drawings\Fleetwood Windows & Doors\FL-17954 R8 Side Hinged Door\FL-17954.2.5.dwg

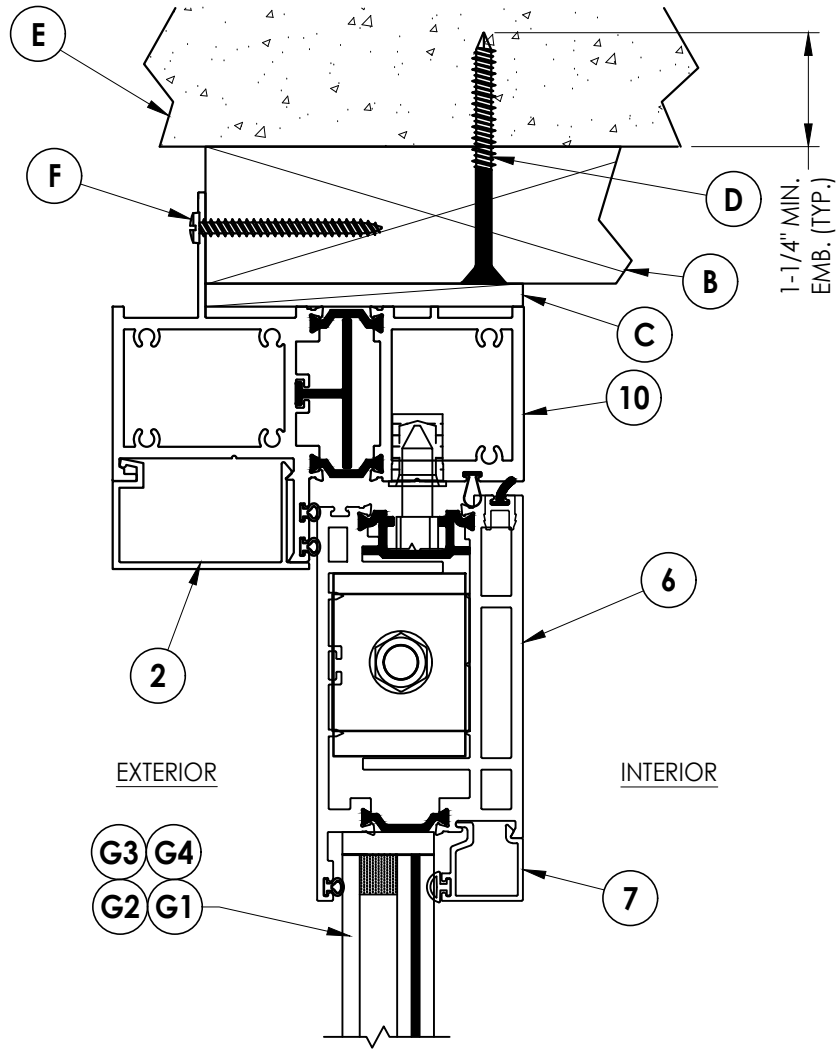


1 VERTICAL CROSS SECTION
6 Inswing shown

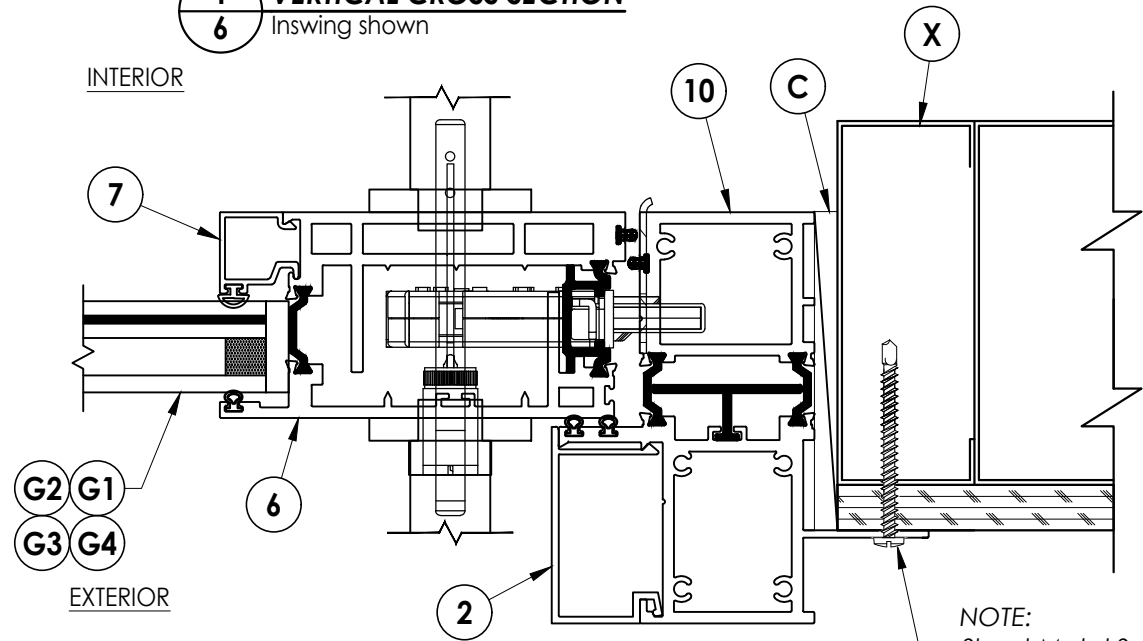


3 HORIZONTAL CROSS SECTION
6 Steel Stud Construction
Inswing shown

NOTE:
Sheet Metal Screws must
penetrate a min. of 3 threads
through metal stud.

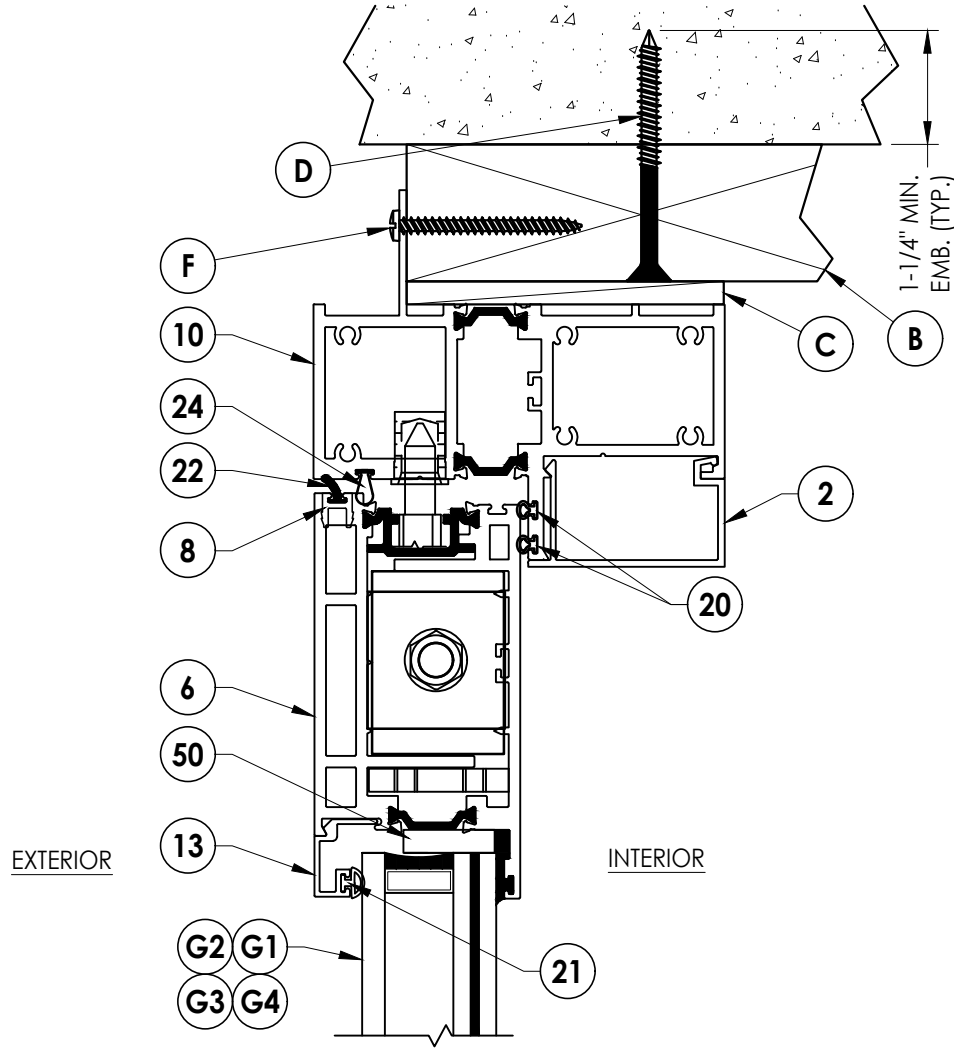

2 VERTICAL CROSS SECTION
6 Outswing shown

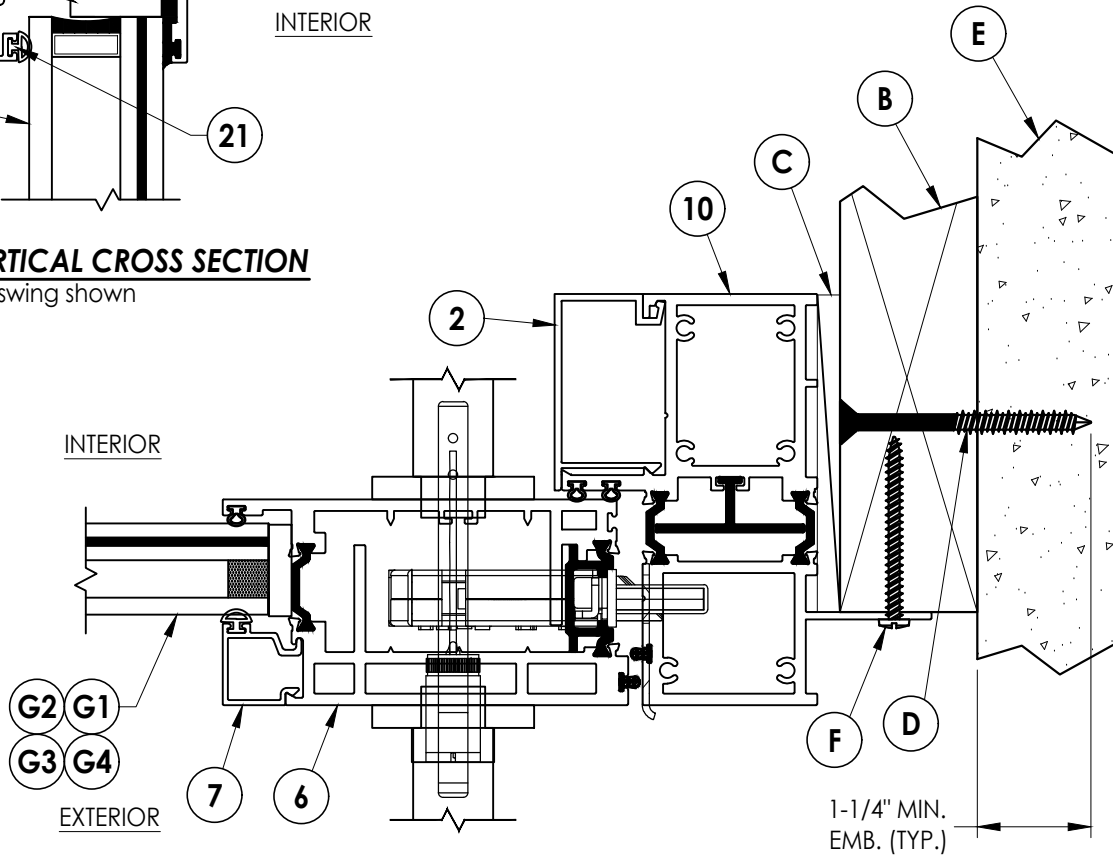

4 HORIZONTAL CROSS SECTION
6 2X Buck Construction
Outswing shown

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

FLEETWOOD WINDOWS AND DOORS

PART OR ASSEMBLY:
FIN HORIZONTAL AND VERTICAL
CROSS SECTIONS

NO.	DATE	REVISIONS
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	7/11/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	8/11/20	UPDATE TO 7TH ED. (2020) FBC DAC
2	08/07/17	UPDATE TO 6TH ED. (2017) FBC LFS
1	11/2/15	REVISE DESIGN PRESSURES JK

DATE: 7/22/15

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:

FL-17954.2


SHEET 6 OF 9

Z:\2023 FBC Drawings\Fleetwood Windows & Doors\FL-17954 R8 Side Hinged Door\FL-17954.2.5.dwg

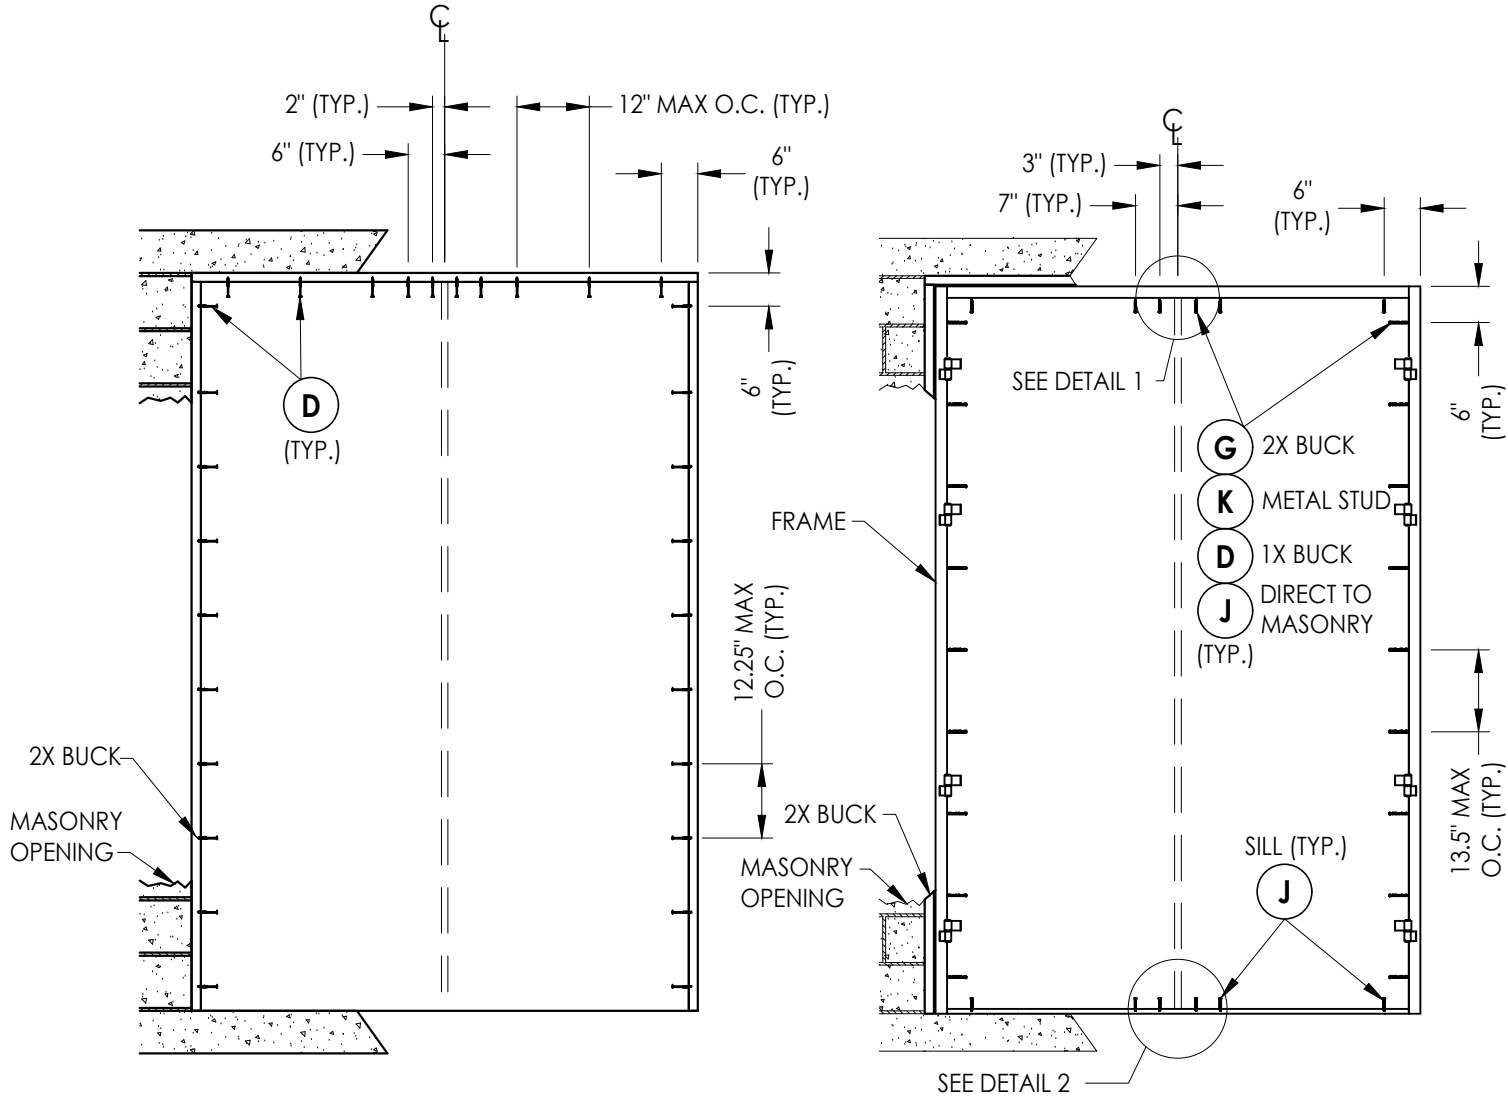


2X BUCK ANCHORING


FRAME ANCHORING

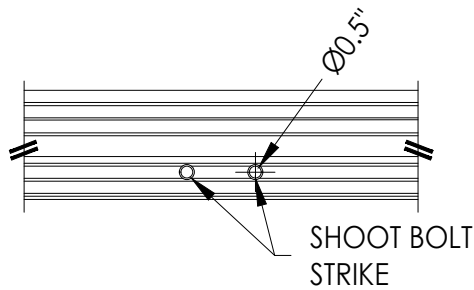

DETAIL 2

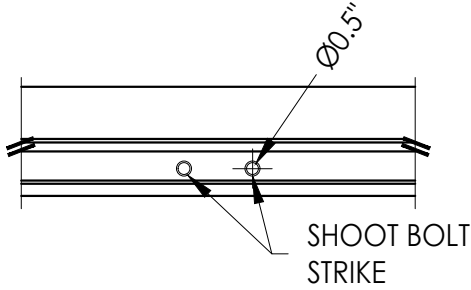


DETAIL 1

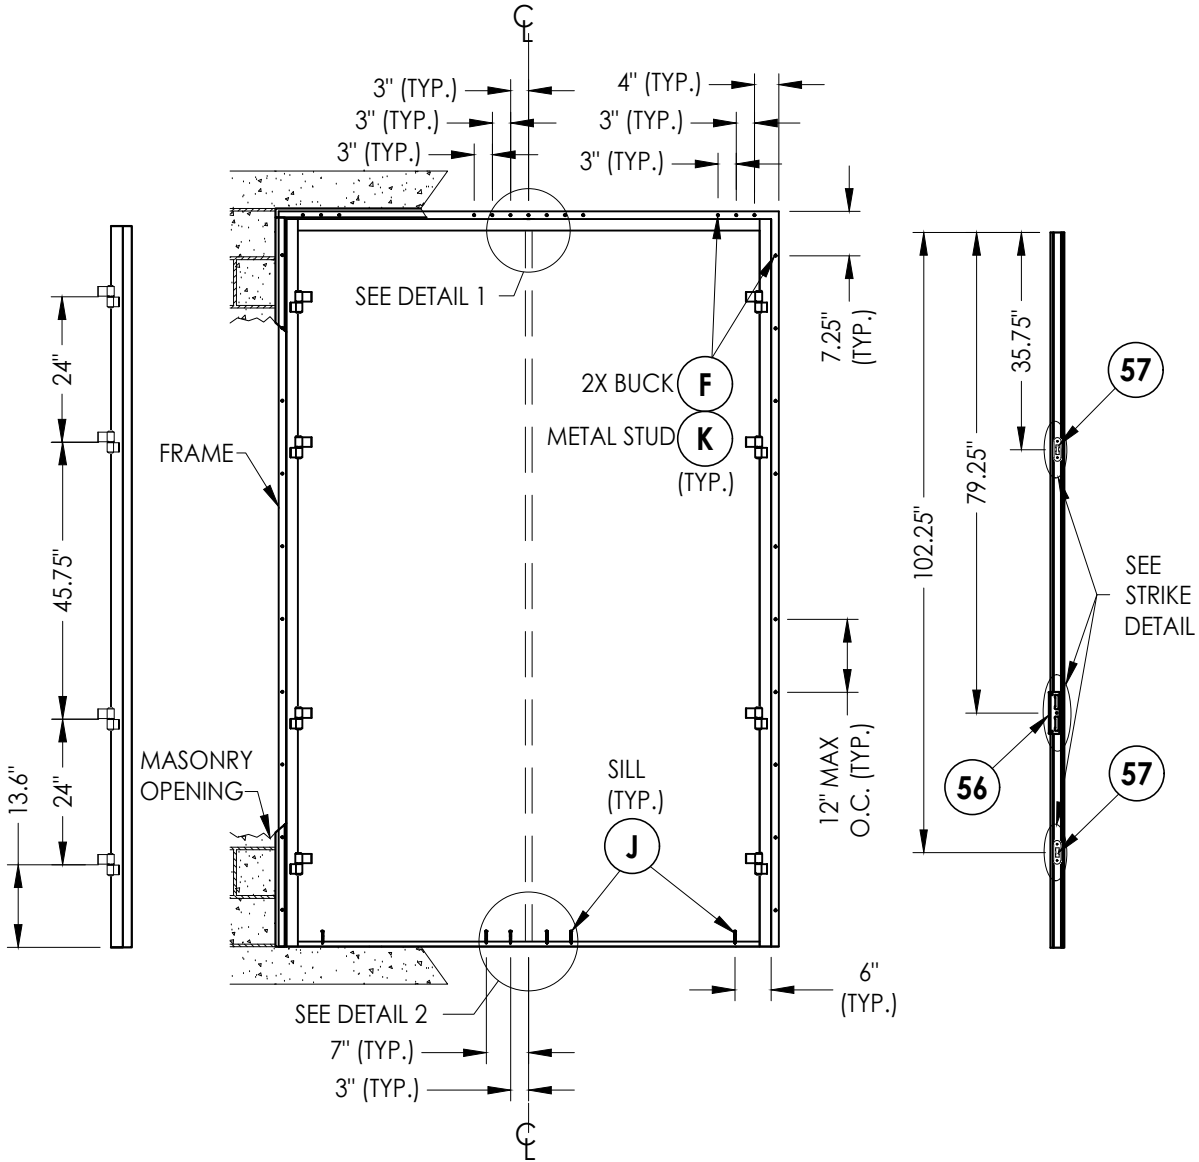

HINGE DETAIL









FIN ANCHORING

ASTRAGAL DETAIL

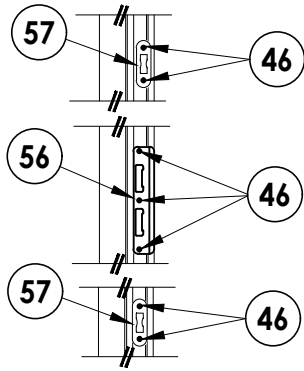

STRIKE DETAIL

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT:		FLEETWOOD WINDOWS AND DOORS	
PART OR ASSEMBLY:		BUCK AND FRAME ANCHORING	
NO.	DATE	REVISIONS	BY
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC
4	7/11/23	UPDATE TO 8TH ED. (2023)	FBC
3	8/11/20	UPDATE TO 7TH ED. (2020)	FBC
2	08/07/17	UPDATE TO 6TH ED. (2017)	FBC
1	11/2/15	REVISE DESIGN PRESSURES	JK
DATE: 7/22/15		SCALE: N.T.S.	
DWG. BY: JK		CHK. BY: LFS	
DRAWING NO.: FL-17954.2		SHEET 7 OF 9	

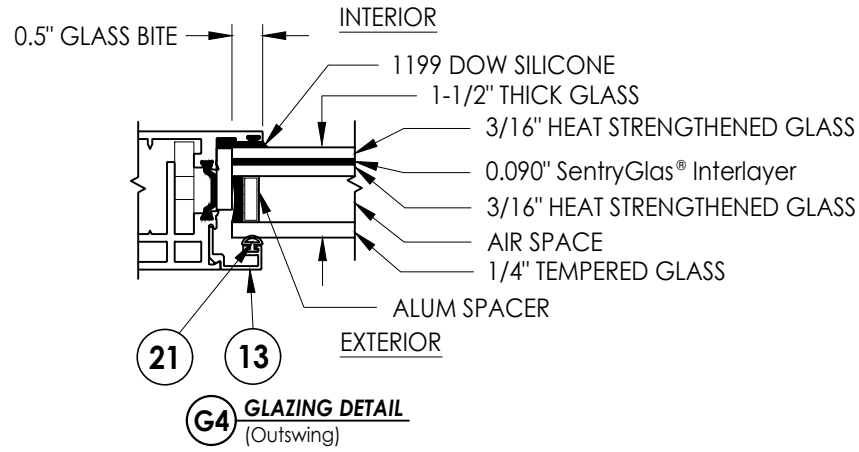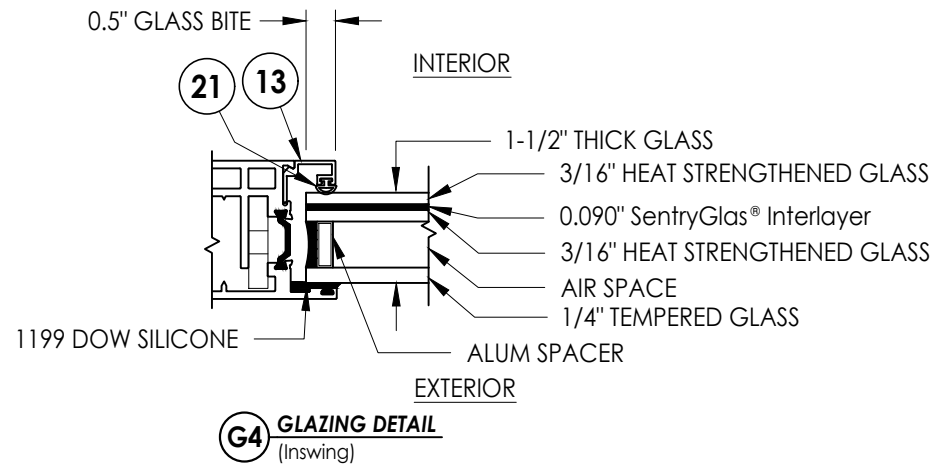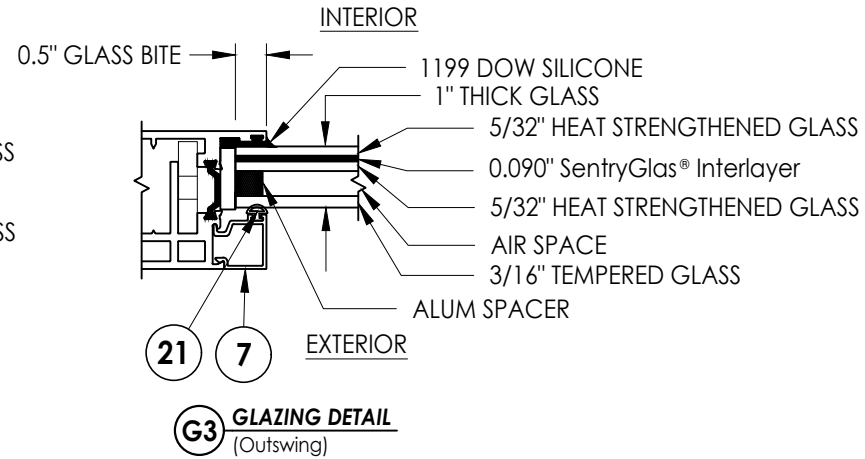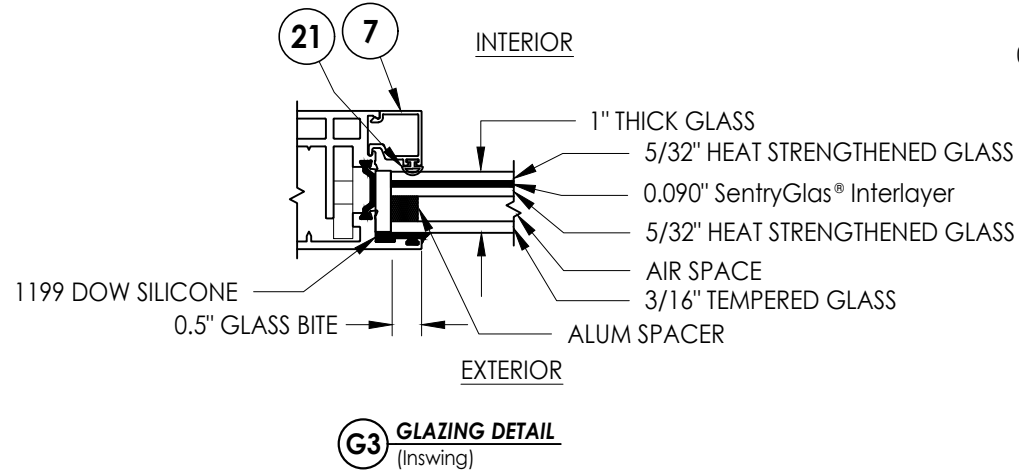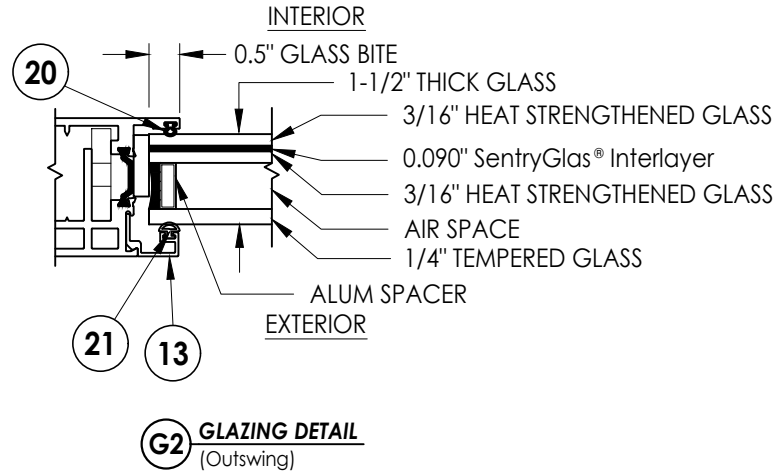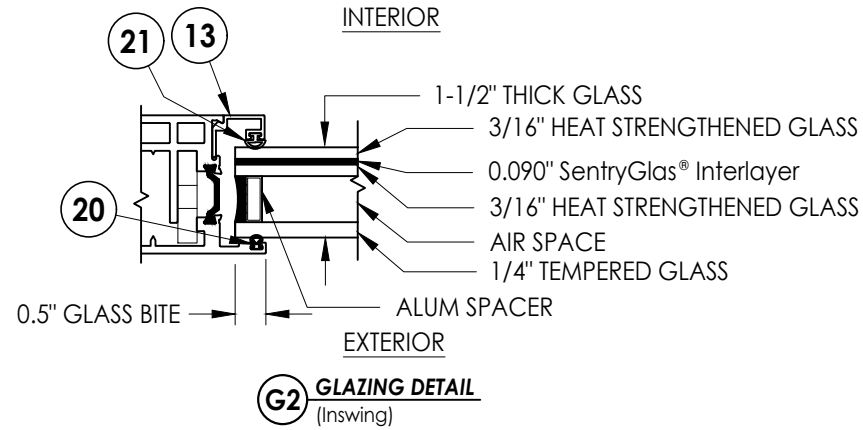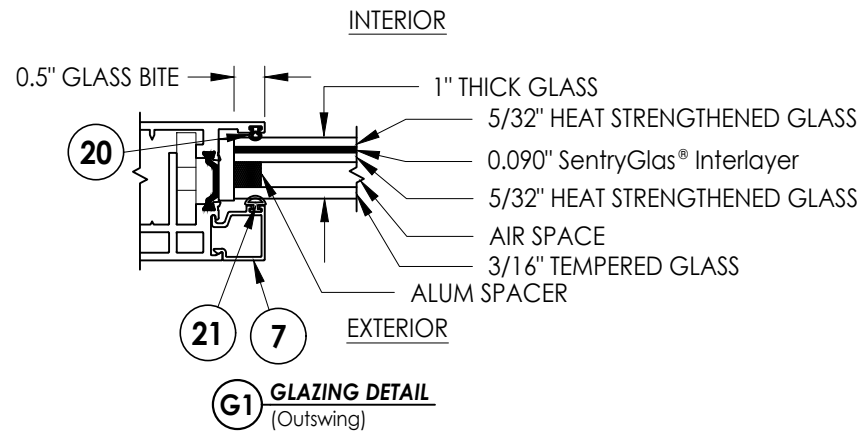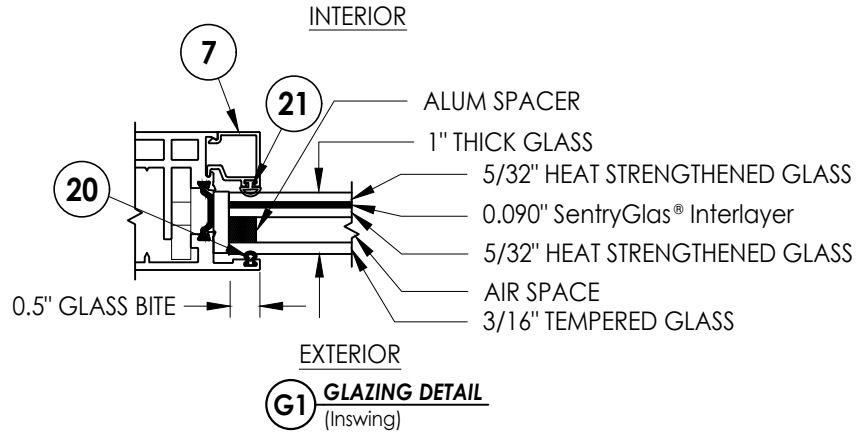

NOTE: GLAZING > 36" WIDE REQUIRES AT LEAST TWO (2) SETTING
BLOCKS CONFORMING TO FBC SECTION 2411.3.3.1.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33593

Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
FLEETWOOD WINDOWS AND DOORS

ASSEMBLY:
GLAZING DETAILS

[illegible]

DATE: 7/22/15

SCALE: *N.T.S.*

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-17954.2

SHEET 8 OF 9


BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL - MANUFACTURER
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" DeWALT OR ITW PFH CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	#10 x 1-3/4" PPH WOOD SCREW (1-1/2" MIN. EMBEDMENT)	STEEL
G	#10 x 2" PPH WOOD SCREW (1-1/2" MIN. EMBEDMENT)	STEEL
J	1/4" X 2-1/4" ITW PFH CONCRETE SCREW	STEEL
K	#10 FH SELF-DRILLING SMS	STEEL
X	STEEL STUD Min. Thk .033" (ASTM A653 GRADE 33 Fy=33 Ksi Min, Fu=45 Ksi Min)	STEEL
1	FRAME	6063-T6 ALUM
2	FRAME SNAP-IN	6063-T6 ALUM
3	OUTSWING SILL	6063-T6 ALUM
4	SILL PAN	6063-T6 ALUM
5	INSWING SILL	6063-T6 ALUM
6	SASH	6063-T6 ALUM
7	1" GLASS STOP	6063-T6 ALUM
8	ATLANTIC SEAL CLIP	6063-T6 ALUM
10	FRAME (FIN)	6063-T6 ALUM
11	ASTRAGAL	6063-T6 ALUM
13	1.5" GLASS STOP	6063-T6 ALUM
20	BULB VINYL - MINI (EPDM 70 Durometer)	TREMCO, # TX20801E
21	BULB VINYL - LARGE (EPDM 70 Durometer)	TREMCO, # TX19638E
22	FOAM SEAL	EMESBURY, # 32390
23	Q-LON FOAM SEAL	SCHLEGEL CORP., # Q225T190
24	Q-LON FOAM SEAL	SCHLEGEL CORP., # Q375T190
25	Q-LON FOAM SEAL	SCHLEGEL CORP., # QEZ 376
31	BUTT HINGE	SAVIO
32	BACK UP KIT	SAVIO
33	HINGE BOLT, 8M X 48MM (FOR PANEL)	SAVIO
36	BACK UP PLATE FOR CORNER BLOCK	-
37	MACHINE SCREW NO 10-32, FHP 1.125"	STAINLESS STEEL
38	MACHINE SCREW NO 10-32, FHP .75"	STAINLESS STEEL
39	HEX HEAD CAP SCREW .375-16, 2.250"	STAINLESS STEEL
40	.375-16 SS. HEX NUT	STAINLESS STEEL
41	.375 SPLIT LOCK WASHER	STAINLESS STEEL
46	#10 X 1/2" PFH SMS	STAINLESS STEEL
47	#10 X 2" PFH SMS	STAINLESS STEEL
50	4" LONG SETTING BLOCK	-
56	LATCH AND DEADBOLT STRIKE PLATE	STAINLESS STEEL
57	STRIKE PLATE	STAINLESS STEEL
60	TDL BAR	6063-T6 ALUM

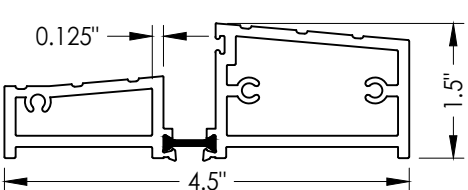


3 OUT-SWING SILL

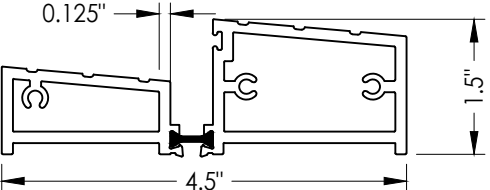


5 INSWING SILL




2 FRAME SNAP-IN

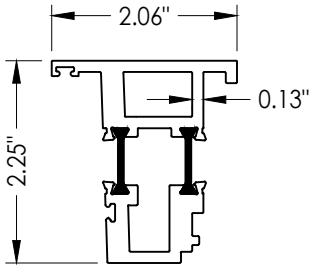


11 ASTRAGAL

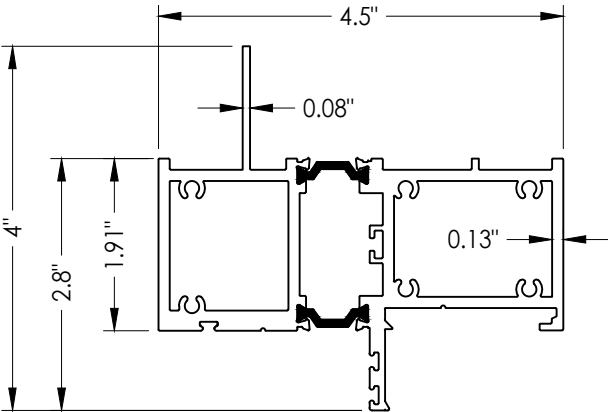


10 FRAME (FIN)

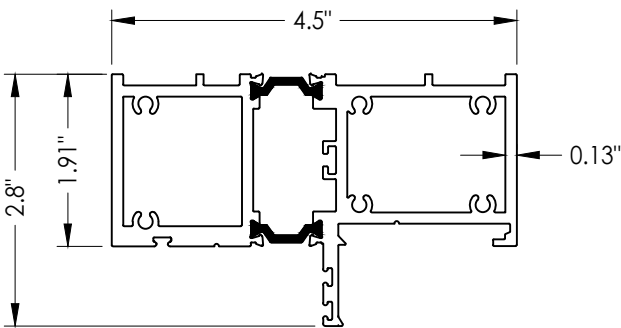


1 FRAME

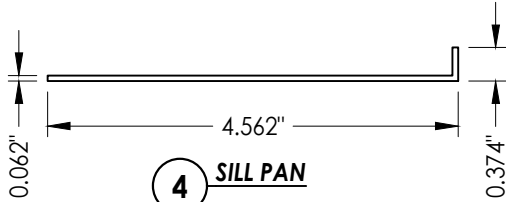


4 SILL PAN



7 1" GLASS STOP



13 1.5" GLASS STOP

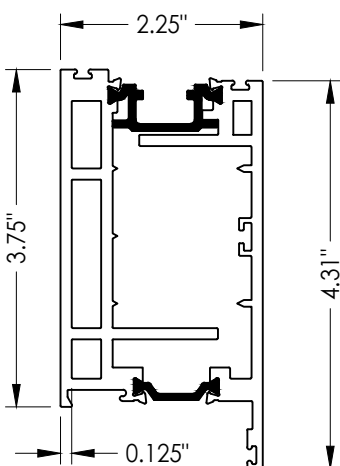

6 SASH

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA-CON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

DATE: 7/22/15
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.:
FL-17954.2
SHEET 9 OF 9

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R²W
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: FLEETWOOD WINDOWS AND DOORS

PART OR ASSEMBLY:

6TH ED. (2
SIGN PRESS
REVISIONS

© 2015 R.W. BUILDING CONSULTANTS INC.