

SUPER SERIES 400 ALUMINUM CASEMENT WINDOW
NON IMPACT


GENERAL NOTES:

- THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 8TH EDITION FBC 2023/ 9TH EDITION FBC 2026 EXCLUDING HIGH VELOCITY HURRICANE ZONE (NON-HVHZ).
- WINDOWS RATED FOR NON-IMPACT.
- THESE WINDOWS ARE APPROVED FOR AIR AND WATER INFILTRATION.
- MATERIAL: ALL ALUMINUM EXTRUSION TO BE 6063-T5 ALLOY
- ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
- ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.
- WOOD BUCKS BY OTHERS MUST BE SOUTHERN PINE, G = 0.55 AND MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE MAIN STRUCTURE.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.1.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).


- ULTIMATE DESIGN LOAD OBTAINED FROM ASCE 7-22, MULTIPLY BY 0.6 SHALL BE LESS THAN OR EQUAL TO DESIGN LOAD IN THIS DOCUMENT.
- A LOAD DURATION FACTOR IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.
- MATERIALS INCLUDING BUT NOT LIMITED TO STEEL / METAL SCREWS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 8TH EDITION FBC 2023/ 9TH EDITION FBC 2026 SECTION AS APPLICABLE.
- METAL STRUCTURES BY OTHERS MUST SUPPORT LOADS IMPOSED BY WINDOW SYSTEM AND TRANSFER THEM TO THE BUILDING MAIN STRUCTURE.
- MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE LABELING TO COMPLY WITH SECTION 1709.9.2.

ABBREVIATIONS AND SYMBOLS	
D.L.O. - DAYLITE OPENING	CL - CENTER LINE
F.H. - FRAME HEIGHT	H.S. - HEAT STRENGTHENED
F.W. - FRAME WIDTH	TEMP. - TEMPERED
W/ - WITH	O.C. - ON CENTER
W/O - WITHOUT	
	SECTION NUMBER
	SHEET NUMBER

LIMITATIONS OF USE	
A-	THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; I.E. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.
B-	CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
C-	THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
D-	SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D.
E-	THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

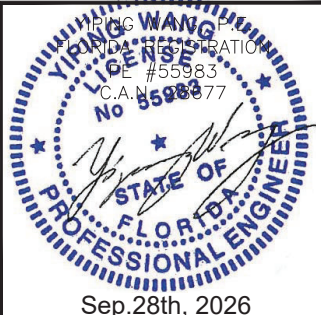

REVISIONS	
NO.	DESCRIPTION
R4	11.16.23 UPDATE TO 2023 FBC
R5	09.28.26 UPDATE TO 2026 FBC




MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY,
SUITE 301
MIRAMAR, FL 33027
P: 305.588.5224
www.MCYEngineering.com


SUPERIOR SERIES # 400 ALUM. CASEMENT WINDOW – N.I.

C.T. WINDOWS, LLC.
9195 BOGGY CREEK RD #1
ORLANDO, FL. 32824
P: (407) 857 - 9237 F: (407) 857 - 9247

FL18004.1	
DATE	09.28.2026
SCALE	AS SHOWN
DRAWN	James
PROJECT	11-051
DRAWING NO. AD11-15	
SHEET 1 OF 7	

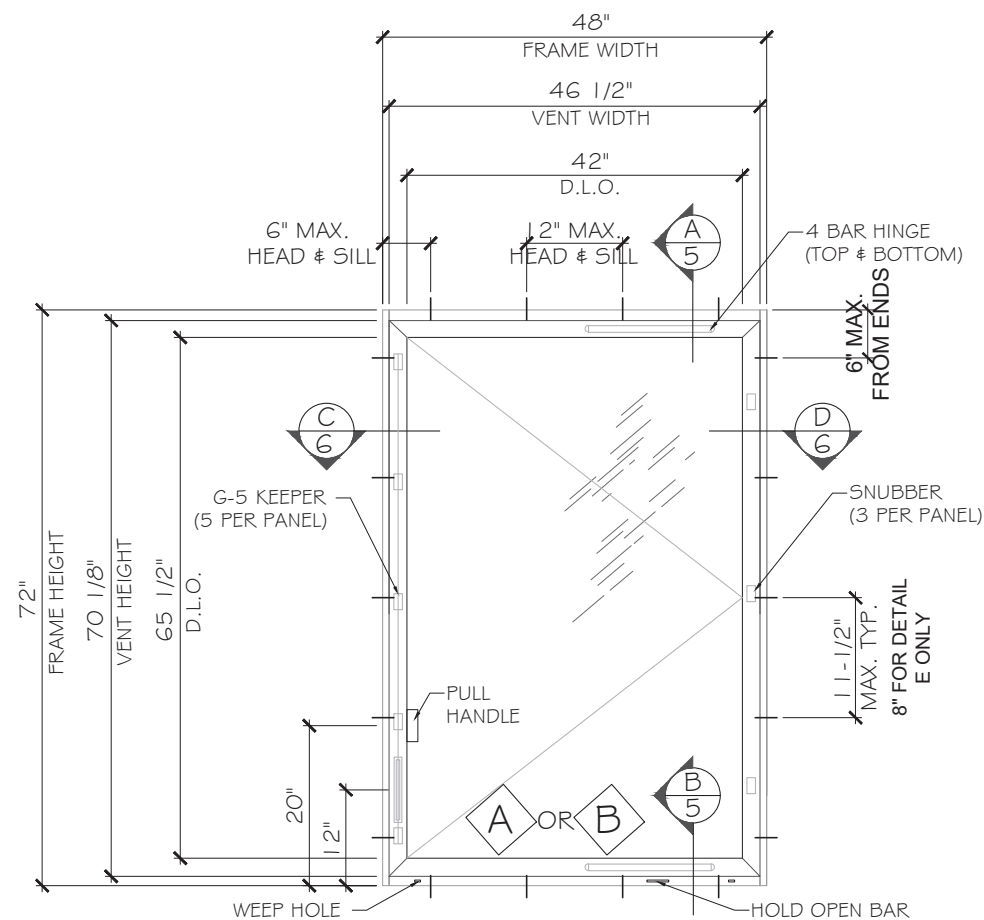


TYPICAL ELEVATION
EQUAL LEG FRAME

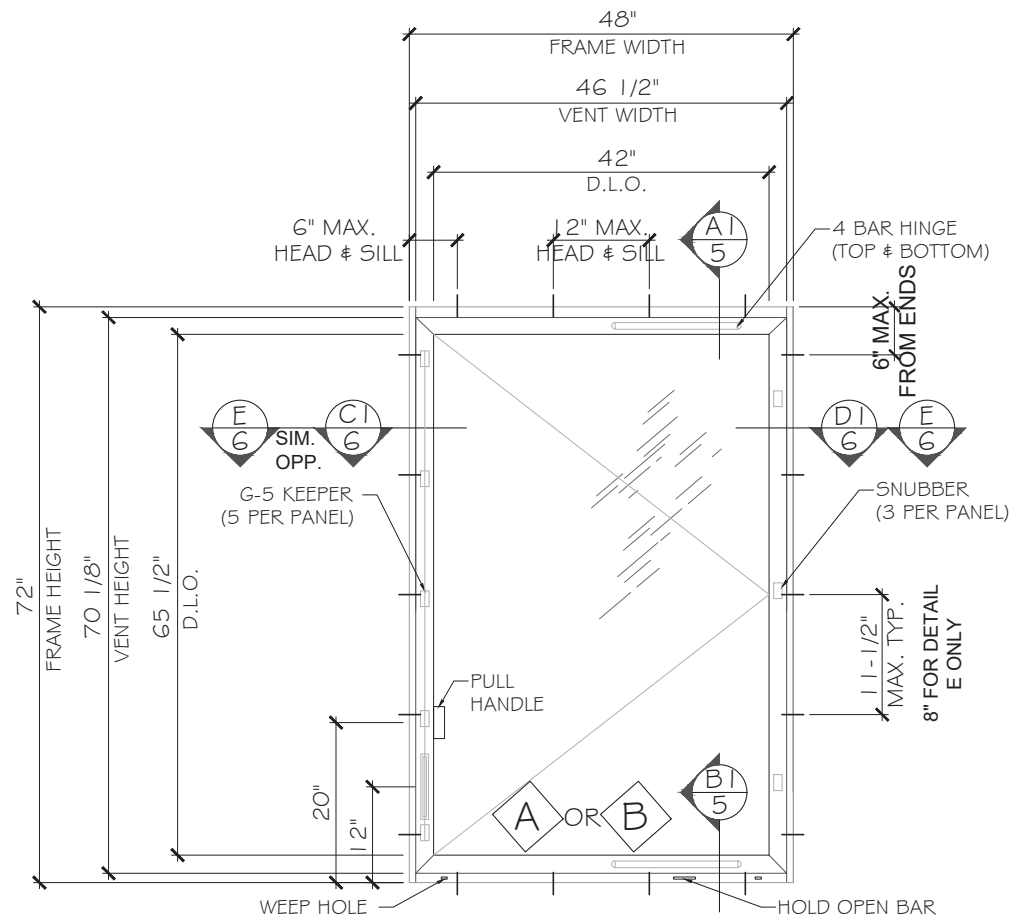

TYPICAL ELEVATION
FLANGED FRAME

MAX. ALLOWABLE
DESIGN LOAD
SEE CHART ON
SHEET 3 OF 8.

D.L.O. WIDTH = WINDOW WIDTH - 6"
D.L.O. LENGTH = WINDOW LENGTH - 6.5"

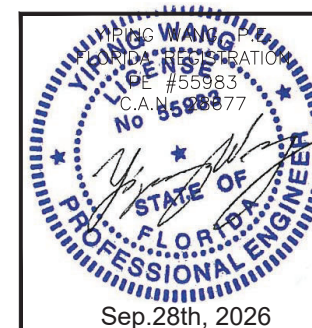


NO.	DATE	DESCRIPTION
R4	11.16.23	UPDATE TO 2023 FBC
R5	09.28.26	UPDATE TO 2026 FBC

MCY
MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY,
SUITE 301
MIRAMAR, FL 33027
F: 305.588.5224
www.MCYEngineering.com MCY@mcyengineering.com


SUPERIOR SERIES # 400 ALUM. CASEMENT WINDOW - N.I.
C.T. WINDOWS, LLC.
9195 BOGGY CREEK RD #1
ORLANDO, FL. 32824
P: (407) 857 - 9237 F: (407) 857 - 9247

FL18004.1	
DATE	09.28.2026
SCALE	AS SHOWN
DRAWN	James
PROJECT	11-051
DRAWING NO. AD11-15	
SHEET 2 OF 7	

CASEMENT WINDOW							
DESIGN LOAD CAPACITY (GLASS TYPE A & B)							
FRAME DIMENSION		EQUAL LEG & FLANGED FRAME (EXCEPT DETAIL E)		FLANGED FRAME (DETAIL E WITH ANCHOR SPACING 12")		FLANGED FRAME (DETAIL E WITH ANCHOR SPACING 8")	
WIDTH in.	HEIGHT in.	EXT. (+) PSF	INT. (-) PSF	EXT. (+) PSF	INT. (-) PSF	EXT. (+) PSF	INT. (-) PSF
24"	60"	80.0	174.0	80.0	108.0	80.0	162.0
	66"	80.0	174.0	80.0	108.0	80.0	162.0
	72"	80.0	160.0	80.0	108.0	80.0	160.0
	78"	80.0	116.2	80.0	108.0	80.0	116.0
	84"	80.0	86.4	80.0	86.4	80.0	86.4
	90"	65.5	65.5	65.5	65.5	65.5	65.5
	96"	50.6	50.6	50.6	50.6	50.6	50.6
30"	60"	80.0	139.0	80.0	86.4	80.0	129.6
	66"	80.0	139.0	80.0	86.4	80.0	129.6
	72"	80.0	128.0	80.0	86.4	80.0	128.0
	78"	80.0	92.9	80.0	86.4	80.0	92.9
	84"	69.1	69.1	69.1	69.1	69.1	69.1
	90"	52.4	52.4	52.4	52.4	52.4	52.4
	96"	40.5	40.5	40.5	40.5	40.5	40.5
36"	60"	80.0	116.0	72.0	72.0	80.0	108.0
	66"	80.0	116.0	72.0	72.0	80.0	108.0
	72"	80.0	106.7	72.0	72.0	80.0	106.7
	78"	77.4	77.4	72.0	72.0	77.4	77.4
	84"	57.6	57.6	57.6	57.6	57.6	57.6
	90"	43.7	43.7	43.7	43.7	43.7	43.7
	96"	43.7	43.7	43.7	43.7	43.7	43.7
42"	60"	80.0	99.0	61.7	61.7	80.0	92.6
	66"	80.0	99.0	61.7	61.7	80.0	92.6
	72"	80.0	91.4	61.7	61.7	80.0	91.4
	78"	66.4	66.4	66.4	61.7	66.4	66.4
	82"	54.3	54.3	54.3	54.3	54.3	54.3
48"	72"	80.0	80.0	80.0	54.0	80.0	80.0
54"	69"	44.4	44.4	44.4	44.4	44.4	44.4

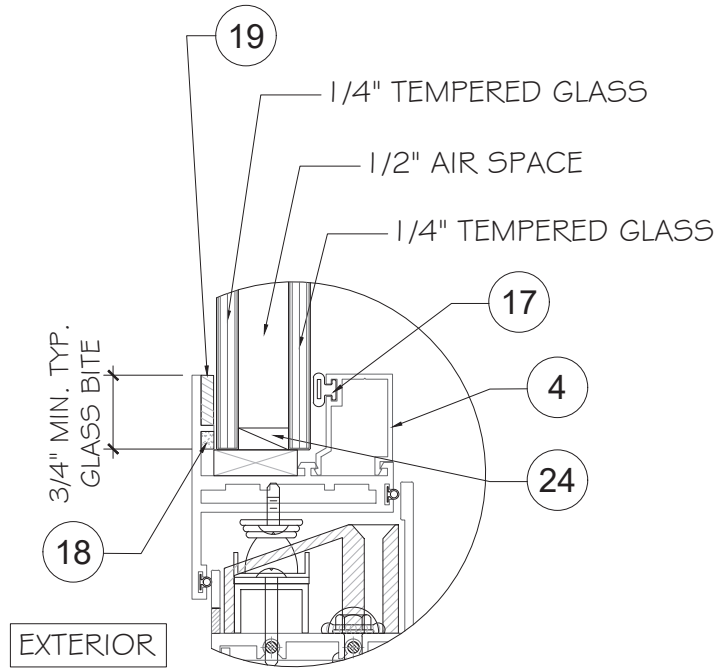


GLASS TYPE "A"

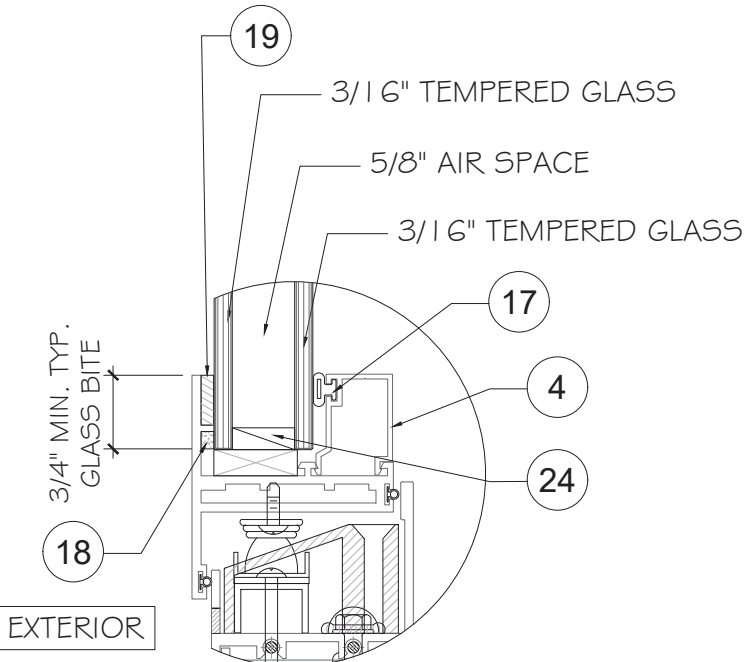

GLASS TYPE "B"

NOTE:
GLASS COMPLIES WITH ASTM E1300-16
OR 24 (3 SEC. GUSTS).

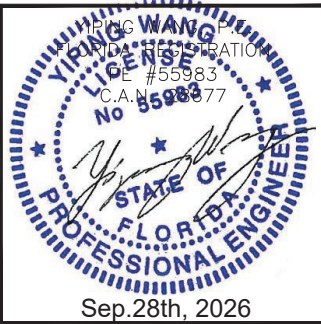

REVISIONS	
NO.	DATE
R4	11.16.23
R5	09.26.26

MCY

MCY ENGINEERING, INC.

GLAZING CONSULTANTS

12781 MIRAMAR PARKWAY,
SUITE 301
MIRAMAR, FL 33027

www.MCYEngineering.com

NO. DATE

DESCRIPTION

UPDATE TO 2023 PEC

UPDATE TO 2026 PEC

F: 305.588.5224

MCY@mcyengineering.com


SUPERIOR SERIES # 400 ALUM. CASEMENT WINDOW - N.I.

C.T. WINDOWS, LLC.

9195 BOGGY CREEK RD #1
ORLANDO, FL 32824

P: (407) 857 - 9237 F: (407) 857 - 9247


FL18004.1	
DATE	09.28.2026
SCALE	AS SHOWN
DRAWN	James
PROJECT	11-051
DRAWING NO. AD11-15	
SHEET 3 OF 7	

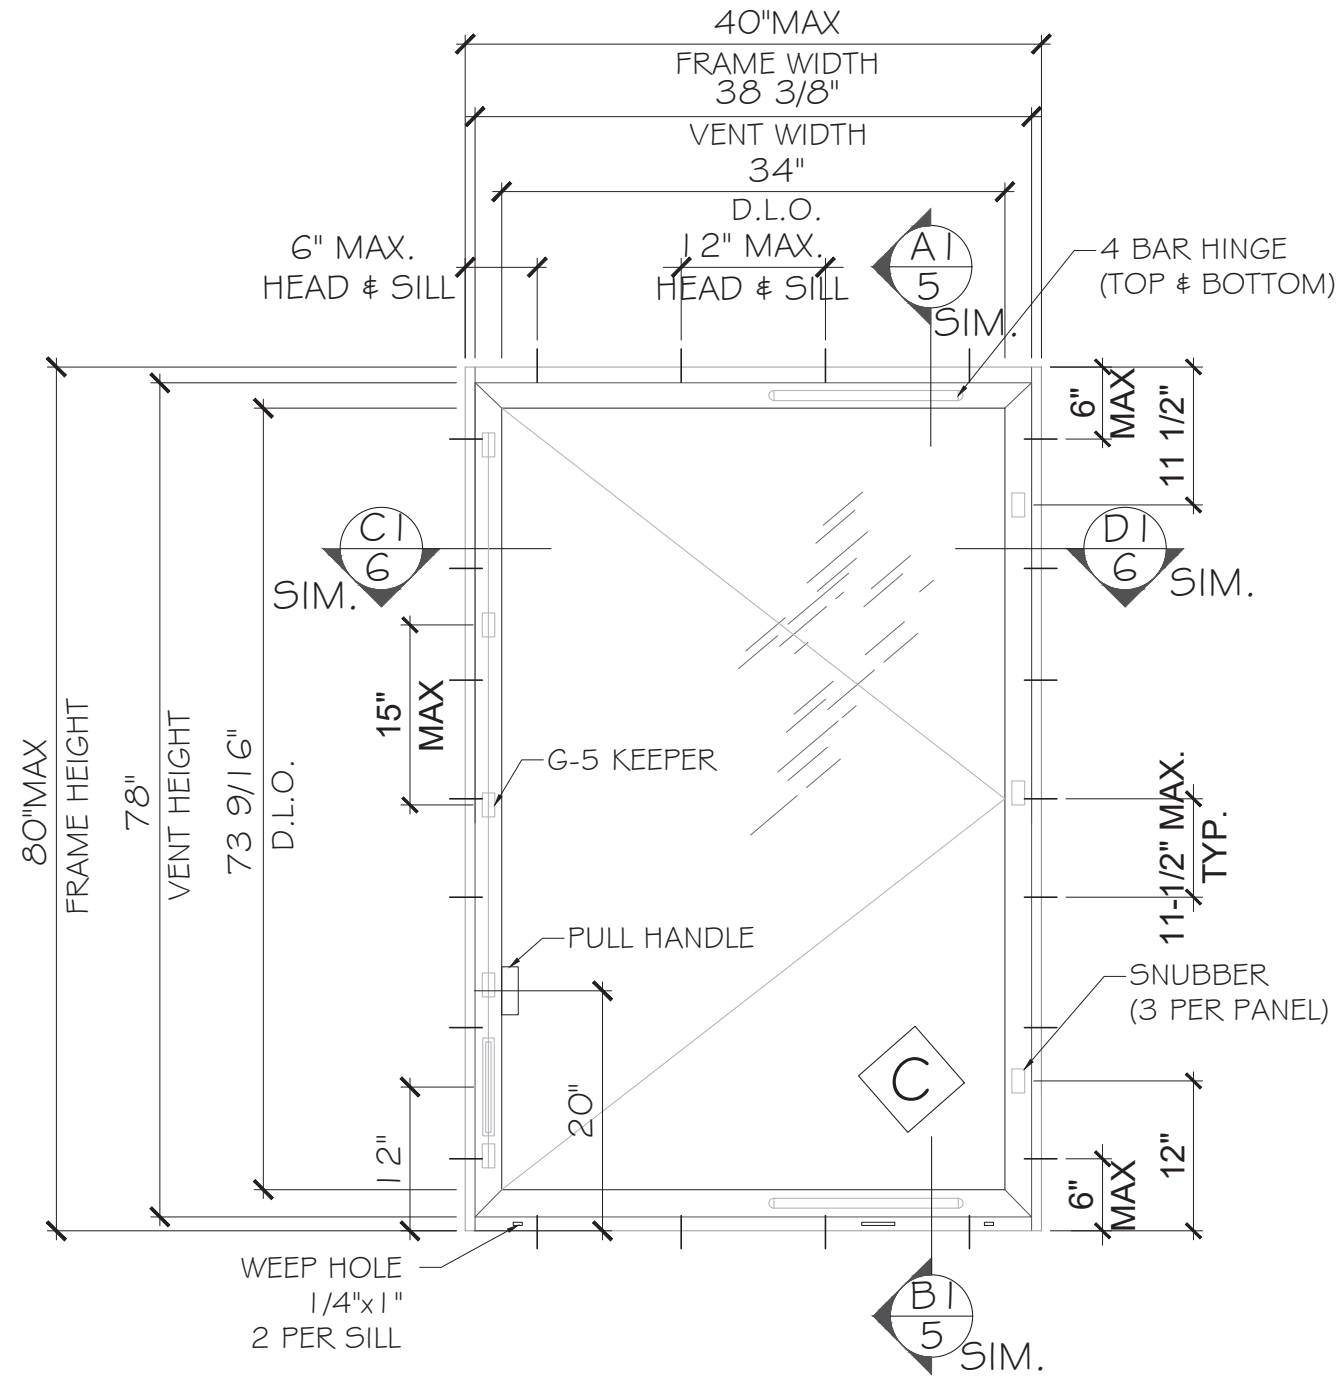

TYPICAL ELEVATION


MAX. DESIGN LOAD (FOR SIZES SHOWN ABOVE OR BELOW)
+70 PSF -75 PSF

D.L.O. WIDTH = WINDOW WIDTH -6"
D.L.O. LENGTH = WINDOW LENGTH -6.4375"

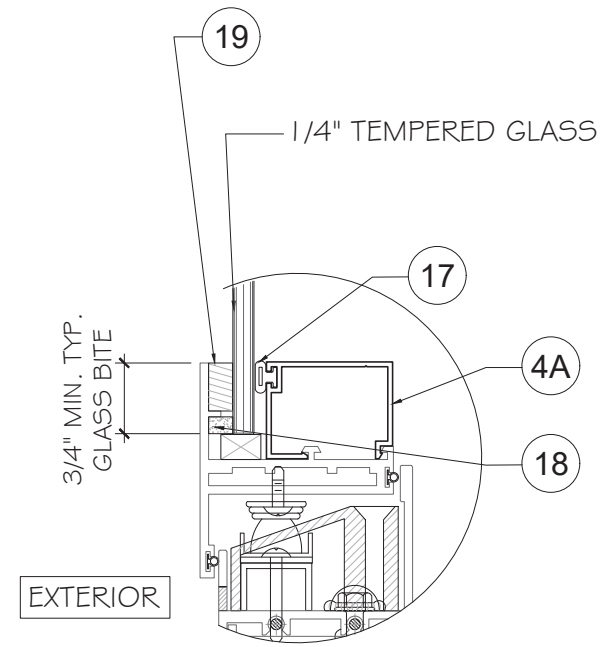

GLASS TYPE "C"

NOTE:
GLASS COMPLIES WITH ASTM E 1300-16
OR 24 (3 SEC. GUSTS).

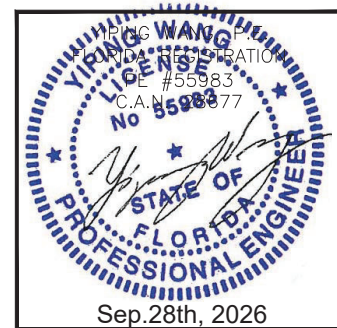

REVISIONS	
NO. DATE	DESCRIPTION
R4 11.16.23	UPDATE TO 2023 PEC
R5 09.28.26	UPDATE TO 2026 PEC

MCY

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY,
SUITE 301
MIRAMAR, FL 33027
www.MCYEngineering.com

SUPERIOR SERIES # 400 ALUM. CASEMENT WINDOW - N.I.




C.T. WINDOWS, LLC.
9195 BOGGY CREEK RD #1
ORLANDO, FL. 32824
P: (407) 857 - 9237 F: (407) 857 - 9247

FL18004.1

DATE	09.28.2026
SCALE	AS SHOWN
DRAWN	James
PROJECT	11-051

DRAWING NO.
AD11-15

SHEET 4 OF 7

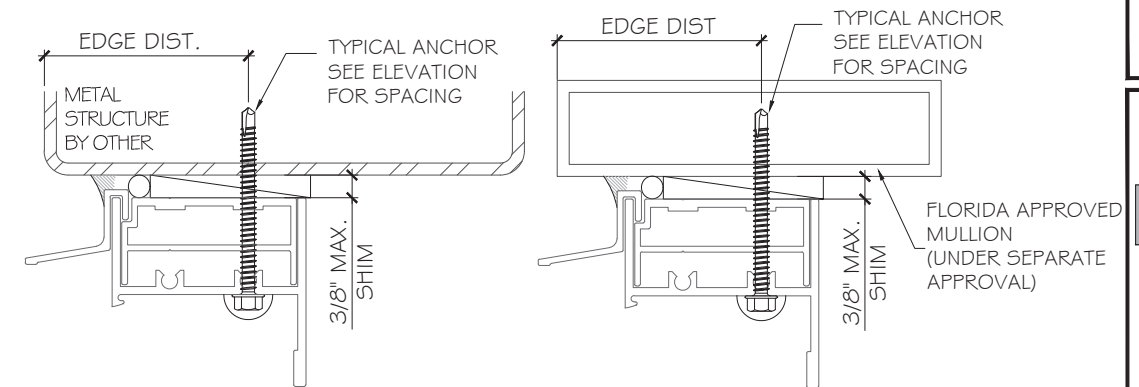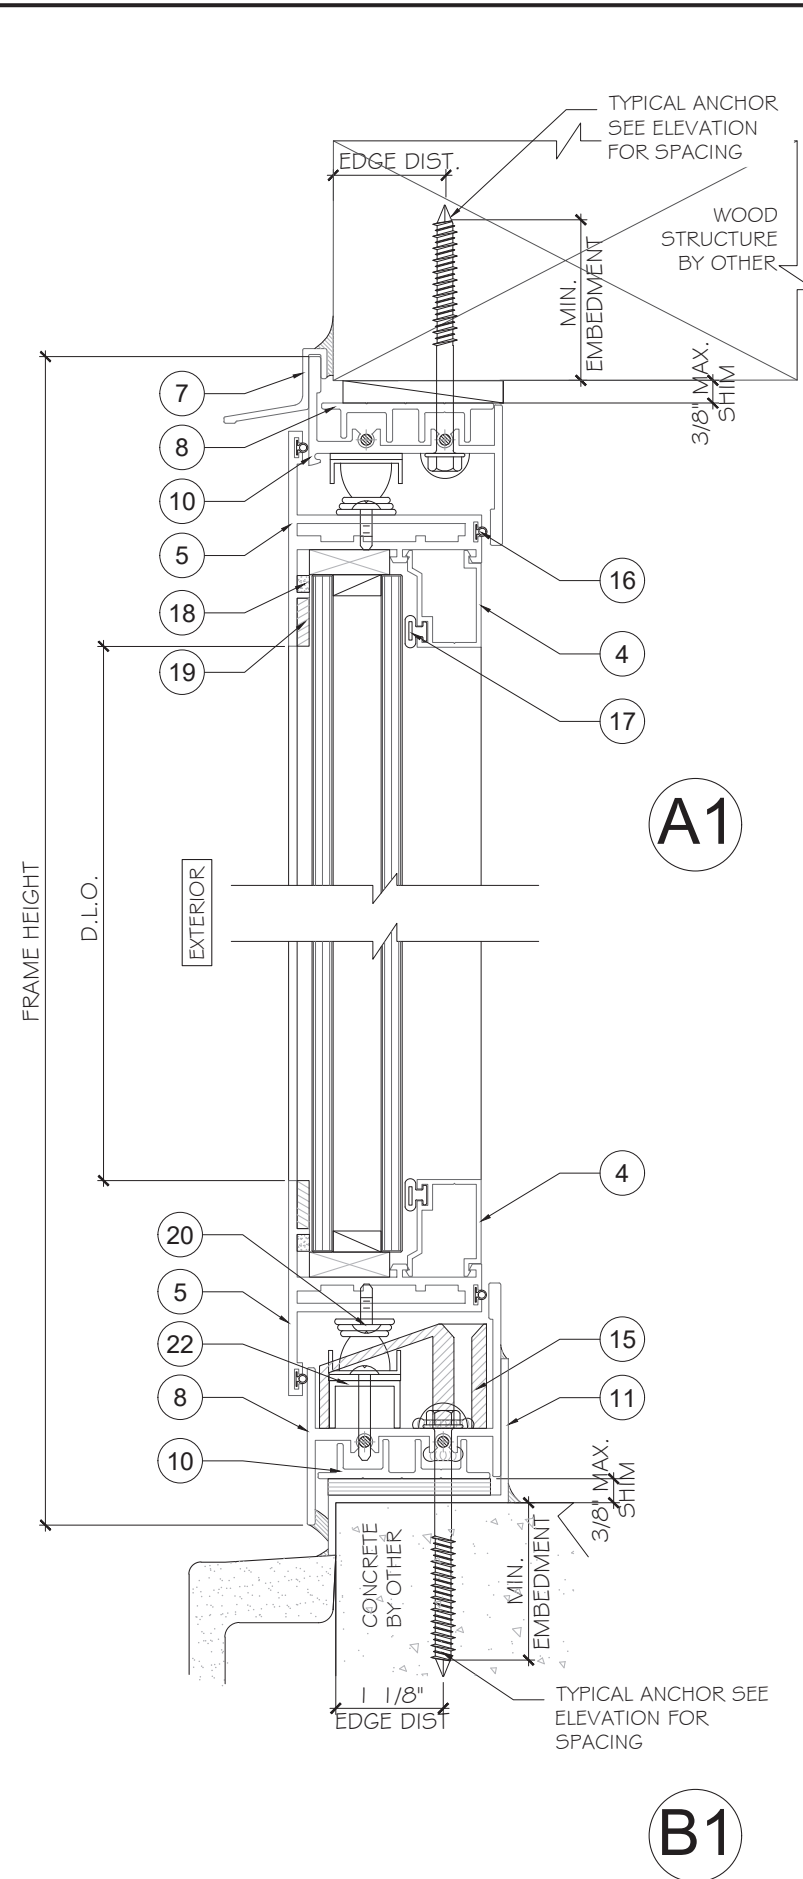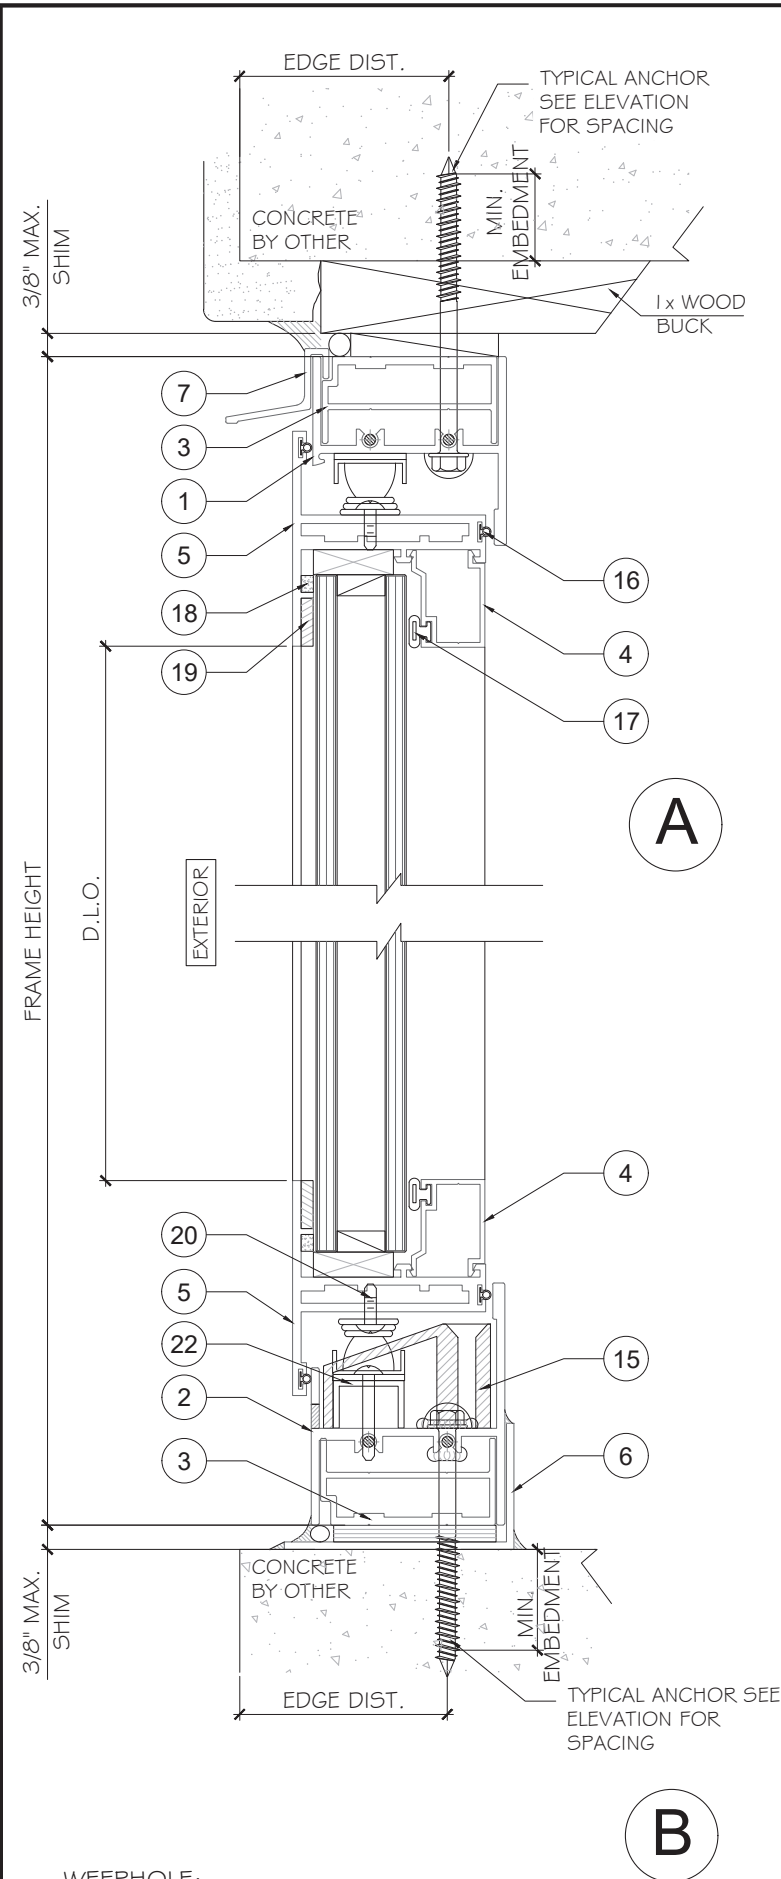

TYPICAL ANCHORS: (SEE ELEVATIONS FOR SPACE)

- TYPE 'A' - 1/4" TAPCONS BY 'ITW' (Fu = 120 KSI, Fy = 92 KSI)
- INTO 2BY WOOD BUCKS OR WOOD STRUCTURE 1-1/2" MIN. PENETRATION INTO WOOD
 - THRU 1 BY BUCKS INTO CONC. OR MASONRY 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 - DIRECTLY INTO CONC. OR MASONRY 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

- TYPE 'B' - 1/4" ULTRACONS BY 'DEWALT' (Fu = 164 KSI, Fy = 148 KSI)
- INTO 2BY WOOD BUCKS OR WOOD STRUCTURE 1-1/2" MIN. PENETRATION INTO WOOD
 - THRU 1 BY BUCKS INTO CONC. OR MASONRY 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 - DIRECTLY INTO CONC. OR MASONRY 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

- TYPE 'C' - 1/4" TEKs OR SELFDRILLING SCREWS (GRADE 5 CRS) INTO METAL STRUCTURES
- STEEL : 1/8" THK MIN (Fy = 36KSI MIN.)
 - ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.) (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

- TYPE 'D' - #14 SMS OR STAINLESS STEEL SCREWS (GRADE 2 CRS) INTO FLORIDA STATE APPROVED MULLIONS

MASONRY
ASTM C90 GROUT FILLED CONCRETE BLOCK
HOLLOW CONCRETE BLOCK


CONCRETE
f_c = 3,000 PSI

ANCHOR EDGE DISTANCES (EXCEPT WHERE NOTED)
INTO CONCRETE = 2" MIN.
INTO MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURES = 1" MIN.
INTO METAL STRUCTURES = 3/4" MIN.

WEEPHOLE:

- 3/4" X 1/4" WEEPHOLES AT FRAME SILL 4" FROM EACH END
- 1 5/16" X 1/4" WEEPHOLE AT MID SPAN OF CAULK JOINT BETWEEN FRAME SILL & SILL PAN

ALL ANCHOR OPTIONS CAN APPLY TO HEAD, SILL AND JAMB ANCHORS.

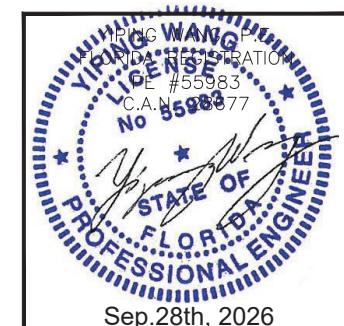



REVISIONS		NO. DATE DESCRIPTION	
		R4	11.16.23 UPDATE TO 2023 FBC
		R5	09.28.26 UPDATE TO 2026 FBC

MCY ENGINEERING, INC. GLAZING CONSULTANTS 12781 MIRAMAR PARKWAY, SUITE 301 MIRAMAR, FL 33027 F: 305.588.5224 www.MCYEngineering.com MCY@mcycyengineering.com		MCY	
---	--	------------	--




SUPERIOR SERIES # 400 ALUM. CASEMENT WINDOW - N.I.		C.T. WINDOWS, LLC. 9195 BOGGY CREEK RD #1 ORLANDO, FL. 32824 P: (407) 857 - 9237 F: (407) 857 - 9247	
--	--	---	--

FL18004.1		DATE 09.28.2026	
		SCALE AS SHOWN	
		DRAWN James	
		PROJECT 11-051	

DRAWING NO. AD11-15		SHEET 5 OF 7	
------------------------	--	--------------	--

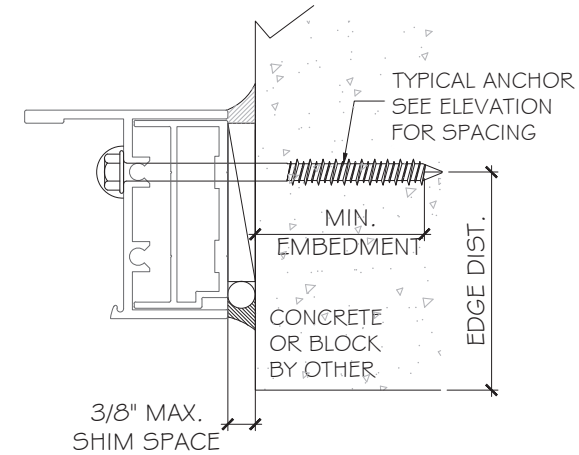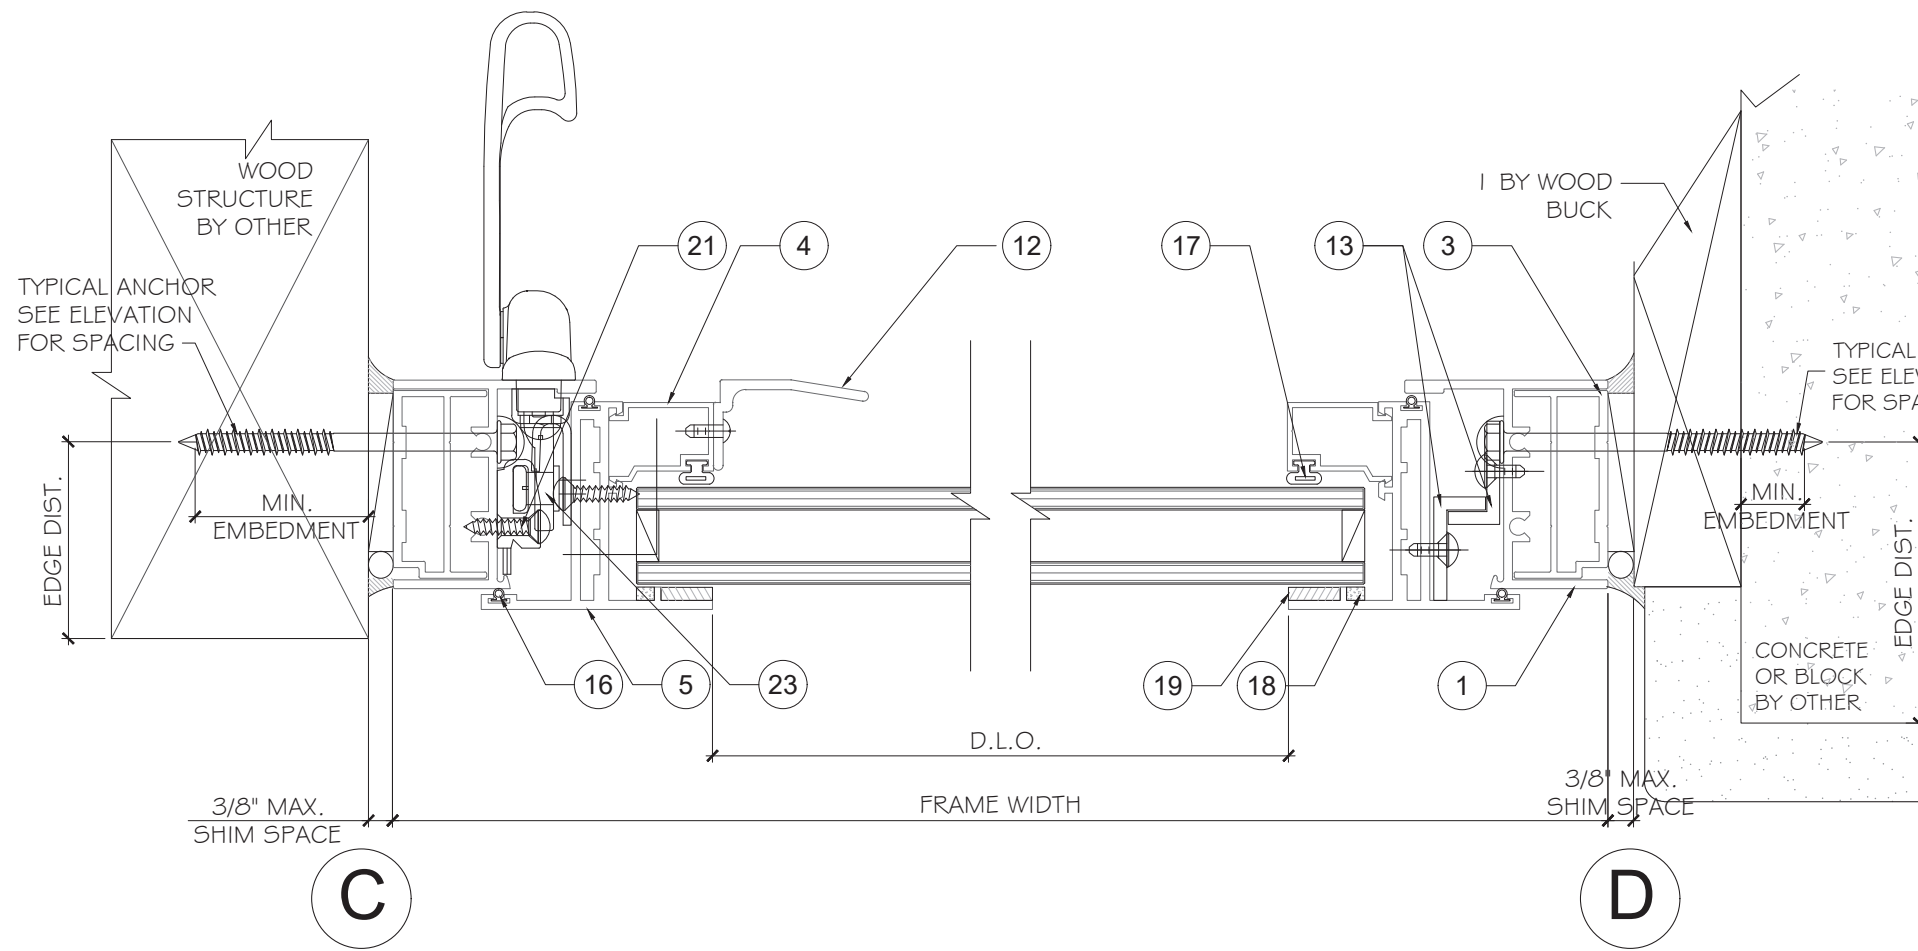

SEALANT:
ALL FRAME CORNERS, VENT CORNERS, FRAME SILL PAN TO SILL (INTERIOR), FRAME SILL TO SUBSTRATE (INTERIOR), FRAME JAMB TO SUBSTRATE (INTERIOR), ALL ASSEMBLY FASTENERS AND FRAME INSTALLATION FASTENERS TO BE SEALED WITH DOW 995













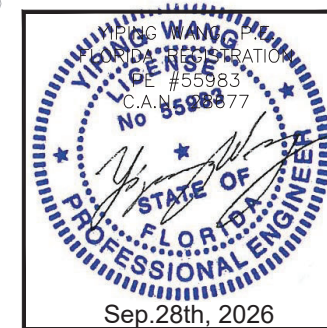
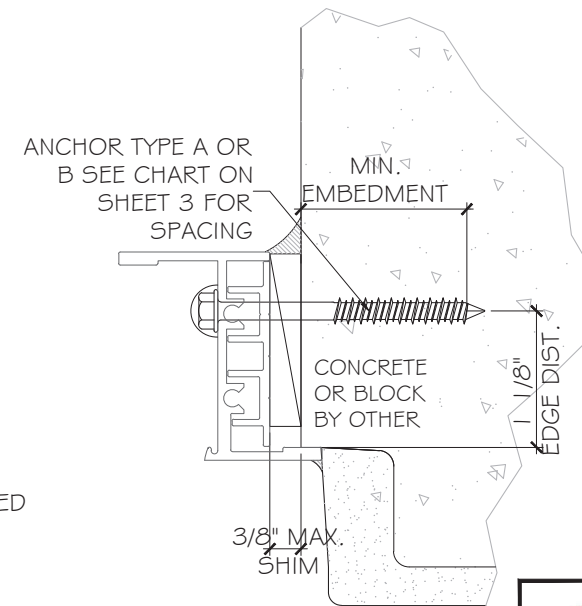
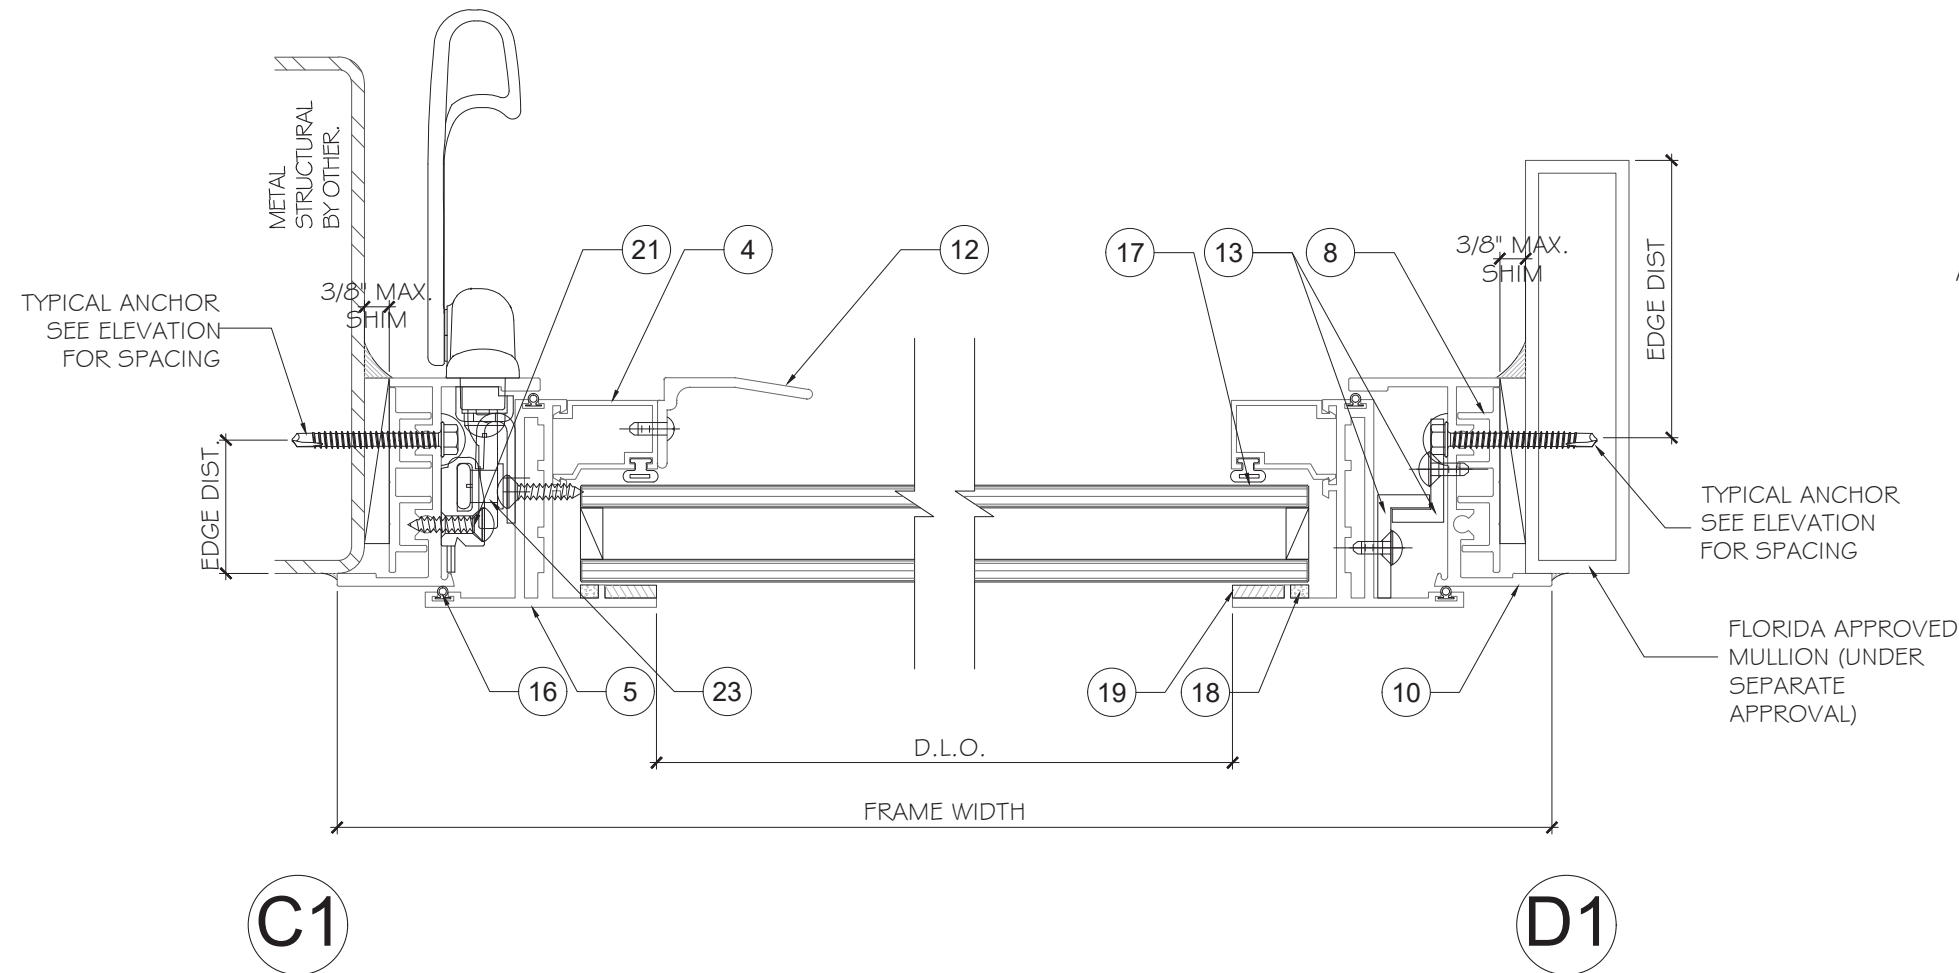



REVISIONS	
NO.	DATE
R4	11.16.23
R5	09.26.26

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY,
SUITE 301
MIRAMAR, FL 33027
F: 305.588.5224
www.MCYEngineering.com MCY@mcycengineering.com


SUPERIOR SERIES # 400 ALUM. CASEMENT WINDOW - N.I.
C.T. WINDOWS, LLC.
9195 BOGGY CREEK RD #1
ORLANDO, FL 32824
P: (407) 857 - 9237 F: (407) 857 - 9247

DATE	09.28.2026
SCALE	AS SHOWN
DRAWN	James
PROJECT	11-051
DRAWING NO.	AD11-15
SHEET	6 OF 7

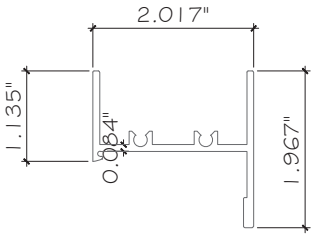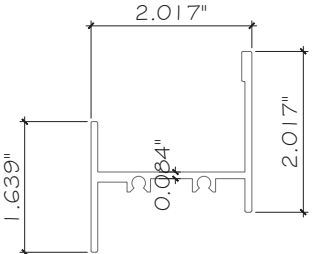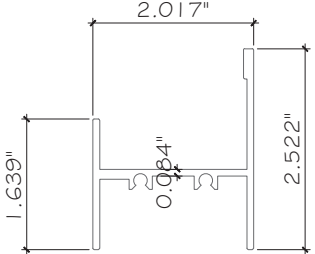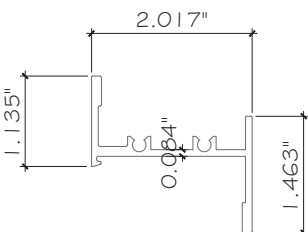 1 CASEMENT EQ. LEG HEAD/JAMB # 9042	 5 VENT SASH FRAME # 9030	 9 CASEMENT FLANGED SILL # 9046	 13 3" SNUBBER
 2 CASEMENT EQUAL LEG SILL # 9000	 6 CASEMENT EQ LEG SILL PAN #8064 (MODIF.)	 10 FLANGED ANCHOR CLIP # 9043	 14 VENT SASH CORNER LOCK # 9008
 3 EQUAL LEG POCKET FILLER # 9052	 7 FRAME HEAD DRIP CAP # 9009	 11 CASEMENT FLANGED SILL PAN # 9045	 22 1/2" x 1/2" x 1/2" x .05" ALUM. CH.
 4 EXTRUDED GLAZING BEAD # 9032	 8 CASEMENT FLANGED HEAD/JAMB # 9012	 12 PULL HANDLE A-21-330	 4A EXTRUDED GLAZING BEAD # 9055

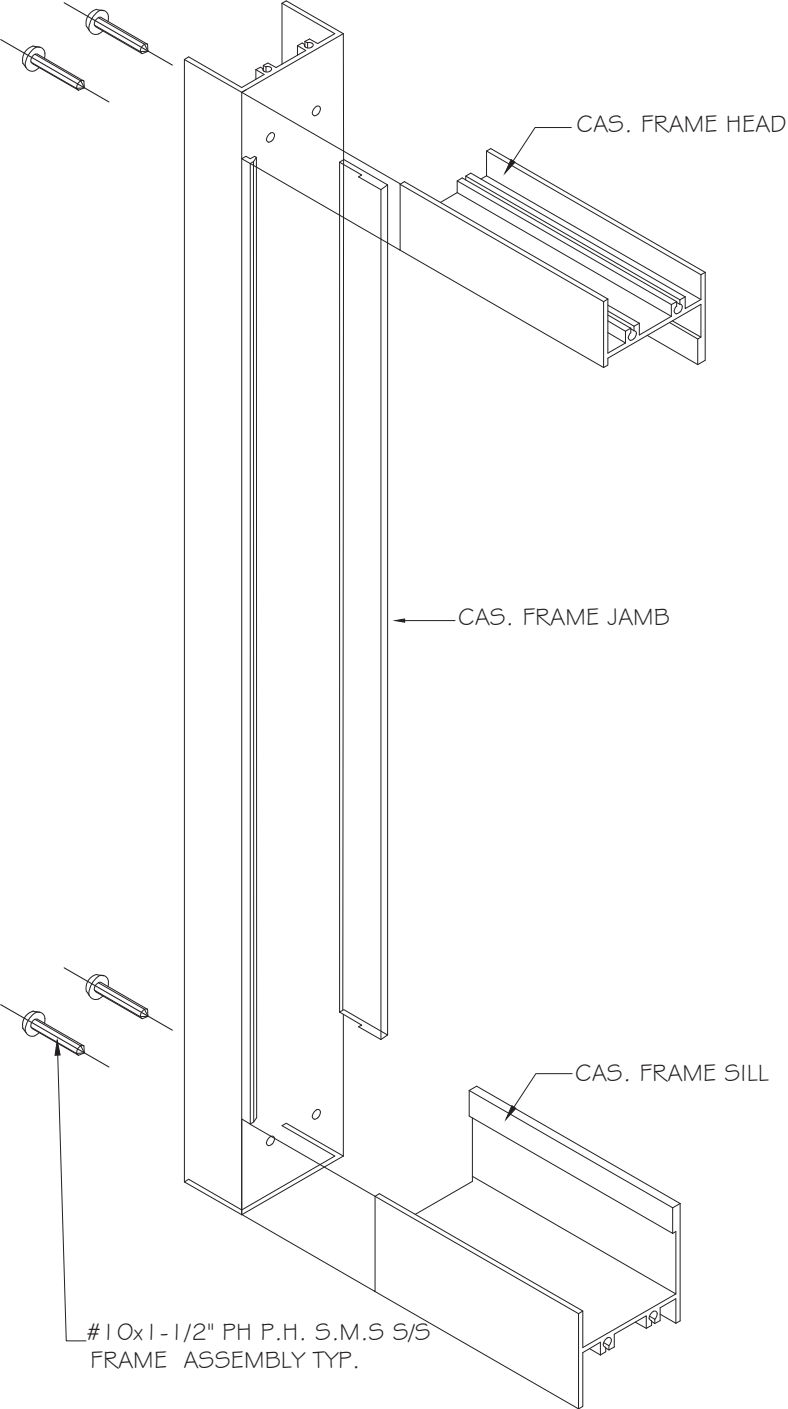

TYPICAL FRAME CONSTRUCTION
ISOMETRIC DETAIL N.T.S.

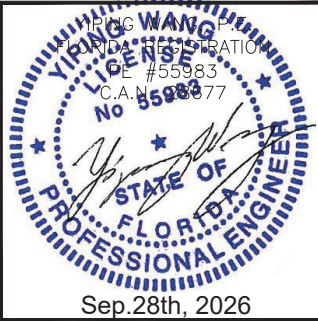

REVISIONS	
NO.	DATE DESCRIPTION
R4	11.16.23 UPDATE TO 2023 PEC
R5	09.28.26 UPDATE TO 2026 PEC

MCY

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY,
SUITE 301
MIRAMAR, FL 33027
F: 305.588.5224
www.MCYEngineering.com MCY@mcyengineering.com


SUPERIOR SERIES # 400 ALUM. CASEMENT WINDOW – N.I.

C.T. WINDOWS, LLC.
9195 BOGGY CREEK RD #1
ORLANDO, FL. 32824
P: (407) 857 - 9237 F: (407) 857 - 9247

FL18004.1	
DATE	09.28.2026
SCALE	AS SHOWN
DRAWN	James
PROJECT	11-051
DRAWING NO. AD11-15	
SHEET 7 OF 7	

BILL OF MATERIALS

ITEM #	QTY.	PROFILE	DESCRIPTION	MATERIAL	MANUFACTURER/REMARKS
1	3 EACH	9042	CASEMENT EQUAL LEG FRAME (HEAD & JAMB)	ALUM. 6063-T5	C. T. WINDOWS LLC.
2	1 EACH	9000	CASEMENT EQUAL LEG SILL	ALUM. 6063-T5	C. T. WINDOWS LLC.
3	4 EACH	9052	EQUAL LEG POCKET FILLER	ALUM. 6063-T5	C. T. WINDOWS LLC.
4(4A)	4 EACH	9032(9055)	EXTRUDED GLAZING BEAD	ALUM. 6063-T5	C. T. WINDOWS LLC.
5	4 EACH	9030	VENT SASH FRAME (HEAD, JAMB & SILL)	ALUM. 6063-T5	C. T. WINDOWS LLC.
6	1 EACH	8064 (MODIF.)	CASEMENT EQUAL LEG EXTRUDED ALUM. SILL PAN	ALUM. 6063-T5	C. T. WINDOWS LLC.
7	1 EACH	9009	FRAME HEAD DRIP CAP	ALUM. 6063-T5	C. T. WINDOWS LLC.
8	3 EACH	9012	CASEMENT FLANGED FRAME (HEAD & JAMB)	ALUM. 6063-T5	C. T. WINDOWS LLC.
9	1 EACH	9046	CASEMENT FLANGED SILL	ALUM. 6063-T5	C. T. WINDOWS LLC.
10	AS REQ'D	9043	FLANGED ANCHOR CLIP	ALUM. 6063-T5	C. T. WINDOWS LLC. / ONE PER ANCHOR
11	1 EACH	9045	CASEMENT FLANGED EXTRUDED ALUM. SILL PAN	ALUM. 6063-T5	C. T. WINDOWS LLC.
12	1 EACH	A-21-330	PULL HANDLE	ALUM. 6063-T5	C. T. WINDOWS LLC. / WITH (2) #10x1-1/2" PH SMS
13	5 PAIRS	-	3" LONG SNUBBER (1/2" x 1" .125 THK ANGLE)	ALUM. 6063-T5	C. T. WINDOWS LLC. / WITH (4) #8 x 1/2" FH SMS
14	4 EACH	9008	VENT SASH CORNER LOCK	ALUM. 6063-T5	C. T. WINDOWS LLC.
15	1 EACH	A-16-97	MASTER TOOL VENT RISER BLOCK (DELFIN)	NYLON	WITH (1) - 10 x 1-1/2" FH SMS
16	AS REQD.	2288	PROTOTYPE INC. VENT WEATHER STRIP	VINYL BULB	PROTOTYPE INC.
17	AS REQD	3220	WEATHER STRIP VINYL BULB	VINYL	PROTOTYPE INC.
18	AS REQD	5026N	FOAM TAPE BLACK GLAZING TAPE (3/16"OR5/16" x 1/4")	URETHANE FOAM	-
19	AS REQD.	995-DR	3/16"OR5/16" X 1/2" DOW 995 GREY SILICONE GLAZING COMPOND	SILICONE	DOWSIL
20	2 EACH	5012-15	4 BAR HINGE LOCATED AT HEAD & SILL 8" FROM HINGE JAMB	300 STAINLESS STL.	MAGNUM USA / (4) #10 x 1/2" PAN PH. SMS S/S & (4) #10 PH SMS TO VENT
21	1 EACH	LBO6-2300	KEEPER	300 STAINLESS STL.	MAGNUM USA / (4) #8 x 1/2" FT HD PH SMS S/S WITH #6 HD U/C
22	1 EACH	-	1/2" x 1/2" x 1/2" x .05" ALUM. CH.	ALUM. 6063-T5	C. T. WINDOWS LLC.
23	1 EACH	LBO6-7790	G6 LOCKBAR WITH 5 ADJUSTABLE ALUMINUM PINS	300 STAINLESS STL.	WITH (2) #8 - 32 x 1/2" PH MS
24	AS REQD.	-	ALUMINUM SPACER	ALUM. 6063-T5	VARIES

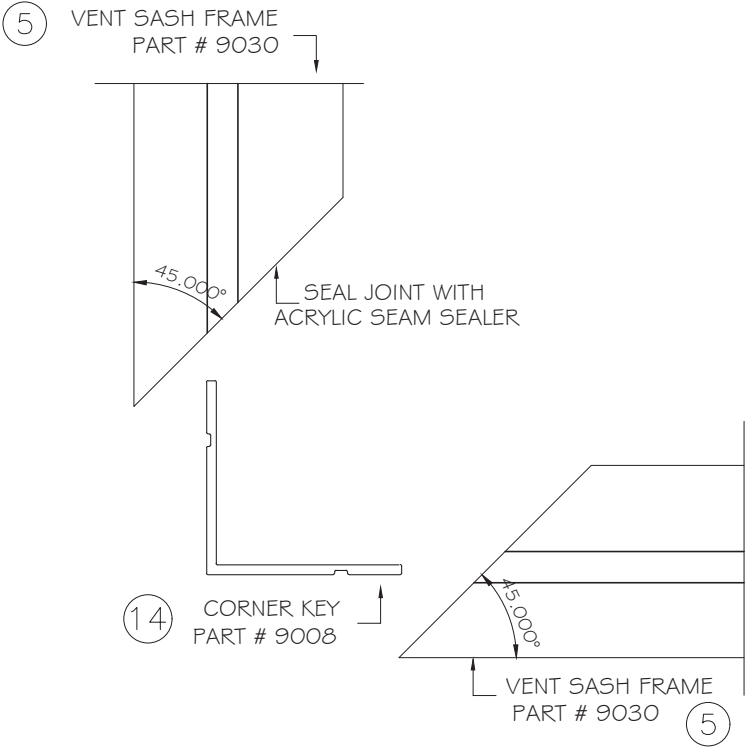

TYPICAL VENT CORNER ASSEMBLY

ALL VENTILATORS SHALL HAVE MITERED JOINTS, REINFORCED BY A SOLID CORNER KEY AND MECHANICALLY CRIMPED TO PREVENT CORNER ROTATION. ALL JOINTS SHALL BE SEALED WITH AN ACRYLIC SEAM SEALER.

REVISIONS	
NO.	DATE DESCRIPTION
R4	11.16.23 UPDATE TO 2023 PEC
R5	09.28.26 UPDATE TO 2026 PEC

MCY

MCY ENGINEERING, INC.

GLAZING CONSULTANTS

12781 MIRAMAR PARKWAY,
SUITE 301
MIRAMAR, FL 33027

F: 305.588.5224
www.MCYEngineering.com
MCY@mcyengineering.com

SUPERIOR SERIES # 400 ALUM. CASEMENT WINDOW – N.I.

C.T. WINDOWS, LLC.
9195 BOGGY CREEK RD #1
ORLANDO, FL. 32824
P: (407) 857 - 9237 F: (407) 857 - 9247

FL18004.1	
DATE	09.28.2026
SCALE	AS SHOWN
DRAWN	James
PROJECT	11-051
DRAWING NO. AD11-15	
SHEET 8 OF 7	

YIPING WANG
REGISTERED PROFESSIONAL ENGINEER
No. 55983
C.A.N. 859877

STATE OF FLORIDA
PROFESSIONAL ENGINEER

Sep.28th, 2026