

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE PER NEW CODE	10/19/2022	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ.
2. STEEL FRAMING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
4. PLATE MATERIAL: 0.125" THICK 3003-H14 ALUMINUM.
5. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
6. FOR ANCHORING PANELS INTO EXTRUSIONS USE #9 X 3/4" COUNTERSUNK HEAD SELF DRILLING 304 STAINLESS STEEL. LOCATE 6" FROM EACH END AND 12" MAX O.C. THEREAFTER AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
7. FOR ANCHORING EXTRUSIONS INTO METAL STRUCTURE USE #12 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL WITH 5/8" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
8. ALL FASTENERS TO BE CORROSION RESISTANT.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

A. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .125" THICK MINIMUM

SIGNED: 08/04/2026

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS
3 – 6	INSTALLATION DETAILS
7	COMPONENTS

MILLERCLAPPERTON
8050 TROON CIRCLE
AUSTELL, GA 30168

3150 ALUMINUM PLATE WALL PANEL SYSTEM
IMPACT – HVHZ
NOTES

DRAWN:
A.R.

DWG NO.
08-03491


REV
A

SCALE NTS


DATE 10/03/19

SHEET 1 OF 7

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

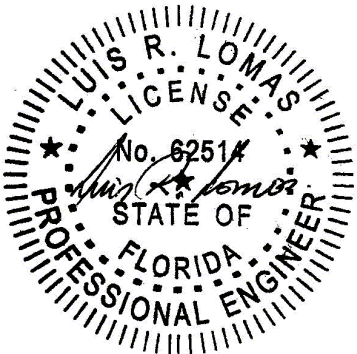

Luis R. Lomas P.E.
FL No.: 62514

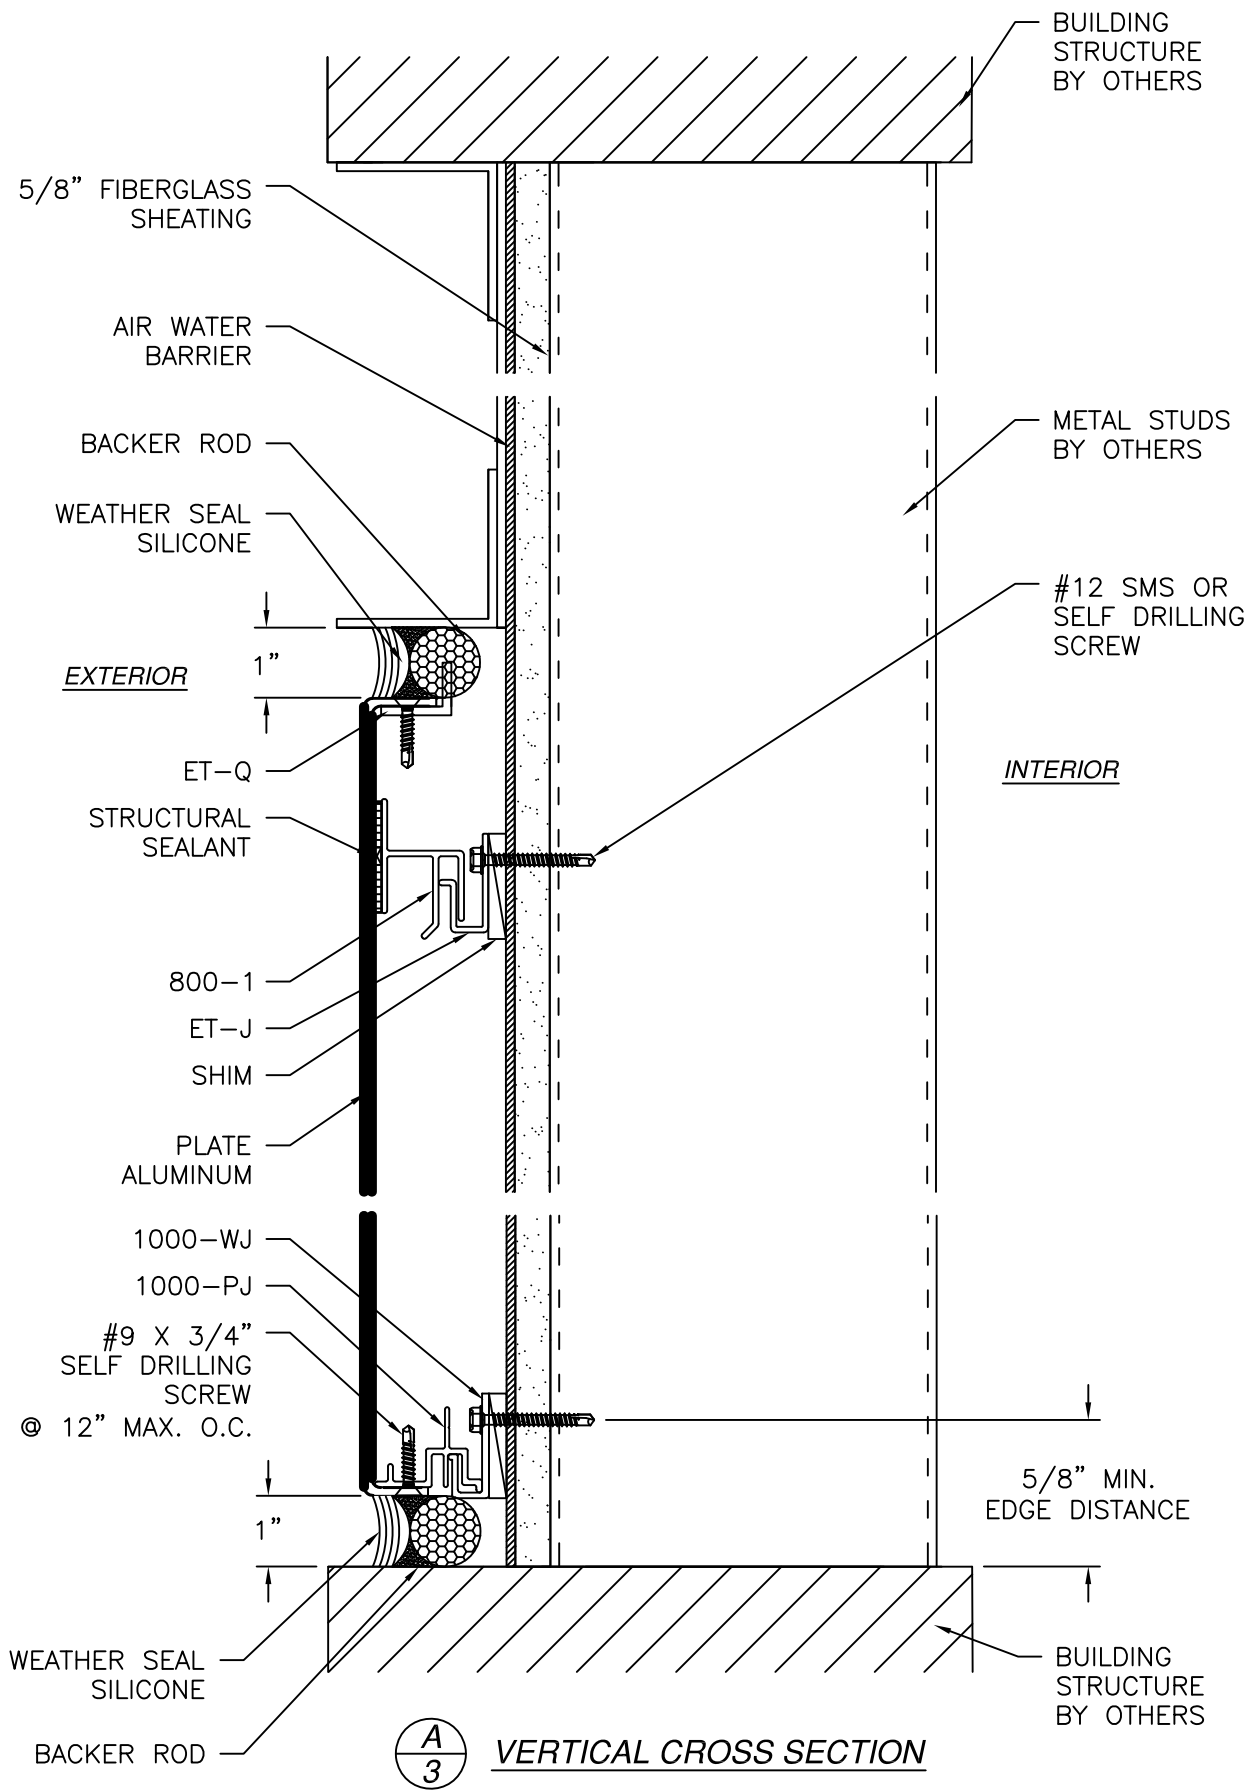


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE PER NEW CODE	10/19/2022	R.L.

- NOTES:
- INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 - PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 08/04/2026

MILLERCLAPPERTON 8050 TROON CIRCLE AUSTELL, GA 30168		
3150 ALUMINUM PLATE WALL PANEL SYSTEM IMPACT - HVHZ INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-03491	REV A
SCALE NTS	DATE 10/03/19	SHEET 3 OF 7
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

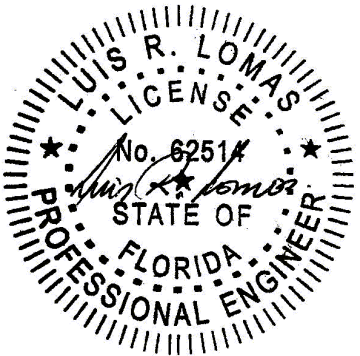

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE PER NEW CODE	10/19/2022	R.L.

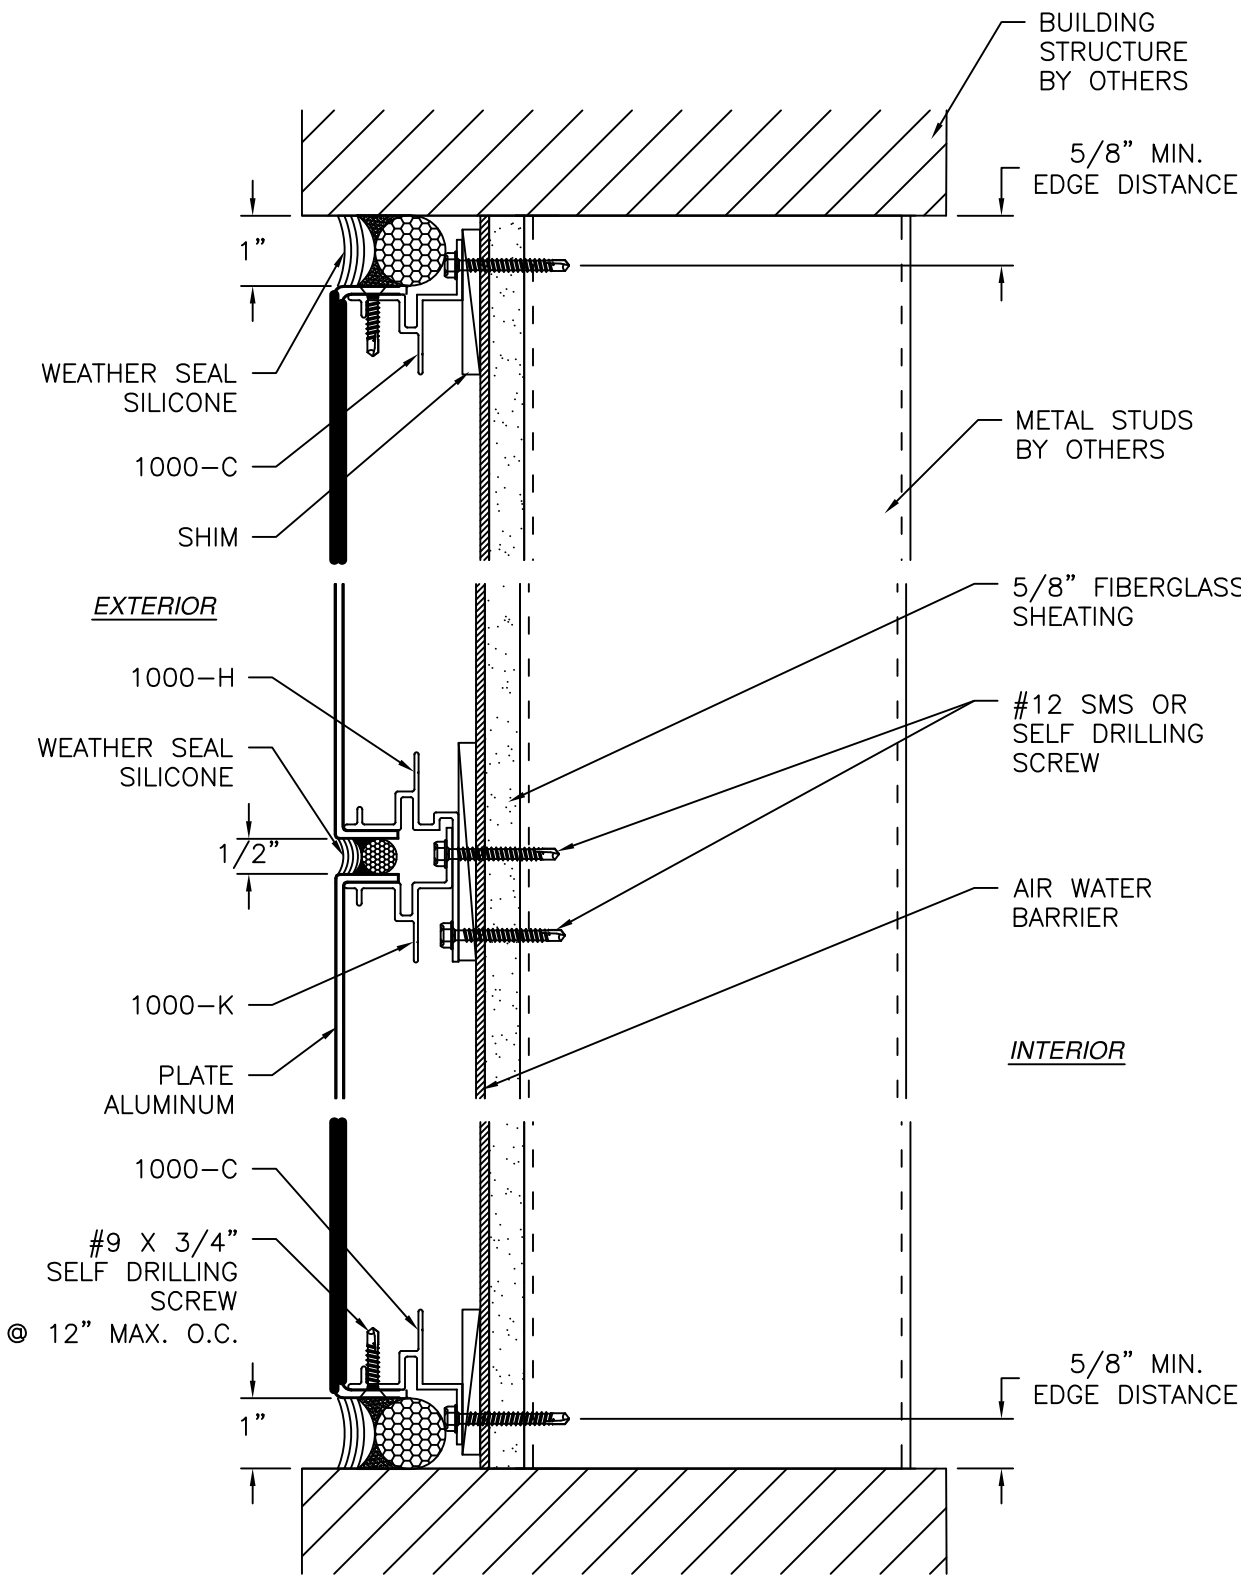

B
4
VERTICAL CROSS SECTION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

MILLERCLAPPERTON

8050 TROON CIRCLE
AUSTELL, GA 30168

3150 ALUMINUM PLATE WALL PANEL SYSTEM

IMPACT – HVHZ

INSTALLATION DETAILS

DRAWN: A.R.

DWG NO. 08-03491

REV A

SCALE NTS

DATE 10/03/19


SHEET 4 OF 7

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903


434-688-0609 rllomas@lrlomaspe.com

SIGNED: 08/04/2026

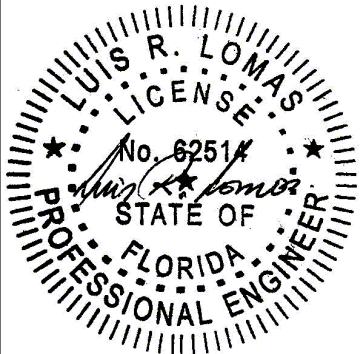

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE PER NEW CODE	10/19/2022	R.L.

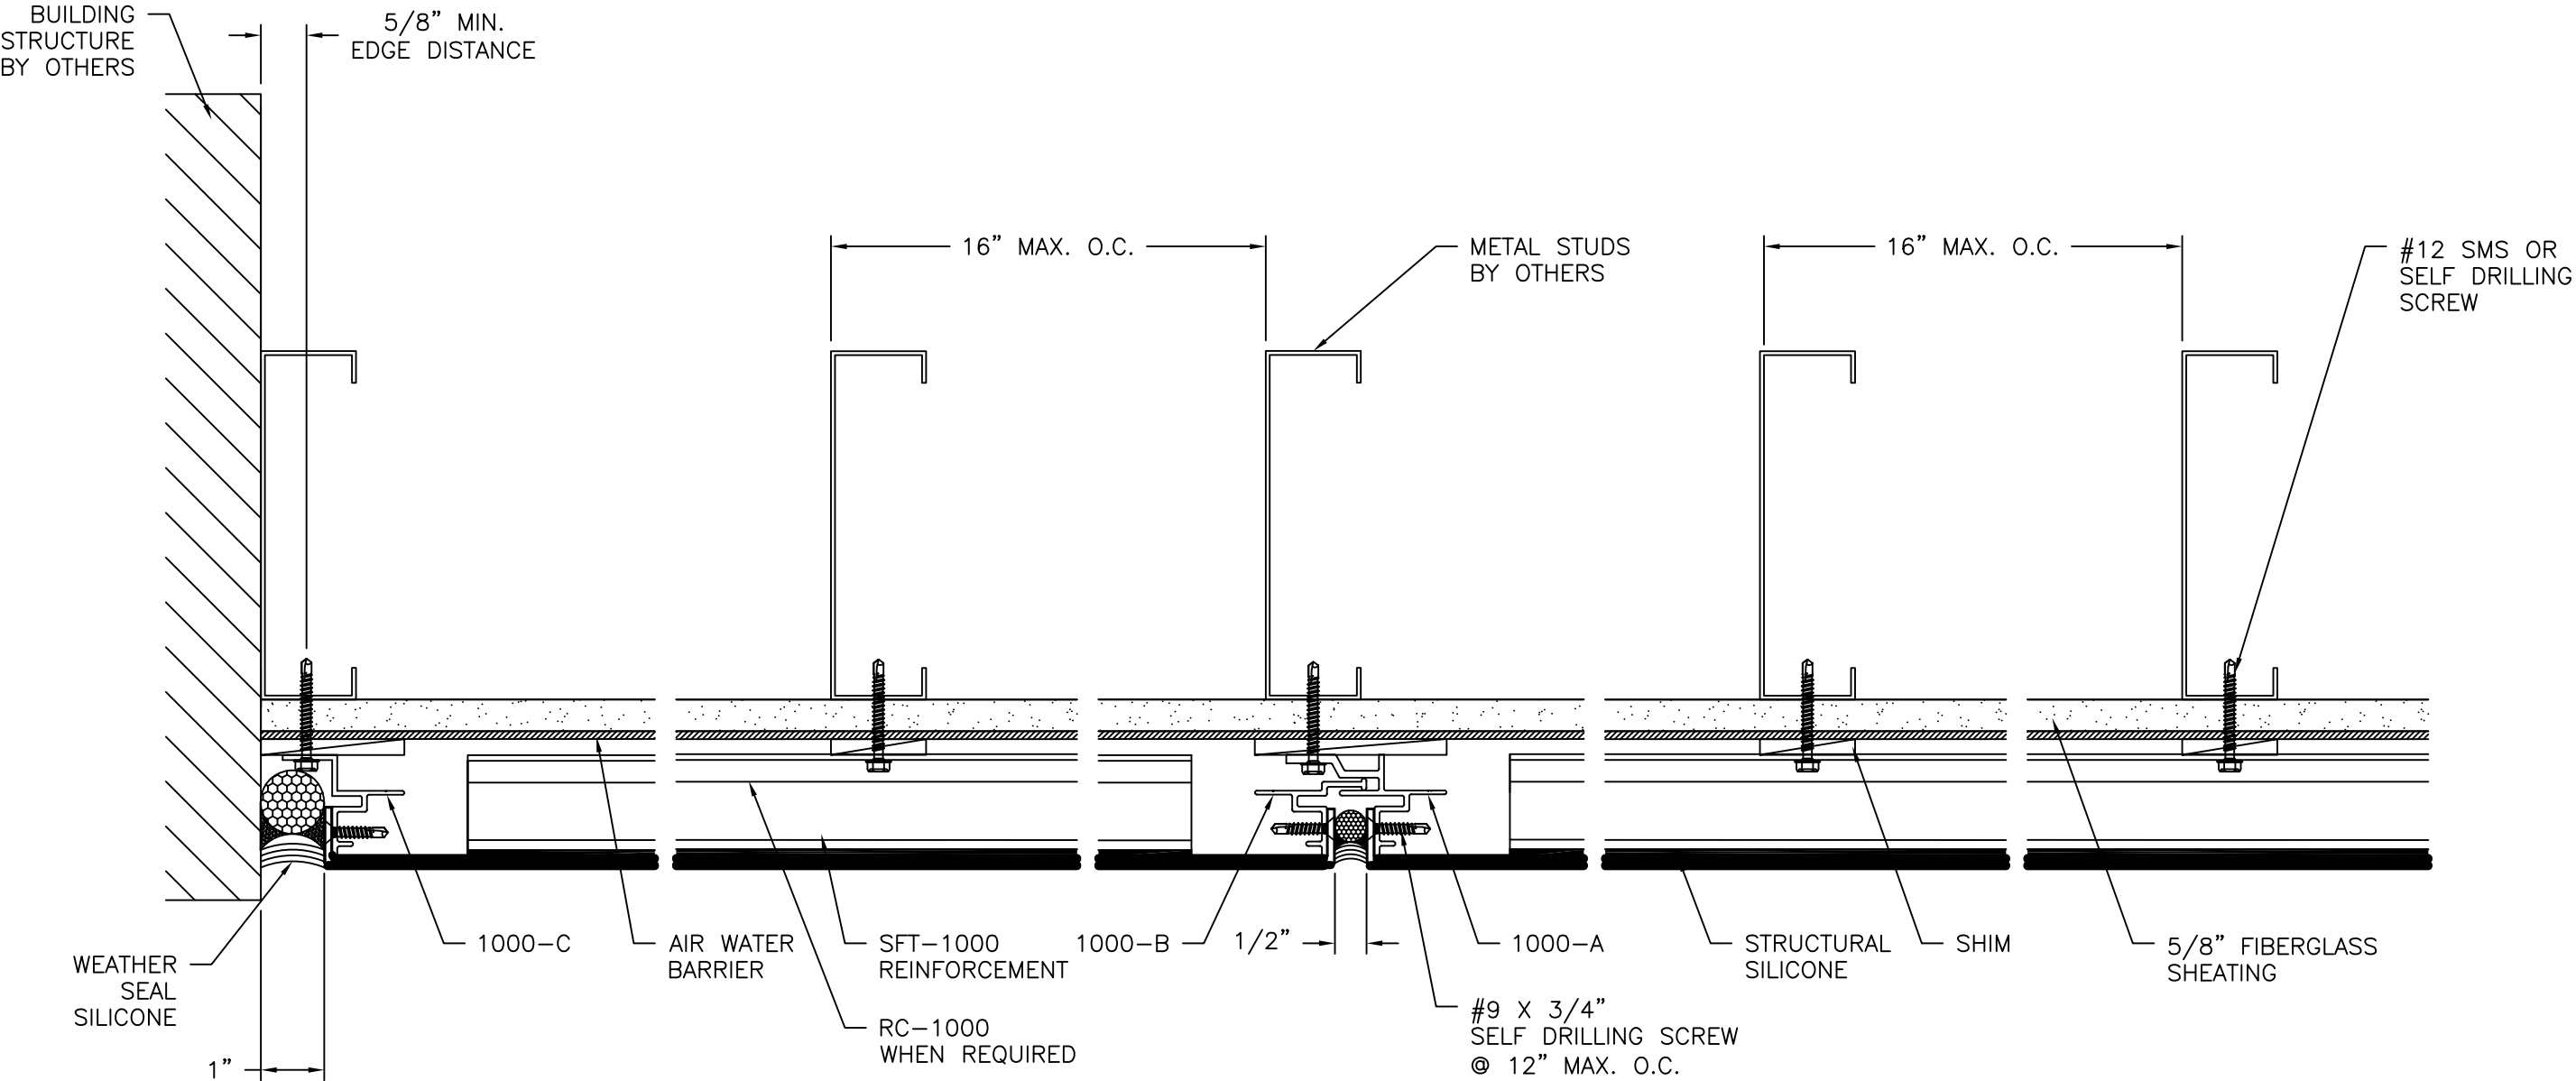


C
5 HORIZONTAL CROSS SECTION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



MILLERCLAPPERTON 8050 TROON CIRCLE AUSTELL, GA 30168		
3150 ALUMINUM PLATE WALL PANEL SYSTEM IMPACT – HVHZ INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-03491	REV A
SCALE NTS	DATE 10/03/19	SHEET 5 OF 7
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 08/04/2026

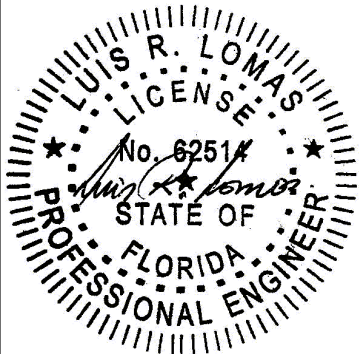


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE PER NEW CODE	10/19/2022	R.L.

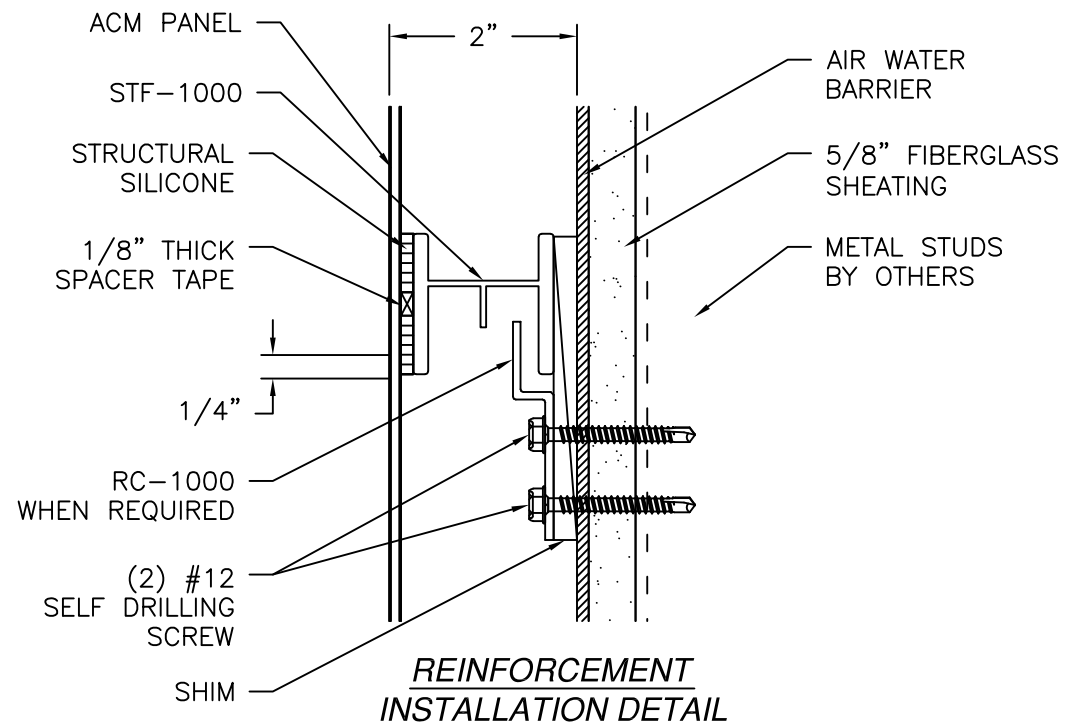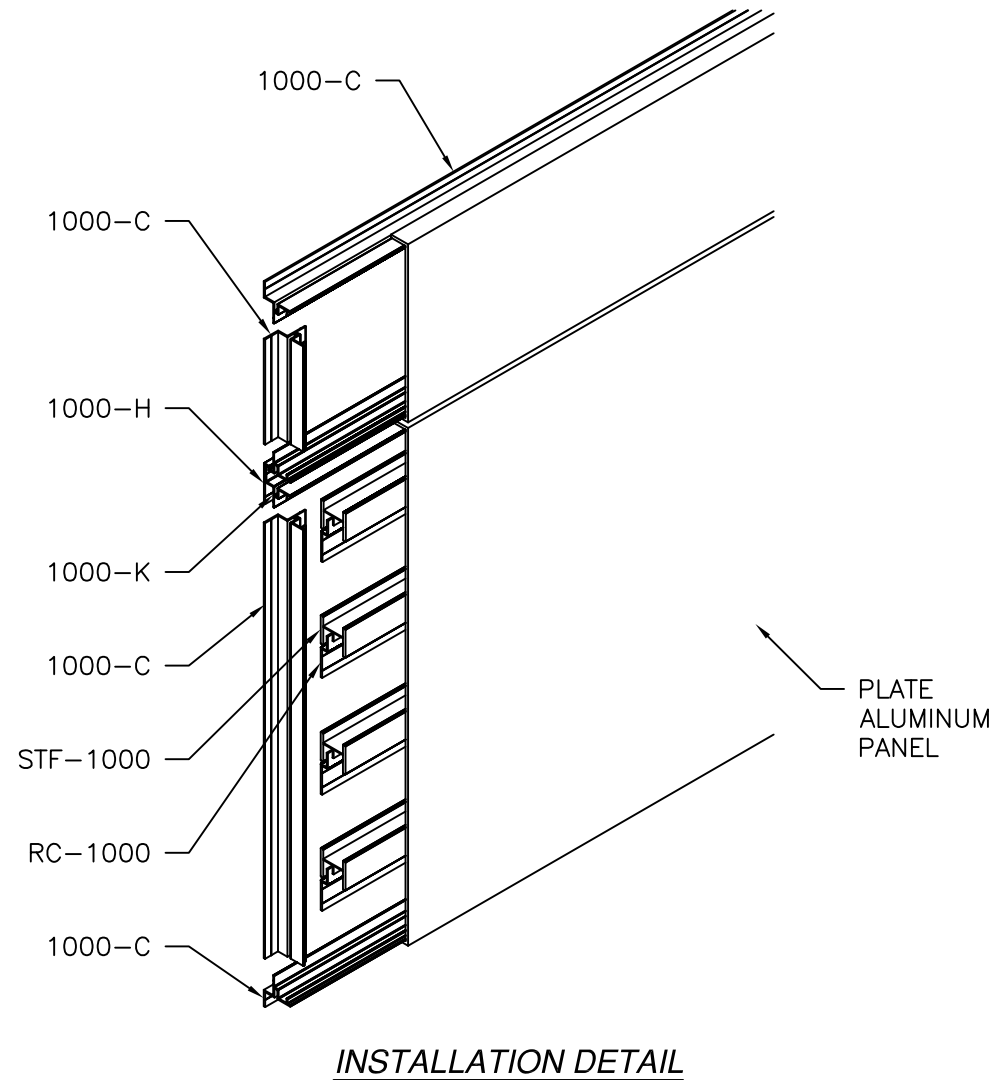


SIGNED: 08/04/2026

MILLERCLAPPERTON 8050 TROON CIRCLE AUSTELL, GA 30168		
3150 ALUMINUM PLATE WALL PANEL SYSTEM IMPACT - HVHZ INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-03491	REV A
SCALE NTS	DATE 10/03/19	SHEET 6 OF 7
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

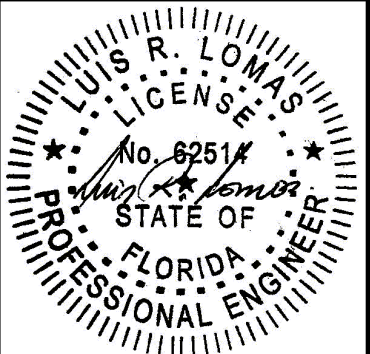


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	UPDATE PER NEW CODE	10/19/2022	R.L.

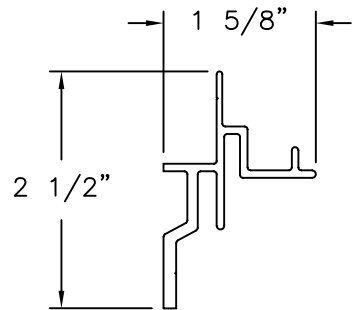


1000-A
ALUMINUM 6005A-T6 (.080" THICK)

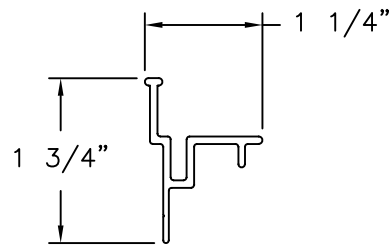


1000-B
ALUMINUM 6005A-T6 (.080" THICK)

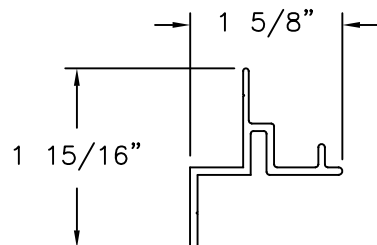


1000-C
ALUMINUM 6005A-T6 (.080" THICK)

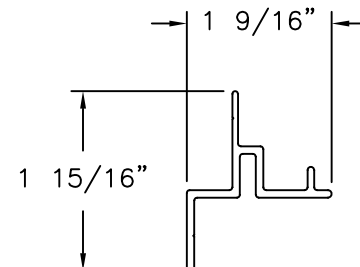


1000-K
ALUMINUM 6005A-T6 (.080" THICK)

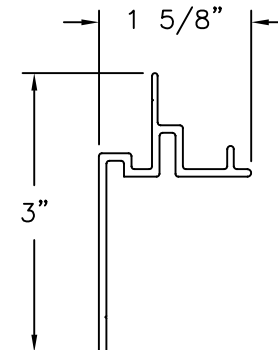


1000-H
ALUMINUM 6005A-T6 (.080" THICK)

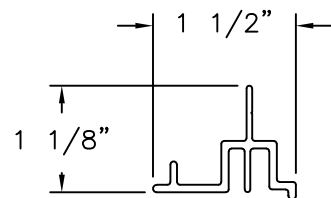


1000-PJ
ALUMINUM 6005A-T6 (.080" THICK)




1000-WJ
ALUMINUM 6005A-T6 (.100" THICK)

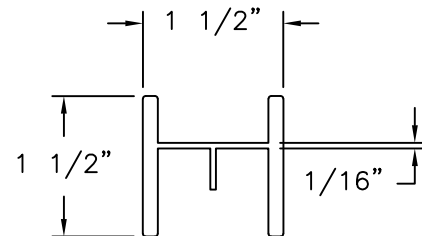


STF-1000
ALUMINUM 6063-T6 (.160" THICK)

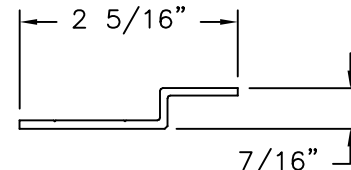


RC-1000
ALUMINUM 6063-T6 (.125" THICK)



ET-Q
ALUMINUM 6063-T6 (.125" THICK)

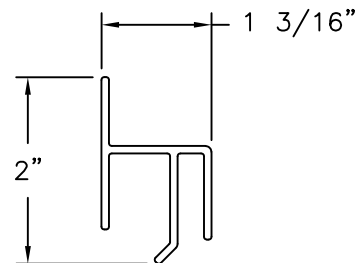

800-1
ALUMINUM 6063-T6 (.080" THICK)



ET-J
ALUMINUM 6063-T6 (.080" THICK)

SIGNED: 08/04/2026

MILLERCLAPPERTON 8050 TROON CIRCLE AUSTELL, GA 30168		
3150 ALUMINUM PLATE WALL PANEL SYSTEM IMPACT – HVHZ COMPONENTS		
DRAWN: A.R.	DWG NO. 08-03491	REV A
SCALE NTS	DATE 10/03/19	SHEET 7 OF 7
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

Luis R. Lomas P.E.
FL No.: 62514