





GENERAL NOTES

1. This product has been evaluated and is in compliance with the 7th Edition (2020) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ", this product complies with Section 1626 of the FBC and does not require an impact resistant covering.
4. This "IMPACT" door jamb, as a component, is to be used as a substitute to a similar door jamb in an impact approval (complies with Section 1626 of the FBC) door system possessing a current Florida Statewide Product Approval (Including the "HVHZ").
5. The design pressure of the assembly shall be the lesser of the design pressure for the door jamb shown in this approval or the design pressure of the door assembly used in conjunction with this approval.
6. The maximum frame size of the door assembly shall be lesser of the maximum frame size stated in this approval or the maximum frame size of door assembly approval used in conjunction with this approval.
7. Refer to the separate Florida Product Approval for the swing door used in conjunction with this component approval to determine the ability of the system to meet the water infiltration requirements for the "HVHZ".
8. Air and water infiltration qualifications to be reviewed by the Building Official.
9. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.


TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Elevations
3	Horizontal cross sections
4	Vertical cross sections
5	Buck and frame anchoring
6	Buck and frame anchoring
7	Bill of materials and components

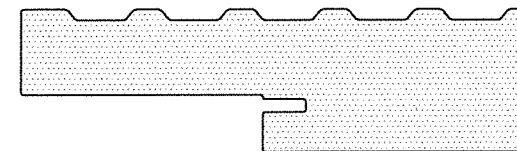

Sure Jamb

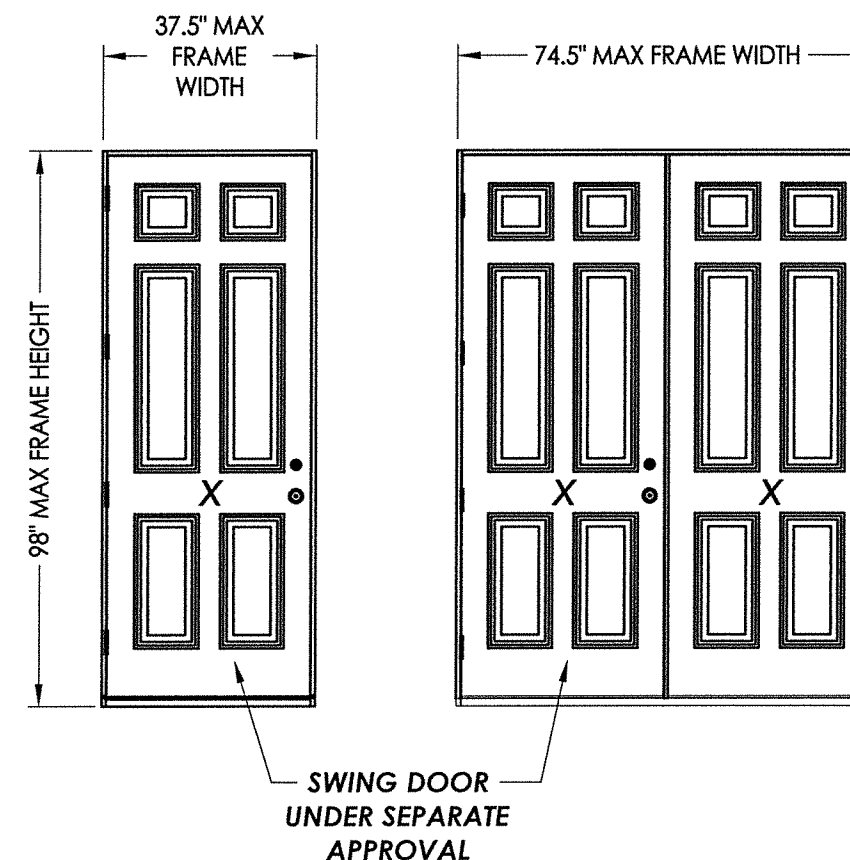

CONFIGURATION	MAX. FRAME DIMENSION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	37.5" x 98.0"	+70.0	-70.0	+70.0	-70.0
XX	74.5" x 98.0"	+45.0	-50.0	+50.0	-50.0

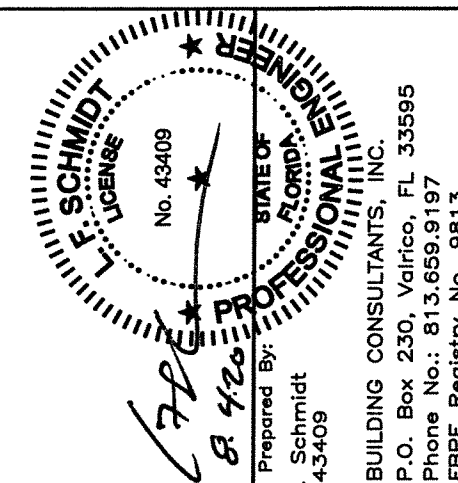

PRODUCT: HM SURE ROCK

PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES

[illegible]


DATE:	10/18/17
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-18385.2
SHEET	1 OF 7

SHEET 2 OF 7

© 2017 R.W. BUILDING CONSULTANTS INC.


P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

2 HORIZONTAL CROSS SECTION
3 Shown w/1X sub-buck


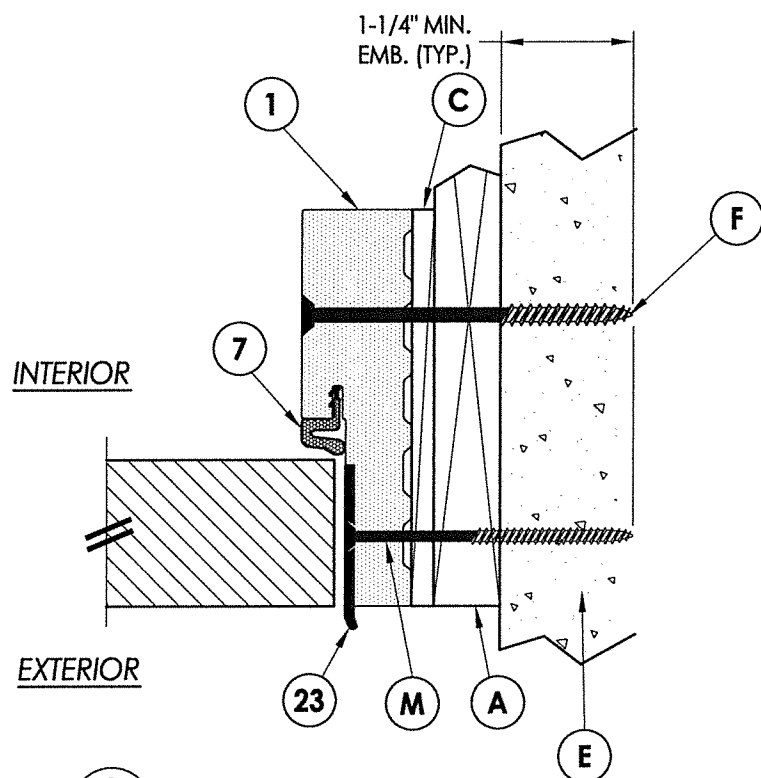


See separate side-hinged door Product Approval for door construction details not shown, including lock hardware, astragal, hinge and threshold connections.

3 HORIZONTAL CROSS SECTION
3 Shown Direct to masonry

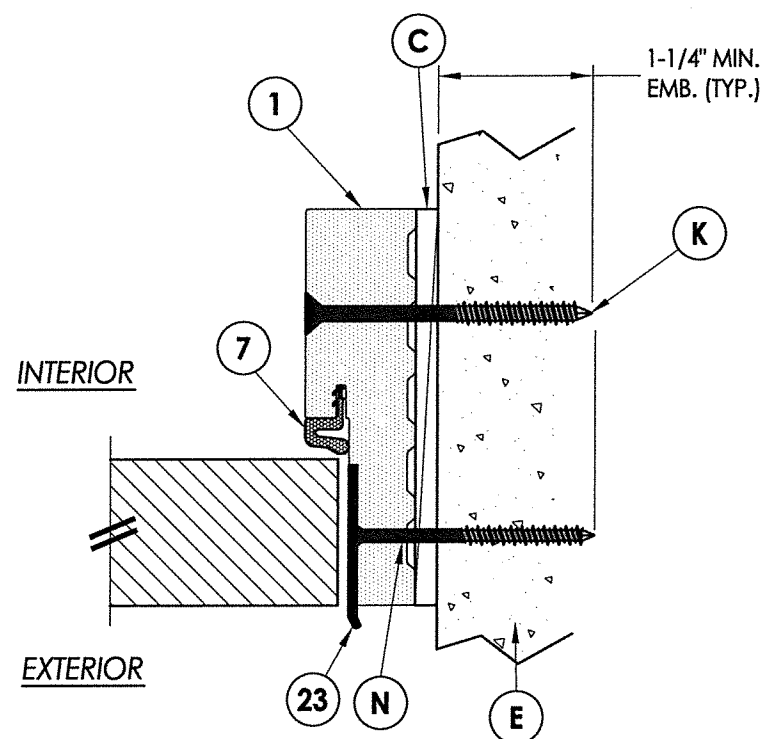

4 HORIZONTAL CROSS SECTION
3 2X Buck Construction

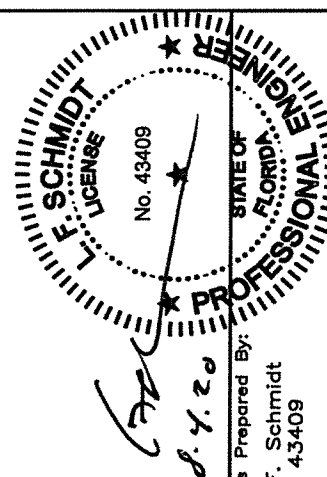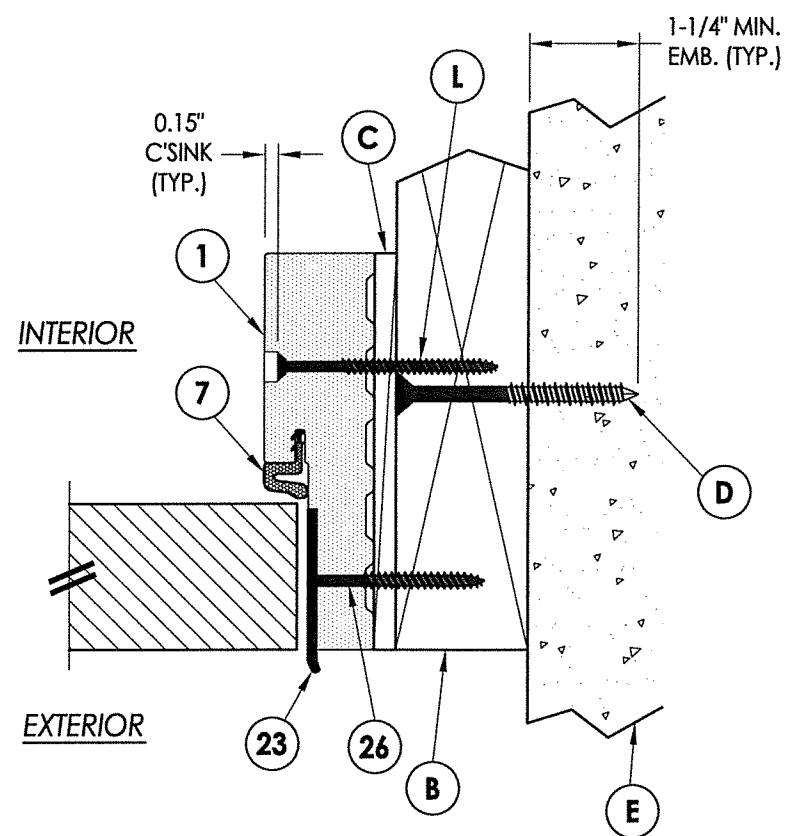


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

[illegible]

Note:
See separate side-hinged door Product Approval for door construction details not shown, including lock hardware, astragal, hinge and threshold connections.

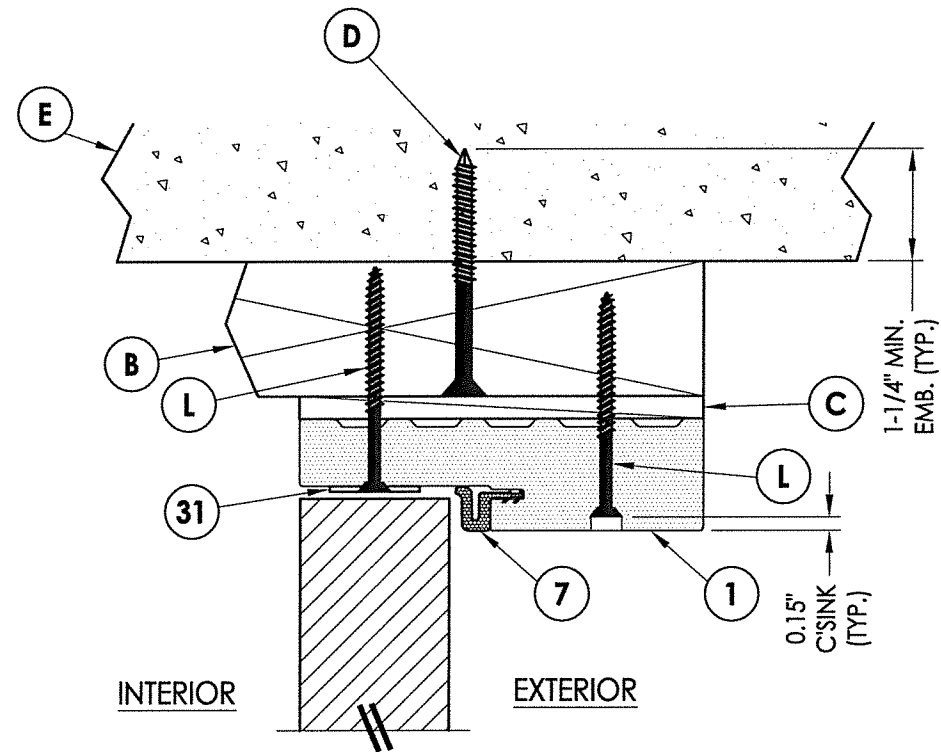


2 VERTICAL CROSS SECTION
4 2X Buck Construction- Double door

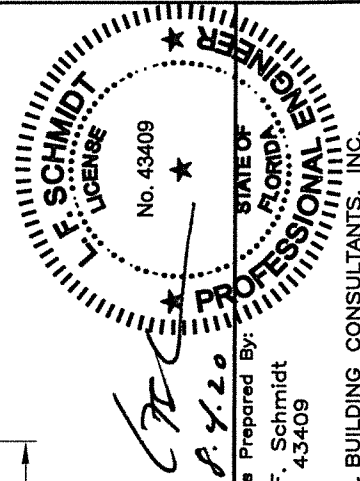


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

Building Consultants, Inc.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813-659-9197
FBPE Registry No. 9813


[illegible]

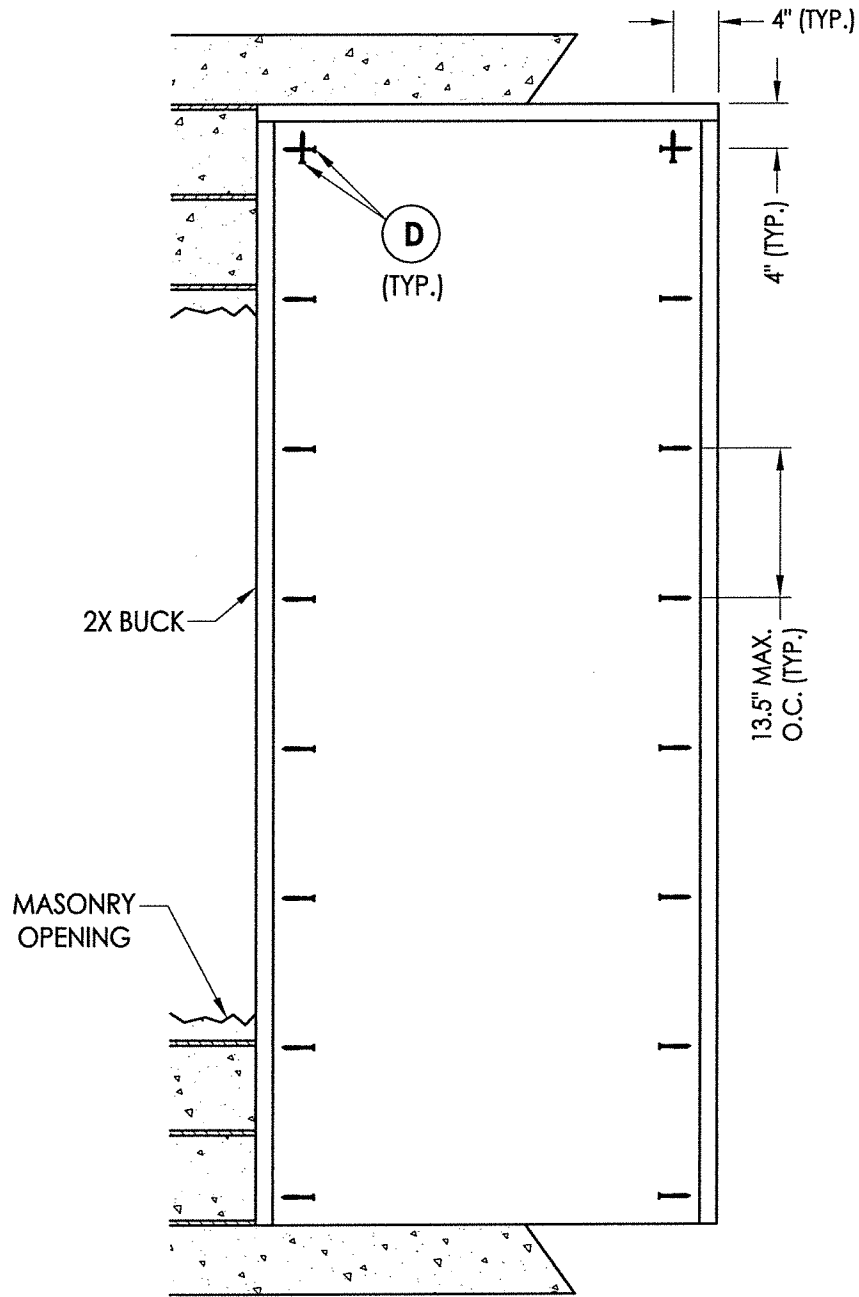


BUCK ANCHORING

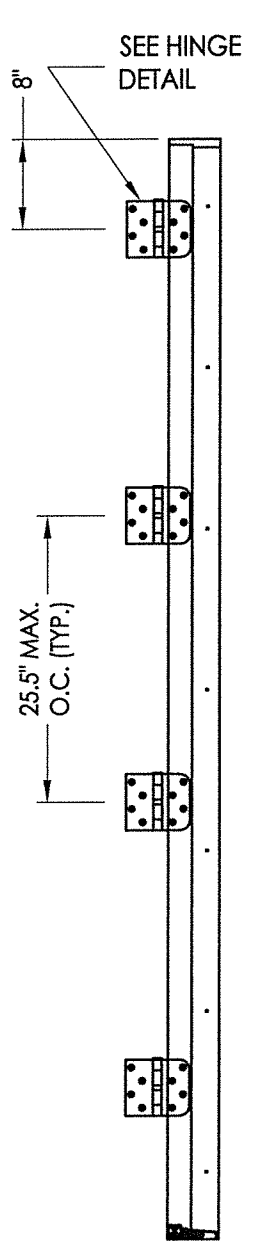


HINGE JAMB

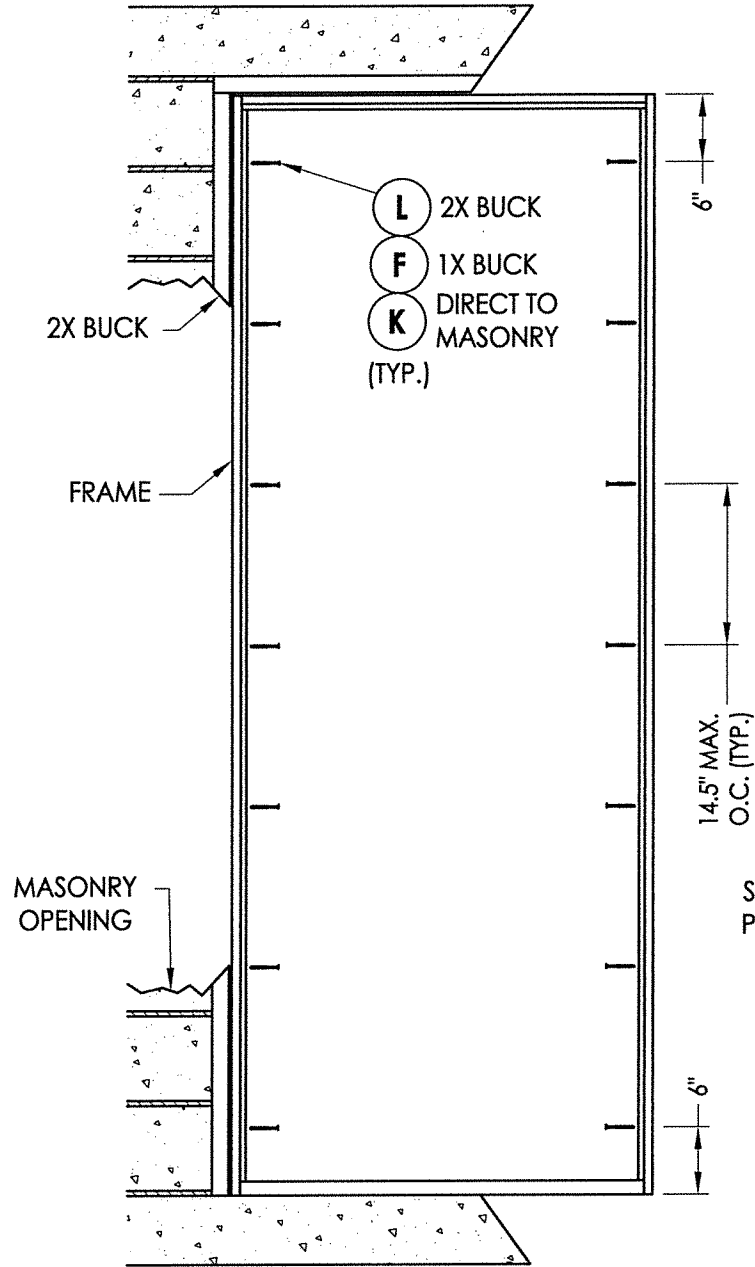


FRAME ANCHORING
Masonry construction

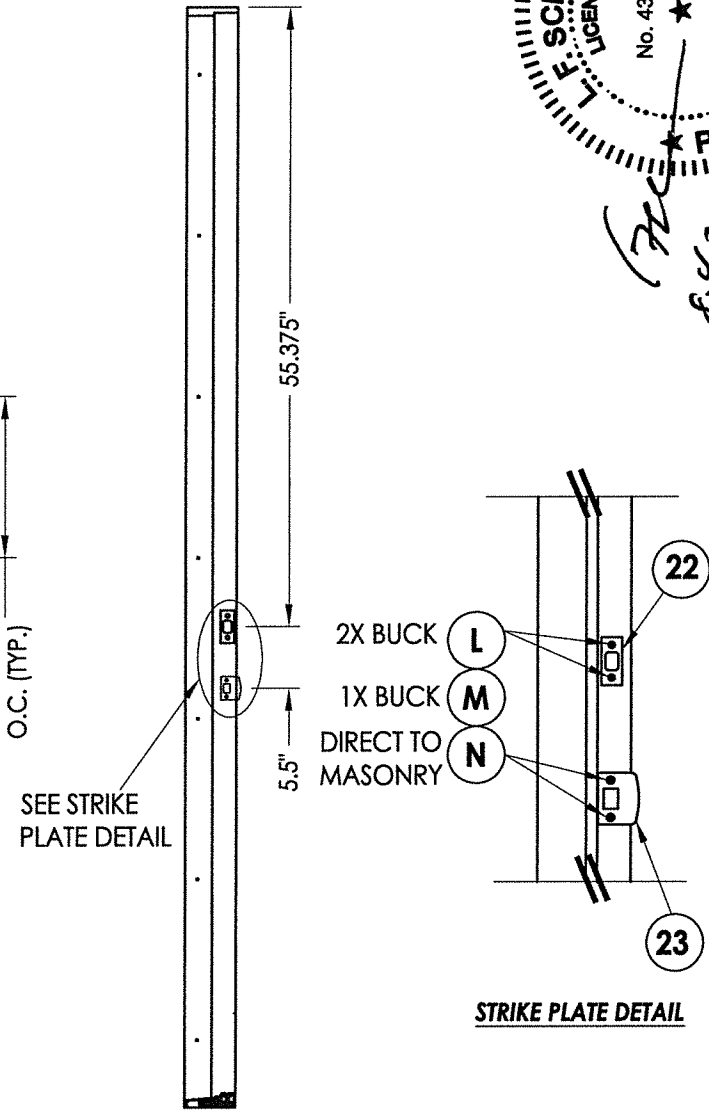

STRIKE JAMB

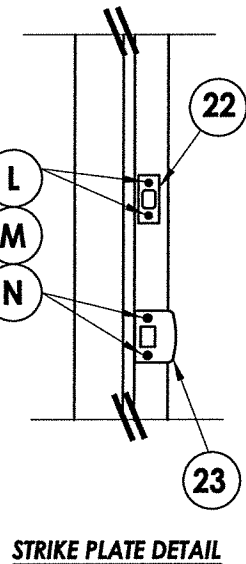

STRIKE PLATE DETAIL

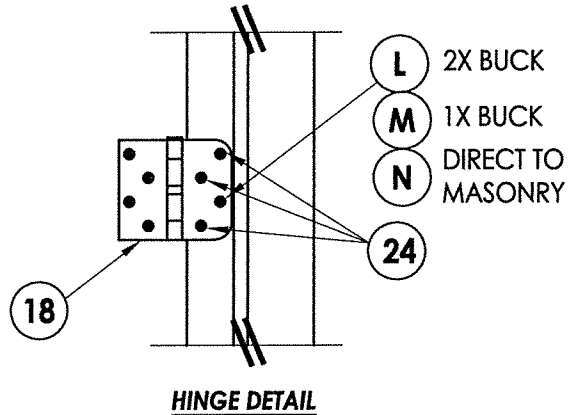

HINGE DETAIL

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA-CON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

Note:

See separate side-hinged door Product Approval for door construction details not shown, including lock hardware, astragal, hinge and threshold connections.

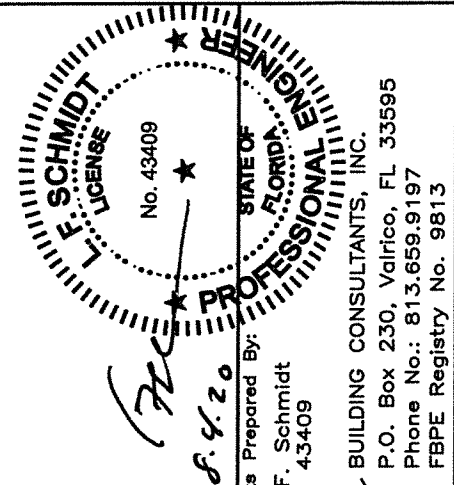

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: HM SURE ROCK COMPONENTS
PART OR ASSEMBLY: BUCK AND FRAME ANCHORING

NO.	DATE	DESCRIPTION	BY
1	8/03/20	UPDATE TO 7TH ED. (2020) FBC	LFS

DATE: 10/18/17


SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-18385.2


SHEET 5 OF 7

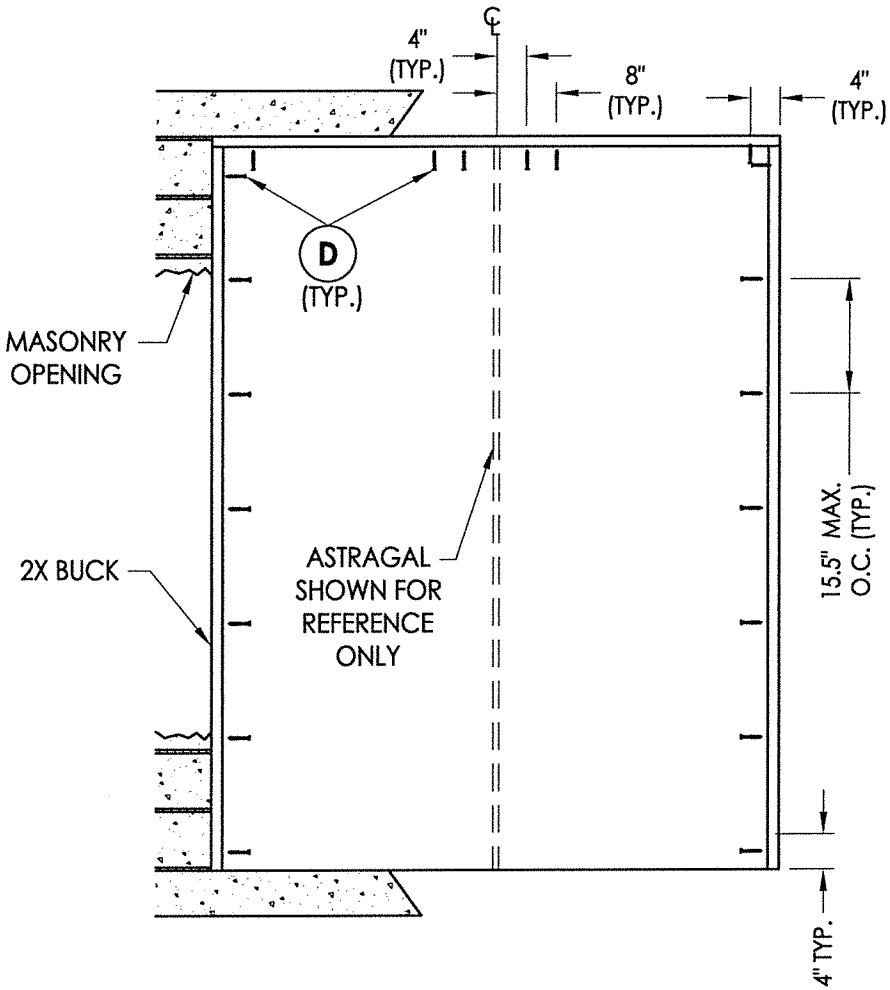


BUCK ANCHORING

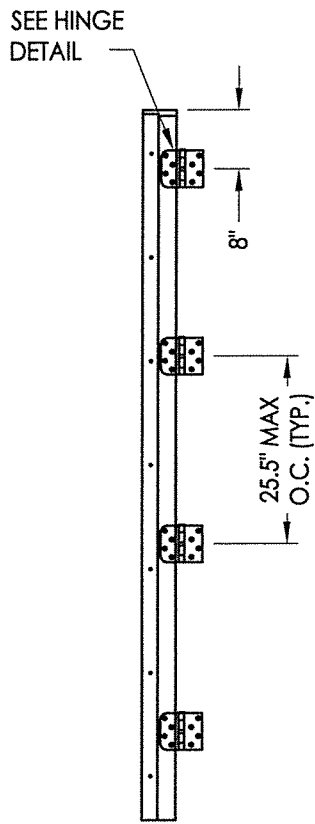

HINGE JAMB

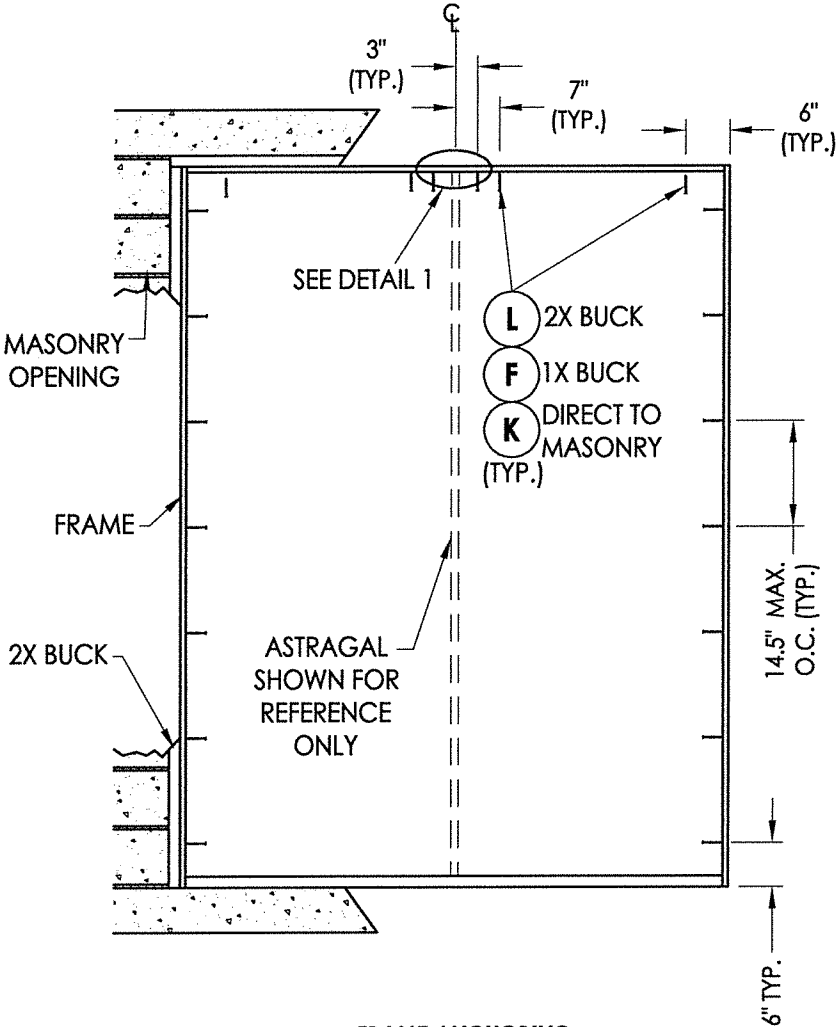

FRAME ANCHORING
Masonry construction

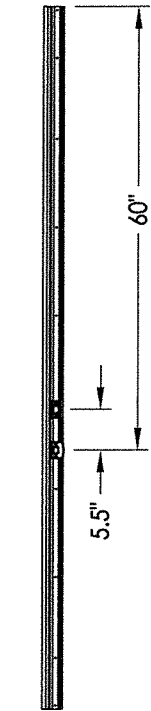

ASTRAGAL


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA-CON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

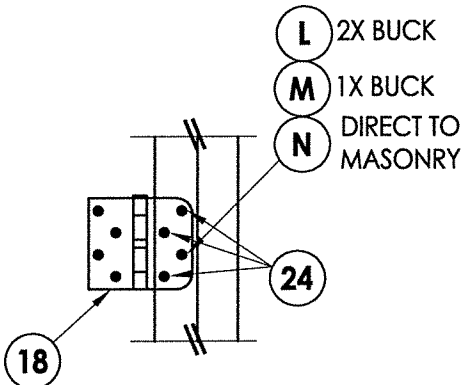


HINGE DETAIL

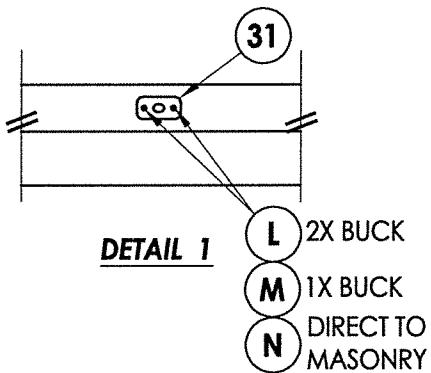

DETAIL 1

Note:

See separate side-hinged door Product Approval for door construction details not shown, including lock hardware, astragal, hinge and threshold connections.

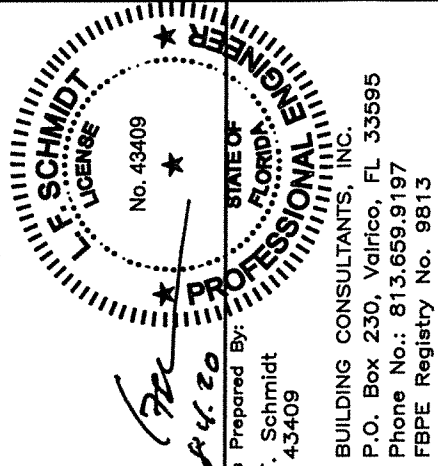

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
HM SURE ROCK COMPONENTS
PART OR ASSEMBLY:
BUCK AND FRAME ANCHORING

NO.	DATE	REVISIONS
1	8/03/20	UPDATE TO 7TH ED. (2020) FBC
		LFS
		BY

DATE: 10/18/17

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-18385.2

SHEET 6 OF 7

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.55)	WOOD
B	2X BUCK (SG >= 0.55)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1-1/8" MIN. EMBEDEMENT)	STEEL
K	1/4" X 3-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
M	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
N	3/16" X 2-3/4" PFH TW CONCRETE SCREW	STEEL
1	HEAD & SIDE JAMB	COMPOSITE
7	WEATHERSTRIP QEBD650 Q-LON	FOAM
18	4" X 4" HINGE	STEEL
22	DEADBOLT STRIKE PLATE	STEEL
23	LATCH STRIKE PLATE	STEEL
24	#10 X 3/4" PFH SMS	STEEL
26	#8 X 2" PFH WOOD SCREW	STEEL
31	ASTRAGAL STRIKE PLATE	STEEL

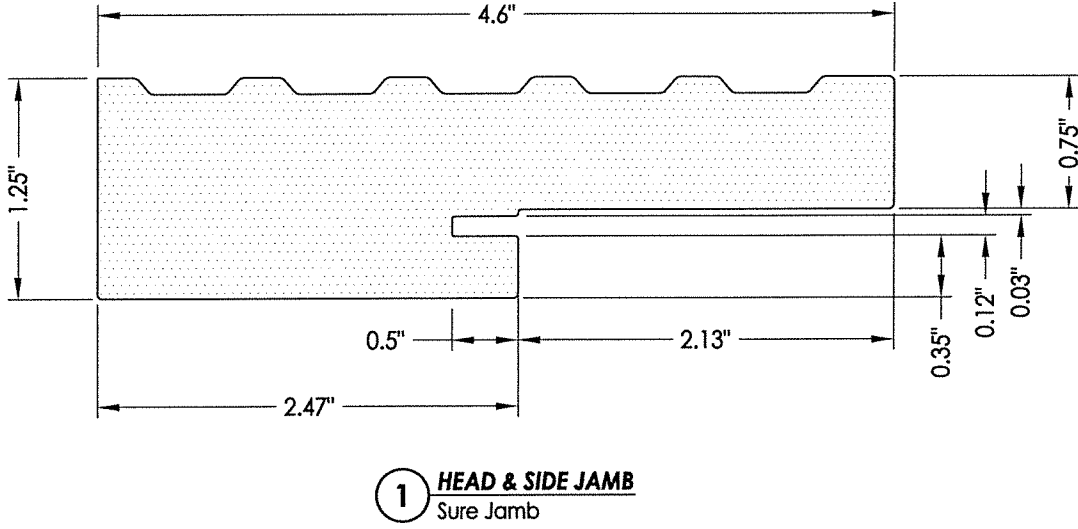

DATE: 10/18/17		PRODUCT:		HM SURE ROCK COMPONENTS
SCALE: N.T.S.				
DWG. BY: JK				
CHK. BY: LFS				
DRAWING NO.: FL-18385.2		PART OR ASSEMBLY:		BILL OF MATERIALS & COMPONENTS
SHEET 7 OF 7		1 8/03/20 UPDATE TO 7TH ED. (2020) FBC		LFS
		NO. DATE		BY
				REVISIONS

701
8.4.20

No. 43409

★

F. SCHMIDT
LICENSE

STATE OF
FLORIDA

PROFESSIONAL ENGINEER

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813