
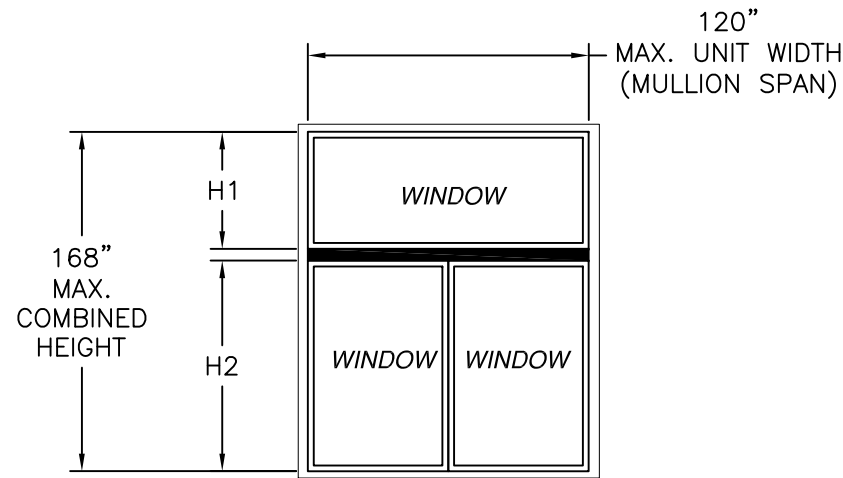


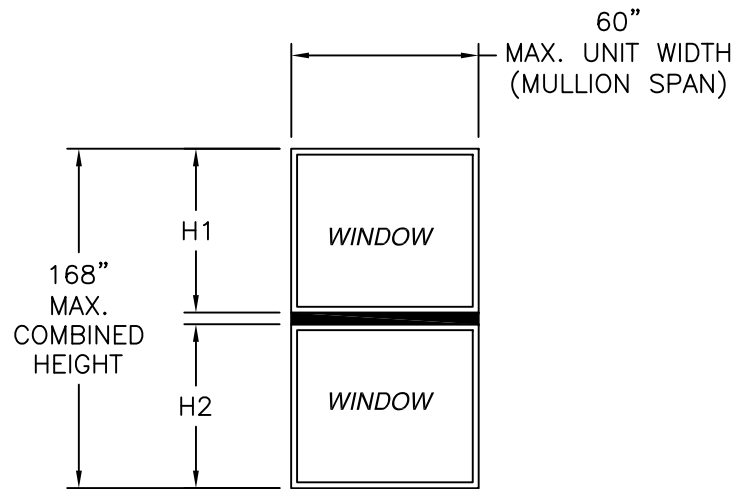

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED INSTALLATION DETAILS	08/07/15	R.L.
B	REVISED INSTALLATION DETAILS	10/17/17	R.L.

NOTES:

- 1) THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
- 2) WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3) ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 4) APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS UP TO WIND ZONE 3
- 5) DESIGN PRESSURE AND INSTALLATION DETAILS SHOWN IN THIS DOCUMENT APPLY ONLY TO THE MULLION. WINDOWS MUST BE APPROVED UNDER SEPARATE APPROVAL.
- 6) SINGLE UNITS TO BE MULLED ARE NOT LIMITED TO THOSE SHOWN IN THIS DRAWING. SINGLE UNITS TO BE MULLED TOGETHER MUST BE MANUFACTURED BY MI WINDOWS AND DOORS
- 7) DESIGN PRESSURE OF MULLED UNIT SHALL BE CONTROLLED BY THE LESSER DESIGN PRESSURE OF THE MULLION OR THE INDIVIDUAL WINDOW UNIT.
- 8) VERTICAL MULLIONS ARE NOT PART OF THIS APPROVAL. VERTICAL MULLIONS USED TO MULL UNITS SIDE BY SIDE MUST HAVE SEPARATE APPROVAL.
- 9) FOR ADDITIONAL APPROVED CONFIGURATIONS SEE SHEET 2.

Maximum design presssure (psf)

Tributary height (in)	Mullion span (in)							
	18.00	24.00	30.00	36.00	42.00	48.00	54.00	60.00
18.00	120.0	120.0	120.0	120.0	120.0	120.0	114.1	100.7
24.00	120.0	120.0	120.0	120.0	120.0	107.0	91.7	80.3
30.00	120.0	120.0	120.0	120.0	114.1	93.4	79.0	68.5
36.00	120.0	120.0	120.0	120.0	107.0	85.6	71.3	61.1
42.00	120.0	120.0	120.0	120.0	104.8	81.5	66.7	56.4
48.00	120.0	120.0	120.0	120.0	104.8	80.3	64.2	53.5
54.00	120.0	120.0	120.0	120.0	104.8	80.3	63.4	51.9
60.00	120.0	120.0	120.0	120.0	104.8	80.3	63.4	51.4
66.00	120.0	120.0	120.0	120.0	104.8	80.3	63.4	51.4
72.00	120.0	120.0	120.0	120.0	104.8	80.3	63.4	51.4
78.00	120.0	120.0	120.0	120.0	104.8	80.3	63.4	51.4
84.00	120.0	120.0	120.0	120.0	104.8	80.3	63.4	51.4

LARGE AND SMALL MISSILE IMPACT, LEVEL D, WIND ZONE 3
DIMENSIONS IN CHART ARE FRAME DIMENSIONS AND DO NOT
INCLUDE FLANGE

Maximum design pressure capacity chart (psf)

Tributary Height (in)	Mullion Span and individual unit width (in)							
	36.00	48.00	60.00	72.00	84.00	96.00	108.00	120.00
18.00	120.0	120.0	100.7	81.5	62.3	41.5	29.0	21.1
24.00	120.0	107.0	80.3	64.2	47.6	31.6	22.0	16.0
30.00	120.0	92.5	68.5	54.1	38.8	25.7	17.9	-
36.00	120.0	82.8	60.8	47.6	33.1	21.8	15.1	-
42.00	118.1	76.1	55.2	43.0	29.1	19.1	-	-
48.00	110.5	71.3	51.1	39.5	26.1	17.0	-	-
54.00	103.8	67.6	48.0	36.8	23.8	15.5	-	-
60.00	97.8	64.2	45.7	34.7	22.0	-	-	-
66.00	92.5	61.1	43.7	33.0	20.6	-	-	-
72.00	87.8	58.4	41.9	31.7	19.5	-	-	-
78.00	83.5	55.8	40.3	30.6	18.5	-	-	-
84.00	79.6	53.5	38.8	29.5	17.8	-	-	-

LARGE AND SMALL MISSILE IMPACT, LEVEL D, WIND ZONE 3
DIMENSIONS IN CHART ARE FRAME DIMENSIONS AND DO NOT
INCLUDE FLANGE

DESIGN PRESSURE TABLE INSTRUCTIONS:

- 1) DEFINE REQUIRED DESIGN LOAD PER FLORIDA BUILDING CODE CHAPTER 16.
- 2) DETERMINE TRIBUTARY HEIGHT AND MULLION SPAN BASED ON PRODUCT TO BE INSTALLED. SEE FORMULA FOR TRIBUTARY HEIGHT.
- 3) LOCATE MULLION SPAN (UNIT WIDTH) AND TRIBUTARY HEIGHT. AT THE INTERSECTION OF COLUMN AND ROW CONTAINING THE MULLION SPAN AND TRIBUTARY WIDTH RESPECTIVELY IS THE MULLION RATING FOR PRODUCT IN STEP 2.
MULLION RATING MUST BE EQUAL OR GREATER THAN REQUIRED DESIGN PRESSURE OBTAINED IN STEP 1.

$$\text{TRIBUTARY HEIGHT} = \frac{H1 + H2}{2}$$

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1, 2	ELEVATION, NOTES AND DESIGN PRESSURE CHARTS
3 – 4	INSTALLATION DETAILS

MI WINDOWS AND DOORS, LLC


650 WEST MARKET STREET
GRATZ, PA 17030-0370

M-2285 HORIZONTAL MULLION
SINGLE, TWIN AND TRIPLE WITH TRANSOM
ELEVATION AND GENERAL NOTES


DRAWN: V.L.	DWG NO. 08-01834	REV B
SCALE NTS	DATE 03/06/12	SHEET 1 OF 3

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@lrlomaspe.com

SIGNED: 10/17/2017

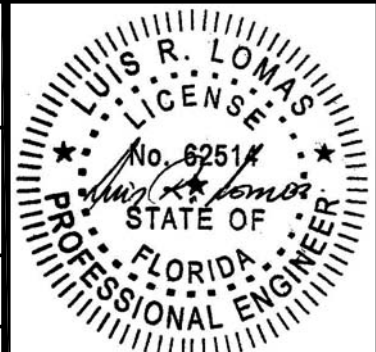


Luis R. Lomas P.E.
FL No.: 62514

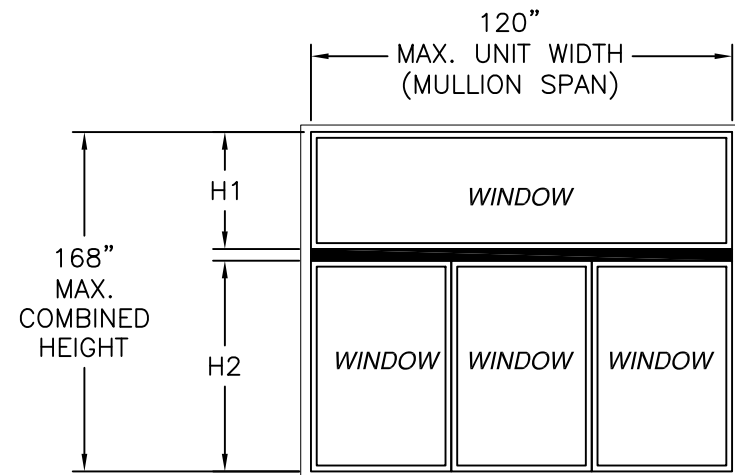


Maximum design pressure capacity chart (psf)

Tributary Height (in)	Mullion Span and individual unit width				
	54.00	72.00	90.00	108.00	120.00
18.00	114.1	81.5	51.4	29.6	21.5
24.00	90.9	64.2	39.0	22.4	16.3
30.00	76.7	53.8	31.7	18.1	-
36.00	67.1	46.7	26.8	15.3	-
42.00	60.4	41.6	23.4	-	-
48.00	55.5	37.8	20.8	-	-
54.00	51.9	34.8	18.8	-	-
60.00	48.9	32.5	17.3	-	-
66.00	46.3	30.7	16.1	-	-
72.00	43.9	29.2	15.0	-	-
78.00	41.8	27.9	-	-	-
84.00	39.8	26.8	-	-	-


LARGE AND SMALL MISSILE IMPACT, LEVEL D, WIND ZONE 3
DIMENSIONS IN CHART ARE FRAME DIMENSIONS AND DO NOT
INCLUDE FLANGE

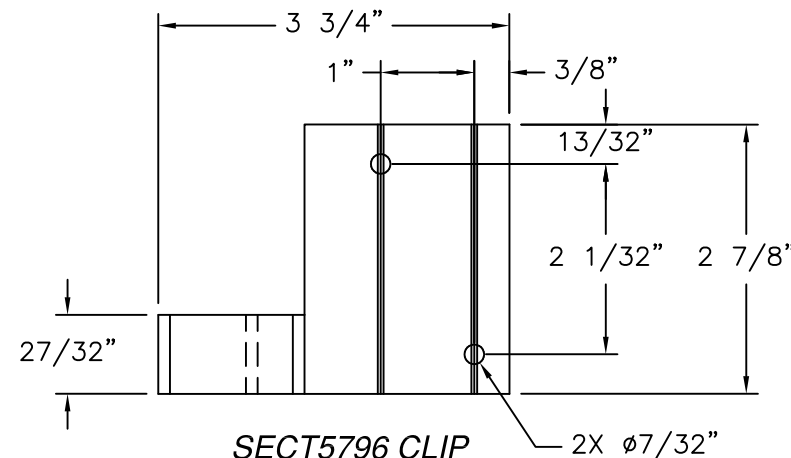


SECT5796 CLIP
FOR CONCRETE INSTALLATION
ALUMINUM 6063-T5 .125" THICK

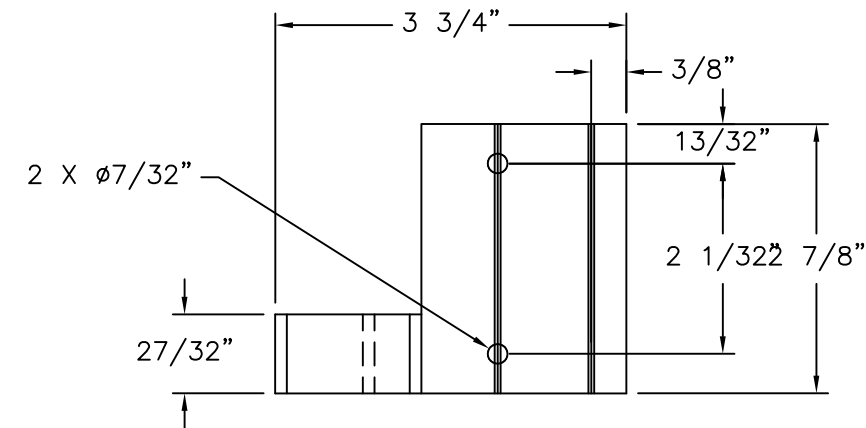


SECT5796 CLIP
FOR CONCRETE INSTALLATION
ALUMINUM 6063-T5 .125" THICK

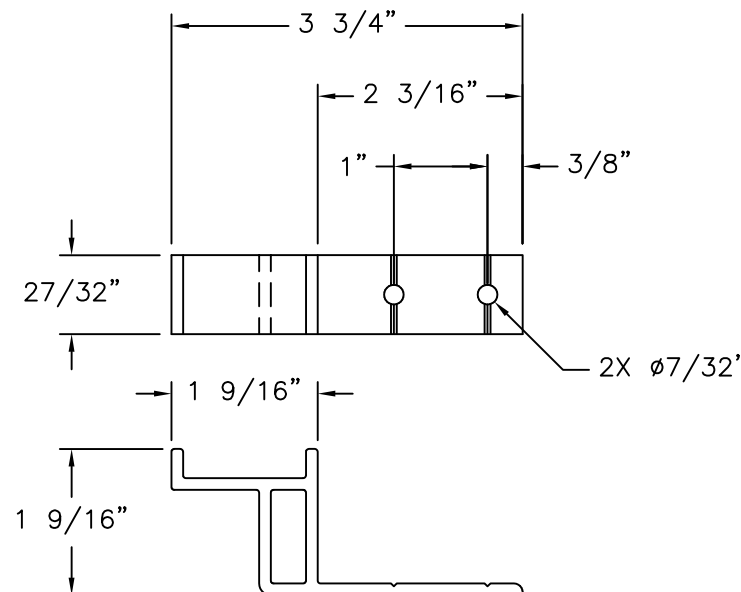

SECT5796 CLIP
FOR WOOD FRAMING INSTALLATION
ALUMINUM 6063-T5 .125" THICK

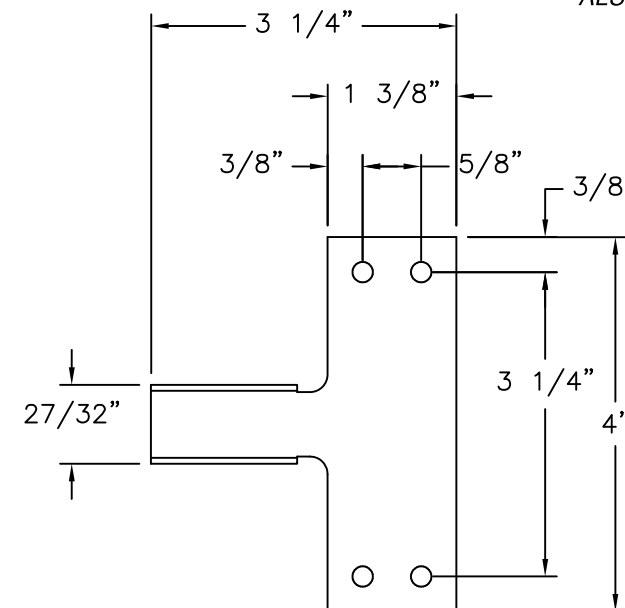

MT000022 CLIP
16GA (.063") GALVANIZED STEEL

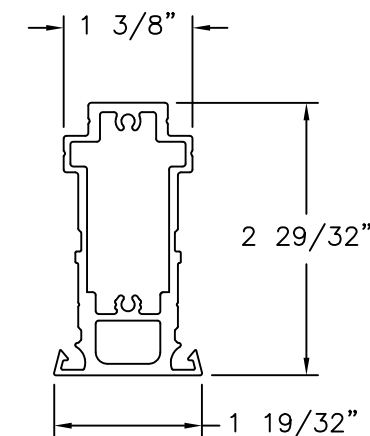

M-2285 MULLION
ALUMINUM 6005-T5 .125" THICK

$$\text{TRIBUTARY HEIGHT} = \frac{H1 + H2}{2}$$

DESIGN PRESSURE TABLE INSTRUCTIONS:

- 1) DEFINE REQUIRED DESIGN LOAD PER FLORIDA BUILDING CODE CHAPTER 16.
- 2) DETERMINE TRIBUTARY HEIGHT AND MULLION SPAN BASED ON PRODUCT TO BE INSTALLED. SEE FORMULA FOR TRIBUTARY HEIGHT.
- 3) LOCATE MULLION SPAN (UNIT WIDTH) AND TRIBUTARY HEIGHT. AT THE INTERSECTION OF COLUMN AND ROW CONTAINING THE MULLION SPAN AND TRIBUTARY WIDTH RESPECTIVELY IS THE MULLION RATING FOR PRODUCT IN STEP 2.
MULLION RATING MUST BE EQUAL OR GREATER THAN REQUIRED DESIGN PRESSURE OBTAINED IN STEP 1.

MI WINDOWS AND DOORS, LLC


650 WEST MARKET STREET
GRATZ, PA 17030-0370

M-2285 HORIZONTAL MULLION
SINGLE, TWIN AND TRIPLE WITH TRANSOM
ELEVATION AND COMPONENTS


DRAWN: V.L.	DWG NO. 08-01834	REV B
SCALE NTS	DATE 03/06/12	SHEET 2 OF 3

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com


SIGNED: 10/17/2017

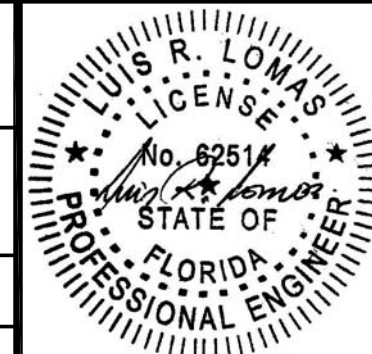


Luis R. Lomas P.E.
FL No.: 62514

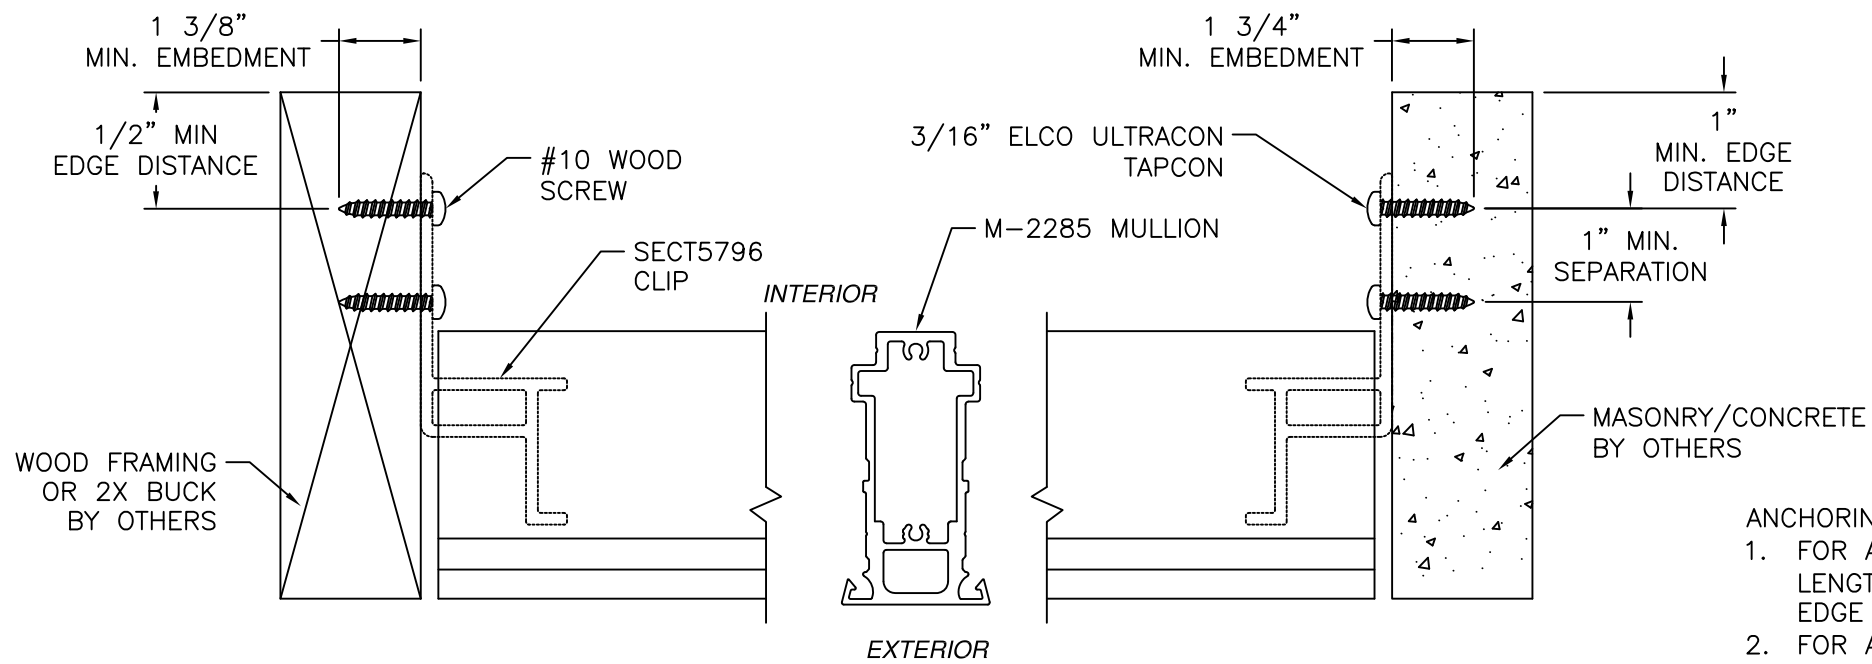


MULLION INSTALLATION
WOOD & CONCRETE

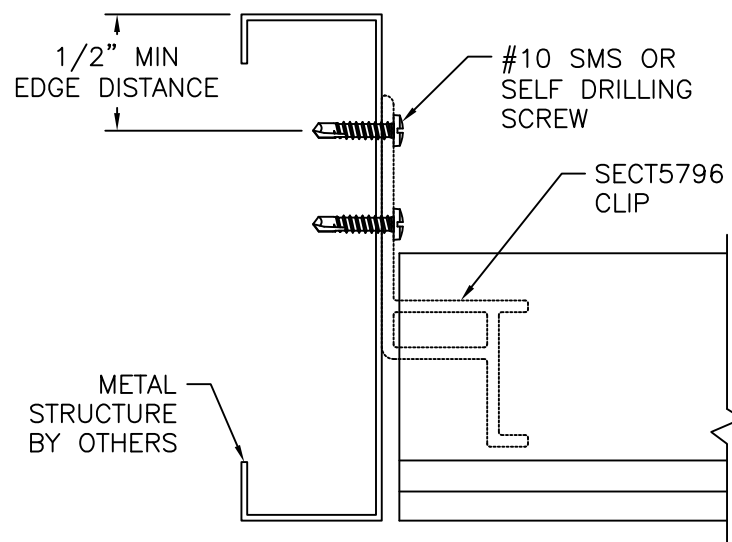

MULLION INSTALLATION
METAL

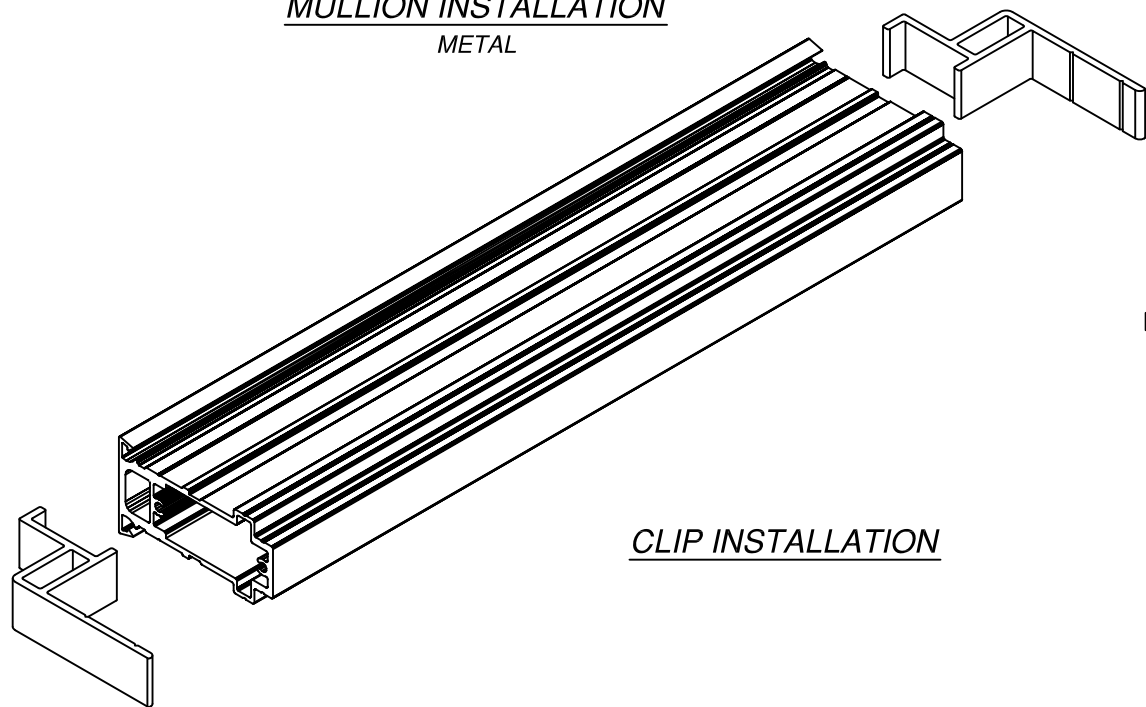

CLIP INSTALLATION

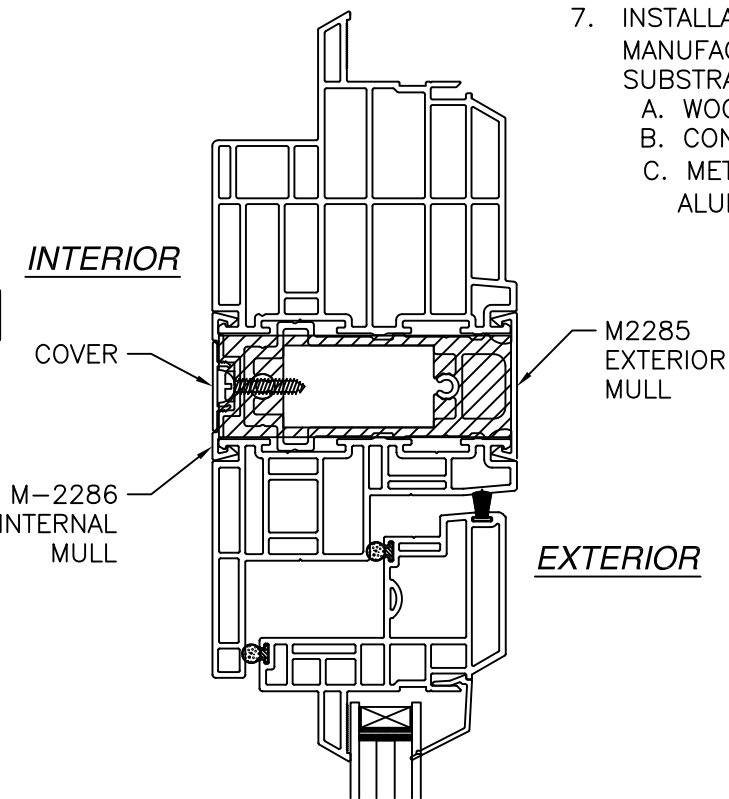

WINDOW & MULLION ASSEMBLY
REFERENCE ONLY

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED INSTALLATION DETAILS	08/07/15	R.L.
B	REVISED INSTALLATION DETAILS	10/17/17	R.L.

ANCHORING NOTES:

1. FOR ANCHORING INTO CONCRETE USE 3/16" ELCO ULTRACON TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 1" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
2. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREW WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/8" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
3. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREW WITH SUFFICIENT LENGTH TO ACHIEVE A 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
4. FOR ATTACHING WINDOW UNITS TO MULLION USE #10 SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A MINIMUM EMBEDMENT OF THREE THREADS PAST THE MULLION WALL. LOCATE SCREWS 6" FROM EACH MULLION END AND 12" MAX. O.C. THEREAFTER. STAGGER SCREWS AT EACH WINDOW.
5. FOR WINDOW UNITS ANCHORING SCHEDULE REFER TO WINDOW APPROVED INSTALLATION INSTRUCTIONS.
6. ALL FASTENERS TO BE CORROSION RESISTANT.
7. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. METAL – STEEL 18GA (.048") FY=33KSI/FU=52 OR ALUMINUM 6063-T5 FU=30KSI .0625" THICK MINIMUM.


SIGNED: 10/17/2017

MI WINDOWS AND DOORS, LLC
650 WEST MARKET STREET
GRATZ, PA 17030-0370

M-2285 HORIZONTAL MULLION
SINGLE, TWIN AND TRIPLE WITH TRANSOM
INSTALLATION DETAILS

DRAWN: V.L.	DWG NO. 08-01834	REV B
SCALE NTS	DATE 03/06/12	SHEET 3 OF 3

L. ROBERTO LOMAS P.E.
1432 WOODFORD RD LEWISVILLE, NC 27023
434-688-0609 rllomas@rlomaspe.com

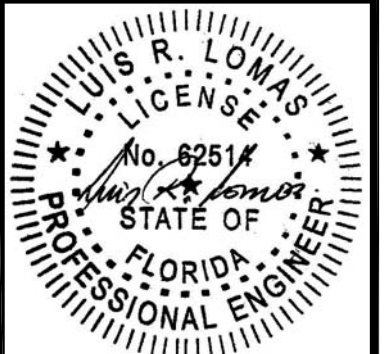

Luis R. Lomas P.E.
FL No.: 62514