

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR INSTALLATION INTO WOOD FRAMING USE #12 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 1/4 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
7. FOR INSTALLATION THROUGH METAL STUD USE 1/4 INCH DIAMETER SELF-DRILLING SCREWS, GR. 5 OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND METAL FRAME SUBSTRATE.
8. FOR INSTALLATION THROUGH CONCRETE AT MULL STIFFENER ANCHOR PLATES, USE 3/8 INCH DIAMETER HILTI KWIK BOLT 3 EXPANSION ANCHORS OF SUFFICIENT LENGTH TO ACHIEVE 2 1/2 INCH MINIMUM EMBEDMENT. INSTALLATION SHALL MAINTAIN MIN. 3" EDGE DISTANCE INTO CONCRETE.
9. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- 10.INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:

FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1). NAIL-FIN, STRAPS, AND CLIPS LISTED WITHIN THIS APPROVAL ARE QUALIFIED TO BE STAINLESS STEEL AS SHOWN HERE-IN.

11.FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.

12.INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

13.INSTALLATION SHALL FOLLOW MANUFACTURERS RECOMMENDATIONS FOR SEALING WINDOWS AND ACCESSORY ITEMS.

14.INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

C. HOLLOW BLOCK MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, TYPE N, WITH MINIMUM COMPRESSIVE STRENGTH, f'm, OF 2000 PSI.

C. FULLY GROUTED MASONRY - STRENGTH CONFORMANCE TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI. GROUT SHALL BE OF MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI

D. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.
- GENERAL NOTES:
1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

TAS 201-94

TAS 202-94

TAS 203-94

AAMA/WDMA/CSA 101/1.S.2/A440-11

ASTM E1886-13a

ASTM E1996-17

2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.

3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.

4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.

6. WINDOW FRAME MATERIAL:

BRASS (MIN. Fy = 29 KSI, MIN. Fu = 50 KSI)

STEEL/PAINTED STEEL (MIN. Fy = 31 KSI, MIN. Fu = 72 KSI)

COR-TEN STEEL (MIN. Fy = 51 KSI, MIN. Fu = 74 KSI)

STAINLESS STEEL (MIN. Fy = 31 KSI, MIN. Fu = 76 KSI)

7. ALL STRUCTURAL MATERIALS & DISSIMILIAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.

8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 6 FOR GLAZING DETAILS.

9. GLAZING SELECTION SHALL MEET SAFETY GLAZING REQUIREMENTS PER CHAPTER 24 OF CURRENT FBC.

10.GLASS SHALL BE SET WITH THE USE OF SETTING BLOCKS IN ACCORDANCE WITH CHAPTER 24 OF THE CURRENT FLORIDA BUILDING CODE.
- BROMBAL ITALY

FARO SERIES FIXED WINDOW

(HVHZ) (IMPACT)
- | TABLE OF CONTENTS | |
|-------------------|---|
| SHEET | SHEET DESCRIPTION |
| 1 | INSTALLATION & GENERAL NOTES |
| 2 | ELEVATIONS & ANCHOR LAYOUTS |
| 3 | ELEVATIONS & ANCHOR LAYOUTS |
| 4 | ELEVATIONS & ANCHOR LAYOUTS |
| 5 | ELEVATIONS & ANCHOR LAYOUTS |
| 6 | DESIGN PRESSURE TABLE & GLAZING DETAILS |
| 7 | VERTICAL SECTIONS |
| 8 | HORIZONTAL SECTIONS |
| 9 | MULLION CONNECTION DETAILS |
| 10 | ALTERNATE ANCHORAGE DETAILS |
- | FIXED WINDOW DESIGN PRESSURE TABLE | | | | |
|------------------------------------|---------------|-----------|---------------|--------------|
| MAX. OVERALL SIZE | CONFIGURATION | MAX. DP | IMPACT RATING | GLAZING TYPE |
| 120" X 144" | OO | +/-55 PSF | LMI | A & B |
| 144" X 72" | O (ARCH TOP) | +/-55 PSF | LMI | A & B |
| SEE SHEET 6 | O | VARIES | LMI | A & B |
- NOTE:

LMI - LARGE MISSILE IMPACT RATED

SEE SHEET 6 FOR DESIGN PRESSURE TABLE FOR ALTERNATE CONFIGURATIONS

SEE SHEET 6 FOR GLAZING DETAILS
- BROMBAL

LUXURY METAL WINDOWS AND DOORS
- BROMBAL SRL

VIA VALLA, 24

31030 CASELLE DI ALTIVOLE
- TITLE: FARO 65 SERIES FIXED WINDOW (HVHZ) (IMPACT)

INSTALLATION & GENERAL NOTES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478

FAX: (954) 744-4738

WEB: www.buildingdrops.com

BUILDING DROPS
- | REMARKS | BY | DATE |
|-----------------|----|----------|
| FBC UPDATE | SM | 10.19.22 |
| 2026 FBC UPDATE | LS | 4.16.26 |
| | | |
| | | |
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.18 17:29:03'00'
-
- FL #:


FL18656
- DATE:

10.09.15
- | | |
|----------|----------|
| DWG. BY: | CHK. BY: |
| LMS | HFN |
- SCALE:


NTS
- DWG. #:

BRB006
- | | |
|--------|------|
| SHEET: | REV. |
| 1 | B |

OF 10

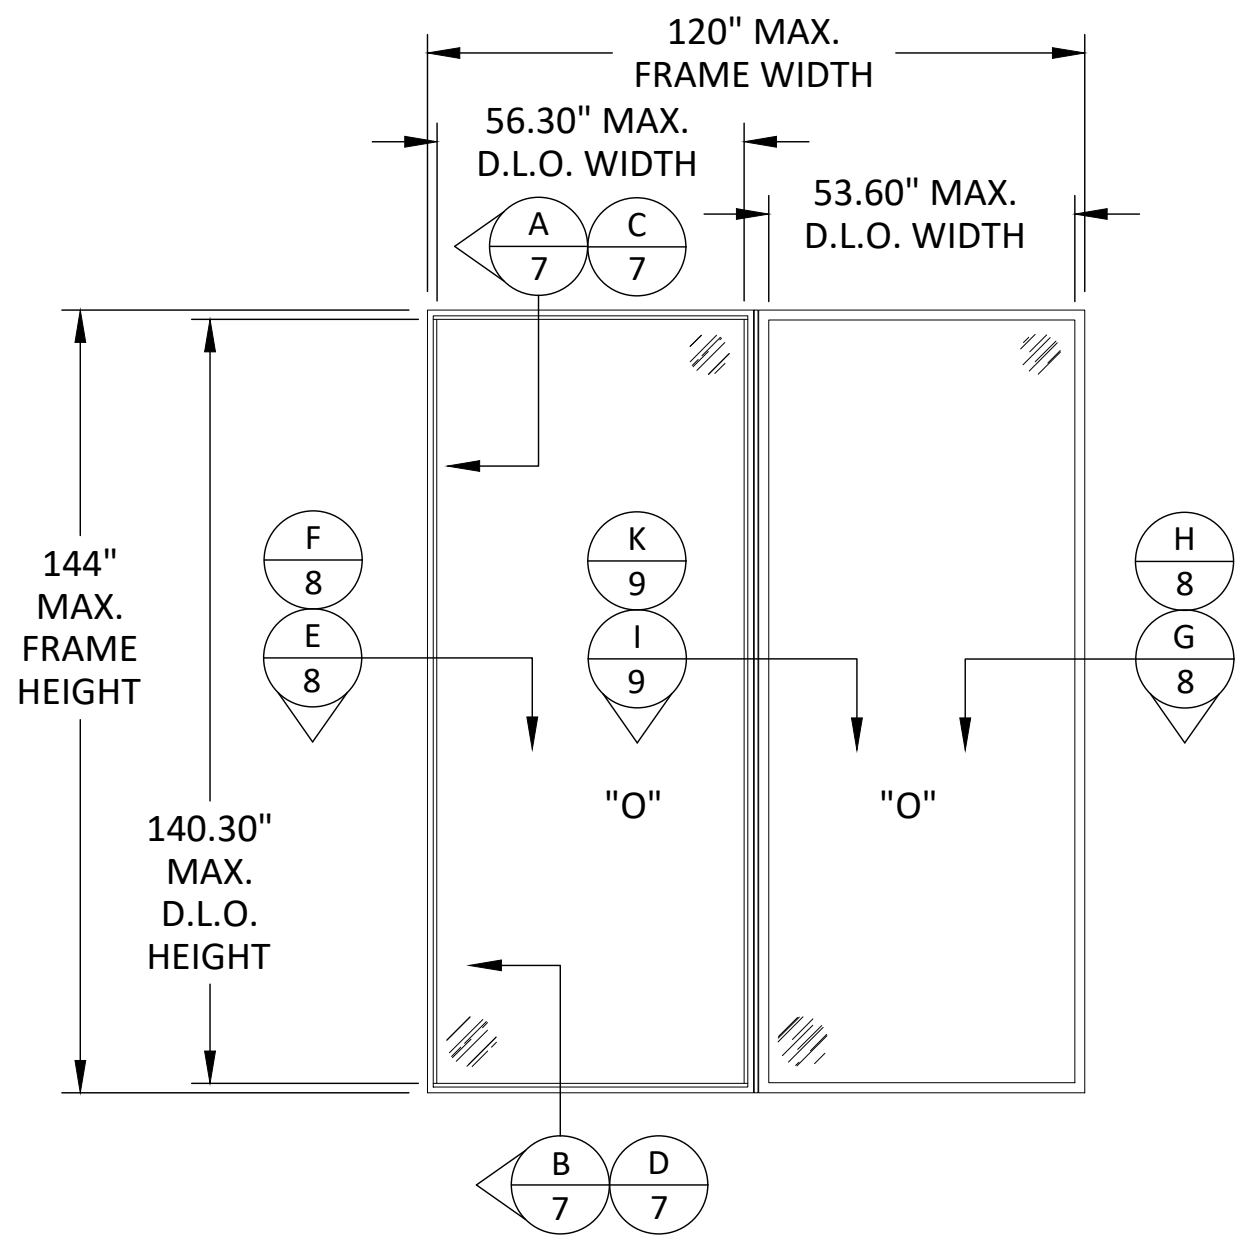

ELEVATION
FIXED WINDOW

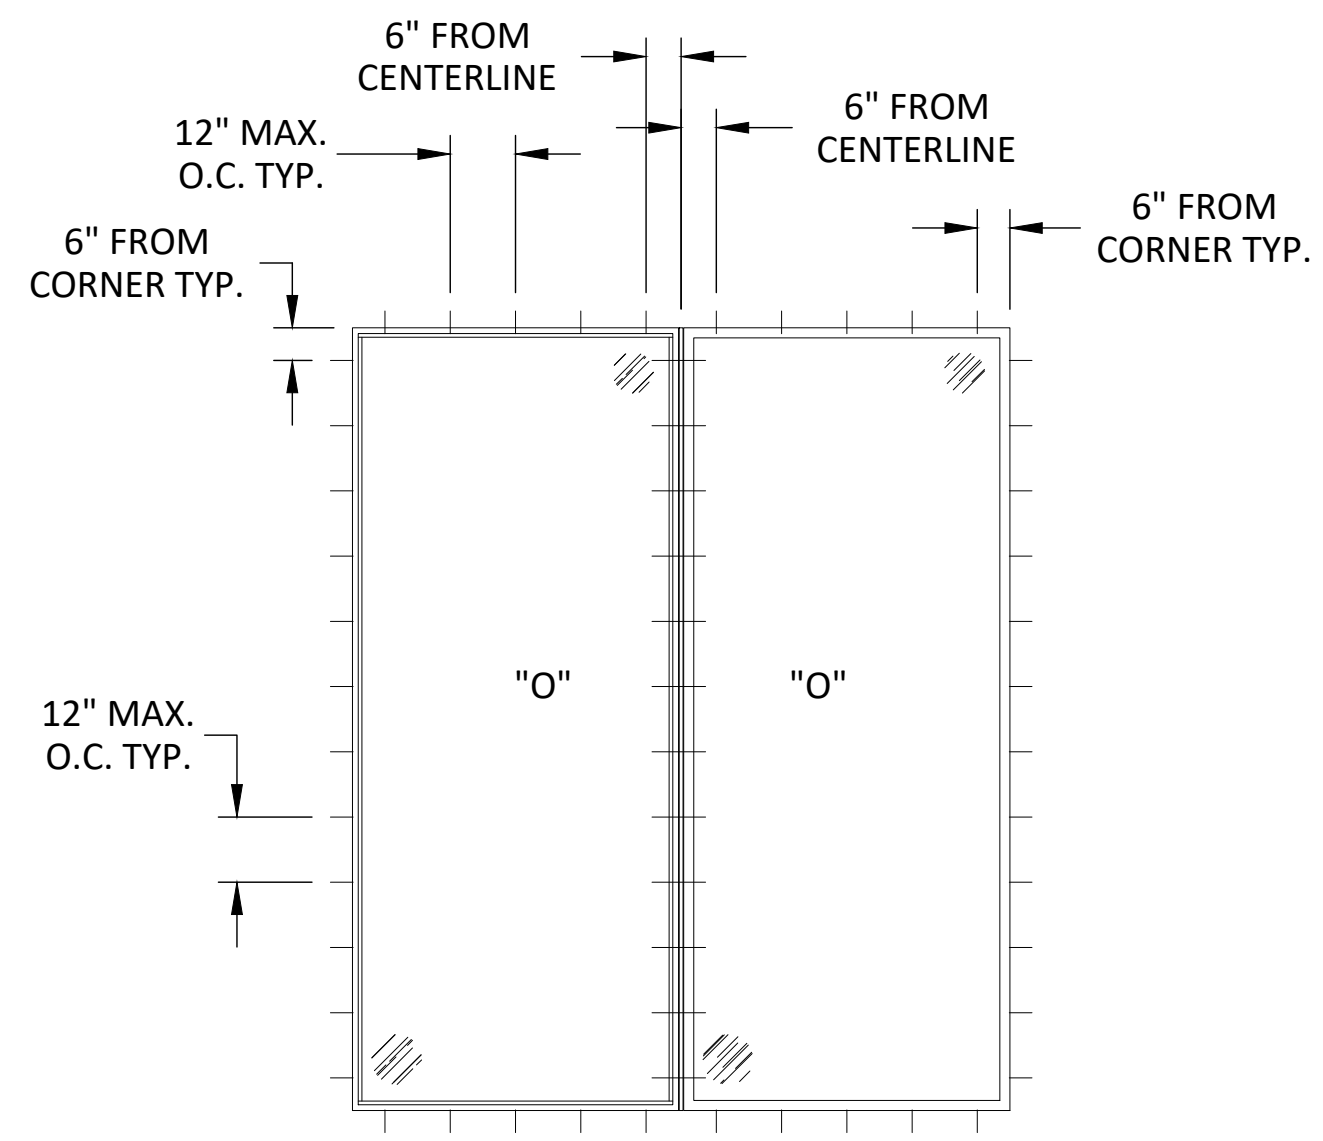

ANCHOR LAYOUT
FIXED WINDOW

NOTE: THROUGH FRAME, ANCHOR STRAP, OR DEFLECTION ANCHOR (HEAD ONLY) INSTALLATION SHOWN ABOVE. REFER TO SHEET 10 FOR NAIL FIN INSTALLATION ANCHOR LAYOUT.

TITLE: FARO 65 SERIES FIXED WINDOW (HVHZ) (IMPACT)


ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
FBC UPDATE	SM	10.19.22
2026 FBC UPDATE	LS	4.16.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

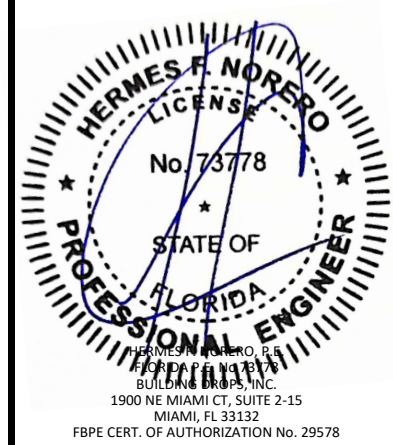

FL #:	FL18656
DATE:	10.09.15
DWG. BY: LMS	CHK. BY: HFN
SCALE:	NTS
DWG. #:	BRB006
SHEET: 2	REV. B

TITLE: FARO 65 SERIES FIXED WINDOW
(HVHZ) (IMPACT)

ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC UPDATE	SM	10.19.22
2026 FBC UPDATE	LS	4.16.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL18656
DATE:	10.09.15
DWG. BY:	CHK. BY:
LMS	HFN
SCALE:	NTS
DWG. #:	BRB006
SHEET:	REV.
3	B
OF 10	

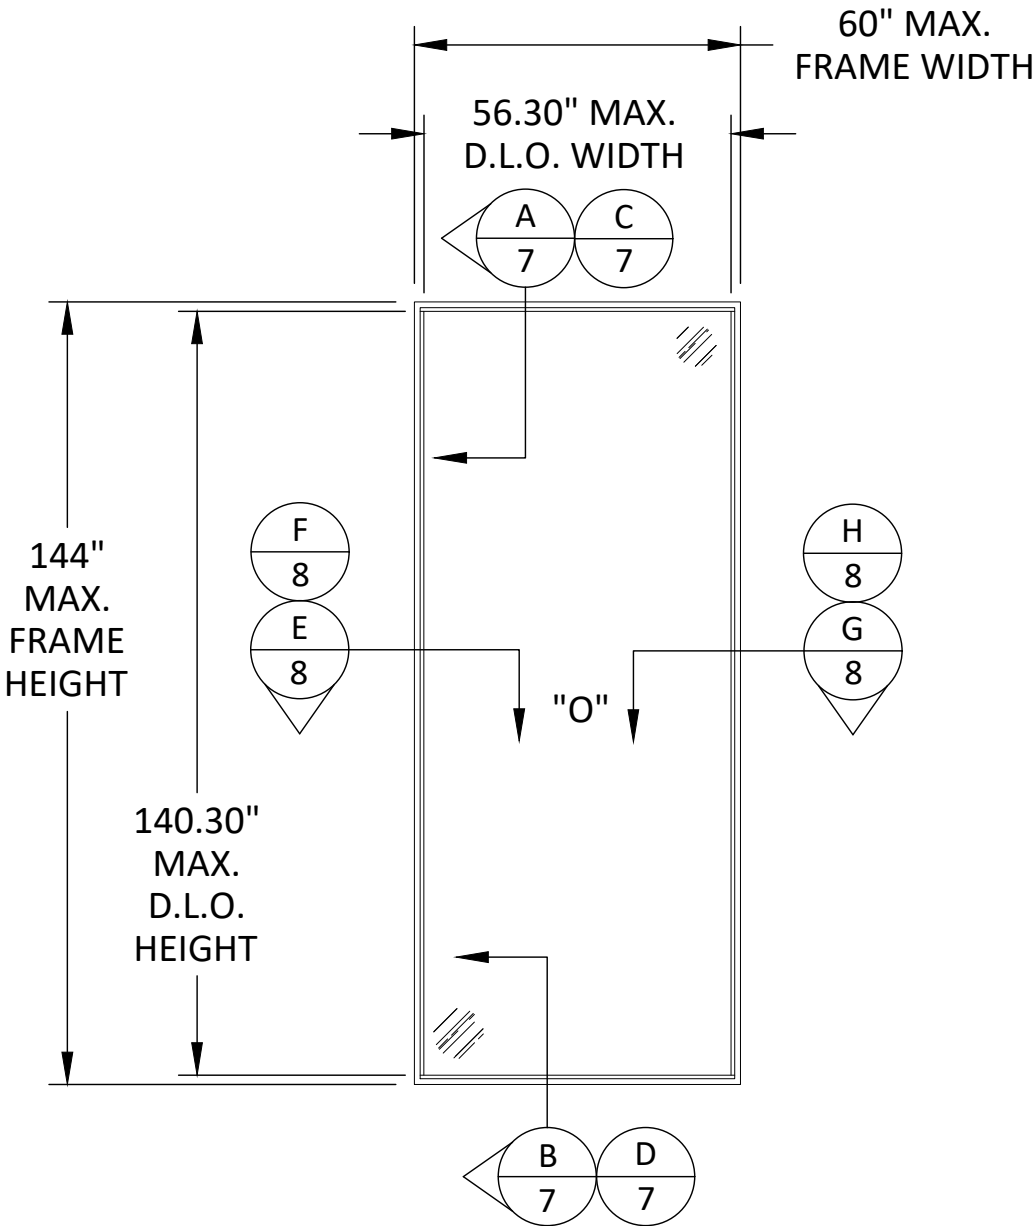

ELEVATION
FIXED WINDOW

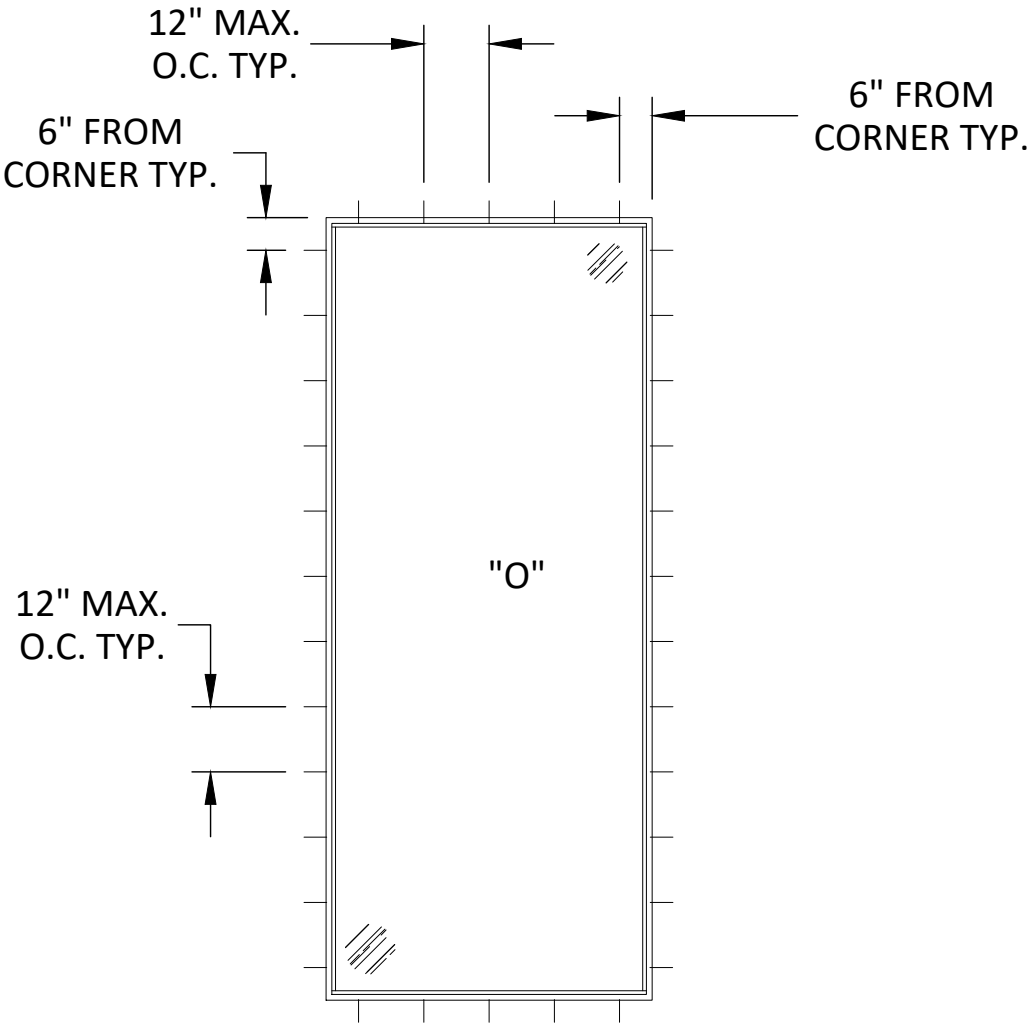

ANCHOR LAYOUT
FIXED WINDOW

NOTE: THROUGH FRAME, ANCHOR STRAP, OR DEFLECTION ANCHOR (HEAD ONLY) INSTALLATION SHOWN ABOVE. REFER TO SHEET 10 FOR NAIL FIN INSTALLATION ANCHOR LAYOUT.

TITLE: FARO 65 SERIES FIXED WINDOW
(HVHZ) (IMPACT)

ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC UPDATE	SM	10.19.22
2026 FBC UPDATE	LS	4.16.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL18656
DATE:	10.09.15
DWG. BY:	CHK. BY:
LMS	HFN
SCALE:	NTS
DWG. #:	BRB006
SHEET:	REV.
4	B
OF 10	

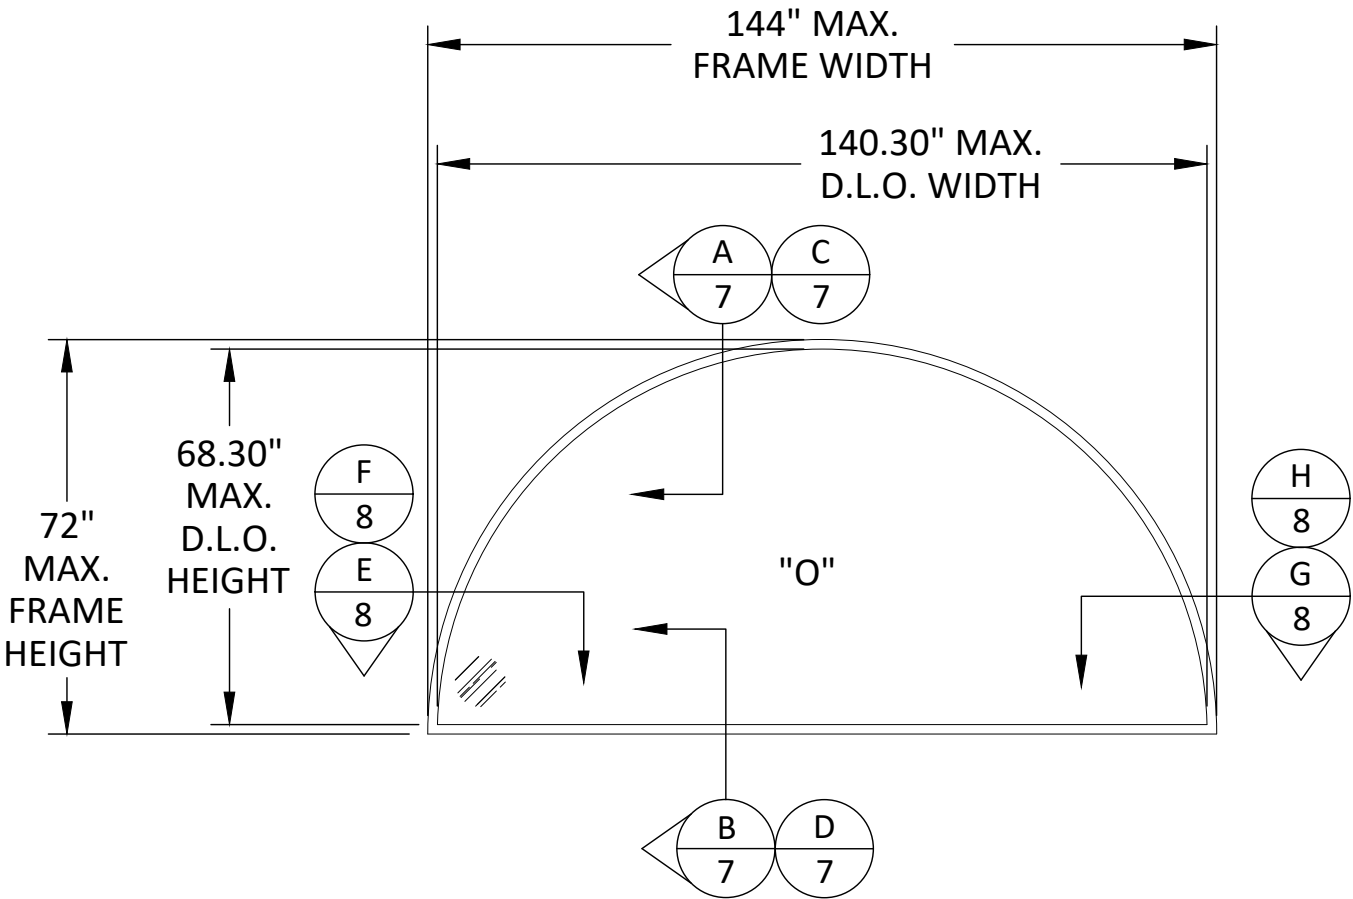

ELEVATION
ARCHED FIXED WINDOW
DP +/- 55 PSF

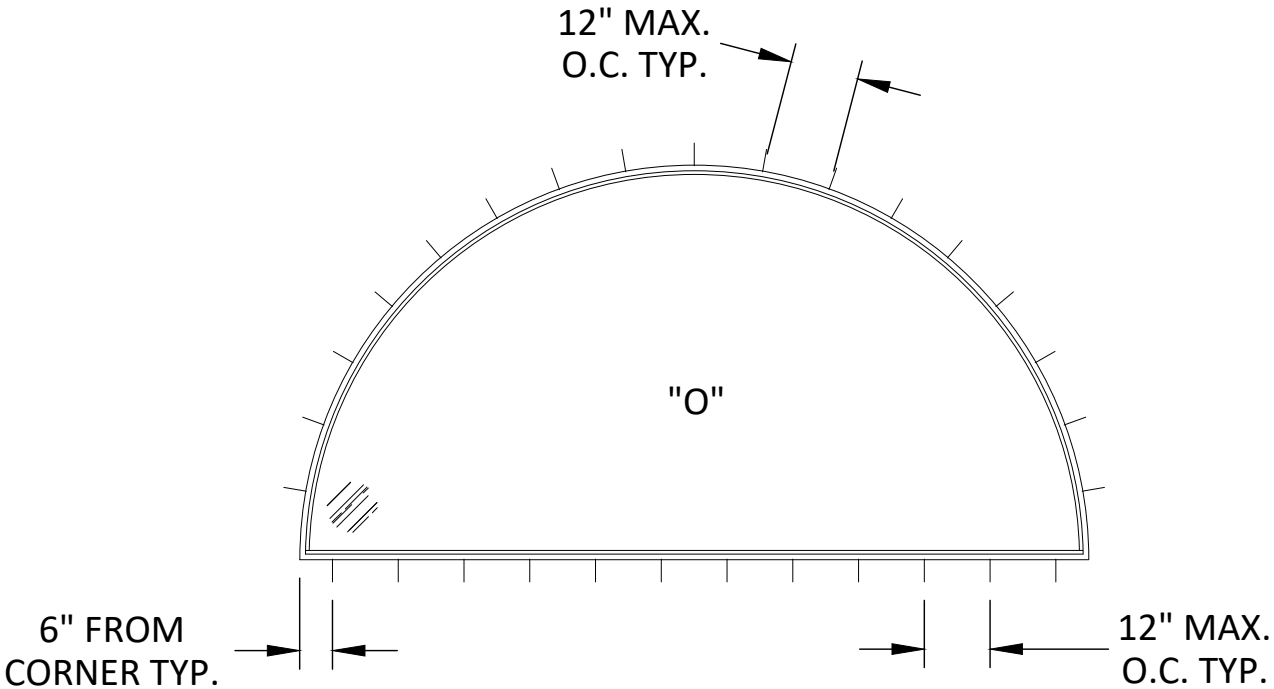

ANCHOR LAYOUT
ARCHED FIXED WINDOW

NOTE: THROUGH FRAME, ANCHOR STRAP, OR DEFLECTION ANCHOR (HEAD ONLY) INSTALLATION SHOWN ABOVE. REFER TO SHEET 10 FOR NAIL FIN INSTALLATION ANCHOR LAYOUT.

TITLE: FARO 65 SERIES FIXED WINDOW
(HVHZ) (IMPACT)

ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC UPDATE	SM	10.19.22
2026 FBC UPDATE	LS	4.16.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: FL18656

DATE: 10.09.15


DWG. BY: LMS
CHK. BY: HFN

SCALE: NTS


DWG. #: BRB006

SHEET: 5
REV. B

OF 10

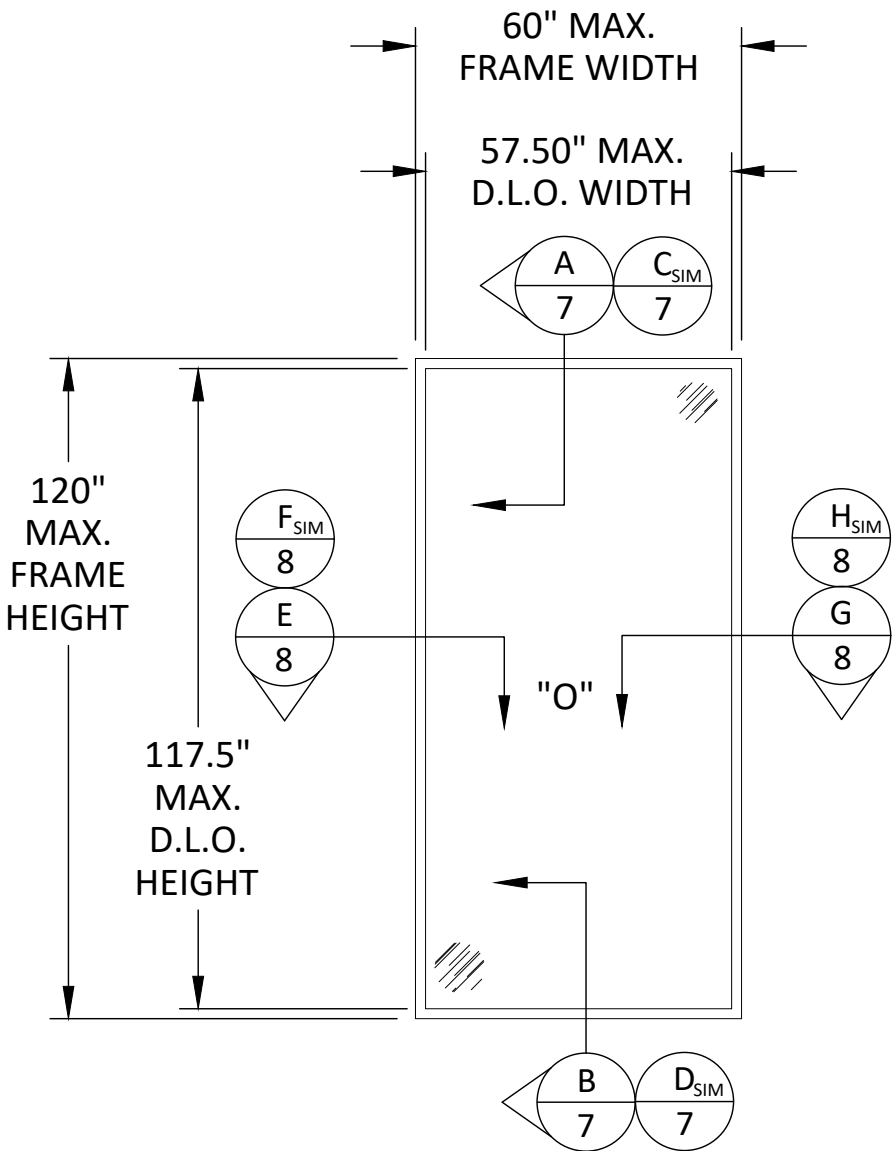

ELEVATION
FIXED WINDOW

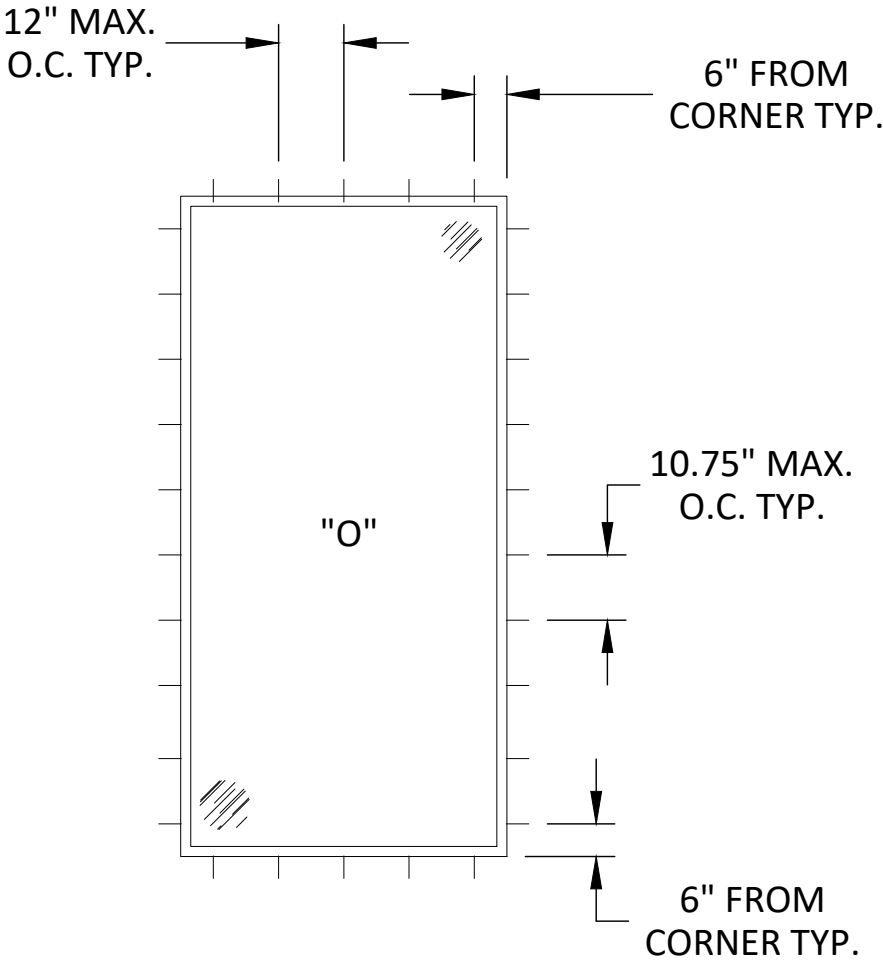



ANCHOR LAYOUT
FIXED WINDOW

NOTE: THROUGH FRAME, ANCHOR STRAP, OR DEFLECTION ANCHOR
(HEAD ONLY) INSTALLATION SHOWN ABOVE. REFER TO SHEET 10
FOR NAIL FIN INSTALLATION ANCHOR LAYOUT.

ALLOWABLE DESIGN PRESSURE CAPACITY TABLE

H - Unit Height	Comparative Analysis (ULD) Allowable Design Pressure																					
	W - Unit Width																					
	18.00	24.00	30.00	36.00	42.00	48.00	54.00	60.00	66.00	72.00	78.00	84.00	90.00	96.00	102.00	108.00	114.00	120.00	126.00	132.00	138.00	144.00
48.00	75.0	75.0	75.0	75.0	75.0	68.8	68.8	68.8	68.8	68.8	68.8	68.8	68.8	68.8	68.8	68.8	68.8	68.0	67.2	66.5	65.9	65.3
54.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	61.1	60.8	60.1	59.5
60.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0
66.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0	-	-	-
72.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	50.0	45.8	45.8	45.8	45.8	45.8	45.8	45.8	45.8	45.8	-	-	-	-
78.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	50.0	45.8	42.3	42.3	42.3	42.3	42.3	42.3	-	-	-	-	-	-
84.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	50.0	45.8	42.3	39.3	39.3	39.3	39.3	-	-	-	-	-	-	-
90.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	50.0	45.8	42.3	39.3	36.7	36.7	-	-	-	-	-	-	-	-
96.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	50.0	45.8	42.3	39.3	36.7	-	-	-	-	-	-	-	-	-
102.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	50.0	45.8	42.3	39.3	-	-	-	-	-	-	-	-	-	-
108.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	50.0	45.8	42.3	-	-	-	-	-	-	-	-	-	-	-
114.00	75.0	75.0	75.0	75.0	75.0	68.8	61.1	55.0	50.0	45.8	-	-	-	-	-	-	-	-	-	-	-	-
120.00	75.0	75.0	75.0	75.0	75.0	68.0	61.1	55.0	50.0	45.8	-	-	-	-	-	-	-	-	-	-	-	-
126.00	75.0	75.0	75.0	75.0	74.6	67.2	61.1	55.0	50.0	-	-	-	-	-	-	-	-	-	-	-	-	-
132.00	75.0	75.0	75.0	75.0	74.0	66.5	60.8	55.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-
138.00	75.0	75.0	75.0	75.0	73.4	65.9	60.1	55.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-
144.00	75.0	75.0	75.0	75.0	72.8	65.3	59.5	55.0	-	-	-	-	-	-	-	-	-	-	-	-	-	-

- NOTE:
- 1. DESIGN PRESSURES WERE EVALUATED IN ACCORDANCE WITH CHAPTER 17 OF THE CURRENT FBC.
 - 2. DESIGN PRESSURES MAY BE READ AS POSITIVE OR NEGATIVE.
 - 3. DESIGN PRESSURES APPLY FOR INDIVIDUAL WINDOW UNITS. MULLED CONFIGURATIONS SHALL BE EVALUATED SEPARATELY.

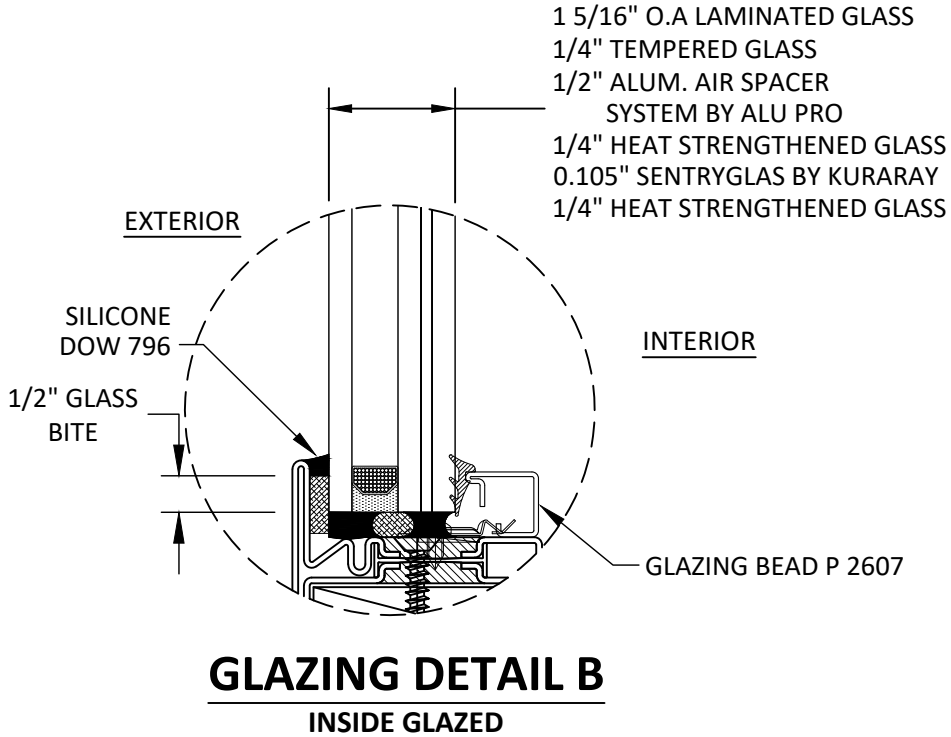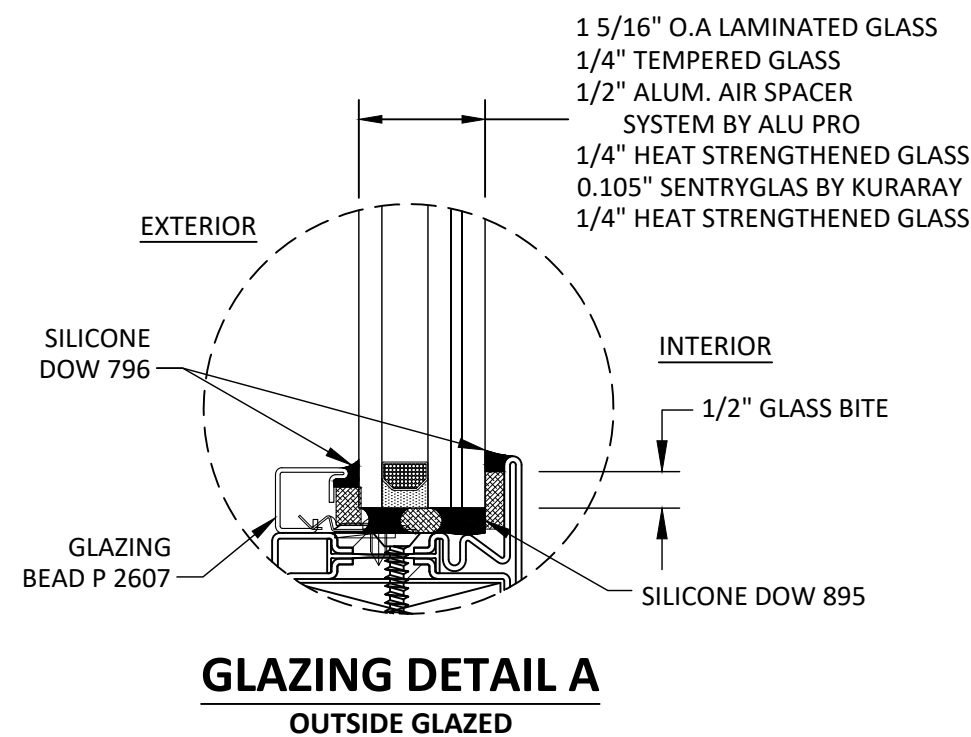

- GLAZING NOTES:**
- GLASS THICKNESS AND TYPE COMPLIES WITH ASTM E1300 GLASS CHART REQUIREMENTS.
 - GLASS TYPE COMPLIES WITH FBC SAFETY GLAZING REQUIREMENTS.
 - USE SETTING BLOCKS WITH 70 TO 90 SHORE A DUROMETER HARDNESS AT SILL FOR UNITS OVER 3 FEET IN WIDTH

BROMBAL
LUXURY METAL WINDOWS AND DOORS

BROMBAL SRL
VIA VALLA, 24
31030 CASELLE DI ALTIVOLE


TITLE: FARO 65 SERIES FIXED WINDOW
(HVHZ) (IMPACT)
DESIGN PRESSURE TABLE
& GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC UPDATE	SM	10.19.22
2026 FBC UPDATE	LS	4.16.26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

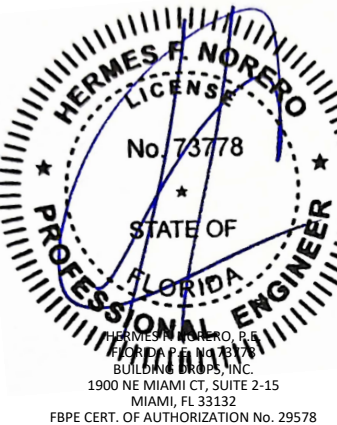


FL #:	FL18656	
DATE:	10.09.15	
DWG. BY:	LMS	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	BRB006	
SHEET:	6	REV. B
OF 10		

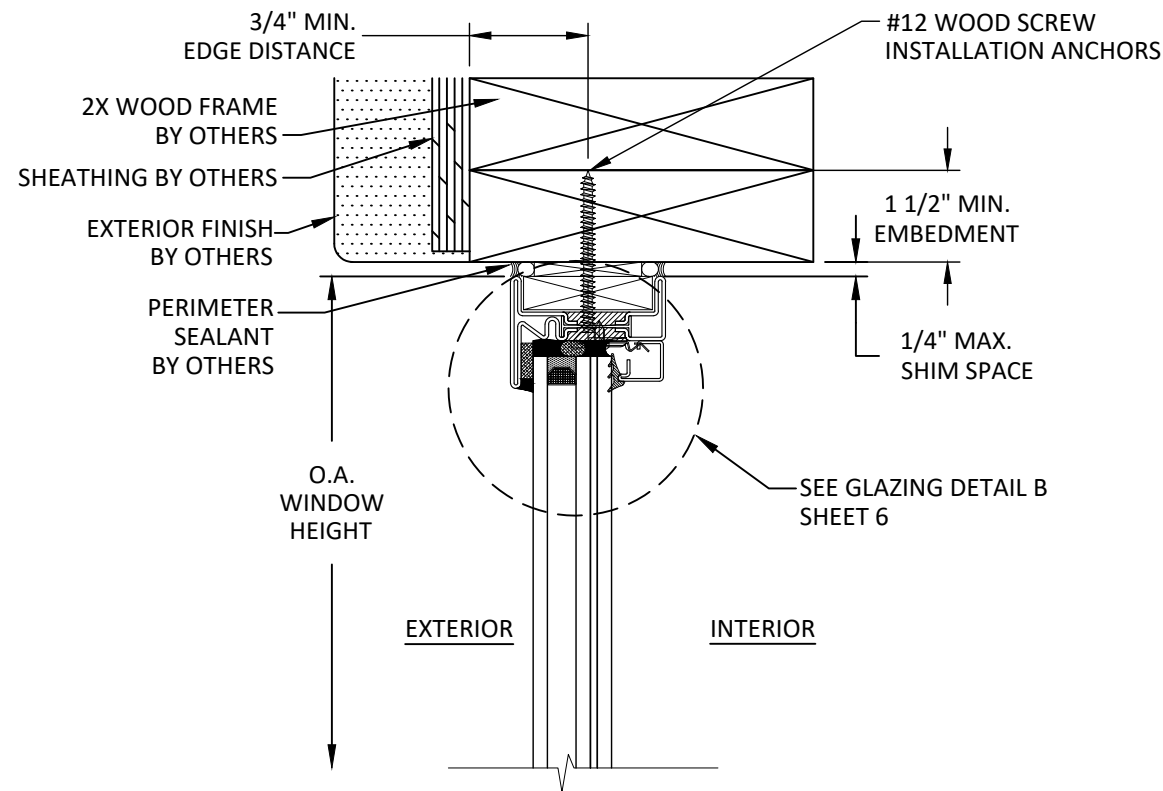


A
7 **VERTICAL SECTION**
FIXED HEAD - 2X WOOD FRAME
INSIDE GLAZED

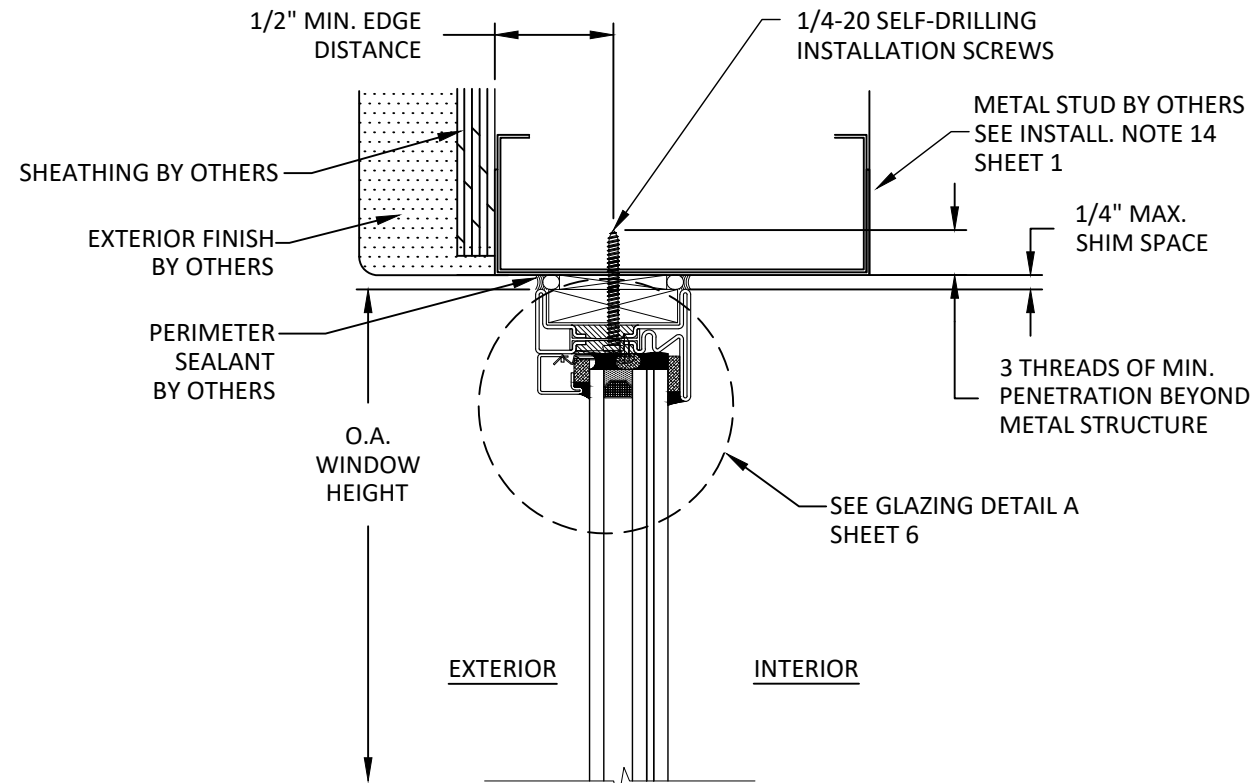

C
7 **VERTICAL SECTION**
FIXED HEAD - METAL STUD FRAME
OUTSIDE GLAZED

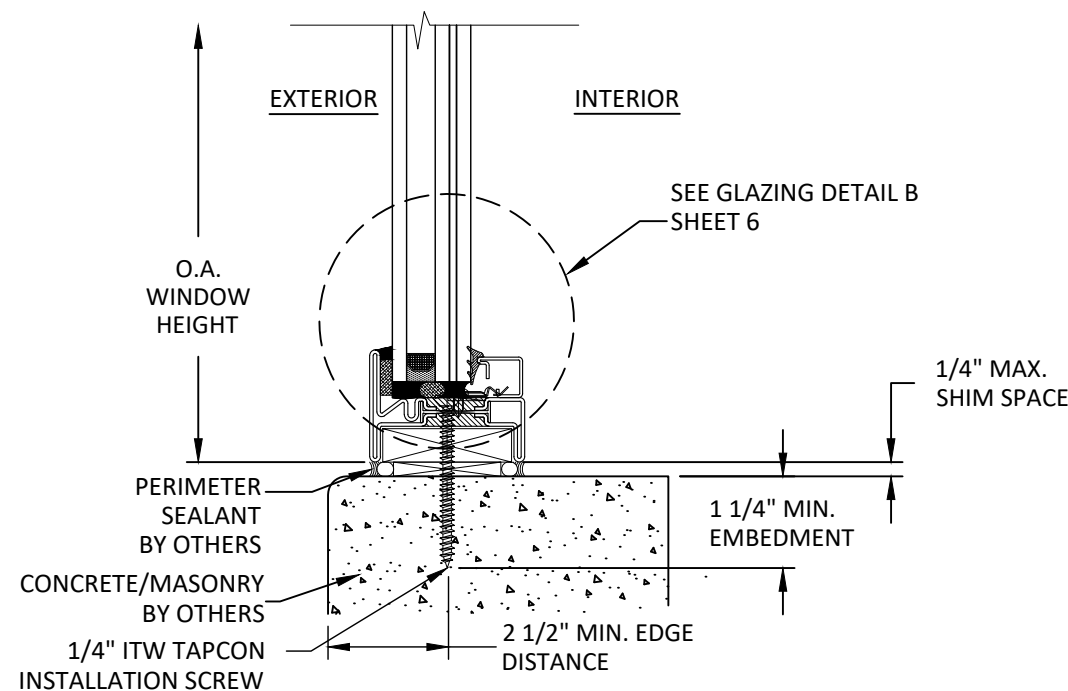

B
7 **VERTICAL SECTION**
FIXED SILL - CONCRETE/MASONRY
INSIDE GLAZED

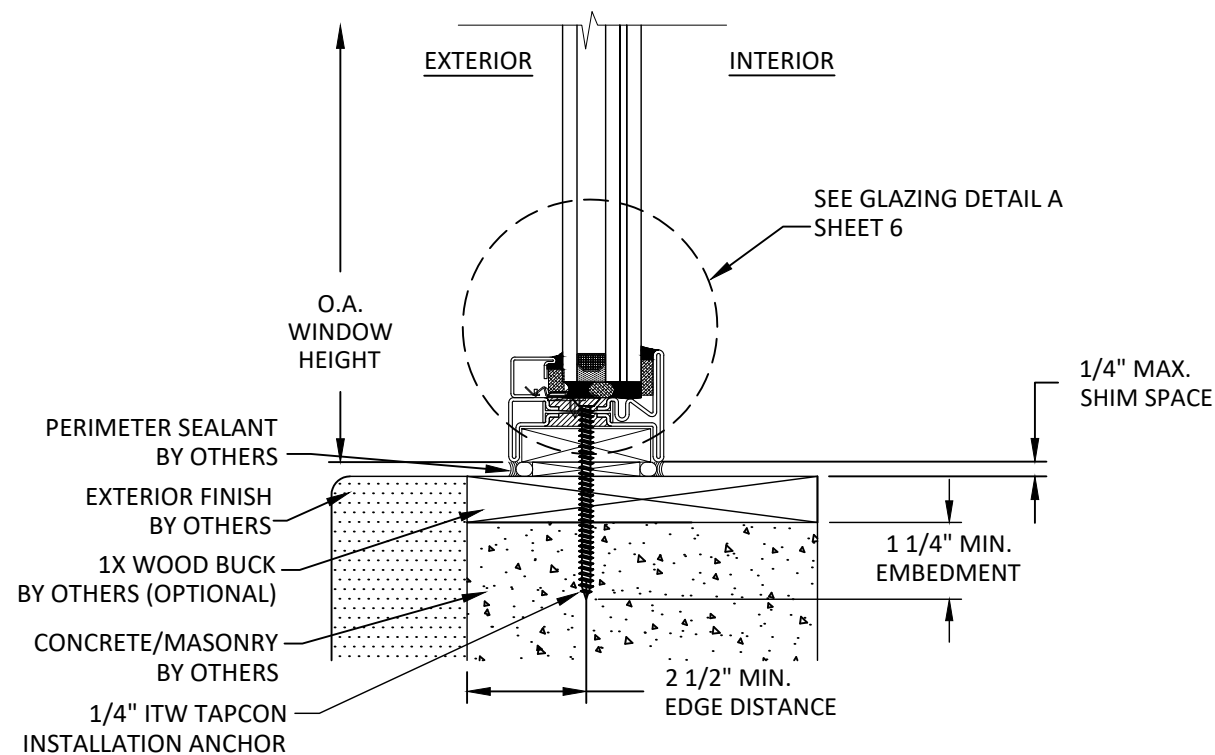

D
7 **VERTICAL SECTION**
FIXED SILL - 1X WOOD BUCK / CONCRETE/MASONRY
OUTSIDE GLAZED

BROMBAL
LUXURY METAL WINDOWS AND DOORS

BROMBAL SRL
VIA VALLA, 24
31030 CASELLE DI ALTIVOLE

TITLE: FARO 65 SERIES FIXED WINDOW
(HVHZ) (IMPACT)

VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC UPDATE	SM	10.19.22
2026 FBC UPDATE	LS	4.16.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL18656**


DATE: **10.09.15**

DWG. BY: **LMS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **BRB006**


SHEET: **7** REV. **B**

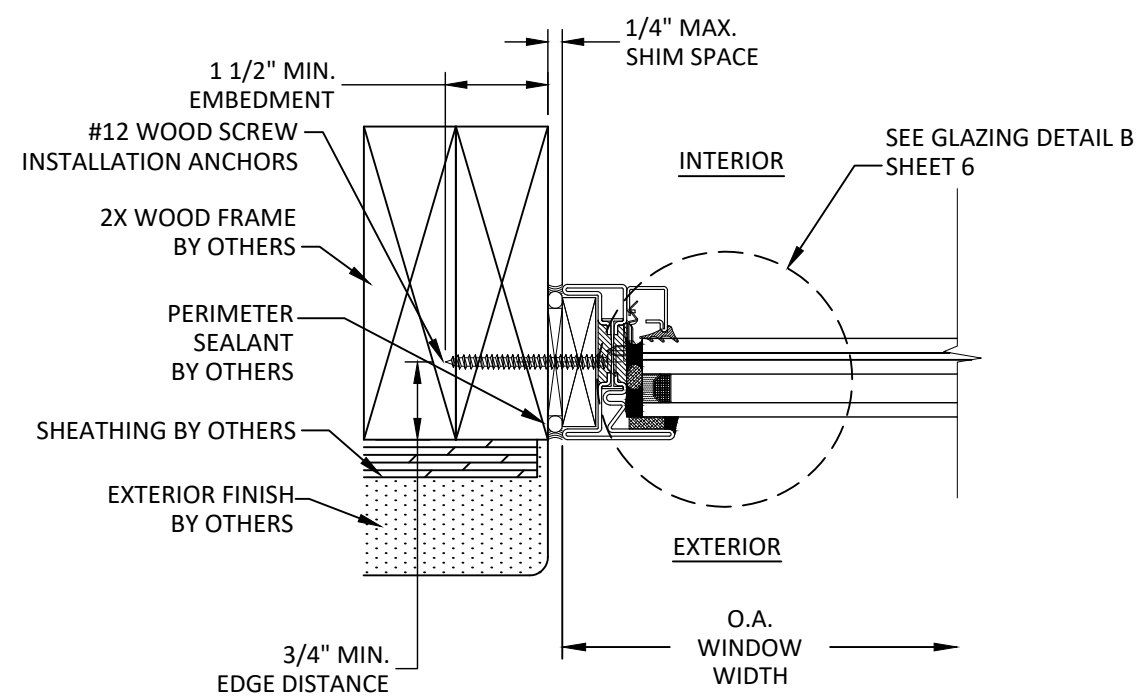


E
8 **HORIZONTAL SECTION**
FIXED JAMB - 2X WOOD FRAME
INSIDE GLAZED

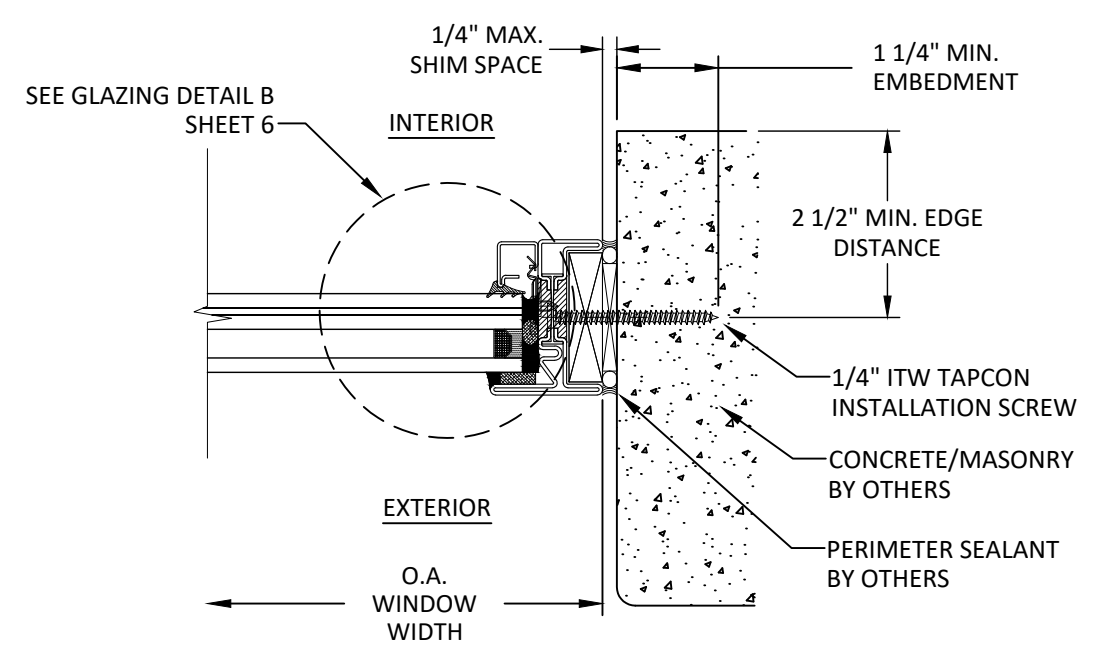

G
8 **HORIZONTAL SECTION**
FIXED JAMB - CONCRETE/MASONRY
INSIDE GLAZED

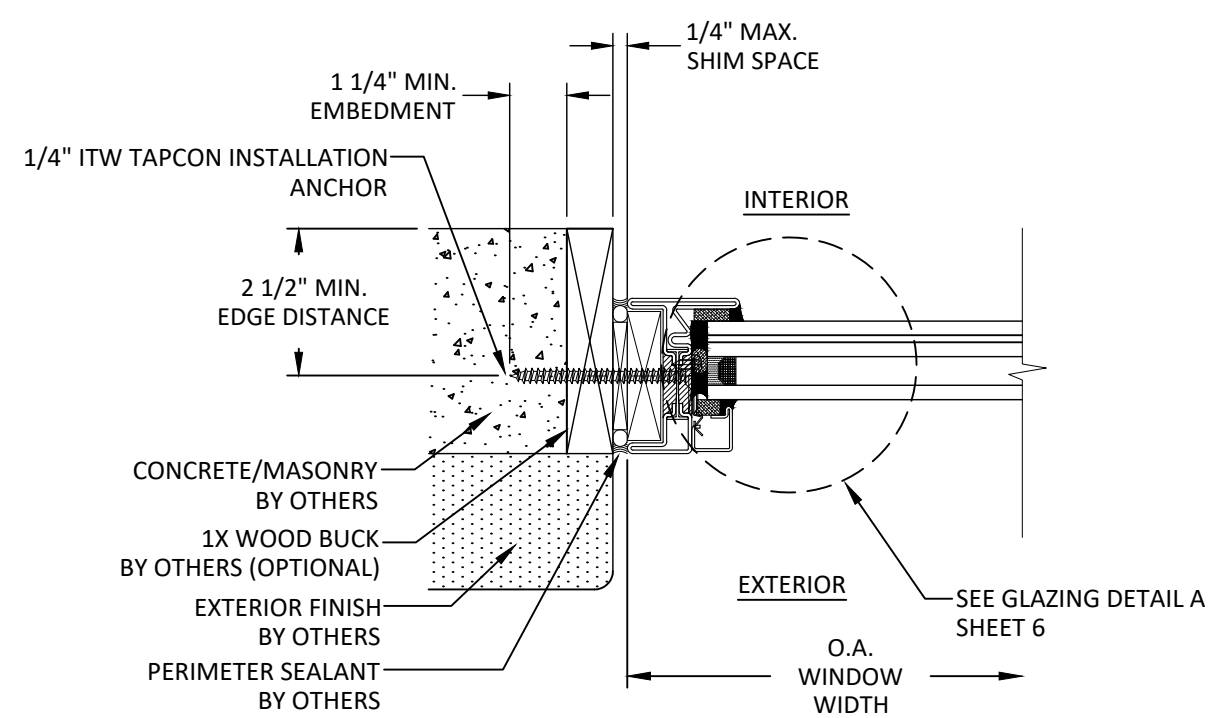

F
8 **HORIZONTAL SECTION**
FIXED JAMB - 1X WOOD BUCK / CONCRETE/MASONRY
OUTSIDE GLAZED

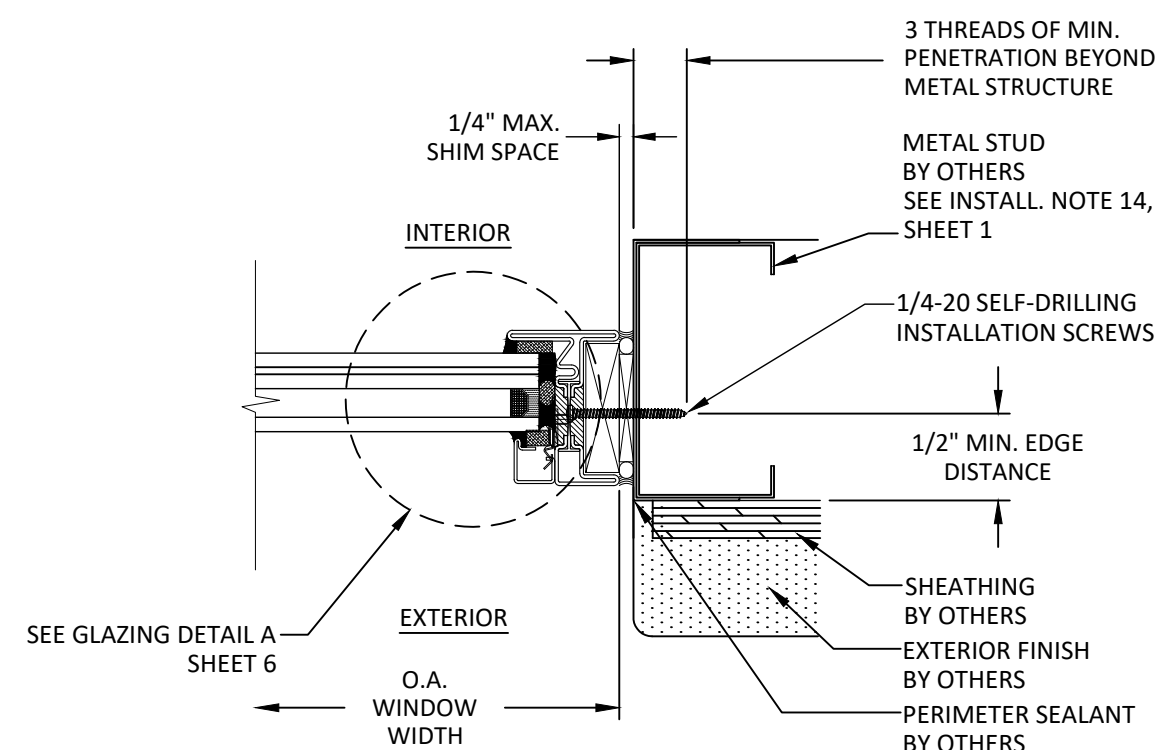

H
8 **HORIZONTAL SECTION**
FIXED JAMB - METAL STUD FRAME
OUTSIDE GLAZED

BROMBAL
LUXURY METAL WINDOWS AND DOORS

BROMBAL SRL
VIA VALLA, 24
31030 CASELLE DI ALTIVOLE

TITLE: FARO 65 SERIES FIXED WINDOW (HVHZ) (IMPACT)	HORIZONTAL SECTIONS	PREPARED BY:	BUILDING DROPS, INC. 1900 NE MIAMI COURT, STE. 2-15 MIAMI, FL 33132 PH: (954) 399-8478 FAX: (954) 744-4738 WEB: www.buildingdrops.com
			


REMARKS	BY	DATE
FBC UPDATE	SM	10.19.22
2026 FBC UPDATE	LS	4.16.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:		FL18656	
DATE:		10.09.15	
DWG. BY:	LMS	CHK. BY:	HFN
SCALE:		NTS	
DWG. #:		BRB006	
SHEET:		REV.	B

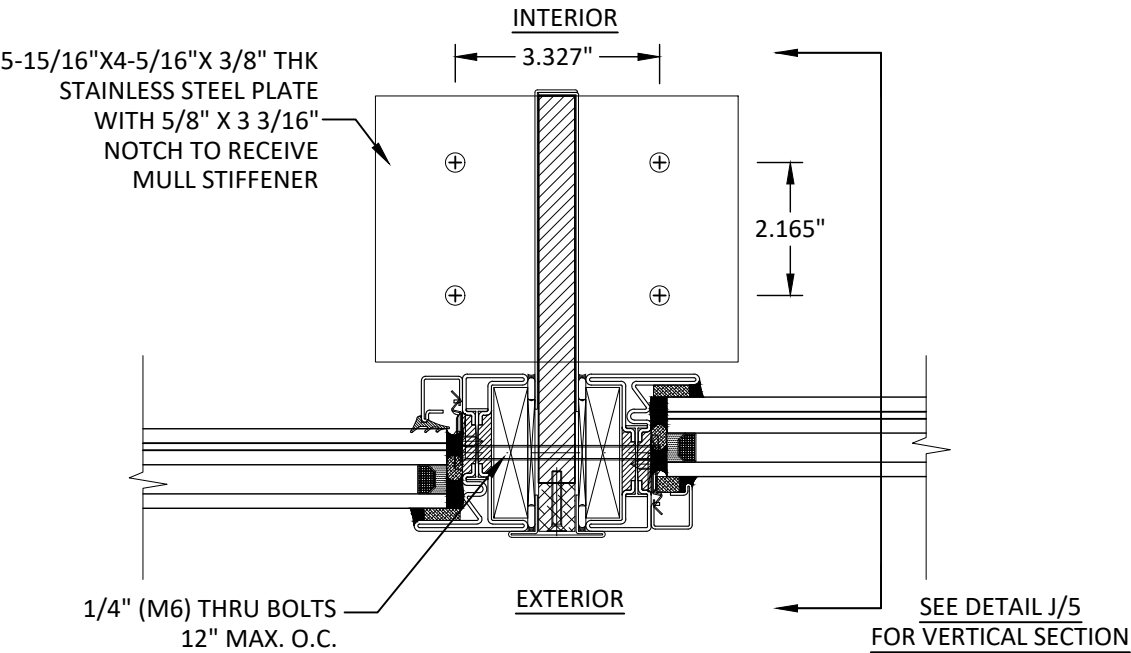


I
9 **HORIZONTAL SECTION**
MULLION DETAIL
WOOD/STEEL STUD SUBSTRATES

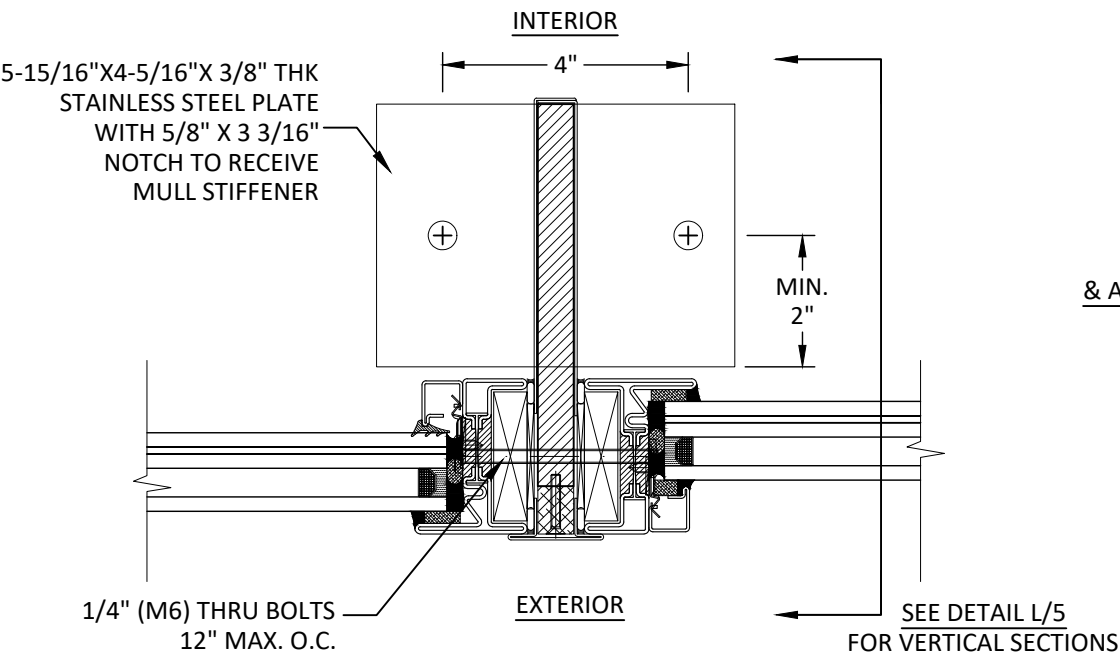


K
9 **HORIZONTAL SECTION**
MULLION DETAIL
CONCRETE SUBSTRATES

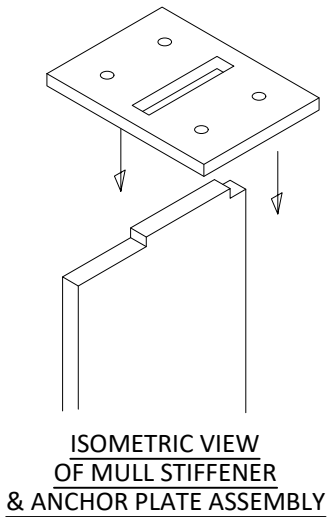

ISOMETRIC VIEW
OF MULL STIFFENER
& ANCHOR PLATE ASSEMBLY

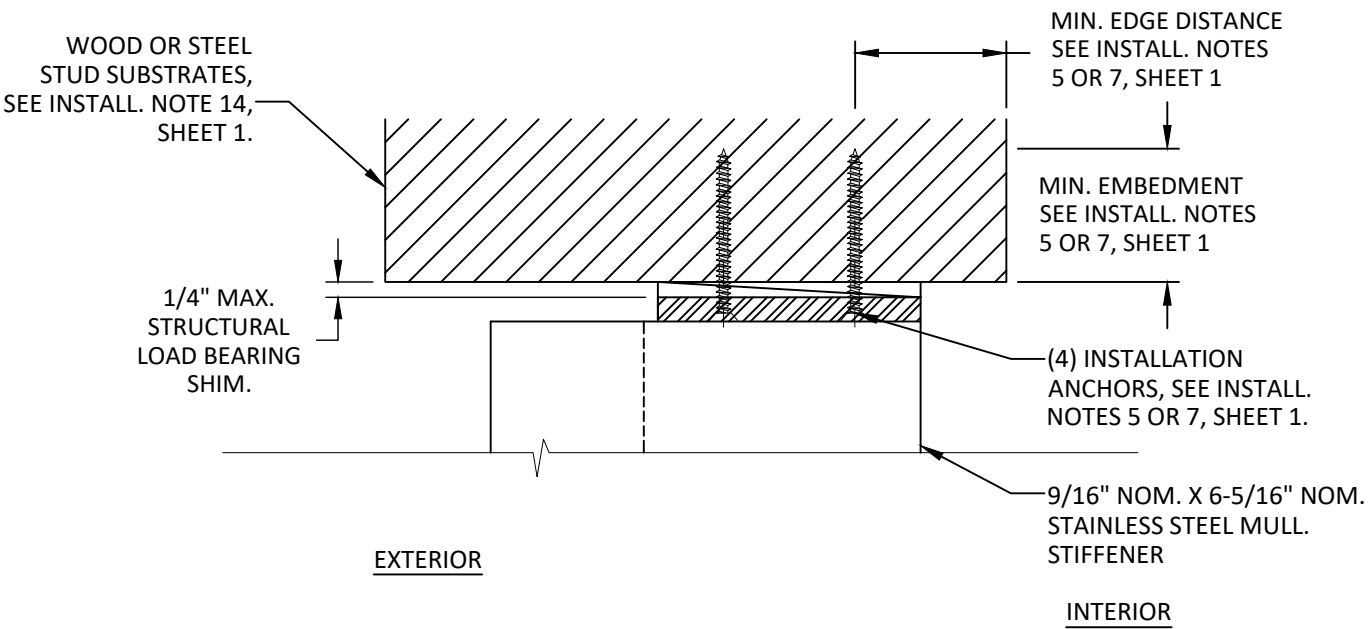

J
9 **VERTICAL SECTION**
MULLION DETAIL
WOOD/STEEL STUD SUBSTRATES

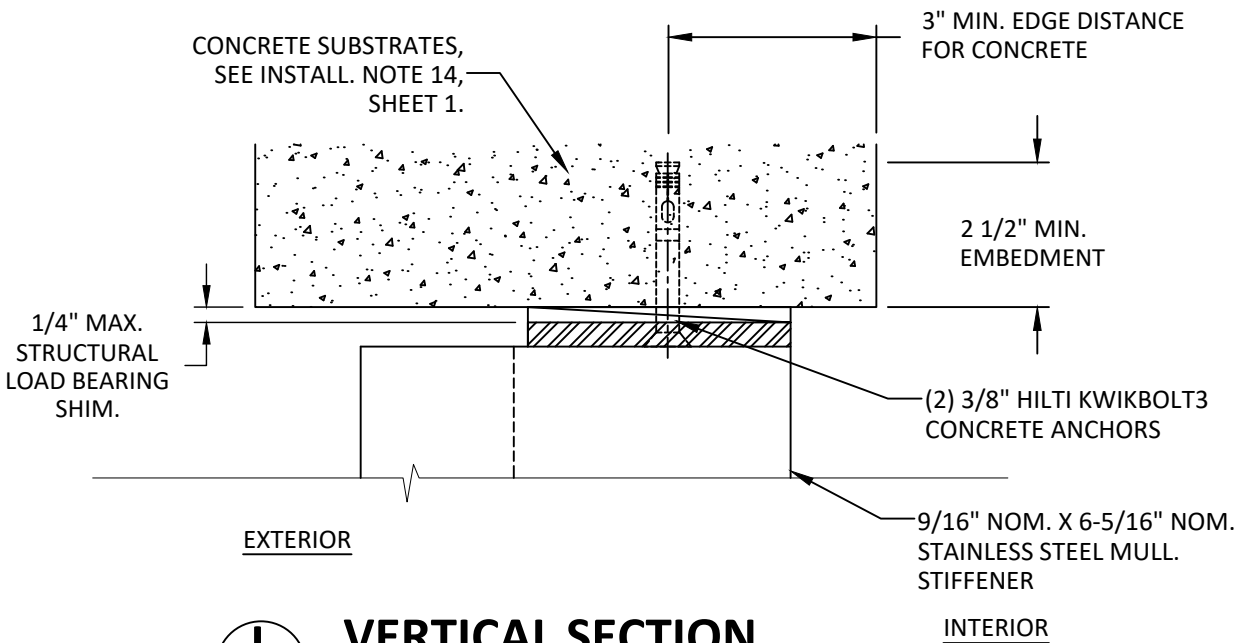

L
9 **VERTICAL SECTION**
MULLION DETAIL
CONCRETE SUBSTRATES

NOTE: ALTERNATE CONNECTIONS MAY BE DESIGNED BY A LICENSED ENGINEER ON A SITE BY SITE BASIS. FOR EXAMPLE, CONNECTIONS TO ACCOMMODATE BUILDING MOVEMENTS AND/OR LINTEL DEFLECTIONS.

BROMBAL
LUXURY METAL WINDOWS AND DOORS

BROMBAL SRL
VIA VALLA, 24
31030 CASELLE DI ALTIVOLE

TITLE: FARO 65 SERIES FIXED WINDOW
(HVHZ) (IMPACT)

MULLION CONNECTION
DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC UPDATE	SM	10.19.22
2026 FBC UPDATE	LS	4.16.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL18656
DATE:	10.09.15
DWG. BY:	LMS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	BRB006
SHEET:	9
REV.	B

TITLE: FARO 65 SERIES FIXED WINDOW
(HVHZ) (IMPACT)

ALTERNATE ANCHORAGE
DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC UPDATE	SM	10.19.22
2026 FBC UPDATE	LS	4.16.26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

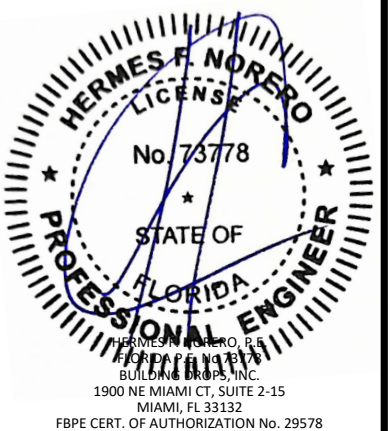


FL #:		FL18656	
DATE:		10.09.15	
DWG. BY:		CHK. BY:	
LMS		HFN	
SCALE:		NTS	
DWG. #:		BRB006	
SHEET:		REV.	
10		B	
		OF 10	

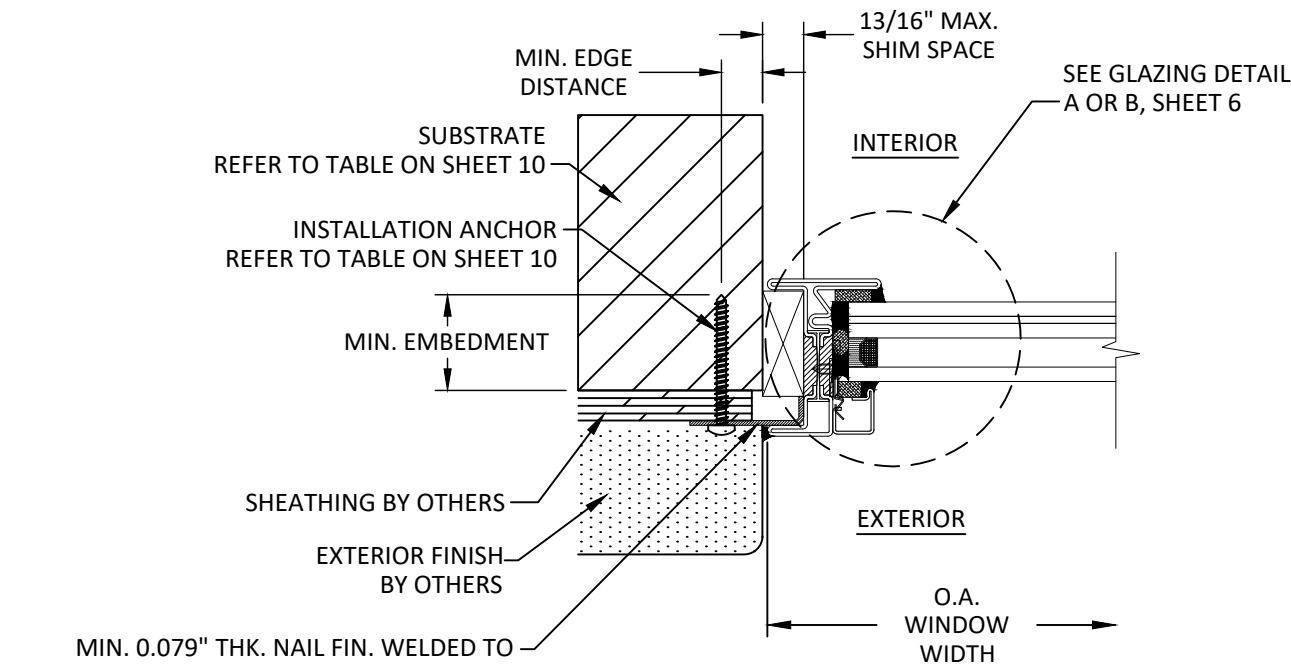


MIN. 0.079" THK. NAIL FIN. WELDED TO FRAME FOR STAINLESS & STEEL TO STEEL. FOR NAIL FIN SCREWED TO FRAME APPLICATIONS, NAIL FIN SHALL BE INSTALLED FOR SEALING & WEATHER PROOFING PURPOSES ONLY AND INSTALLATION SHALL USE ADDITIONAL ANCHOR STRAP OR THRU FRAME INSTALLATION METHODS.


M/10 HORIZONTAL SECTION
NAIL FIN INSTALLATION
TYP. INSTALLATION - HEAD/JAMB/SILL

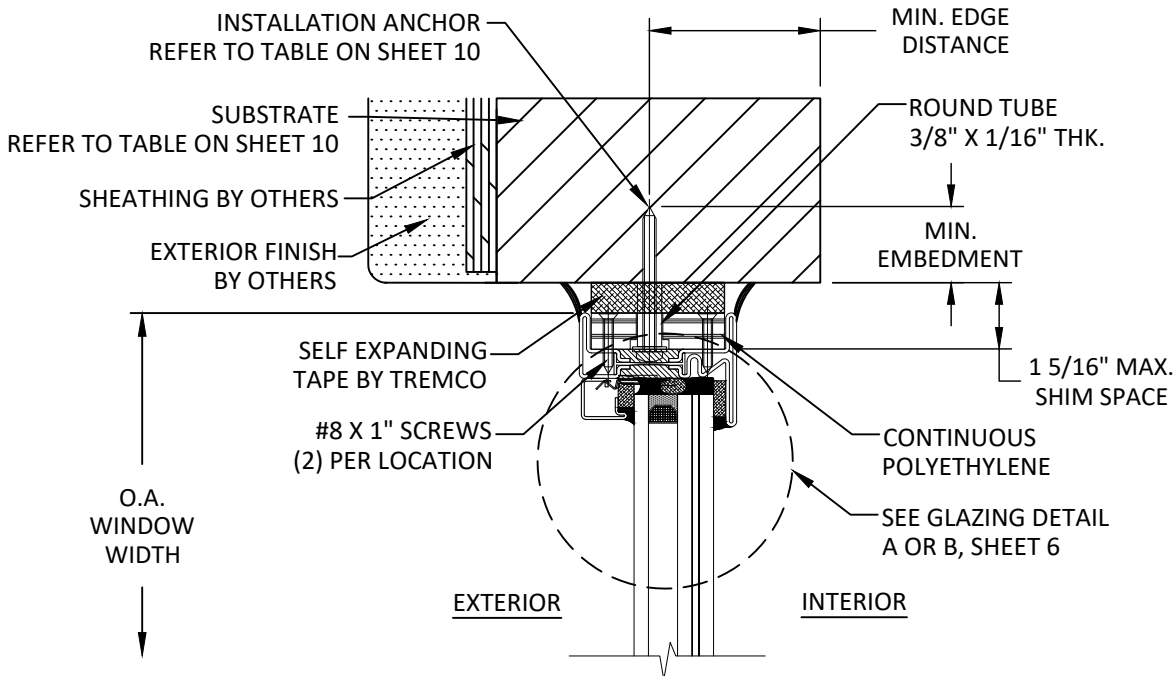

N/10 VERTICAL SECTION
DEFLECTION ANCHOR
TYP. INSTALLATION - HEAD ONLY

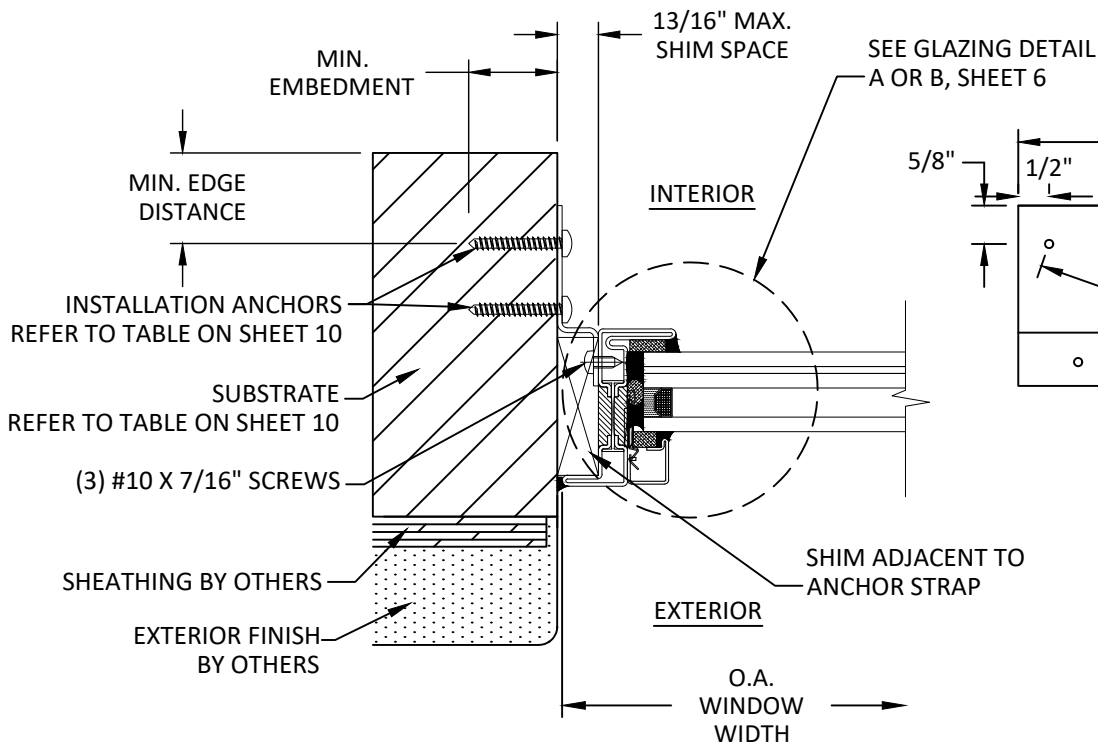

O/10 HORIZONTAL SECTION
THRU STRAP INSTALLATION
TYP. INSTALLATION - HEAD/JAMB/SILL

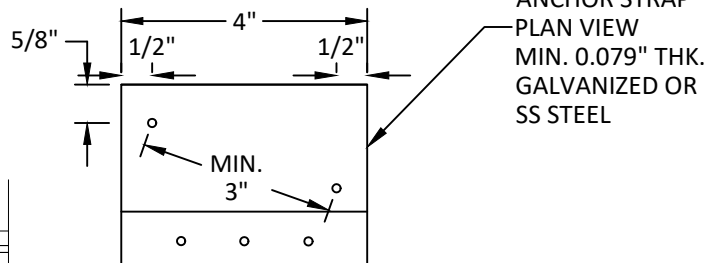

ALTERNATE ANCHOR OPTIONS

INSTALLATION METHOD								
METHOD	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE	MAX. DIST. FROM CORNERS	MAX. O.C. SPACING		
						H	J	S
NAIL FIN DETAIL M/10	MIN. S.G. = 0.55 WOOD	#12 WOOD SCREW	1.5"	0.75"	4"	8"	8"	8"
	18 GAUGE STEEL, MIN fy = 33 ksi	#12 PAN HEAD SCREW	3 THREADS PENETRATION	0.75"	4"	8"	8"	8"
THRU STRAP DETAIL O/10	MIN. S.G. = 0.55 WOOD	#12 WOOD SCREW	1.5"	0.75"	Refer to Elevations on Sheets 2-5 for Anchor Layout			
	18 GAUGE STEEL, MIN fy = 33 ksi	#12 PAN HEAD SCREW	3 THREADS PENETRATION	0.75"				
	CONCRETE/MASONRY, MIN fc = 3000 psi	1/4" ITW TAPCON	1 1/4"	2 1/2"				
THRU FRAME (DEFLECTION ANCHOR) DETAIL N/10	MIN. S.G. = 0.55 WOOD	#12 WOOD SCREW	1.5"	0.75"	Refer to Elevations on Sheets 2-5 for Anchor Layout			
	18 GAUGE STEEL, MIN fy = 33 ksi	#12 PAN HEAD SCREW	3 THREADS PENETRATION	0.75"				
	CONCRETE/MASONRY, MIN fc = 3000 psi	1/4" ITW TAPCON	1 1/4"	2 1/2"				