

DESIGN LOAD CAPACITY – PSF									
AVERAGE PANEL WIDTH INCHES		DOOR FRAME HEIGHT INCHES		JAMBS W/O ANCHORS			JAMBS WITH ANCHORS		
				STD. ASTRAGAL		REINF. ASTRAGAL	STD. ASTRAGAL		REINF. ASTRAGAL
				GLASS TYPES 'A' & 'A1'	GLASS TYPES 'B' & 'B1'		GLASS TYPES 'A' & 'A1'	GLASS TYPES 'B' & 'B1'	
				EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)
30	82-7/8	100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
36		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
42		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
48		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
54	84	88.9	88.9	71.1	71.1	88.9	88.9	80.0	80.0
60		80.0	80.0	–	–	80.0	80.0	–	–
30		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
36		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
42	90	100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
48		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
54		88.9	88.9	–	–	88.9	88.9	–	–
60		–	–	–	–	–	–	–	–
30	96	100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
36		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
42		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
48		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
54	102	88.9	88.9	–	–	88.9	88.9	–	–
60		–	–	–	–	–	–	–	–
30		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
36		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
42	108	100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
48		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
54		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
60		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
30	114	100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
36		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
42		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
48		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
54	120	100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
60		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
30		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
36		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
42	120	100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
48		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
54		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0
60		100.0	100.0	80.0	80.0	100.0	100.0	80.0	80.0

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

INSTRUCTIONS:

USE CHARTS AS FOLLOWS.

- STEP 1
DETERMINE DESIGN WIND LOAD REQUIREMENT BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
- STEP 2
DETERMINE DOOR CAPACITY FROM TABLE ON SHEET 1 FOR THE GLASS TYPE USED.
- STEP 3
USING CHARTS ON SHEET 4 SELECT HEAD ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE.
- STEP 4
THE LOWEST VALUE RESULTING FROM STEPS 2 AND 3 SHALL APPLY TO ENTIRE SYSTEM.
- STEP 5
FOR DOORS WITH UNANCHORED JAMBS, USING SHEET 8 DETERMINE MIN. AND MAX. GAP DIMENSIONS.


THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

SERIES MG-1000 (L.M.I.)
ALUMINUM SLIDING GLASS DOOR

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).
WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.
A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.
ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.
MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE.
MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1710.8.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1710.8.2.

- A- THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; i.e. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.
- B- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- C- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- D- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- E- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

FL #19092

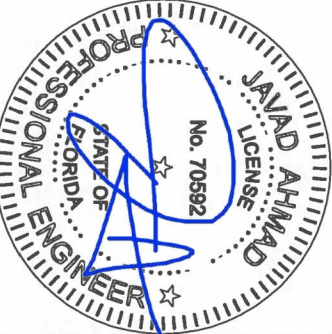

date: 10-28-15

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

revisions:

no	date	by	description
A	11.17.15		GENERAL REVISION







MG-1000 ALUM SLIDING GLASS DOOR (L.M.I.)
MR. GLASS DOORS & WINDOWS INC.
8120 N.W. 84 STREET
MEDLEY, FL. 33166
TEL. (305) 470-8284 FAX. (305) 470-8285

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978




EXTERIOR(+) LOADS SHOWN IN CHART ABOVE ARE FOR ALL DOOR CONFIGURATIONS EXCEPT TWO PANEL (XX) DOORS
SEE SHEET 6 FOR TWO PANEL (XX) DOOR LIMITATIONS.

AVERAGE PANEL WIDTH = DOOR FRAME WIDTH / NUMBER OF PANELS

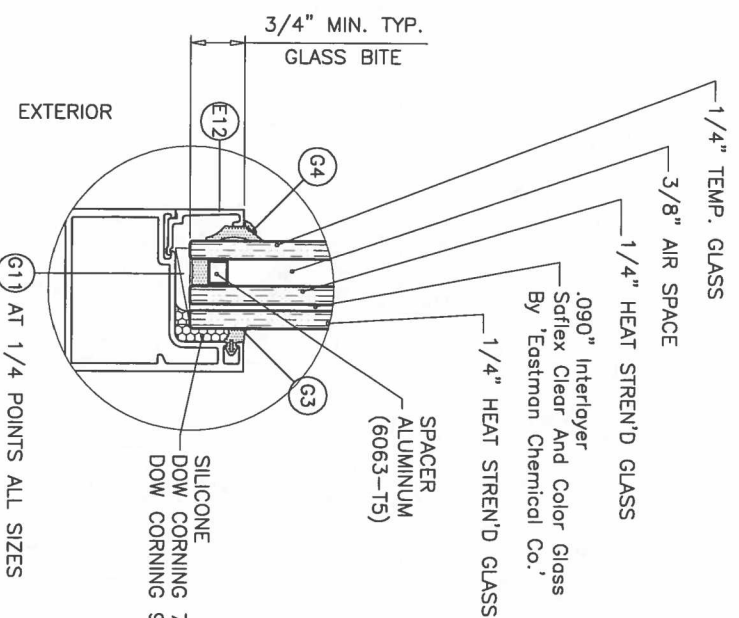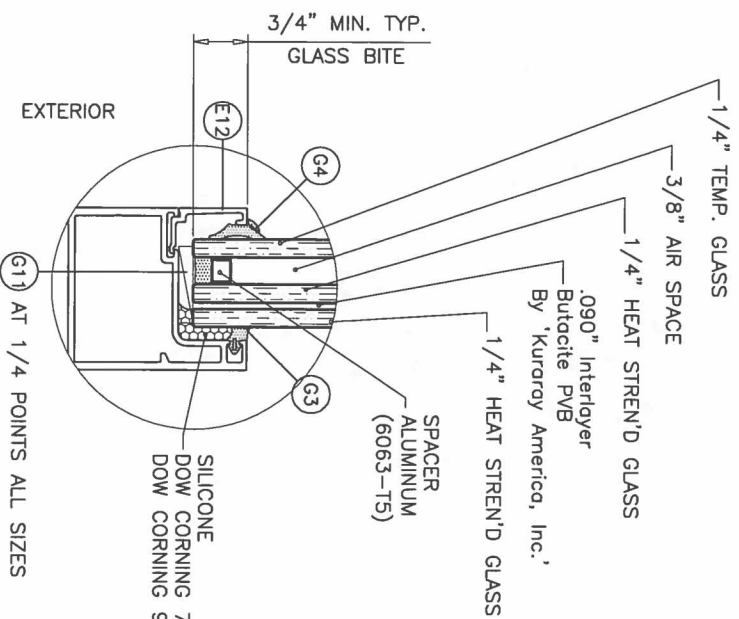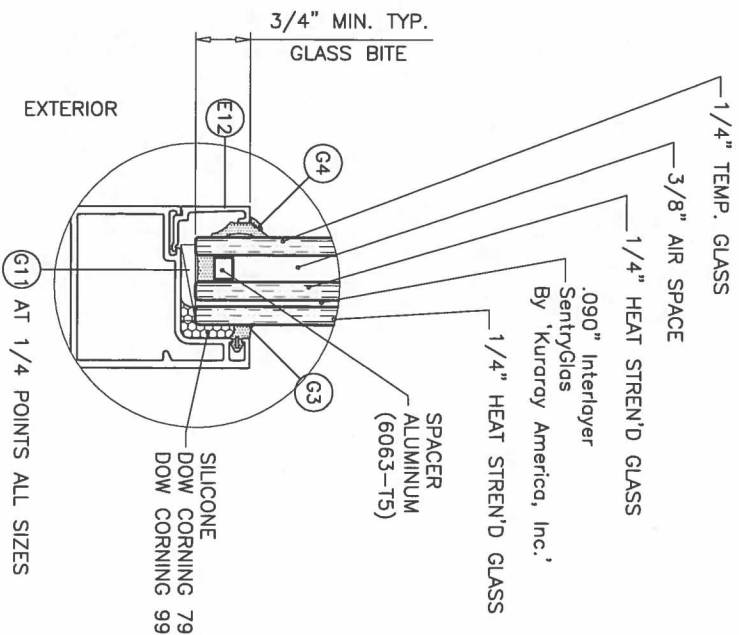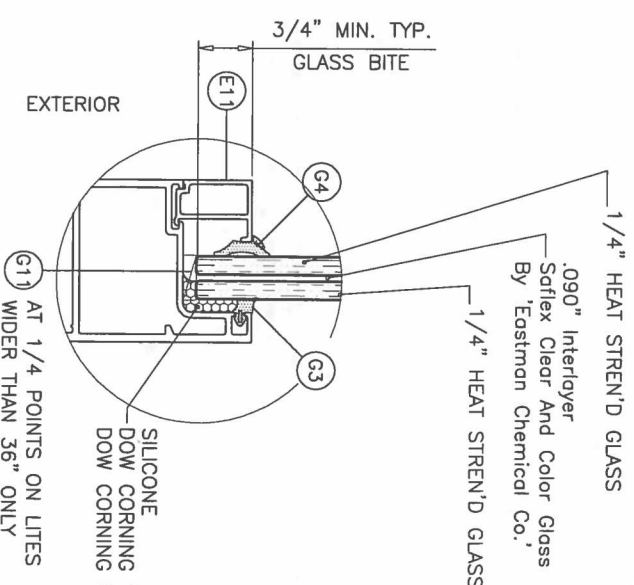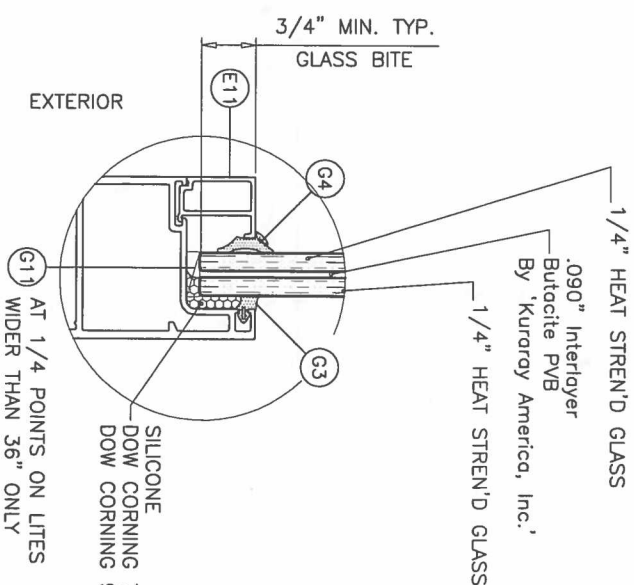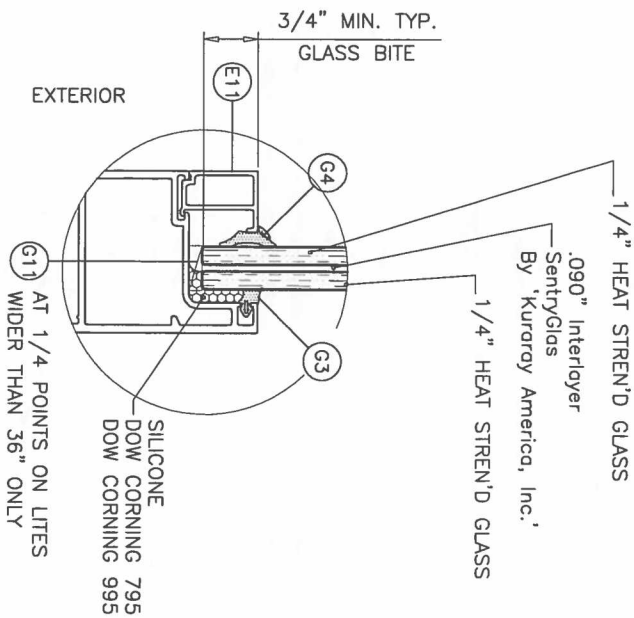

GLAZING OPTIONS

FL #19092

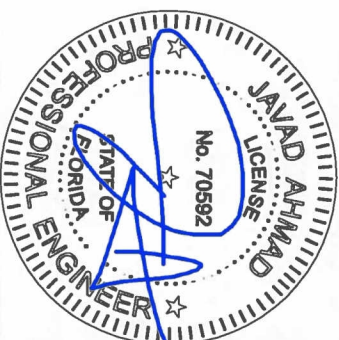


date: 10-28-15	revisions:
scale: 3/8" = 1"	no date by description
dr. by: TARIQ	
chk. by:	

MG-1000 ALUM SLIDING GLASS DOOR (L.M.I.)
MR. GLASS DOORS & WINDOWS INC.
8120 N.W. 84 STREET
MEDLEY, FL. 33166
TEL. (305) 470-8284 FAX. (305) 470-8285


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978



COMP-ANL\W15-83MG

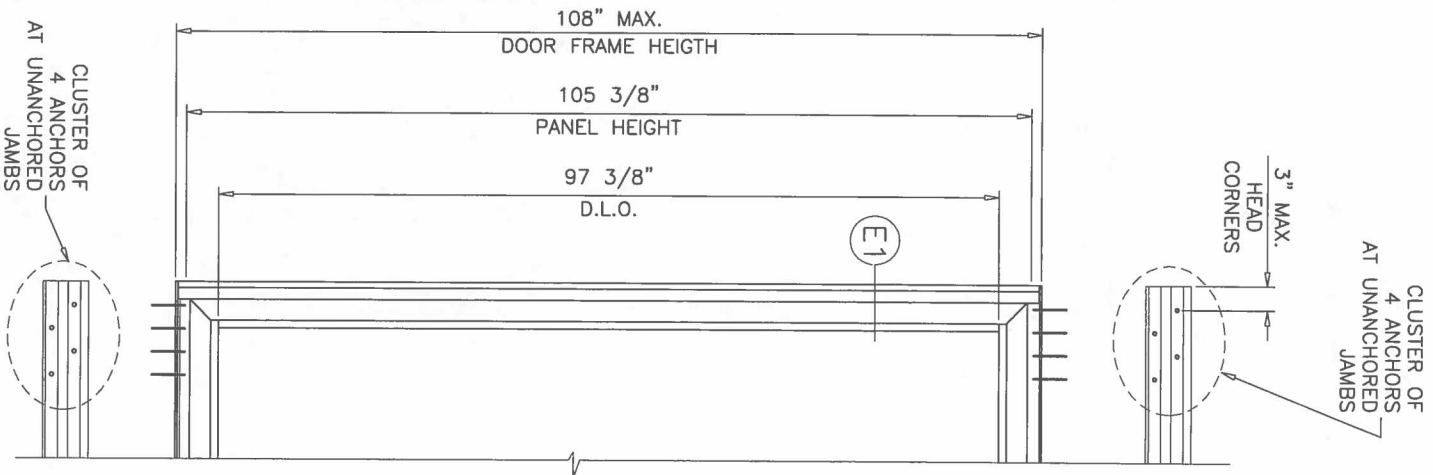

JAMB OPTION W/O ANCHORS
(108" MAX. DOOR HEIGHT)
(MAX. DESIGN LOADS = ±100.0 PSF)

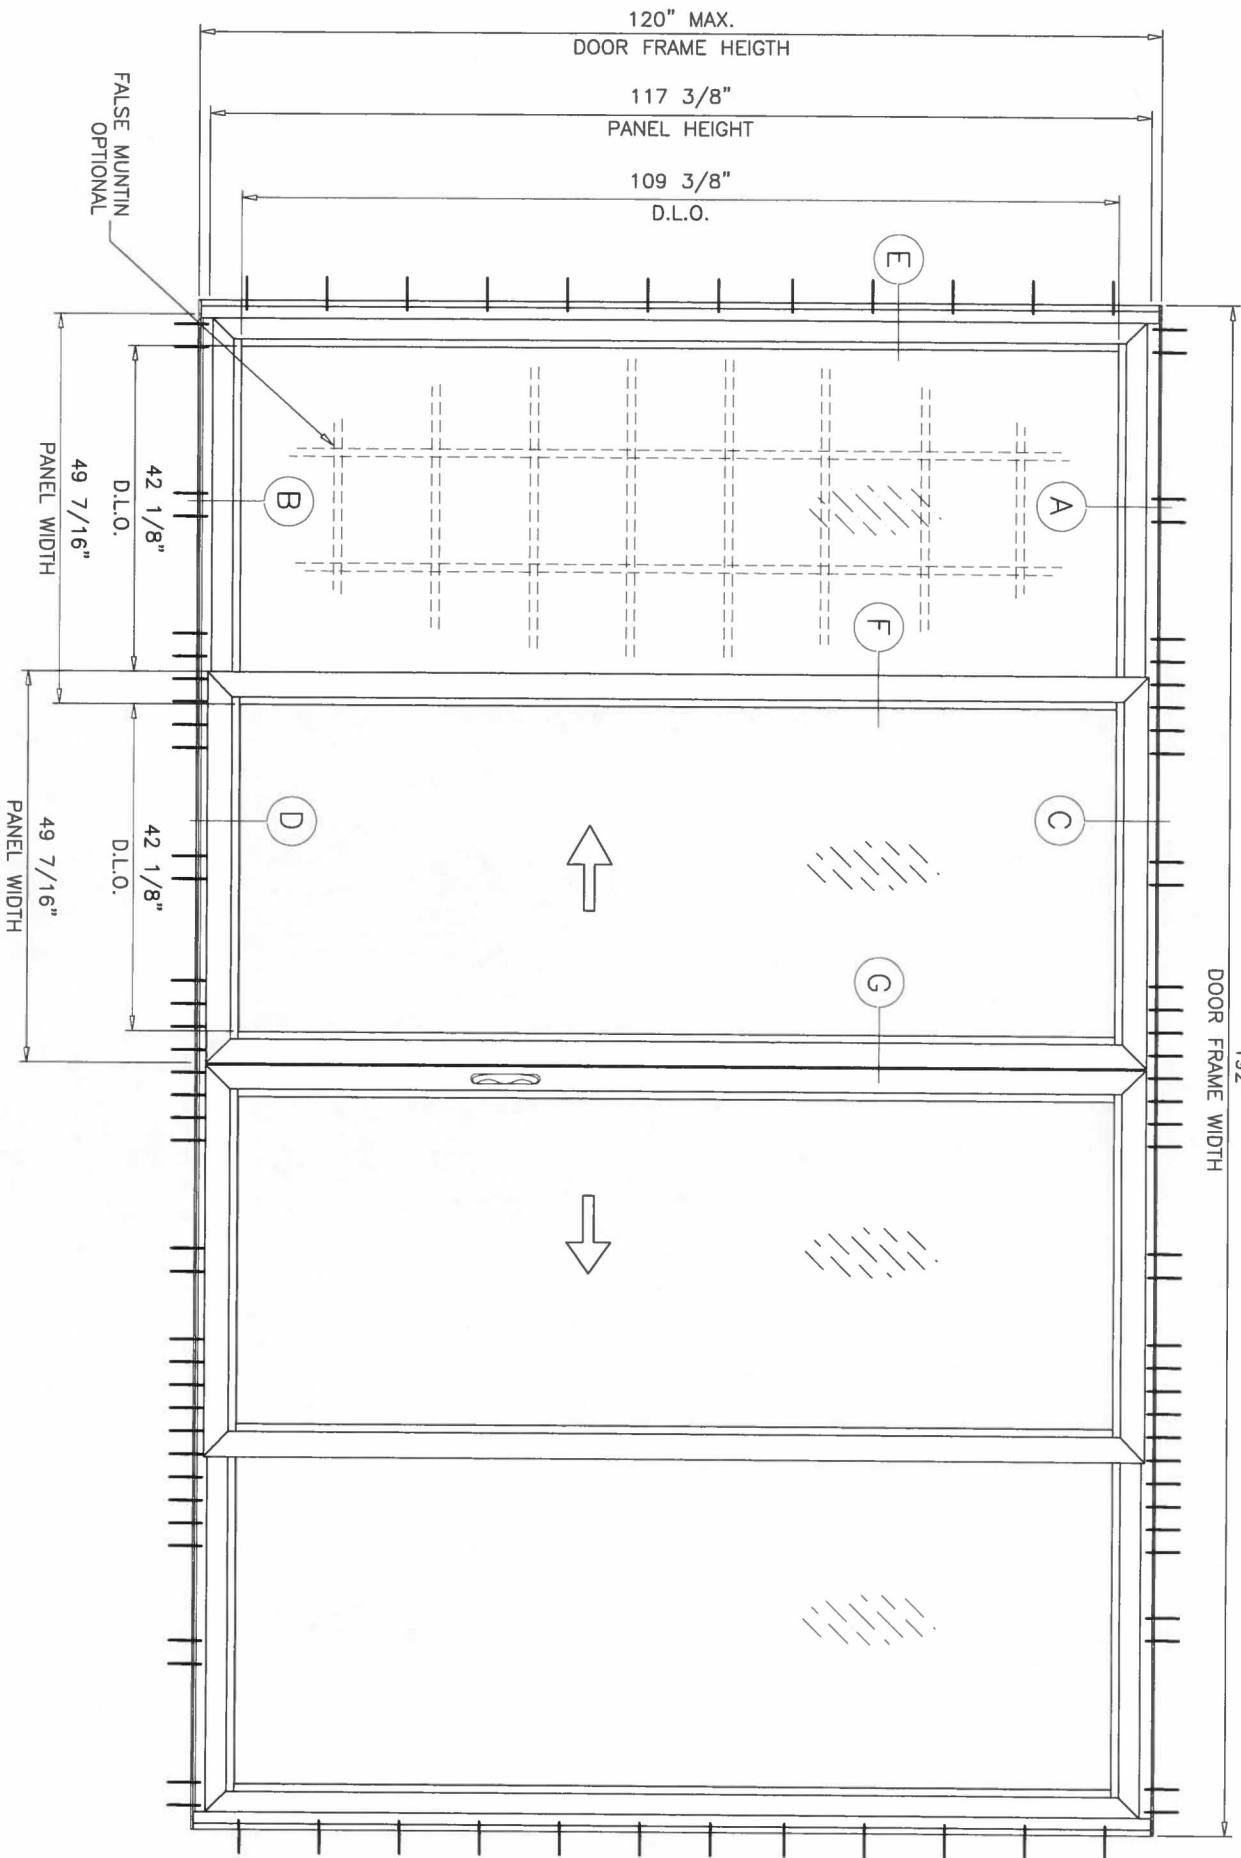

DAYLITE OPENINGS WIDTHS:
PANEL WIDTH - 7.313"



DAYLITE OPENING HEIGHT:
PANEL HEIGHT - 8.0"

PANEL HEIGHT = DOOR FRAME HEIGHT - 2.625"


MAX. FRAME AREA OF S.G.D. SHALL NOT EXCEED FRAME AND PANEL AREA OF TESTED UNIT PER FBC REQUIREMENTS.

CLUSTER OF 6, 8 OR 10 ANCHORS AT INTERLOCK/ASTRAGAL (SEE SHEET 4)

TYPICAL ELEVATION
TESTED UNIT

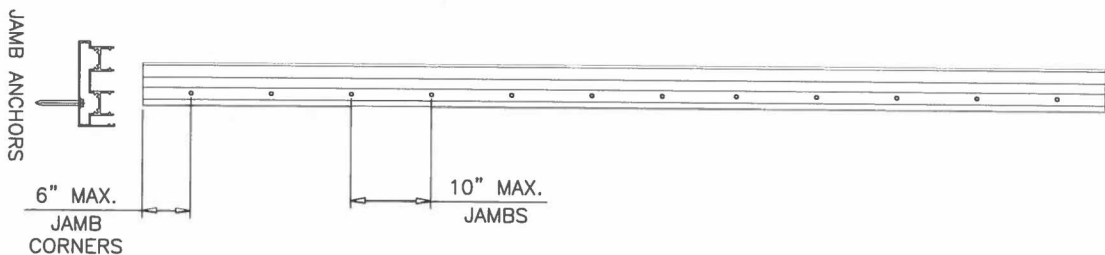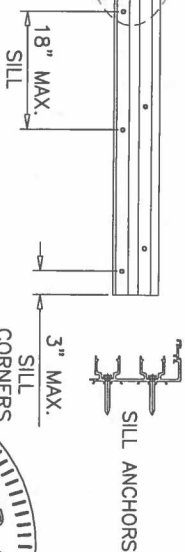

FL #19092

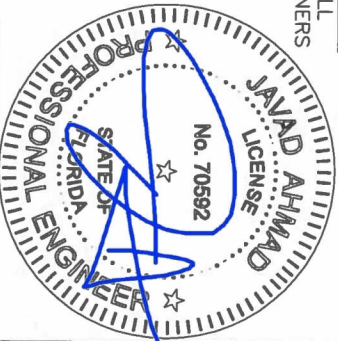













date: 10-28-15	revisions:
scale: 1/2"=1'-0"	no date by description
dr. by: TARIQ	
chk. by:	

MG-1000 ALUM SLIDING GLASS DOOR (L.M.I.)
MR. GLASS DOORS & WINDOWS INC.
8120 N.W. 84 STREET
MEDLEY, FL. 33166
TEL. (305) 470-8284 FAX. (305) 470-8285

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c


COMP-ANL\W15-83MG

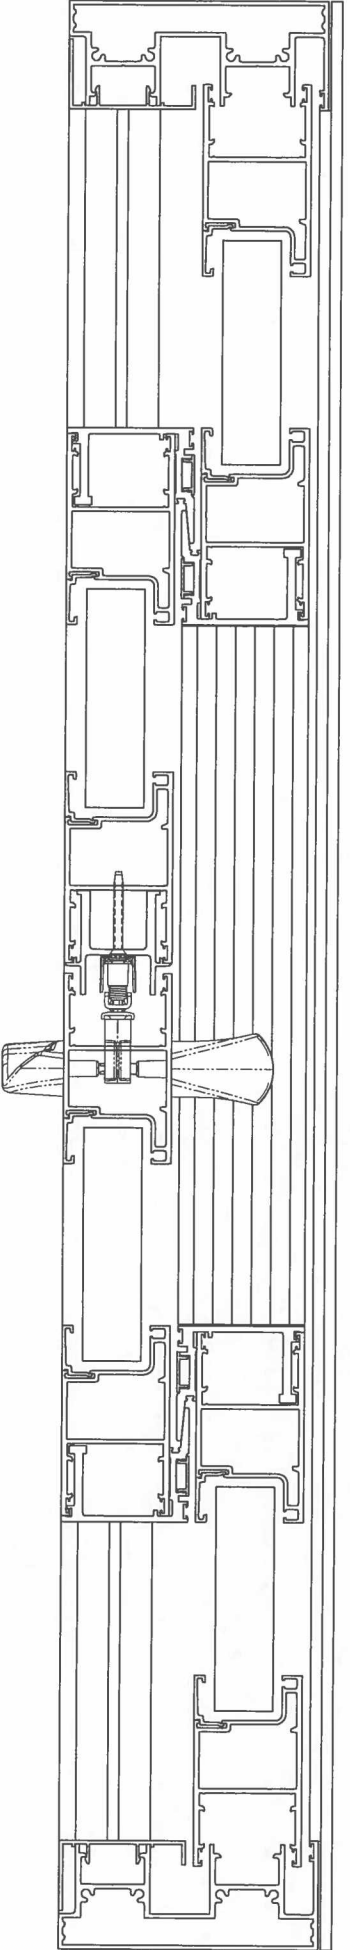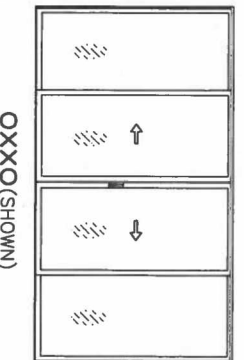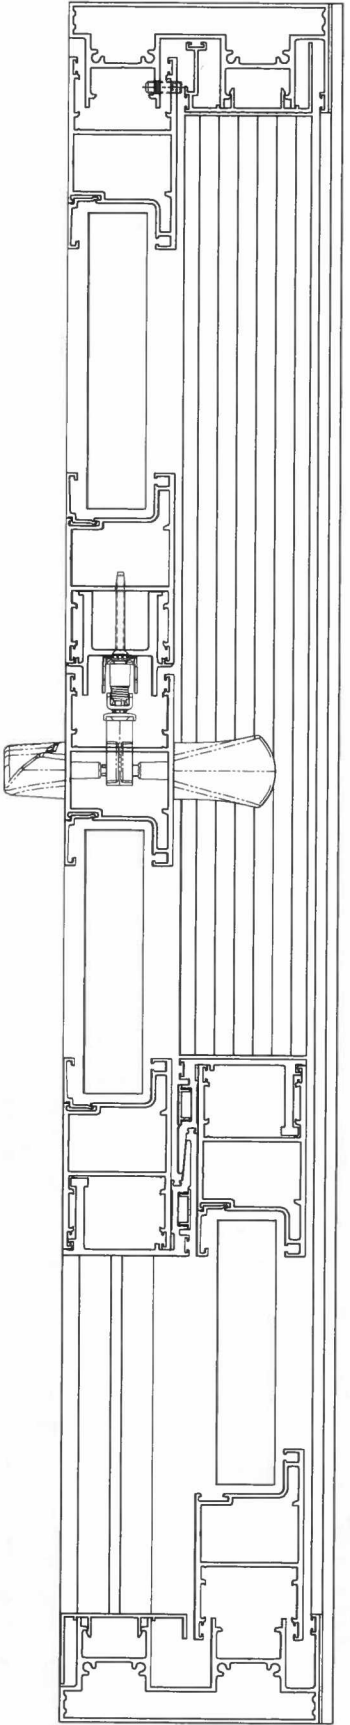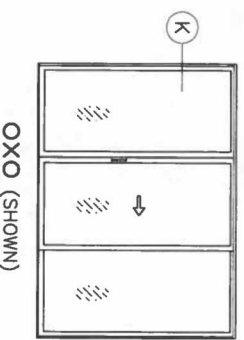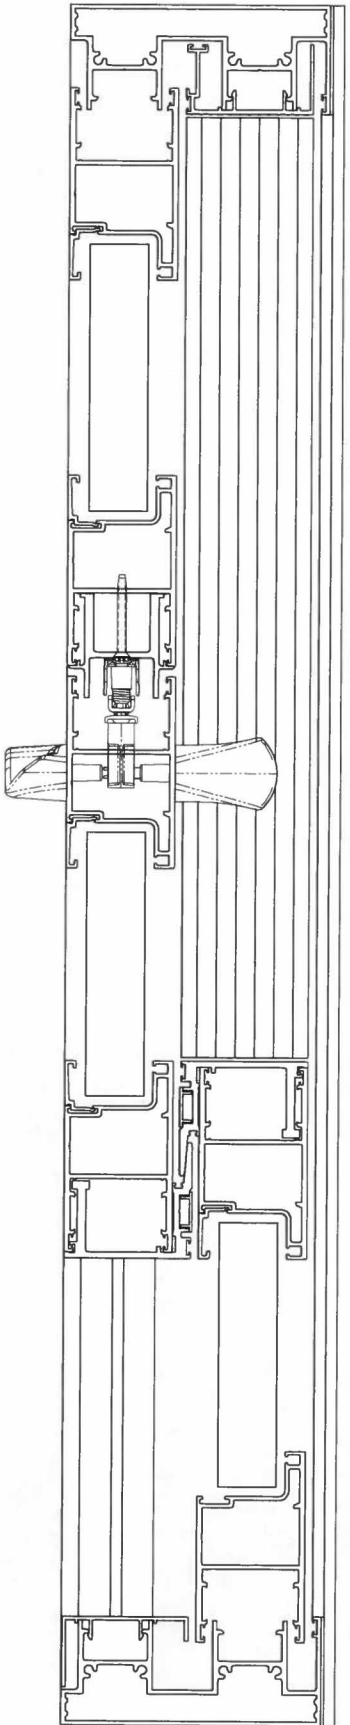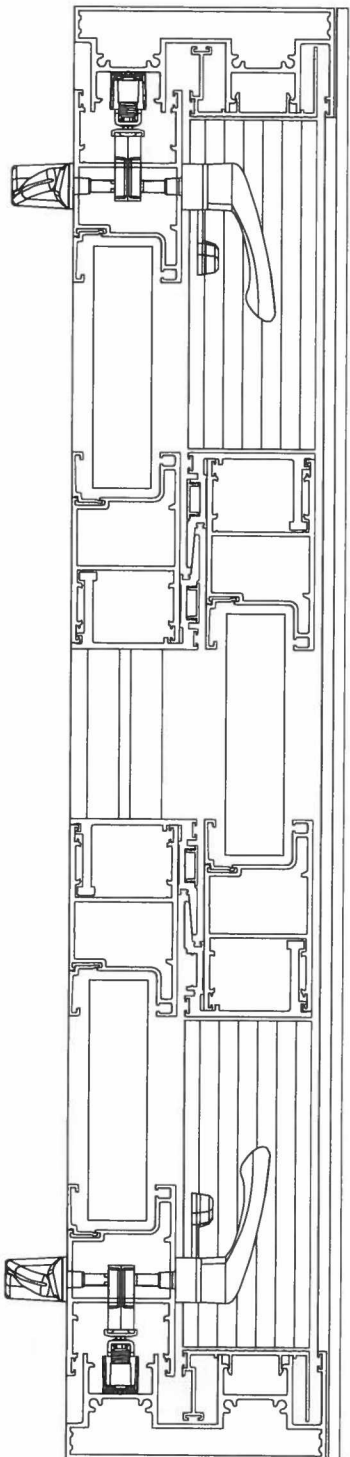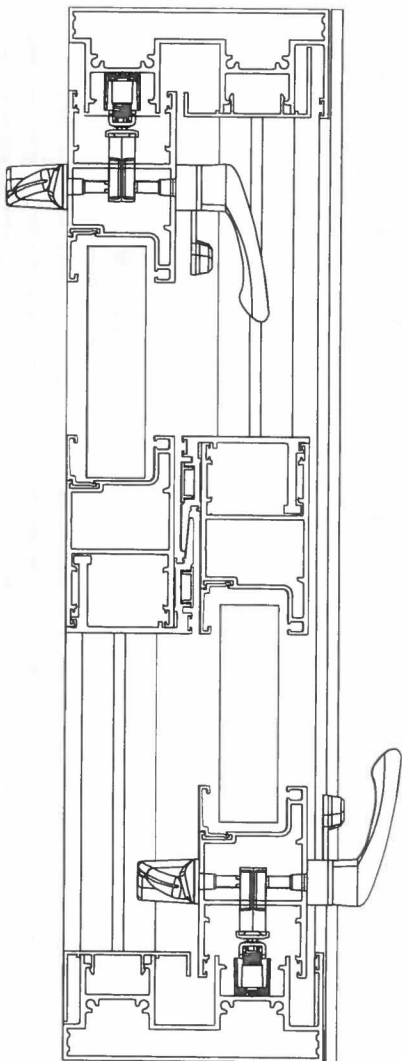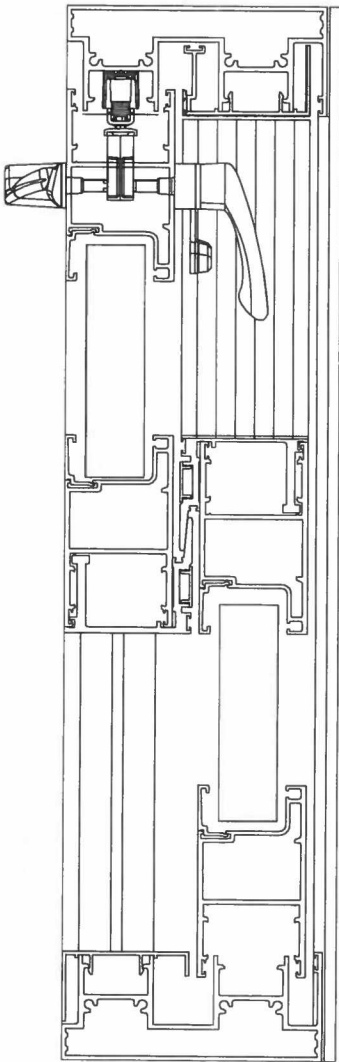

- NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
 2. FOR APPLICABLE DESIGN PRESSURES SEE INSTRUCTIONS IN SHEET 1.
 3. FOR ANCHOR DETAILS SEE SHEETS 6 THRU 9.

APPROVED CONFIGURATIONS

FL #19092

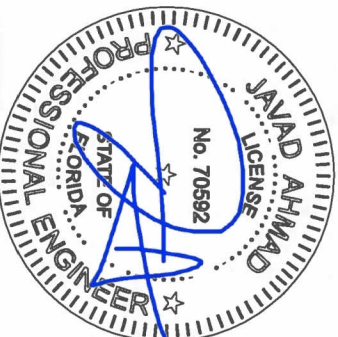

MG-1000 ALUM SLIDING GLASS DOOR (L.M.I.)
MR. GLASS DOORS & WINDOWS INC.
 8120 N.W. 84 STREET
 MEDLEY, FL. 33166
 TEL. (305) 470-8284 FAX. (305) 470-8285

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

a f c


COMP-ANL\W15-83MG

date: 10-28-15	revisions:
scale: -	no date by description
dr. by: TARIQ	
chk. by:	

drawing no.
W15-83

sheet 5 of 12


Signed 12/16/2015

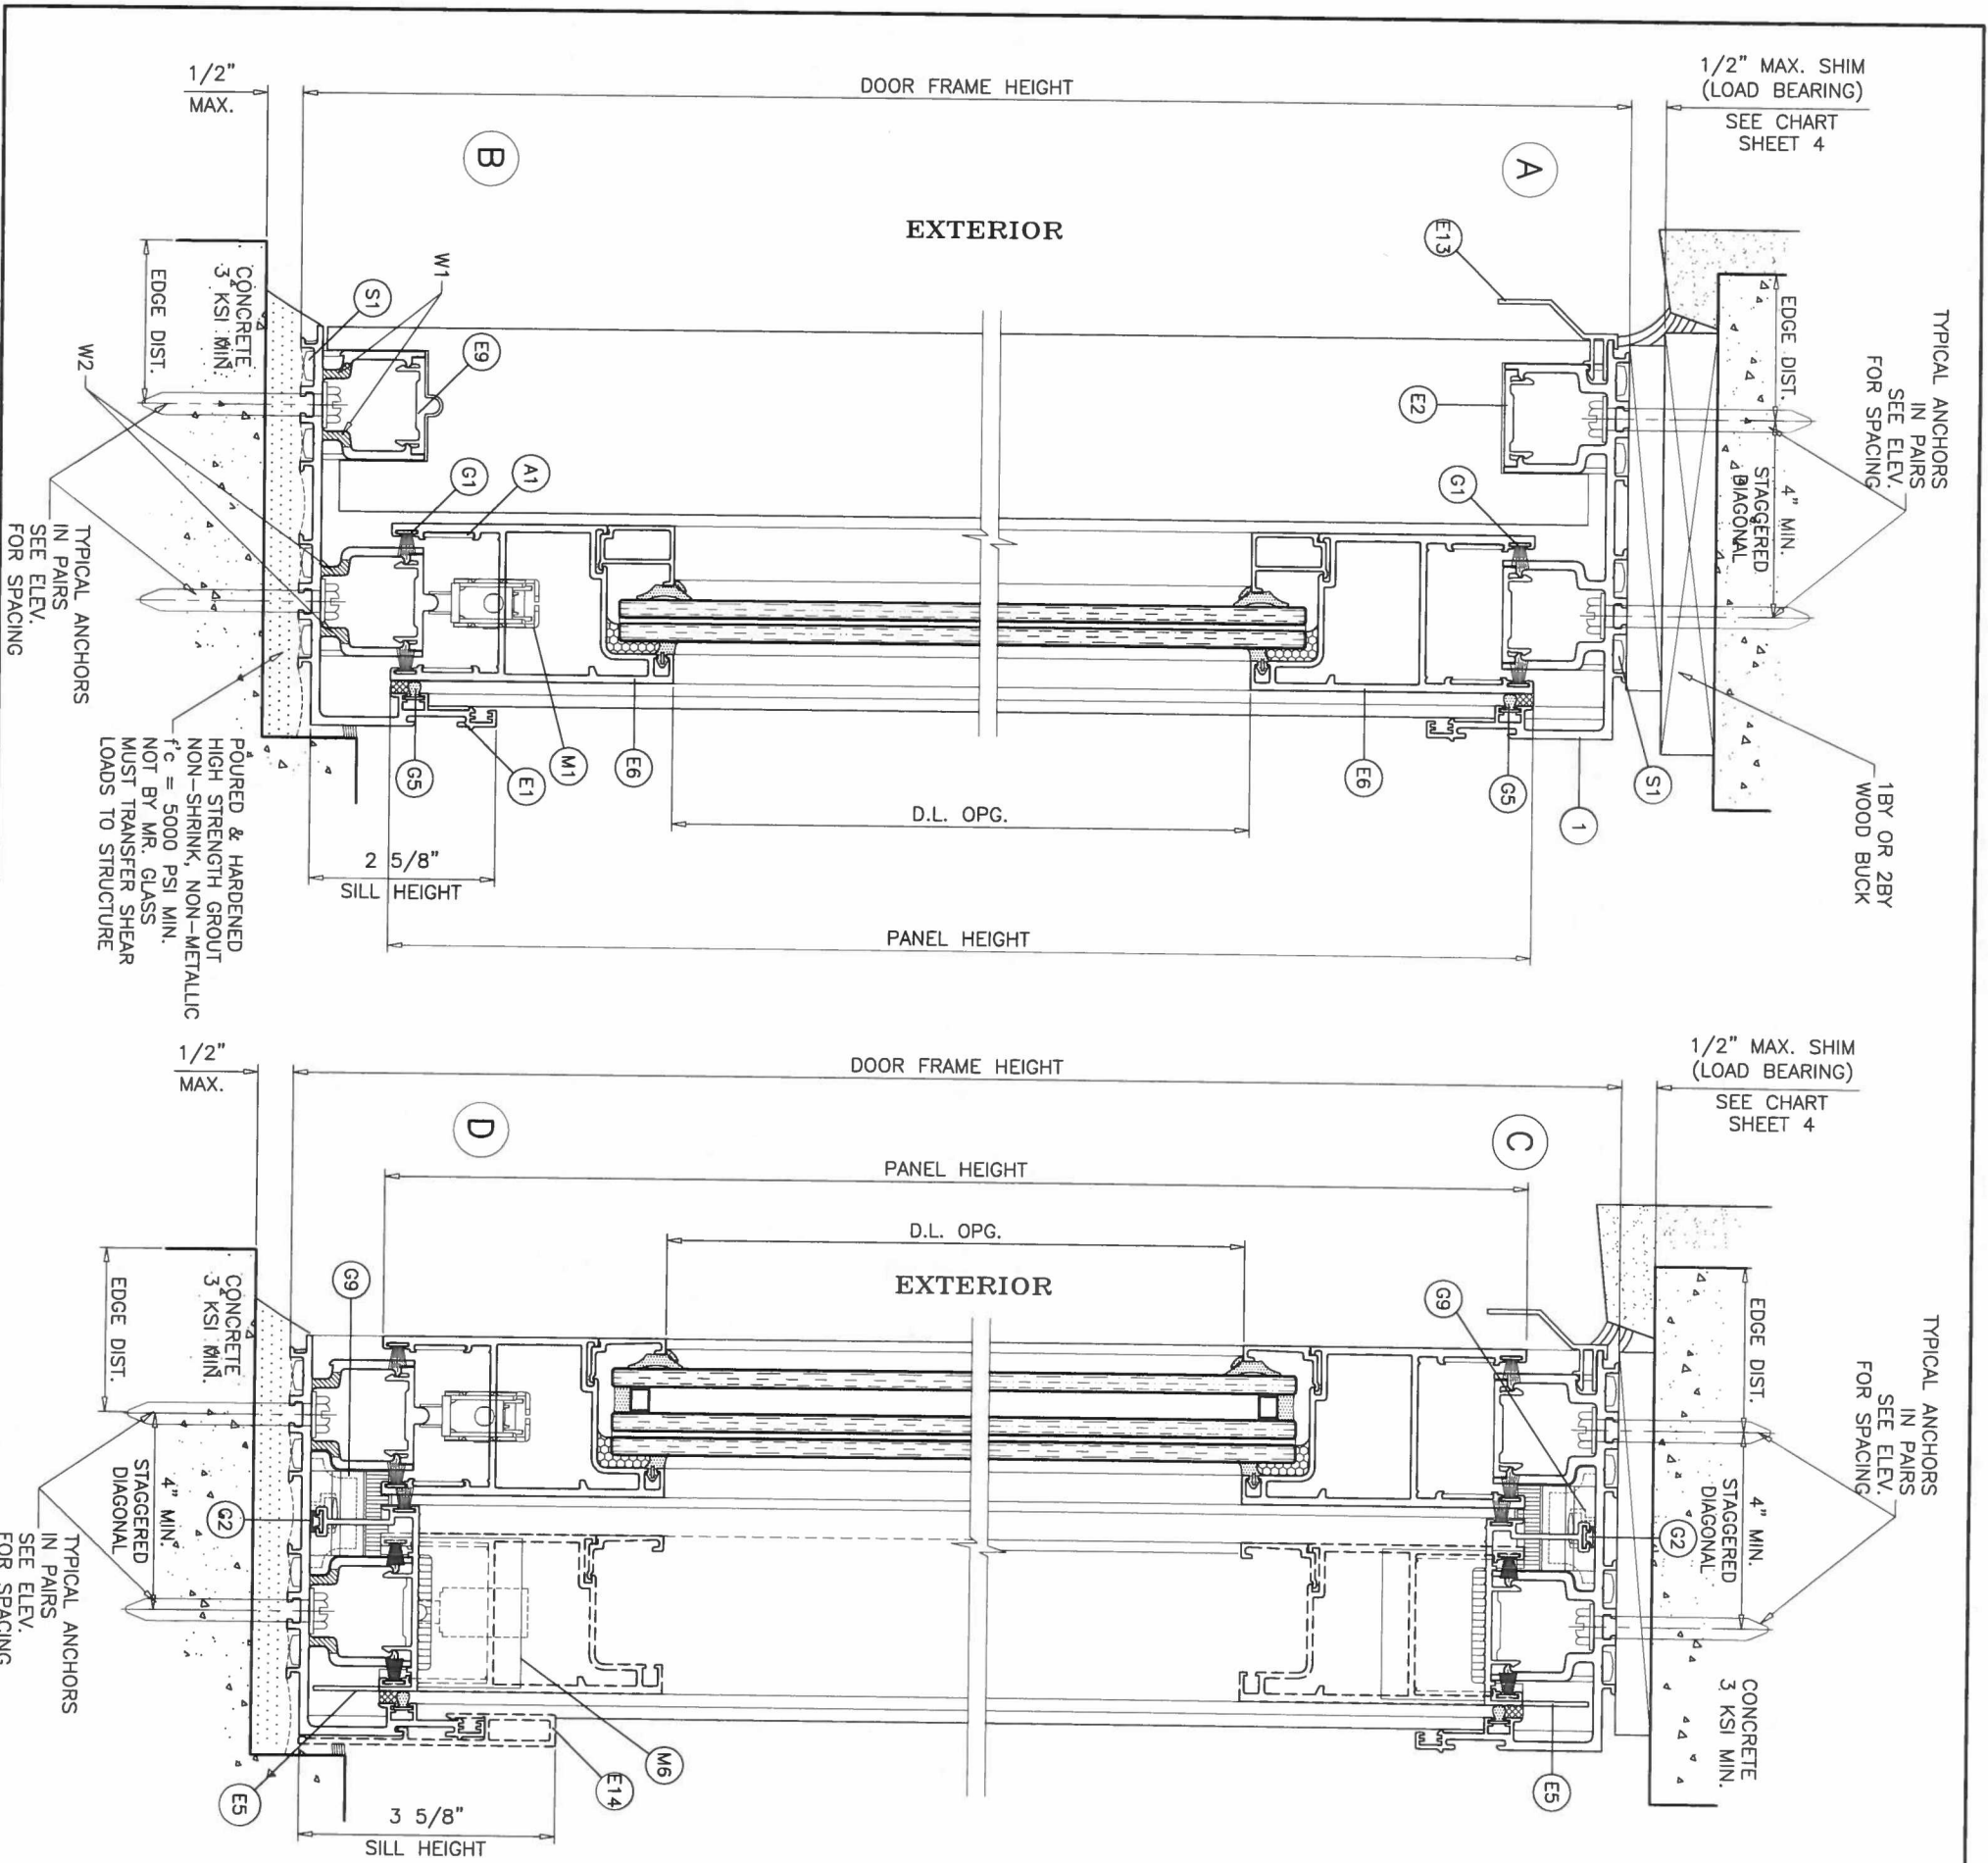

FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED AT TWO PANEL (XX) DOORS ONLY WITHOUT SILL RISER LIMIT MAX. EXT.(+) LOADS TO 70.0 PSF FOR 3-5/8" SILL RISER LIMIT MAX. EXT.(+) LOADS TO 80.0 PSF FOR 4-5/8" SILL RISER MAX. EXT.(+) LOADS = 120.0 PSF




WEEPHOLES:
W1 = 1/4" X 1-1/2" LONG WEEP HOLES AT 5 1/2" FROM EACH END AND 16" O.C.
W2 = 1/4" X 1-1/2" LONG WEEP HOLES
(1) AT FIX. PANEL
(3) AT MOV. PANEL

FL #19092

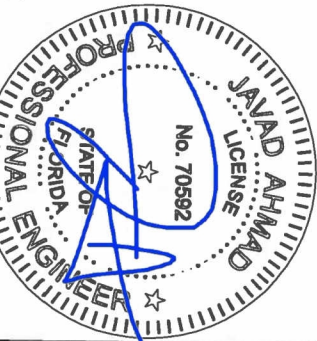

date: 10-28-15 scale: 3/8" = 1" dr. by: TARIQ chk. by:		revisions: <table border="1"> <tr> <th>no</th> <th>date</th> <th>by</th> <th>description</th> </tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td></tr> </table>		no	date	by	description													MG-1000 ALUM SLIDING GLASS DOOR (L.M.I.) MR. GLASS DOORS & WINDOWS INC. 8120 N.W. 84 STREET MEDLEY, FL. 33166 TEL. (305) 470-8284 FAX. (305) 470-8285		AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 TEL. (305) 264-8100 FAX. (305) 262-6978		
no	date	by	description																					

COMP-ANL\W15-83MG

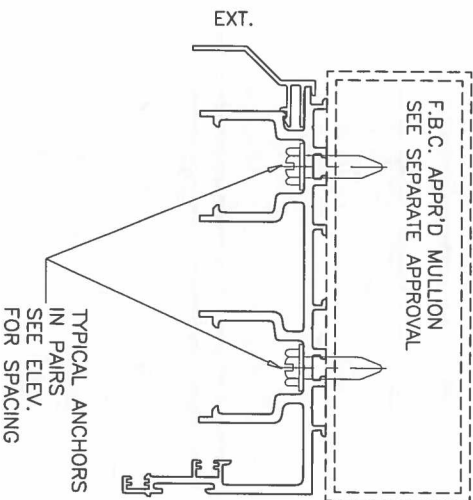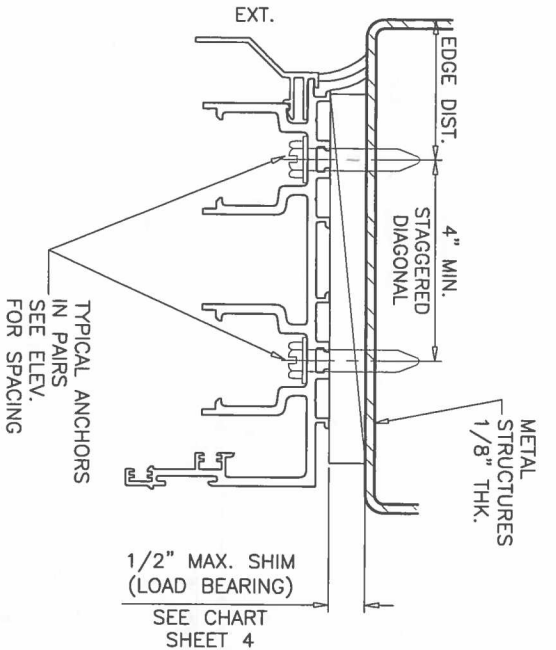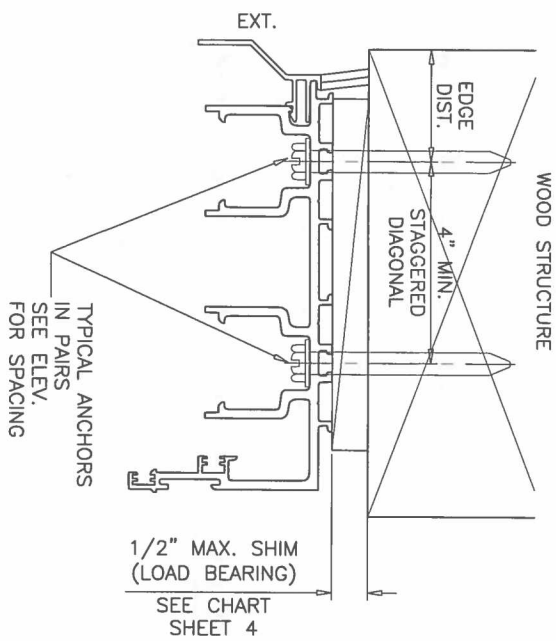

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY MR. GLASS
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A'- 5/16" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

INTO WOOD STRUCTURES
1-7/8" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)
THRU 1BY OR 2BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONCRETE (HEAD)
1-1/4" MIN. EMBED INTO CONC. OR MASONRY (JAMBS)
DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONCRETE (JAMBS)
1-3/4" MIN. EMBED INTO FILLED BLOCKS (JAMBS)

TYPE 'B'- 5/16" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

DIRECTLY INTO CONCRETE
1-3/4" MIN. EMBED (HEAD/SILL)

TYPE 'C'- 5/16" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)


INTO METAL STRUCTURES
STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)
INTO F.B.C. APPROVED MULLIONS
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.) (NO SHIM SPACE)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 GROUT FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

FL #19092

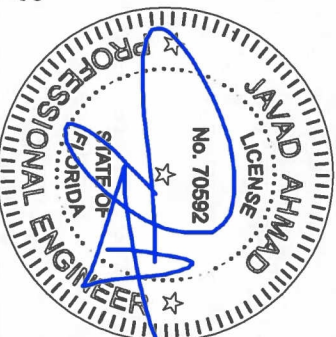





date: 10-28-15	revisions:
scale: 3/8" = 1"	no date by description
dr. by: TARIQ	
chk. by:	

MG-1000 ALUM SLIDING GLASS DOOR (L.M.I.)
MR. GLASS DOORS & WINDOWS INC.
8120 N.W. 84 STREET
MEDLEY, FL. 33166
TEL. (305) 470-8284 FAX. (305) 470-8285


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

a f c

COMP-ANL\W15-83MG

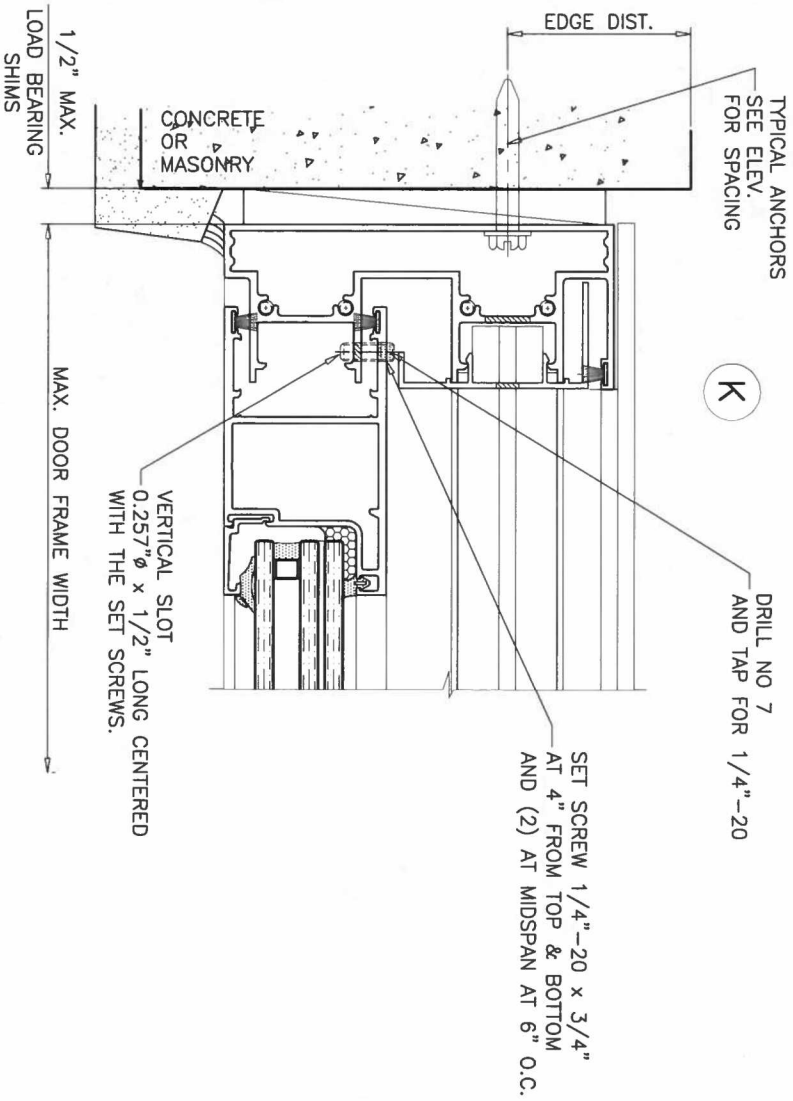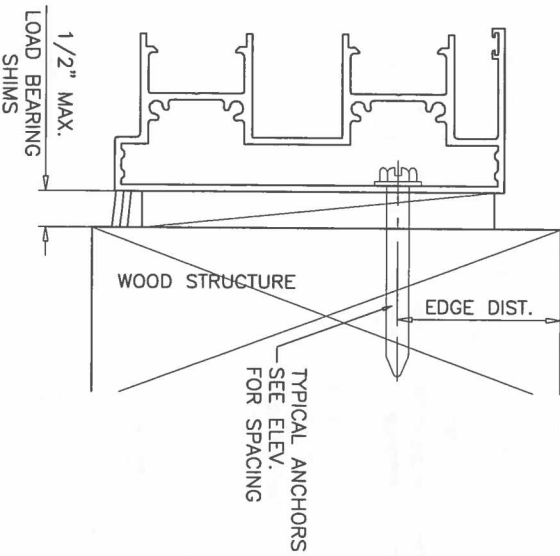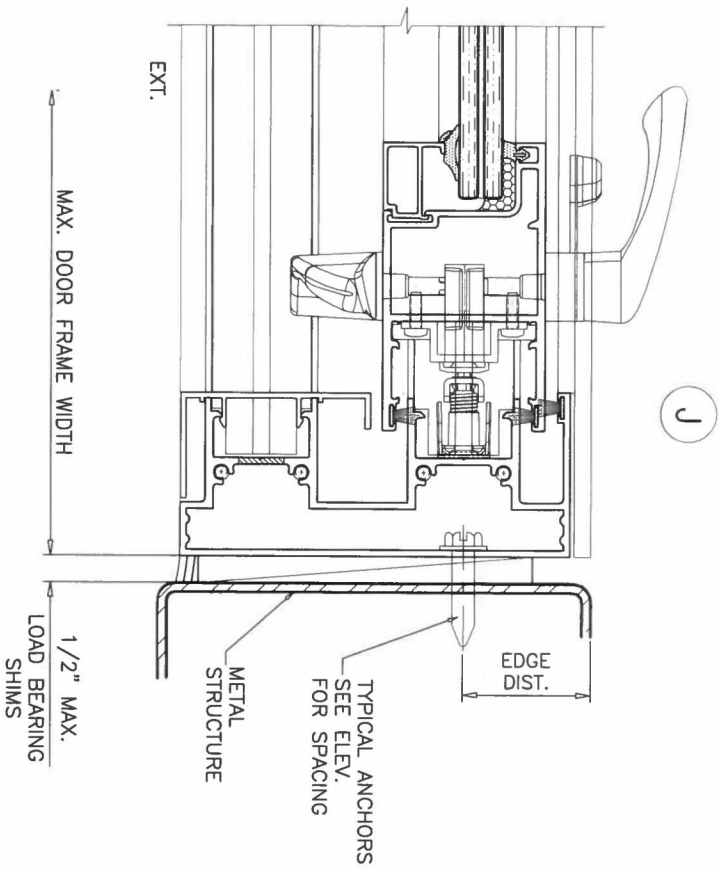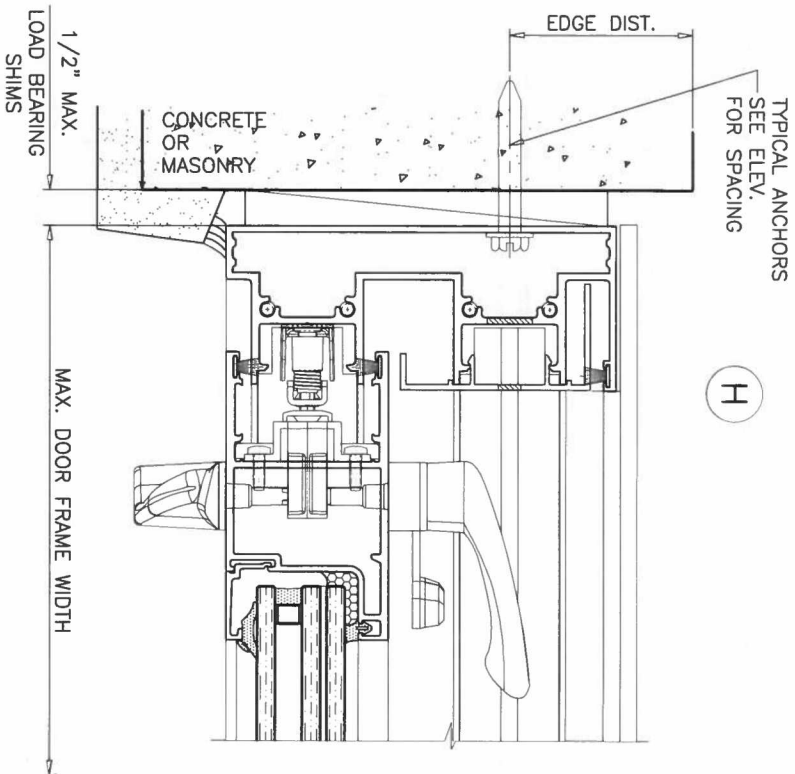

FL #19092

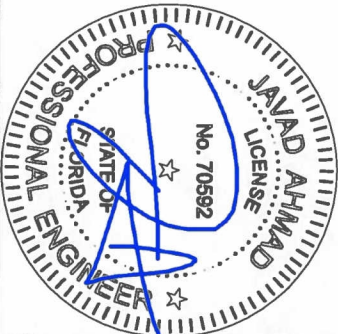






date: 10-28-15	revisions:
scale: 3/8" = 1"	no date by description
dr. by: TARIQ	
chk. by:	

MG-1000 ALUM SLIDING GLASS DOOR (L.M.I.)
MR. GLASS DOORS & WINDOWS INC.
 8120 N.W. 84 STREET
 MEDLEY, FL. 33166
 TEL. (305) 470-8284 FAX. (305) 470-8285

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978




COMP-ANL\W15-83MG

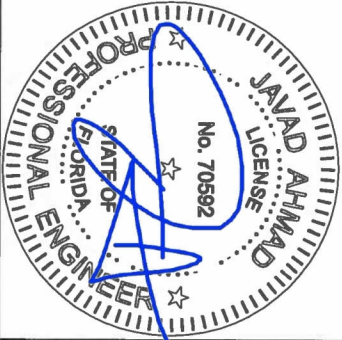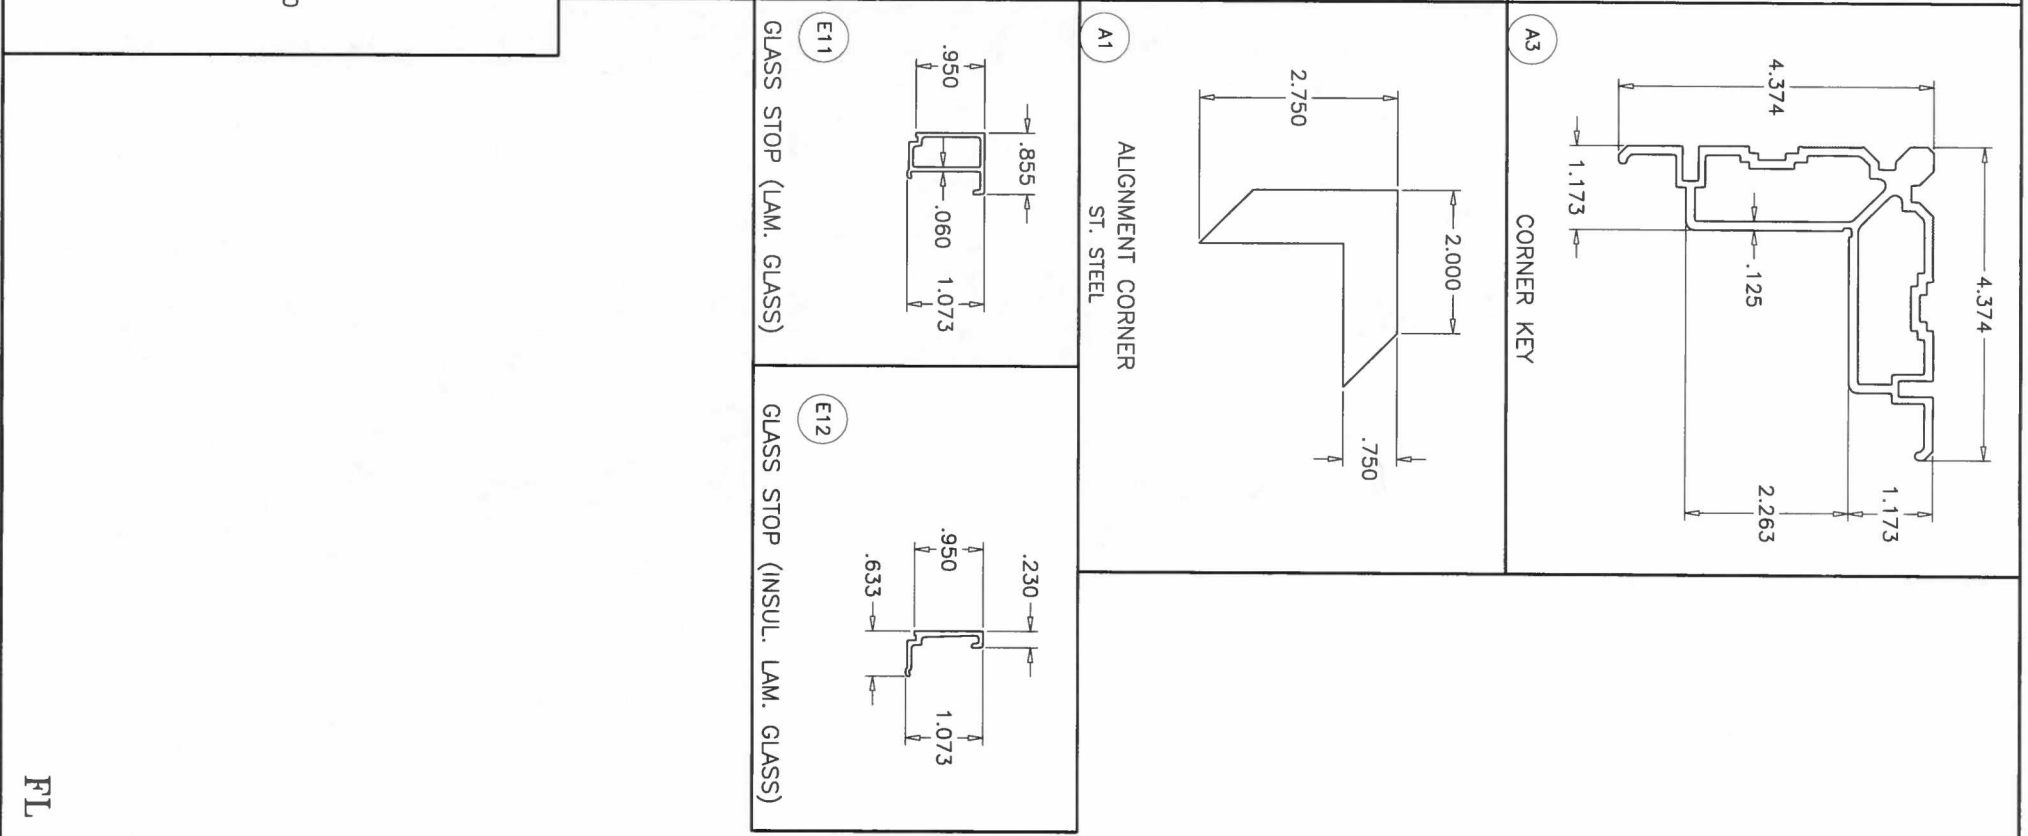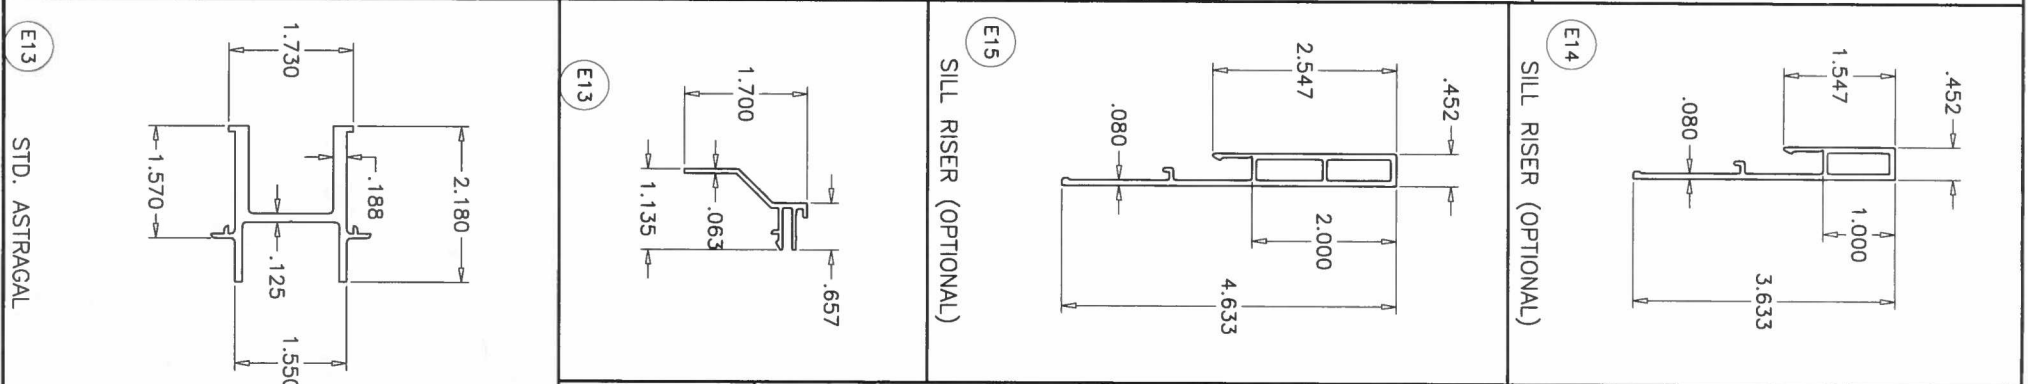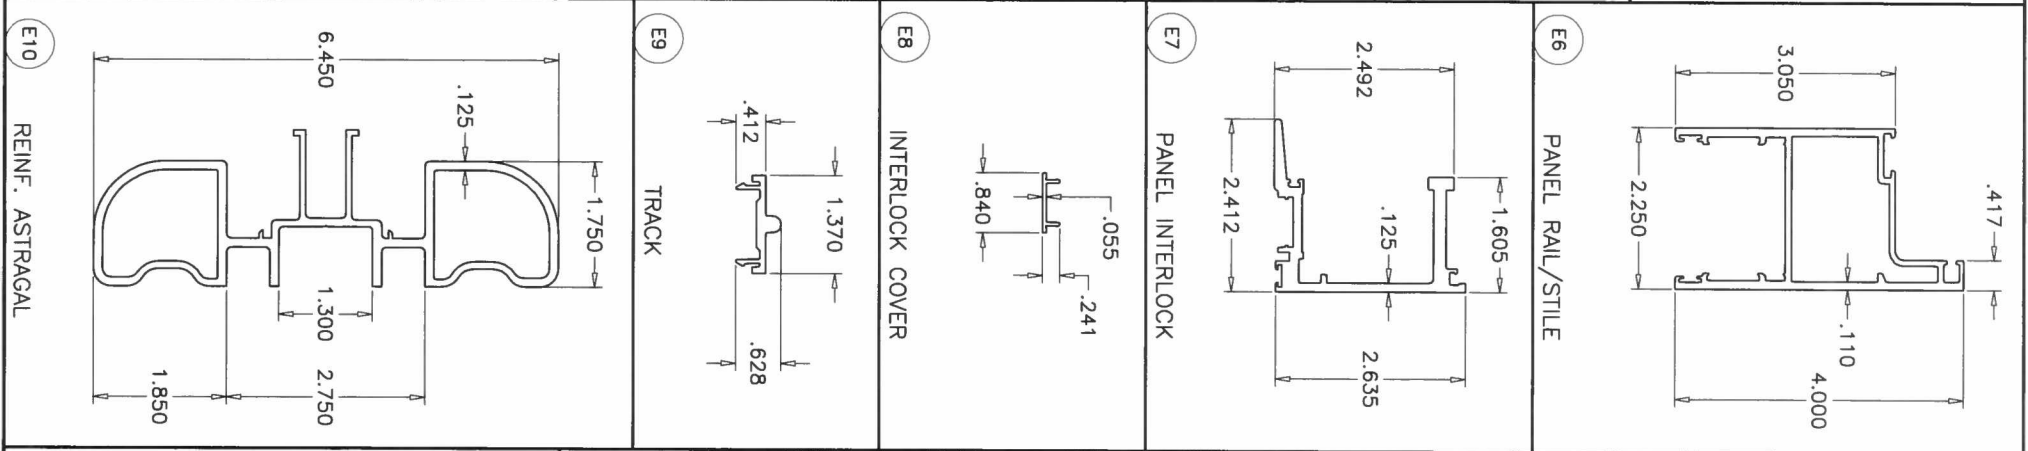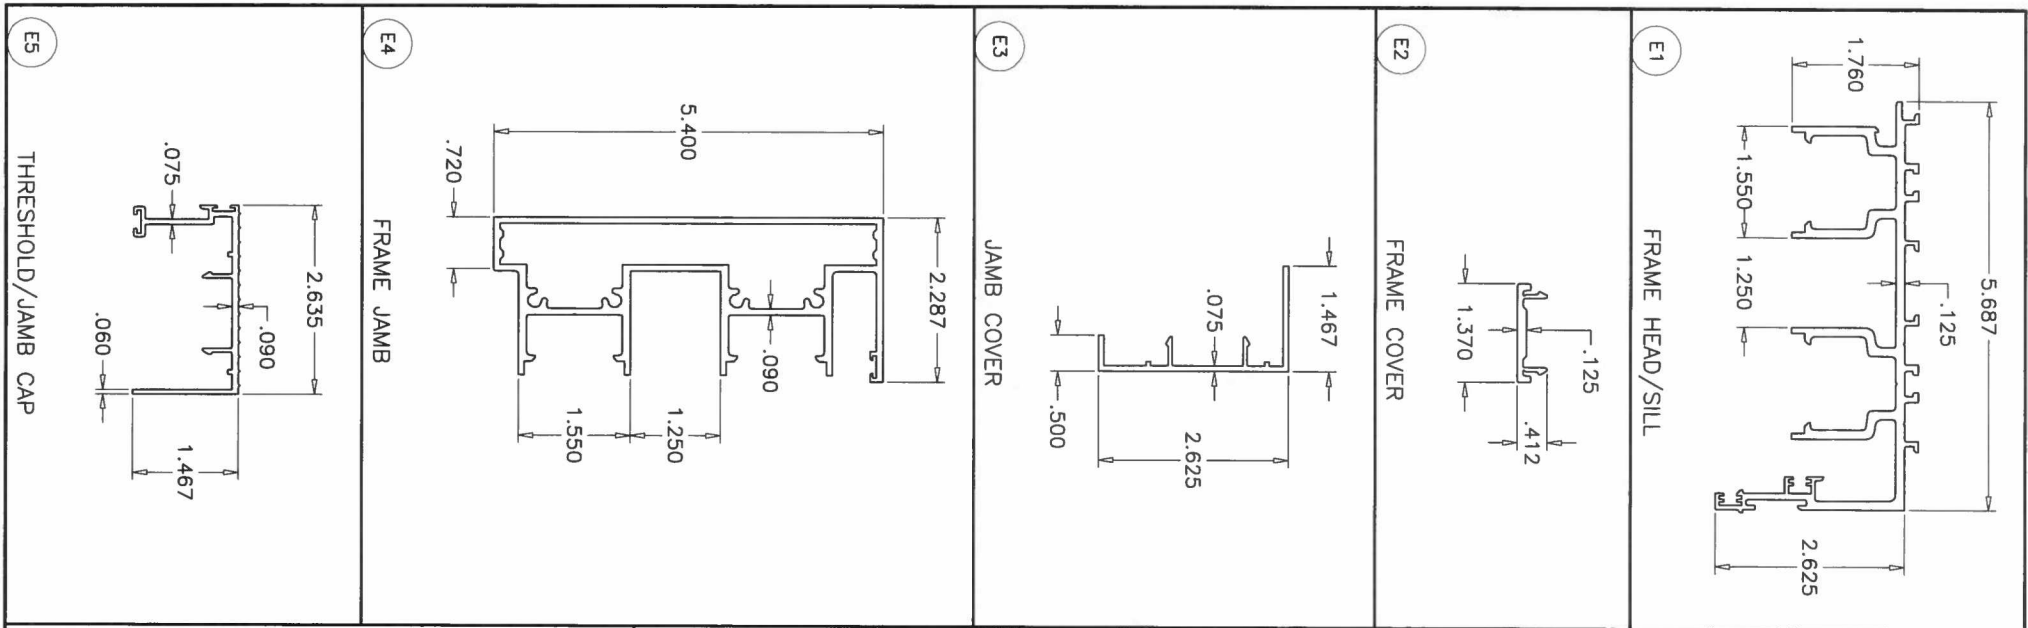

SEALANT:
ALL JOINTS AND FRAME CONNECTIONS SEALED WITH
WHITE/ALUMINUM COLORED SILICONE.

LOCKS:
SURFACE MOUNT METALLIC THREE PLY DUAL HOOK LOCK
AT 38-1/2" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) 10-24 X 1/2" FH TC MS
SURFACE MOUNT METALLIC HANDLE AT 38-1/2" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) 8-32 X 2-5/8" FH MS
SURFACE MOUNT METALLIC KEEPER FACING LOCK AT 38 1/2" FROM BOTTOM
FASTENED WITH
(1) #14 X 2-7/8" FH SDS AND
(1) 12-24 X 1/2" PH MS

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	1000-E-1001	2	FRAME HEAD/SILL	6005-T5	-
E2	-	AS REQD.	FRAME COVER	6063-T5	-
E3	-	AS REQD.	JAMB COVER	6063-T5	-
E4	1000-E-1002	2	FRAME JAMB	6063-T6	-
E5	1000-E-1005	AS REQD.	THRESHOLD/JAMB CAP	6063-T5	-
E6	1000-E-1010	AS REQD.	PANEL RAIL/STILE	6005-T5	-
E7	1000-E-1011	AS REQD.	PANEL INTERLOCK	6005-T5	-
E8	1000-E-1018	AS REQD.	INTERLOCK COVER	6063-T5	-
E9	1000-E-1007	1/ MOV. PANEL	TRACK	6005-T5	-
E10	1000-E-1013	AS REQD.	REINF. ASTRAGAL	6005-T5	-
E11	1000-E-9001	4/ PANEL	GLASS STOP (LAM. GLASS)	6063-T6	-
E12	1000-E-9002	4/ PANEL	GLASS STOP (INSUL. LAM. GLASS)	6063-T6	-
E13	1000-E-1012	AS REQD.	STD. ASTRAGAL	6005-T5	-
E14	MGR-1014	AS REQD.	3-5/8" SILL RISER	6063-T6	OPTIONAL
E15	MGR-1019	AS REQD.	4-5/8" SILL RISER	6063-T6	OPTIONAL
G1	W71325NK	AS REQD.	TRI FIN PILE W/STRIPPING	-	ULTRAFAB
G2	-	AS REQD.	COMPRESSION GASKET	EPDM	DUROMETER 70±5 SHORE A
G3	-	AS REQD.	OFFSET GLAZING GASKET	SANTOPRENE	DUROMETER 70±5 SHORE A
G4	-	AS REQD.	WEDGE GASKET	EPDM	DUROMETER 70±5 SHORE A
G5	E516	AS REQD.	AIR SEAL GASKET	SANTOPRENE	ULTRAFAB
G6	E238	AS REQD.	INTERLOCK GASKET	POLYPROPYLENE	ULTRAFAB
G8	-	-	1/4" THK. FOAM PAD	POLYETHYLENE	-
G9	-	-	AIR SEAL BRIDGE AT INTERLOCK	POLYAMIDE	-
G10	-	-	AIR SEAL BRIDGE AT MTG. STILE	POLYAMIDE	-
G11	-	AS REQD.	SETTING BLOCKS	EPDM	DUROMETER 80±5 SHORE A
A1	-	-	ALIGNMENT CORNER	ST. STEEL	-
A3	-	-	CORNER KEY	6063-T6	-
L1	PS01-7002	-	2 POINT MORTISE LOCK & HANDLE	-	INTERLOCK
L2	PS01-7102	-	2 POINT MORTISE LOCK & HANDLE	-	INTERLOCK
L3	PS01-1005	-	ADJUSTABLE STRIKER	-	INTERLOCK
L5	-	-	LOCK RECIEVER	6063-T5	-
M1	-	2 PANEL	ROLLER ASSEMBLY AT 9" FROM ENDS	ST. STEEL/ACETAL	FASTENED WITH (2) 12-24 X 3/4" PH MS
M6	-	AS REQD.	PANEL GUIDES	NYLON	-
M7	-	AS REQD.	PANEL GUIDES	NYLON	-
S1	#12 X 1 1/2"	4/ CORNER	FRAME ASSEMBLY FASTENERS	ST. STEEL	HWH SDS
S2	10-24 X 1/2"	AS REQD.	INTERLOCK FASTENERS, AT 6" FROM ENDS AND 12" O.C.	ST. STEEL	PH TC MS
S3	#8-18 X 1/2"	AS REQD.	LOCK RECIEVER FASTENERS	AISI 304	PHILIP PH SMS
S4	1/4-20 X 1/2"	AS REQD.	PANEL ASSEMBLY FASTENERS	ST. STEEL	FH SMS

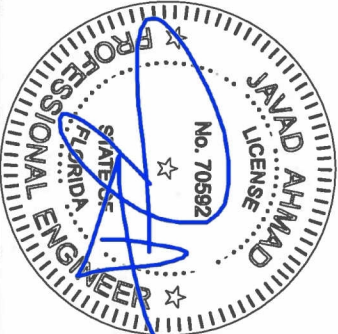

FL #19092



date: 10-28-15	revisions:
scale: 3/8" = 1"	no date by description
dr. by: TARIQ	
chk. by:	

MG-1000 ALUM SLIDING GLASS DOOR (L.M.I.)
MR. GLASS DOORS & WINDOWS INC.
8120 N.W. 84 STREET
MEDLEY, FL. 33166
TEL. (305) 470-8284 FAX. (305) 470-8285

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978




COMP-ANL\W15-83MG

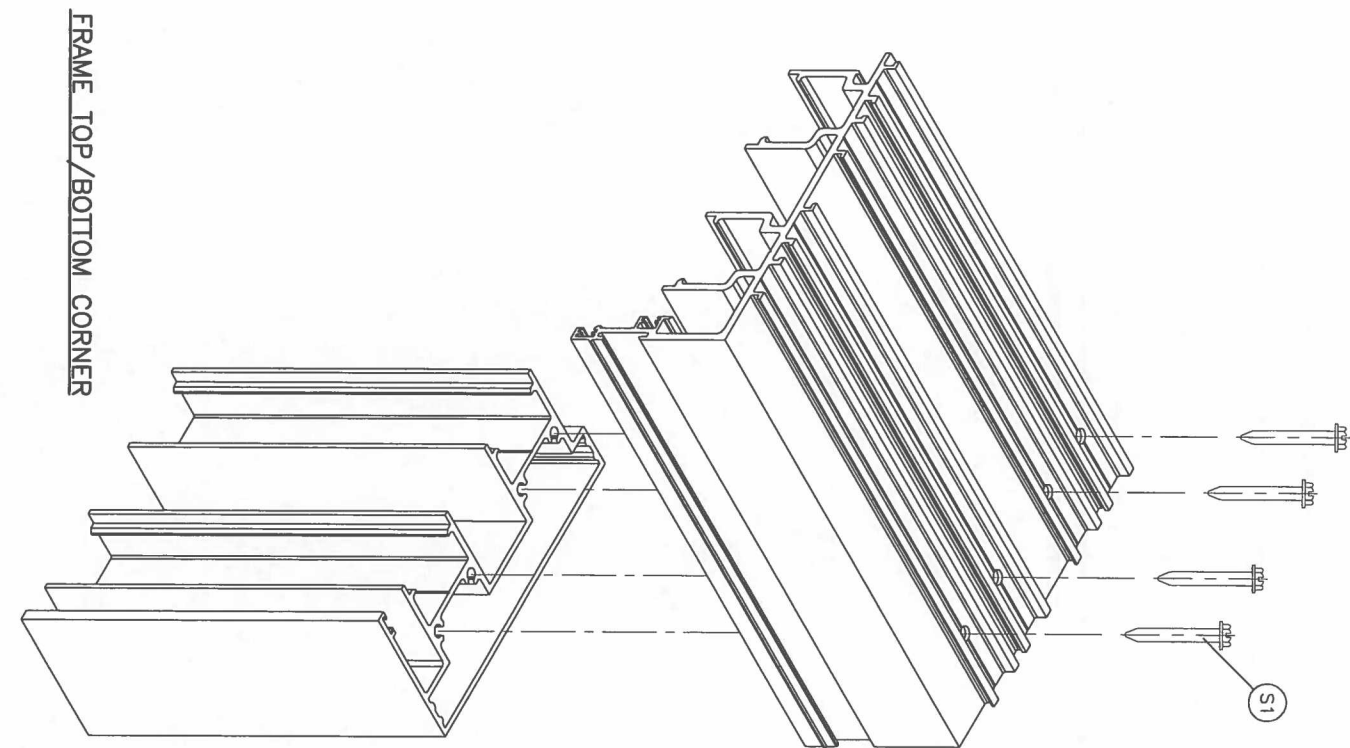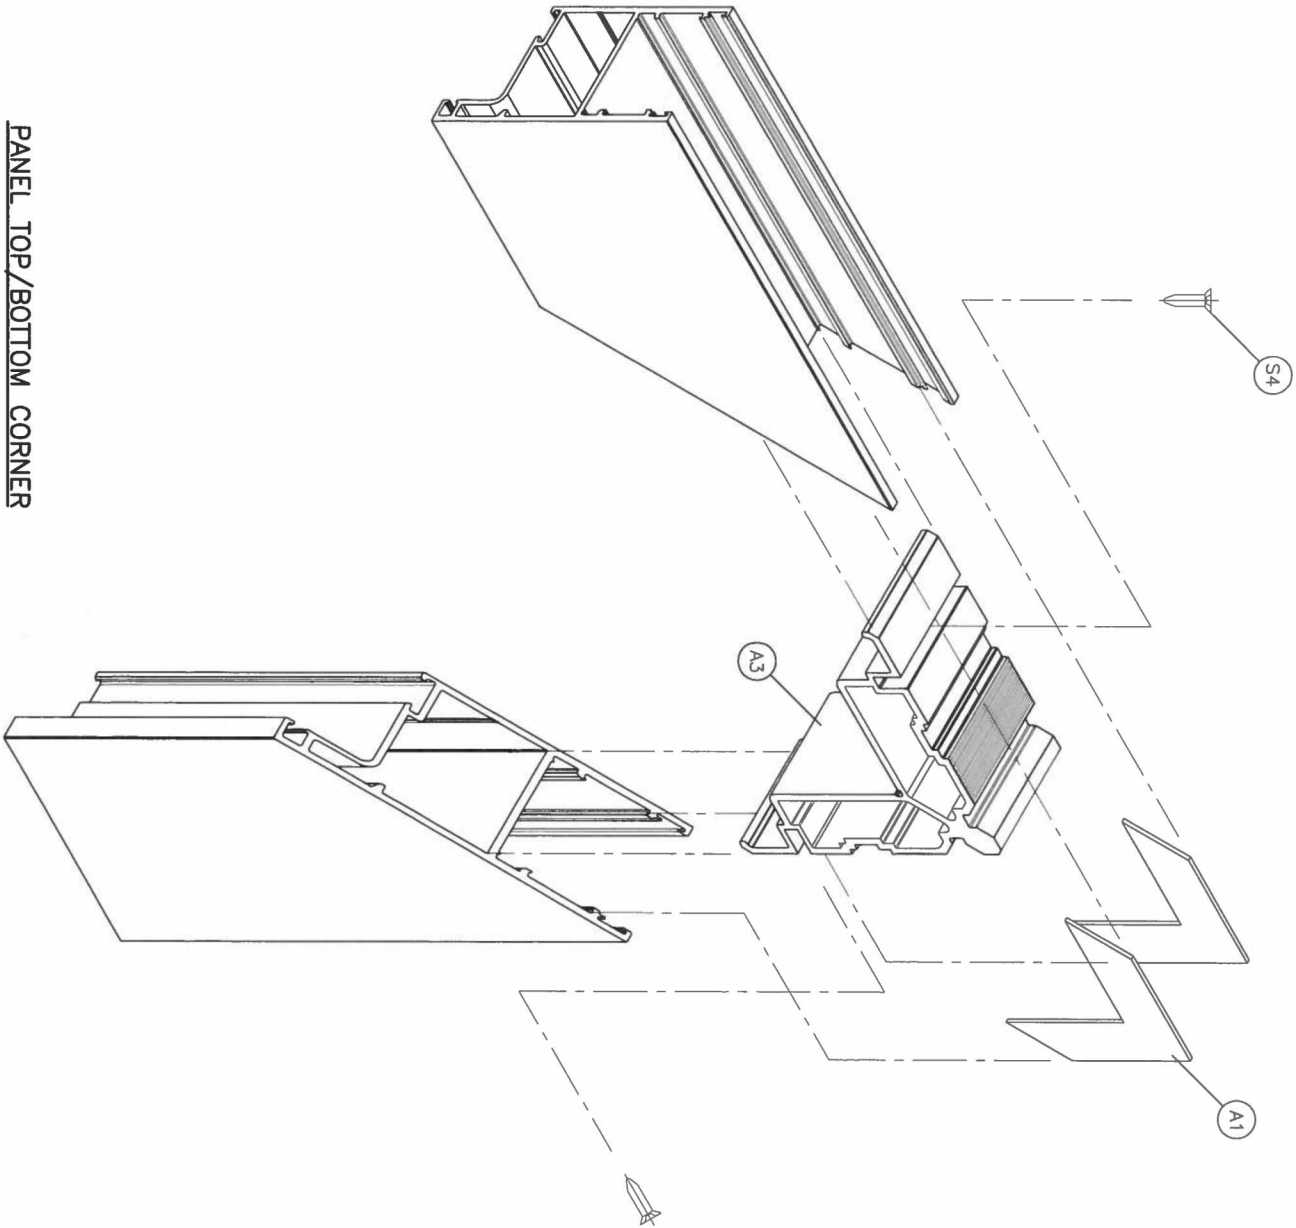

PANEL TOP/BOTTOM CORNER

FRAME TOP/BOTTOM CORNER

FL #19092

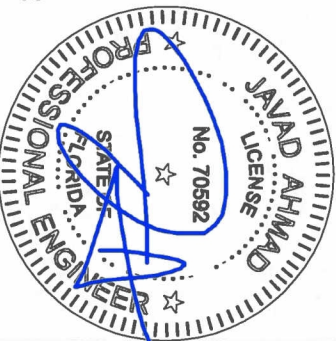

date: 10-28-15	revisions:
scale: 3/8" = 1"	no date by description
dr. by: TARIQ	
chk. by:	

MG-1000 ALUM SLIDING GLASS DOOR (L.M.I.)
MR. GLASS DOORS & WINDOWS INC.
 8120 N.W. 84 STREET
 MEDLEY, FL. 33166
 TEL. (305) 470-8284 FAX. (305) 470-8285

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978



COMP-ANL\W15-83MG