

INSTALLATION NOTES:

1. INSTALLATION CLIPS: ONE (1) INSTALLATION ANCHOR CLIP IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, EACH CLIP IS TO USE TWO (2) INSTALLATION ANCHORS.
2. THROUGH FRAME AND NAIL FIN: ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
3. *INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.*
4. **INSTALLATION CLIP:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE TWO (2) *3/16 INCH HWH ITW TAPCON* PER INSTALLATION CLIP OF SUFFICIENT LENGTH TO ACHIEVE *1 1/4 INCH* MINIMUM EMBEDMENT AND SHALL MAINTAIN MINIMUM 2 EDGE DISTANCE.
5. **INSTALLATION CLIP:** FOR INSTALLATION INTO 2X BUCK USE TWO (2) #8 PAN HEAD WOOD SCREWS PER INSTALLATION CLIP OF SUFFICIENT LENGTH TO ACHIEVE *1 1/2 INCH* MINIMUM EMBEDMENT INTO WOOD SUBSTRATE AND SHALL MAINTAIN MINIMUM 3/4" EDGE DISTANCE.
6. **INSTALLATION CLIP:** FOR INSTALLATION THROUGH METAL STUD USE TWO (2) #8 HWH GRADE 5 SELF-DRILLING OR SELF-TAPPING SCREWS PER INSTALLATION CLIP OF SUFFICIENT LENGTH TO ACHIEVE *3 THREADS* MINIMUM PENETRATION BEYOND METAL FRAME SUBSTRATE AND SHALL MAINTAIN MINIMUM 3/4" EDGE DISTANCE.
7. **THROUGH FRAME:** FOR INSTALLATION INTO 2X BUCK USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE *1 1/2 INCH* MINIMUM EMBEDMENT INTO WOOD SUBSTRATE AND SHALL MAINTAIN MINIMUM 3/4" EDGE DISTANCE.
8. **THROUGH FRAME:** FOR INSTALLATION INTO METAL SUBSTRATES USE #10 HWH GRADE 5 SELF-DRILLING OR SELF-TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE *3 THREADS* MINIMUM PENETRATION BEYOND METAL FRAME SUBSTRATE AND SHALL MAINTAIN MINIMUM 3/4" EDGE DISTANCE.
9. **THROUGH FRAME:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE ONE (1) *3/16 INCH ITW TAPCON* OF SUFFICIENT LENGTH TO ACHIEVE *1 1/4 INCH* MINIMUM EMBEDMENT AND SHALL MAINTAIN MINIMUM 2" EDGE DISTANCE.
- 10.**NAIL FIN:** FOR INSTALLATION INTO 2X BUCK USE #8 PAN HEAD WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE *1 1/2 INCH* MINIMUM EMBEDMENT INTO WOOD SUBSTRATE AND SHALL MAINTAIN MINIMUM 3/4" EDGE DISTANCE.
- 11.**NAIL FIN:** FOR INSTALLATION INTO METAL SUBSTRATES USE #8 HWH GRADE 5 SELF-DRILLING OR SELF-TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE *3 THREADS* MINIMUM PENETRATION BEYOND METAL FRAME SUBSTRATE AND SHALL MAINTAIN MINIMUM 3/4" EDGE DISTANCE.
- 12.MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- 13.INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- 14.FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- 15.INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- 16.INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF *0.55*.

B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF *3000 PSI*.

C. GROUT-FILLED CMU- UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.

D. HOLLOW BLOCK CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI.

E. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 48 MILS (18 GAUGE).

F.ALUMINUM - MINIMUM WALL THICKNESS OF 1/8", 6063-T5 ALLOY OR BETTER.

ANDERSEN CORPORATION, INC

RENEWAL BY ANDERSEN FIXED WINDOWS - FULL FRAME

(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE, EXCLUDING HVHZ. THE PRODUCT HAS BEEN EVALUATED TO THE FOLLOWING:

AAMA/WDMA/CSA 101/I.S.2/A440-11
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: *FIBREX®* AND PVC.
7. GLASS MEETS THE REQUIREMENTS OF ASTM E1300. SEE GLAZING DETAILS ON SHEET 3.
8. *DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:*

X: OPERABLE PANEL

O: FIXED PANEL

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL & INSTALLATION NOTES
2	ELEVATIONS & ANCHOR LAYOUTS
3	THROUGH FRAME & NAIL FIN INSTALLATION DETAILS & GLAZING DETAIL
4	NAIL FIN INSTALLATION DETAILS
5	CLIP INSTALLATION DETAILS
6	QUALIFIED SHAPES

DESIGN PRESSURE RATING			
SIZE	DESIGN PRESSURE (DP/PG)	INSTALLATION OPTIONS	INSTALLATION SUBSTRATES
48x48	+/- 50 PSF	Through Frame & Optional Nail Fin	Wood, Concrete/Masonry, Metal Stud
		Installation Clip	Wood, Concrete/Masonry, Metal Stud
84x84	+/- 35 PSF	Through Frame & Optional Nail Fin	Wood, Concrete/Masonry, Metal Stud
		Installation Clip	Wood, Concrete/Masonry, Metal Stud
		Nail Fin Only	Wood or Metal Stud Only
84x84	+/- 50 PSF	Through Frame & Nail Fin Required	Wood or Metal Stud Only
		Installation Clip	Wood, Concrete/Masonry, Metal Stud
106x62	+/- 35 PSF	Through Frame & Optional Nail Fin	Wood, Concrete/Masonry, Metal Stud
		Installation Clip	Wood, Concrete/Masonry, Metal Stud
		Nail Fin Only	Wood Or Metal Stud Only
106x62	+/- 50 PSF	Through Frame & Nail Fin Required	Wood or Metal Stud Only
		Installation Clip	Wood, Concrete/Masonry, Metal Stud



ANDERSEN
WINDOWS & DOORS

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096

PH: (651) 264-5150 FX: (651) 264-5485

TITLE:

RENEWAL BY ANDERSEN FIXED
WINDOWS - FULL FRAME
(NON-HVHZ)(NON-IMPACT)

GENERAL & INSTALLATION NOTES

PREPARED BY:


BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
REV.FOR PG50 UNITS	MS	2.15.16
FBC UPDATE	SM	12.17.18
7TH FBC CODE CHANGE	SR	3.24.20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F Norero
Reason: I am approving this document
Date: 2020.10.11 18:30:26 +02'00'

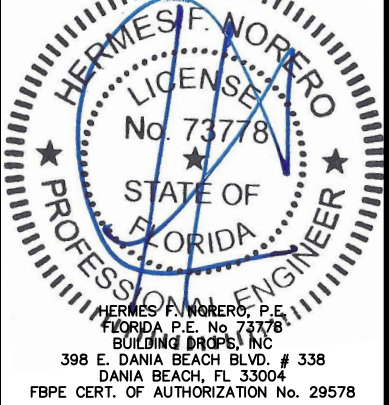

FL #:

FL19562

DATE:

12.17.15

DWG. BY:

SM

CHK. BY:

MSS

SCALE:

NTS

DWG. #:


AWD092

SHEET:


1

OF 6

10/9/2020 6:27 PM
s:\projects\andersen windows\cc-20-0224 - code change\revisions\19562\dwgs\19562.1awd092.dwg

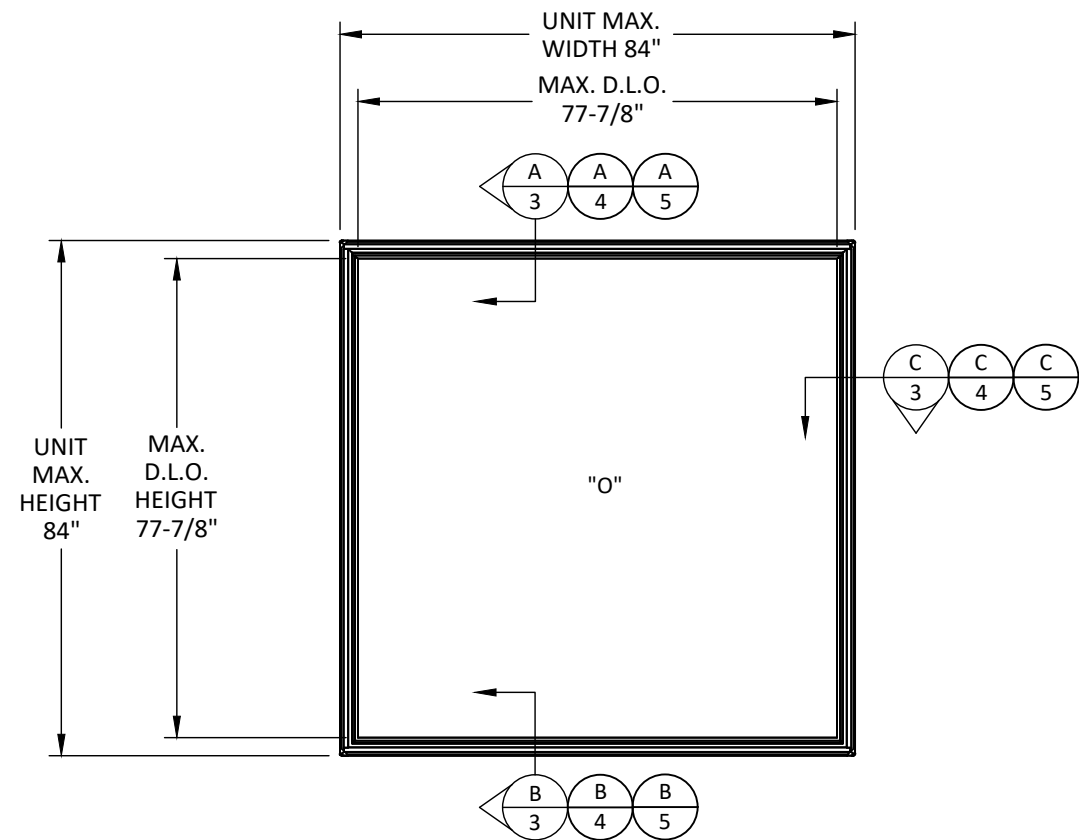

ELEVATION

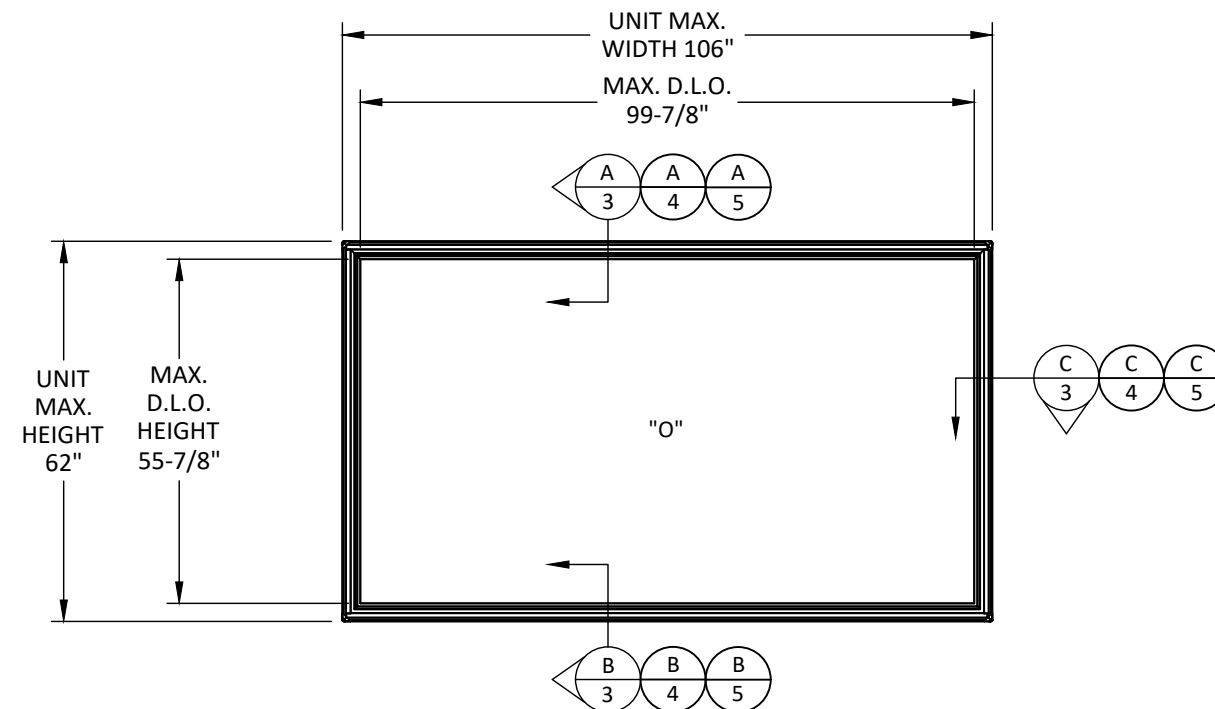


ELEVATION


RENEWAL SERIES PICTURE WINDOW - FULL FRAME				
ANCHOR SPACING				
INSTALLATION METHOD	FROM CORNERS (IN)	MAX. O.C. HEAD (IN)	MAX. O.C. SILL (IN)	MAX. O.C. JAMBS (IN)
NAIL FIN	3.5	3.5	3.5	3.5
INSTALLATION CLIP	10	12	12	12
THROUGH FRAME	10	12.875	12.875	12.875

NOTES:

- ALL TYPICAL SUBSTRATES & INSTALLATION METHODS SHOWN HEREIN MAY BE USED AT THE HEAD, JAMBS, OR SILL. ANCHOR EDGE DISTANCE AND EMBEDMENT SHALL BE AS SPECIFIED IN TYPICAL DETAILS. SEE INSTALLATION NOTES 4-11, SHEET 1, FOR ANCHOR SPECIFICATIONS FOR EACH INSTALLATION METHOD.

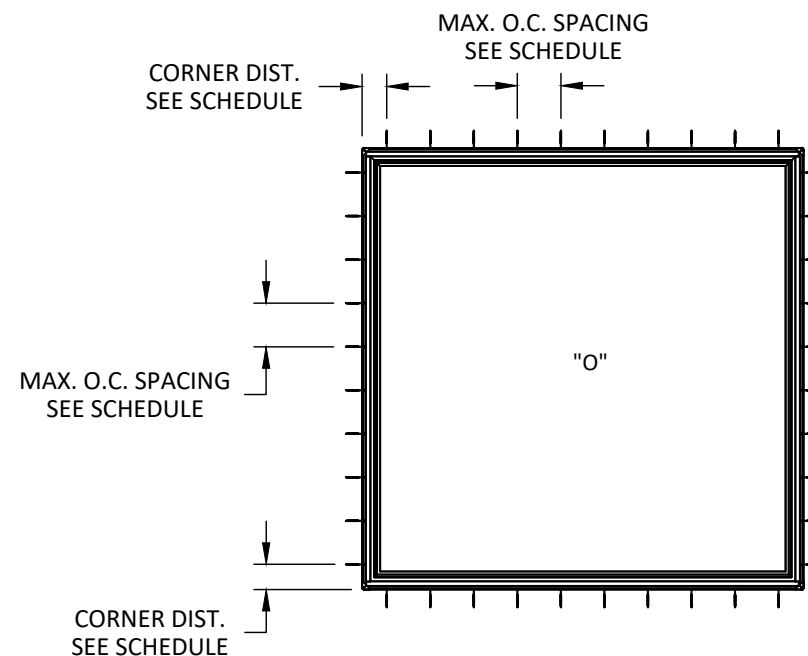

ANCHOR LAYOUT

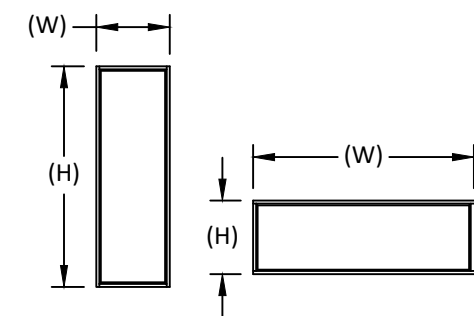

NOTE:
WINDOW WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FOOT AREA. ANCHOR SPACING SHALL NOT EXCEED THOSE SHOWN FOR LONG OR SHORT LEG OF UNIT.




100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE: RENEWAL BY ANDERSEN FIXED
WINDOWS - FULL FRAME
(NON-HVHZ)/(NON-IMPACT)
ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
REV. FOR PG50 UNITS	MS	2.15.16
FBC UPDATE	SM	12.17.18
7TH FBC CODE CHANGE	SR	3.24.20


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

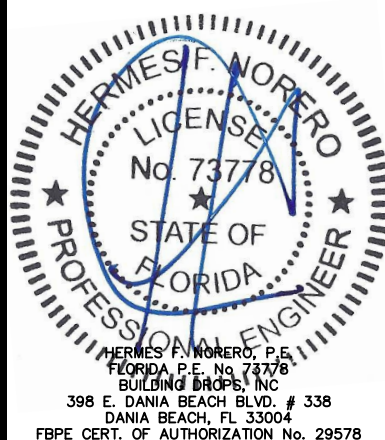

FL #:	FL19562
DATE:	12.17.15
DWG. BY:	CHK. BY:
SM	MSS
SCALE:	NTS
DWG. #:	AWD092
SHEET:	

2


s:\projects\andersen windows\cc-20-0224 - code change - fbc 2020 (version 7) code change\revisions\119562.dwg\19562.1awd092.dwg
10/9/2020 6:27 PM

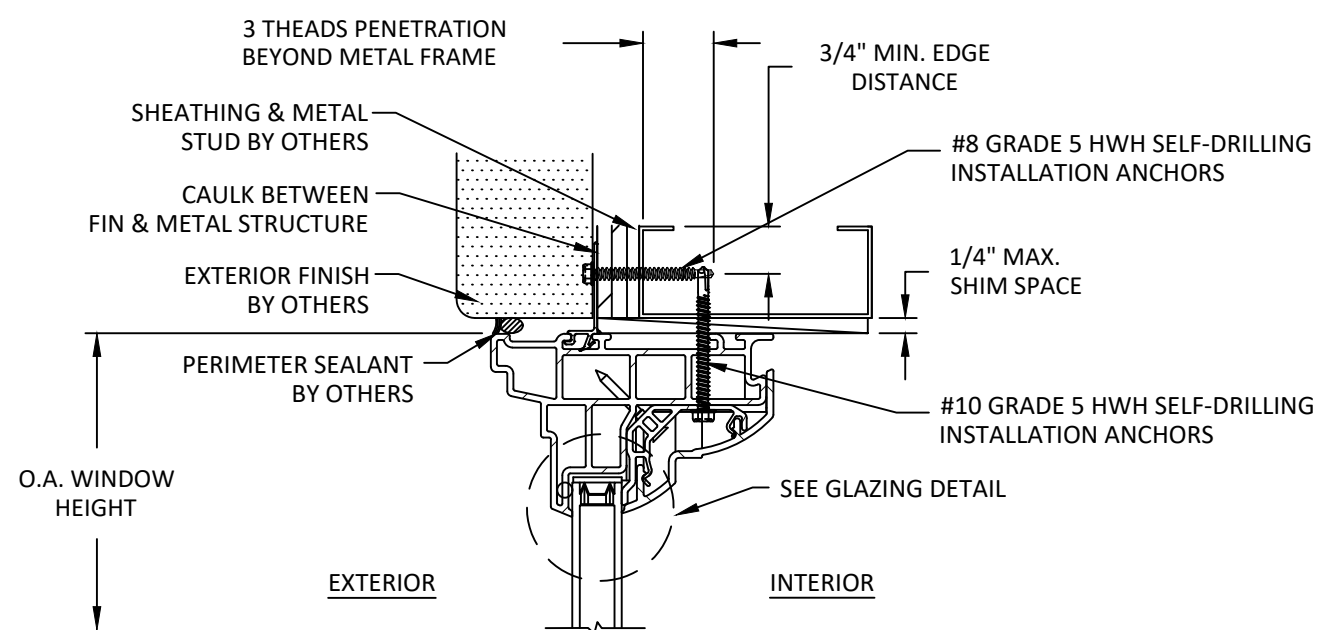


A
3 **VERTICAL SECTION**
HEAD - METAL FRAME SUBSTRATE
NAIL FIN

NAIL FIN/FLANGE IS REVERSIBLE, SEE ORIENTATION DIFFERENCE IN DETAIL A AND B


NOTE: NAIL FIN IS OPTIONAL FOR ALL UNITS AT DP (PG) 35 OR LESS AND 48" X 48" UNITS AT DP (PG) 50. ALL OTHER UNITS REQUIRE BOTH THROUGH FRAME AND NAIL FIN ANCHORAGE.

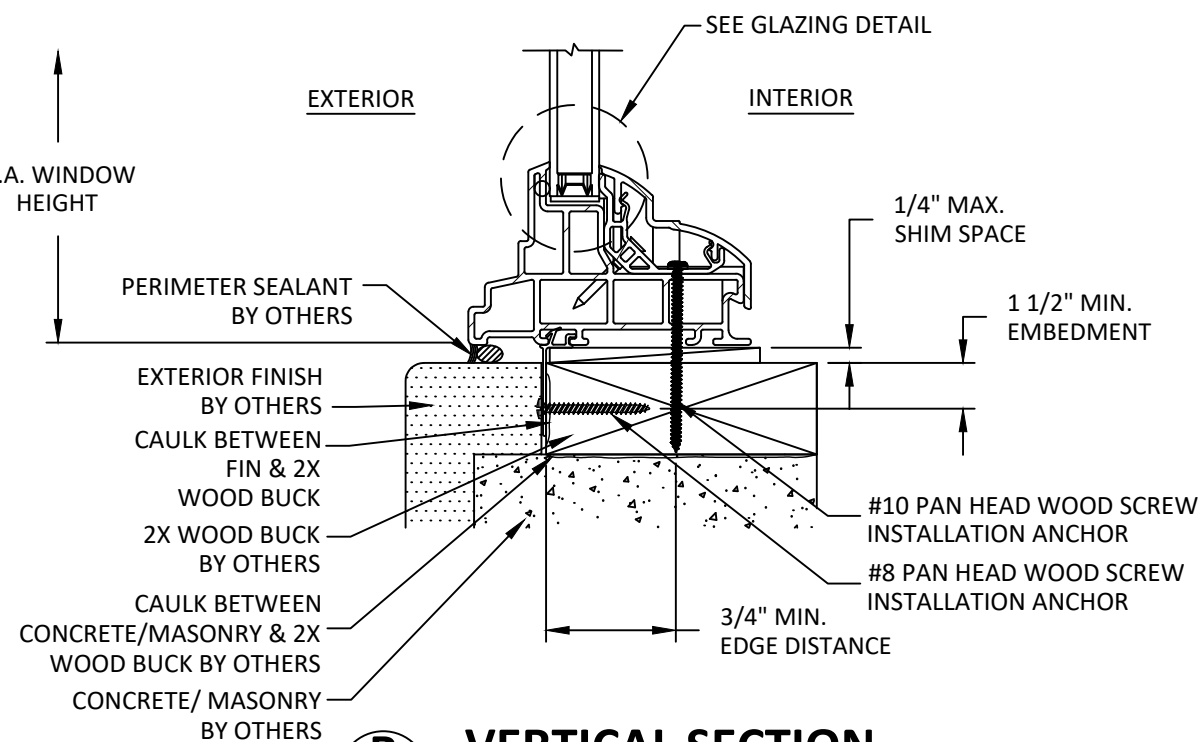

B
3 **VERTICAL SECTION**
SILL - 2X WOOD BUCK
NAIL FIN

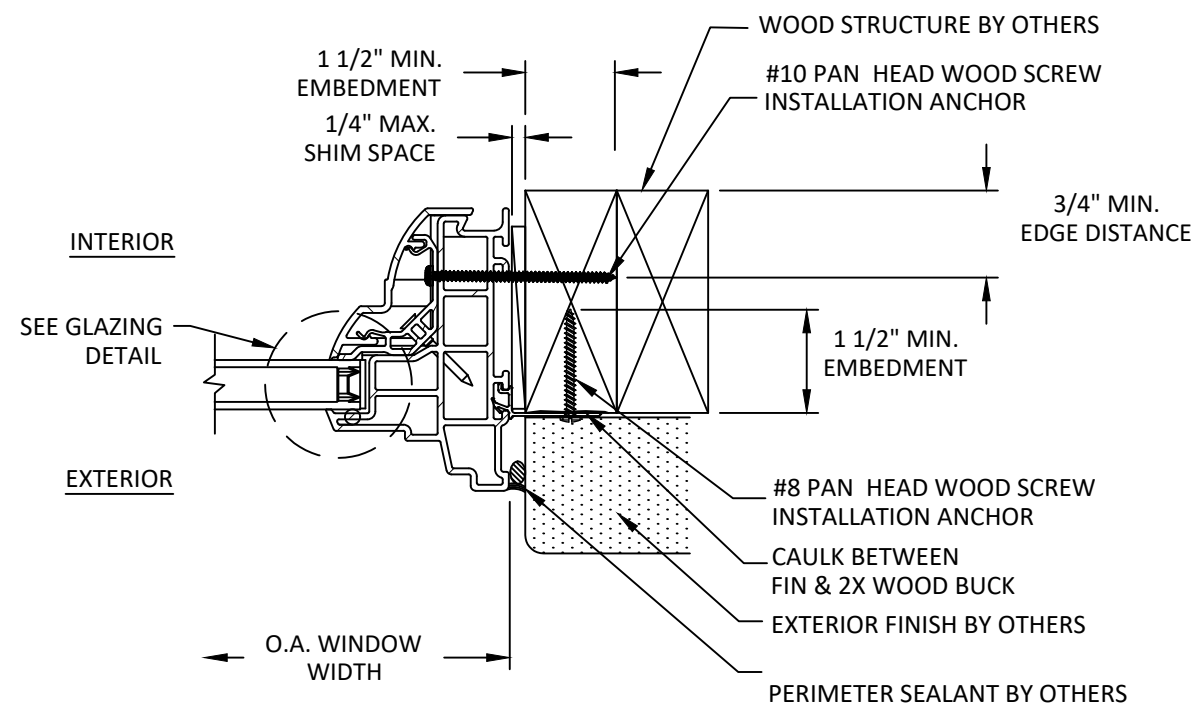

C
3 **HORIZONTAL SECTION**
JAMB - WOOD BUCK
NAIL FIN

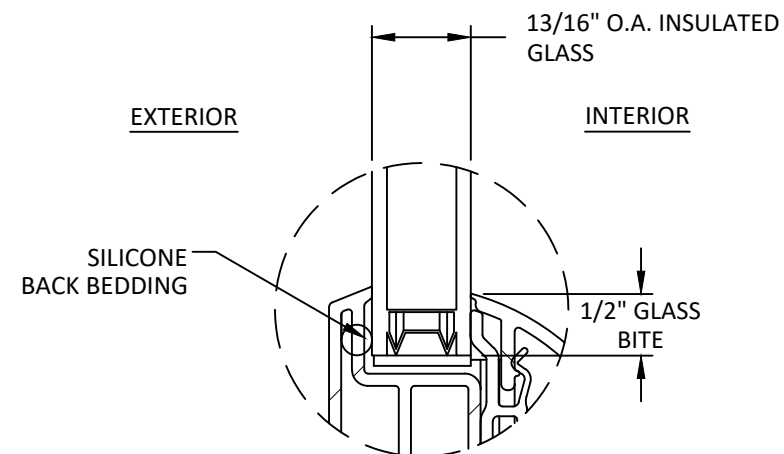

GLAZING DETAIL

NOTE:

1. ALL GLAZING MEETS SAFETY GLAZING REQUIREMENTS AS PER CH 24 OF THE FBC.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER CHAPTER 24.
4. D.L.O. MAY NOT EXCEED MAX DIMENSIONS SHOWN IN ELEVATIONS.



ANDERSEN
WINDOWS & DOORS

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096

PH: (651) 264-5150 FX: (651) 264-5485

TITLE:
RENEWAL BY ANDERSEN FIXED
WINDOWS - FULL FRAME
(NON-HVHZ)/(NON-IMPACT)
NAIL FIN, THROUGH FRAME, GLAZING

PREPARED BY:

BUILDING DROPS, INC.


398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004

PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
REV. FOR PG50 UNITS	MS	2.15.16
FBC UPDATE	SM	12.17.18
7TH FBC CODE CHANGE	SR	3.24.20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

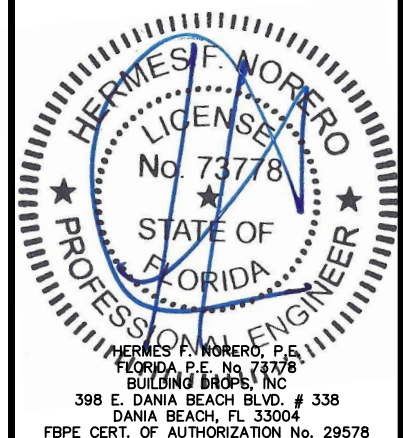

FL #: **FL19562**

DATE: **12.17.15**

DWG. BY: **SM** CHK. BY: **MSS**

SCALE: **NTS**


DWG. #: **AWD092**

SHEET:

3


OF 6

s:\projects\andersen windows\cc-20-0224 - code change - fbc 2020 (version 7) code change\revisions\19562.dwg, 19562.1awd092.dwg
10/9/2020 6:27 PM

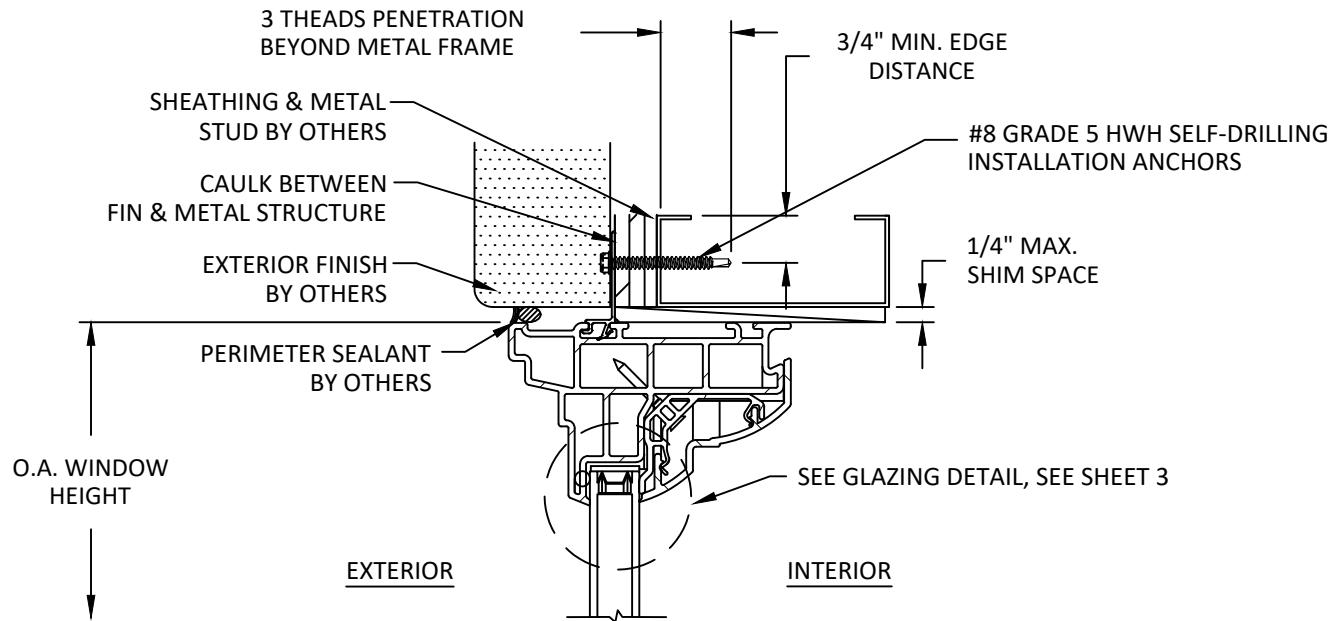


A
4 **VERTICAL SECTION**
HEAD - METAL FRAME SUBSTRATE
NAIL FIN

NAIL FIN/FLANGE IS REVERSIBLE, SEE
ORIENTATION DIFFERENCE IN DETAIL
A AND B

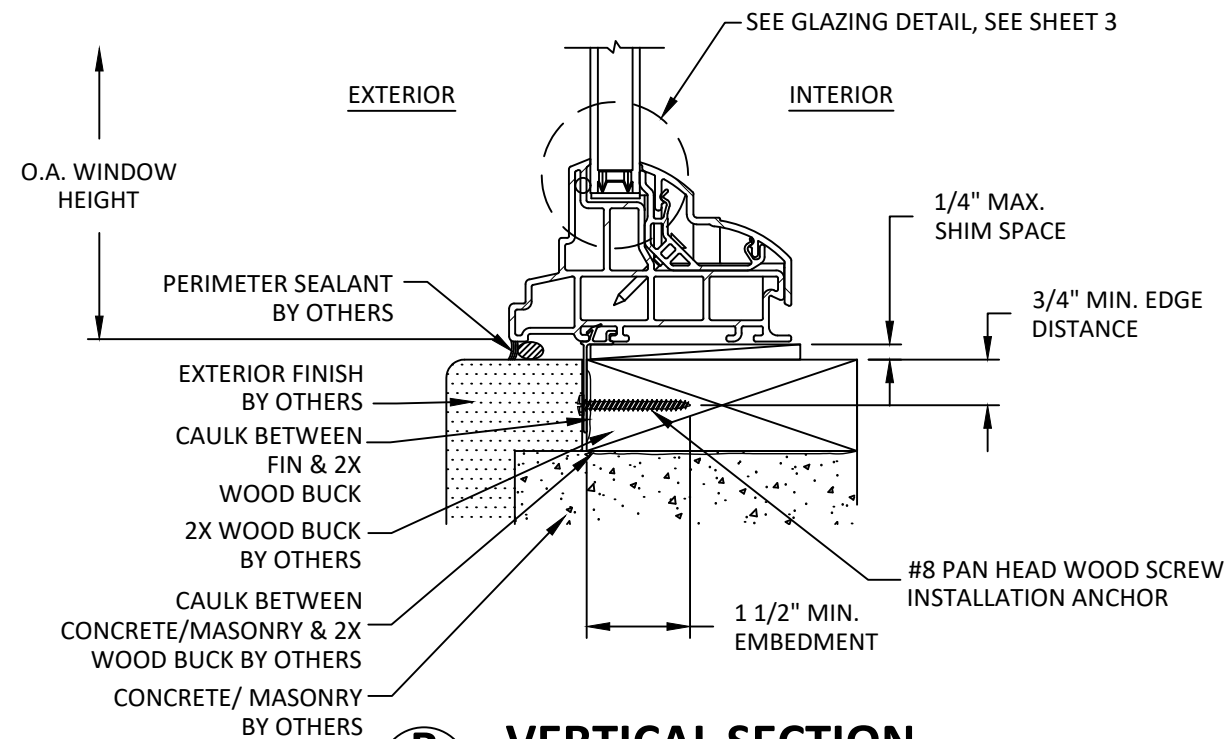

B
4 **VERTICAL SECTION**
SILL - 2X WOOD BUCK
NAIL FIN

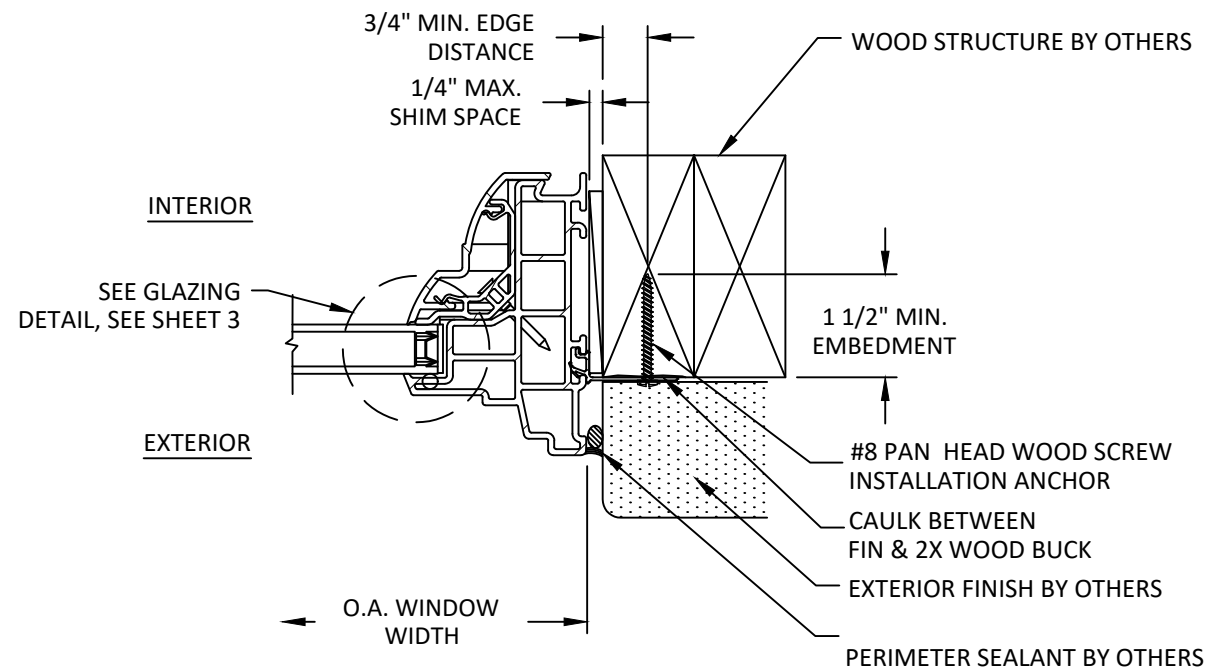

C
4 **HORIZONTAL SECTION**
JAMB - WOOD BUCK
NAIL FIN




100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE:
RENEWAL BY ANDERSEN FIXED
WINDOWS - FULL FRAME
(NON-HVHZ)/(NON-IMPACT)
INSTALLATION CLIP DETAILS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
REV. FOR PG50 UNITS	MS	2.15.16
FBC UPDATE	SM	12.17.18
7TH FBC CODE CHANGE	SR	3.24.20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

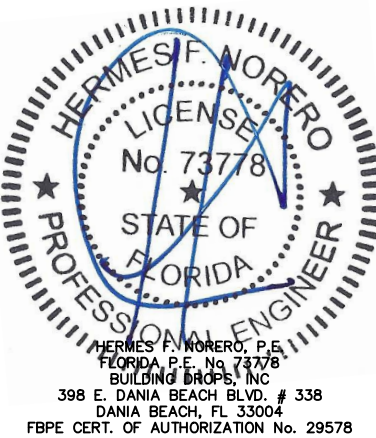


FL #:	FL19562
DATE:	12.17.15
DWG. BY:	CHK. BY:
SM	MSS
SCALE:	NTS
DWG. #:	AWD092
SHEET:	


4

OF 6

s:\projects\andersen windows\cc-20-0224 - code change - fbc 2020 (version 7) code change\revisions\19562\dwgs\19562.1awd092.dwg
10/9/2020 6:27 PM

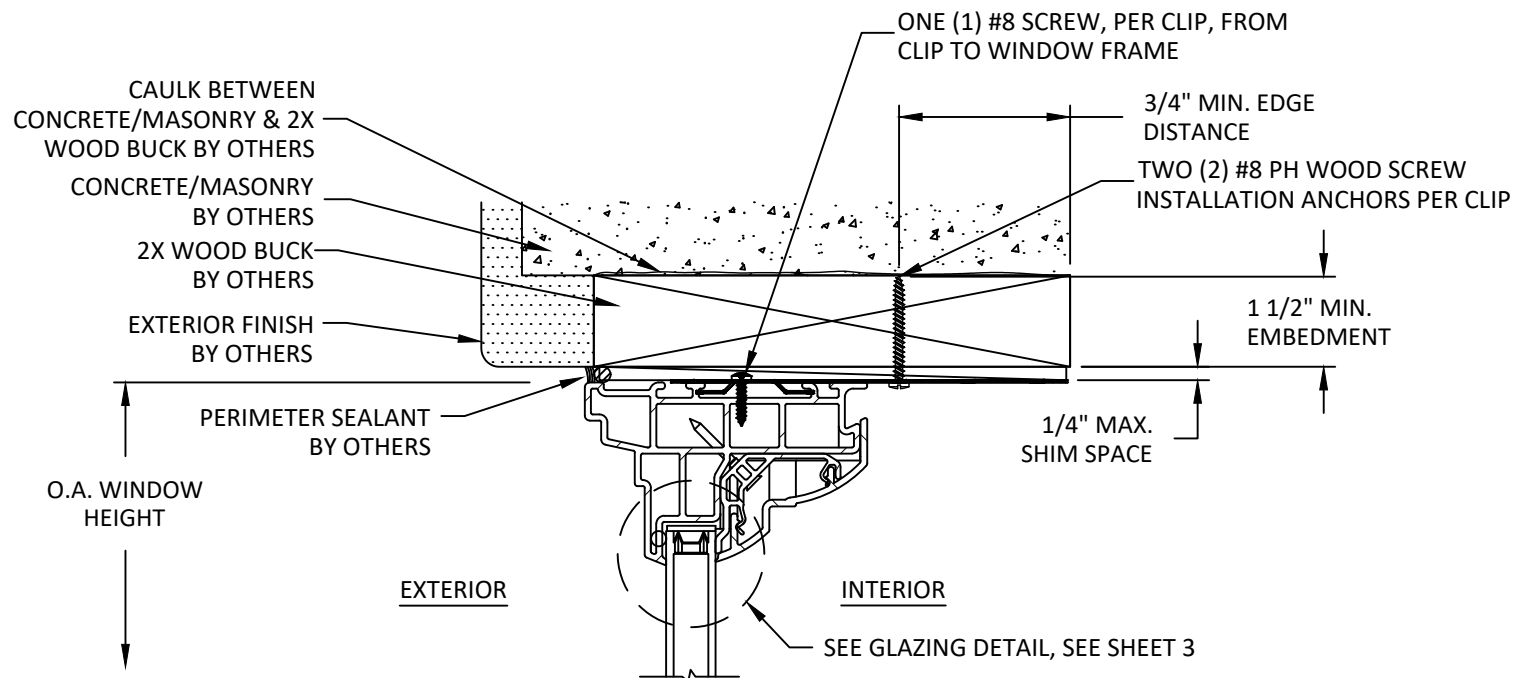

A
5 **VERTICAL SECTION**
HEAD - 2X WOOD BUCK
INSTALLATION CLIP

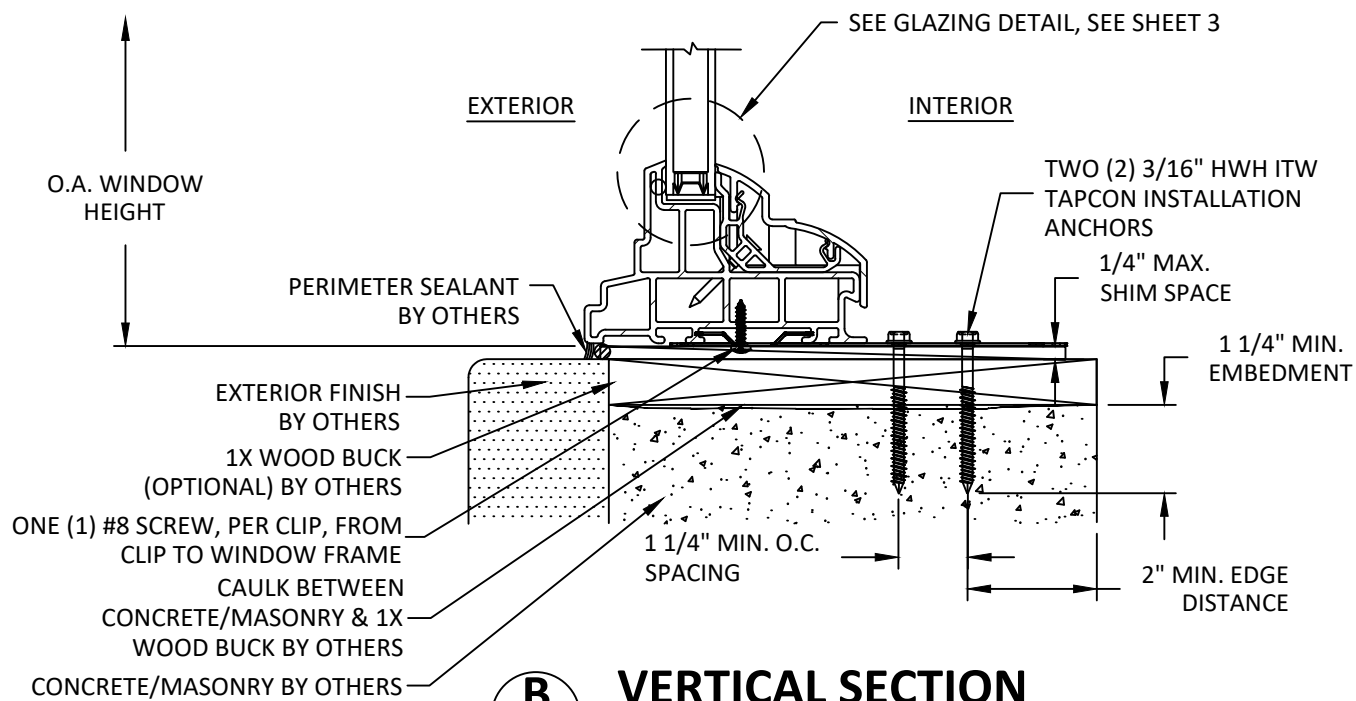

B
5 **VERTICAL SECTION**
SILL - 1X WOOD ON CONCRETE/MASONRY
INSTALLATION CLIP


INSTALLATION CLIP ANCHOR REQUIREMENTS:

WOOD SUBSTRATE: USE TWO #8 PAN HEAD WOOD SCREWS PER CLIP, IN ROW NUMBER ONE OF PREDRILLED HOLES SHOWN BELOW.


METAL SUBSTRATE: USE TWO #8 HWH SMS ANCHORS PER CLIP, IN ROW NUMBER ONE OF PREDRILLED HOLES SHOWN BELOW.

CONCRETE/MASONRY: USE TWO 3/16" ITW TAPCON ANCHORS, WITH ONE ANCHOR PLACED IN ROW NUMBER ONE AND ONE ANCHOR PLACED IN ROW NUMBER TWO OF PREDRILLED HOLES SHOWN BELOW. ANCHORS MUST BE PLACED DIAGONALLY ACROSS THE CLIP.

DO NOT INSTALL ANCHORS THROUGH ROW NUMBER THREE.

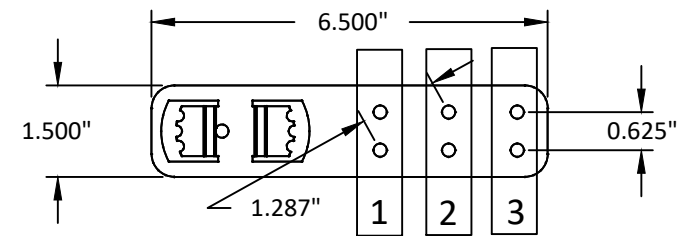

INSTALLATION CLIP DETAIL

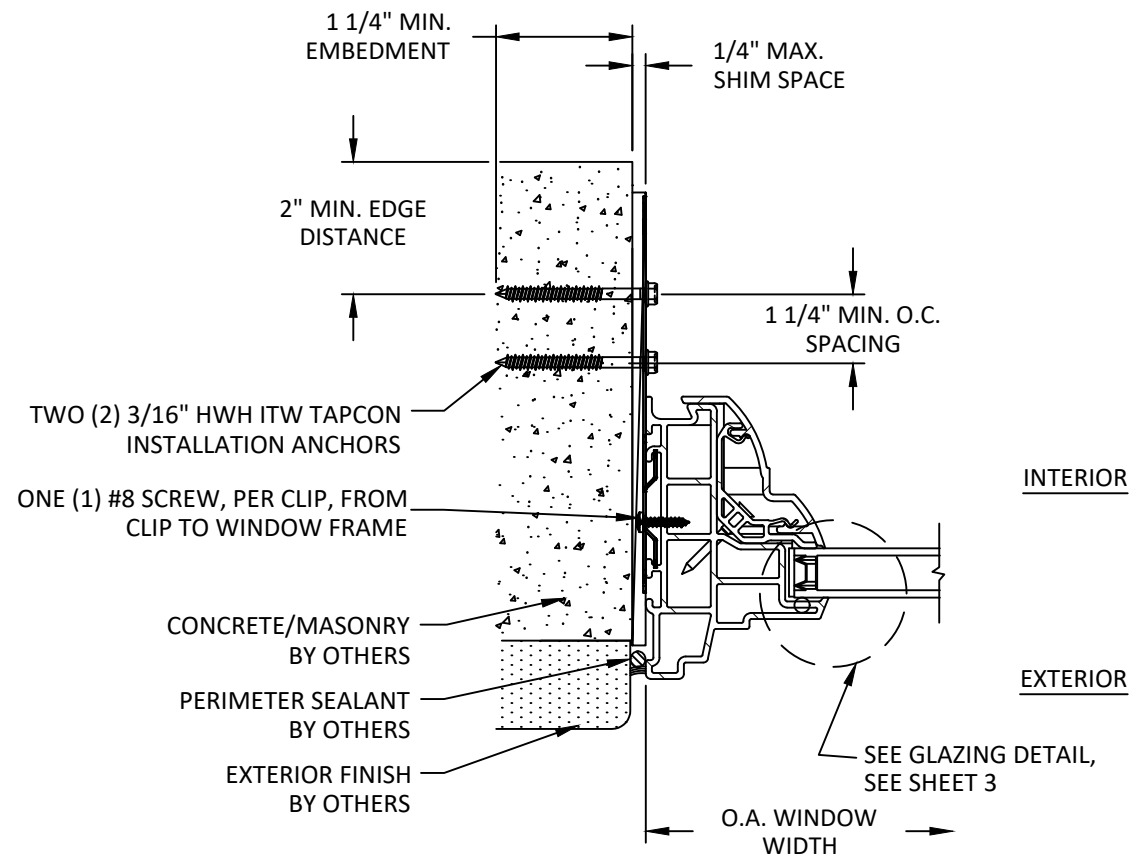

C
5 **HORIZONTAL SECTION**
JAMB - CONCRETE/MASONRY
INSTALLATION CLIP




100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE:
RENEWAL BY ANDERSEN FIXED
WINDOWS - FULL FRAME
(NON-HVHZ)/(NON-IMPACT)
INSTALLATION CLIP DETAILS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
REV. FOR PG50 UNITS	MS	2.15.16
FBC UPDATE	SM	12.17.18
7TH FBC CODE CHANGE	SR	3.24.20



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

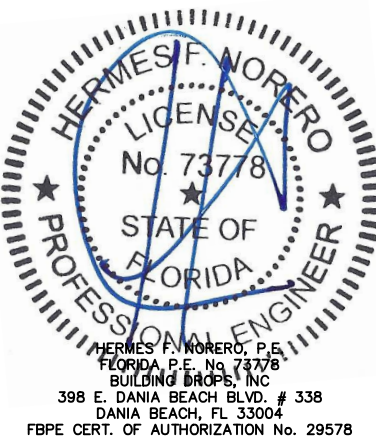

FL #:	FL19562
DATE:	12.17.15
DWG. BY:	CHK. BY:
SM	MSS
SCALE:	NTS
DWG. #:	AWD092
SHEET:	5

s:\projects\andersen windows\cc-20-0224 - code change - fbc 2020 (version 7) code change\revisions\19562\dwgs\19562.1awd092.dwg 10/9/2020 6:27 PM

QUALIFIED SHAPES

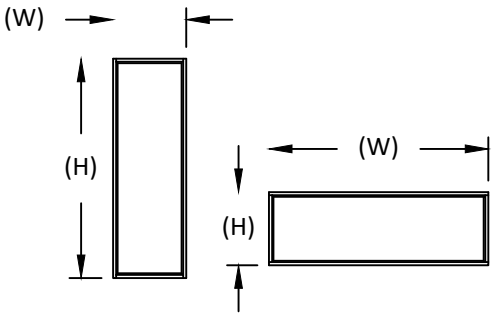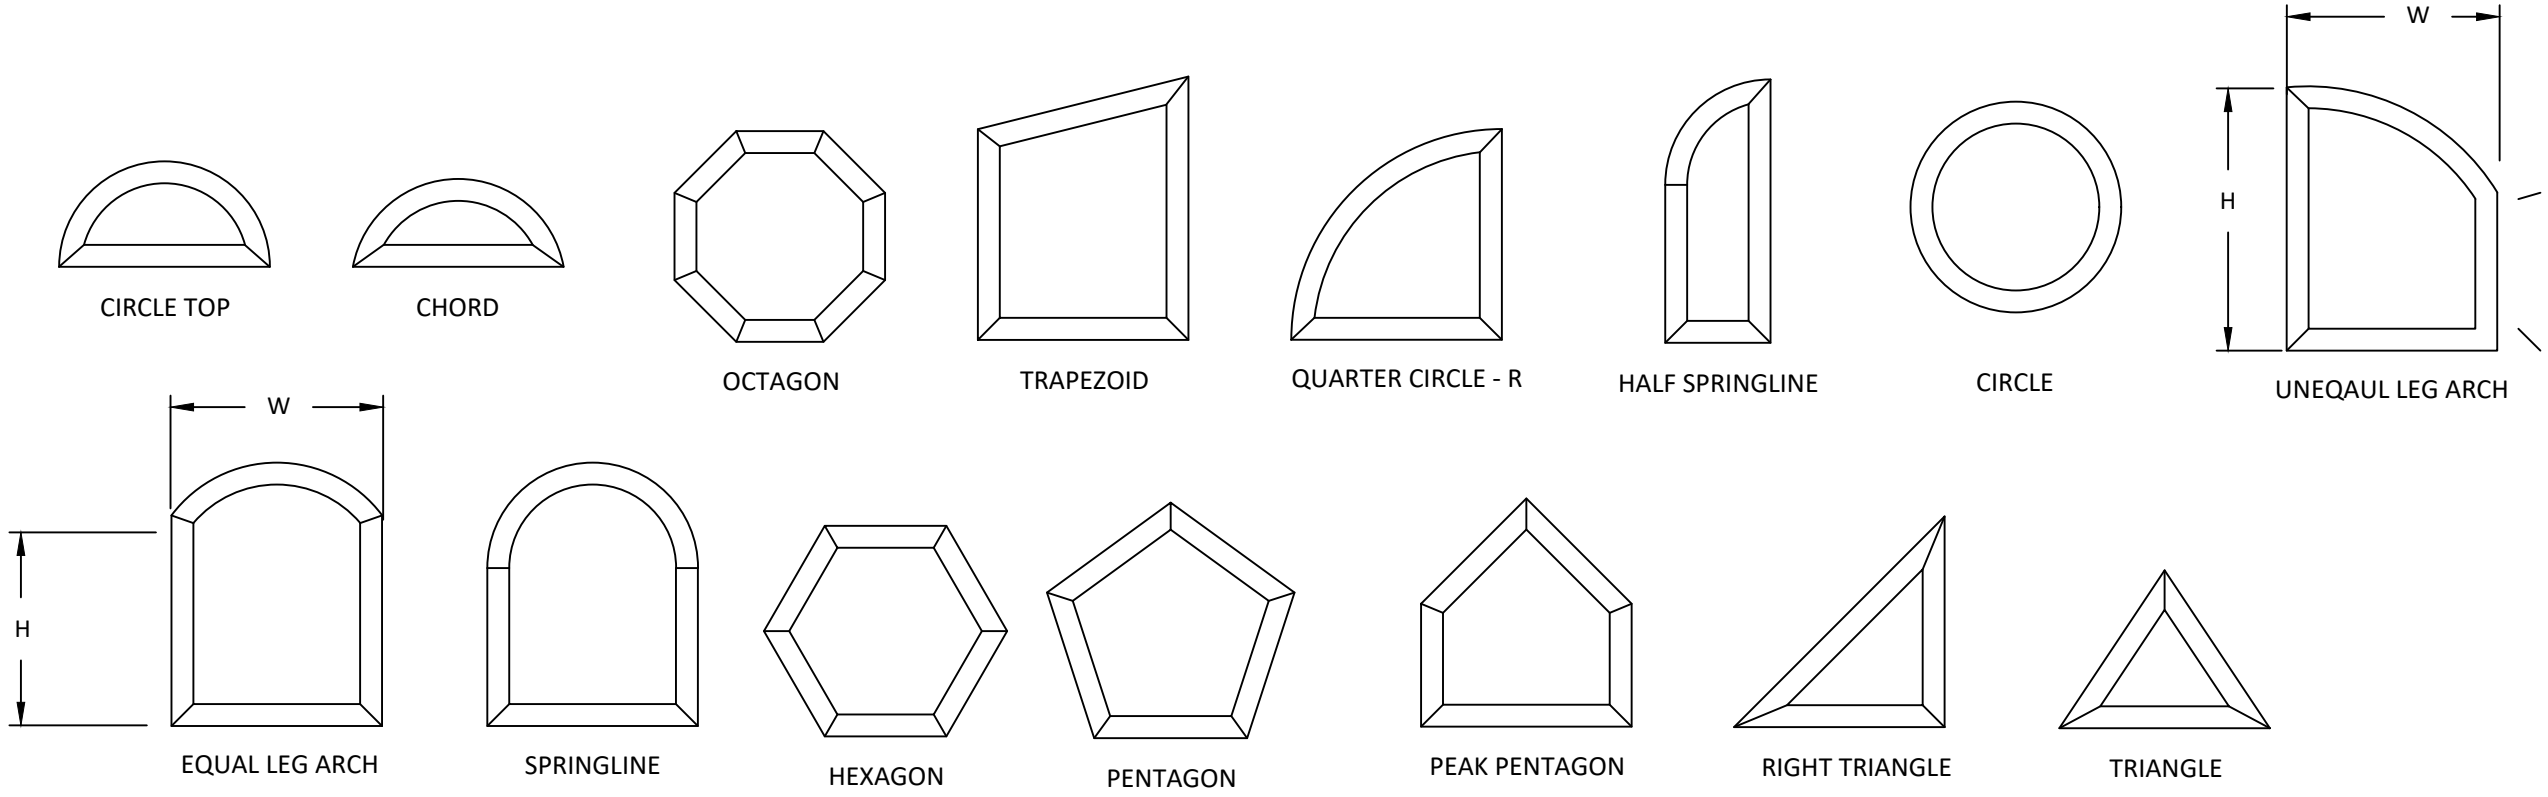

NOTE:
WINDOW WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FOOT AREA.



ANDERSEN
WINDOWS & DOORS

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096

PH: (651) 264-5150 FX: (651) 264-5485


TITLE:
RENEWAL BY ANDERSEN FIXED
WINDOWS - FULL FRAME
(NON-HVHZ)/(NON-IMPACT)
QUALIFIED SHAPES

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
REV. FOR PG50 UNITS	MS	2.15.16
FBC UPDATE	SM	12.17.18
7TH FBC CODE CHANGE	SR	3.24.20

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

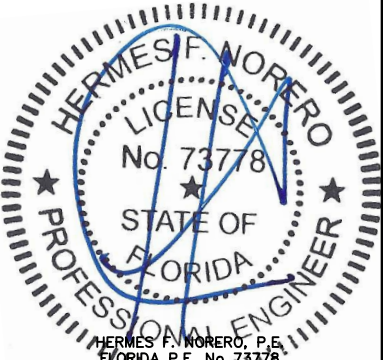

HERMES F. MORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL19562

DATE: **12.17.15**

DWG. BY: **SM**CHK. BY: **MSS**

SCALE: **NTS**

DWG. #: **AWD092**

SHEET:
6
OF 6