

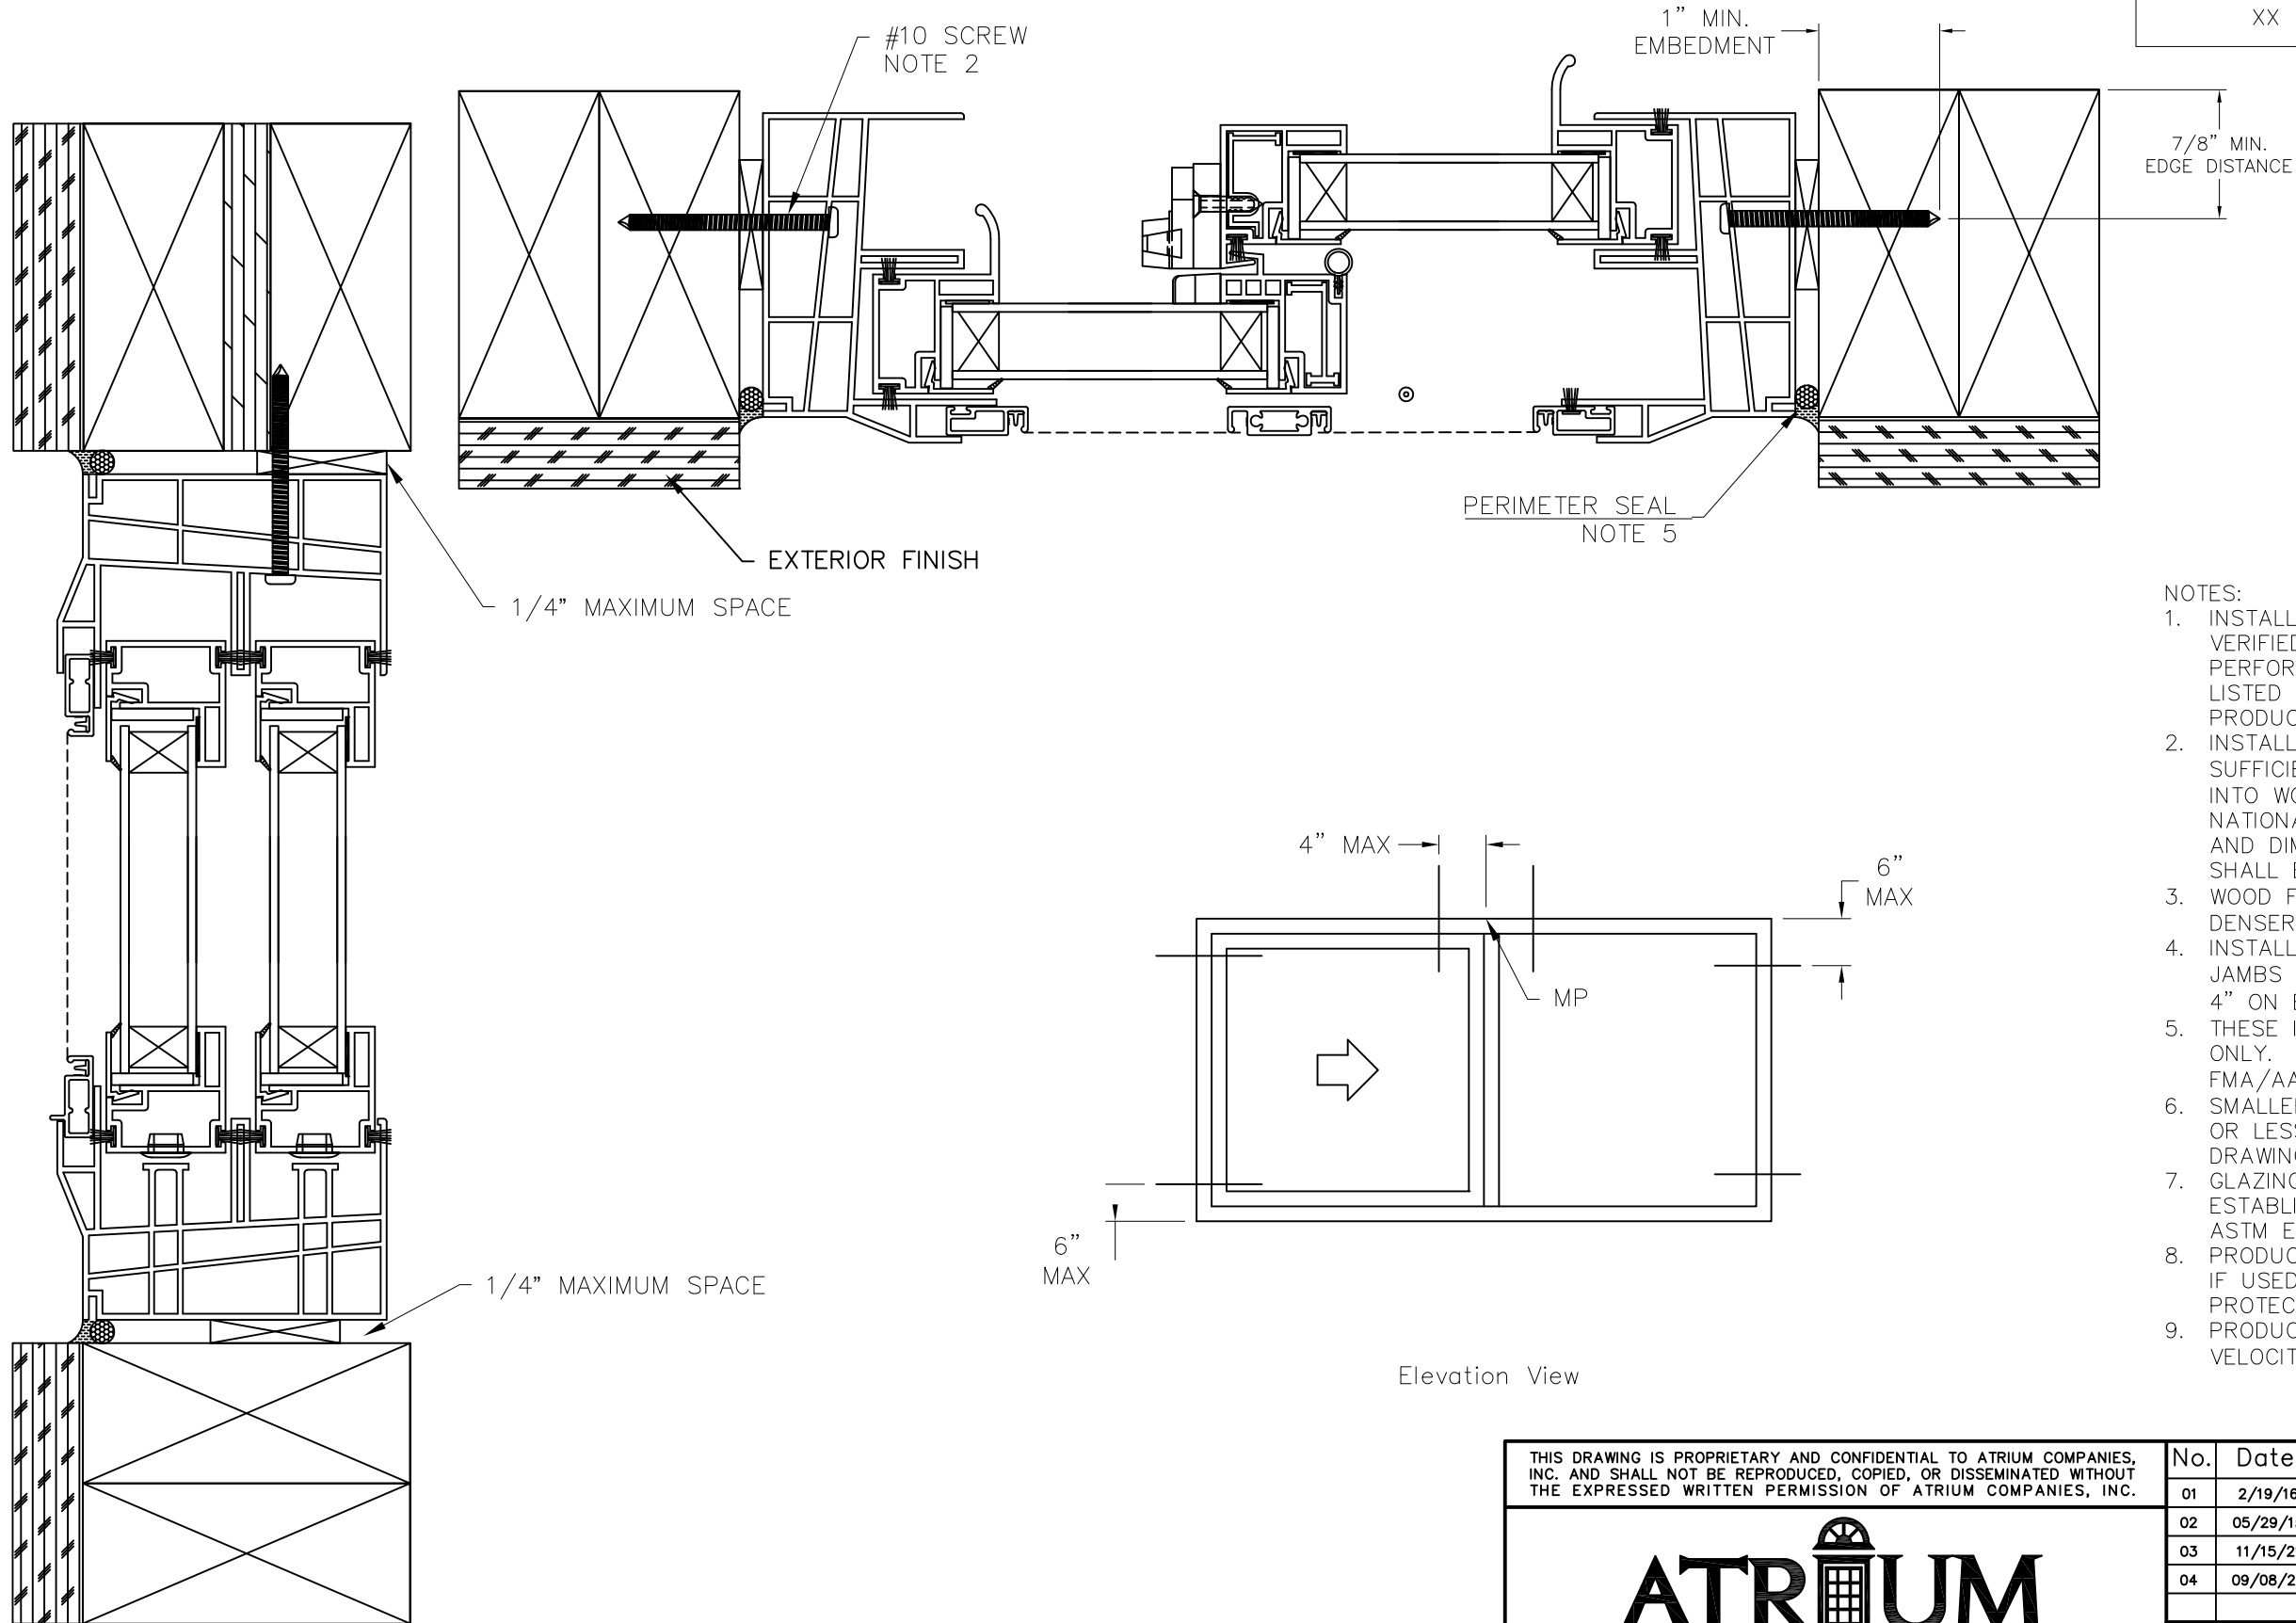


Table 1 –Verified Installations			
Configuration	DP (psf)	WIDTH (in)	HEIGHT (in)
XX	+/- 30.0	72	48

- NOTES:
1. INSTALLATIONS SHOWN ON THIS DRAWING HAVE BEEN VERIFIED AS THE AS-TESTED INSTALLATION FOR THE PERFORMANCE LEVEL SHOWN. VERIFIED PRODUCTS ARE LISTED IN TABLE 1. THIS DRAWING APPLIES ONLY TO THOSE PRODUCTS.
 2. INSTALLATION ANCHORS SHALL BE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE MINIMUM EMBEDMENT OF 1" INTO WOOD FRAMING MEMBER. WOOD SCREWS SHALL SATISFY NATIONAL DESIGN SPECIFICATION FOR MATERIAL PROPERTIES AND DIMENSIONS. PER NDS-2005 11.1.4.7, EDGE DISTANCES SHALL BE SUFFICIENT TO PREVENT SPLITTING.
 3. WOOD FRAMING SHALL BE SPRUCE-PINE-FIR (G=0.42) OR DENSER.
 4. INSTALLATION ANCHORS SHALL BE LOCATED THROUGH THE JAMBS 6" FROM HEAD AND SILL, AND THROUGH THE HEAD 4" ON EITHER SIDE OF THE MIDPOINT.
 5. THESE INSTRUCTIONS ADDRESS STRUCTURAL REQUIREMENTS ONLY. WINDOWS SHALL BE INSTALLED PER ASTM E2112 OR FMA/AAMA 100.
 6. SMALLER WINDOWS OF THE SAME CONSTRUCTION AND EQUAL OR LESSER DESIGN PRESSURES ARE COVERED BY THIS DRAWING.
 7. GLAZING TYPE, GLASS TYPE, AND GLASS THICKNESS ARE ESTABLISHED BY THE CERTIFICATION AND SHALL SATISFY ASTM E1300. GLAZING TYPE SHALL BE INSULATING GLASS.
 8. PRODUCTS LISTED IN TABLE 1 ARE NOT IMPACT RESISTANT. IF USED IN WIND-BORNE DEBRIS REGIONS, APPROVED PROTECTION DEVICES ARE REQUIRED.
 9. PRODUCT OR INSTALLATION IS NOT APPROVED FOR HIGH VELOCITY HURRICANE ZONE (HVHZ)

Elevation View

THIS DRAWING IS PROPRIETARY AND CONFIDENTIAL TO ATRIUM COMPANIES, INC. AND SHALL NOT BE REPRODUCED, COPIED, OR DISSEMINATED WITHOUT THE EXPRESSED WRITTEN PERMISSION OF ATRIUM COMPANIES, INC.				No.		Date	Revision Description		By	ECN #			
				01		2/19/16	ADDED LEADERS "1/4" MAXIMUM SPACE) TO SHIM AREAS OF THE HEAD & SILL.		JKW	-----			
				02		05/29/15	5TH ED. FBC UPDATES		BB	-----			
				03		11/15/21	UPDATED FOR 7TH EDITION 2020 FBC		LMH	-----			
				04		09/08/25	UPDATED TO CURRENT FBC		LMH	-----			
Title: ADW-08 8300/8500/8700 XX HORIZONTAL SLIDER REPLACEMENT INSTALLATION				Material (Type-Alloy-Temper): -----			Est. Area (in²): NA		Tolerances: X.XX = ±X.XX X.XXX = ±X.XXX X.X' = ±X.X'				
							Est. Weight (lb/ft): NA						
				Drawn By: JTS		Approved By: DJC		Date: 27 AUGUST 2008		Scale: 1:2		Sheet Size: ANSI B	
				ECN# (Initial Issue): ECN-2008-1395EE			File Name: ADW-08 8700/6000/1600/3500 HS FINLESS INSTALLATION			Sheet 1/1			