


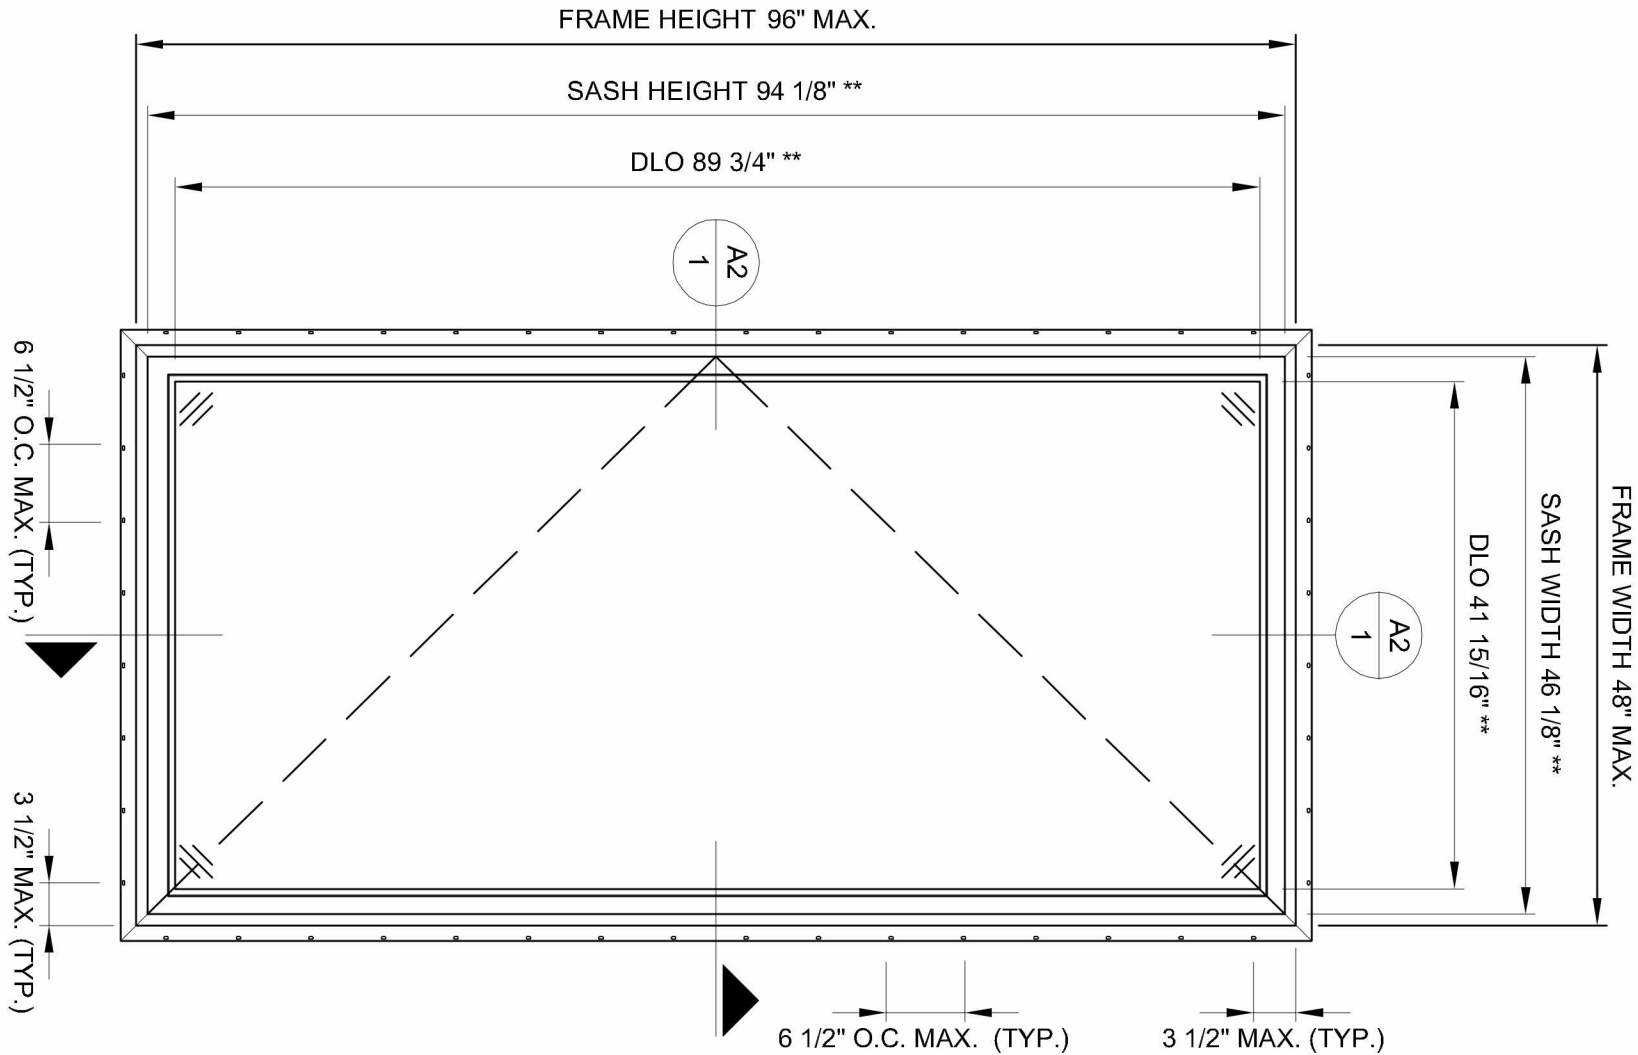

A1 ELEVATION
1 SCALE 1:1

GENERAL NOTES:


- ALL FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS AND MAY NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE PROJECT DRAWINGS. SPECIFIED ANCHOR EMBEDMENT INTO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
 - THE EMBEDMENT INTO BASE MATERIAL SHALL BE NO LESS THAN 1 7/8" INTO THE WOOD STRUCTURAL MEMBER.
 - THE EDGE DISTANCE SHALL BE NO LESS THAN 1/2" FROM EDGE OF WOOD STRUCTURAL MEMBER.
- OPENINGS, BUCKINGS, & BUCKING FASTENERS MUST BE DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
- THESE NON-IMPACT RATED WINDOW SYSTEM INSTALLATIONS ARE IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (F.B.C.) AND ALL LOCAL APPLICABLE CODES.
- ALL ANCHORS SECURING THE WINDOW NAILING FLANGE TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE-TREATING CHEMICALS IN THE WOOD.
- MATERIALS, INCLUDING BUT NOT LIMITED TO ROOFING NAILS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE CHAPTER 20 AND ALL LOCAL APPLICABLE CODES.
- CERTIFICATION OF THESE WINDOW INSTALLATIONS SHALL BE CONSIDERED VOID IF ANY OF THE FOLLOWING APPLY:
 - THEY ARE INSTALLED WITHOUT A BUILDING PERMIT FROM THE APPLICABLE LOCAL BUILDING DEPARTMENT.
 - IF THEY ARE INSTALLED BY ANYONE OTHER THAN A LICENSED CONTRACTOR EXPERIENCED WITH DOOR INSTALLATIONS.
 - IF CHANGES HAVE OCCURRED TO THE PRODUCTS CERTIFICATION ENTITY'S CERTIFICATE THAT CAUSE THESE INSTALLATIONS TO BE INCORRECT OR INCONSISTENT WITH WHAT HAS BEEN TESTED.
 - THE LEAST DESIGN PRESSURE SPECIFIED EITHER IN THIS DRAWING OR IN THE PRODUCTS CERTIFICATION SHALL CONTROL FOR THE INSTALLED WINDOW.
 - THESE DRAWINGS CERTIFY THE WINDOW INSTALLATION ONLY.
 - WATERPROOFING AND AIR BARRIER TRANSITIONS TO THE INSTALLED WINDOWS IS NOT PART OF THIS INSTALLATION CERTIFICATION. THAT RESPONSIBILITY SHALL BE THAT OF THE DESIGN PROFESSIONAL AND INSTALLER(S).
 - IMPACT SHUTTERS ARE REQUIRED ONLY WITH NON-IMPACT UNITS AS PER F.B.C. REQUIREMENTS.
 - OPERATION OF WINDOWS INCLUDES LEFT AND RIGHT.



INSTALLATION METHOD :

- 2" (50 mm), 11 GA (6d) ROOFING NAILS WITHIN 3 1/2" (90 mm) OF OUTSIDE FRAME CORNERS AND 6 1/2" (165 mm) O/C MAX. ON HEAD, SILL AND JAMB.

** THE DAYLIGHT OPENING (DLO) AND SASH DIMENSIONS WILL VARY BASED ON THE SIZE OF THE FRAME.

Oversize Casement Design Pressure/Size Table				
Width	Height	Clad/ Non-Clad	DP	PG
42	96	Clad	50	CW - PG50
42	96	Non-Clad	50	CW - PG50
48	96	Clad	40	CW - PG40
48	96	Non-Clad	30	CW - PG30

		Loewen claims proprietary rights in the material depicted on this drawing and reserves the right to discontinue or modify the product for any reason without express written permission.	
Drawn by: James S.		 Units of Measurement: Imperial Product Family: 28 Series - CA	
Date: 10/28/2015			
Checked by: CWS			
Date: 01/22/2016			
Drawing No: 28A21 - 1		Rev. No:	

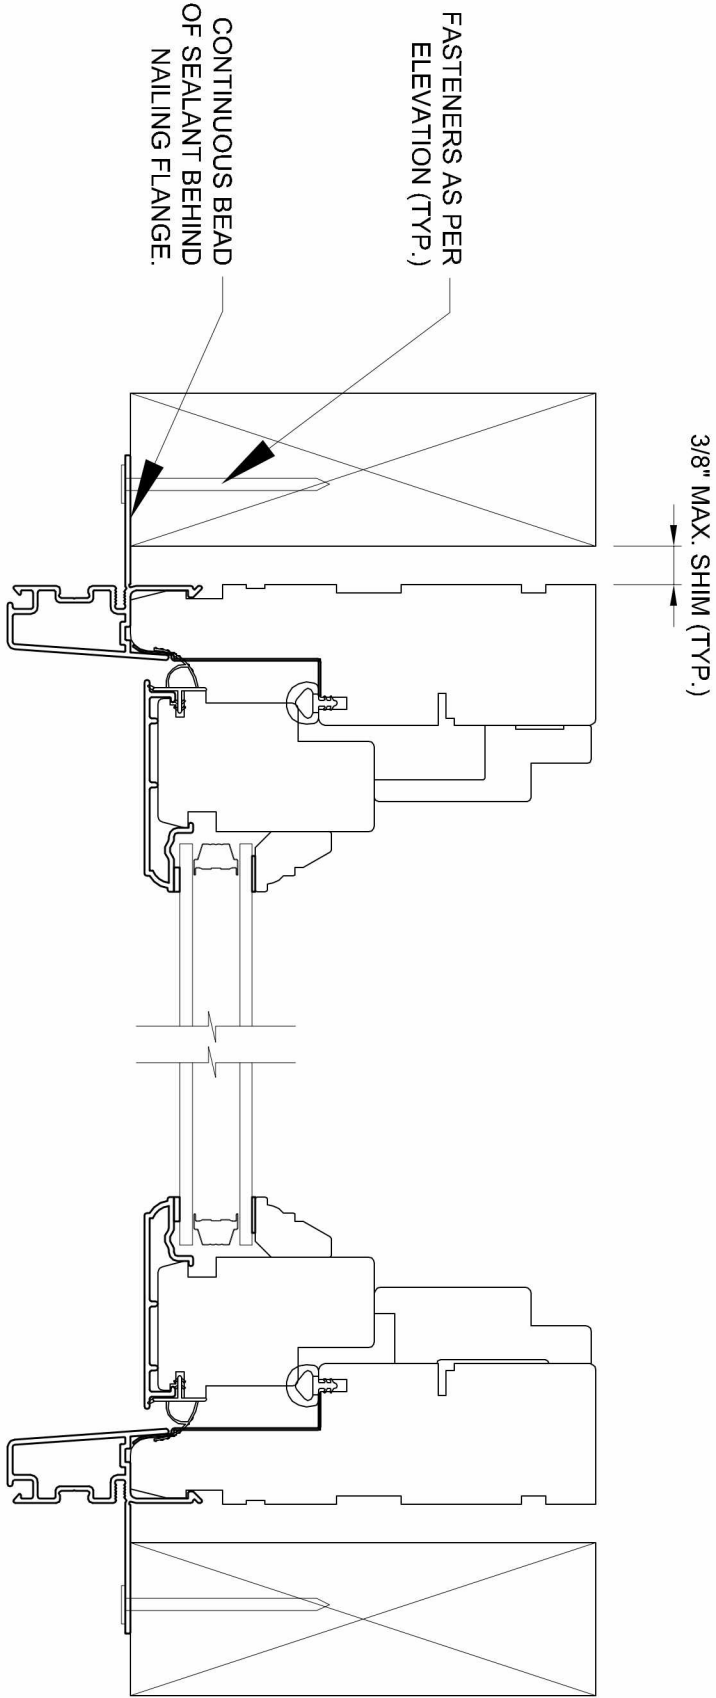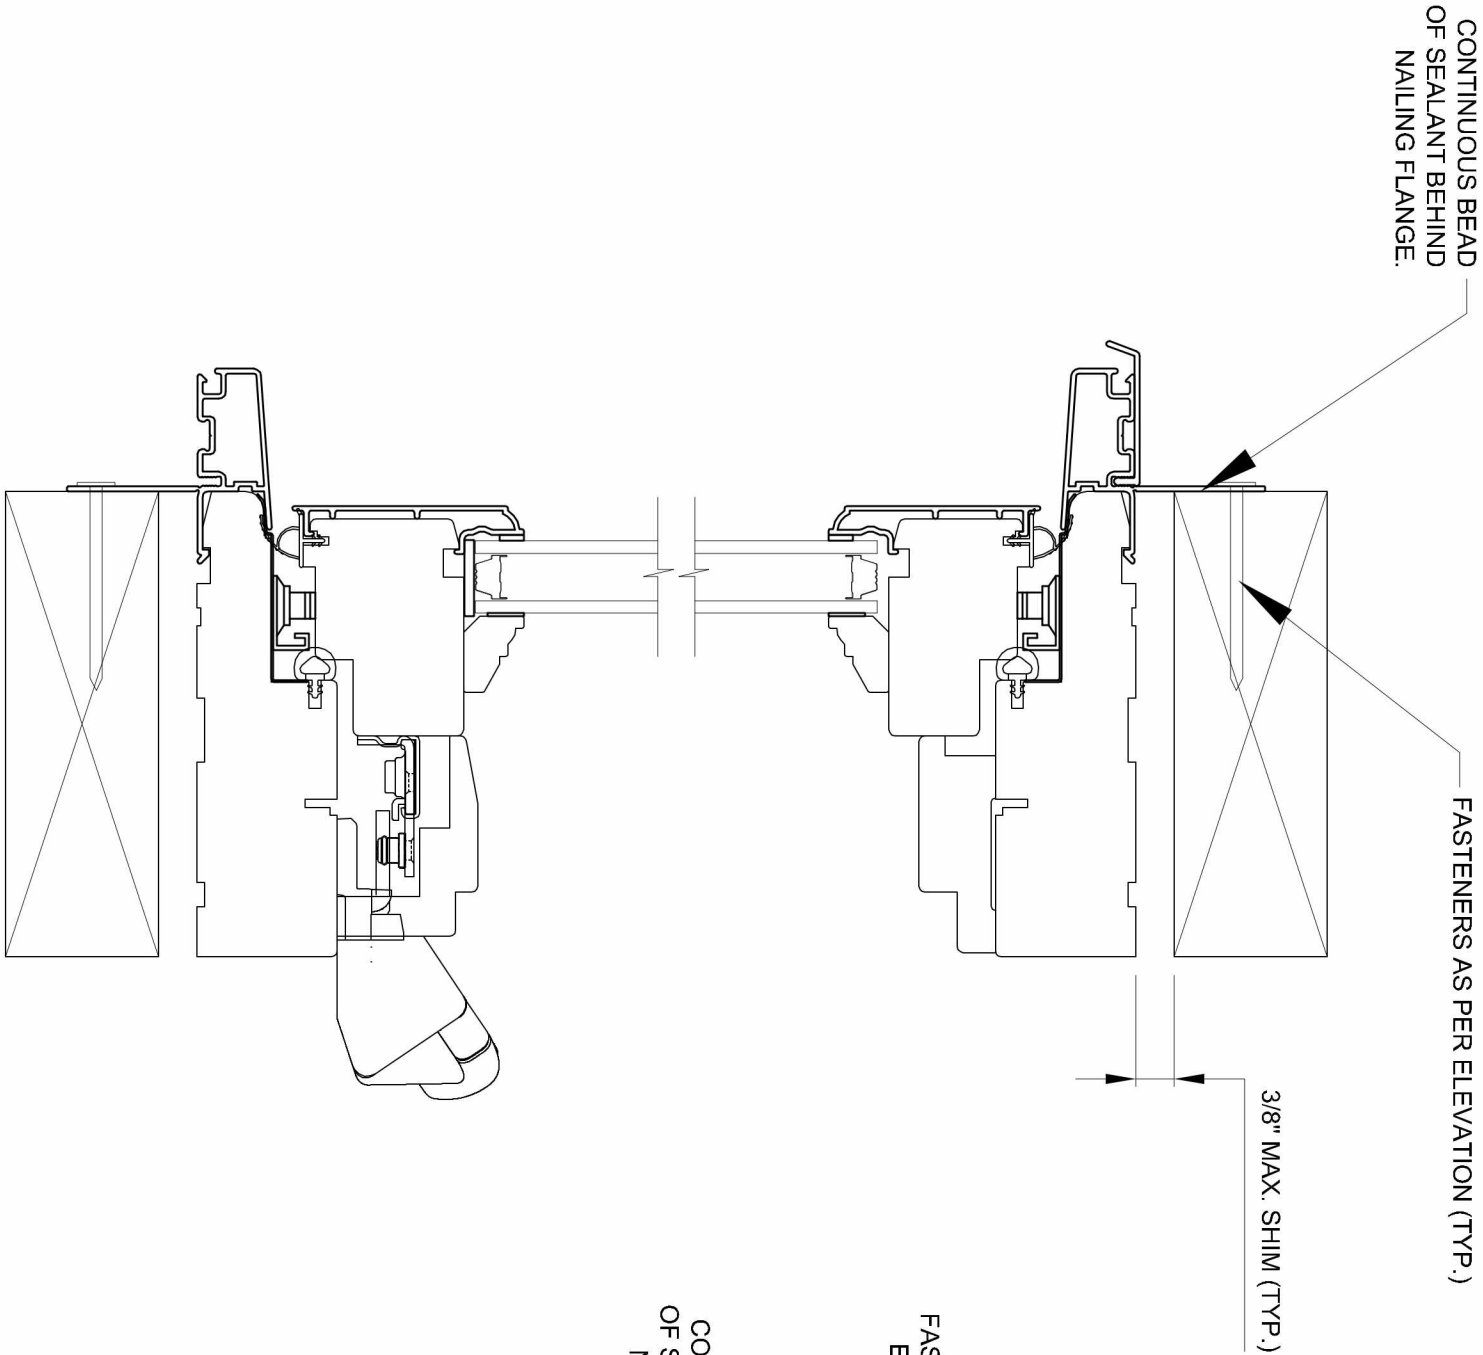

	Loewen claims proprietary rights in the design and construction of its products. It may not be reproduced for any reason without express written permission.			Units of Measurement: Imperial	
	Drawn by: James S.			Product Family: 28 Series - CA	
	Date: 10/28/2015			OVERSIZE CASEMENT - METAL CLAD (NON-IMPACT)	
	Checked by: CWS			Drawing No: 28A21 - 2	Rev. No:
	Date: 01/22/2016				
Sheet: 2 of 2					