


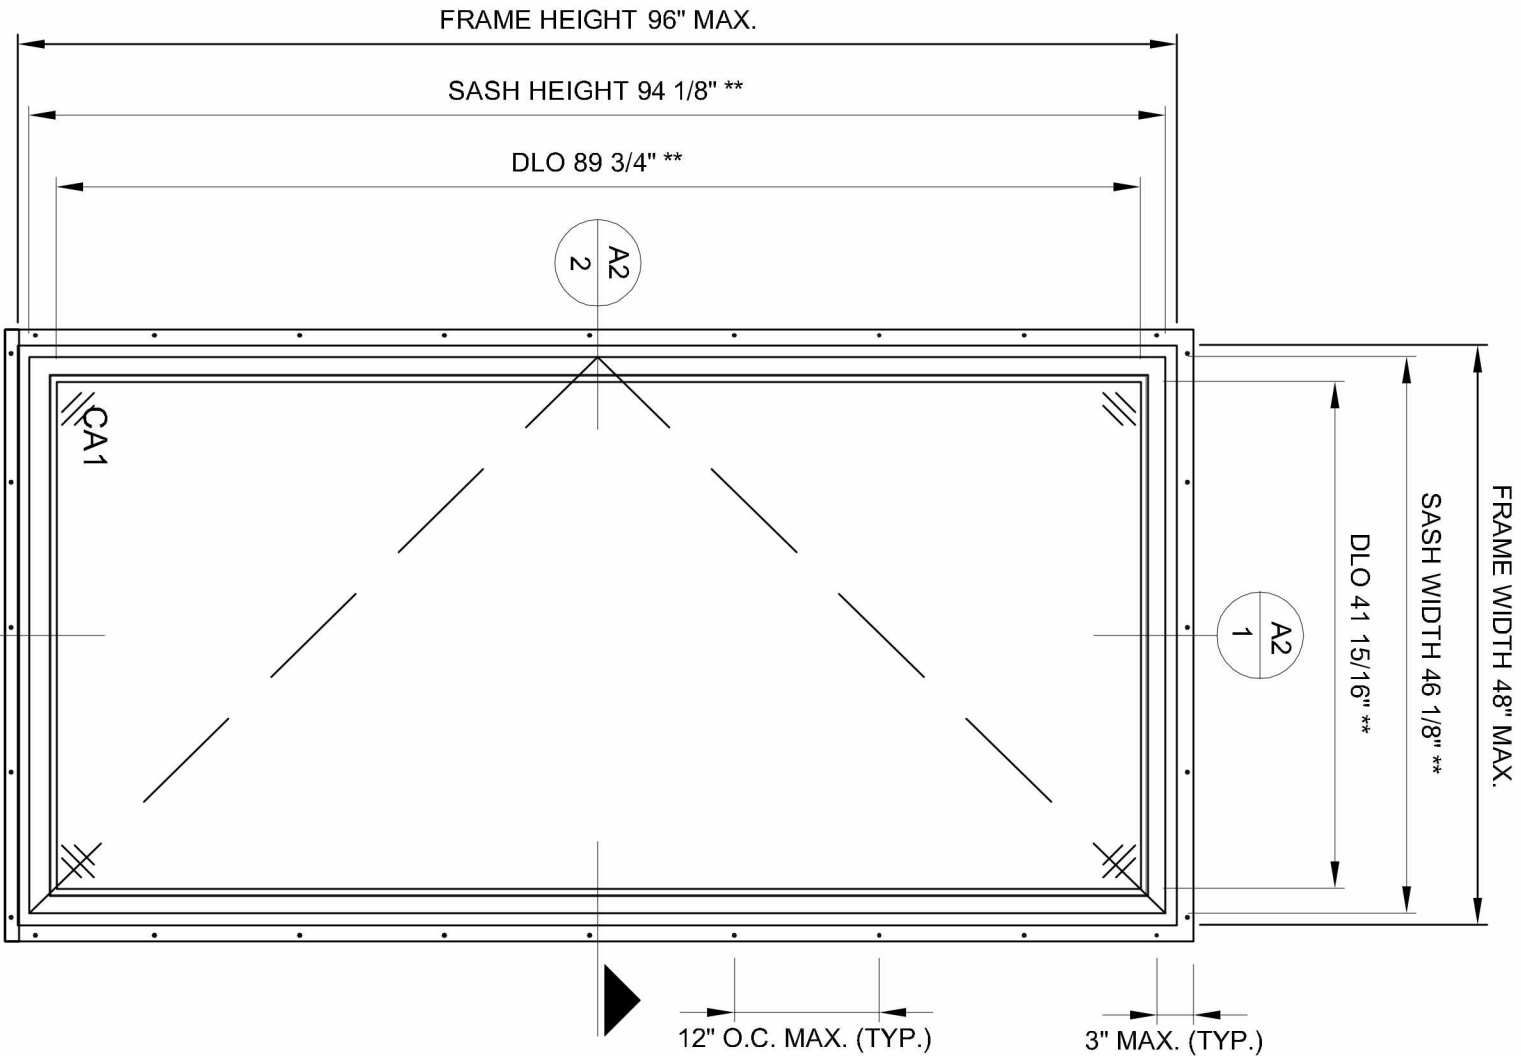

A1 ELEVATION
1 SCALE 1:1

GENERAL NOTES:

- ALL FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS AND MAY NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE PROJECT DRAWINGS. SPECIFIED ANCHOR EMBEDMENT INTO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
 - THE EMBEDMENT INTO BASE MATERIAL SHALL BE NO LESS THAN 1 7/8" INTO THE WOOD STRUCTURAL MEMBER.
 - THE EDGE DISTANCE SHALL BE NO LESS THAN 1/2" FROM EDGE OF WOOD STRUCTURAL MEMBER.
- OPENINGS, BUCKINGS, & BUCKING FASTENERS MUST BE DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
- THESE NON-IMPACT RATED WINDOW SYSTEM INSTALLATIONS ARE IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (F.B.C.) AND ALL LOCAL APPLICABLE CODES.
- ALL ANCHORS SECURING THE WINDOW NAILING FLANGE TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE-TREATING CHEMICALS IN THE WOOD.
- MATERIALS, INCLUDING BUT NOT LIMITED TO ROOFING NAILS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE CHAPTER 20 AND ALL LOCAL APPLICABLE CODES.
- CERTIFICATION OF THESE WINDOW INSTALLATIONS SHALL BE CONSIDERED VOID IF ANY OF THE FOLLOWING APPLY:
 - THEY ARE INSTALLED WITHOUT A BUILDING PERMIT FROM THE APPLICABLE LOCAL BUILDING DEPARTMENT.
 - IF THEY ARE INSTALLED BY ANYONE OTHER THAN A LICENSED CONTRACTOR EXPERIENCED WITH DOOR INSTALLATIONS.
 - IF CHANGES HAVE OCCURRED TO THE PRODUCTS CERTIFICATION ENTRY'S CERTIFICATE THAT CAUSE THESE INSTALLATIONS TO BE INCORRECT OR INCONSISTENT WITH WHAT HAS BEEN TESTED.
 - THE LEAST DESIGN PRESSURE SPECIFIED EITHER IN THIS DRAWING OR IN THE PRODUCTS CERTIFICATION SHALL CONTROL FOR THE INSTALLED WINDOW.
 - THESE DRAWINGS CERTIFY THE WINDOW INSTALLATION ONLY.
 - WATERPROOFING AND AIR BARRIER TRANSITIONS TO THE INSTALLED WINDOWS IS NOT PART OF THIS INSTALLATION CERTIFICATION. THAT RESPONSIBILITY SHALL BE THAT OF THE DESIGN PROFESSIONAL AND INSTALLER(S).
 - IMPACT SHUTTERS ARE REQUIRED ONLY WITH NON-IMPACT UNITS AS PER F.B.C. REQUIREMENTS.
 - OPERATION OF WINDOWS INCLUDES LEFT AND RIGHT.



INSTALLATION METHOD :

- 2 1/2" (64 mm), 14 GA (8d) FINISH NAILS WITHIN 3" (76 mm) OF OUTSIDE FRAME CORNERS AND 12" (300 mm) O/C MAX. ON HEAD, SILL AND JAMBS.

** THE DAYLIGHT OPENING (DLO) AND SASH DIMENSIONS WILL VARY BASED ON THE SIZE OF THE FRAME.

Oversize Casement Design Pressure/Size Table			
Width	Height	Clad/ Non-Clad	DP PG
42	96	Clad	50 CW - PG60
42	96	Non-Clad	50 CW - PG60
48	96	Clad	40 CW - PG40
48	96	Non-Clad	30 CW - PG30

 Loewen claims proprietary rights in the material shown on this drawing. It may not be reproduced for any reason without express written permission.		Units of Measurement: Imperial	
Product Description: OVERSIZE CASEMENT - NON CLAD (NON-IMPACT)		Product Family: 28 Series - CA	
Drawn by: James S.			
Date: 10/28/2015			
Checked by: CWS			
Date: 01/22/2016			
Sheet: 1 of 2		Drawing No: 28A22 - 1	
		Rev. No:	

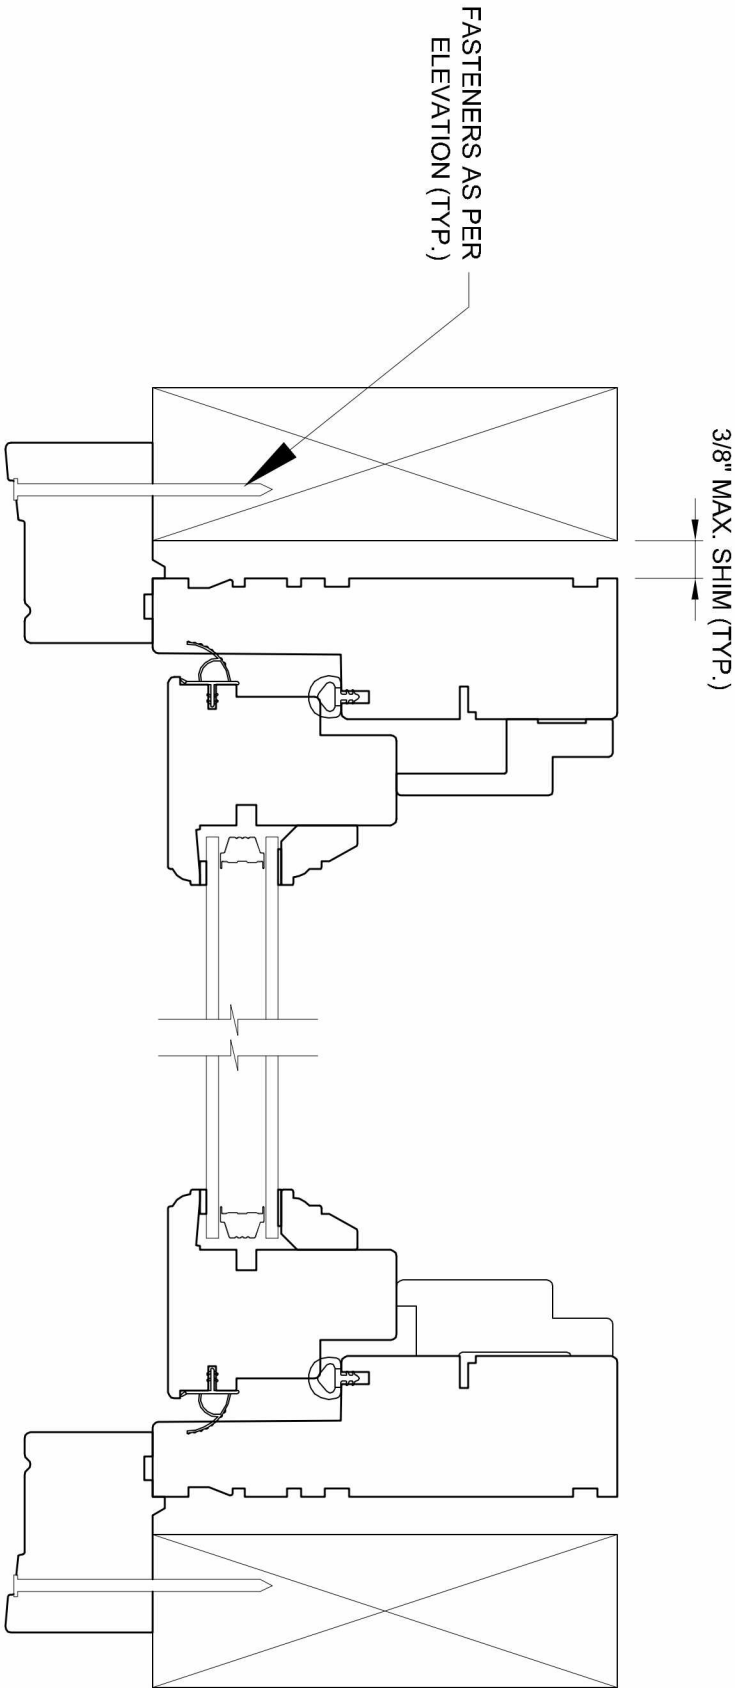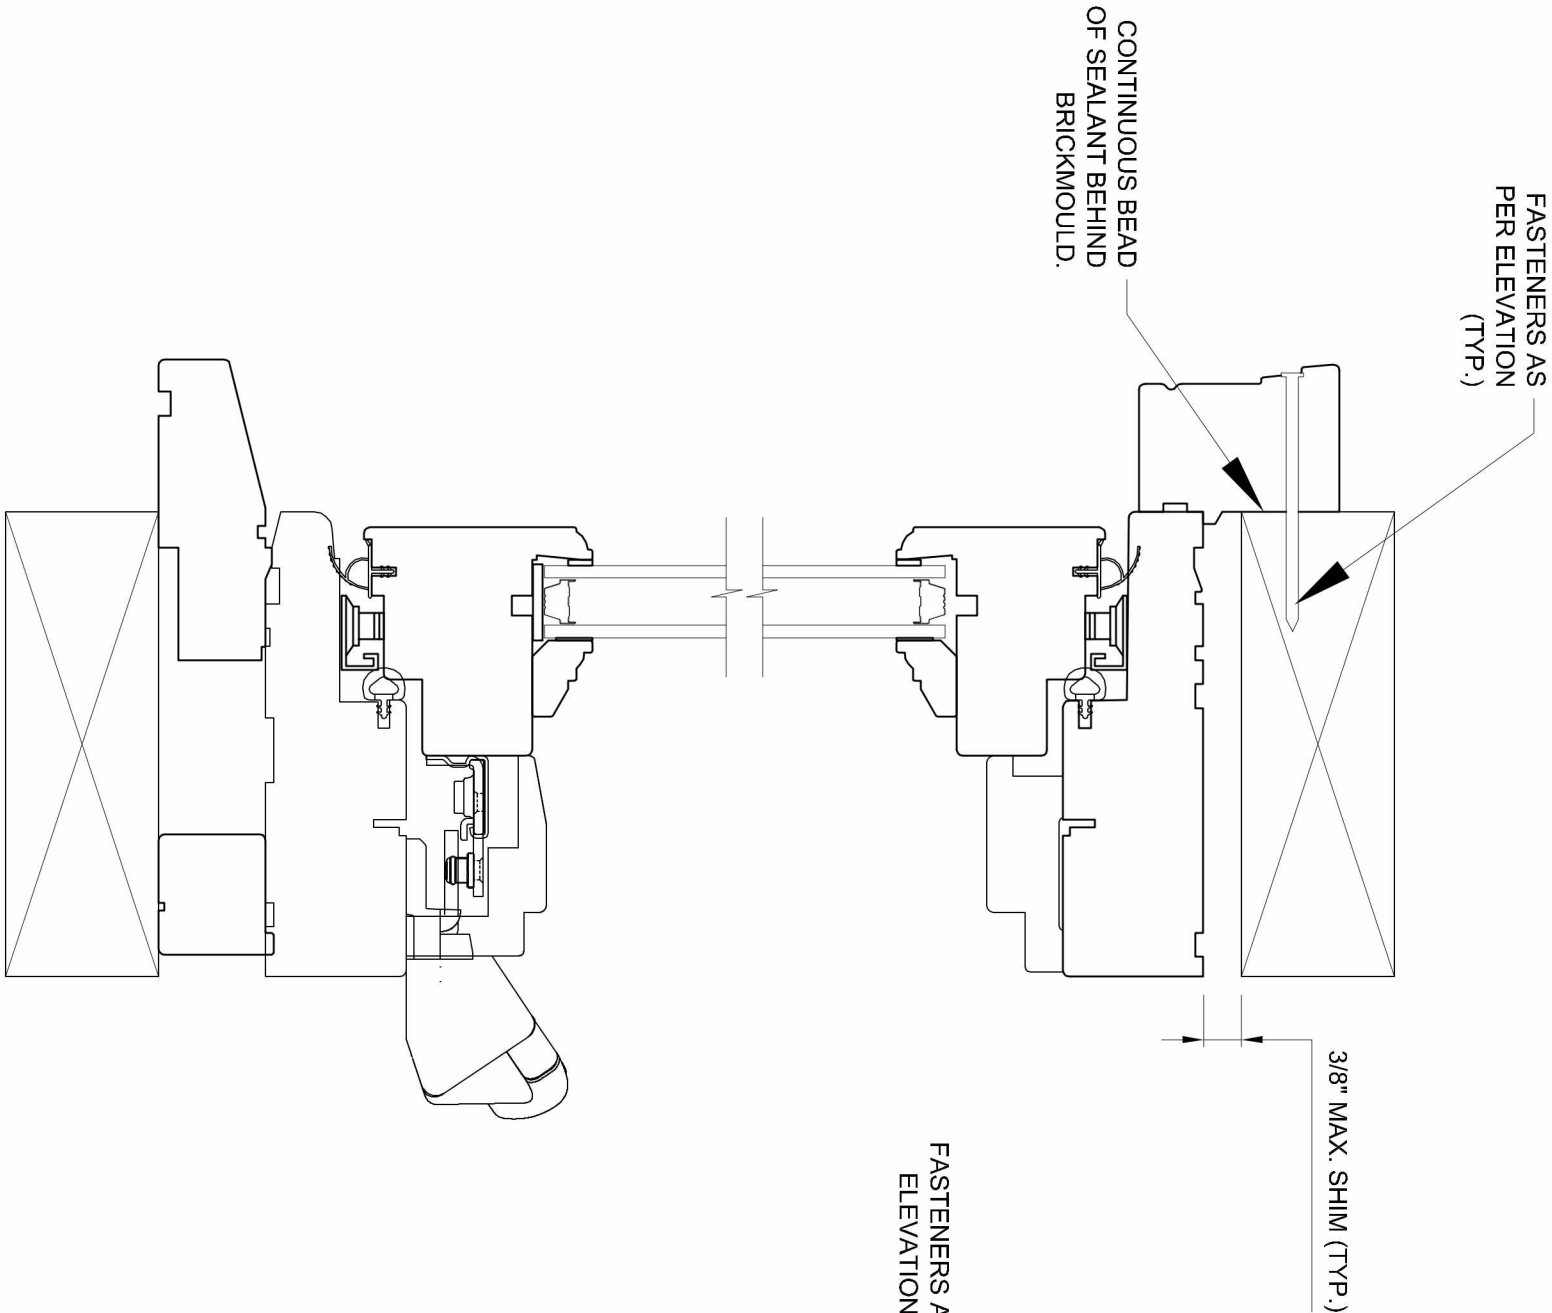

A2 HEAD AND SILL SECTION
1 SCALE 1:1

A2 JAMB SECTION
2 SCALE 1:1

	Imperial claims proprietary rights in the design and construction of the Imperial window system. It may not be reproduced for any reason without express written permission.	Units of Measurement: Imperial
Drawn by: James S.		Product Family: 28 Series - CA
Date: 10/28/2015		
Checked by: CWS		
Date: 01/22/2016		
Sheet: 2 of 2	Drawing No:	Rev. No:
	28A22 - 2	
Product Description: OVERSIZE CASEMENT - NON CLAD (NON-IMPACT)		