

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
8. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
11. FRAME MATERIAL: EXTRUDED RIGID PVC.
12. UNITS MUST BE GLAZED PER ASTM E1300-04.
13. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH f'm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .045" THICK MINIMUM


SIGNED: 02/03/2016

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS
3 - 6	INSTALLATION DETAILS


COMFORT VIEW PRODUCTS LLC. 320 COWETA INDUSTRIAL PARK NEWNAN, GA 30265		
SERIES 900 VINYL SINGLE HUNG WINDOW W/REINFORCED SASH 44" X 72" - NON-IMPACT NOTES		
DRAWN: N.G.	DWG NO. 08-02863	REV -
SCALE NTS	DATE 02/02/16	SHEET 1 OF 6



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

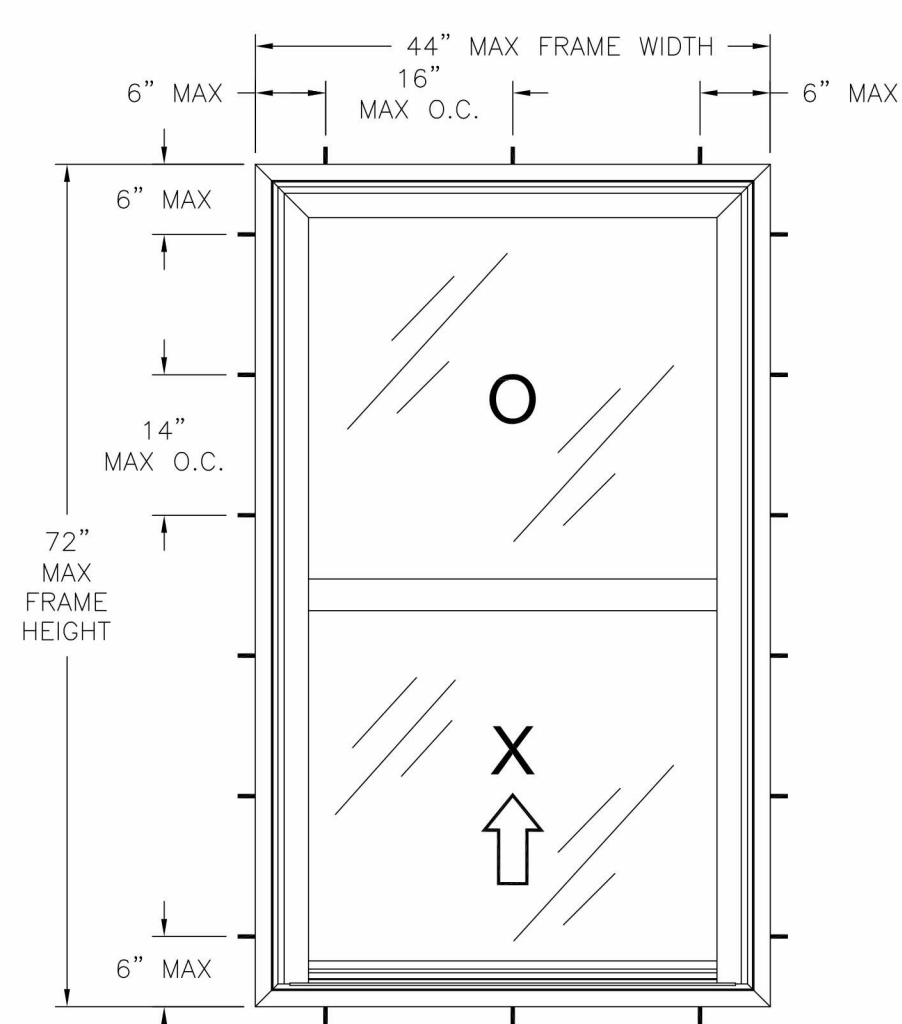

SERIES 900 VINYL SINGLE HUNG WINDOW
EXTERIOR VIEW
FRAME INSTALLATION

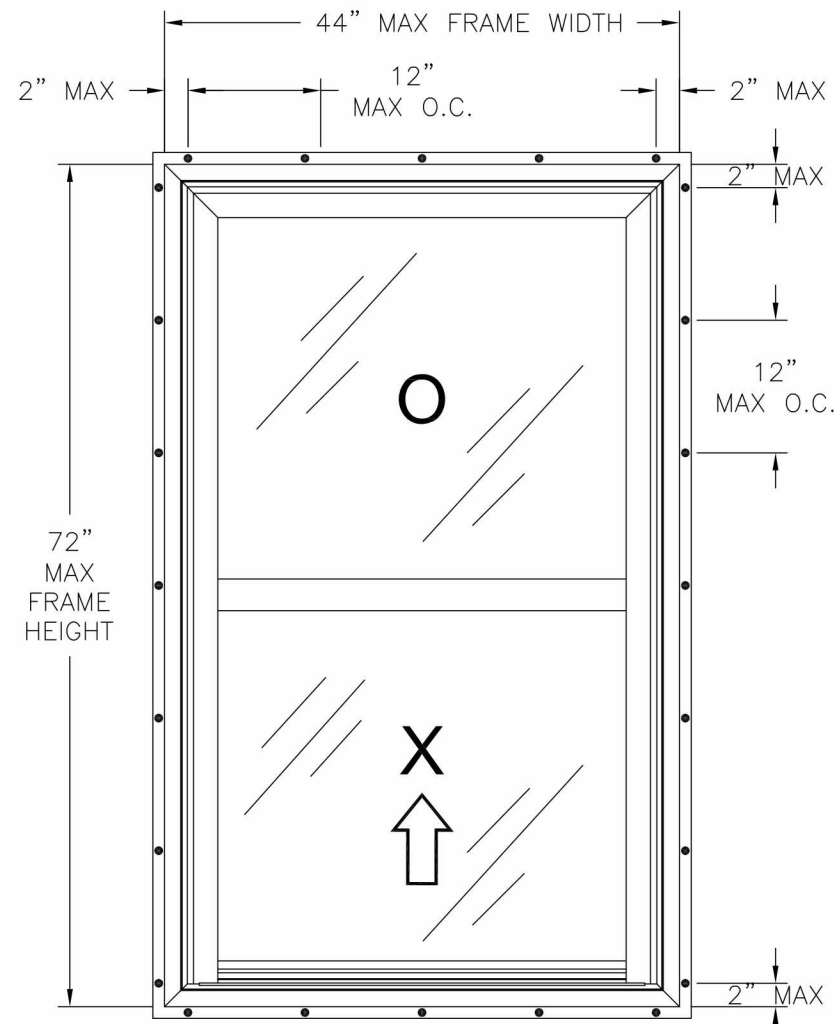

SERIES 900 VINYL SINGLE HUNG WINDOW
EXTERIOR VIEW
FIN INSTALLATION

DESIGN PRESSURE RATING	IMPACT RATING
+50.0/-60.0PSF	NONE

NOTES:

1. MAXIMUM SASH SIZE: 41 1/16" X 34 13/16"
2. MAXIMUM D.L.O.: 39 1/4" X 32 9/16"
3. (2) WEEPNOTCH 2 1/4" WIDE BY LEG HEIGHT AT EACH END OF SILL SASH RETENTION LEG.
4. (4) WEEPNOTCH 2 1/4" WIDE BY LEG HEIGHT TWO AT EACH END OF SILL SCREEN TRACK LEG
5. (2) WEEPSLOT 3/8" X 5/32" AT EACH END OF BOTTOM RAIL GLAZING POCKET
6. (2) WEEPSLOT 3/8" X 3/32" AT EACH END OF FIXED MEETING RAIL GLAZING POCKET
7. (4) WEEPSLOT 3/8" X 3/32" TWO AT EACH END OF FIXED MEETING RAIL.

HARDWARE SCHEDULE

A.	(2) COMPOSITE SWEEP LOCK AT 8" FROM EACH END AT LOCK RAIL
B.	(2) BLOCK & TACKLE BALANCE SYSTEM W/LOCKING SHOE ONE PER JAMB
C.	(2) METAL PIVOT BAR AT EACH END OF BOTTOM RAIL
D.	(2) PLASTIC FLUSH MOUNT TILT LATCH AT EACH END OF LOCK RAIL
E.	ALUMINUM REINFORCEMENT (10300269) AT FIXED MEETING RAIL
F.	ALUMINUM REINFORCEMENT (029H006) AT LOCK RAIL
G.	ALUMINUM REINFORCEMENT (A029H001) AT BOTTOM RAIL & STILES


SIGNED: 02/03/2016

COMFORT VIEW PRODUCTS LLC.
320 COWETA INDUSTRIAL PARK
NEWNAN, GA 30265


SERIES 900 VINYL SINGLE HUNG WINDOW
W/REINFORCED SASH 44" X 72" - NON-IMPACT
ELEVATION

DRAWN: N.G.	DWG NO. 08-02863	REV -
SCALE NTS	DATE 02/02/16	SHEET 2 OF 6



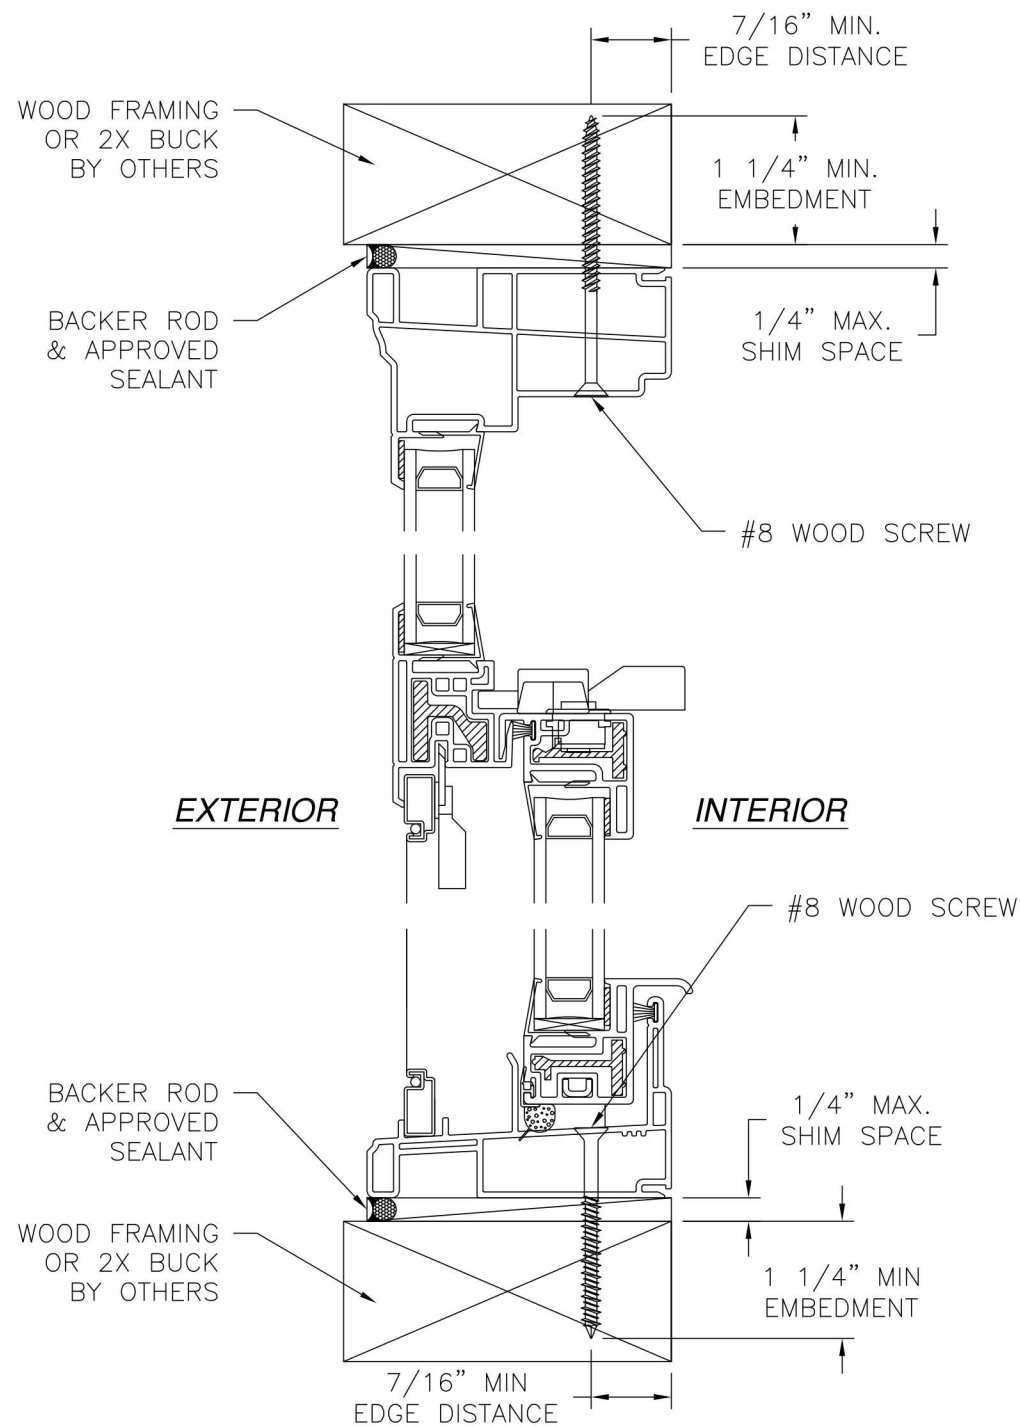

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

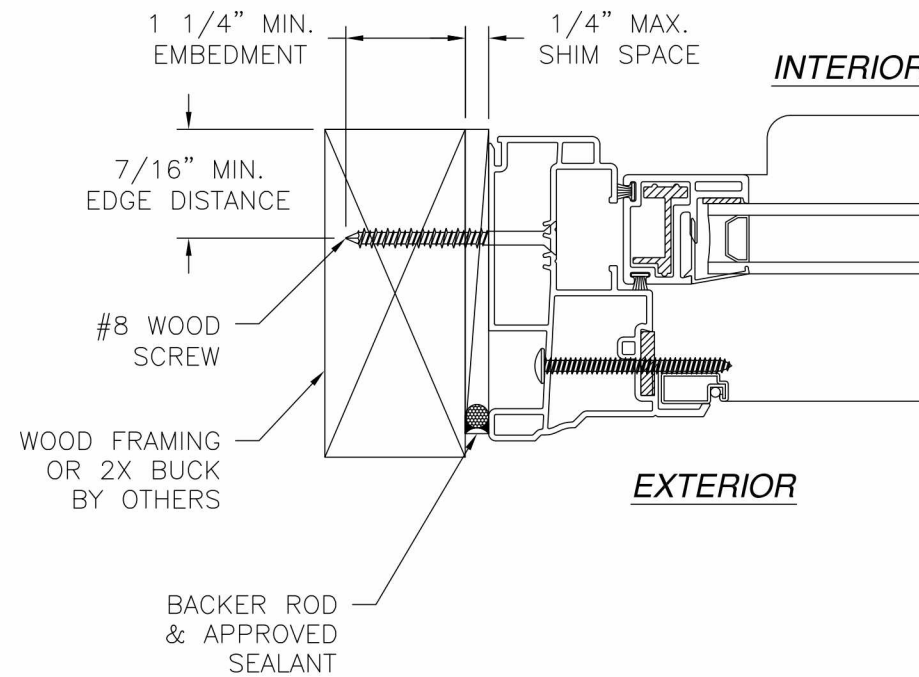

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

SIGNED: 02/03/2016




COMFORT VIEW PRODUCTS LLC.
320 COWETA INDUSTRIAL PARK
NEWNAN, GA 30265

SERIES 900 VINYL SINGLE HUNG WINDOW
W/REINFORCED SASH 44" X 72" – NON-IMPACT
INSTALLATION DETAILS


DRAWN: N.G.	DWG NO. 08-02863	REV —
SCALE NTS	DATE 02/02/16	SHEET 3 OF 6

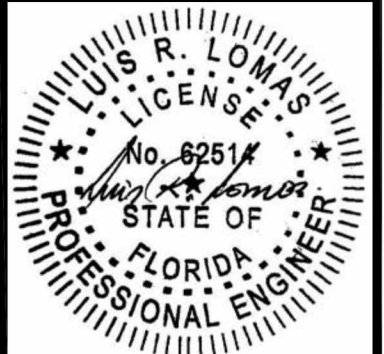

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

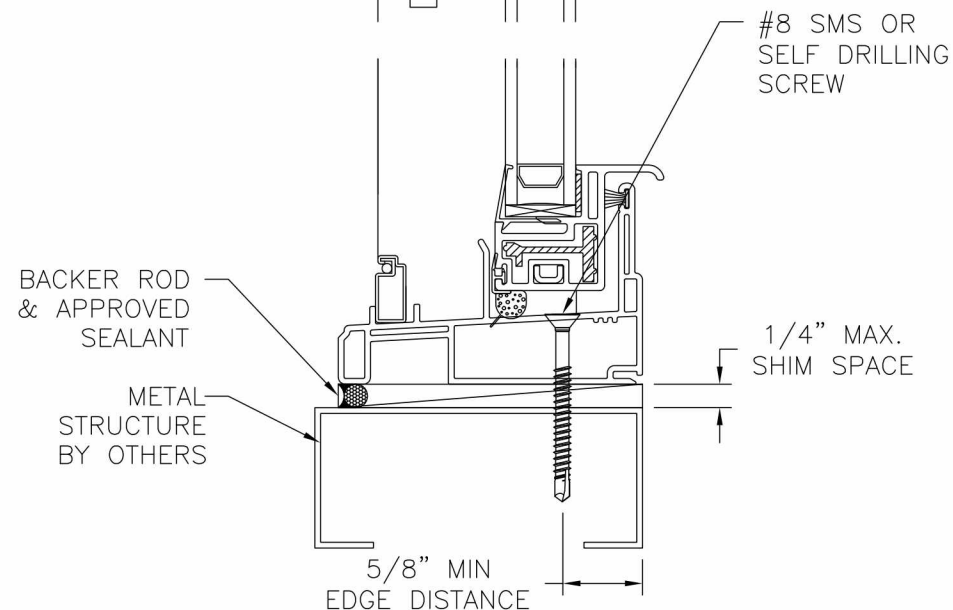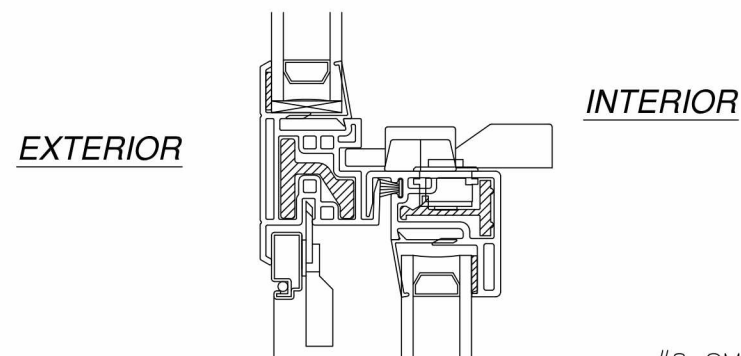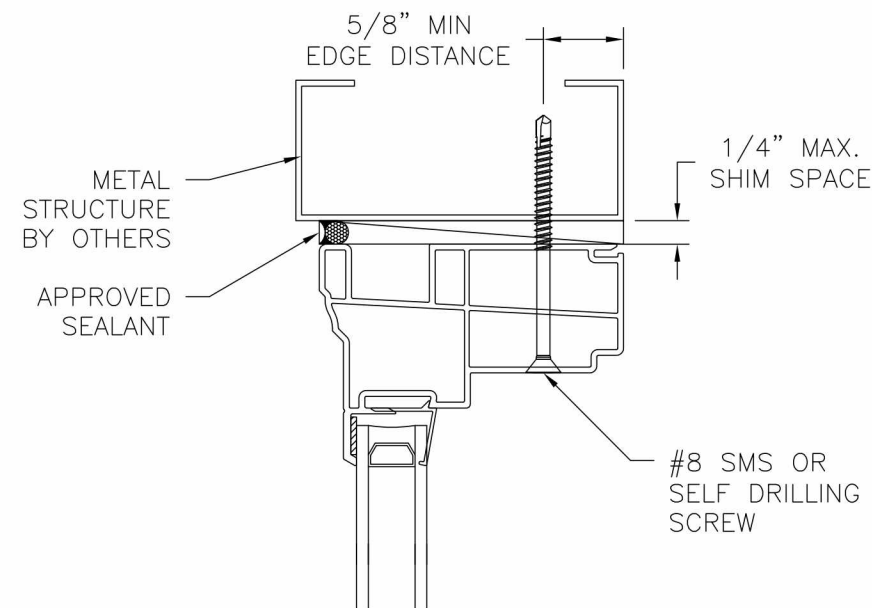

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

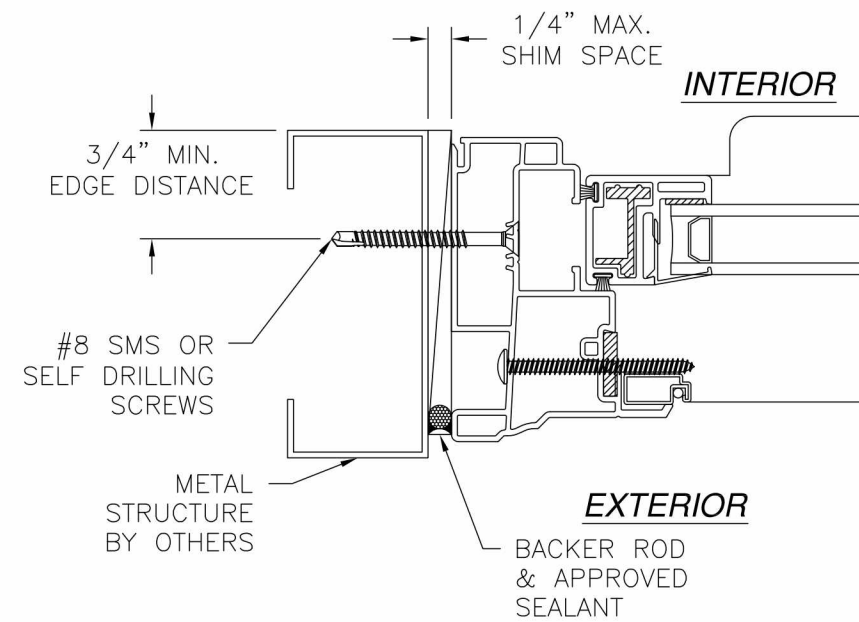

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION


NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 02/03/2016

COMFORT VIEW PRODUCTS LLC. 320 COWETA INDUSTRIAL PARK NEWNAN, GA 30265			
SERIES 900 VINYL SINGLE HUNG WINDOW W/REINFORCED SASH 44" X 72" – NON-IMPACT INSTALLATION DETAILS			
DRAWN: N.G.	DWG NO. 08-02863	REV —	
SCALE NTS	DATE 02/02/16	SHEET 4 OF 6	

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

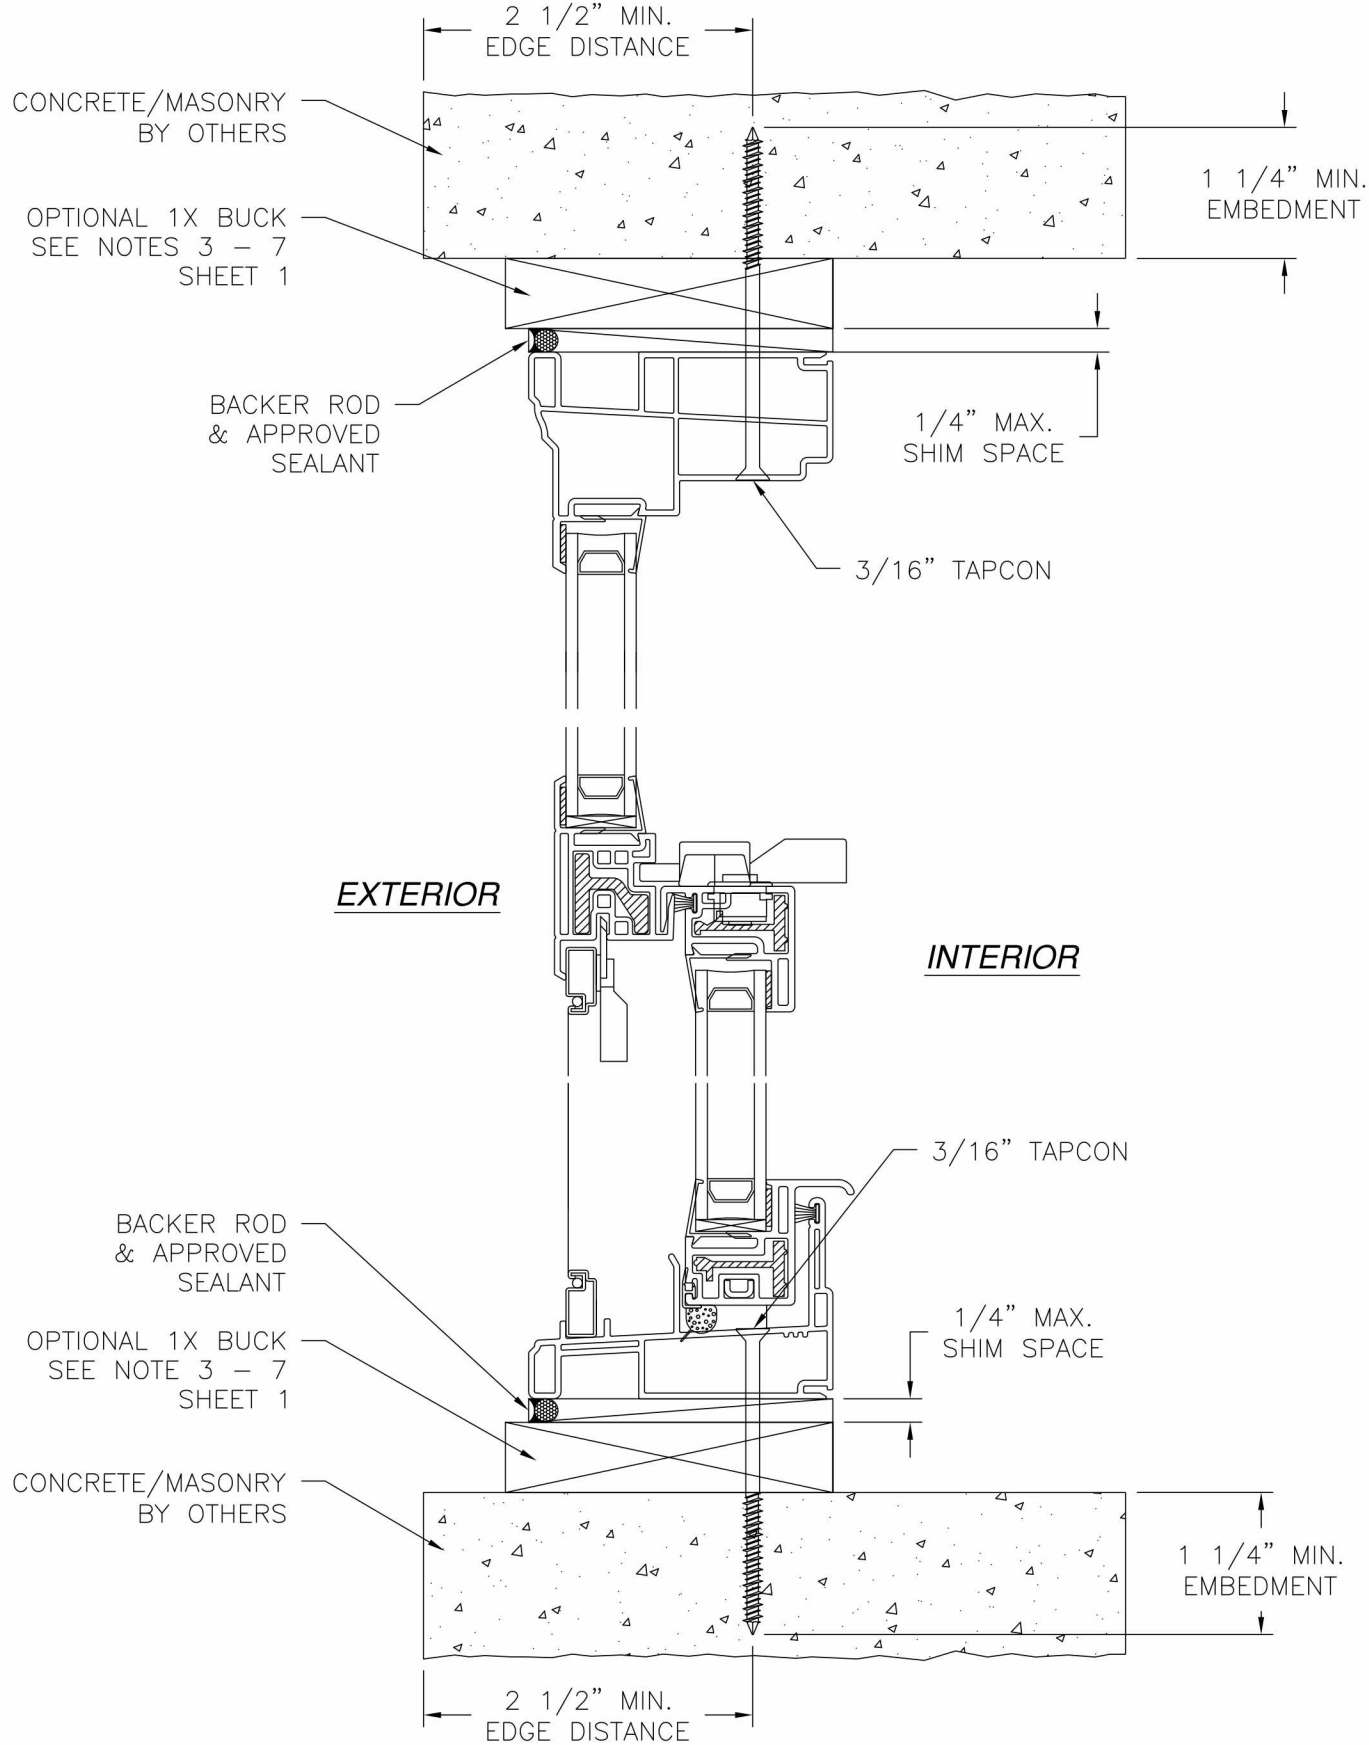

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

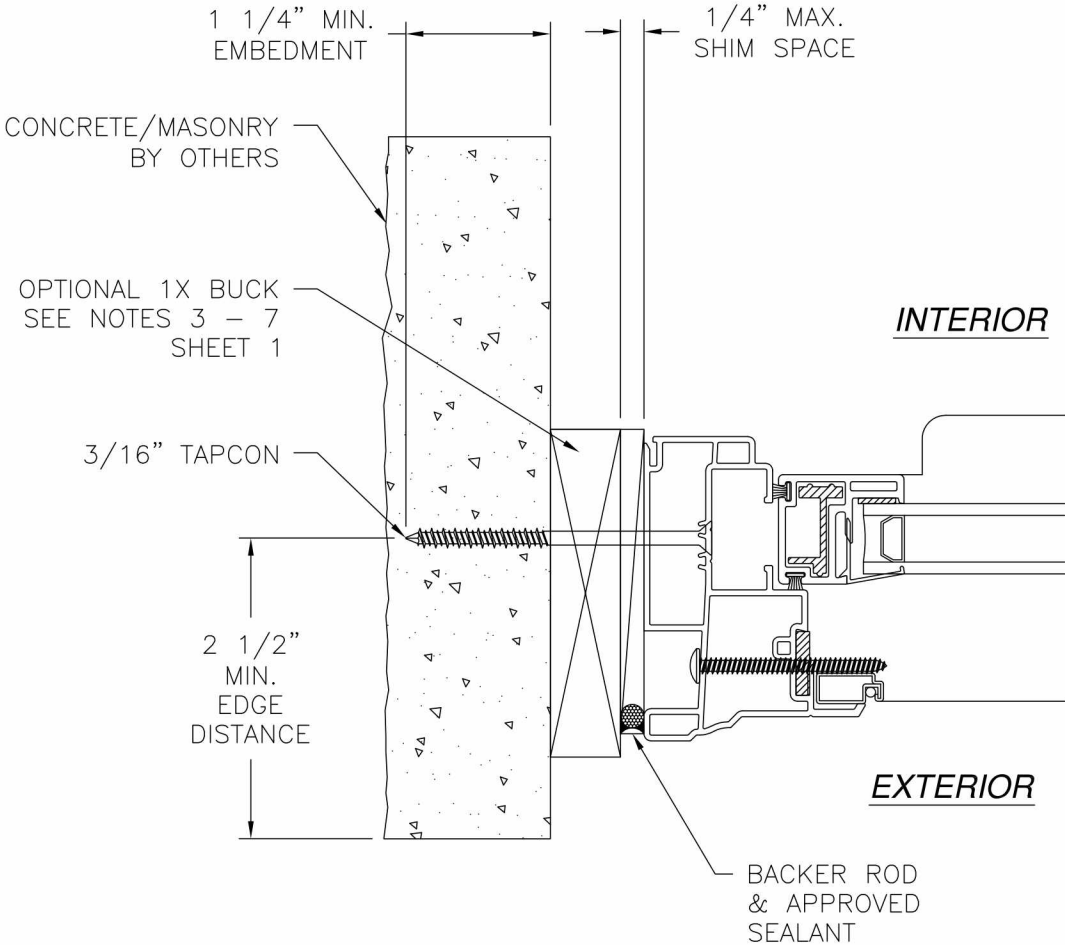




JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 02/03/2016

COMFORT VIEW PRODUCTS LLC. 320 COWETA INDUSTRIAL PARK NEWNAN, GA 30265		
SERIES 900 VINYL SINGLE HUNG WINDOW W/REINFORCED SASH 44" X 72" – NON-IMPACT INSTALLATION DETAILS		
DRAWN: N.G.	DWG NO. 08-02863	REV —
SCALE NTS	DATE 02/02/16	SHEET 5 OF 6



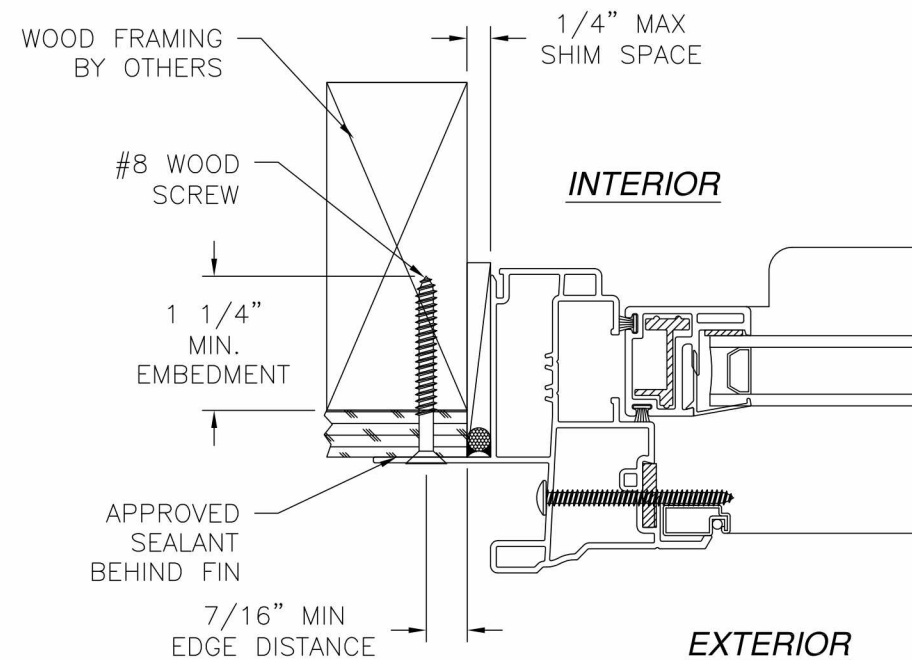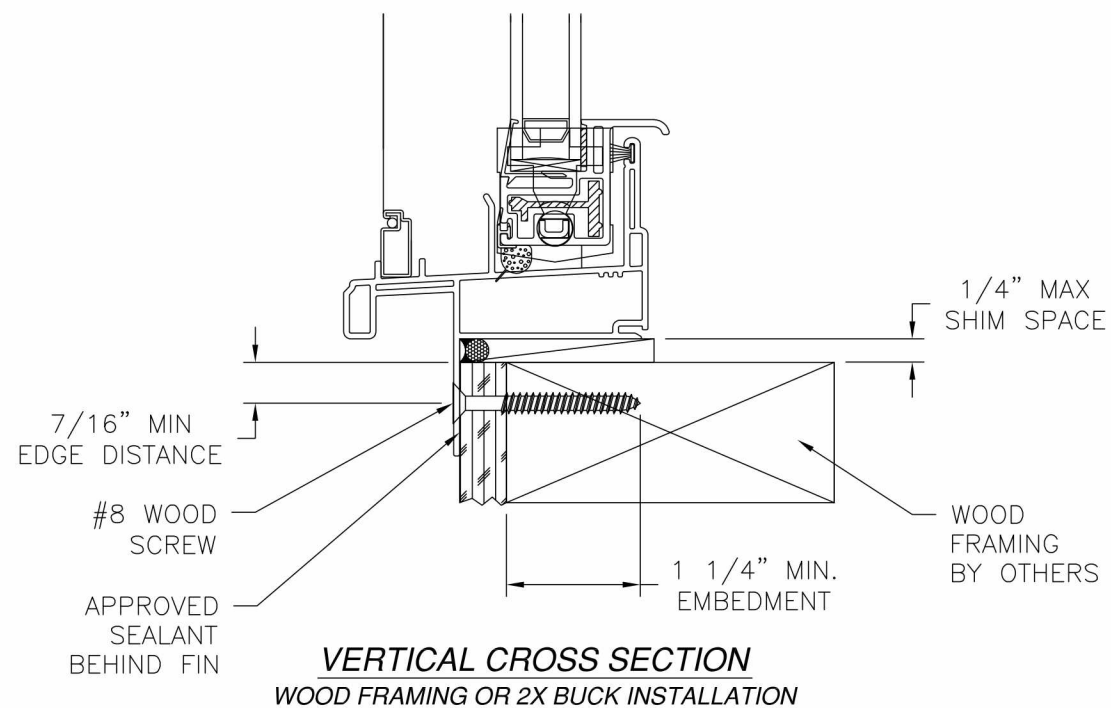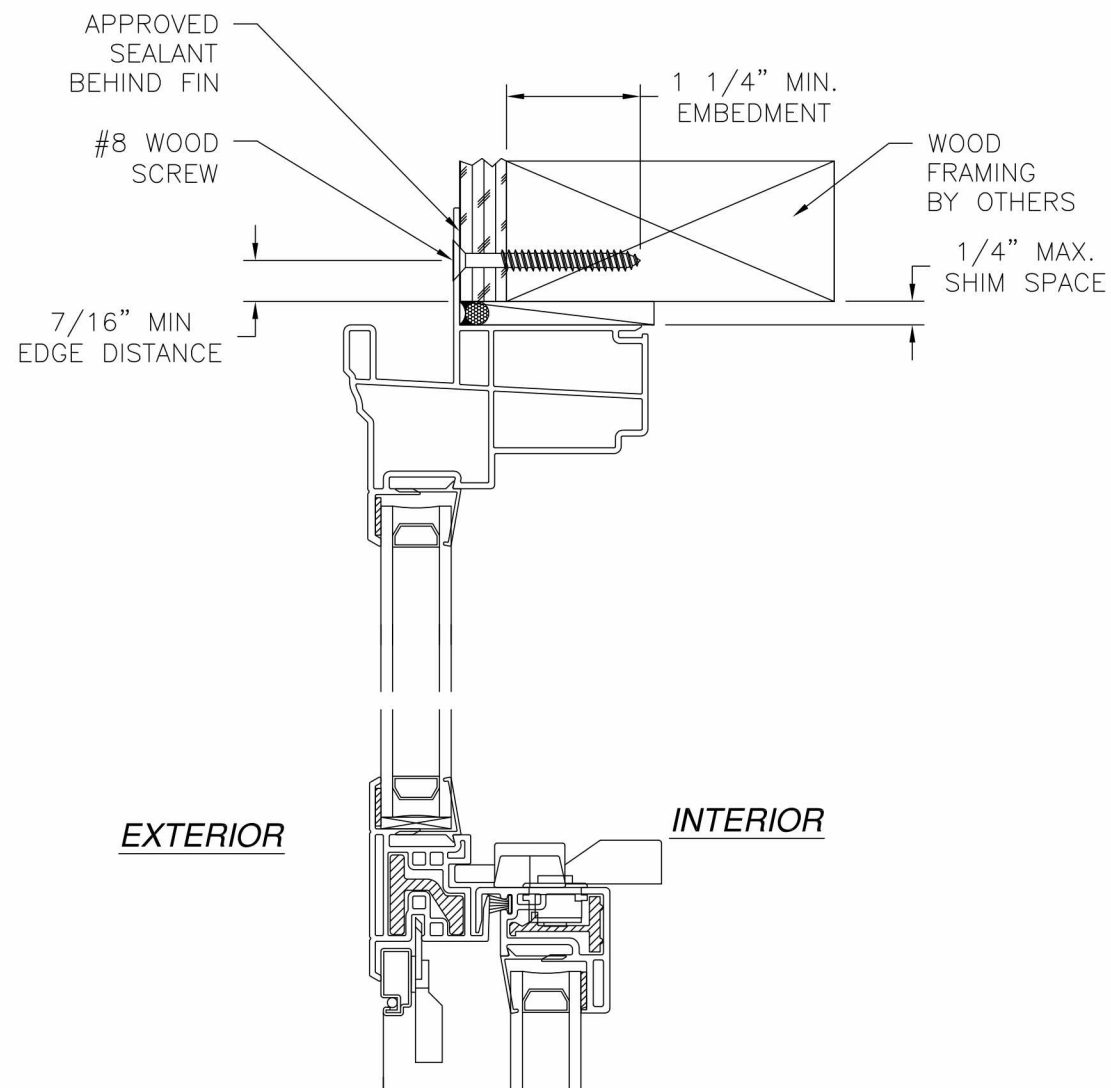

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

SIGNED: 02/03/2016

COMFORT VIEW PRODUCTS LLC.
320 COWETA INDUSTRIAL PARK
NEWNAN, GA 30265

SERIES 900 VINYL SINGLE HUNG WINDOW
W/REINFORCED SASH 44" X 72" – NON-IMPACT
INSTALLATION DETAILS

DRAWN: N.G.	DWG NO. 08-02863	REV —
SCALE NTS	DATE 02/02/16	SHEET 6 OF 6

