

NEXT DOOR COMPANY

SERIES S-6070F OUTSWING FLUSH STEEL DOOR

(HVHZ)(IMPACT)

GENERAL NOTES:

1.

THESE PRODUCTS HAVE BEEN TESTED TO HVHZ PROTOCOLS TAS 201, 202, 203-94, AND COMPLY WITH THE CURRENT FLORIDA BUILDING CODE.
2.

THE DOORS ARE LARGE AND SMALL MISSILE IMPACT RATED. SHUTTERS ARE NOT REQUIRED.

NOTES:

1.

ALL DIMENSIONS SHOWN MAX. AND TYP. FOR ALL DOOR/FRAME MODELS, UNLESS OTHER INDICATED.

2.

ANCHOR REQUIREMENTS: SEE SHEETS 5-6 & 11-13 FOR APPROVED ANCHORS AND INSTALLATION.

3.

HINGE REQUIREMENTS: 4.5" STD WT. MIN. (MIN. 3 HINGES) BUTT OR CONTINUOUS HINGE LOCATIONS: 10.25" MAX. FROM RABBET IN HEAD TO CL OF TOP HINGE 12.25" MAX. FROM FLOOR TO CL OF BOTTOM HINGE, EQUALLY SPACED IN BETWEEN.

4.

SEE SHEETS 3 & 4 FOR AVAILABLE STANDARD OPENING SIZES AND SPECIFICATIONS.

5.

HARDWARE INSTALLATION AS PER MANUFACTURER'S INSTRUCTIONS.

6.

HEAD SECTION CAN HAVE 4" FACE DIMENSIONS.

7.

APPLY CAULK AS NEEDED

8.

WOOD OR STEEL STRUCTURAL MEMBERS OF WOOD AND STEEL-STUD WALLS MUST BE DESIGNED TO CARRY THE APPROPRIATE LOAD DESIGN

9.

ELECTRIFIED AND FIRE RATED OPTIONS OF APPROVED HARDWARE ARE ACCEPTABLE. INSTALLATION AND APPLICATION IS UNDER SEPARATE APPROVAL AND IS REVIEWED BY THE CORRESPONDING AUTHORITY. FIRE RATING NOT PART OF THIS APPROVAL, CONSULT MANUFACTURER FOR APPROVED CONFIGURATIONS.

10.

OPTIONAL POWER TRANSFERS, MONITORING SWITCHES, SUPPLEMENTAL MAGNETIC LOCKS MAY BE USED AS ALLOWED BY CODE AND DOES NOT EFFECT THE MECHANICAL PROPERTIES OF HARDWARE AND OR INHIBIT EGRESS. TO BE REVIEWED BY THE BUILDING OFFICIAL.

CONSTRUCTION NOTES:

1.

DOOR CONSTRUCTION

1.1.

NOMINAL DOOR THICKNESS - 1 3/4"
2.

FRAME CONSTRUCTION

2.1.

MINIMUM JAMB DEPTH - 4 3/4", STOP HEIGHT - 5/8"
MAXIMUM JAMB DEPTH - 8 3/4"

2.2.

MINIMUM JAMB TRIM (WIDTH) - 1 1/4"
MAXIMUM JAMB TRIM (WIDTH) - 2"

2.3.

MINIMUM HEAD TRIM (WIDTH) - 1 1/4"
MAXIMUM HEAD TRIM (WIDTH) - 4"
3.

FRAME CORNER WELD: CONTINUOUS BACK WELD WITH FULL PENETRATION TO FACE SEAM. GRIND, SMOOTH, PRIME, & PAINT (PRIME & PAINT NOT REQUIRED FOR STAINLESS STEEL). WELD CLASSIFICATION - E70XX. SEE SHEET 11 FOR DETAIL.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND DESIGN PRESSURE TABLE
2	TABLE 1: DOOR CONFIG. & LOCKING HARDWARE
3	DOUBLE DOOR: OPENING DIMENSIONS & BOM
4	SINGLE DOOR: OPENING DIMENSIONS & BOM
5	DOUBLE DOOR ANCHOR LAYOUT
6	SINGLE DOOR ANCHOR LAYOUT
7	VERTICAL SECTIONS
8	VERTICAL SECTIONS
9	HORIZONTAL SECTIONS
10	HORIZONTAL SECTIONS
11	ISOMETRIC AND HORIZONTAL SECTIONS
12	INSTALLATION NOTES AND DETAILS
13	INSTALLATION DETAILS
14	COMPONENTS
15	COMPONENTS

DESIGN PRESSURE RATING		IMPACT RATING
WHERE WATER AND AIR INFILTRATION REQUIREMENTS ARE NEEDED	WHERE WATER AND AIR INFILTRATION REQUIREMENTS ARE <u>NOT</u> NEEDED	LARGE AND SMALL MISSILE IMPACT LARGE MISSILE IMPACT 50 F/S
+ 90 PSF / -90 PSF	+ 90 PSF / -90 PSF	



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)
GENERAL NOTES &
DESIGN PRESSURE TABLE


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.04.15 14:18:39 -0400'

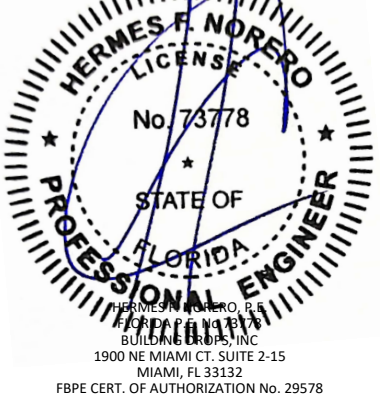

FL20078

DATE: 01.14.26

DWG. BY: DI
CHK. BY: HFN

SCALE: NTS

DWG. #: NDC002

SHEET:

1

OF 15

TABLE 1: DOOR CONFIGURATIONS AND LOCKING HARDWARE

DOOR CONFIGURATION	MAXIMUM DESIGN PRESSURE, PSF		MAXIMUM DOOR OPENING SIZE, IN		LOCKING HARDWARE DESCRIPTION					COMMENTS
	POSITIVE	NEGATIVE	WIDTH	HEIGHT	HARDWARE ACTIVE LEAF	MODEL/SERIES	BRAND	HARDWARE INACTIVE LEAF	BRAND	
1	90	90	72	84	CYLINDRICAL LOCK	ADVANTAGE E SERIES	PHILADELPHIA HARDWARE GROUP	360 SURFACE BOLT, HDSB-12-12 SURFACE BOLT OR F9700 SURFACE VERTICAL ROD EXIT DEVICE	IVES / PHILADELPHIA HARDWARE GROUP	FUNCTIONS WITH 1/2" MIN. THROW LATCH
						ADVANTAGE F SERIES	PHILADELPHIA HARDWARE GROUP			
2	90	90	72	84	MORTISE LOCK WITH DEADBOLT	L/LV9400 SERIES	SCHLAGE	360 SURFACE BOLT OR HDSB-12-12 SURFACE BOLT	IVES / PHILADELPHIA HARDWARE GROUP	FUNCTIONS WITH DEADBOLT 3/4" MIN. THROW LATCH & 1" MIN. THROW DEADBOLT
						ADVANTAGE M SERIES	PHILADELPHIA HARDWARE GROUP			
3	90	90	72	84	RIM EXIT DEVICE	XP98, XP99, XP98-F, XP99-F	VON DUPRIN	-	-	FOR PAIRS USE 9000 MULLION BY PHILADELPHIA HARDWARE GROUP OR HH9954 MULLION BY VON DUPRIN
						F9500 SERIES	PHILADELPHIA HARDWARE GROUP			
4	90	90	72	84	SURFACE VERTICAL ROD EXIT DEVICE	WS98/9927(F)	VON DUPRIN	-	-	
						F9700 SERIES	PHILADELPHIA HARDWARE GROUP			



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)

TABLE 1: DOOR CONFIGS.
& LOCKING HARDWARE

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

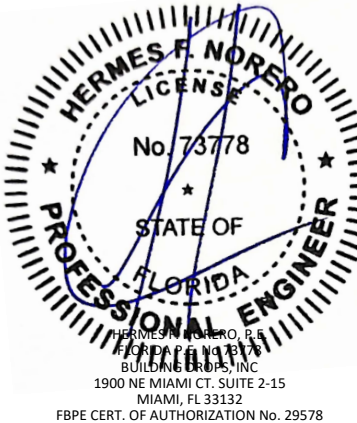

FL20078

DATE: 01.14.26

DWG. BY: DI

CHK. BY: HFN

SCALE: NTS

DWG. #: NDC002

SHEET:

2

OF 15

TITLE: SERIES S-6070F OUTSWING
 FLUSH STEEL DOOR
 (HVHZ)(IMPACT)

DOUBLE DOOR: OPENING DIMENSIONS
 & BOM

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
 MIAMI, FL 33132
 PH: (954) 399-8478
 FAX: (954) 744-4738
 WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL20078

DATE: 01.14.26

DWG. BY: DI

CHK. BY: HFN

SCALE: NTS

DWG. #: NDC002


SHEET:

3

OF 15

TABLE 2: (FOR SINGLE DOOR CONFIGURATION SEE TABLE 3 SHT. 4)

ITEM	QUANTITY	DESCRIPTION	MATERIAL	SIZE
1	1	FRAME HEAD/JAMB (4-3/4" X 1-1/4")	.053" MIN. STL OR STAINLESS STL	MAX. 88"
1A	1	FRAME HEAD/JAMB (5-3/4" X 2")		
1B	1	FRAME HEAD/JAMB (8-3/4" X 4")		
1C	1	FRAME HEAD/JAMB (4-3/4" X 2")		
2	2	FRAME JAMB (8-3/4" X 2")	.053" MIN. STL OR STAINLESS STL	MAX. 88" HEIGHT
3A	1	PHG T500	.115" MIN. ALUM	MAX. 72"
3B	1	ZERO 65A	.125" MIN. ALUM	MAX. 72"
4	AS NEEDED	BOLT SPACER (1-1/4" FRAME)	.042" MIN. STL OR STAINLESS STL	-
4A	AS NEEDED	BOLT SPACER (2" FRAME)		
5	AS NEEDED	HAT STIFFENERS IN PAIRS	.026" MIN. STL OR STAINLESS STL	-
6	-	DOOR PANEL	.053" MIN. STL OR .048" STAINLESS STL	-
7	4	TOP AND BOTTOM RAIL CHANNEL (FULL LENGTH)	.067" MIN. STL OR STAINLESS STL	.875" X 1.65625" X .875"
8	2	TOP RAIL CAP (FULL LENGTH)	.053" MIN. STL OR STAINLESS STL	.75" X 1.50" X .75"
CORE MATERIAL				
9	-	POLYSTYRENE	EPS	-
9A	-	THERMAL INSULATION W/ STEEL STIFFENERS	-	-
10	-	-	-	-
11	2	FLAT BAR ASTRAGAL	.093" MIN. STL OR STAINLESS STL	MAX. 84" HEIGHT
WEATHERSTRIPPING				
12A	AS NEEDED	PHG W416	VINYL	MAX. 84"
12B		ZERO 9188	VINYL	MAX. 84"
12C		ZERO 188S	-	MAX. 84"
12D		PHG W412	-	-
12E		ZERO 9003V	-	-
12F		ZERO 475 ADJUSTABLE SEAL	-	-
12G		PHG DBS311 OVERHEAD RAIN DRIP	ALUMINUM	-
12H		ZERO 142	ALUMINUM	-
12I		PHG DBS313 DOOR BOTTOM SWEEP	-	-
12J		ZERO 9097V	-	-
12K		PHG DBS319 DOOR SHOE	-	-
12L		ZERO 253	-	-
13A	NOTE 3, SHT. 1	MIN. 4.5" BUTT HINGES	.134" MIN. STL	-
13B		OPTIONAL CONTINUOUS HINGE	.075" MIN. STL / .110 ALUM.	MAX. 84"
14	AS NEEDED	HINGE REINFORCEMENT (FRAME/DOOR)	.167" MIN. STL OR STAINLESS STL	1.25" X 10"
MULLION HARDWARE				
15A	AS NEEDED	PHG 9000 SERIES	.1875" MIN. A500 STL	MAX. 84"
15B		VON DUPRIN HH9954 SERIES	.312" MIN. A500 STL	MAX. 84"
17	4	LOCK/STRIKE REINFORCEMENT	.114" MIN. STL OR STAINLESS STEEL	1.50" X 3"
18	2	BOTTOM CAP CHANNEL	.053" MIN. STL OR STAINLESS STL	0.50" X 1.50" X 0.50"
19	2	LOCK STILE REINFORCEMENT CHANNEL (FULL LENGTH)	.097" MIN. STL OR STAINLESS STL	0.99" X 1.44" X 0.99"
20	2	LOCK STILE REINFORCEMENT CHANNEL	.097" MIN. STL OR STAINLESS STL	0.977" X 1.156" X 0.977" FULL LENGTH FOR INACTIVE CUT OUT FOR LOCK FOR ACTIVE
21	2	LOCK STILE REINFORCEMENT TUBE/CHANNEL	.093" MIN. STL OR STAINLESS STL	1.50" X 5.625" X 1.50" 17.75" MIN. LENGTH
22	2	EDGE REINFORCEMENT	.067" MIN. STL OR STAINLESS STL	-
23	2	IVES SB360 SURFACE BOLT	STL	12" MIN. - 24" MAX. LENGTH
24	2	PHG HDSB-12-12 SURFACE BOLT	STL	12" MIN. - 24" MAX. LENGTH
25	AS NEEDED	LOCKING HARDWARE - SEE SHEET 2		

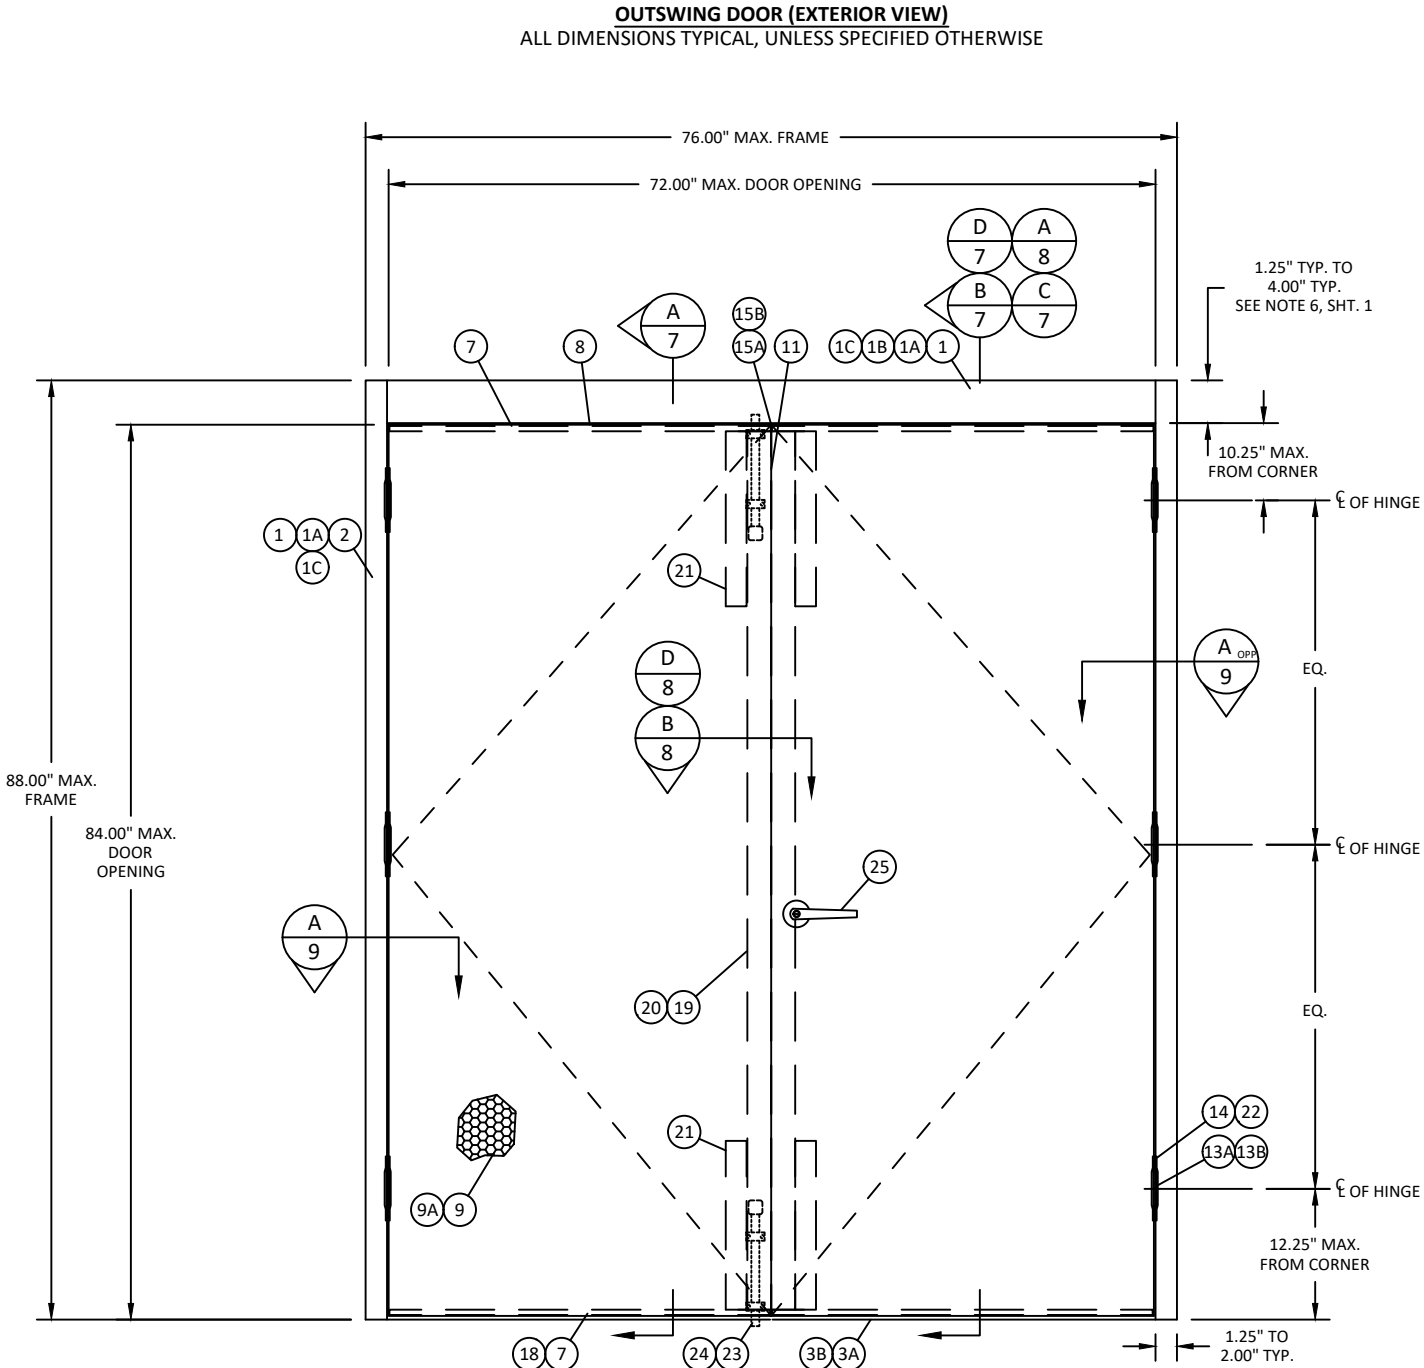



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)
SINGLE DOOR: OPENING DIMENSIONS
& BOM

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL20078

DATE: 01.14.26

DWG. BY: DI

CHK. BY: HFN

SCALE: NTS

DWG. #: NDC002


SHEET:

4

OF 15

TABLE 3: (FOR DOUBLE DOOR CONFIGURATION SEE TABLE 2 SHT. 3)

ITEM	QUANTITY	DESCRIPTION	MATERIAL	SIZE
1	1	FRAME HEAD/JAMB (4-3/4" X 1-1/4")	.053" MIN. STL OR STAINLESS STL	MAX. 88"
1A	1	FRAME HEAD/JAMB (5-3/4" X 2")		
1B	1	FRAME HEAD/JAMB (8-3/4" X 4")		
1C	1	FRAME HEAD/JAMB (4-3/4" X 2")		
2	2	FRAME JAMB (8-3/4" X 2")	.053" MIN. STL OR STAINLESS STL	MAX. 88" HEIGHT
3A	1	PHG T500	.115" MIN. ALUM	MAX. 84"
3B	1	ZERO 65A	.125" MIN. ALUM	MAX. 84"
4	AS NEEDED	BOLT SPACER (1-1/4" FRAME)	.042" MIN. STL OR STAINLESS STL	-
4A	AS NEEDED	BOLT SPACER (2" FRAME)		
5	AS NEEDED	HAT STIFFENERS IN PAIRS	.026" MIN. STL OR STAINLESS STL	-
6	-	DOOR PANEL	.053" MIN. STL OR .048"STAINLESS STL	-
7	2	TOP AND BOTTOM RAIL CHANNEL (FULL LENGTH)	.067" MIN. STL OR STAINLESS STL	.875" X 1.65625" X .875"
8	1	TOP RAIL CAP (FULL LENGTH)	.053" MIN. STL OR STAINLESS STL	.75" X 1.50" X .75"
CORE MATERIAL				
9	-	POLYSTYRENE	EPS	-
9A	-	THERMAL INSULATION W/ STEEL STIFFENERS	-	-
10	-	-	-	-
11	-	-	-	-
WEATHERSTRIPPING				
12A	AS NEEDED	PHG W416	VINYL	MAX. 84"
12B		ZERO 9188	VINYL	MAX. 84"
12C		ZERO 1885	-	MAX. 84"
12D		PHG W412	-	-
12E		ZERO 9003V	-	-
12F		ZERO 475 ADJUSTABLE SEAL	-	-
12G		PHG DBS311 OVERHEAD RAIN DRIP	ALUMINUM	-
12H		ZERO 142	ALUMINUM	-
12I		PHG DBS313 DOOR BOTTOM SWEEP	-	-
12J		ZERO 9097V	-	-
12K		PHG DBS319 DOOR SHOE	-	-
12L		ZERO 253	-	-
13A	NOTE 3, SHT. 1	MIN. 4.5" BUTT HINGES	.134" MIN. STL	-
13B		OPTIONAL CONTINUOUS HINGE	.075" MIN. STL / .110 ALUM.	MAX. 84"
14	AS NEEDED	HINGE REINFORCEMENT (FRAME/DOOR)	.167" MIN. STL OR STAINLESS STL	1.25" X 10"
MULLION HARDWARE				
15A	-	-	-	-
15B		-	-	-
17	2	LOCK/STRIKE REINFORCEMENT	.114" MIN. STL OR STAINLESS STEEL	1.50" X 3"
18	2	BOTTOM CAP CHANNEL	.053" MIN. STL OR STAINLESS STL	0.50" X 1.50" X 0.50"
19	2	LOCK STILE REINFORCEMENT CHANNEL (FULL LENGTH)	.097" MIN. STL OR STAINLESS STL	0.99" X 1.44" X 0.99"
20	2	LOCK STILE REINFORCEMENT CHANNEL	.097" MIN. STL OR STAINLESS STL	0.977" X 1.156" X 0.977" FULL LENGTH FOR INACTIVE CUT OUT FOR LOCK FOR ACTIVE
21	2	LOCK STILE REINFORCEMENT TUBE/CHANNEL	.093" MIN. STL OR STAINLESS STL	1.50" X 5.625" X 1.50" 17.75" MIN. LENGTH
22	2	EDGE REINFORCEMENT	.067" MIN. STL OR STAINLESS STL	-
23	-	-	-	-
24	-	-	-	-
25	AS NEEDED	LOCKING HARDWARE - SEE SHEET 2		

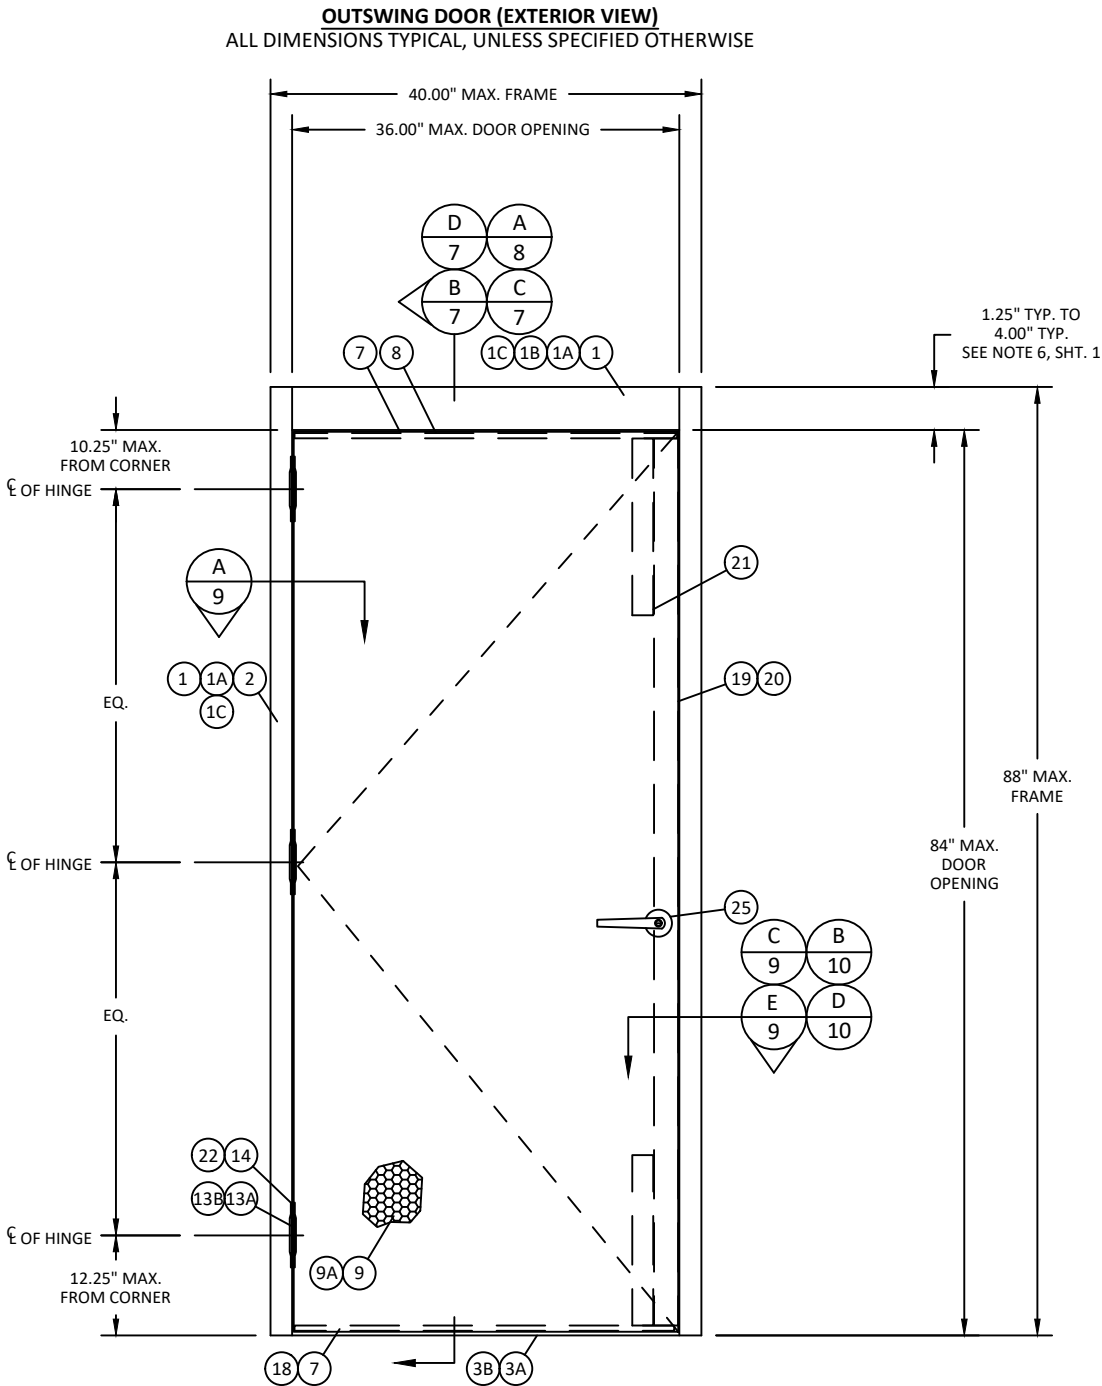



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)
DOUBLE DOOR
ANCHOR LAYOUT

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL20078

DATE: 01.14.26

DWG. BY: DI

CHK. BY: HFN


SCALE: NTS

DWG. #: NDC002

SHEET:

5

OF 15

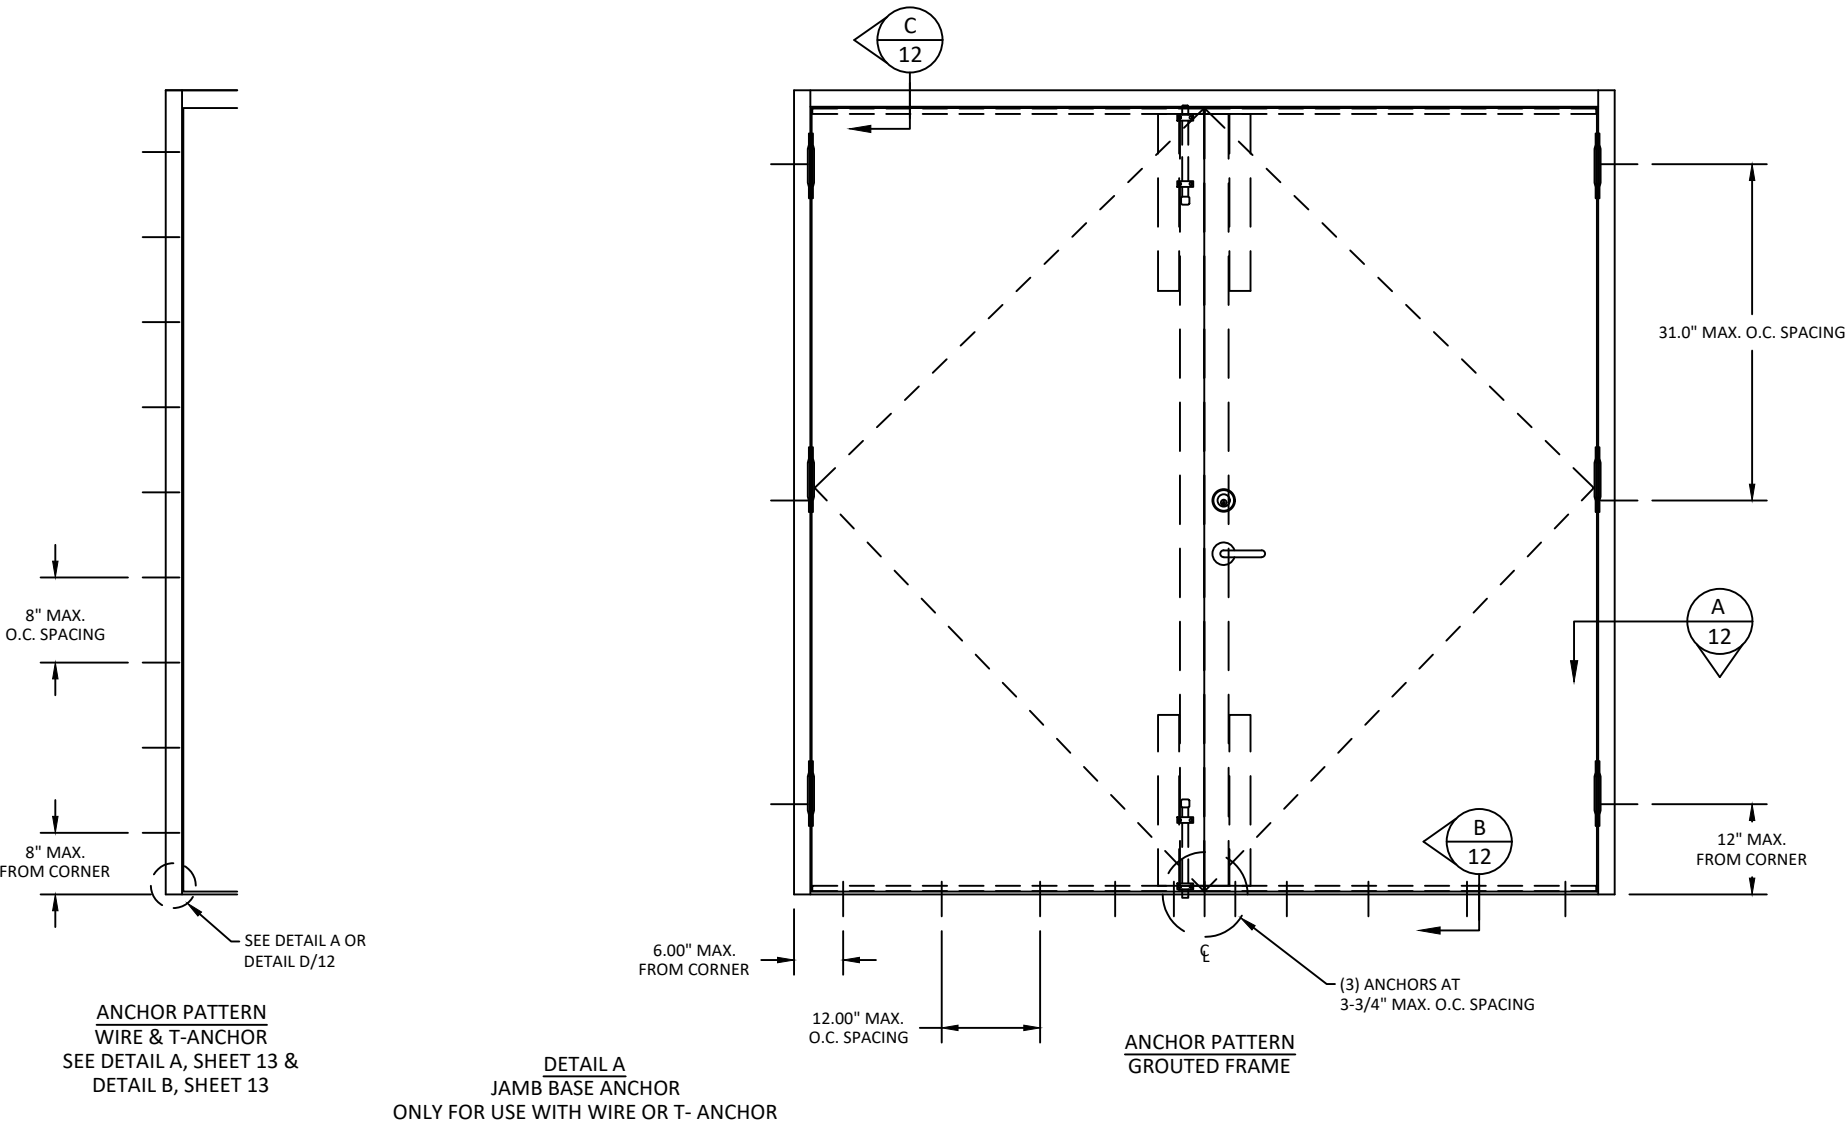

ANCHOR PATTERN
WIRE & T-ANCHOR
SEE DETAIL A, SHEET 13 &
DETAIL B, SHEET 13

DETAIL A
JAMB BASE ANCHOR
ONLY FOR USE WITH WIRE OR T- ANCHOR

ANCHOR PATTERN
GROUTED FRAME

SUB CHANNEL
18 GA. STEEL

JAMB BASE ANCHOR INTO
CONCRETE (3 KSI MIN.)
Ø0.1875" WITH 1.5"
MIN. EMBEDMENT
ITW TAPCONS OR #12
WOOD SCREWS INTO (2) 2X
WOOD SILL (SG=0.55)

WELDED TO SUBCHANNEL

3" MIN

JAMB BASE ANCHOR INTO
CONCRETE (3 KSI MIN.)
Ø0.1875" WITH 1.5"
MIN. EMBEDMENT
ITW TAPCONS OR #12
WOOD SCREWS INTO (2) 2X
WOOD SILL (SG=0.55)

WELDED TO FRAME

3" MIN



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)
SINGLE DOOR
ANCHOR LAYOUT

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL20078



DATE:	01.14.26
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	NDC002
SHEET:	6

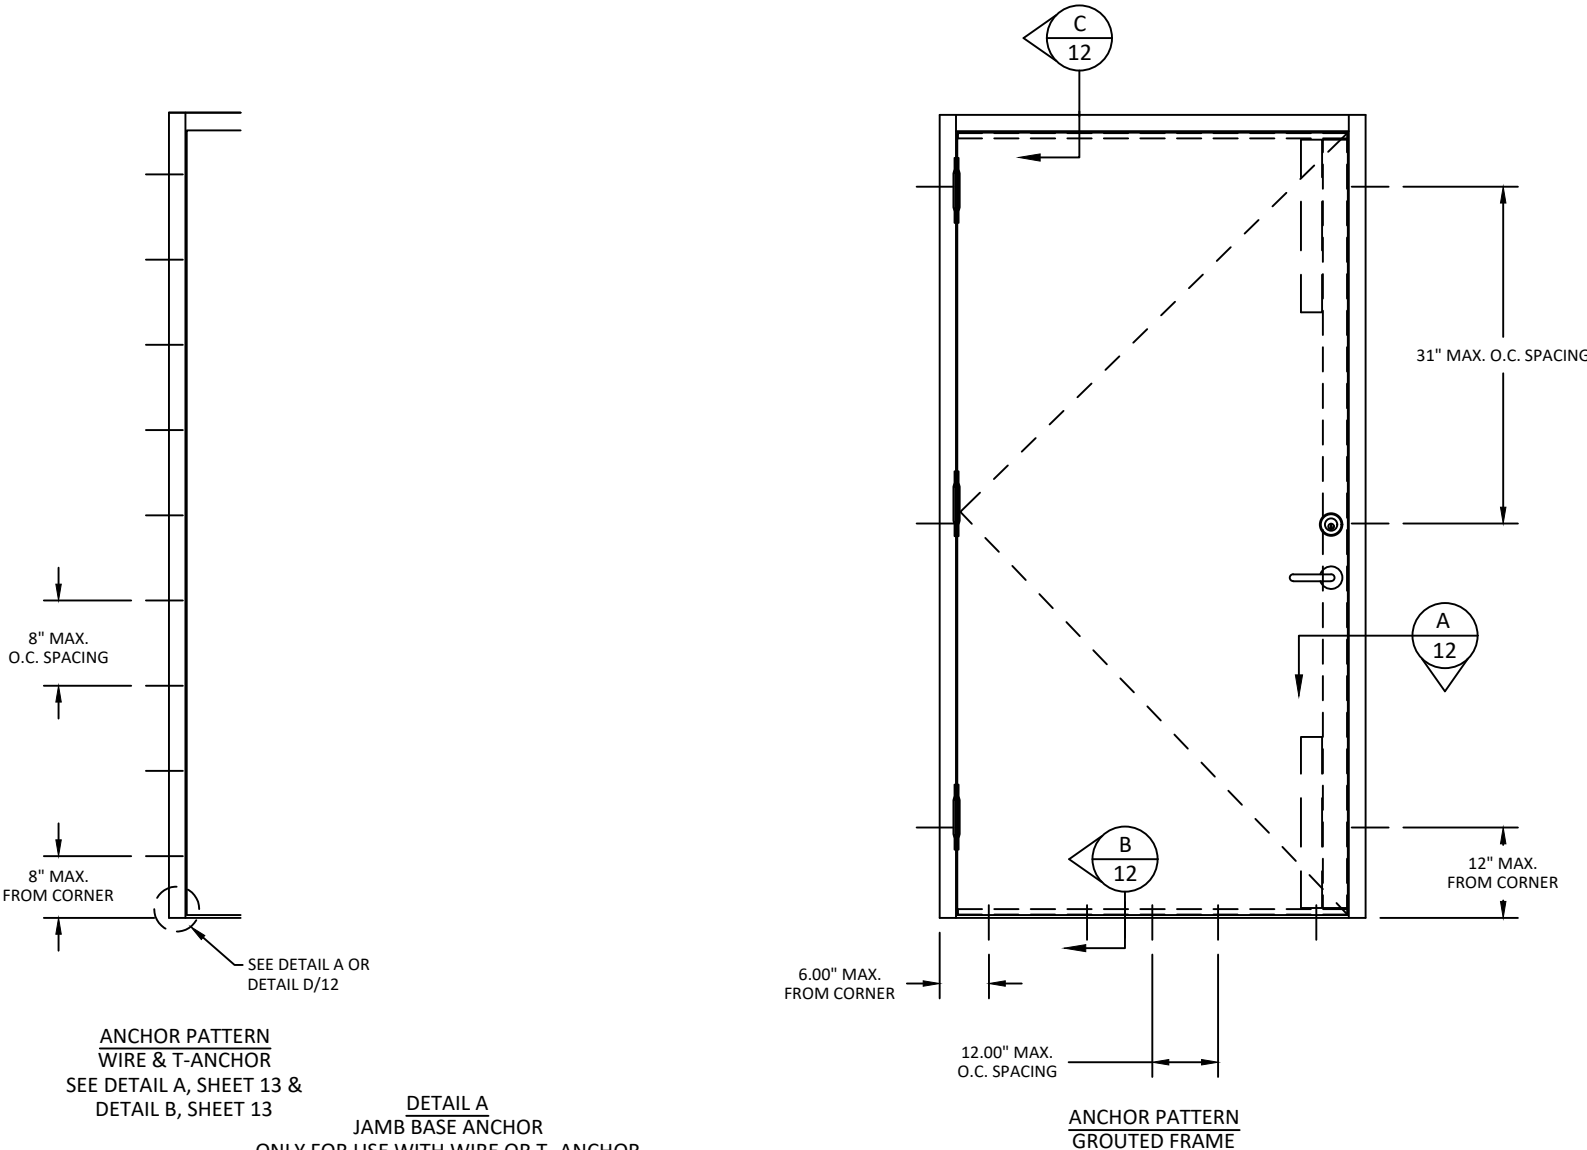


ANCHOR PATTERN
WIRE & T-ANCHOR
SEE DETAIL A, SHEET 13 &
DETAIL B, SHEET 13

DETAIL A
JAMB BASE ANCHOR
ONLY FOR USE WITH WIRE OR T- ANCHOR

ANCHOR PATTERN
GROUTED FRAME

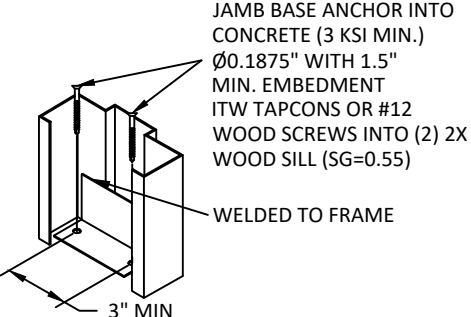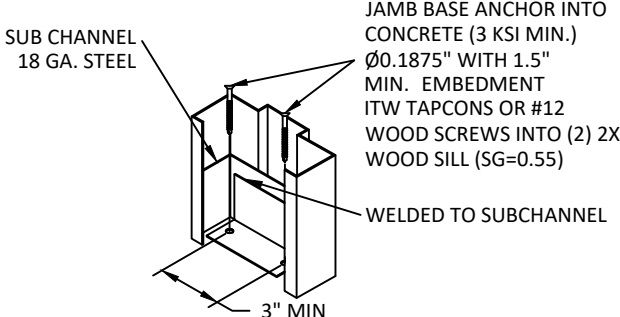

NOTE: 4.75" X 1.25" HEAD
FRAME SHOWN, ALL FRAME
HEADS QUALIFIED.

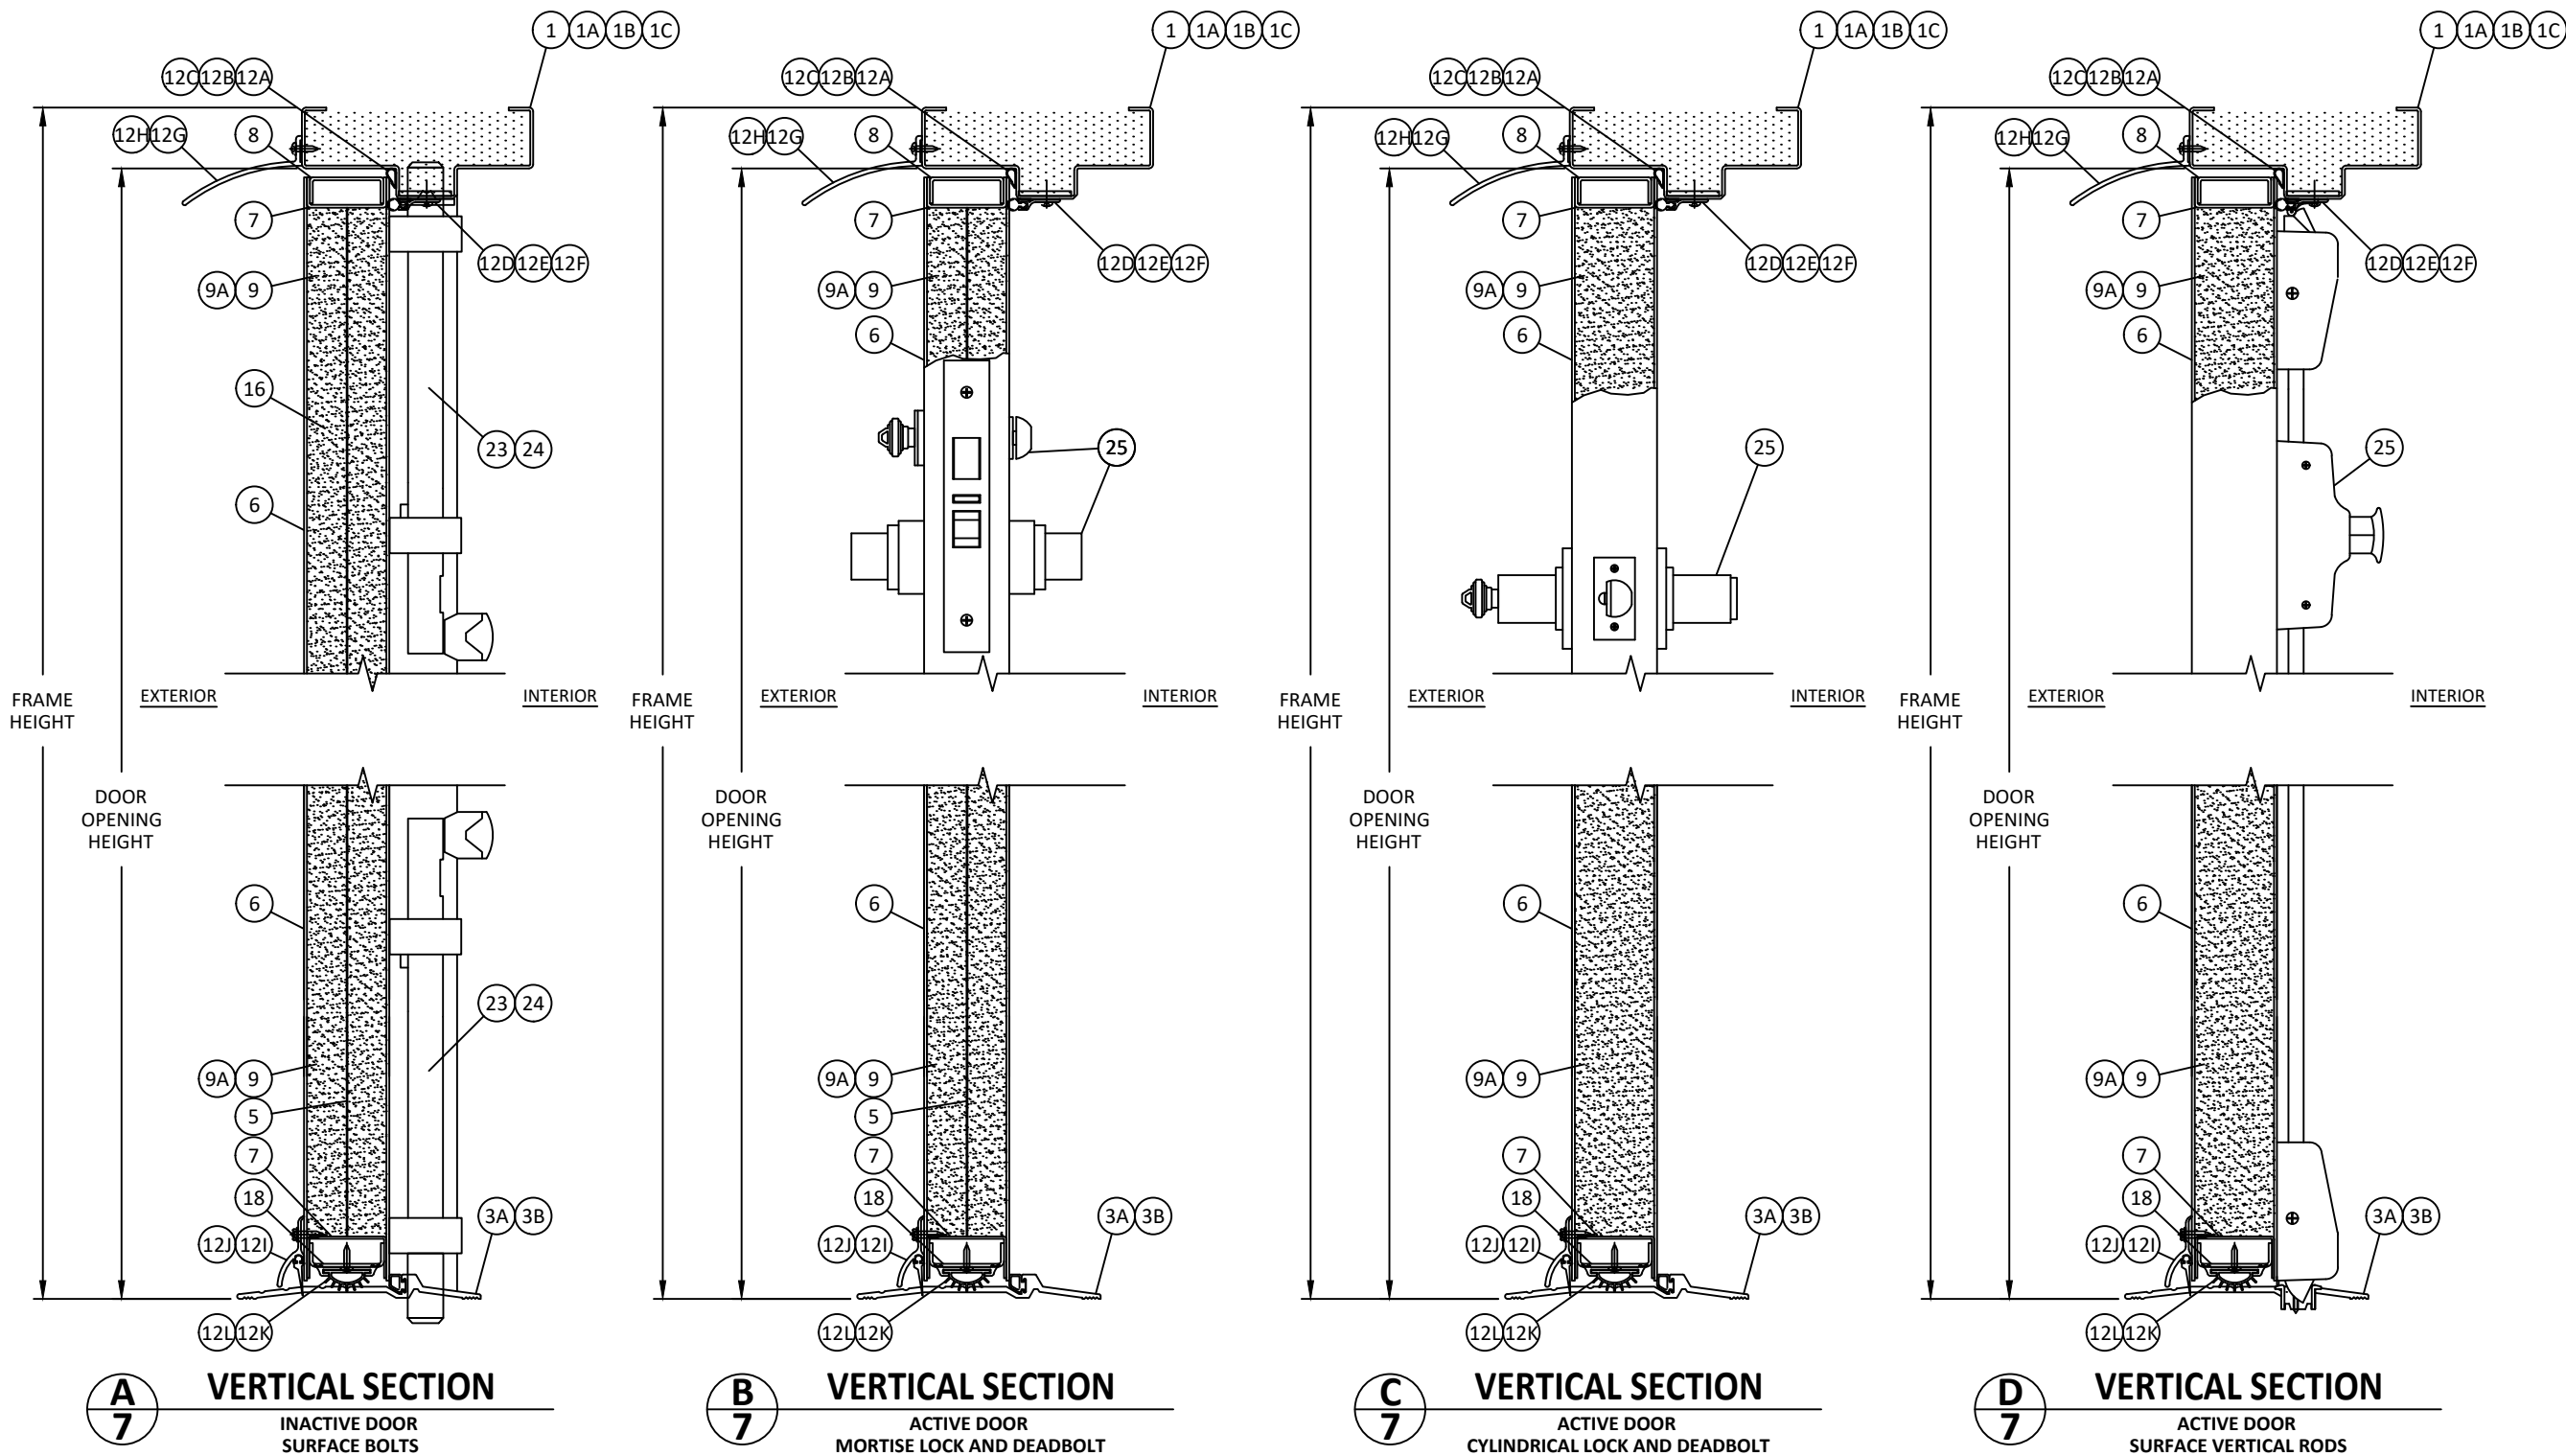

NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589


TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)
VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

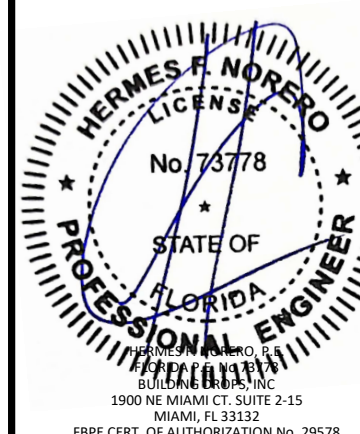

FL20078

DATE: 01.14.26

DWG. BY:
DI

CHK. BY:
HFN


SCALE: NTS

DWG. #: NDC002

SHEET:

7

OF 15

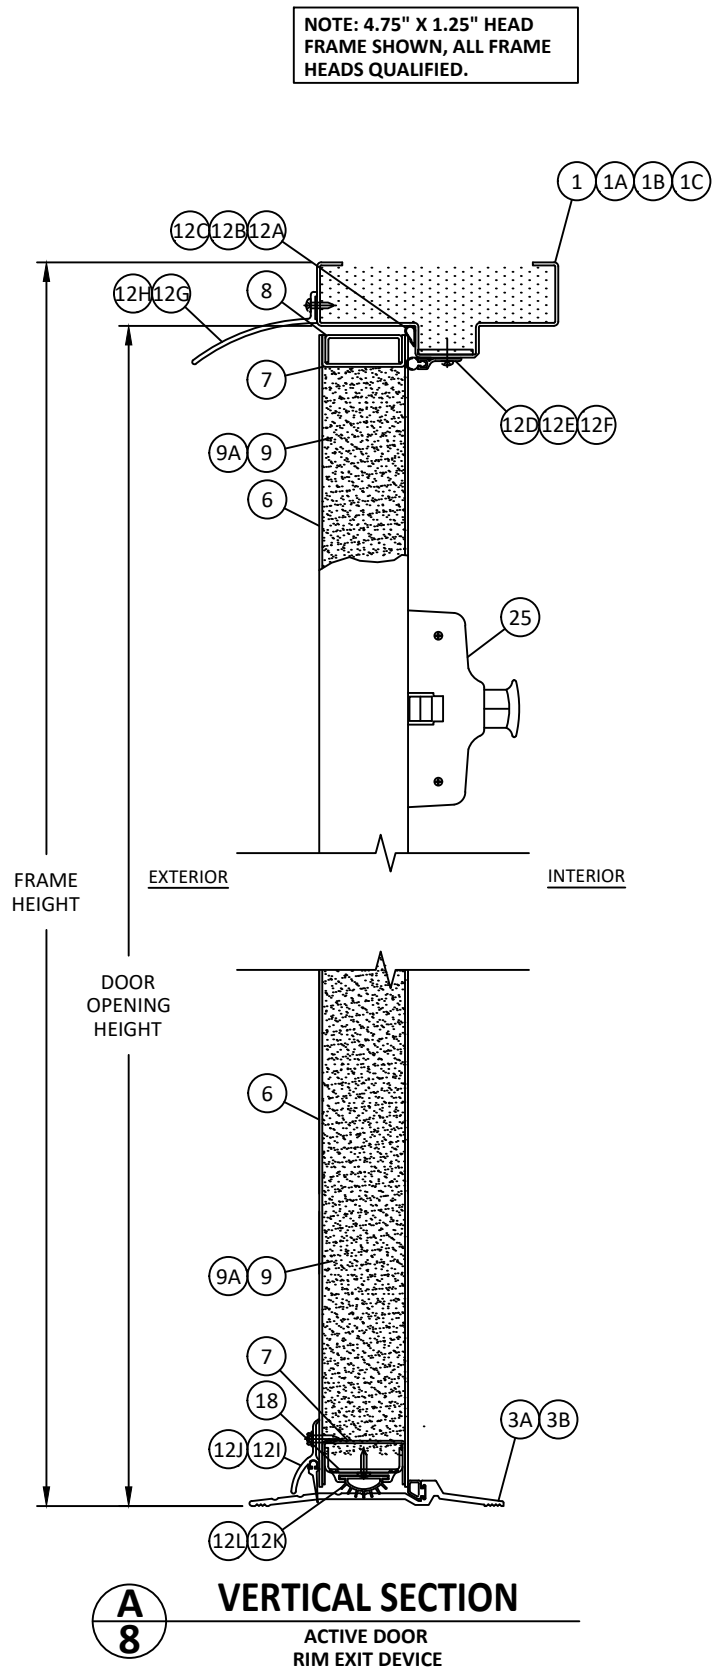

NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589


TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

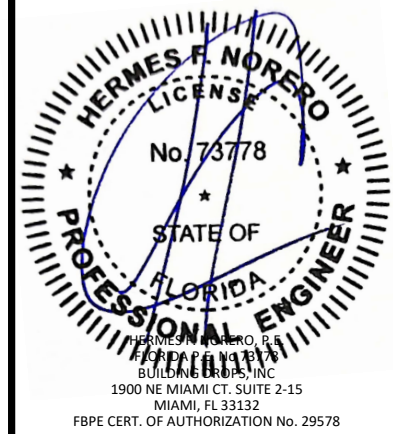


FL20078

DATE:	01.14.26
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	NDC002
SHEET:	


8

OF 15


NOTE: 4.75" X 1.25" JAMB
FRAME SHOWN, ALL FRAME
JAMBS QUALIFIED.

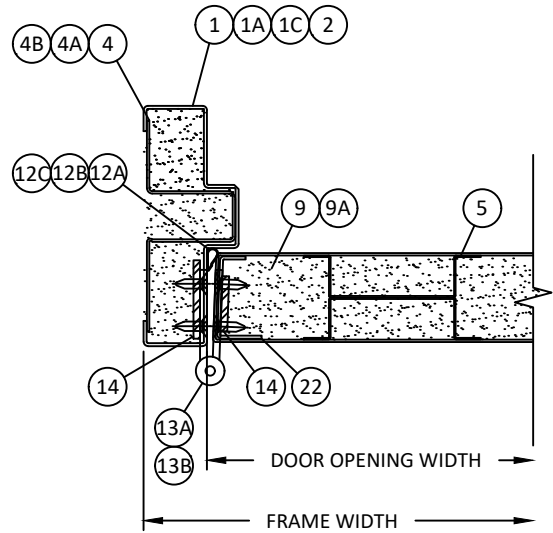


A
9 **HORIZONTAL SECTION**
BUTT HINGE JAMB

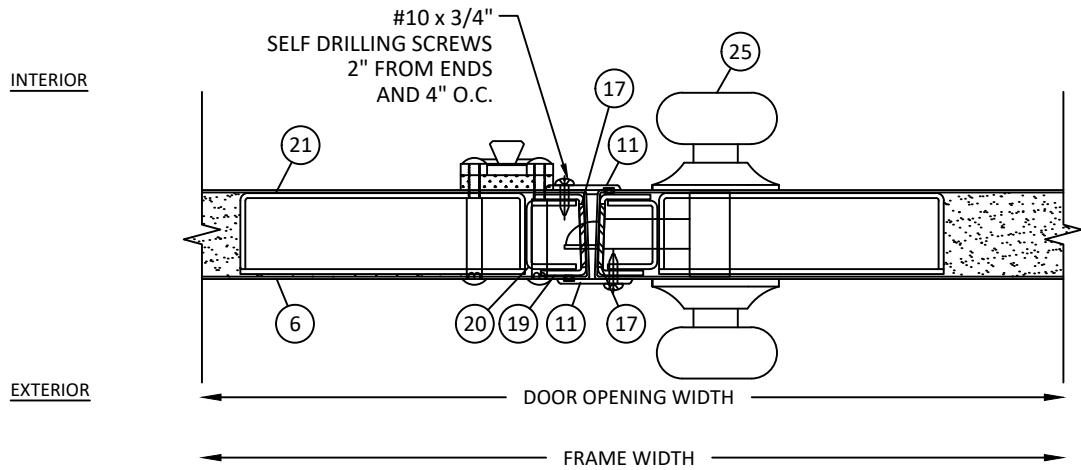


B
9 **HORIZONTAL SECTION**
CYLINDRICAL LOCK W/ DB & SURFACE BOLT
MEETING STILE

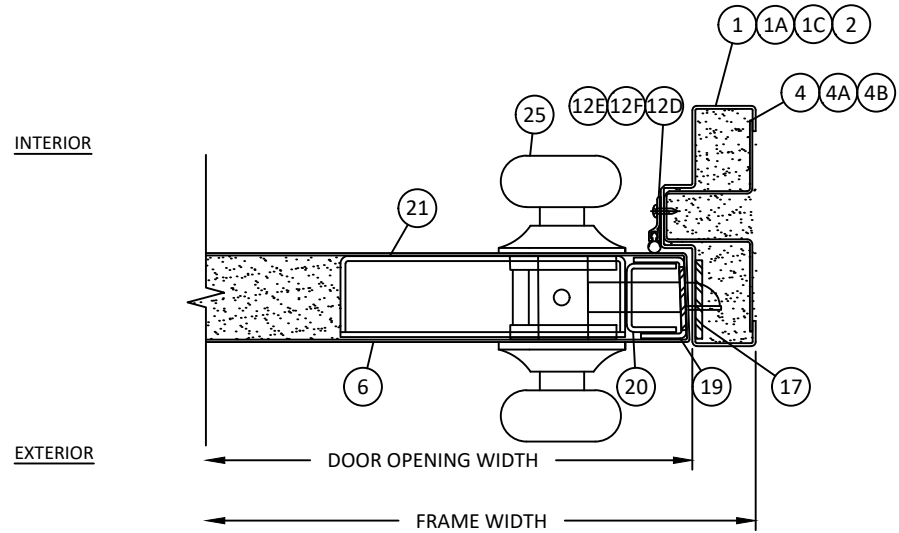

C
9 **HORIZONTAL SECTION**
CYLINDRICAL LOCK WITH DEADBOLT
LOCK JAMB

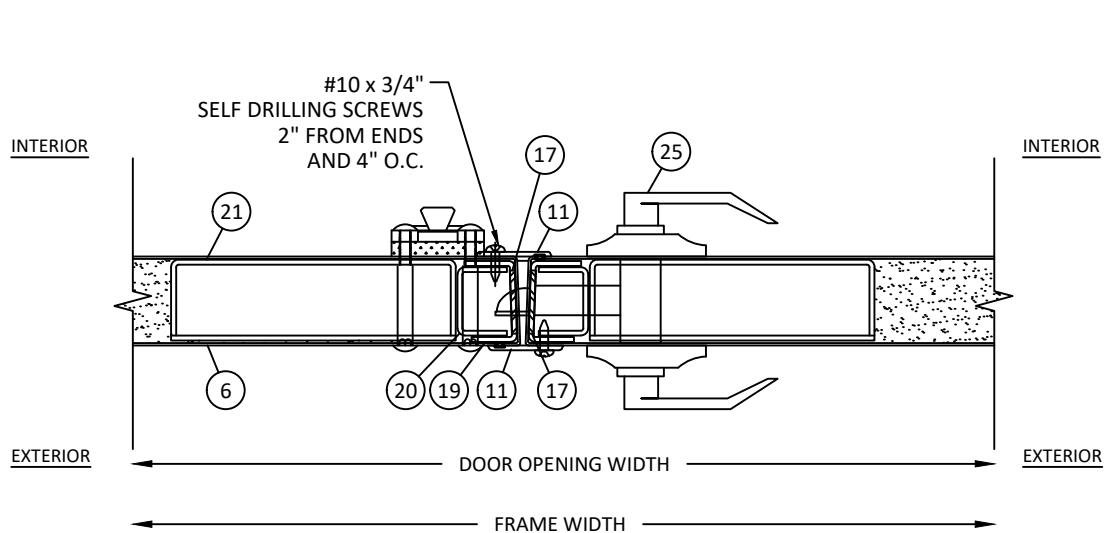

D
9 **HORIZONTAL SECTION**
MORTISE LOCK W/ DB & SURFACE BOLT
MEETING STILE

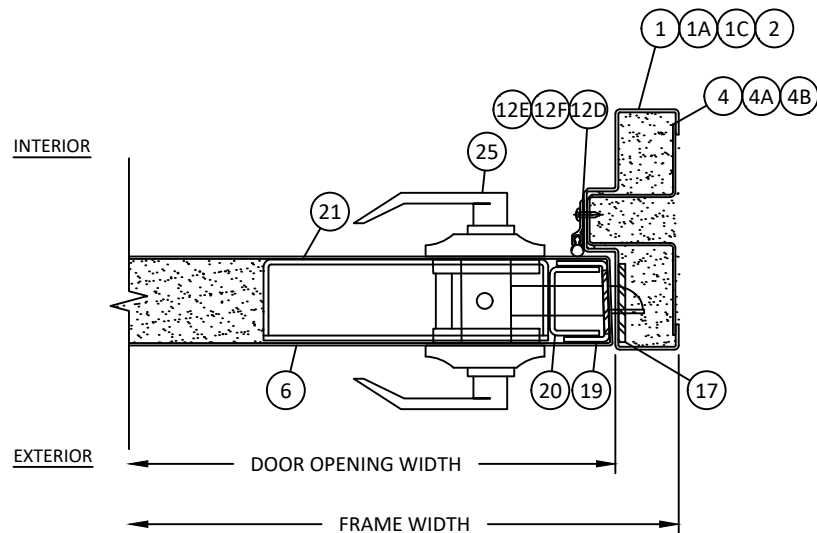

E
9 **HORIZONTAL SECTION**
MORTISE LOCK WITH DEADBOLT
LOCK JAMB



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)

HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

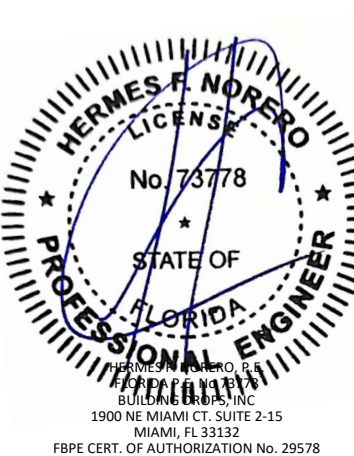

FL20078

DATE: 01.14.26

DWG. BY:
DI

CHK. BY:
HFN

SCALE: NTS


DWG. #: NDC002

SHEET:


9

OF 15


NOTE: 4.75" X 1.25" JAMB
FRAME SHOWN, ALL FRAME
JAMBS QUALIFIED.

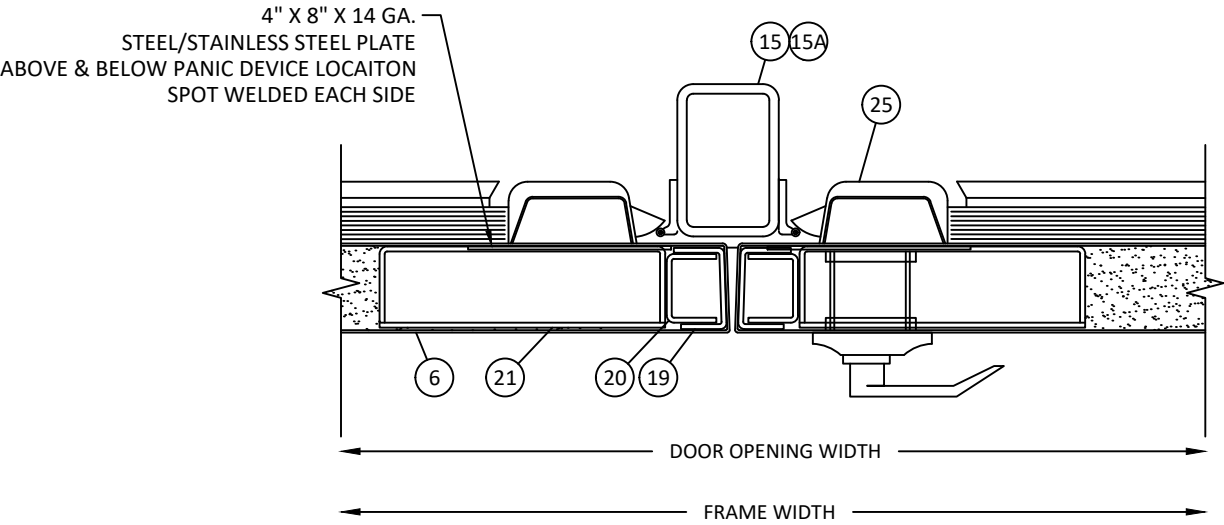


A
10 HORIZONTAL SECTION
RIM EXIT DEVICE
MEETING STILE

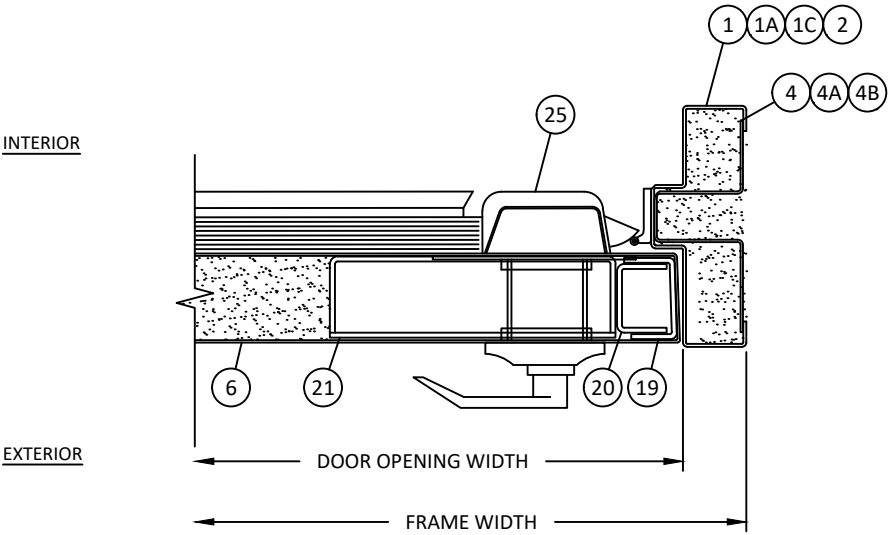

B
10 HORIZONTAL SECTION
RIM EXIT DEVICE
LOCK JAMB

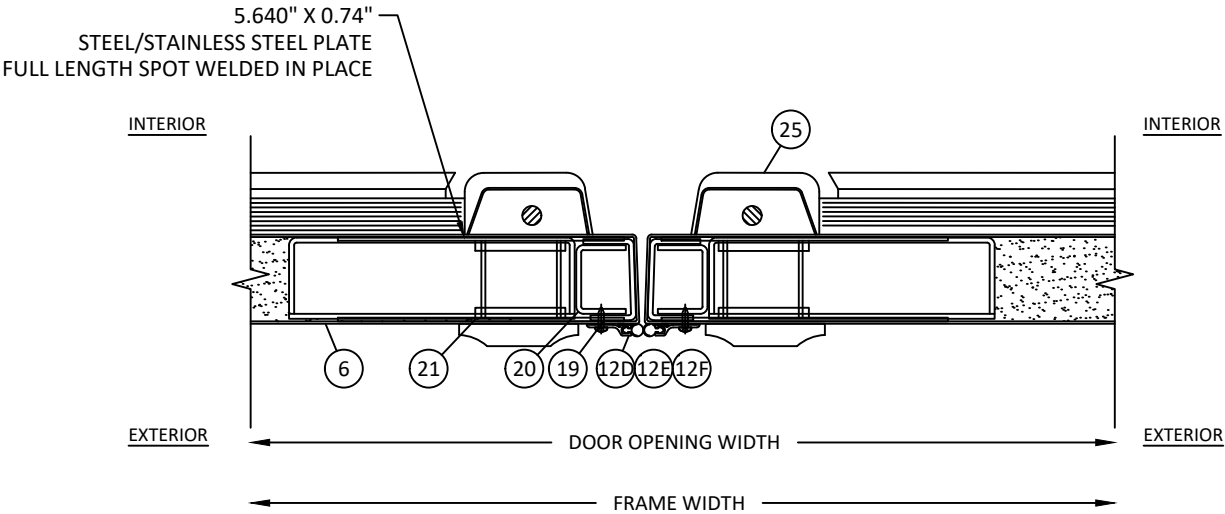

C
10 HORIZONTAL SECTION
SURFACE VERTICAL ROD
MEETING STILE

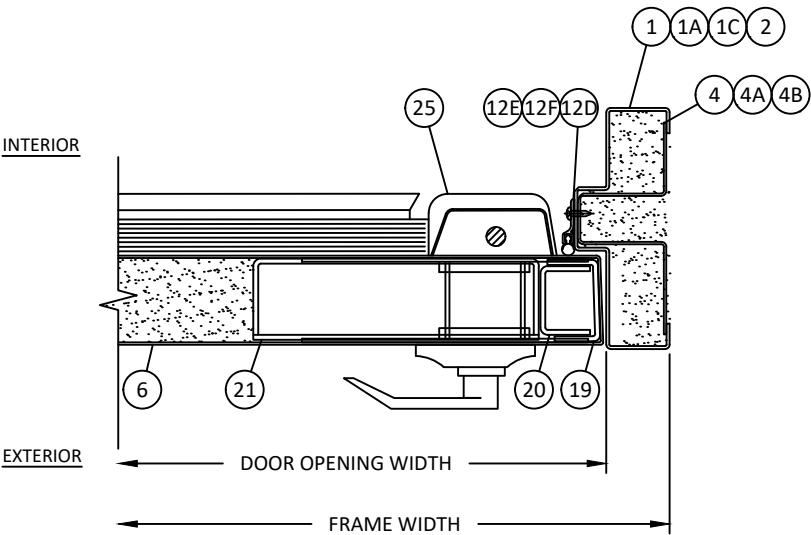

D
10 HORIZONTAL SECTION
SURFACE VERTICAL ROD
LOCK JAMB



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)

HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL20078

DATE: 01.14.26

DWG. BY:
DI

CHK. BY:
HFN


SCALE: NTS

DWG. #: NDC002


SHEET:

10


OF 15

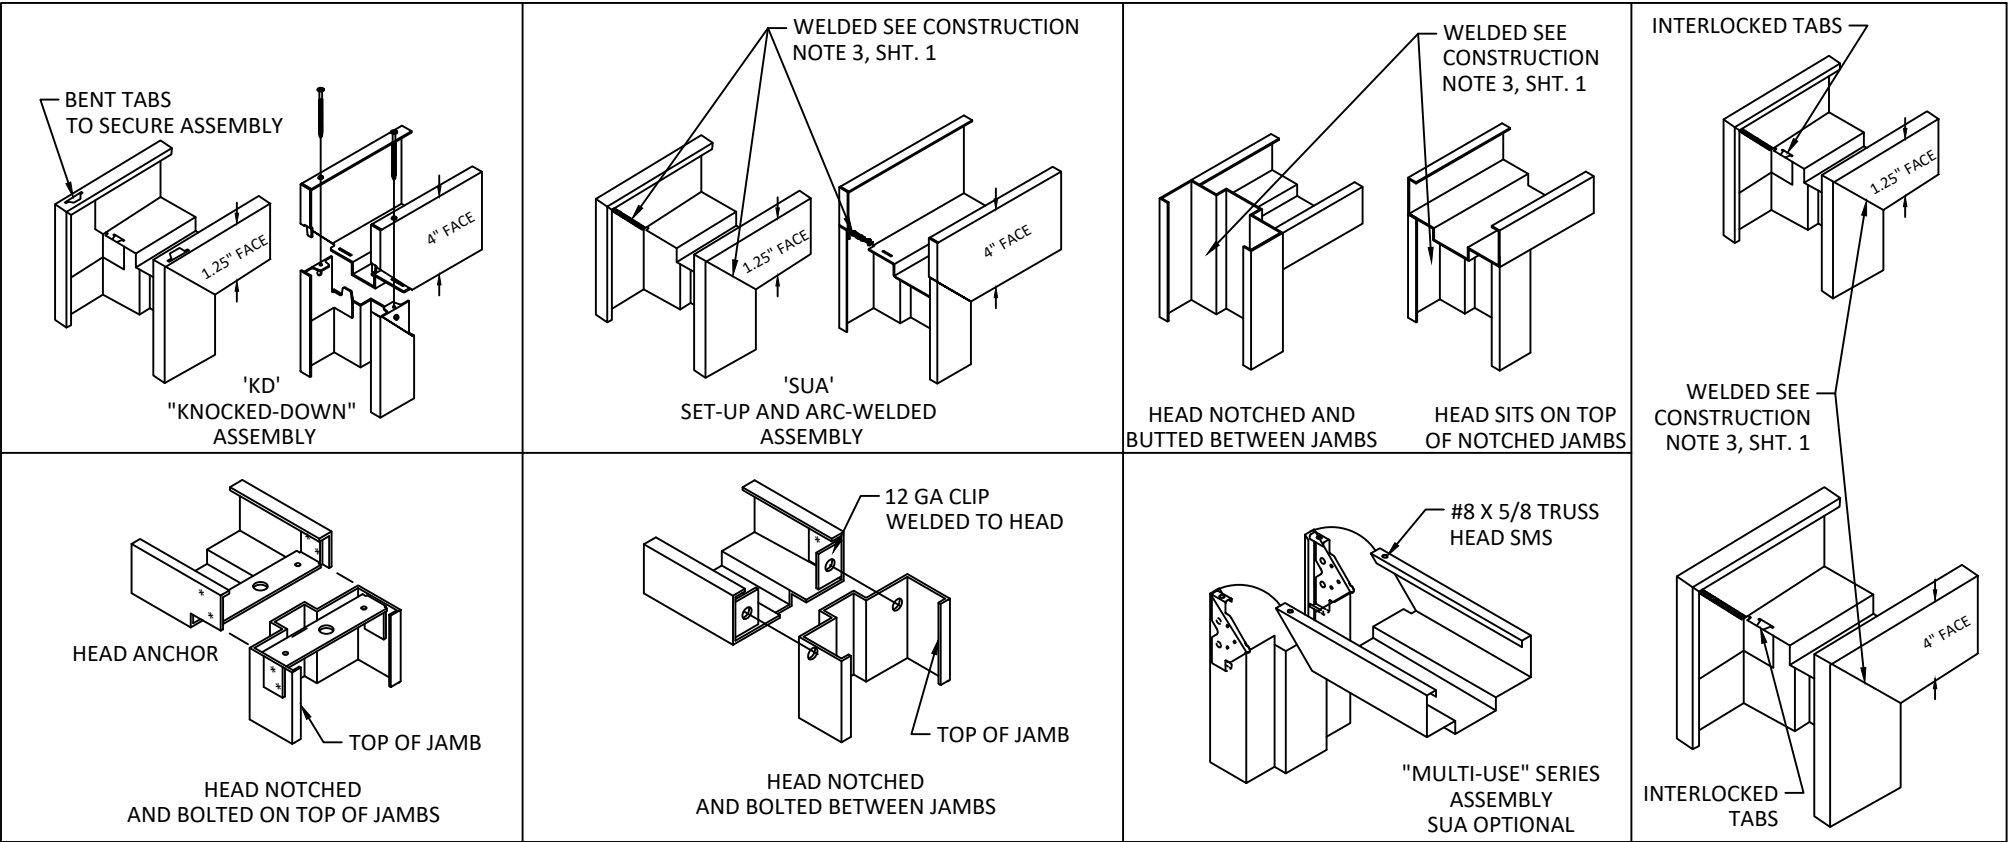

A
11 ISOMETRIC SECTION
CORNER CONSTRUCTION

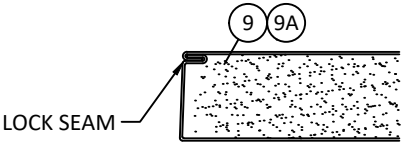

B
11 HORIZONTAL SECTION
LOCK SEAM EDGE CONSTRUCTION

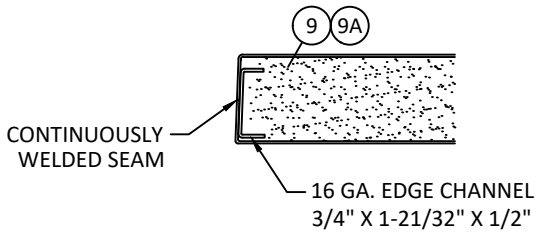


C
11 HORIZONTAL SECTION
BUTT SEAM EDGE CONSTRUCTION



D
11 ISOMETRIC SECTION
9000 SERIES PHG MULLION

VON DUPRIN MULLION EXPANSION ANCHOR
NOTES:
ALLOWABLE ANCHOR TYPES ARE (SEE ABOVE FOR SPACING REQUIREMENTS):
1/4" DEWALT/POWERS SMART DI+ EXPANSION ANCHORS WITH MIN 1" EMBEDMENT AND 2.8" EDGE DISTANCE IN 3000 PSI CONCRETE OR
1/4" HILTI KB-TZ2 (CS OR SS) 1-1/2" EMBEDMENT WITH MIN 3.25" EDGE DISTANCE IN 4000 PSI CONCRETE OR
1/4" CS SIMPSON TITEN HD (316 S.S.) HEAVY-DUTY WITH MINIMUM 2.8" MIN. EDGE DISTANCE IN 3000 PSI CONCRETE

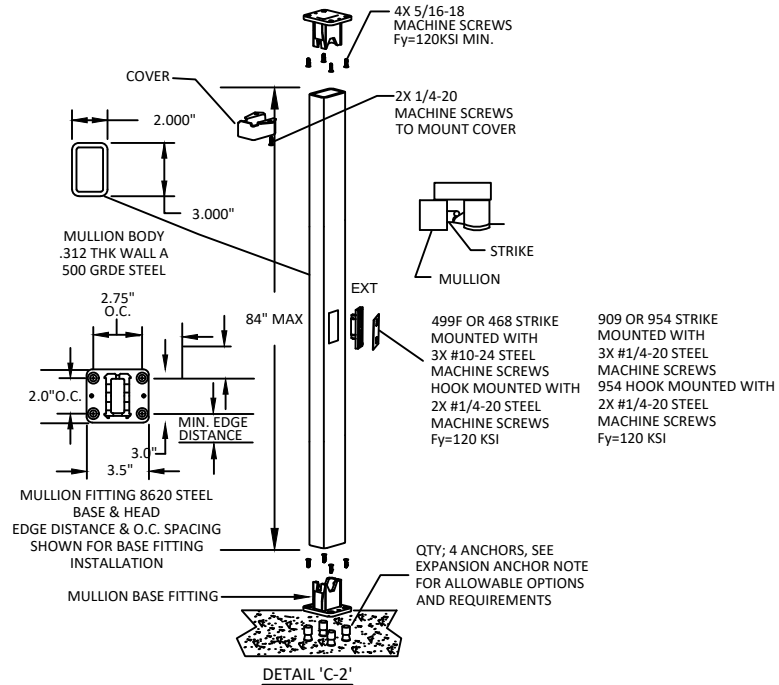

E
11 ISOMETRIC SECTION
VON DUPRIN HH9954 MULLION



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)

ISOMETRIC AND HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL20078

DATE: 01.14.26

DWG. BY: DI

CHK. BY: HFN

SCALE: NTS

DWG. #: NDC002


SHEET:

11

OF 15


INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN UNLESS OTHERWISE NOTED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

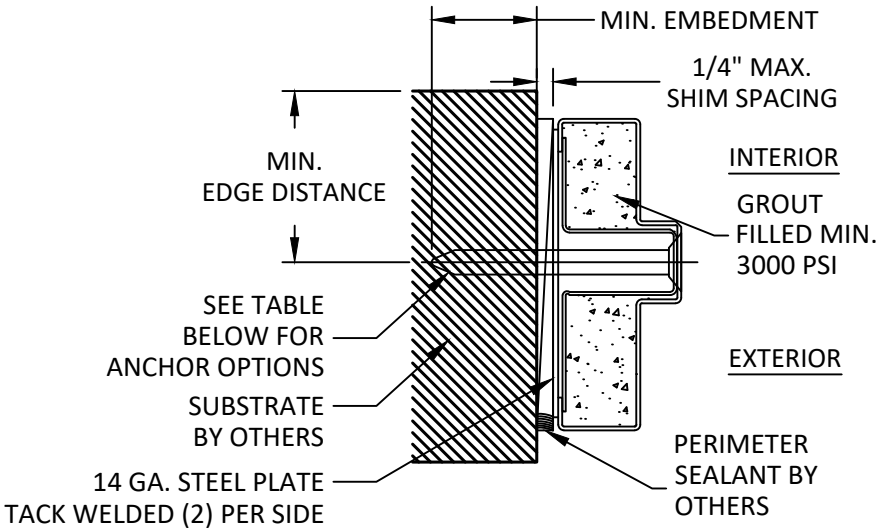


A
12 HORIZONTAL SECTION
EXISTING WALL ANCHOR (EWA) TUBE JAMB


NOTE:
4.75" X 1.25"
FRAME SHOWN,
ALL FRAMES
QUALIFIED.

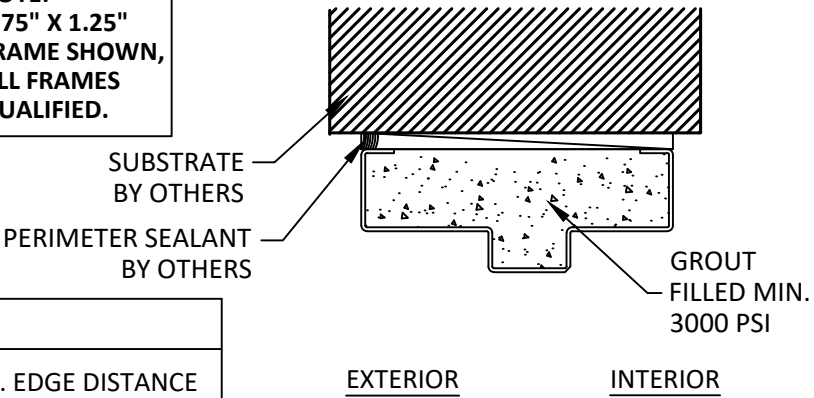

C
12 HORIZONTAL SECTION
GROUT FILLED HEAD

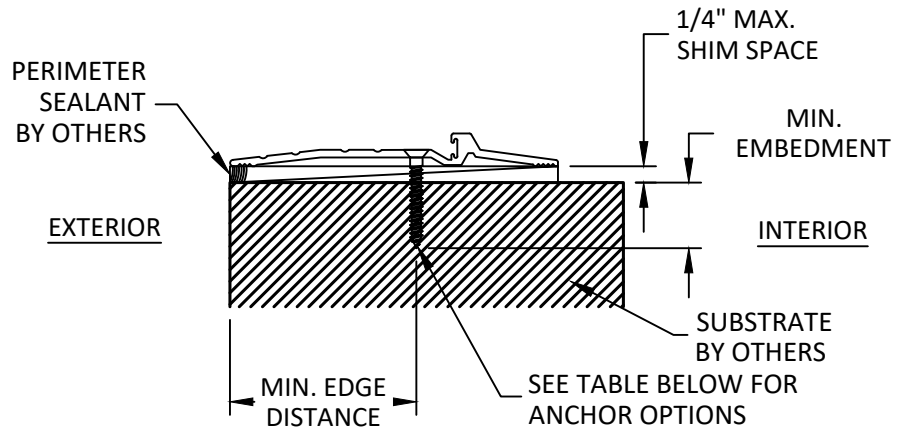

B
12 VERTICAL SECTION
THRESHOLD

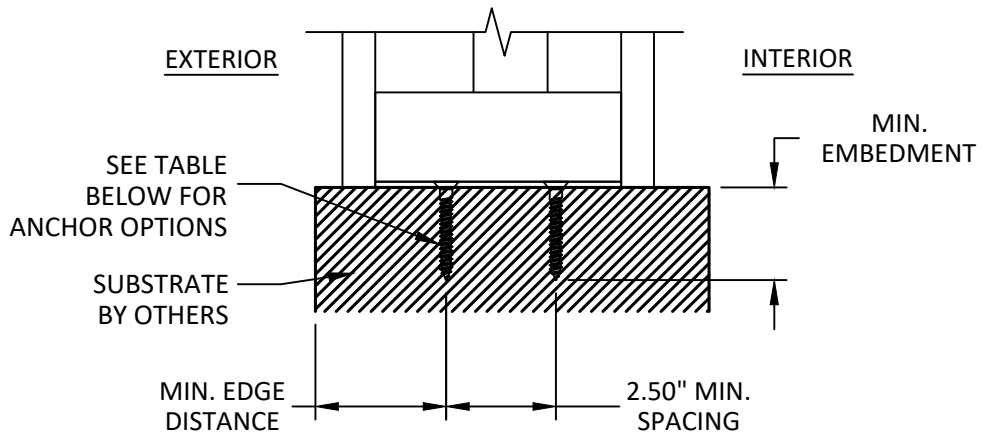

D
12 VERTICAL SECTION
JAMB BASE ANCHOR

EWA TUBE ANCHOR SCHEDULE			
SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
WOOD: MIN. S.G. = 0.55	3/8" LAG SCREW	1-1/2"	1"
STEEL: MIN. 18 GA. MIN. Fy = 33 ksi	3/8" GRADE 2 SELF-DRILLING/ SELF-TAPPING SCREW OR SMS OR MACHINE BOLTS	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
ALUMINUM: MIN. 1/8" THICK MIN. 6063-T5			
CONCRETE: MIN. f'c = 3000 psi	3/8" HILTI HLC SLEEVE	1-1/4"	3-1/2"
	3/8" DEWALT POWER-BOLT	2-1/2"	3"
CONCRETE: MIN. f'c = 4000 psi	3/8" WEJ-IT SLEEVE	2-1/2"	2-1/2"
CONCRETE: MIN. f'c = 3500 psi	3/8" MKT SUP-R-SLEEVE	1-1/4"	3-3/4"
MASONRY: GROUT FILLED CMU per ASTM C90 MIN. 2000 PSI	3/8" HILTI HLC SLEEVE	1-1/4"	4"
	3/8" DEWALT POWER-BOLT	2"	5-5/8"
	3/8" WEJ-IT SLEEVE	1-1/2"	3-3/4"

THRESHOLD ANCHOR SCHEDULE			
SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
WOOD: MIN. S.G. = 0.55	#14 WOOD SCREW	1-1/2"	3/4"
CONCRETE: MIN. f'c = 3000 psi	1/4" ITW TAPCON	1-3/4"	2-1/2"

JAMB BASE ANCHOR SCHEDULE			
SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
WOOD: MIN. S.G. = 0.55	#12 WOOD SCREW	1-1/2"	1/2"
CONCRETE: MIN. f'c = 3000 psi	3/16" ITW TAPCON	1-1/2"	2-1/2"



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)

INSTALLATION NOTES AND DETAILS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL20078

DATE: 01.14.26

DWG. BY: DI

CHK. BY: HFN


SCALE: NTS

DWG. #: NDC002

SHEET:


12

OF 15

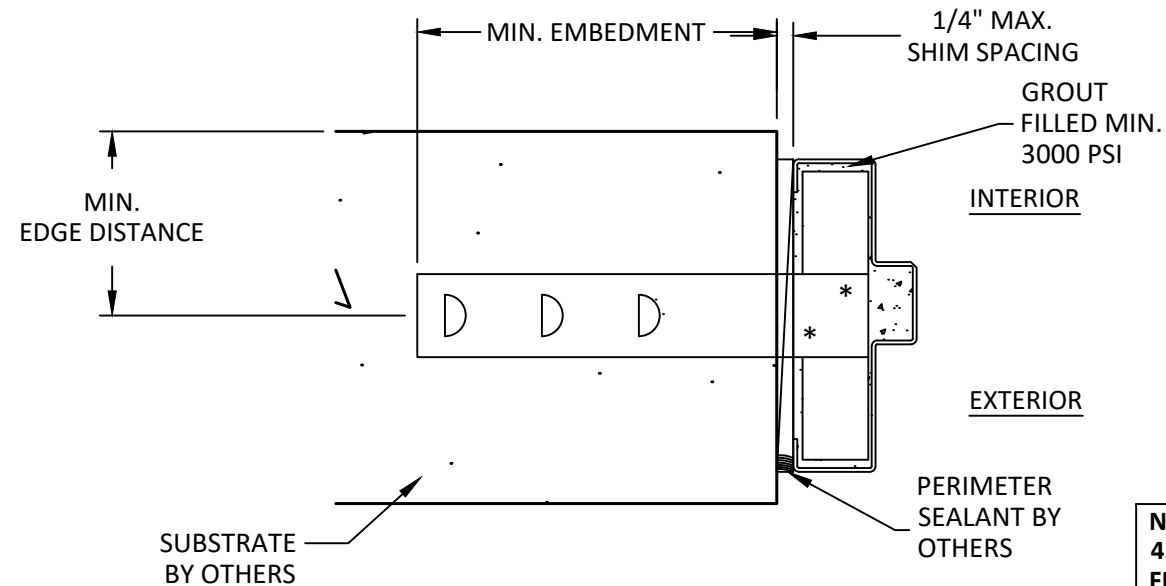



A
13 **HORIZONTAL SECTION**
MASONRY T-ANCHOR

NOTE:
4.75" X 1.25"
FRAME SHOWN,
ALL FRAMES
QUALIFIED.

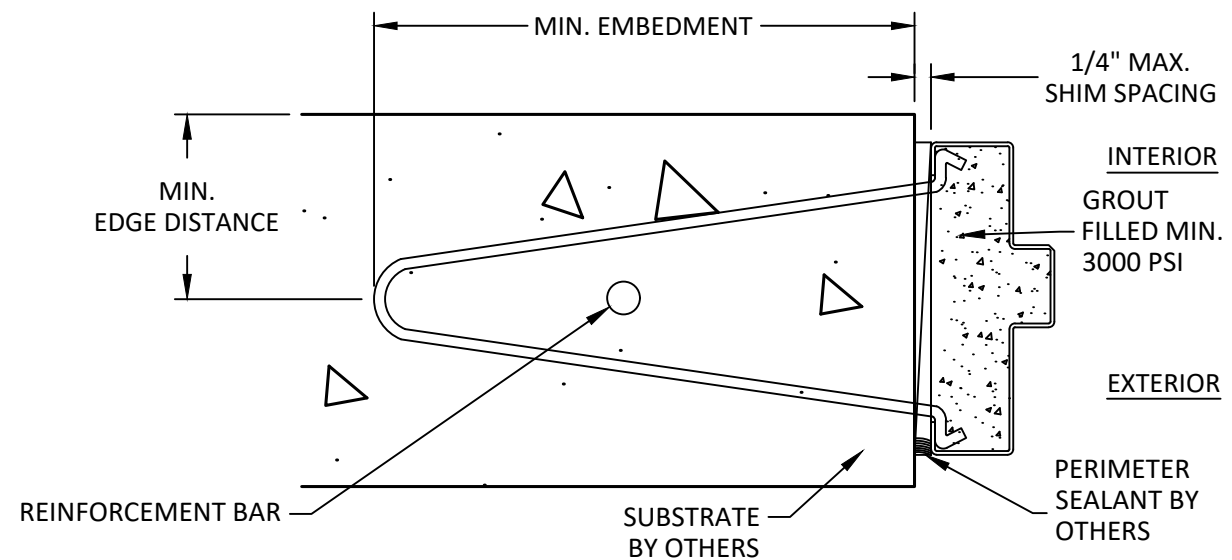

B
13 **HORIZONTAL SECTION**
WIRE ANCHOR

WIRE & MASONRY T-ANCHOR SCHEDULE			
SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
POURED CONCRETE TILT UP WALLS: MIN. f'c = 2700 psi	WIRE	8-1/2"	2-7/8"
	MASONRY T	6"	2-1/2"
MASONRY: GROUT FILLED CMU per ASTM C90 MIN. 2000 PSI	WIRE	8-1/2"	2-7/8"
	MASONRY T	6"	2-1/2"

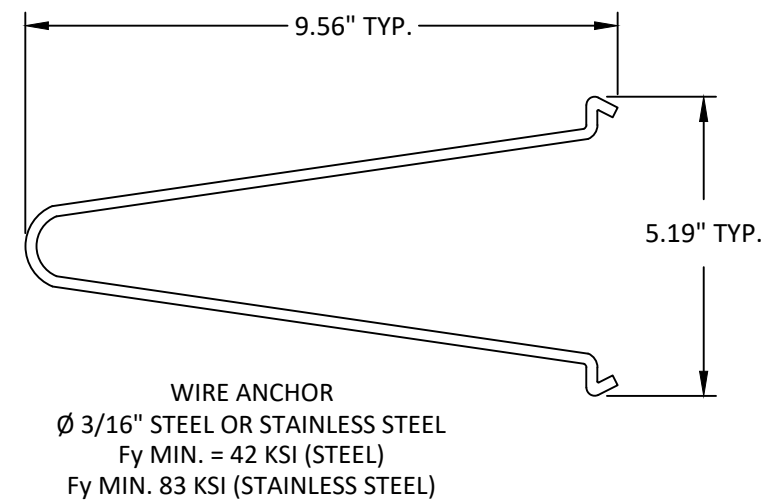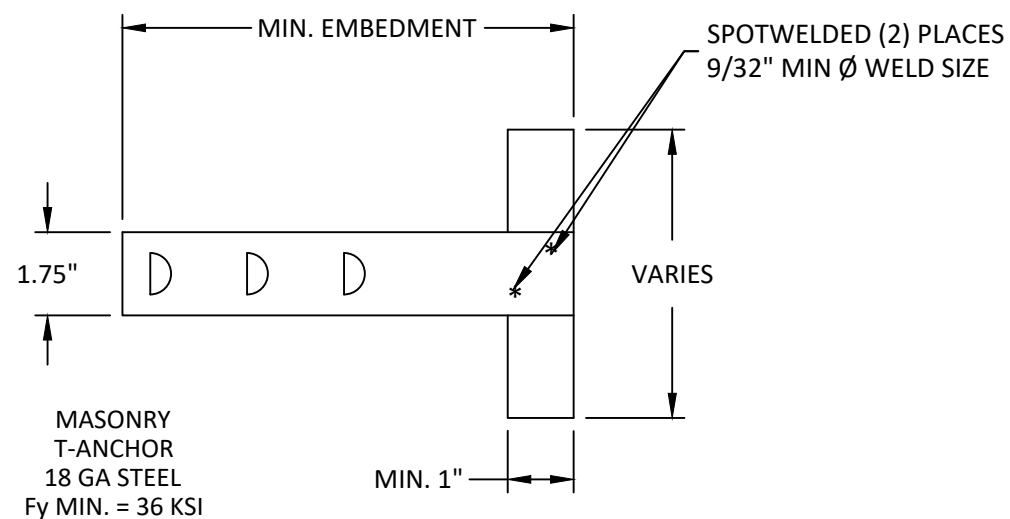

NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)
INSTALLATION DETAILS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL20078

DATE: **01.14.26**

DWG. BY: **DI** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **NDC002**


SHEET:

13


OF 15

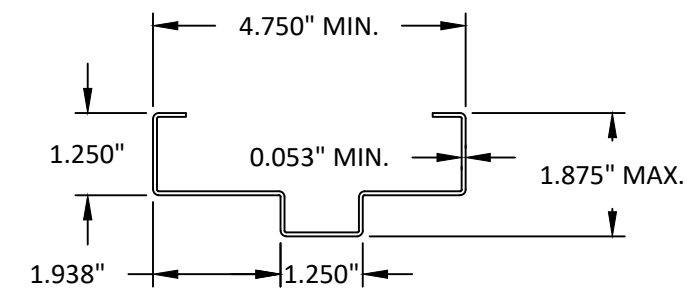


1 FRAME HEAD/JAMB
STEEL

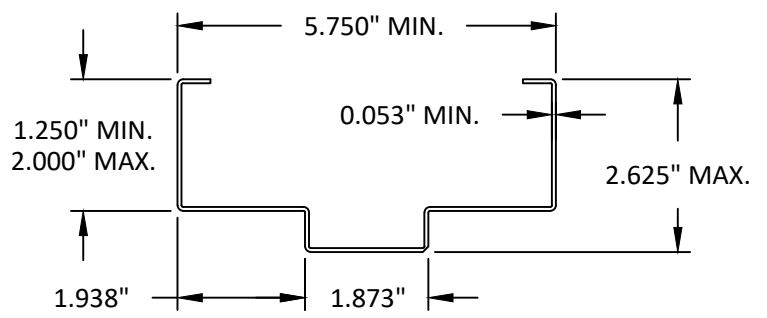


1A FRAME HEAD/JAMB
STEEL

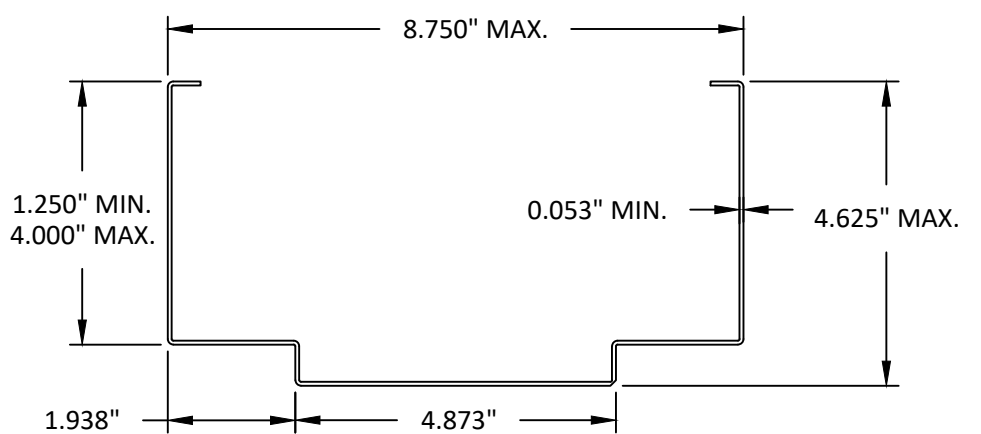


1B FRAME HEAD/JAMB
STEEL

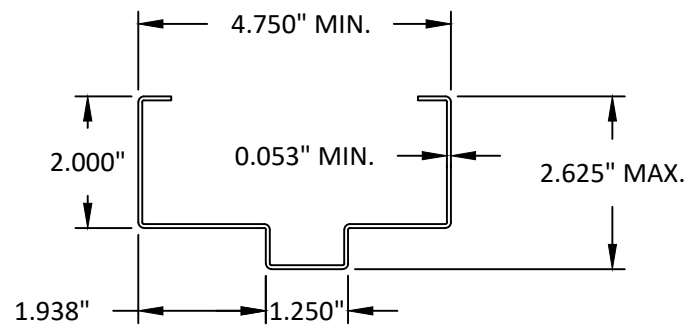


1C FRAME HEAD/JAMB
STEEL

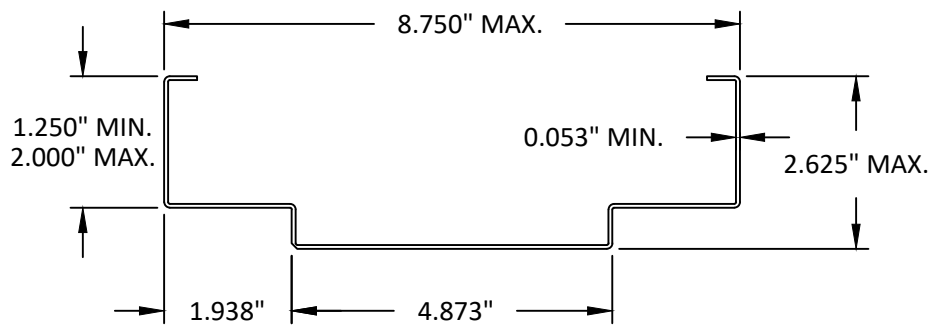


2 FRAME JAMB
STEEL

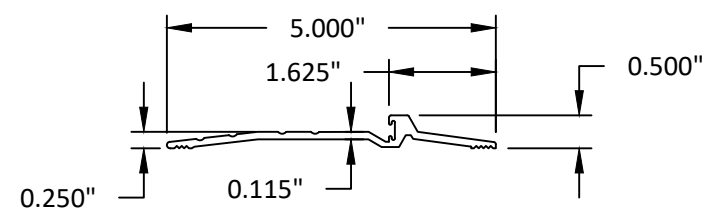


3A THRESHOLD
ALUMINUM

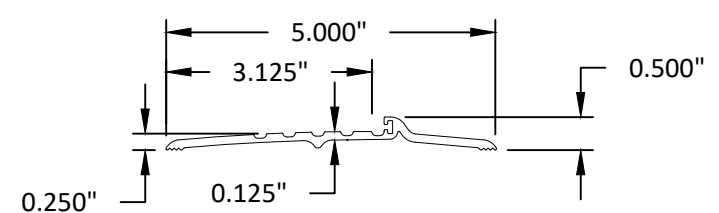

3B THRESHOLD
ALUMINUM

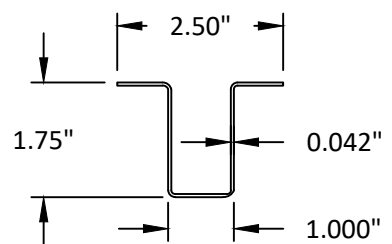

4 BOLT SPACER
STEEL

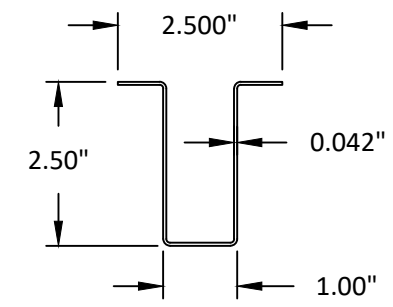

4A BOLT SPACER
STEEL



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)


COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

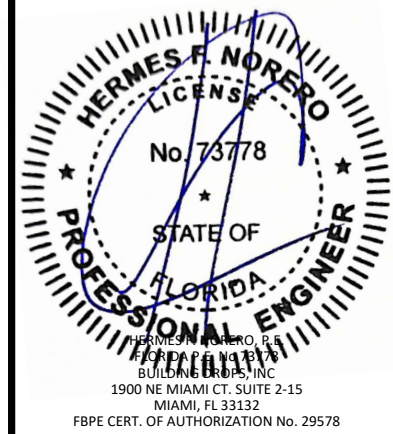

FL20078

DATE: 01.14.26

DWG. BY: DI

CHK. BY: HFN


SCALE: NTS

DWG. #: NDC002


SHEET:

14


OF 15

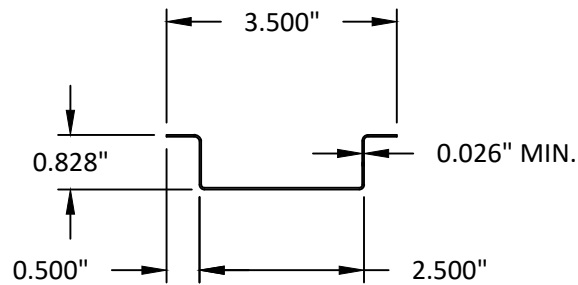


5 HAT CHANNEL REINFORCEMENT STEEL

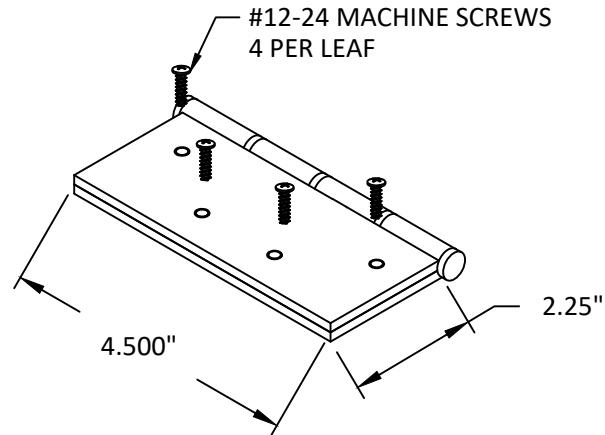


13A BUTT HINGE STEEL

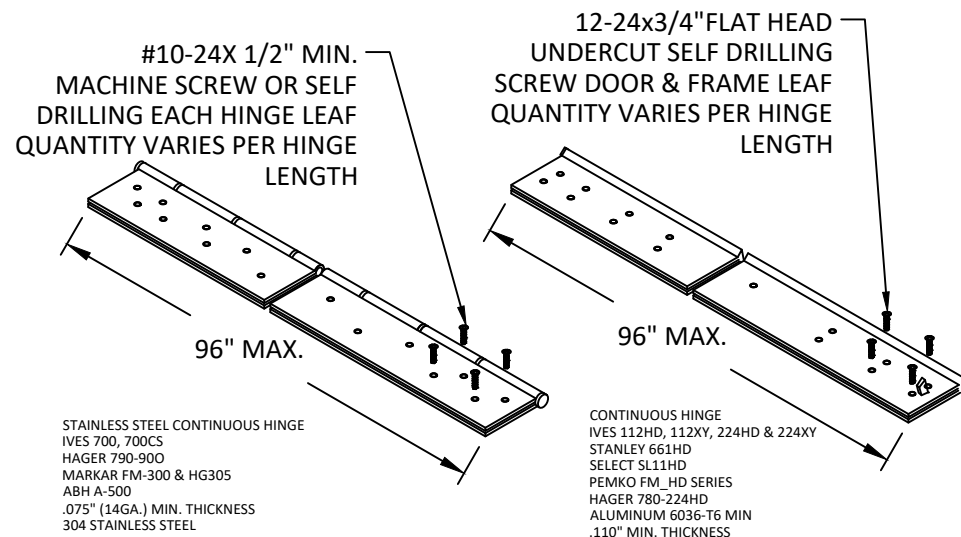


13B CONTINUOUS HINGE STEEL/ALUM

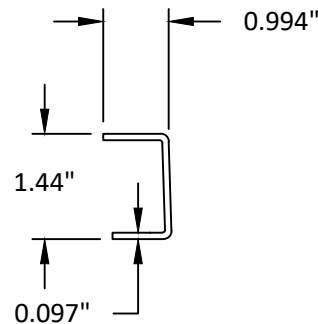


19 LOCK STILE REINF. STEEL

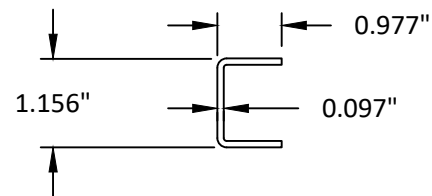

20 LOCK STILE REINF. STEEL

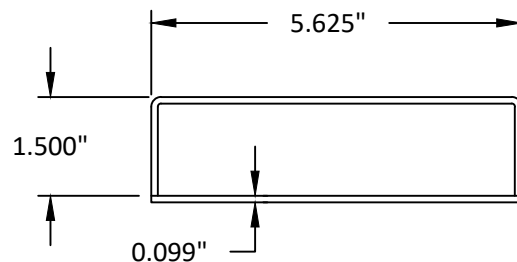

21 LOCK STILE REINF. STEEL

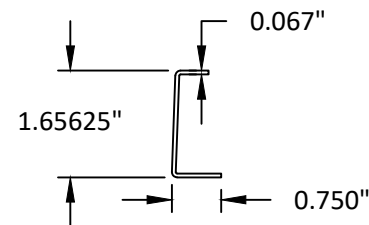

22 EDGE REINF. STEEL



NEXT DOOR COMPANY
4005 E. 10TH COURT
HIALEAH, FL 33013
PH: (305) 691-1589

TITLE: SERIES S-6070F OUTSWING
FLUSH STEEL DOOR
(HVHZ)(IMPACT)

COMPONENTS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL20078

DATE: 01.14.26

DWG. BY: DI

CHK. BY: HFN

SCALE: NTS

DWG. #: NDC002

SHEET:

15

OF 15