


SLIDING GLASS DOOR - NON-IMPACT



- GENERAL NOTES:
1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE FLORIDA BUILDING CODE (FBC), CURRENT EDITION AND IS RATED FOR USE IN THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
  2. GLAZING OPTIONS: (SEE SHEET 4)
  3. APPROVED CONFIGURATIONS INCLUDE BUT ARE NOT LIMITED TO:  
"XO", "OX", "XX", "OXO", "XXX", "OXXO", "XXXX", "PX", "PXX", "PXXX", "PXXXX", "PXXP", "PXXXXP", "PXXXXXXP", "PXXXXXXXP"  
2 TRACK, 3 TRACK, 4 TRACK
  4. DESIGN PRESSURE RATING:  
-NEGATIVE DESIGN LOADS BASED ON, TESTED PRESSURE AND GLASS TABLES ASTM E-1300-04e01/09.  
-POSITIVE DESIGN LOADS BASED ON, TESTED PRESSURE, WATER INFILTRATION TEST PRESSURE AND GLASS TABLES ASTM E-1300-04e01/09.
  5. ANCHORAGE: THE 33 1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. SEE SHEETS 10-11 FOR ANCHOR DETAILS. WINDLOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
  6. NOT APPROVED FOR IMPACT RESISTANCE. IMPACT PROTECTIVE SYSTEM REQUIRED IN WIND BORNE DEBRIS REGION.
  7. ALL FRAMES AND VENTS ARE PROCESSED AND SCREWED TOGETHER.
  8. SERIES / MODEL DESIGNATION SGD-380.
  9. THE DESIGNATION X AND O STAND FOR THE FOLLOWING:  
X = OPERABLE SASH, O = FIXED SASH, P = POCKET/HOOKSTRIP
  10. SECTION CALLOUTS APPLY TO ALL CONFIGURATIONS IN A SIMILAR LOCATION.
  11. WEEP SLOTS = 1/4" x 1-3/4" LOCATED 6" FROM BOTH ENDS.

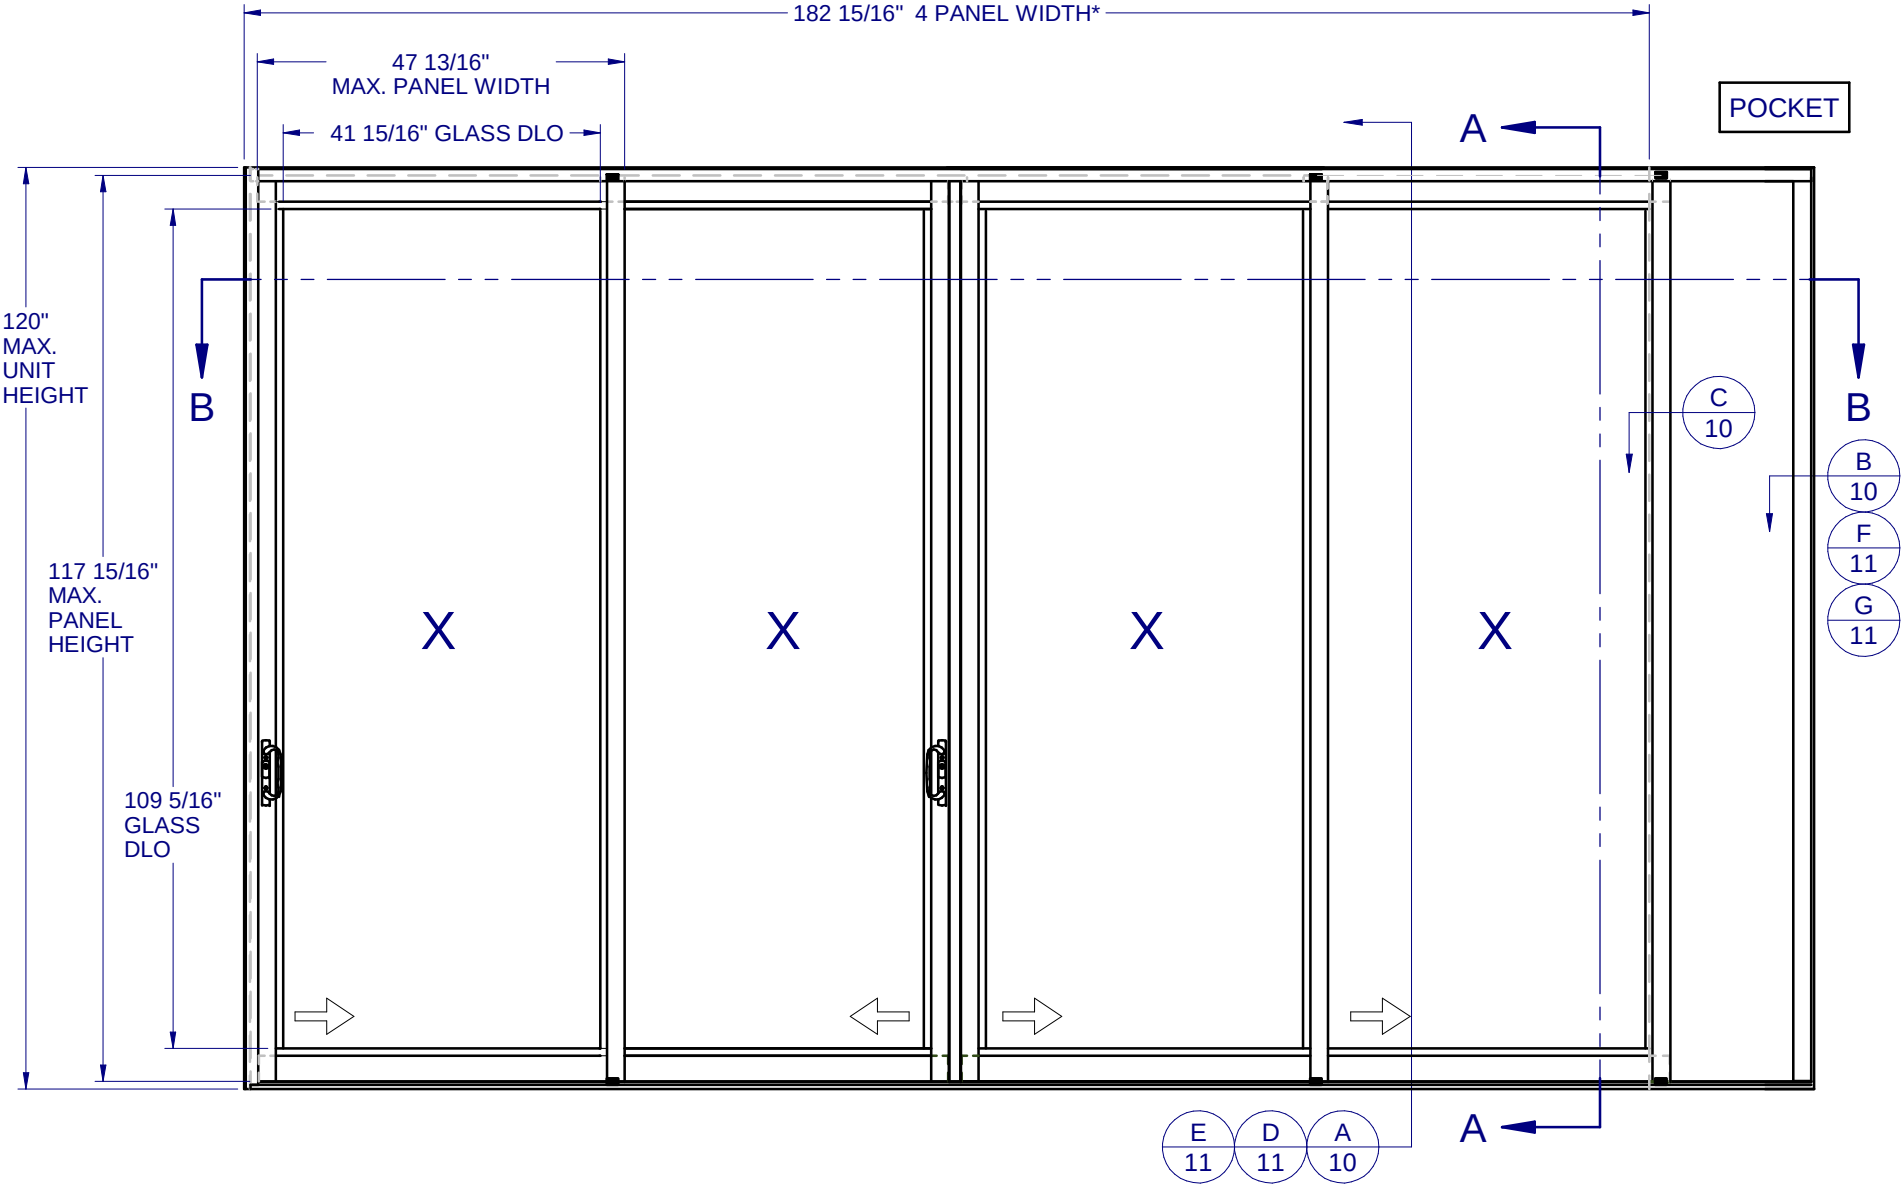


1900 SW 44TH AVE.  
OCALA, FLORIDA 34474  
WWW.CWS.CC

380 ALUM. SLIDING GLASS DOOR NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.: 20443

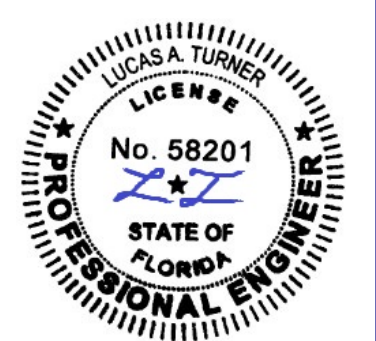

9/19/2023

LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering & Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574

SHEET DESCRIPTION:  
GENERAL NOTES AND ELEVATIONS

|           |           |
|-----------|-----------|
| DRAWN BY: | DATE:     |
| MCS       | 9/19/2023 |
| DWG #:    | REV.:     |
| CWS-1155  | B         |
| SCALE:    | SHEET     |
| 1:25      | 1 OF 11   |

TABLE OF CONTENTS

GENERAL NOTES & ELEVATIONS.....1  
DP CHART.....2  
SECTION VIEWS.....3  
BOM & GLAZING DETAIL.....4  
EXTRUSIONS.....5-6  
TRACK WIDTHS.....7  
ANCHOR SCHEDULE & NOTES.....8  
ANCHOR PATTERNS (STAGGER).....9  
INSTALLATION DETAILS.....10-11

| MAX. PANEL SIZE        | DESIGN PRESSURE RATING | IMPACT RATING |
|------------------------|------------------------|---------------|
| 47-13/16" x 117-15/16" | +/-65 PSF              | NONE          |

\*(4) PANELS SHOWN; HVHZ LIMITED TO MAX. (9) PANELS. OUTSIDE HVHZ, UNLIMITED NUMBER OF PANELS IS ALLOWABLE AS LONG AS INDIVIDUAL PANELS DO NOT EXCEED PANEL SIZE AS SHOWN.

Lucas Turner  
2023.09.19  
16:17:27  
-05'00'

380 ALUM. SLIDING  
GLASS DOOR  
NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN  
THIS DRAWING IS THE SOLE  
PROPERTY OF CUSTOM WINDOW  
SYSTEMS, INC. ANY  
REPRODUCTION IN PART OR AS A  
WHOLE WITHOUT THE WRITTEN  
PERMISSION OF CUSTOM WINDOW  
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:  
20443



9/19/2023

LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering &  
Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574

SHEET DESCRIPTION:

DP CHART

|           |           |
|-----------|-----------|
| DRAWN BY: | DATE:     |
| MCS       | 9/19/2023 |
| DWG #:    | REV.:     |
| CWS-1155  | B         |
| SCALE:    | SHEET     |
| 1:1       | 2 OF 11   |

Chart 1. Design Pressures (psf) with Reinforcement and Low Rise Sill 2094

| Width<br>(in.) | Door Height (in.) |             |             |             |             |             |             |             |
|----------------|-------------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
|                | 78.000            | 84.000      | 90.000      | 96.000      | 102.000     | 108.000     | 114.000     | 120.000     |
| 30.000         | +65 / -97.5       | +65 / -97.5 | +65 / -97.5 | +65 / -97.5 | +65 / -97.5 | +65 / -97.5 | +65 / -97.5 | +65 / -94.8 |
| 36.000         | +65 / -97.5       | +65 / -97.5 | +65 / -97.5 | +65 / -97.5 | +65 / -97.5 | +65 / -92.2 | +65 / -86.4 | +65 / -81.3 |
| 42.000         | +65 / -84.2       | +65 / -84.2 | +65 / -84.2 | +65 / -84.2 | +65 / -84.2 | +65 / -81.7 | +65 / -76.5 | +65 / -71.8 |
| 47.813         | +65 / -65         | +65 / -65   | +65 / -65   | +65 / -65   | +65 / -65   | +65 / -65   | +65 / -65   | +65 / -65   |

Chart 2. Design Pressures (psf) with Reinforcement and High Rise Sill 2095

| Panel<br>Width | Door Height (in.) |             |             |             |             |             |               |               |
|----------------|-------------------|-------------|-------------|-------------|-------------|-------------|---------------|---------------|
|                | 78.000            | 84.000      | 90.000      | 96.000      | 102.000     | 108.000     | 114.000       | 120.000       |
| 30.000         | +80 / -97.5       | +80 / -97.5 | +80 / -97.5 | +80 / -97.5 | +80 / -97.5 | +80 / -97.5 | +80 / -97.5   | +80 / -94.8   |
| 36.000         | +80 / -97.5       | +80 / -97.5 | +80 / -97.5 | +80 / -97.5 | +80 / -97.5 | +80 / -92.2 | +80 / -86.4   | +80 / -81.3   |
| 42.000         | +80 / -84.2       | +80 / -84.2 | +80 / -84.2 | +80 / -84.2 | +80 / -84.2 | +80 / -81.7 | +76.5 / -76.5 | +71.8 / -71.8 |
| 47.813         | +65 / -65         | +65 / -65   | +65 / -65   | +65 / -65   | +65 / -65   | +65 / -65   | +65 / -65     | +65 / -65     |

| SILL RISER | MAX. POSITIVE DP |
|------------|------------------|
| 2094       | 65 psf           |
| 2095       | 80 psf           |


NOTE: INSTALLATION W/NO SILL RISER ALLOWED TO THE FULL DP'S INDICATED ABOVE, IN LOCATIONS WHERE WATER INFILTRATION RESISTANCE IS NOT REQUIRED, SUCH AS BUT NOT LIMITED TO LOCATIONS WHERE AN OVERHANG IS PRESENT THAT IS AS WIDE AS THE WALL IS TALL.

NOTE: IF SIZE INTENDED IS NOT SHOWN, USE NEXT LARGER SIZE.

**380 ALUM. SLIDING  
GLASS DOOR  
NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL  
THE INFORMATION CONTAINED IN  
THIS DRAWING IS THE SOLE  
PROPERTY OF CUSTOM WINDOW  
SYSTEMS, INC. ANY  
REPRODUCTION IN PART OR AS A  
WHOLE WITHOUT THE WRITTEN  
PERMISSION OF CUSTOM WINDOW  
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:  
20443

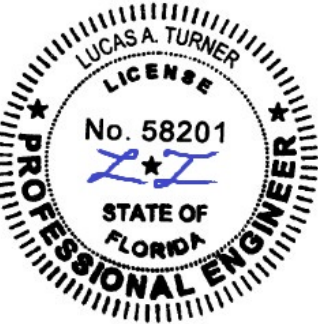


9/19/2023

LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering &  
Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574


SHEET DESCRIPTION:

**SECTION VIEWS**


|           |           |
|-----------|-----------|
| DRAWN BY: | DATE:     |
| MCS       | 9/19/2023 |
| DWG #:    | REV.:     |
| CWS-1155  | B         |
| SCALE:    | SHEET     |
| 1:3       | 3 OF 11   |

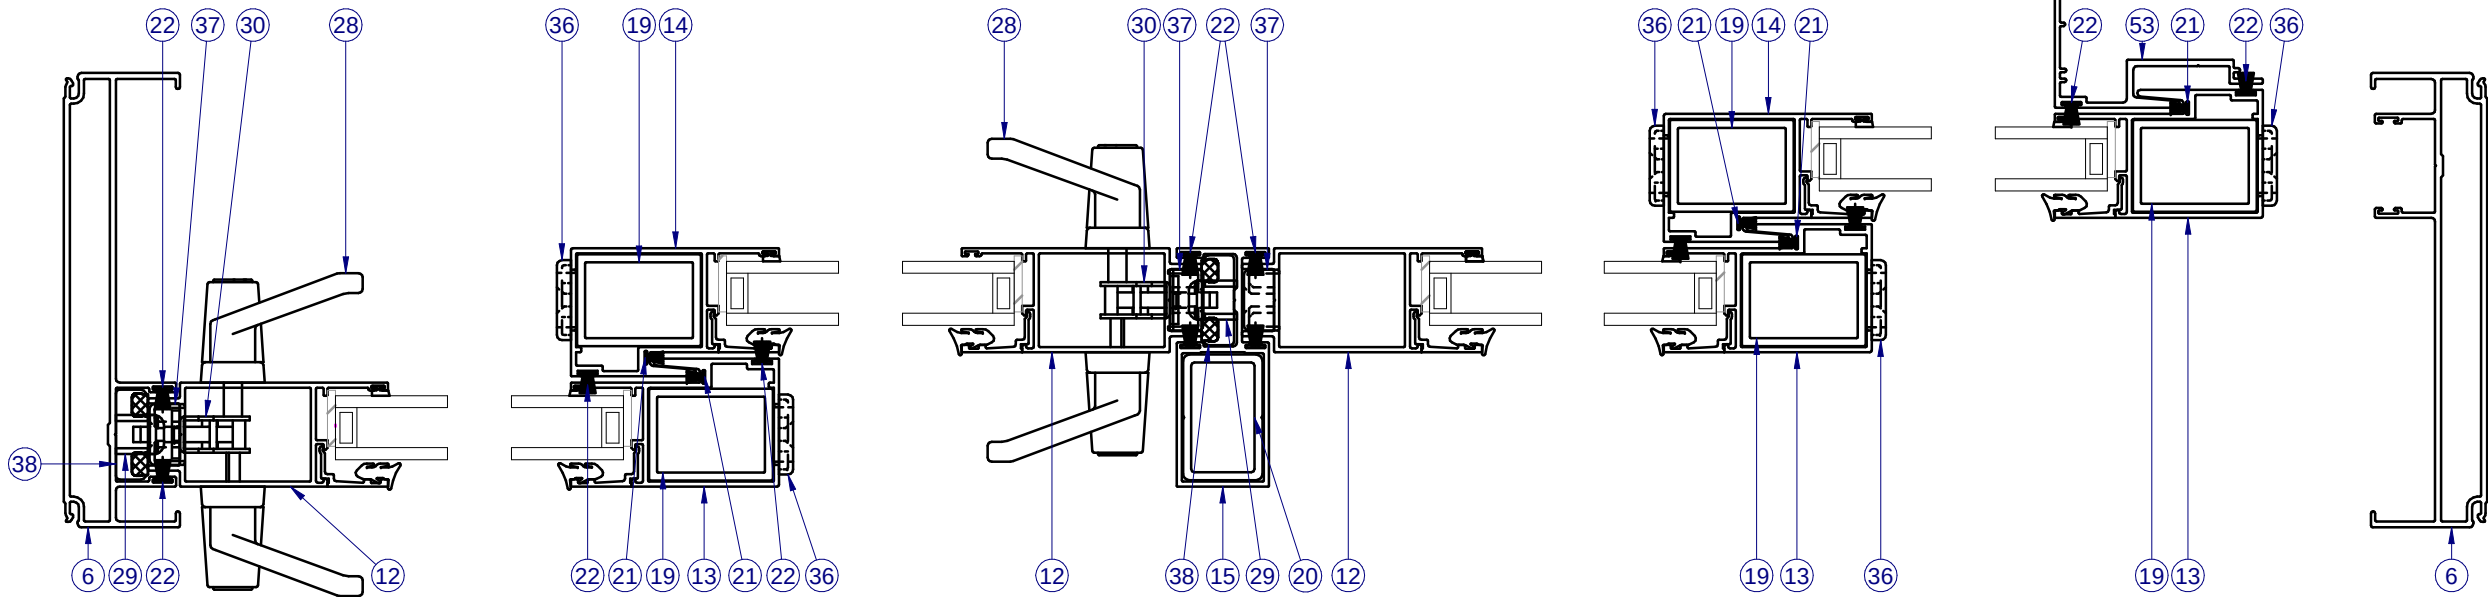


SECTION VIEW B-B

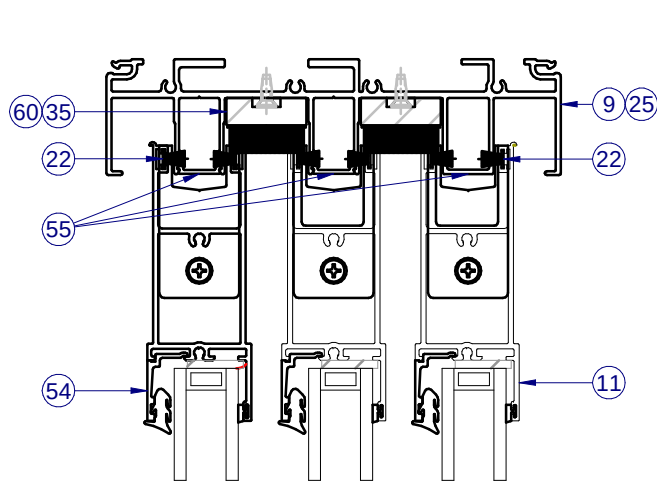


SECTION VIEW A-A  
NO SILL RISER

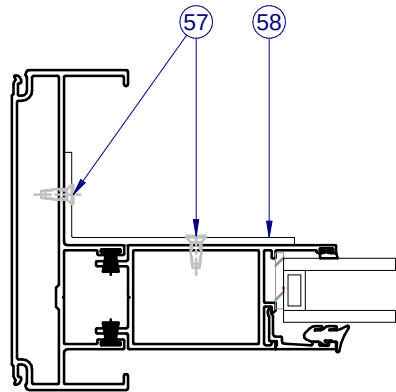


FIXED PANEL  
ATTACHMENT

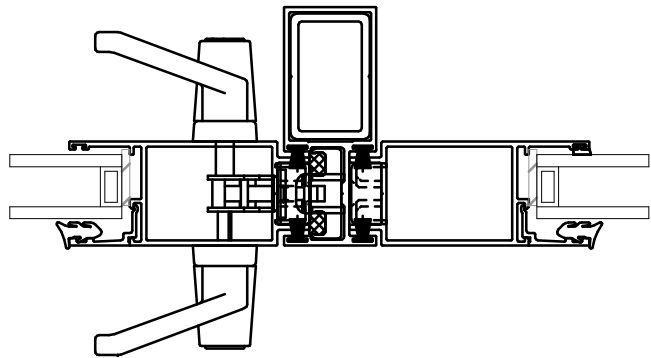


ASTRAGAL ORIENTATION  
EXT. TRACK W/SCREEN

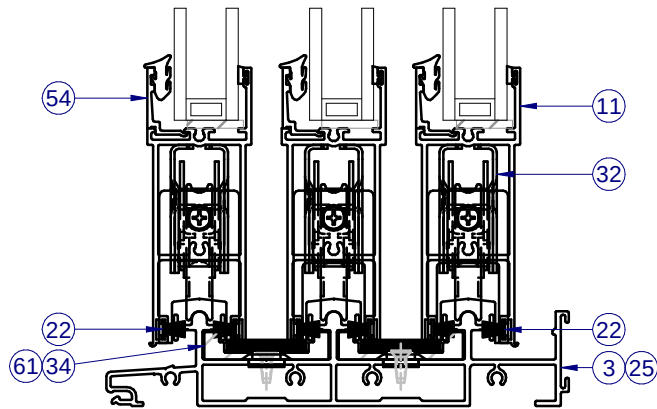

| SILL RISER | MAX. POSITIVE DP |
|------------|------------------|
| 2094       | 65 psf           |
| 2095       | 80 psf           |

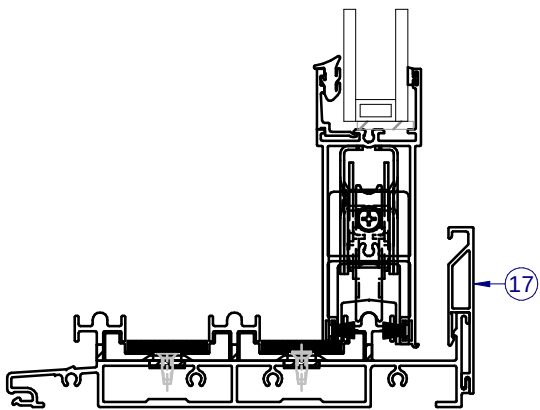

ALTERNATE SILL VIEW  
SILL RISER - 2094

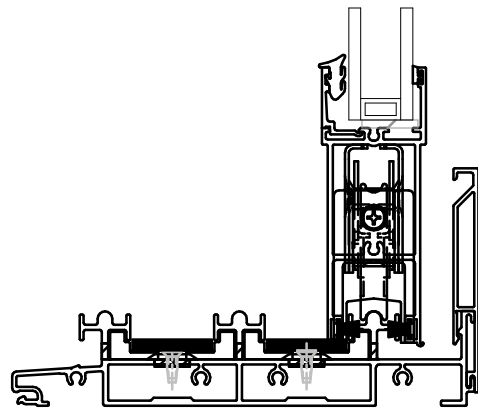

ALTERNATE SILL VIEW  
SILL RISER - 2095



ITEMS NOT SHOWN FOR CLARITY:  
23-24, 26-27, 31, 33, 39-52, 56, 59, 62-63

NOTE:  
1) INSTALLATION W/NO SILL RISER ALLOWED TO THE FULL DP'S INDICATED ABOVE, ALLOWED IN LOCATIONS WHERE WATER INFILTRATION RESISTANCE IS NOT REQUIRED, SUCH AS BUT NOT LIMITED TO LOCATIONS WHERE AN OVERHANG IS PRESENT THAT IS AS WIDE AS THE WALL IS TALL.

| PARTS LIST |        |                                               |          |
|------------|--------|-----------------------------------------------|----------|
| ITEM       | PART # | DESCRIPTION                                   | MATERIAL |
| 1          | GLASS  | SEE THIS SHEET                                |          |
| 2          | H-2076 | 2-Track Sill                                  | Aluminum |
| 3          | H-2077 | 3-Track Sill                                  | Aluminum |
| 4          | H-2078 | 4-Track Sill                                  | Aluminum |
| 5          | H-2079 | 2-Track Jamb                                  | Aluminum |
| 6          | H-2080 | 3-Track Jamb                                  | Aluminum |
| 7          | H-2081 | 4-Track Jamb                                  | Aluminum |
| 8          | H-2082 | 2-Track Head                                  | Aluminum |
| 9          | H-2083 | 3-Track Head                                  | Aluminum |
| 10         | H-2084 | 4-Track Head                                  | Aluminum |
| 11         | H-2085 | Top/Bottom Rail                               | Aluminum |
| 12         | H-2086 | Lock Stile                                    | Aluminum |
| 13         | H-2087 | Interlock Stile - Exterior                    | Aluminum |
| 14         | H-2088 | Interlock Stile - Interior                    | Aluminum |
| 15         | H-2089 | Astragal                                      | Aluminum |
| 16         | H-2091 | LAMI Glazing Bead, 7/16"                      | Aluminum |
| 17         | H-2094 | Sill Riser                                    | Aluminum |
| 18         | H-2095 | Sill Riser                                    | Aluminum |
| 19         | H-2096 | Reinforcement, Interlock                      | Aluminum |
| 20         | H-2126 | Reinforcement, Astragal                       | Aluminum |
| 21         | P-3300 | Wtsp., 0.280" x 0.187" Back, Fin, Black       |          |
| 22         | P-3308 | Wtsp., 0.310" x 0.270" Back, Fin, Black       |          |
| 23         |        | SikaFlex 552, Purfect Glaze "H"               | Silicone |
| 24         | P-3514 | #8 x 1" Ph Truss Hd Type A SMS                | Steel    |
| 25         | P-4138 | #10 x 1-1/4" PH PH SELF-DRILLING TEK (PVC)    | Steel    |
| 26         | P-3539 | #8 x 3/4" PN SQ TEK - Roller Asm/Mortise Lock | Steel    |
| 27         | P-5588 | Hole Plug, 0.500" Dia.                        | Nylon    |
| 28         | P-5563 | KIT, INT/EXT HANDLE W/ THUMBTURN, SGD         | Aluminum |
| 29         | P-3792 | Keeper                                        | Steel    |
| 30         | P-3793 | Multi-Point Mortise Lock                      | Steel    |
| 31         | P-5259 | #10 X 1 Ph FH TEK                             | Steel    |
| 32         | P-5287 | Tandem Roller Assy, 2.125" Dia Wheel          | Steel    |
| 33         | P-5531 | Setting Block, 0.09" x 1" x 2"                | Rubber   |
| 34         | P-5480 | Air Seal Bridge - Sill                        | Nylon    |
| 35         | P-5481 | Air Seal Bridge - Head                        | Nylon    |
| 36         | P-5482 | Panel Guide - Interlock Stile                 | Nylon    |
| 37         | P-5483 | Panel Guide - Lock Stile                      | Nylon    |
| 38         | P-5484 | Bumper/Panel Guide - Frame and Astragal       | Nylon    |
| 39         | P-5485 | Offset Glazing Gasket                         | Rubber   |
| 40         | P-5486 | Bumper/Panel Guide - Interlock                | Rubber   |
| 41         | P-5498 | Glazing Bead Wedge Gasket                     | Rubber   |
| 42         | S-2137 | Screen, Astragal                              | Aluminum |
| 43         | H-2135 | Screen, 1-Track Head                          | Aluminum |
| 45         | S-2134 | Screen, 1-Track Sill                          | Aluminum |
| 46         | S-2053 | Screen, 2-Track Head                          | Aluminum |
| 47         | S-2054 | Screen, 2-Track Jamb                          | Aluminum |
| 48         | S-2055 | Screen, 2-Track Sill                          | Aluminum |
| 49         | S-2056 | Screen, 3-Track Head                          | Aluminum |
| 50         | S-2057 | Screen, 3-Track Jamb                          | Aluminum |
| 51         | S-2058 | Screen, 3-Track Sill                          | Aluminum |
| 52         | S-2059 | Screen, Snap Cover                            | Aluminum |

NOTE: ALL ALUMINUM EXTRUSIONS ARE 6063-T6 UNLESS OTHERWISE NOTED.

| PARTS LIST |        |                                                      |          |
|------------|--------|------------------------------------------------------|----------|
| ITEM       | PART # | DESCRIPTION                                          | MATERIAL |
| 53         | S-2090 | Hook Strip                                           | Aluminum |
| 54         | S-2092 | IG Glazing Bead, 1"                                  | Aluminum |
| 55         | S-2093 | Track Filler - Head                                  | Aluminum |
| 56         | S-2097 | Screen, Interlock                                    | Aluminum |
| 57         |        | Screw, Fixed Panel Clip to Panel                     | Steel    |
| 58         |        | Fixed Panel Clip                                     | Aluminum |
| 59         |        | Gasket, Frame Assembly                               |          |
| 60         |        | Dust Plug @ Head, 1-1/4" x 3-1/2" x 0.44" Tall, Fin  |          |
| 61         |        | Dust Plug @ Sill, 1-3/16" x 3-1/2" x 0.44" Tall, Fin |          |
| 62         |        | Screen, Spline                                       | Rubber   |
| 63         |        | Screen, Cloth                                        |          |

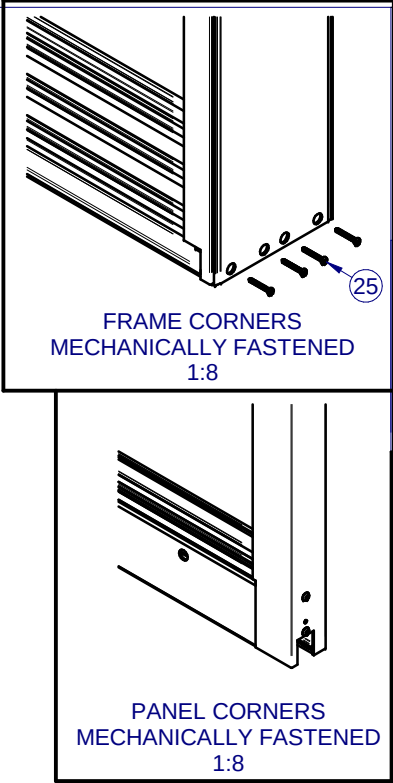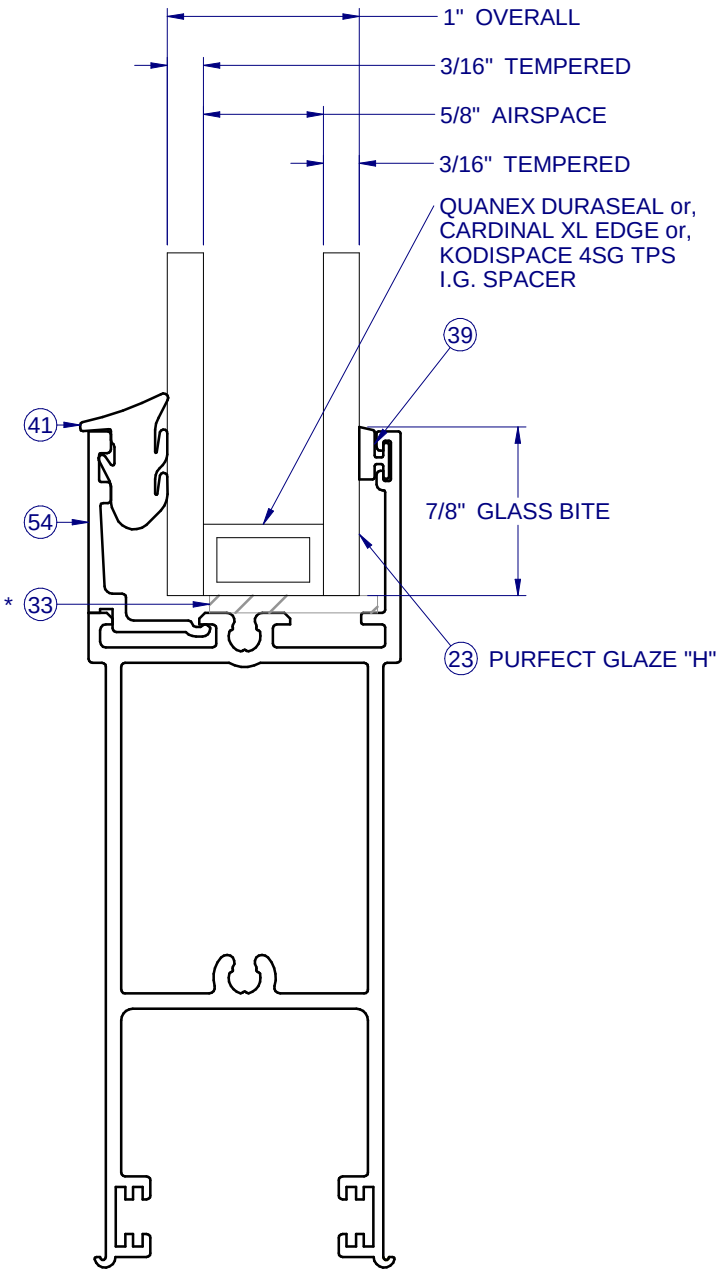




1900 SW 44TH AVE.  
OCALA, FLORIDA 34474  
WWW.CWS.CC

## 380 ALUM. SLIDING GLASS DOOR NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:  
20443

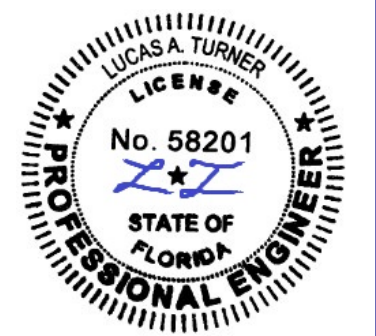


9/19/2023

LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering & Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574

SHEET DESCRIPTION:  
BOM AND GLAZING  
DETAIL

|                    |                    |
|--------------------|--------------------|
| DRAWN BY:<br>MCS   | DATE:<br>9/19/2023 |
| DWG #:<br>CWS-1155 | REV.:<br>B         |
| SCALE:<br>1:1      | SHEET<br>4 OF 11   |

\* SETTING BLOCKS PER FBC 2411.3.3.1

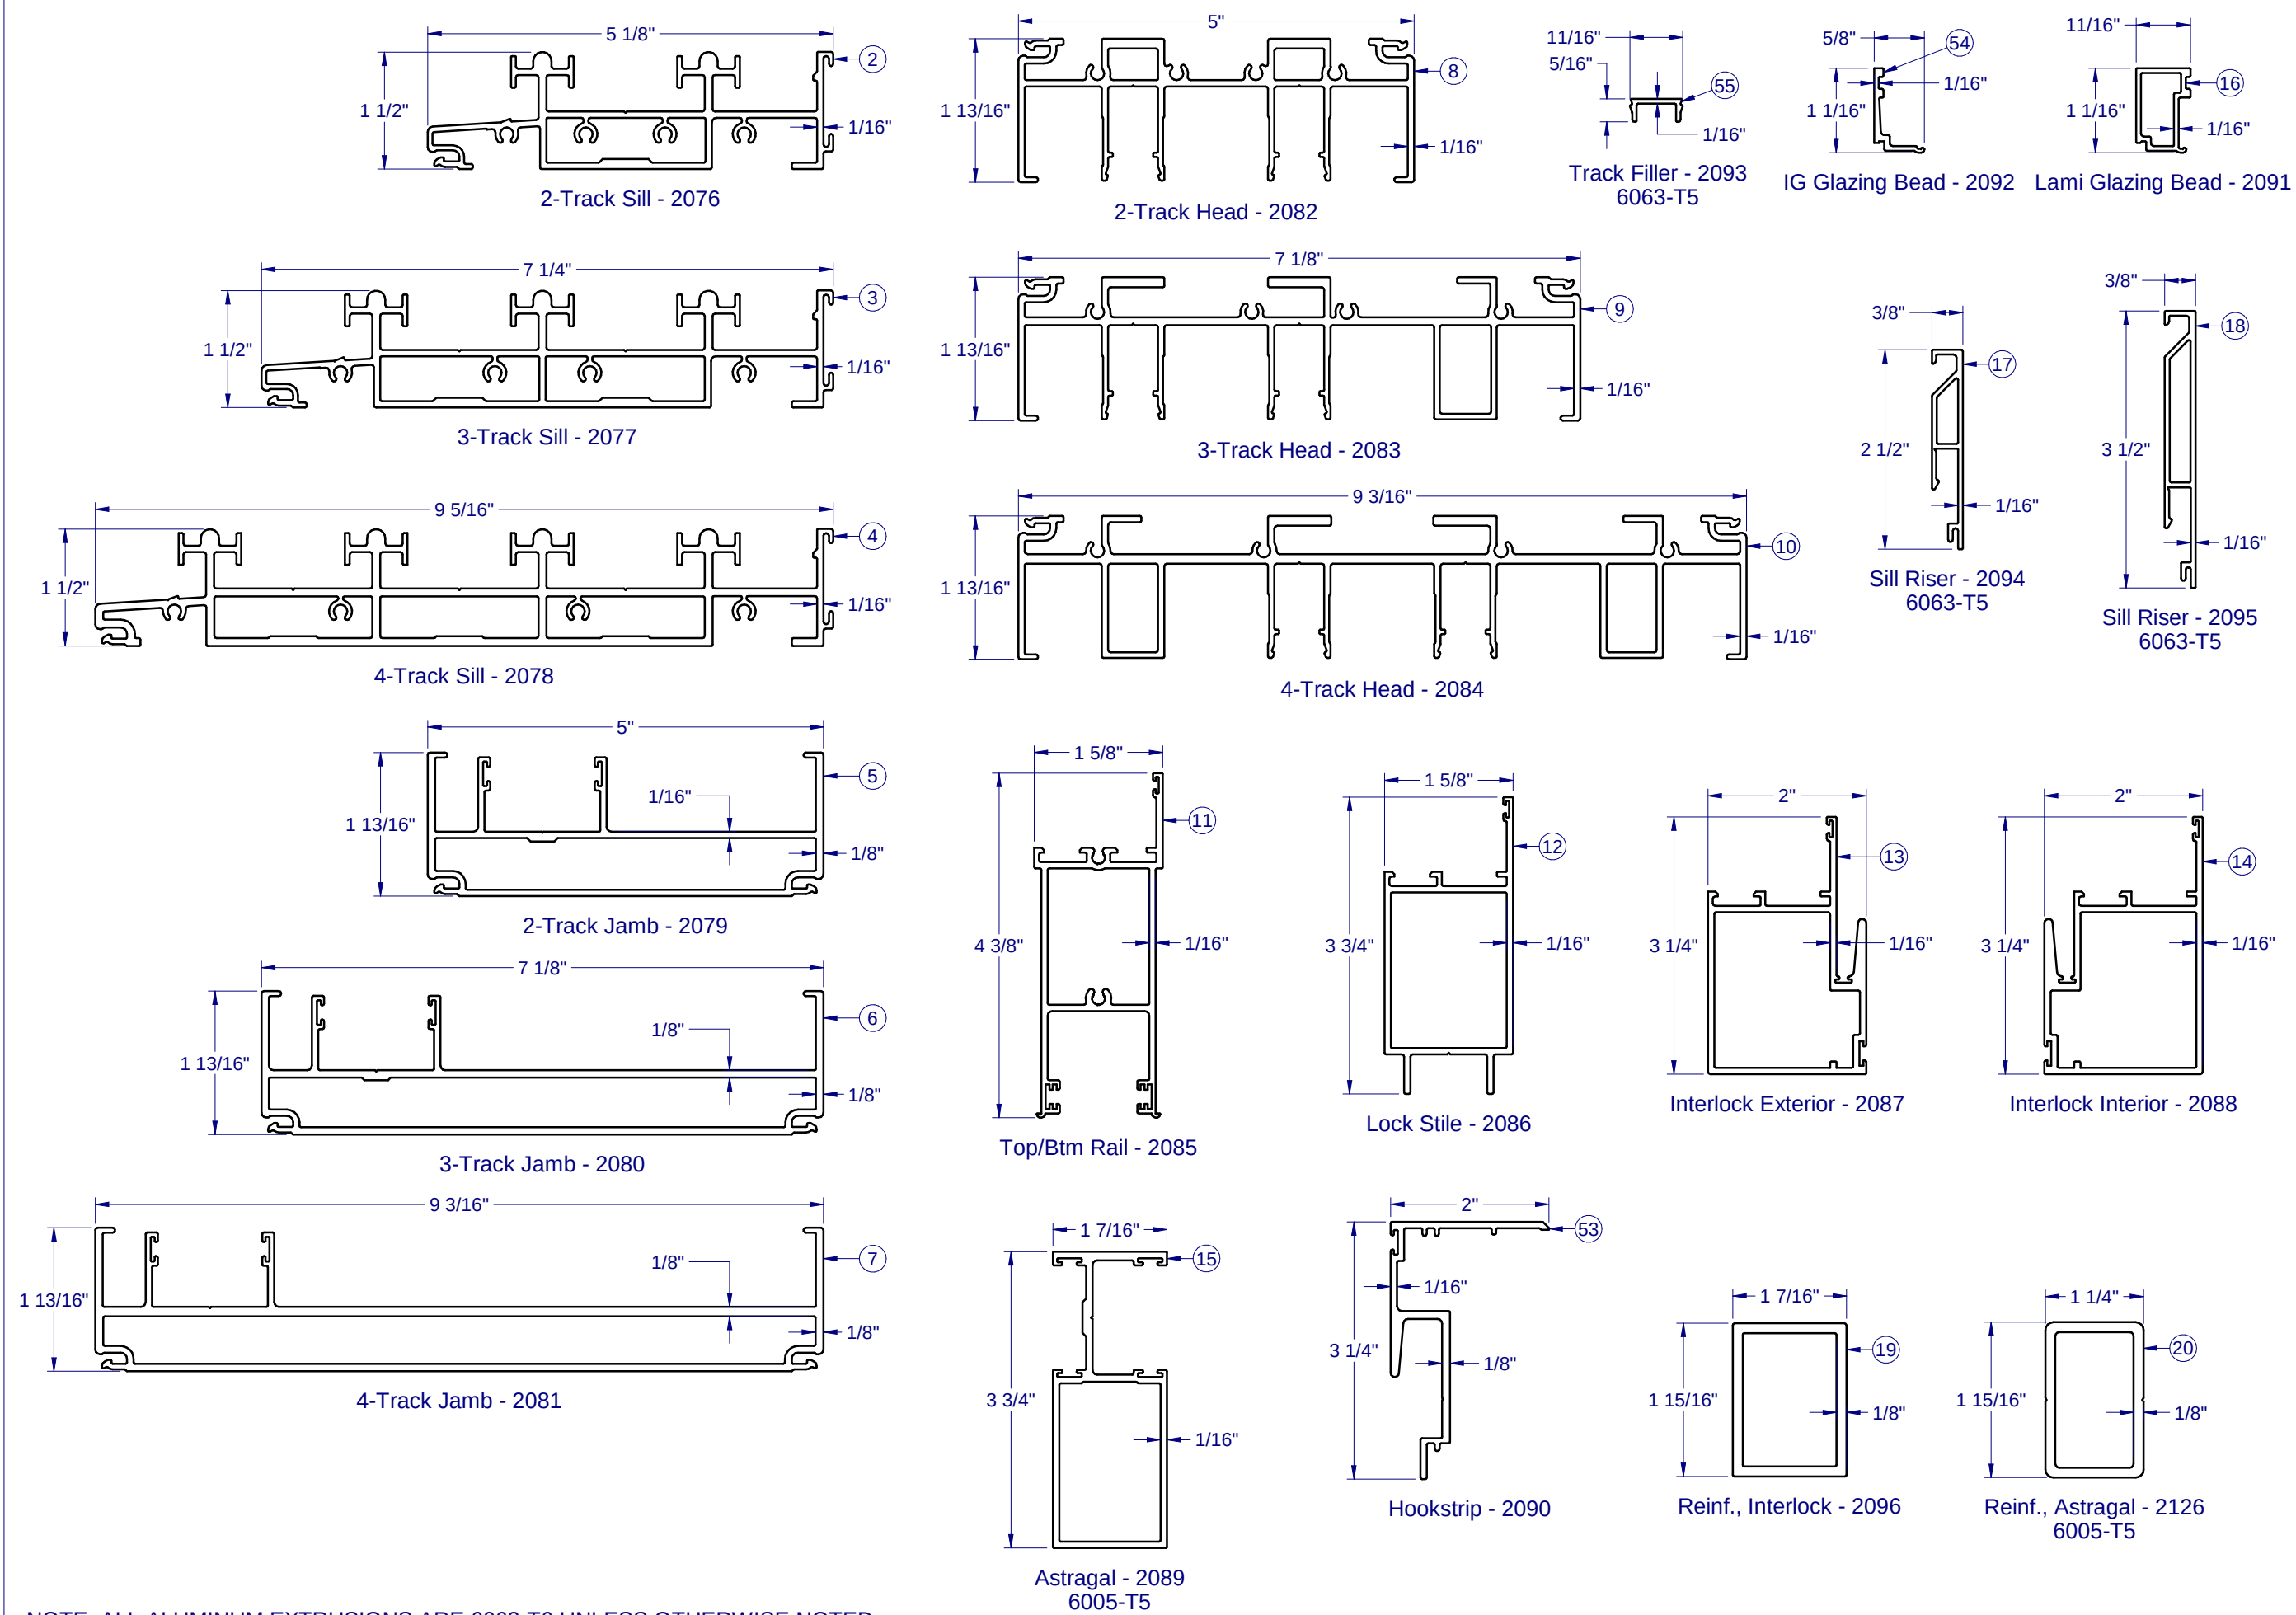

NOTE: ALL ALUMINUM EXTRUSIONS ARE 6063-T6 UNLESS OTHERWISE NOTED.



1900 SW 44TH AVE.  
OCALA, FLORIDA 34474  
WWW.CWS.CC

380 ALUM. SLIDING  
GLASS DOOR  
NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:  
20443




9/19/2023


LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering & Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574

SHEET DESCRIPTION:  
EXTRUSIONS


|           |           |
|-----------|-----------|
| DRAWN BY: | DATE:     |
| MCS       | 9/19/2023 |
| DWG #:    | REV.:     |
| CWS-1155  | B         |
| SCALE:    | SHEET     |
| 1:2       | 5 OF 11   |

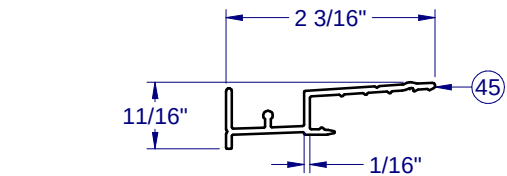


Screen, 1-Track Sill - 2134

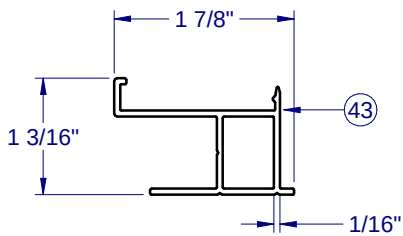


Screen, 1-Track Head/Jamb - 2135

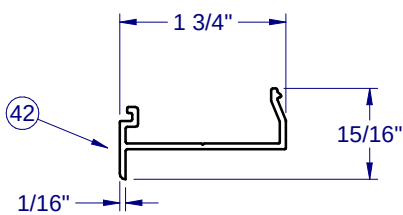


Screen, Astragal - 2137




Screen, Snap Cover - 2059




Screen, 2-Track Sill - 2055

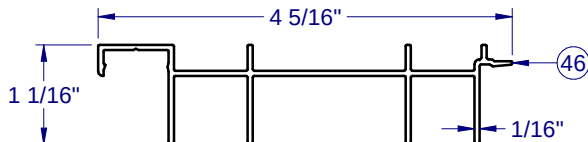


Screen, 2-Track Head - 2053

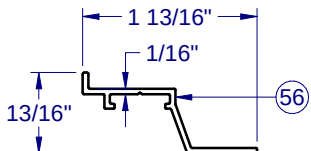


Screen, Interlock - 2097

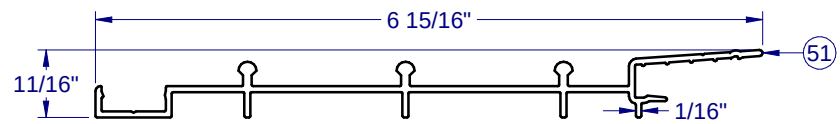


Screen, 3-Track Sill - 2058

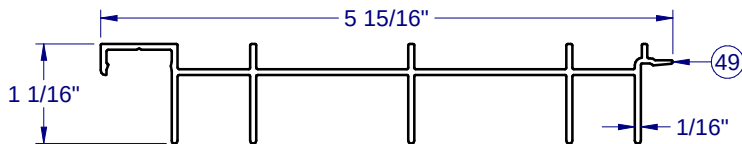


Screen, 3-Track Head - 2056

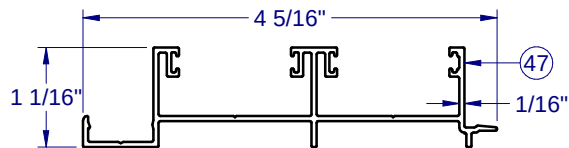


Screen, 2-Track Jamb - 2054

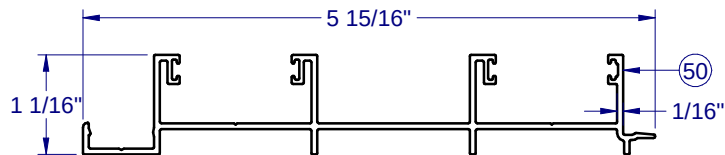


Screen, 3-Track Jamb - 2057

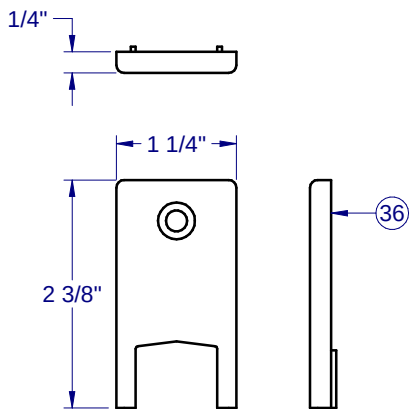

Panel Guide, Interlock - P-5482

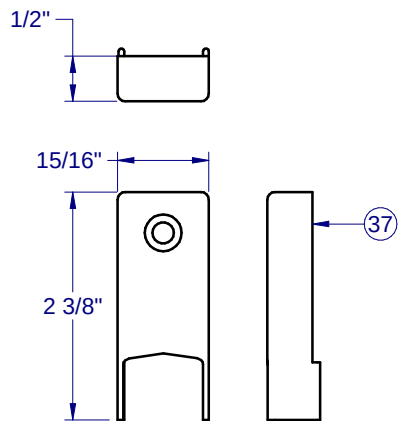

Panel Guide, Lock Stile - P-5483

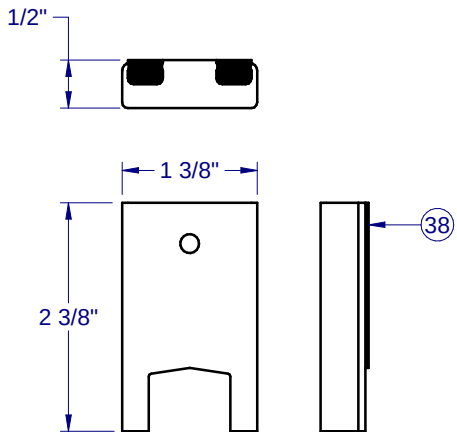

Bumper/Panel Guide - P-5484

NOTE: ALL ALUMINUM EXTRUSIONS ARE 6063-T6 UNLESS OTHERWISE NOTED.

**380 ALUM. SLIDING  
GLASS DOOR  
NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL  
THE INFORMATION CONTAINED IN  
THIS DRAWING IS THE SOLE  
PROPERTY OF CUSTOM WINDOW  
SYSTEMS, INC. ANY  
REPRODUCTION IN PART OR AS A  
WHOLE WITHOUT THE WRITTEN  
PERMISSION OF CUSTOM WINDOW  
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:  
20443




9/19/2023

LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering &  
Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574


SHEET DESCRIPTION:

EXTRUSIONS


|           |           |
|-----------|-----------|
| DRAWN BY: | DATE:     |
| MCS       | 9/19/2023 |
| DWG #:    | REV.:     |
| CWS-1155  | B         |
| SCALE:    | SHEET     |
| 1:2       | 6 OF 11   |

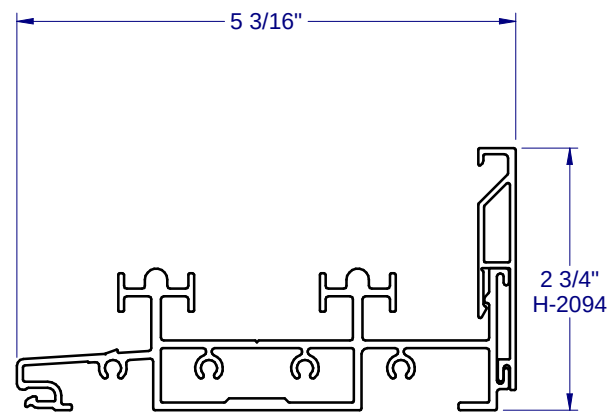


2T Sill w/Riser

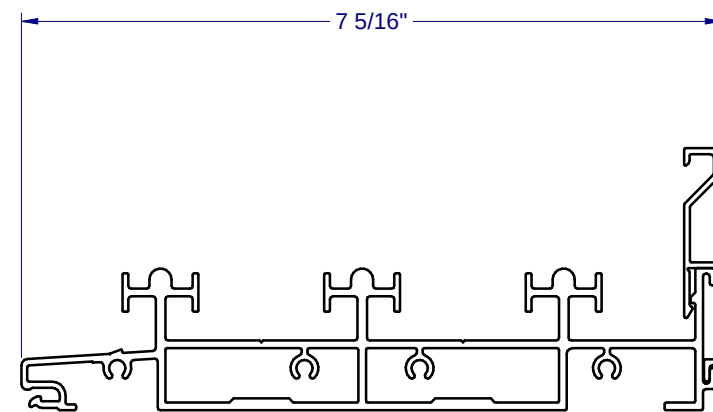


3T Sill w/Riser

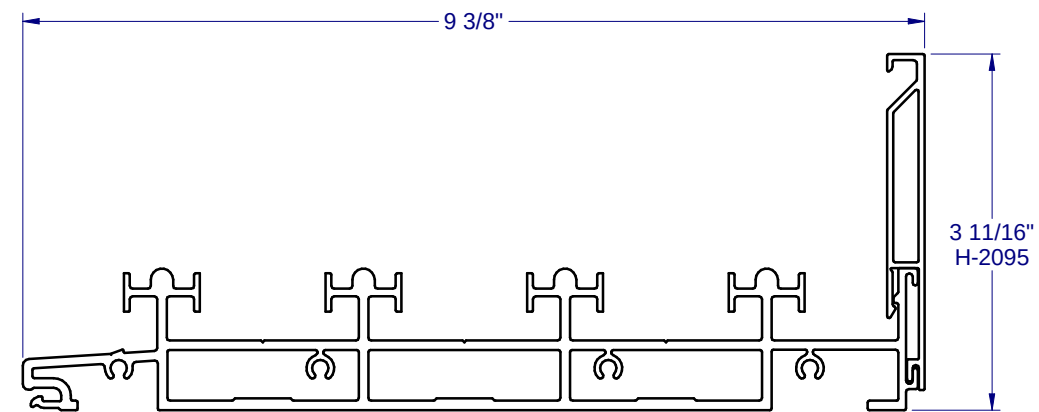


4T Sill w/Riser

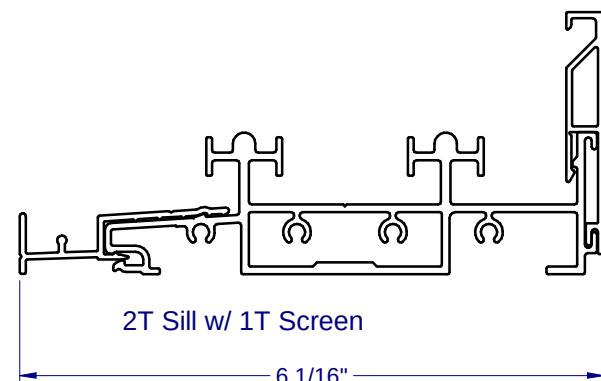


2T Sill w/ 1T Screen

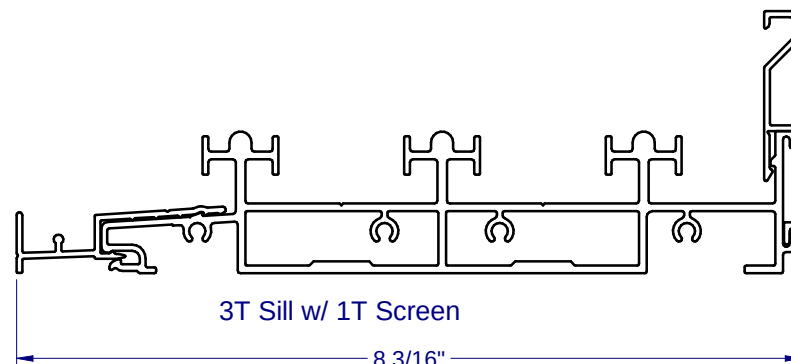


3T Sill w/ 1T Screen

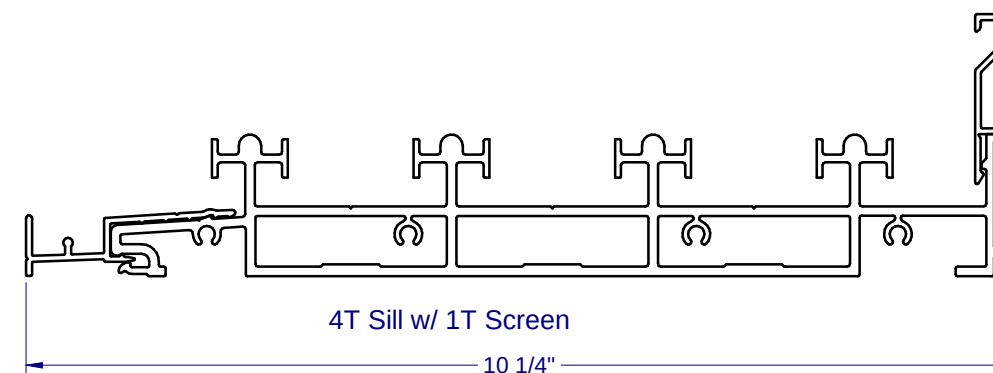

4T Sill w/ 1T Screen

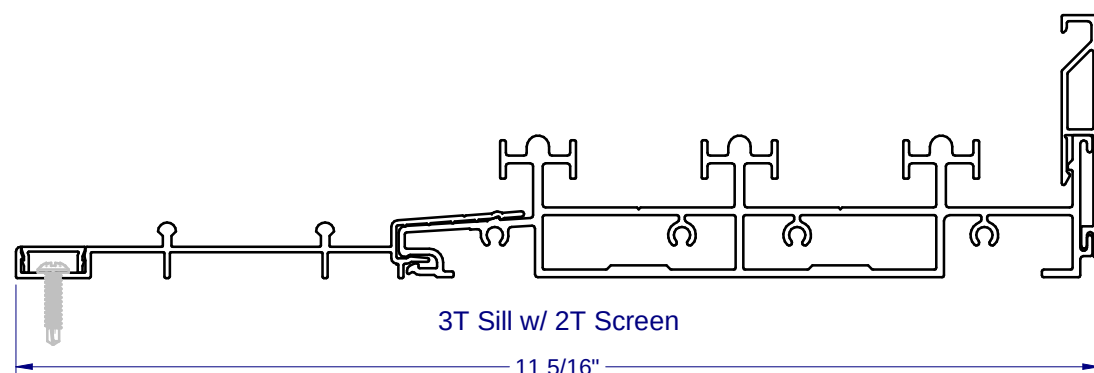

3T Sill w/ 2T Screen

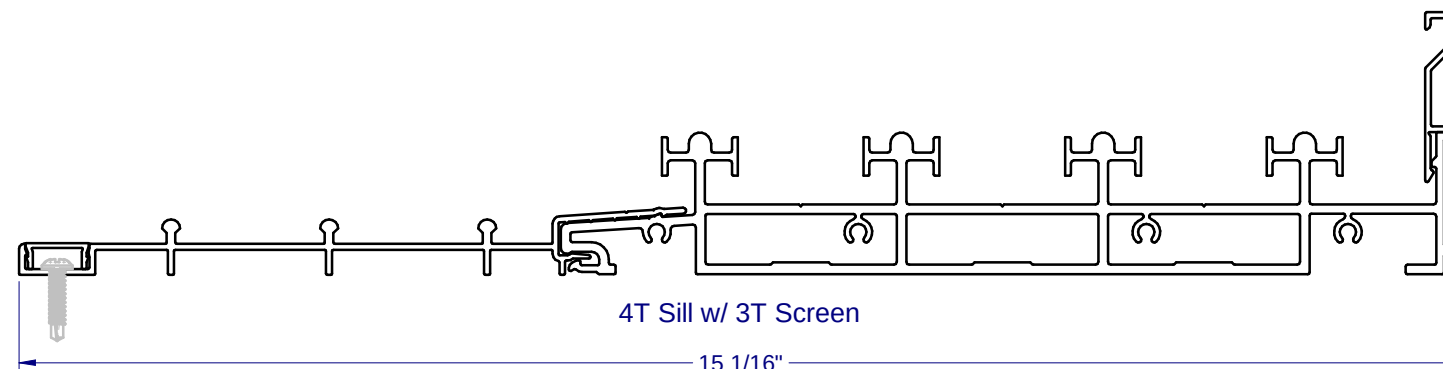

4T Sill w/ 3T Screen



1900 SW 44TH AVE.  
OCALA, FLORIDA 34474  
WWW.CWS.CC


## 380 ALUM. SLIDING GLASS DOOR NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN  
THIS DRAWING IS THE SOLE  
PROPERTY OF CUSTOM WINDOW  
SYSTEMS, INC. ANY  
REPRODUCTION IN PART OR AS A  
WHOLE WITHOUT THE WRITTEN  
PERMISSION OF CUSTOM WINDOW  
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:

20443

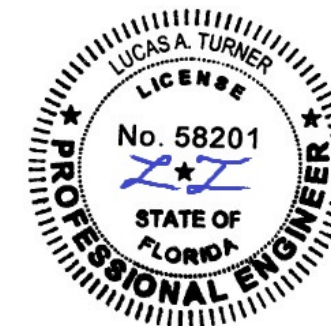


9/19/2023

LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering &  
Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574

SHEET DESCRIPTION:

### TRACK WIDTHS

|           |           |
|-----------|-----------|
| DRAWN BY: | DATE:     |
| MCS       | 9/19/2023 |
| DWG #:    | REV.:     |
| CWS-1155  | B         |
| SCALE:    | SHEET     |
| 1:2       | 7 OF 11   |

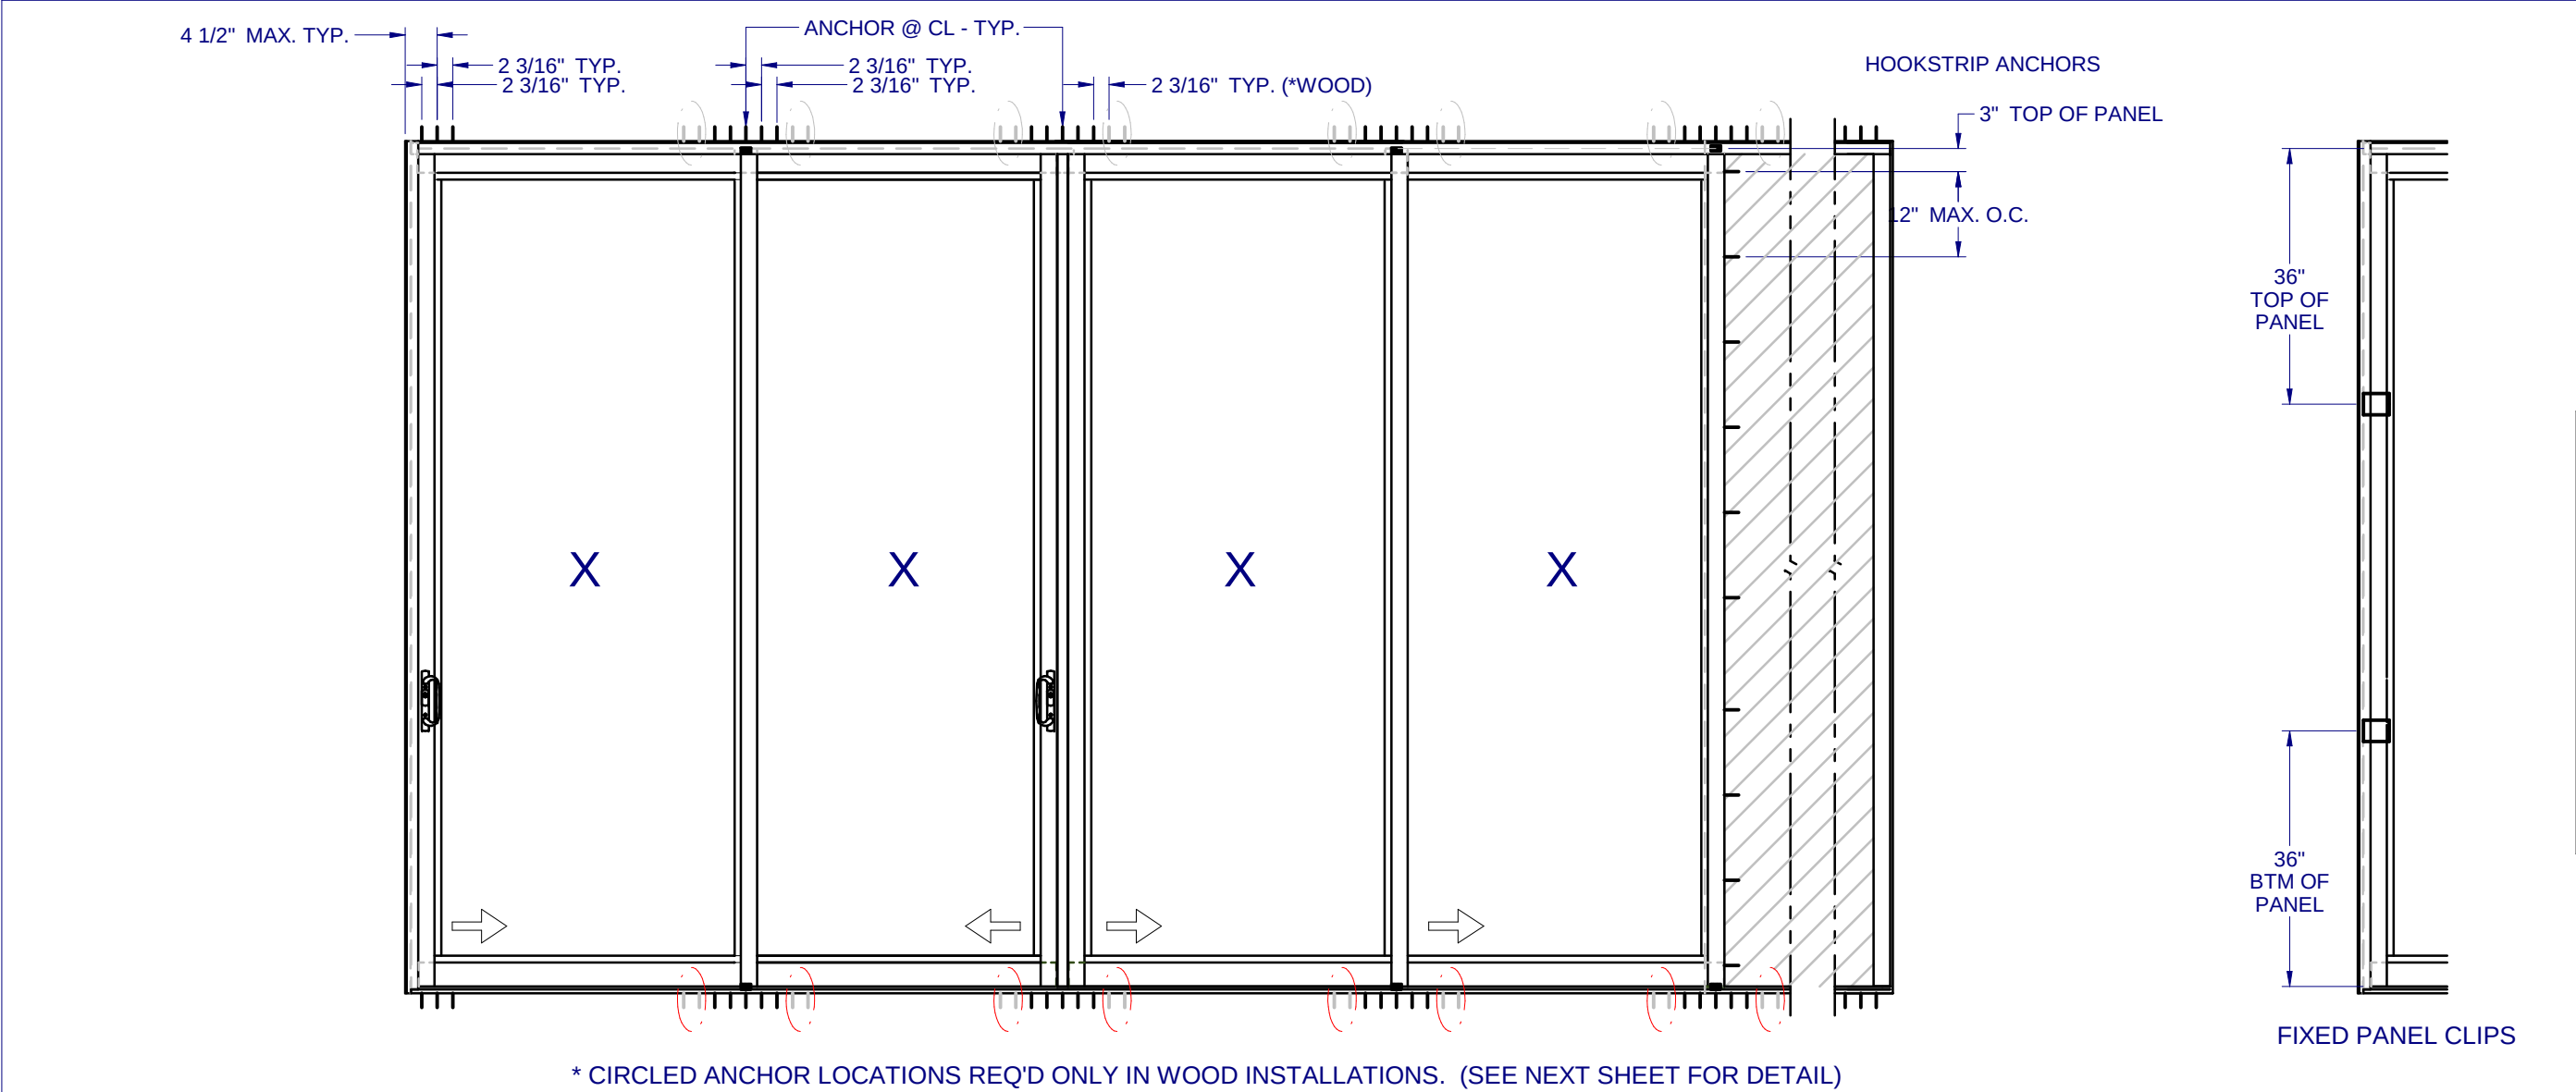

NOTES:

1. INSTALL ONE ANCHOR AT EACH INSTALLATION LOCATION (SEE STAGGER DETAILS ON NEXT SHEET). SILL ANCHOR SPACING SAME AS HEAD FOR 3T AND 4T. INSTALL ONE ANCHOR AT EACH LOCATION IN HOOKSTRIP. SEE SPECIAL LOCATIONS AND SPACING FOR 2T SILL, NEXT SHEET.
2. SHIM AS REQ AT EACH INSTALLATION ANCHOR USING LOAD BEARING SHIMS. MAX. ALLOWABLE SHIM STACK TO BE 1/4". USE SHIMS WHERE SPACE GREATER THAN 1/16" IS PRESENT. LOAD BEARING SHIMS SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER. WOOD SHIMS ARE NOT ALLOWED.
3. ANCHOR TYPE, SIZE, SPACING AND EMBEDMENT SHALL BE AS SPECIFIED IN THESE DRAWINGS, SEE TABLE 1, SHEET 10.
4. ALL INSTALLATION ANCHORS MUST BE MADE OF OR PROTECTED WITH A CORROSION RESISTANT MATERIAL OR COATING. DISSIMILAR METALS OR MATERIALS IN CONTACT WITH PRESSURE TREATED WOOD MUST BE PROTECTED TO PREVENT REACTION.
5. INSTALLATION ANCHORS SHALL BE IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM SPECIFIED IN TABLE 1, SHEET 10.
6. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO. FOR CONCRETE/CMU OPENINGS, EMBEDMENT SHALL BE BEYOND WOOD BUCKS, IF USED, INTO SUBSTRATE. INSTALLATIONS TO SOLID CONCRETE OR GROUT-FILLED CMU MAY INCLUDE BUT DO NOT REQUIRE 1X WOOD BUCKS BETWEEN THE PRODUCT AND SUBSTRATE. INSTALLATIONS TO HOLLOW CMU REQUIRE THE USE OF 1X BUCKS BETWEEN THE PRODUCT AND SUBSTRATE.
7. A MINIMUM CENTER-TO-CENTER SPACING SHALL BE MAINTAINED BETWEEN ALL FASTENERS: 3" FOR SOLID CONCRETE, 6" FOR CMU MASONRY, 1" FOR WOOD AND METAL.
8. WOOD OR MASONRY OPENINGS, BUCKS AND BUCK FASTENERS SHALL BE PROPERLY DESIGNED BY THE ARCHITECT OR ENGINEER OF RECORD AND INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE. SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS AS SHOWN IN TABLE1, SHEET 10. CONCRETE AND MASONRY SUBSTRATES MAY NOT BE CRACKED.
9. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS FOLLOWING THE CURRENT VERSION OF THE REFERENCE DOCUMENTS: FMA/AAMA 100(FIN WINDOWS), FMA/AAMA 200(FLANGE WINDOWS), FMA/WDMA 250(BOX WINDOWS), FMA/AAMA/WDMA 300(EXTERIOR DOORS)



1900 SW 44TH AVE.  
OCALA, FLORIDA 34474  
WWW.CWS.CC


**380 ALUM. SLIDING GLASS DOOR NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:

20443

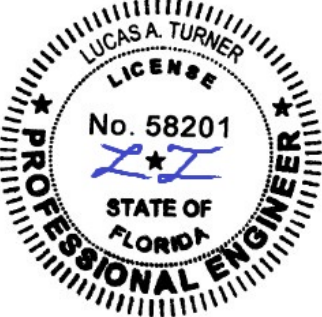


9/19/2023

LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering & Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574


SHEET DESCRIPTION:

**ANCHOR SCHEDULE AND NOTES**


|           |           |
|-----------|-----------|
| DRAWN BY: | DATE:     |
| MCS       | 9/19/2023 |
| DWG #:    | REV.:     |
| CWS-1155  | B         |
| SCALE:    | SHEET     |
| 1:25      | 8 OF 11   |

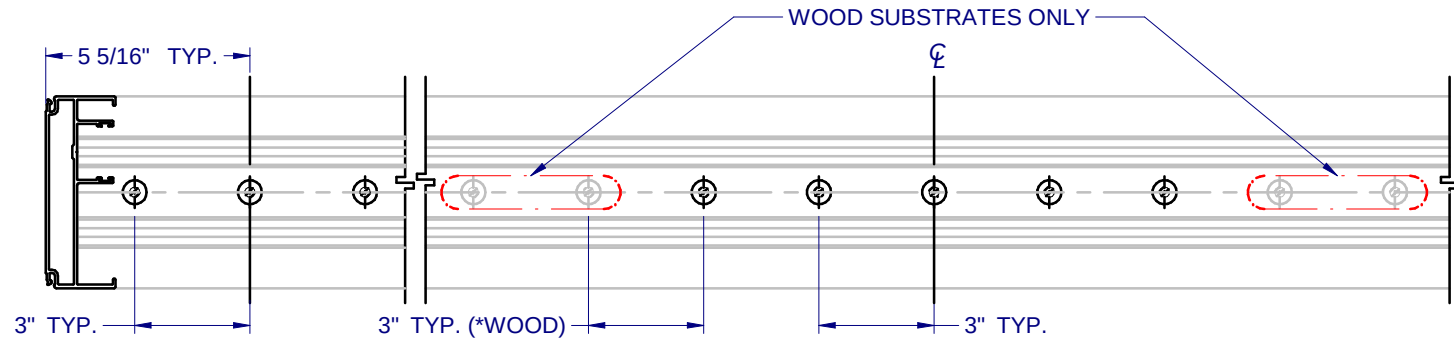


2T SILL

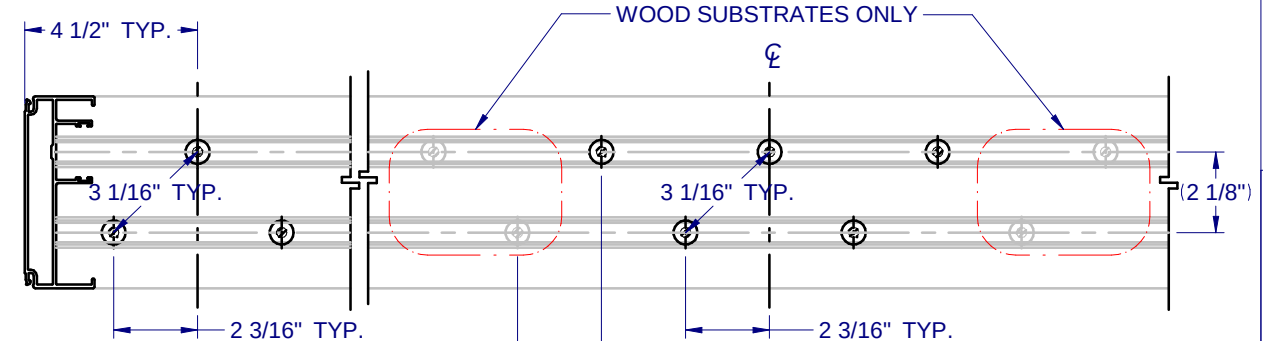


2T HEAD

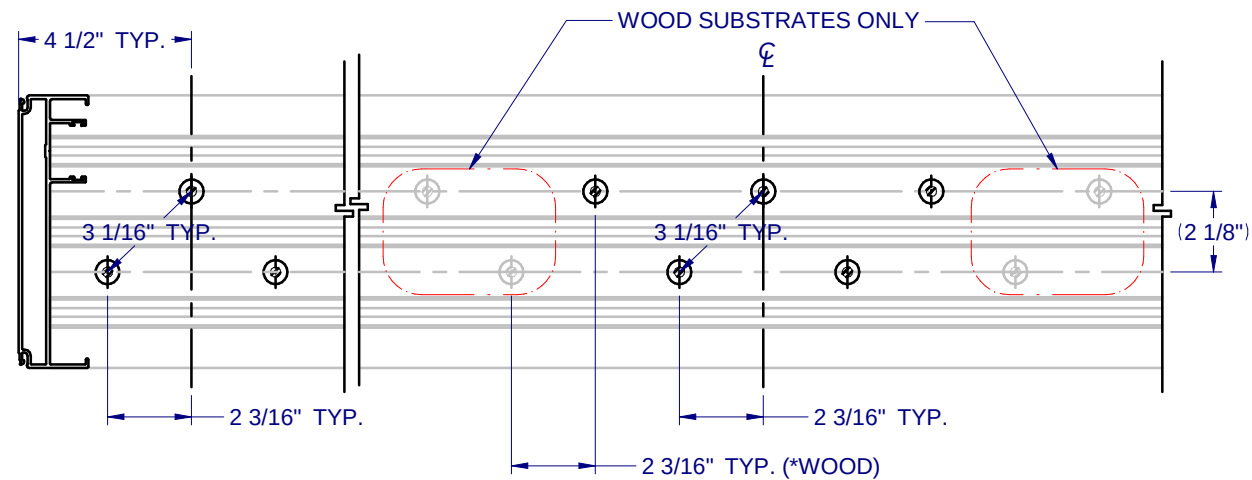


3T SILL

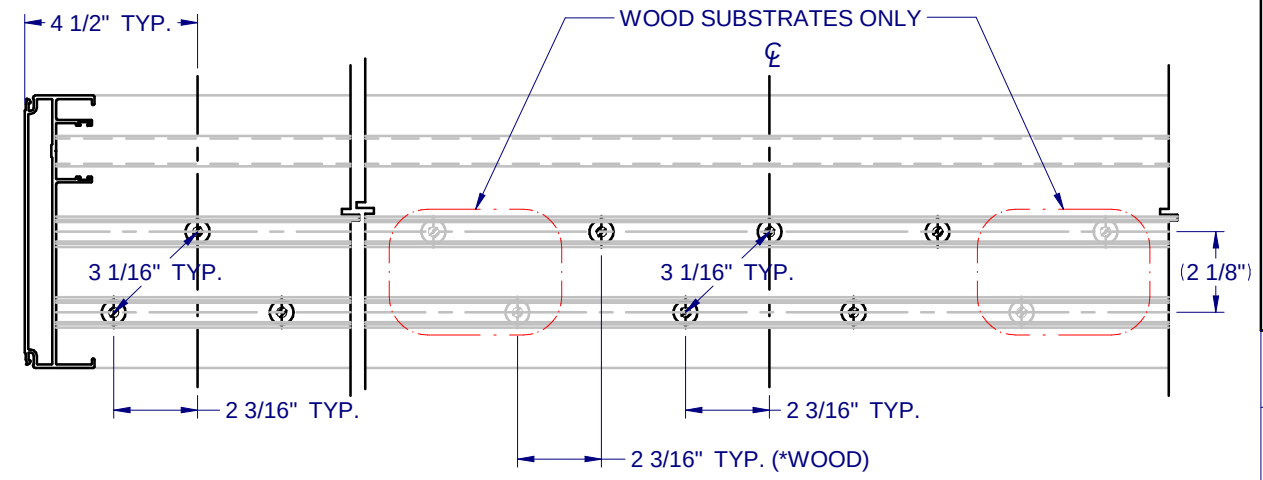

3T HEAD

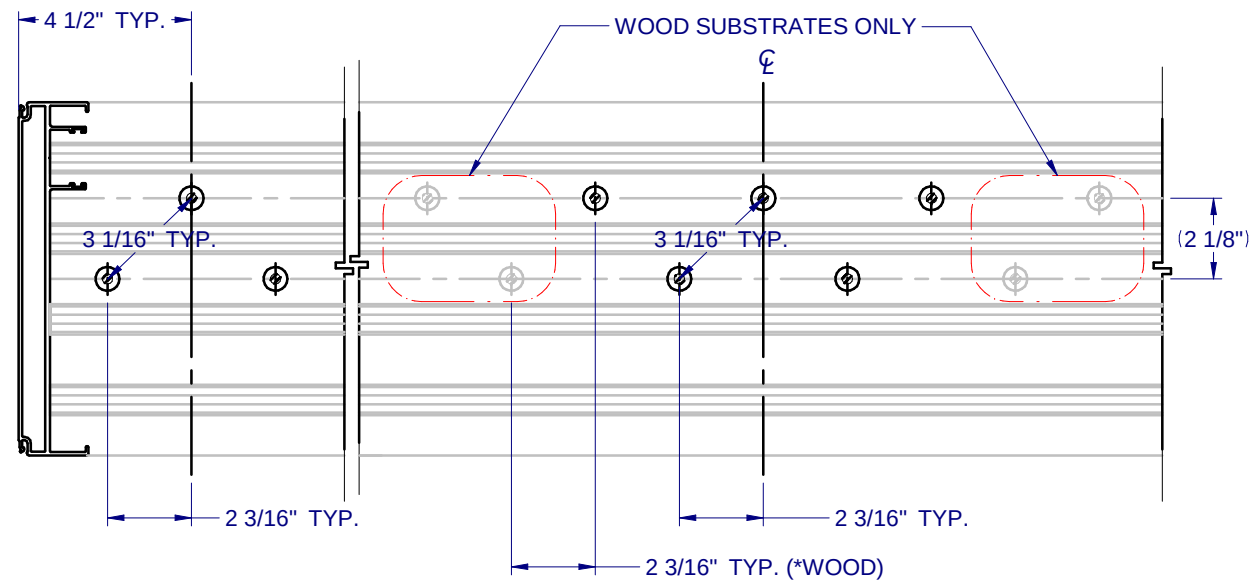

4T SILL

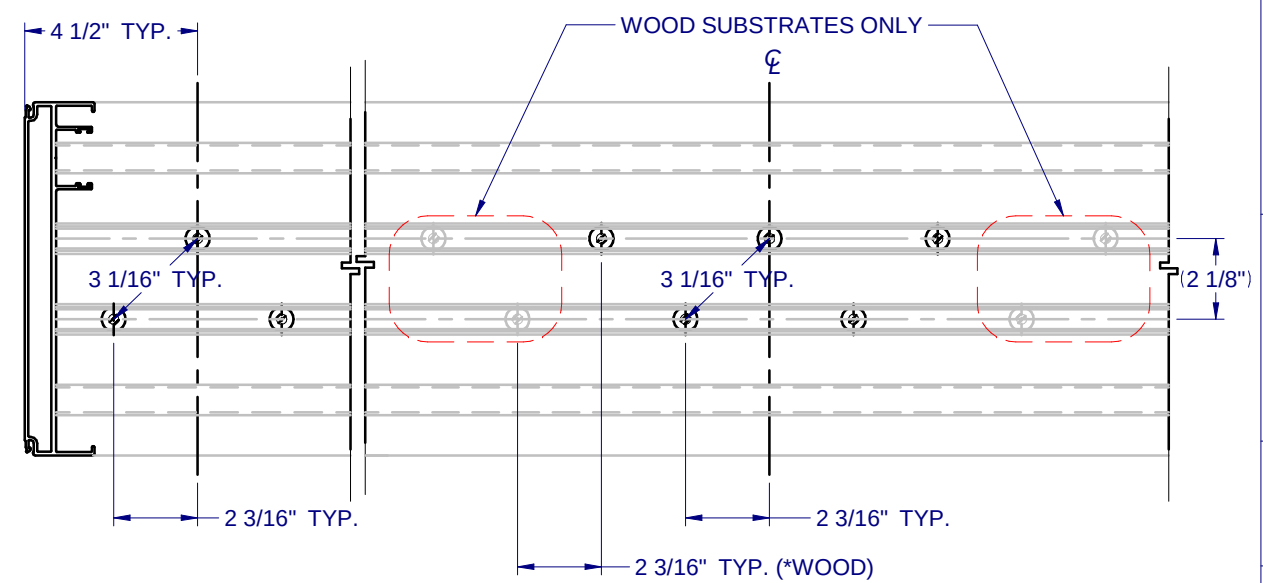

4T HEAD

\* CIRCLED ANCHOR LOCATIONS REQ'D ONLY IN WOOD INSTALLATIONS.

NOTE: CL = CENTERLINE OF INTERLOCK OR ASTRAGAL




1900 SW 44TH AVE.  
OCALA, FLORIDA 34474  
WWW.CWS.CC

## 380 ALUM. SLIDING GLASS DOOR NON-IMPACT

PROPRIETARY AND CONFIDENTIAL  
THE INFORMATION CONTAINED IN  
THIS DRAWING IS THE SOLE  
PROPERTY OF CUSTOM WINDOW  
SYSTEMS, INC. ANY  
REPRODUCTION IN PART OR AS A  
WHOLE WITHOUT THE WRITTEN  
PERMISSION OF CUSTOM WINDOW  
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:

20443

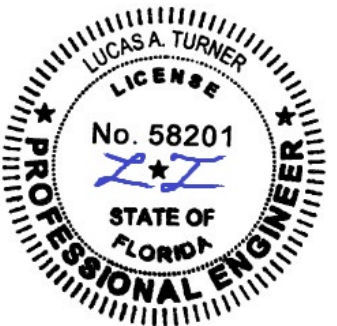

9/19/2023

LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering &  
Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574

SHEET DESCRIPTION:

ANCHOR PATTERNS  
(STAGGER)

DRAWN BY:

MCS

DATE:

9/19/2023

DWG #:

CWS-1155

REV.:


B

SCALE:

1:5


SHEET

9 OF 11

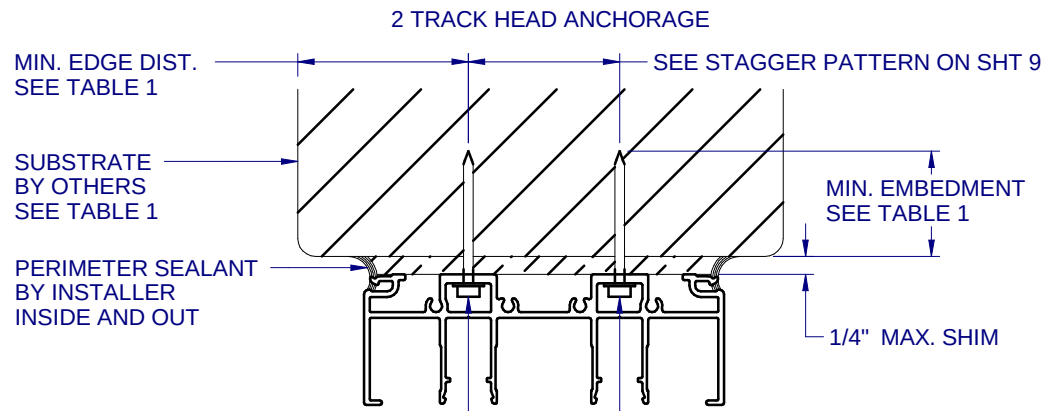


INTERIOR


INSTALLATION ANCHOR SEE TABLE 1

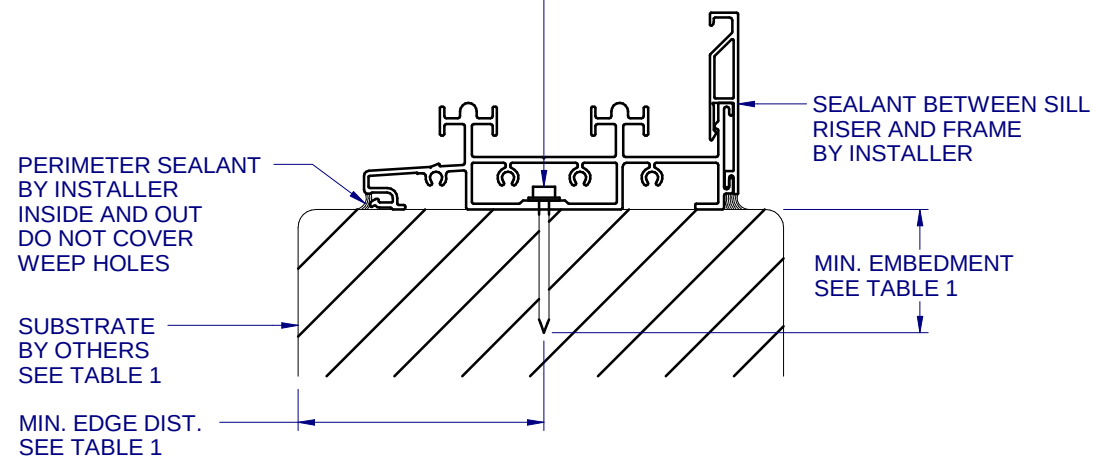

A  
10 VERTICAL SECTION  
2 TRACK SILL ANCHORAGE

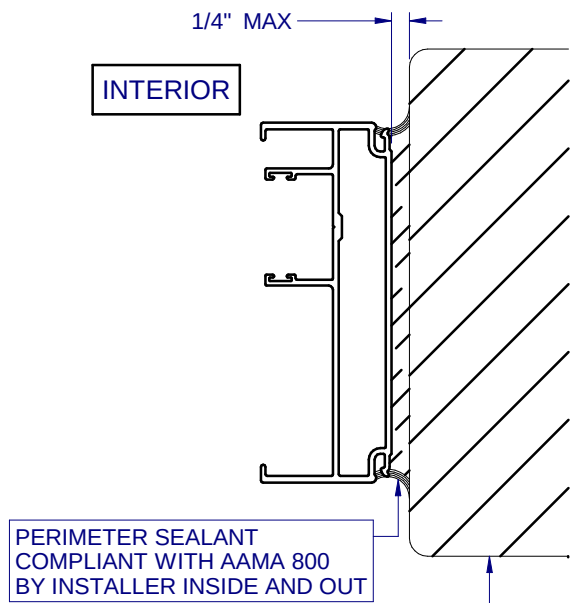

B  
10 HORIZONTAL SECTION  
2 TRACK JAMB ANCHORAGE

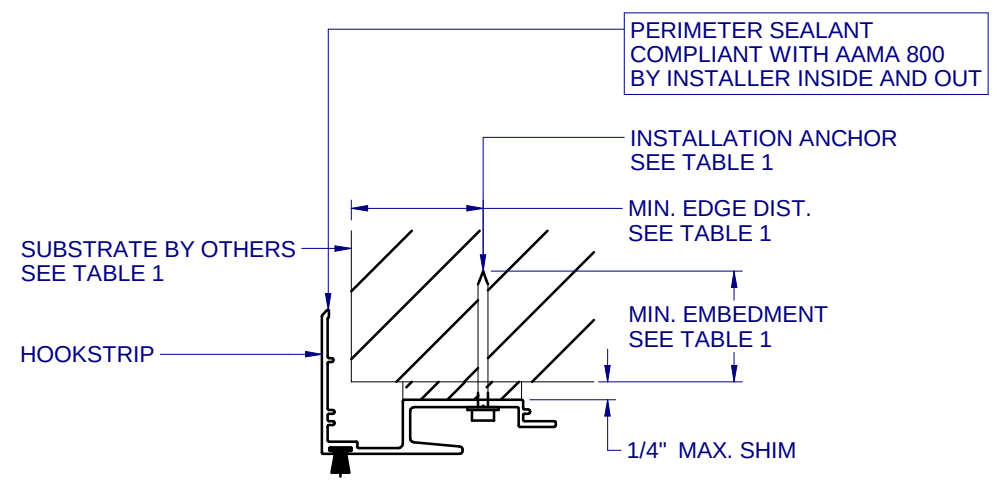

C  
10 HORIZONTAL SECTION  
HOOK STRIP

| TABLE 1: APPROVED INSTALLATION FASTENERS              |                                                        |                         |                 |
|-------------------------------------------------------|--------------------------------------------------------|-------------------------|-----------------|
| SUBSTRATE TYPE                                        | ANCHOR TYPE                                            | MIN. EMBEDMENT          | MIN. EDGE DIST. |
| CONCRETE (2.0 KSI MIN.)                               | 1/4" ITW TAPCON                                        | 1-1/2"                  | 4"              |
| CONCRETE (3.05 KSI MIN.)                              | 1/4" DEWALT ULTRACON+                                  | 1-3/4"                  | 2-1/2"          |
| 2X MIN. SOUTHERN PINE (G=0.55)                        | 1/4" ITW TAPCON OR DEWALT ULTRACON+                    | 1-3/8"                  | 7/8"            |
| 2X MIN. SOUTHERN PINE (G=0.55)                        | #12 WOOD SCREW                                         | 1-3/8"                  | 7/8"            |
| 16 GAUGE (0.060") MIN. STEEL STUD (33 KSI YIELD MIN)  | #12-14 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW | FULL THREAD THRU 0.060" | 1/2"            |
| 1/8" ALUM. (6063-T5 MIN.) OR 1/8" STEEL (33 KSI MIN.) | #12 GRADE 5 SELF-TAPPING / DRILLING SCREW              | FULL THREAD THRU 0.125" | 1/2"            |
| HOKSTRIP ONLY: HOLLOW OR GROUT-FILLED CMU (ASTM C-90) | 1/4" DEWALT ULTRACON+                                  | 1-3/4"                  | 2-1/2"          |

### 380 ALUM. SLIDING GLASS DOOR NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:  
20443





9/19/2023



LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering & Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574

SHEET DESCRIPTION:  
INSTALLATION DETAILS  
2 TRACK


|           |           |
|-----------|-----------|
| DRAWN BY: | DATE:     |
| MCS       | 9/19/2023 |
| DWG #:    | REV.:     |
| CWS-1155  | B         |
| SCALE:    | SHEET     |
| 1:2       | 10 OF 11  |

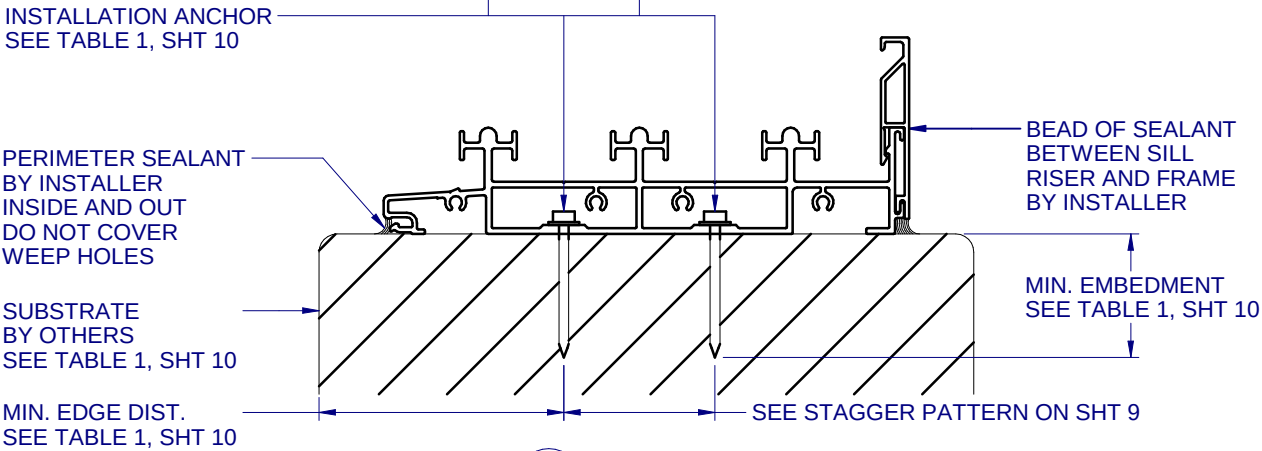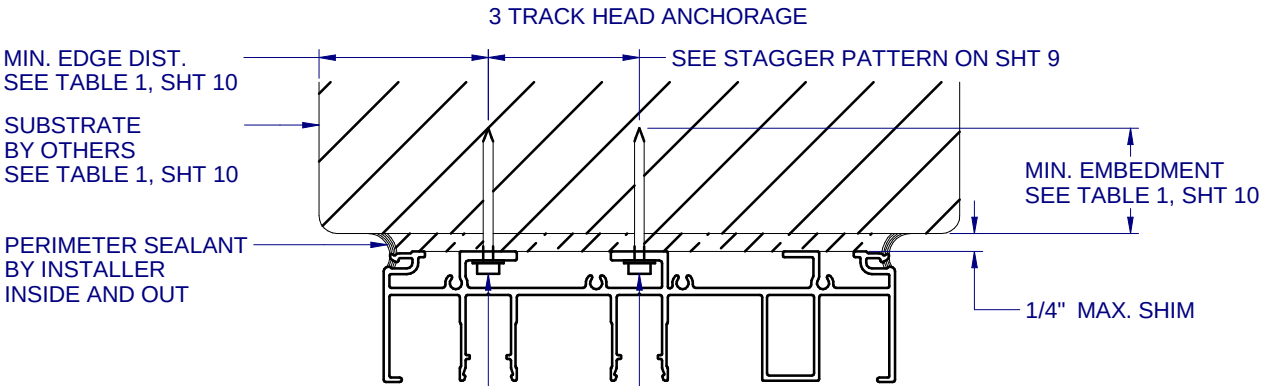


D  
11 VERTICAL SECTION  
3 TRACK SILL ANCHORAGE

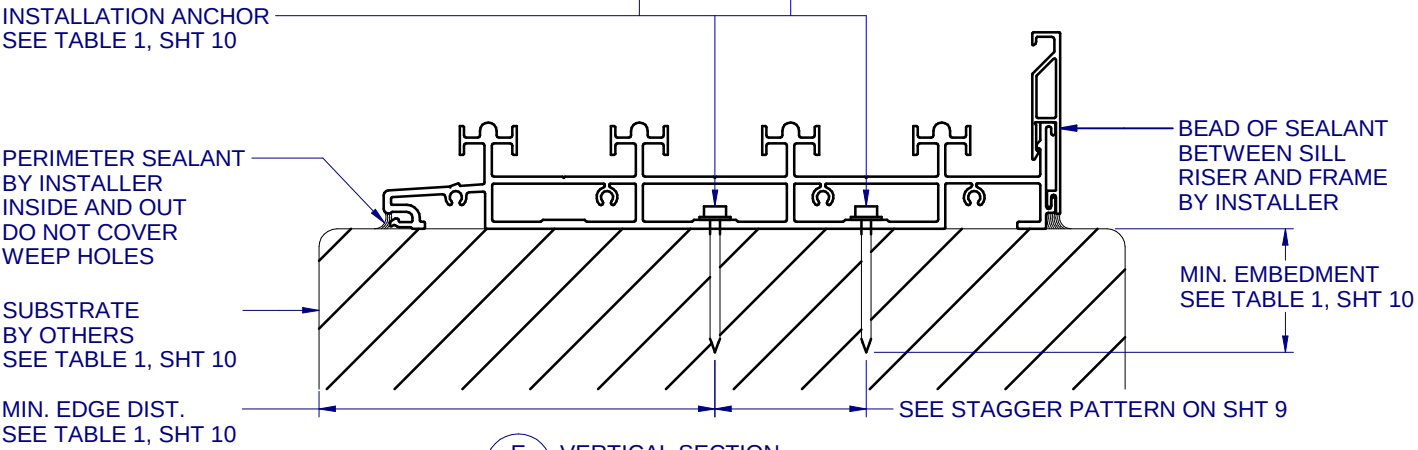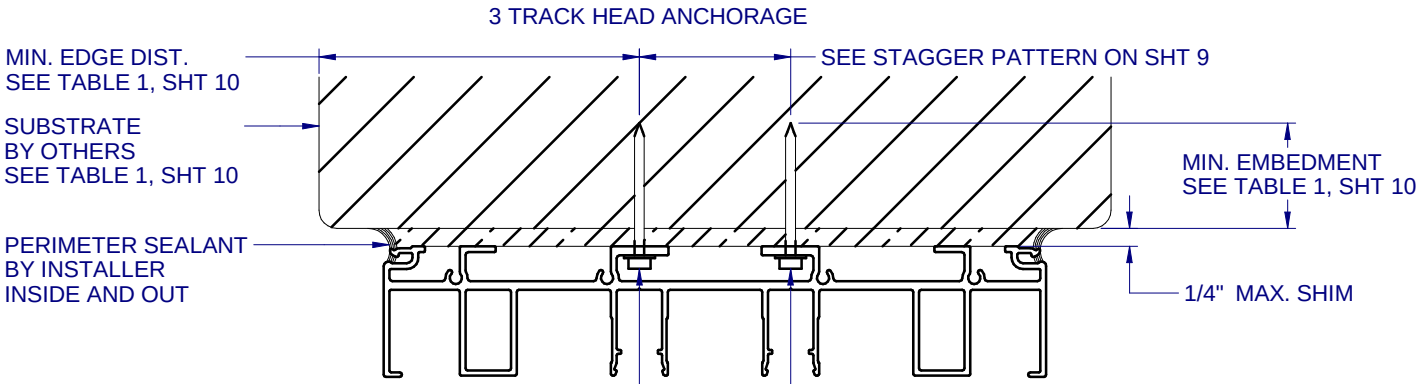

E  
11 VERTICAL SECTION  
4 TRACK SILL ANCHORAGE

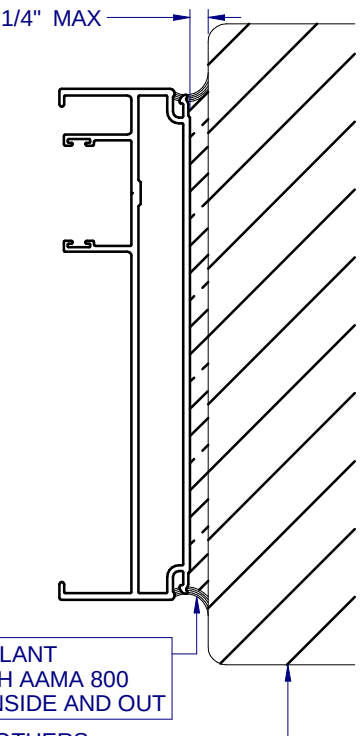

F  
11 HORIZONTAL SECTION  
3 TRACK JAMB ANCHORAGE

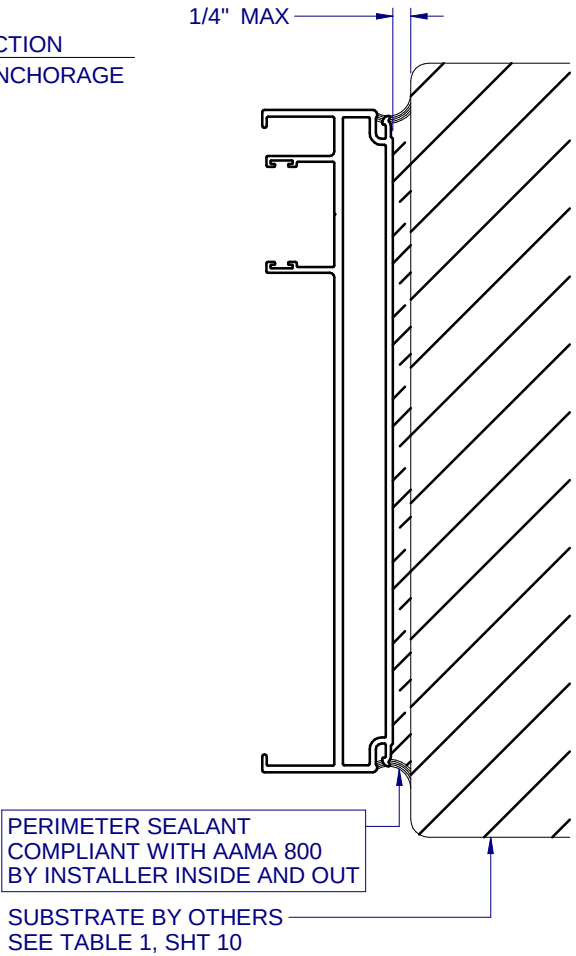

G  
11 HORIZONTAL SECTION  
4 TRACK JAMB ANCHORAGE




1900 SW 44TH AVE.  
OCALA, FLORIDA 34474  
WWW.CWS.CC

### 380 ALUM. SLIDING GLASS DOOR NON-IMPACT

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN  
THIS DRAWING IS THE SOLE  
PROPERTY OF CUSTOM WINDOW  
SYSTEMS, INC. ANY  
REPRODUCTION IN PART OR AS A  
WHOLE WITHOUT THE WRITTEN  
PERMISSION OF CUSTOM WINDOW  
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:  
20443

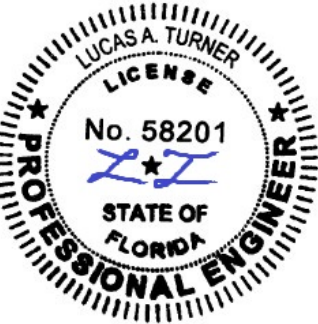

9/19/2023

LUCAS A. TURNER, P.E.  
FL PE # 58201  
Turner Engineering &  
Consulting, Inc.  
2428 Old Natchez Trc Trl  
Camden, TN 38320  
PH. 941-380-1574

SHEET DESCRIPTION:  
INSTALLATION DETAILS  
3 & 4 TRACK

|           |           |
|-----------|-----------|
| DRAWN BY: | DATE:     |
| MCS       | 9/19/2023 |
| DWG #:    | REV.:     |
| CWS-1155  | B         |
| SCALE:    | SHEET     |
| 1:2       | 11 OF 11  |