

Appendix A

Alteration Addendum

Note: *No alterations were required.*

Appendix B

Photographs



Photo No. 1
Unit During Air Infiltration



Photo No. 2
Unit During Water Infiltration



Photo No. 3
Unit During Uniform Static Load Infiltration

Appendix C

Drawings

Note: Complete drawings packet on file with Architectural Testing, Inc.

451TVG825

CONFIDENTIAL AND PROPRIETARY
INFORMATION KAWNEER COMPANY IN

THESE DRAWINGS ARE THE SOLE AND EXCLUSIVE PROPERTY OF KAWNEER AND CONTAIN SENSITIVE, PRIVILEGED OR CONFIDENTIAL INFORMATION WHICH MAY BE USED ONLY FOR ITS BENEFIT. THE DISCLOSURE OF THESE DRAWINGS TO UNAUTHORIZED PERSONS IS STRICTLY PROHIBITED. THIS DOCUMENT AND ALL COPIES MUST BE RETURNED UPON DEMAND.

© COPYRIGHT KAWNEER COMPANY, INC., 2014



Deviations are noted.

Report #: **D7635-550-47**
Date: **6/20/14** Tech: *Adam K. Naggett*

Lyn K. Huppelt



©

TYPICAL "W" BLOCK LOCATION,
DEEP POCKETS ONLY

APPLY SEALANT TO END DAMS AND POSITION ON FLASHING.
INSTALL FLASHING, SEAL OVER HEADS OF FASTENERS.
APPLY SEALANT TO INSIDE JOINTS BETWEEN FLASHING AND END DAMS.
SEAL ALONG EDGES OF END DAMS AND SURROUNDING CONDITION.

DRAWN: MUS	MATERIAL AND FINISH		95484 - 055	-	ESTABLISHED	02/25/14
DATE: 02/25/14	FINISH TO BE #17 CLEAR ANODIZE		E.C. NO.	REV.	DESCRIPTION	DATE
CHECK: BAP	 AN • CO • NY		DRAWING DESC. (AS ORDERED)			TRIFAB 451T VG, FRONT SET, HP SILL INSIDE AND OUTSIDE GLAZE TEST UNIT DRAWINGS
APPRO: GBM			FILE NAME			
SCALE: NONE	Product Engineering & Development					
						451TVG825

NOTES

1. FINISH TO BE #17 CLEAR ANODIZED.
2. ALL MATERIAL TO BE FACTORY FABRICATED, ASSEMBLED, GLAZED, AND INSTALLED IN WOOD BUCKS.
3. WOOD BUCK TO BE SUPPLIED BY KAWNEER - NORCROSS, GEORGIA.




Architectural Testing

Test sample complies with these details.



Deviations are noted.

Report #: **D7635-550-47**

Date: **6/20/14** Tech: *John R. Ruppel*

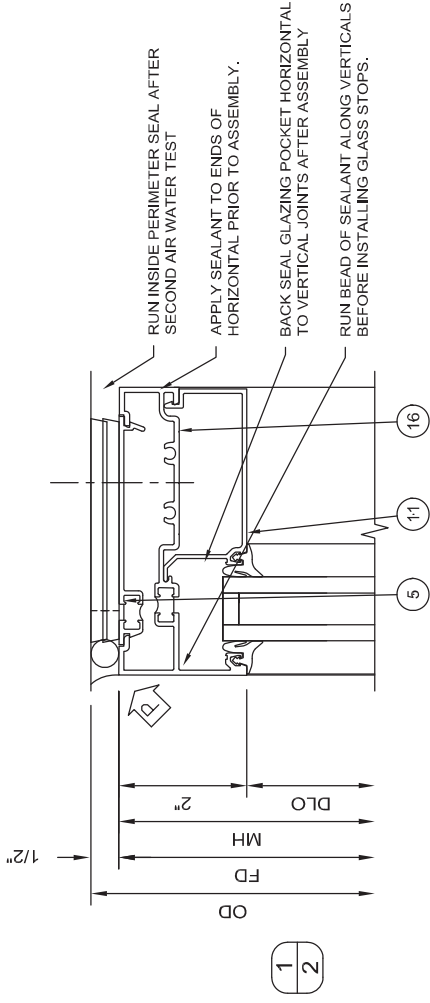

RUN SEALANT ALONG ALL EDGES OF WATER DEFLECTORS AND ALONG VERTICAL JOINTS.

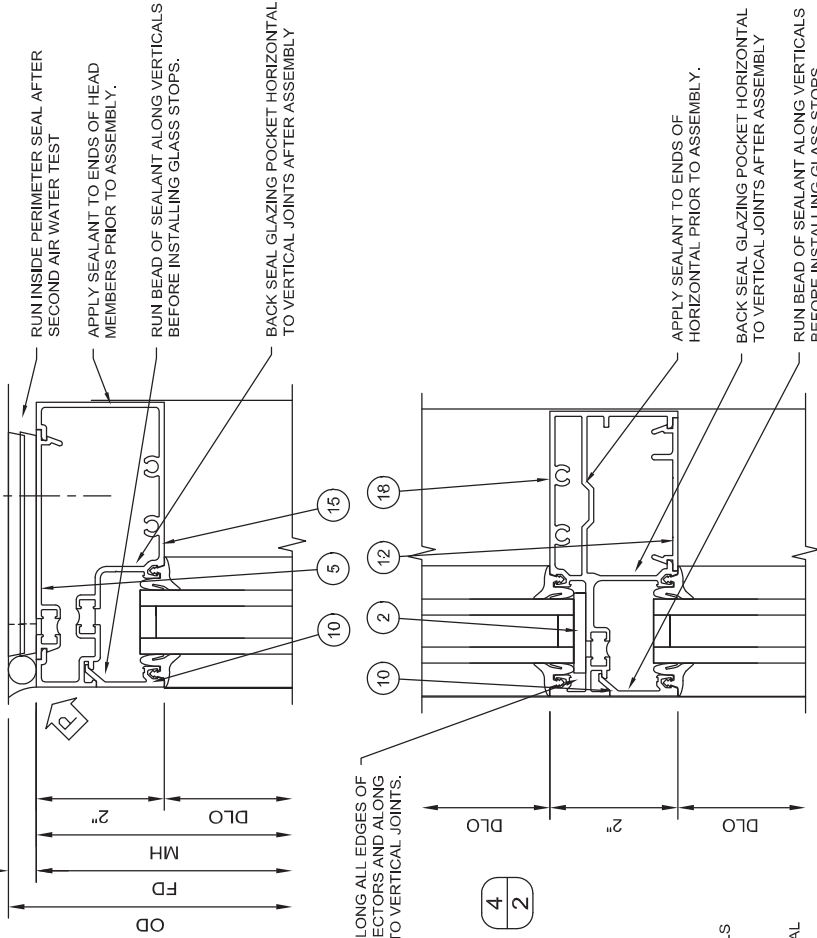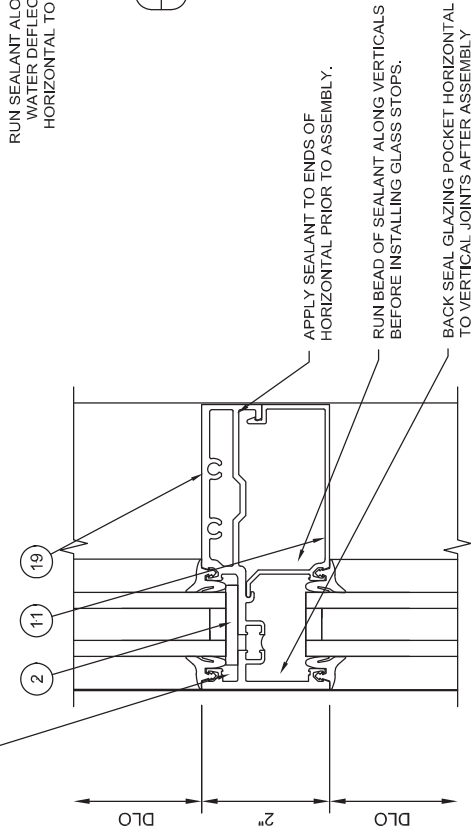

RUN SEALANT ALONG ALL EDGES OF WATER DEFLECTORS AND ALONG HORIZONTAL TO VERTICAL JOINTS.

APPLY SEALANT TO ENDS OF HORIZONTAL PRIOR TO ASSEMBLY.
RUN BEAD OF SEALANT ALONG VERTICALS BEFORE INSTALLING GLASS STOPS.
BACK SEAL GLAZING POCKET HORIZONTAL TO VERTICAL JOINTS AFTER ASSEMBLY.

APPLY SEALANT TO ENDS OF HORIZONTAL PRIOR TO ASSEMBLY.
BACK SEAL GLAZING POCKET HORIZONTAL TO VERTICAL JOINTS AFTER ASSEMBLY
RUN BEAD OF SEALANT ALONG VERTICALS BEFORE INSTALLING GLASS STOPS.

451TVG825

CONFIDENTIAL AND PROPRIETARY INFORMATION KAWNEER COMPANY INC. THESE DRAWINGS ARE THE SOLE AND EXCLUSIVE PROPERTY OF KAWNEER AND CONTAIN SENSITIVE, PRIVILEGED OR CONFIDENTIAL INFORMATION. NOT TO BE REPRODUCED, COPIED, OR DISCLOSED TO ANY OTHER PERSONS WITHOUT THE WRITTEN AUTHORIZATION OF KAWNEER. ANY UNAUTHORIZED REPRODUCTION OR DISCLOSURE OF THIS DOCUMENT AND ALL COPIES MUST BE RETURNED UPON DEMAND. © COPYRIGHT KAWNEER COMPANY, INC., 2014




DRAWN: MJS	MATERIAL AND FINISH	95484 - 055	-	ESTABLISHED	02/25/14
DATE: 02/25/14	FINISH TO BE #17 CLEAR ANODIZE	E.C. NO.	REV.	DESCRIPTION	DATE
CHECK: BAP				TRIFAB 451T VG, FRONT SET, HP SILL	
APPROD: GBM				INSIDE AND OUTSIDE GLAZE	
SCALE: NONE				TEST UNIT DRAWINGS	
	Product Engineering & Development				451TVG825

451TVG825	-
CONFIDENTIAL AND PROPRIETARY INFORMATION KAWNEER COMPANY INC. THESE DRAWINGS ARE THE SOLE AND EXCLUSIVE PROPERTY OF KAWNEER AND CONTAIN SENSITIVE, PRIVILEGED OR CONFIDENTIAL INFORMATION WHICH MAY BE USED ONLY FOR ITS INTENDED PURPOSE. NO PARTS OF THESE DRAWINGS OR UNAUTHORIZED PERSONS IS STRICTLY PROHIBITED. THIS DOCUMENT AND ALL COPIES MUST BE RETURNED UPON DEMAND. © COPYRIGHT KAWNEER COMPANY, INC., 2014	



Architectural Testing

Test sample complies with these details.
 Deviations are noted.
 Report #: **D7635-550-47**
 Date: **6/20/14** Tech: *John R. Ruppel*

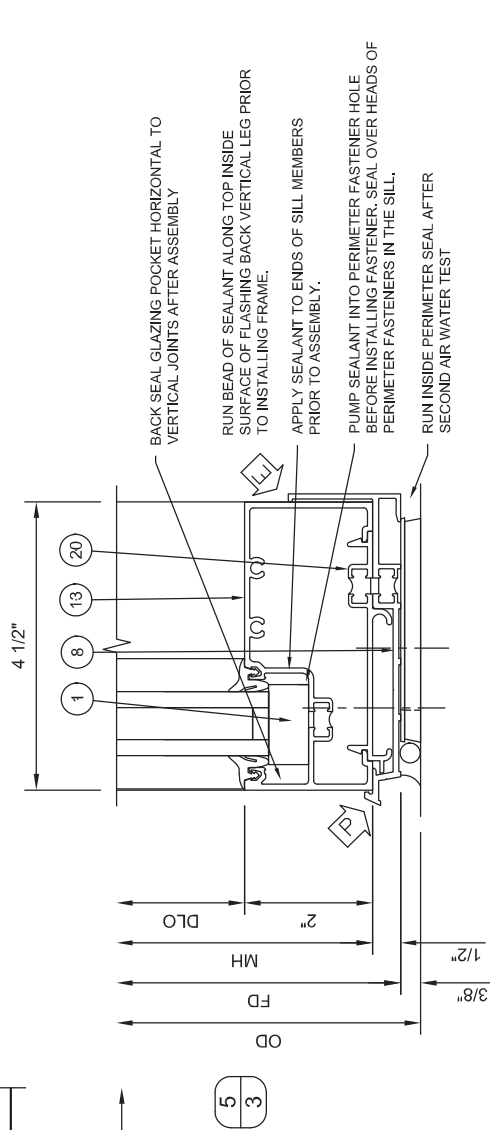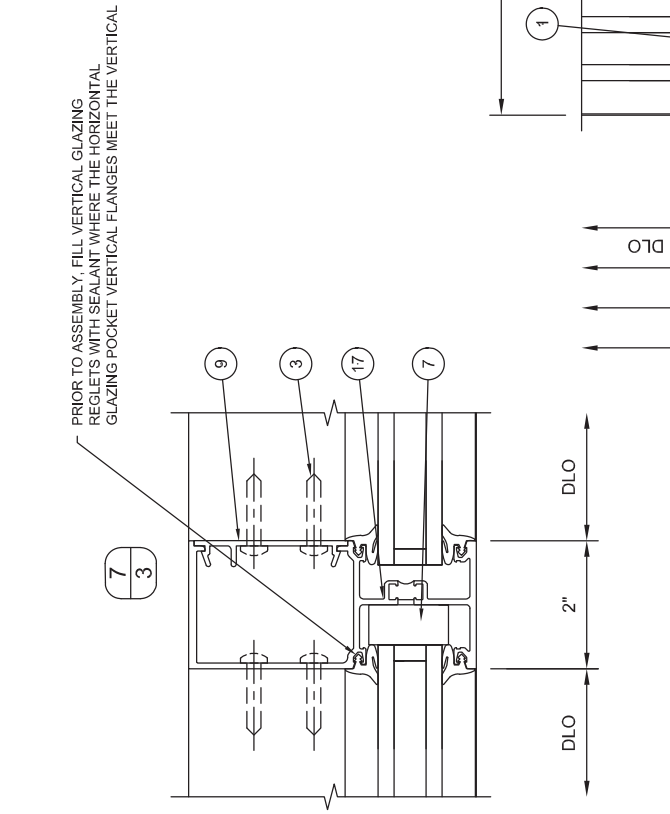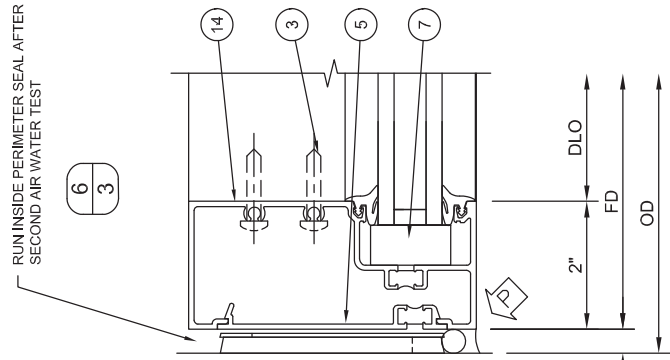

DRAWN: MJS	MATERIAL AND FINISH	95484 - 055	ESTABLISHED	02/25/14
DATE: 02/25/14	FINISH TO BE #17 CLEAR ANODIZE	REV.	DESCRIPTION	DATE
CHECK: BAP	 Product Engineering & Development	TRIFAB 451T VG, FRONT SET, HP SILL		
APPRD: GBM		INSIDE AND OUTSIDE GLAZE TEST UNIT DRAWINGS		
SCALE: NONE		DRAWING DESC. (30 CHRS)	FILE NAME	451TVG825