


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product is required to be protected with an impact resistant covering that complies with Section 1626 of the FBC.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with Section 1609.1.2 & R301.2.1.2 of the FBC.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. Outswing configurations using Coastal Sill (item #19) & Composite Sill (item #16) under active doors meet water infiltration requirements for "HVHZ". All other configurations do not meet the water infiltration requirements for the "HVHZ" and shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.
8. Fiber-Classic & Smooth-Star Door panels require the use of "J" part numbers and must be stained or painted within six months of installation.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes
2	Door Panel Details
3	Elevations
4	Horizontal & Vertical Cross Sections (2X Buck)
5	Horizontal & Vertical Cross Sections (1X Buck)
6	Horizontal & Vertical Cross Sections (Direct to Masonry)
7	Vertical Cross Sections (Thresholds)
8	Buck & Frame Anchoring
9	Hardware Details
10	Components
11	Components & Bill of Materials

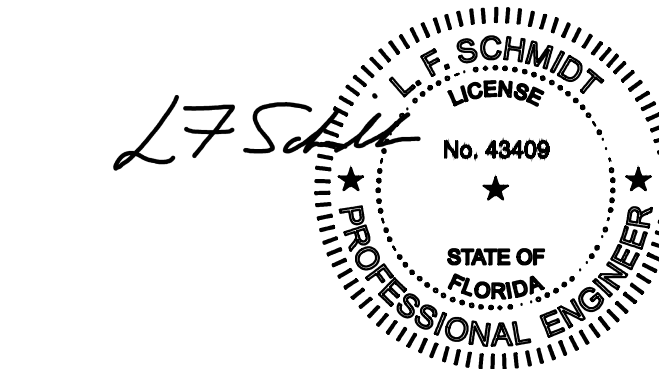


Digitally signed by Lyndon F Schmidt
Date: 2023.08.07 17:35:28 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

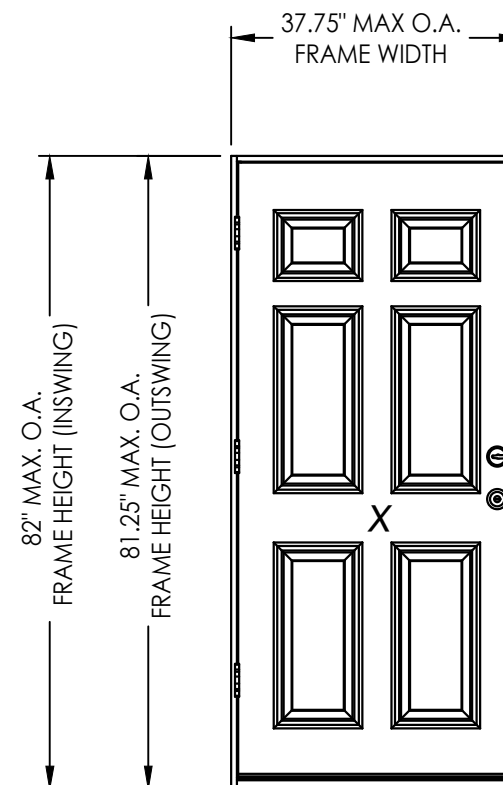


CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	+67.0	-67.0	+67.0	-67.0


See Sheet 3 for Hardware Specifications

DATE: 5/26/16 SCALE: N.T.S. DWG. BY: JK CHK. BY: LFS DRAWING NO.: FL-20470.17 SHEET 1 OF 11		REVISIONS NO. DATE		3 7/25/23 UPDATE TO 8TH ED. (2023) FBC LFS 2 7/22/20 UPDATE TO 7th ED (2020) FBC LFS 1 7/14/17 UPDATE TO 6TH ED. (2017) FBC JK BY		PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES		Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409 <i>RW</i> BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
--	--	-----------------------	--	--	--	---	--	---	--	---	--


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R4\FL-20470.17-19.dwg

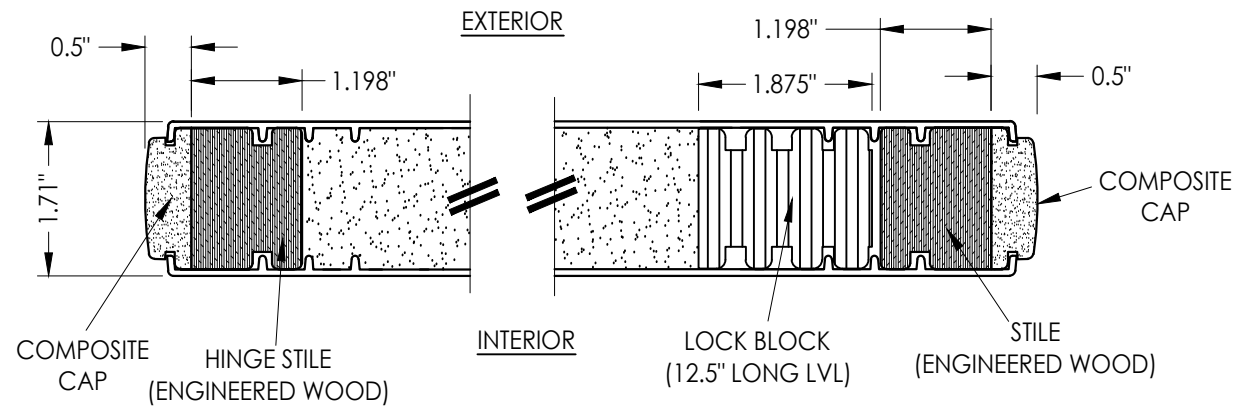


1
2 HORIZONTAL CROSS SECTION

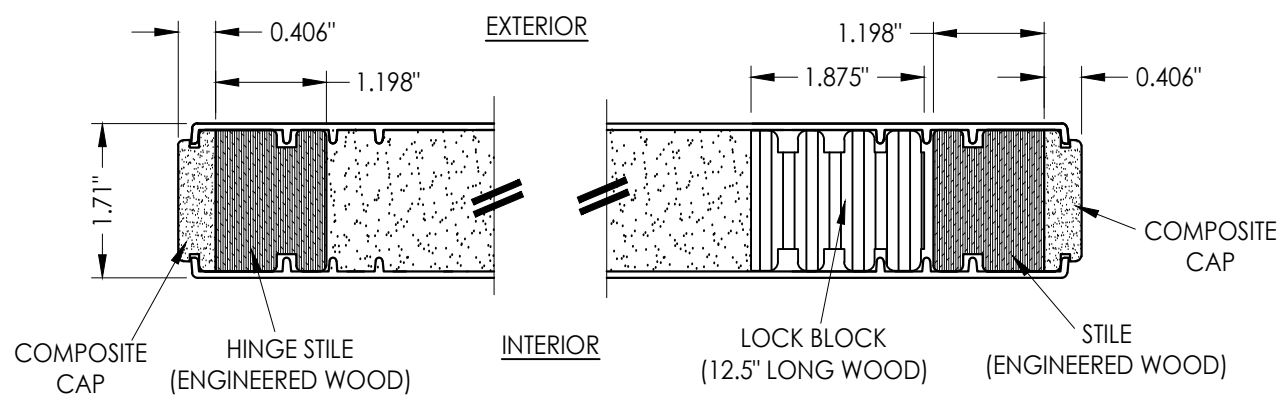


2
2 HORIZONTAL CROSS SECTION

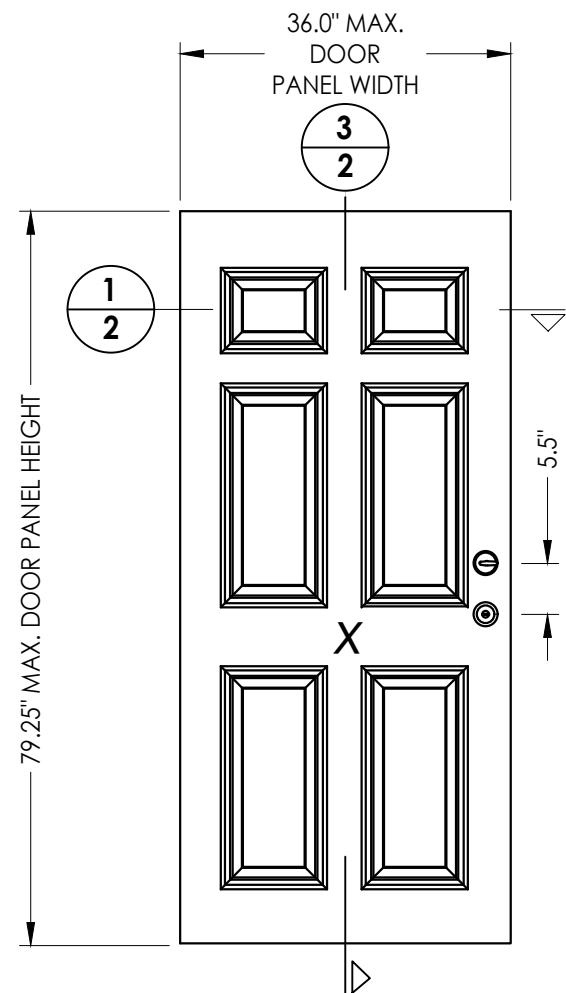


40 DOOR PANEL BOOK

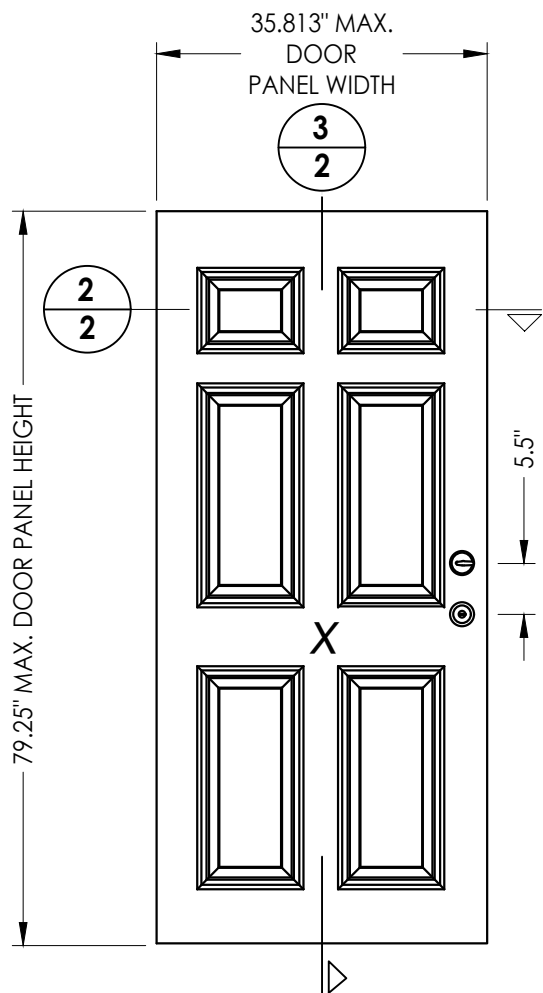

41 DOOR PANEL Hybrid Door

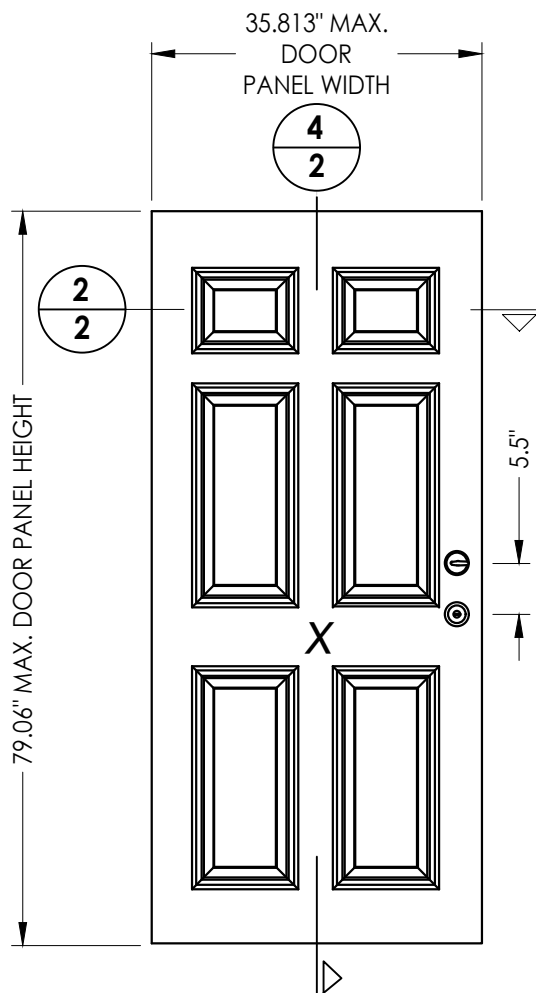

42 DOOR PANEL U1 Door

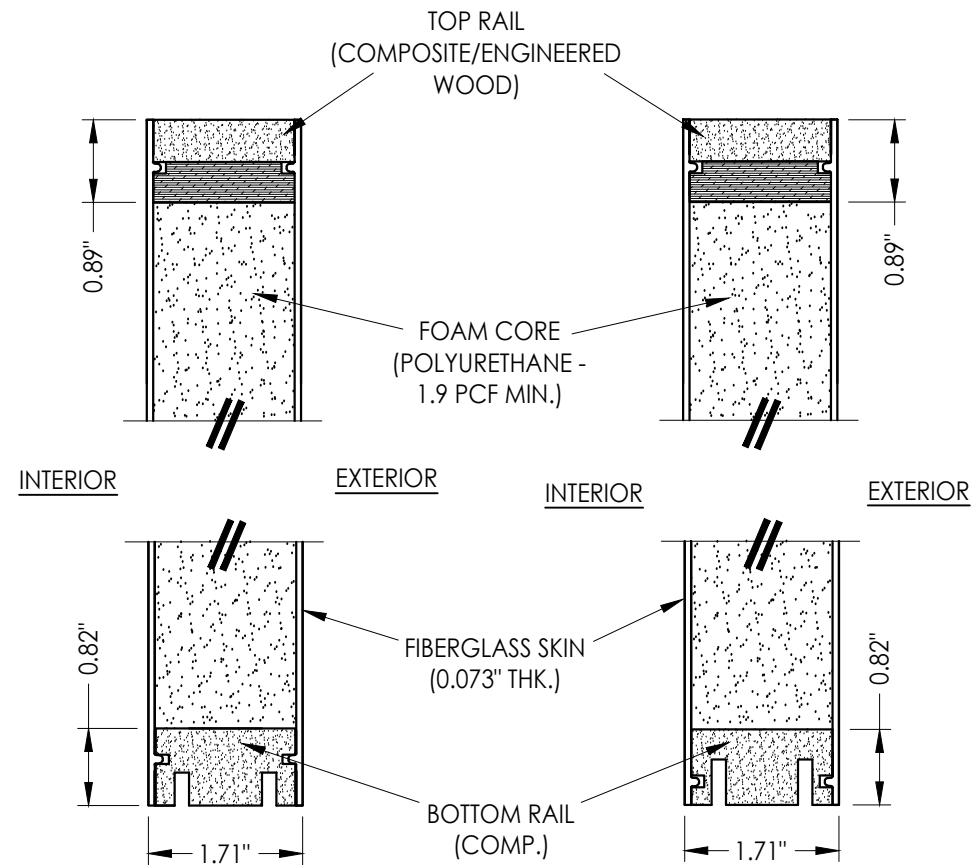

3
2 VERTICAL CROSS SECTION

4
2 VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
DOOR PANEL DETAILS

NO.	DATE	REVISIONS
3	7/25/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	7/22/20	UPDATE TO 7th ED (2020) FBC LFS
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC JK

DATE: 5/26/16

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-20470.17

SHEET 2 OF 11

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R4\FL-20470.17-19.dwg

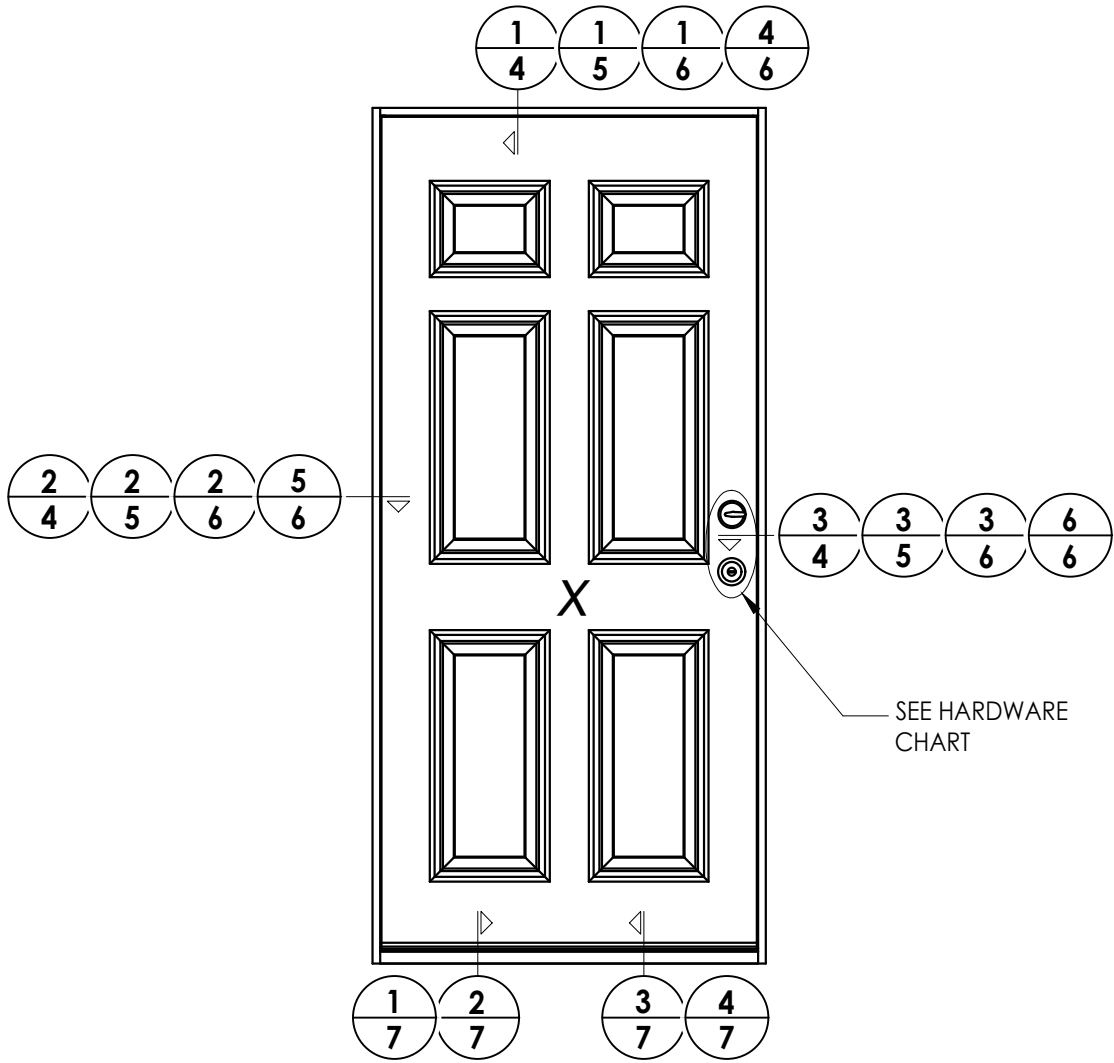

HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	KNOB:	F51
	DEADBOLT:	B60
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)
HOPPE (THERMA-TRU)	MULTIPOINT : MPDGART (3 pt. Manual Tongue)	

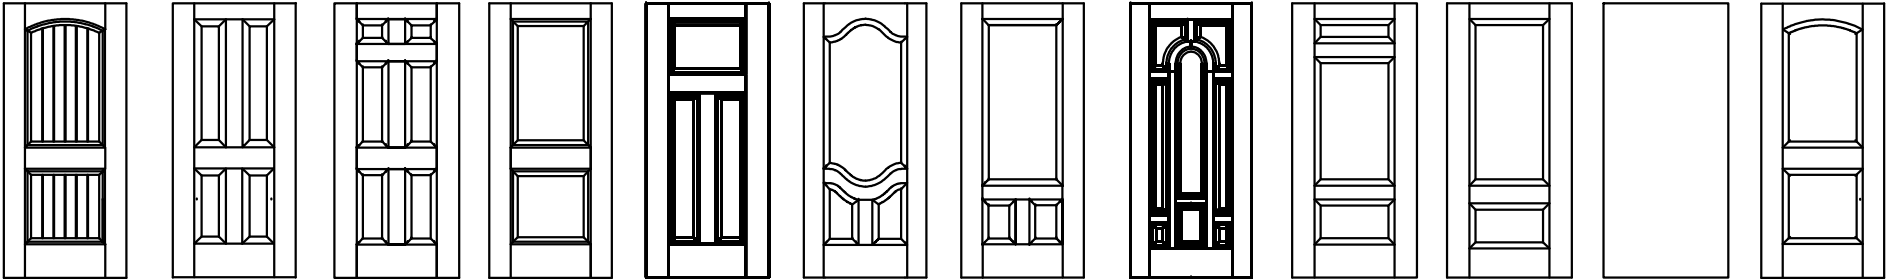

Fiber-Classic/Smooth-Star Door Panel Options
Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
ELEVATIONS

DATE: 5/26/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-20470.17

SHEET 3 OF 11

3 7/25/23 UPDATE TO 8TH ED. (2023) FBC LFS

2 7/22/20 UPDATE TO 7th ED (2020) FBC LFS


1 7/14/17 UPDATE TO 6TH ED. (2017) FBC JK

NO. DATE


REVISIONS

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R4\FL-20470.17-19.dwg

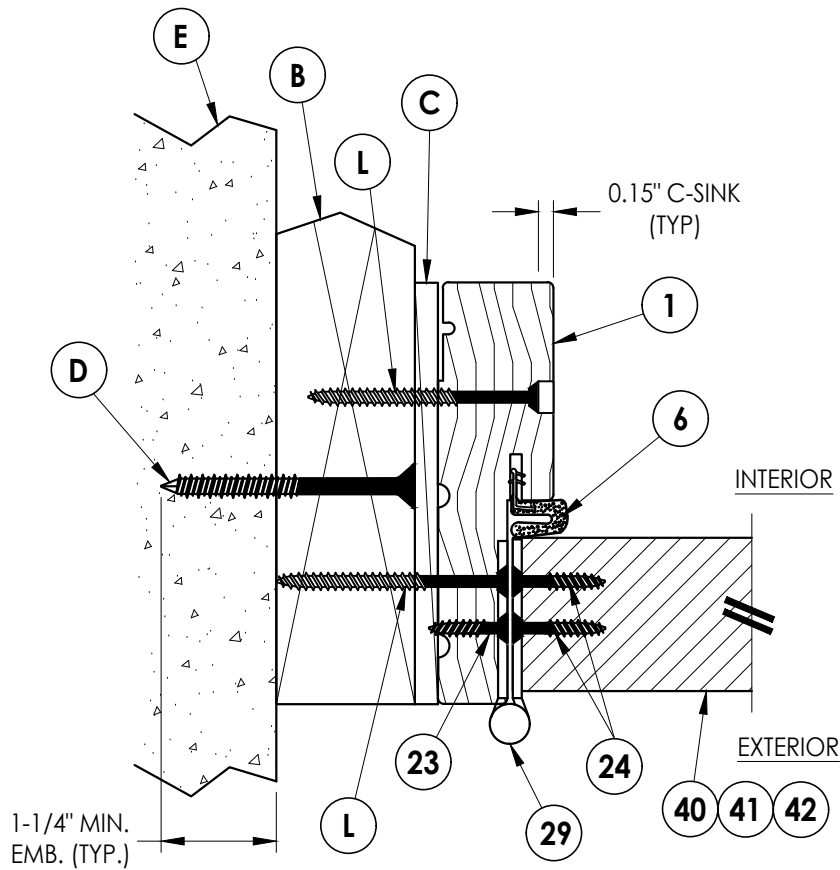

2 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

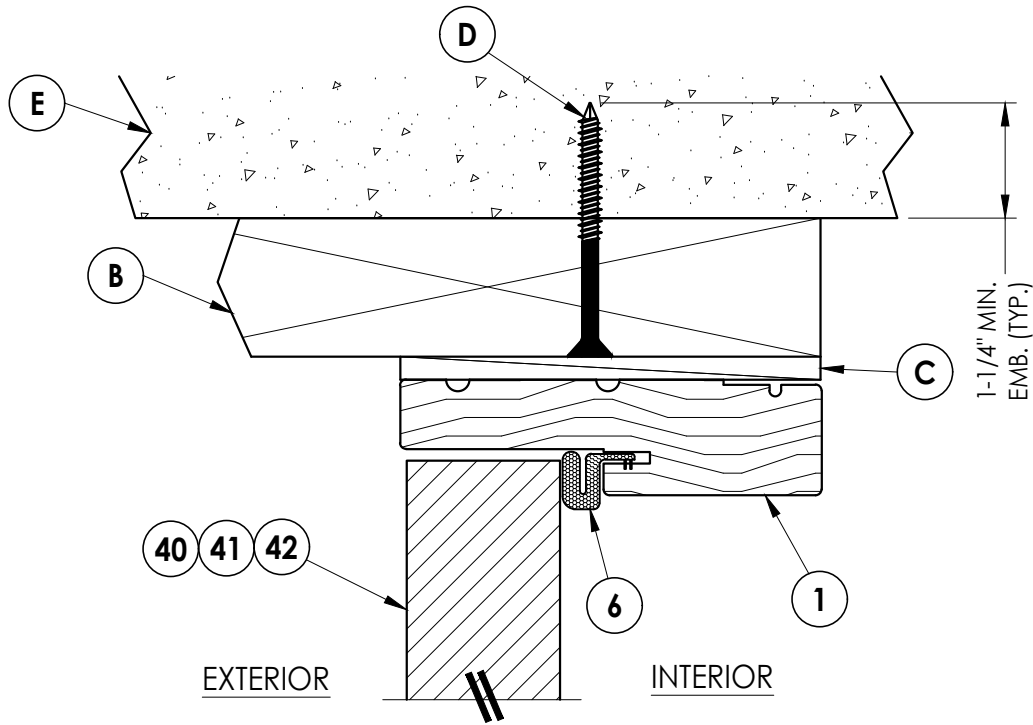

1 VERTICAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

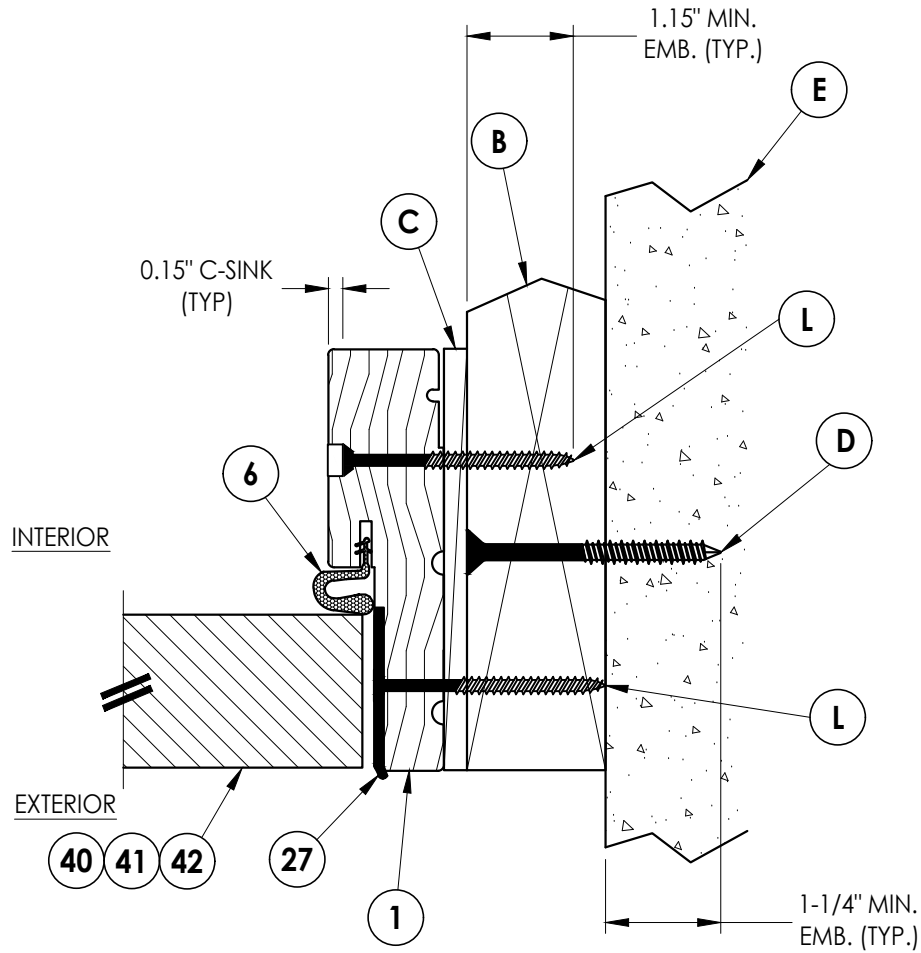


3 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)


DATE		NO.		DATE		BY	
5/26/16		3		7/25/23		LFS	
SCALE: N.T.S.		2		7/22/20		FBC	
DWG. BY: JK		1		7/14/17		FBC	
CHK. BY: LFS		1		7/14/17		FBC	
DRAWING NO.: FL-20470.17		1		7/14/17		FBC	
SHEET 4 OF 11		1		7/14/17		FBC	

PRODUCT:		PART OR ASSEMBLY:	
THERMA-TRU FIBERGLASS DOOR		HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)	


Documents Prepared By:		R ^W BUILDING CONSULTANTS, INC.	
Lyndon F. Schmidt		P.O. Box 230, Valrico, FL 33595	
P.E. No. 43409		Phone No.: 813.659.9197	
		FBPE Registry No. 9813	



1 VERTICAL CROSS SECTION
5 Shown w/ 1X sub-buck
Outswing shown (Inswing similar)



2 **HORIZONTAL CROSS SECTION**
5 Shown w/ 1X sub-buck
 Outswing shown (Inswing similar)




3 **HORIZONTAL CROSS SECTION** 5 Shown w/ 1X sub-buck Outswing shown (Inswing similar)

3	7/25/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
2	7/22/20	UPDATE TO 7th ED (2020)	FBC	LFS
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC	JK
NO.	DATE			BY
REVISIONS				


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R4\FL-20470.17-19.dwg

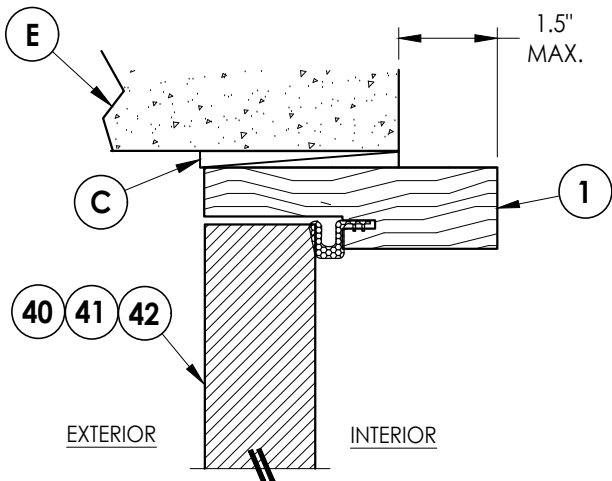


1/6 VERTICAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

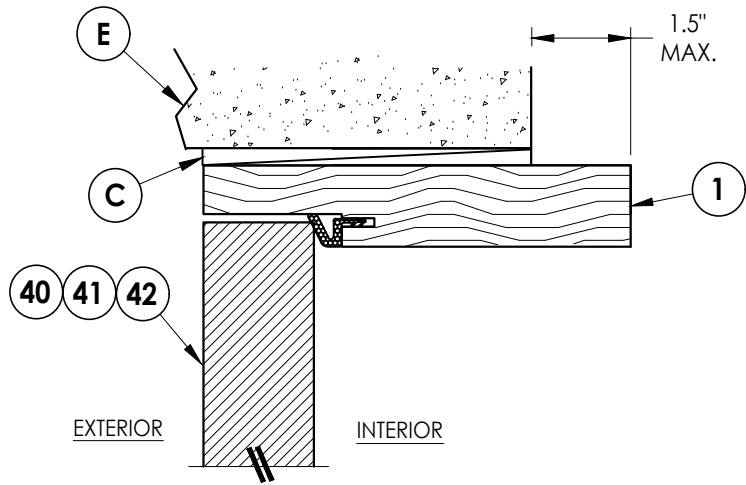


4/6 VERTICAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb


DIRECT TO MASONRY MAX. DESIGN PRESSURE:
w/ STANDARD STRIKE = ± 55 PSF
w/ SECURITY STRIKE = ± 65 PSF

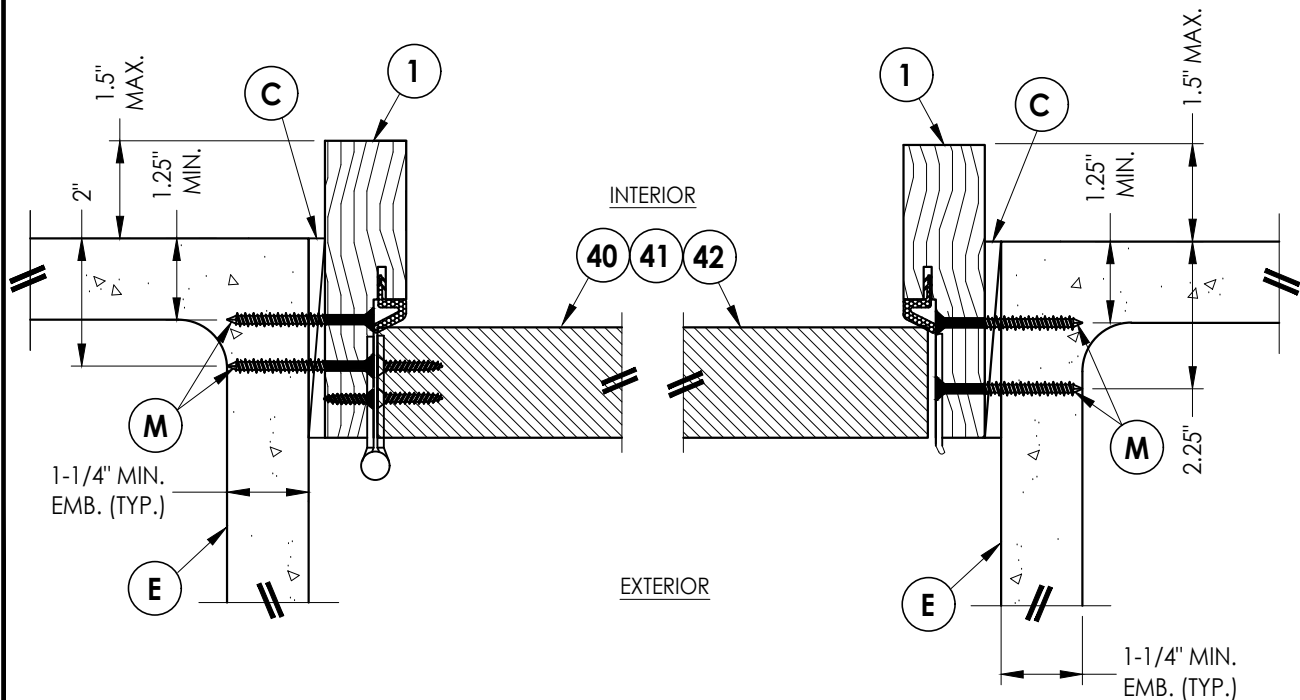


2/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

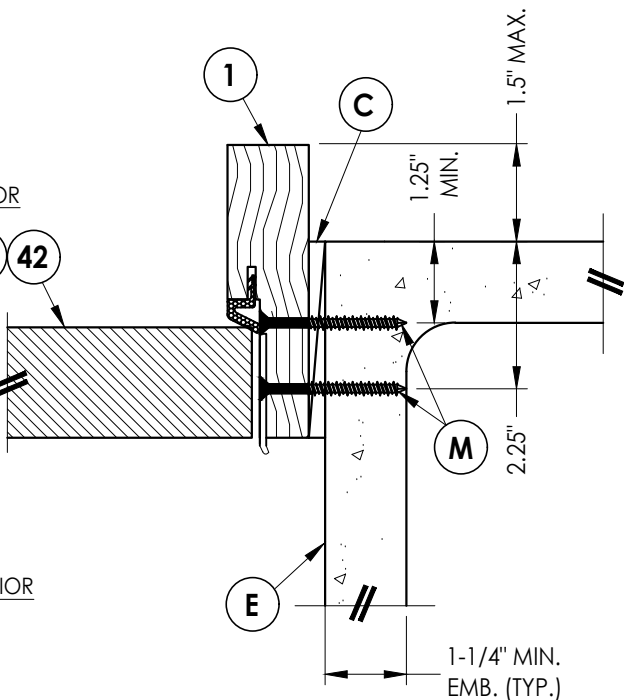

3/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

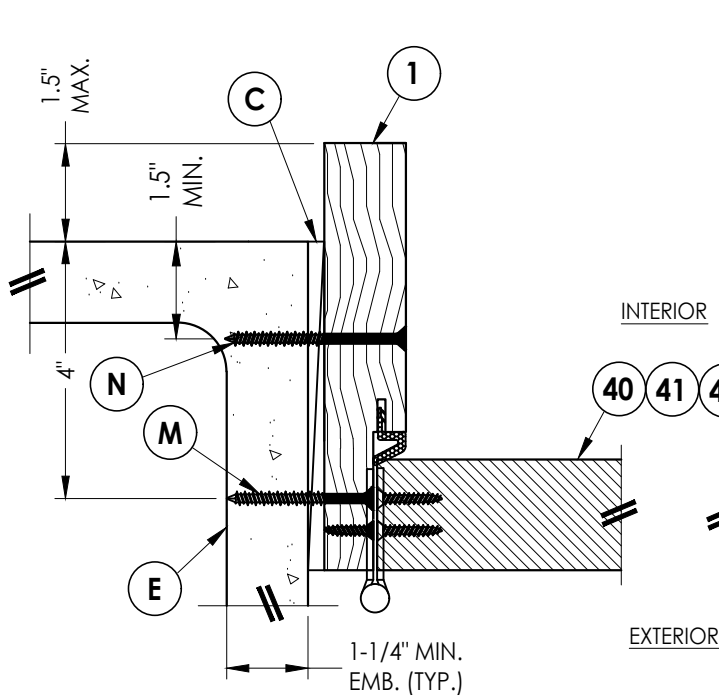

5/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

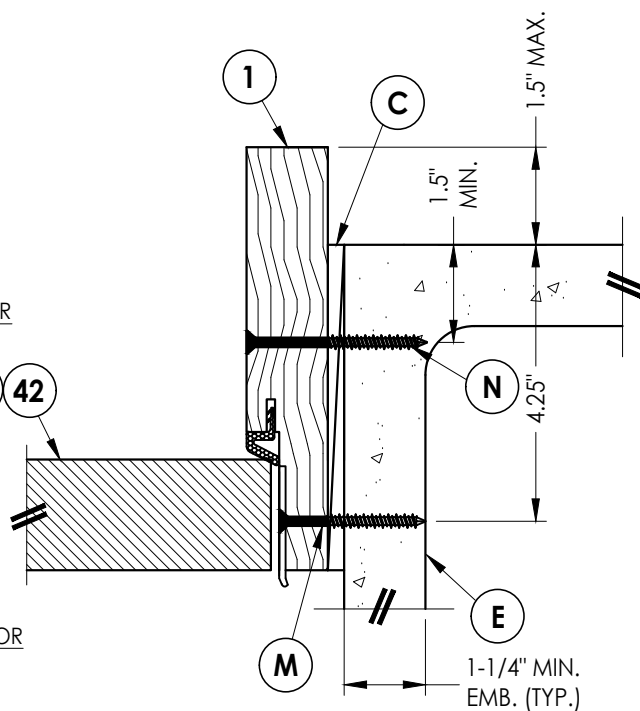

6/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
3	7/25/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	7/22/20	UPDATE TO 7th ED (2020) FBC LFS
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC JK

DATE: 5/26/16

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:
FL-20470.17

SHEET 6 OF 11


Notes:
1. Sill Item #'s 16, 32, 36, 37, 38, 39, 43, 44, 45, 46, 47 & 48 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws at each end.
Sill Item #'s 17, 18 & 19 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph SMS at each end.

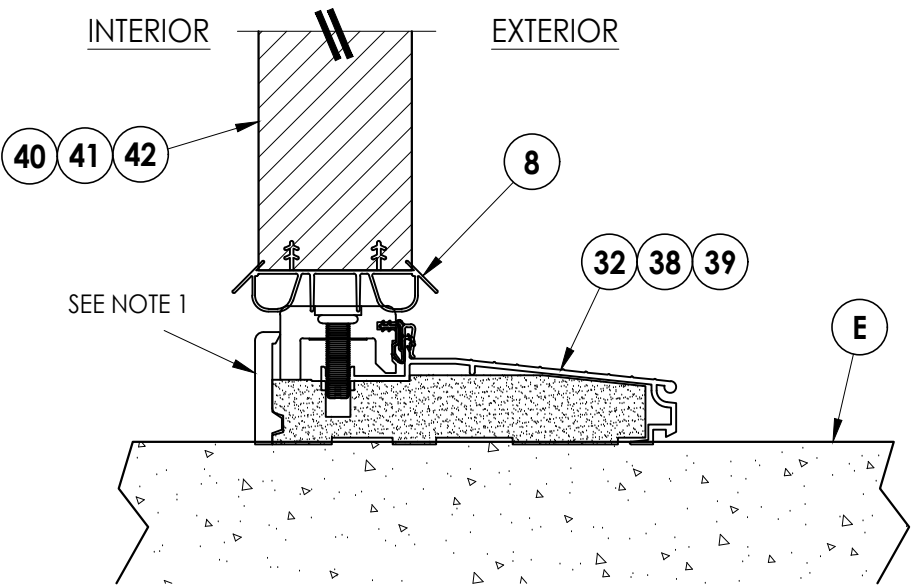


1
7 VERTICAL CROSS SECTION
Inswing Sill

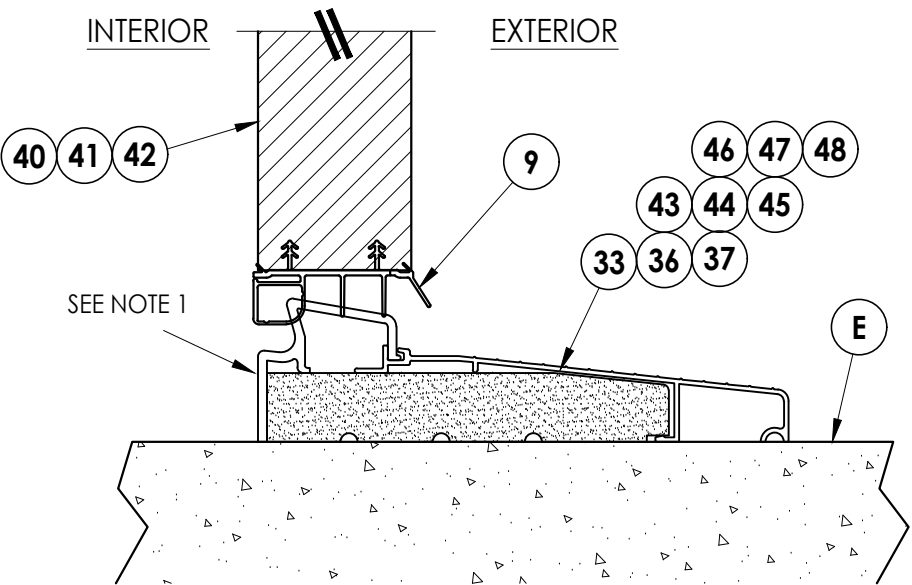

2
7 VERTICAL CROSS SECTION
Inswing Sill

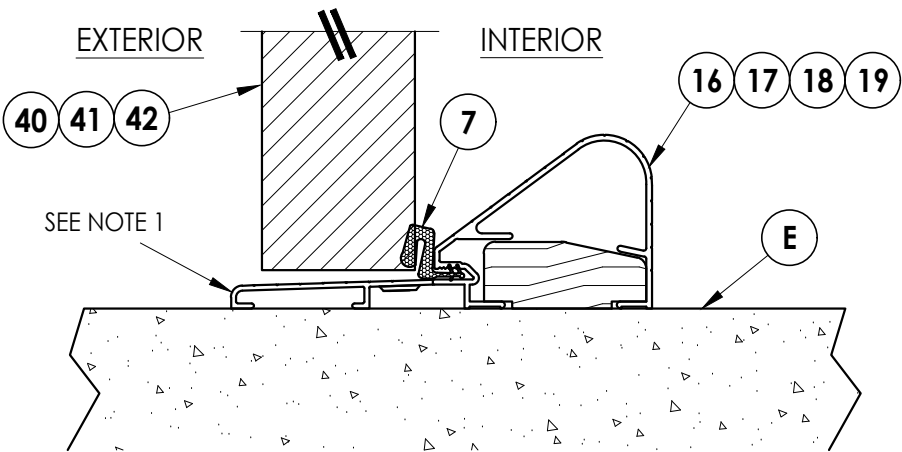

3
7 VERTICAL CROSS SECTION
Outswing Sill

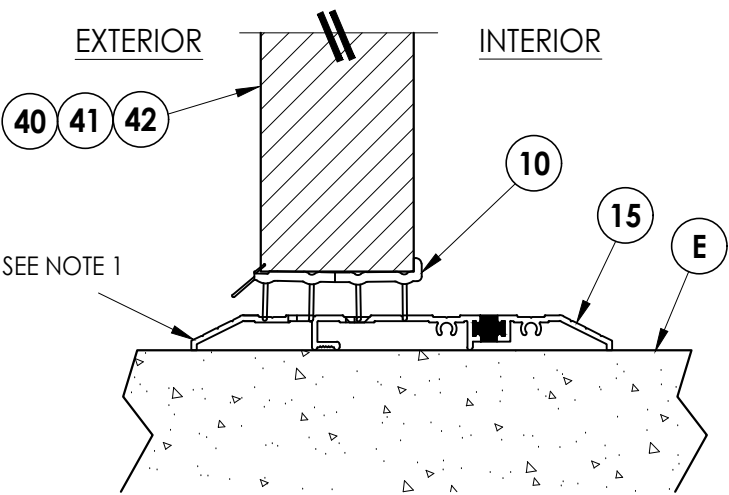

4
7 VERTICAL CROSS SECTION
Public Access Sill

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS			
		DATE	BY	JK	LFS
3	7/25/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
2	7/22/20	UPDATE TO 7th ED (2020)	FBC	LFS	
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC	JK	

DATE: 5/26/16

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:
FL-20470.17

SHEET 7 OF 11


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R4\FL-20470.17-19.dwg

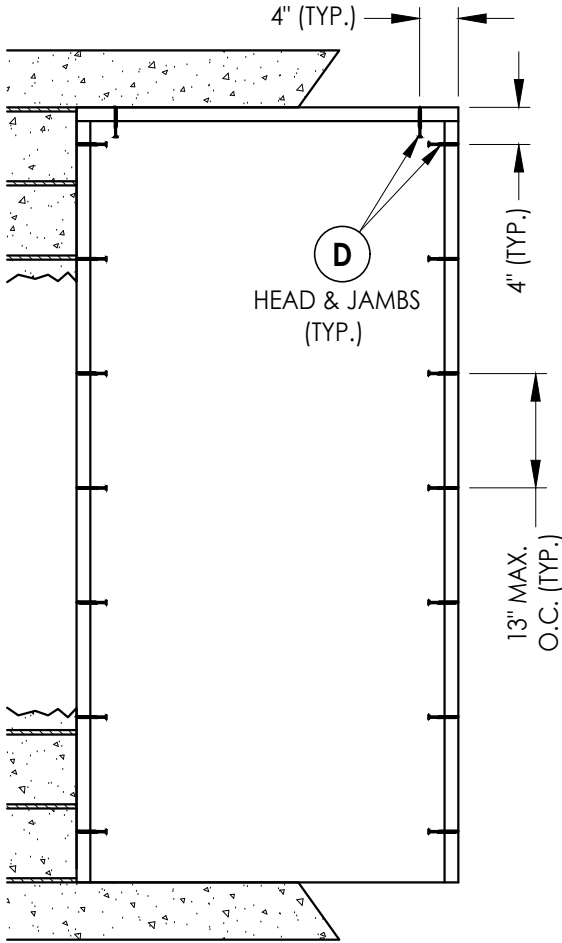

2X BUCK ANCHORING

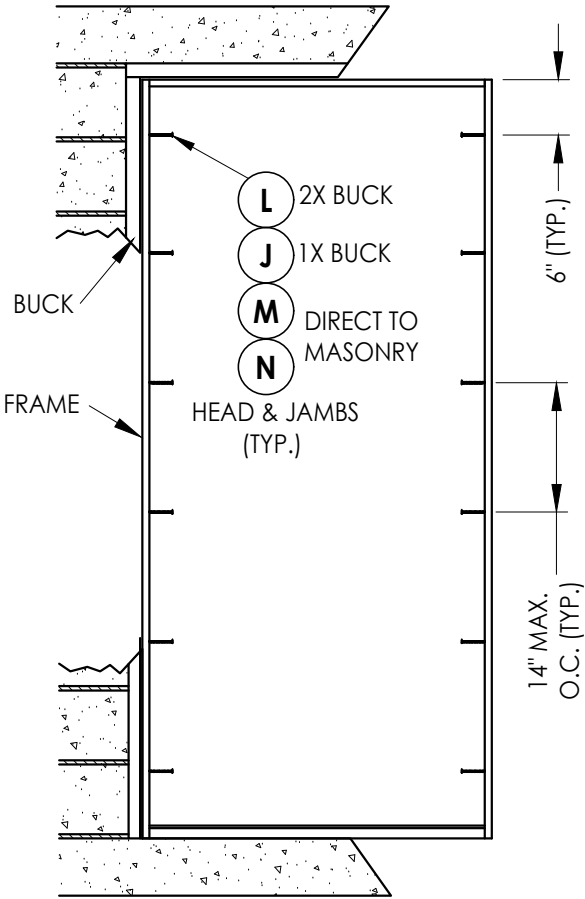

FRAME ANCHORING

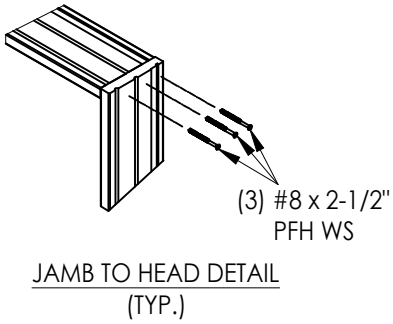

DATE:	5/26/16
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-20470.17
SHEET	8 OF 11


PRODUCT:	Therma-Tru FIBERGLASS DOOR
PART OR ASSEMBLY:	BUCK & FRAME ANCHORING

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW


BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R4\FL-20470.17-19.dwg

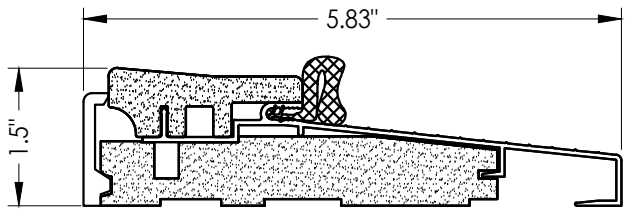


16 OUTSWING THRESHOLD
Composite Sill


MAX. +55 PSF
(where water infiltration is required)

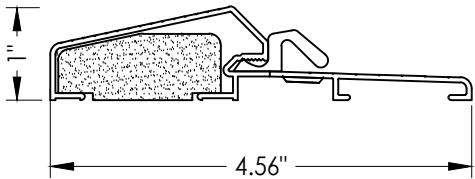


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

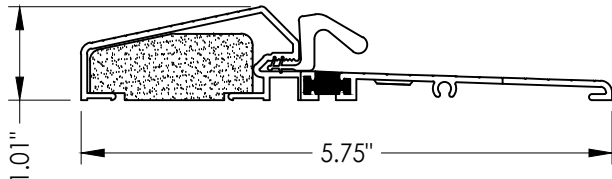


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

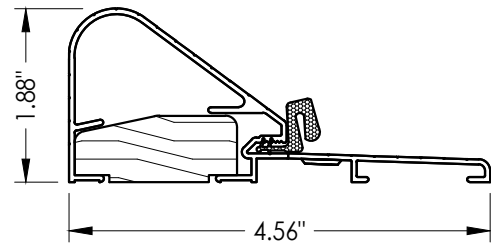


19 COASTAL OUTSWING THRESHOLD
Wood / Aluminum Sill

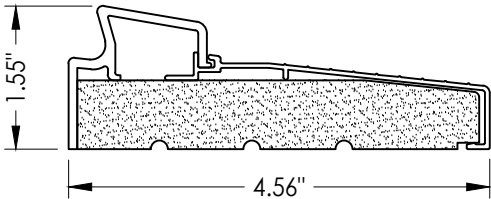


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

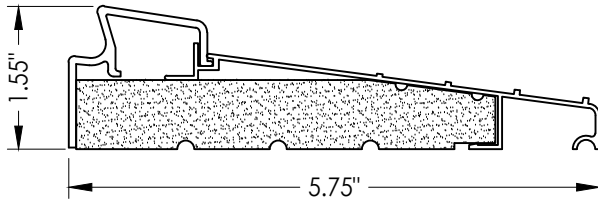


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill

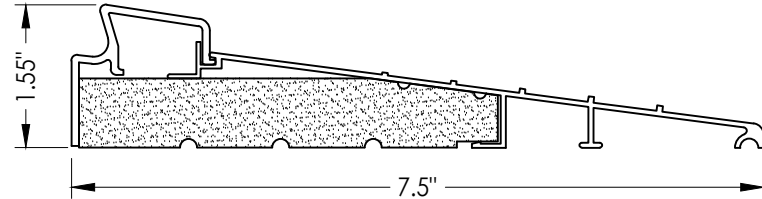


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

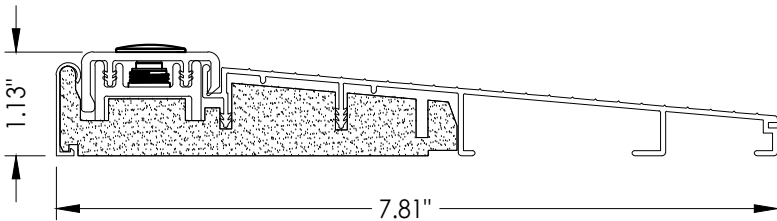


32 INSWING THRESHOLD
Inswing Composite Adjustable 7-3/4" Sill

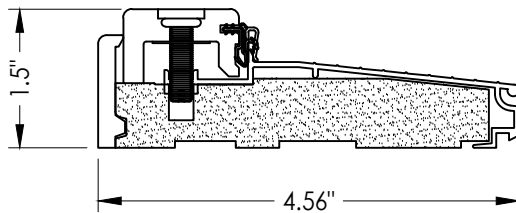


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

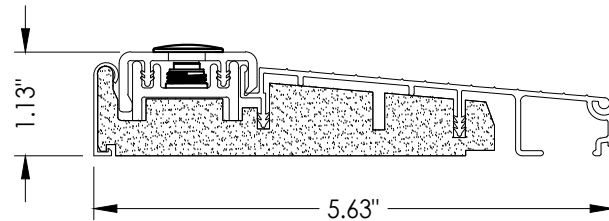


39 INSWING THRESHOLD
Inswing Composite Adjustable Sill

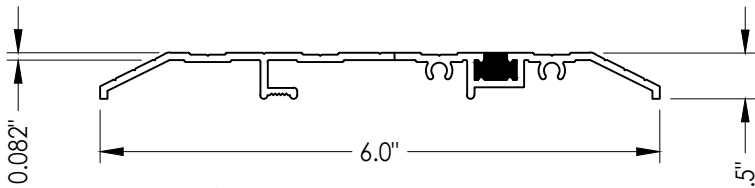


15 PUBLIC ACCESS THRESHOLD

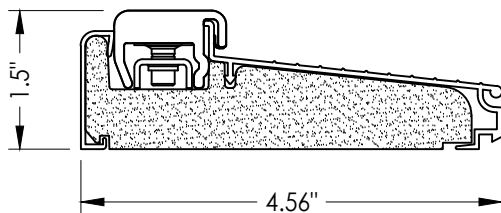


43 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

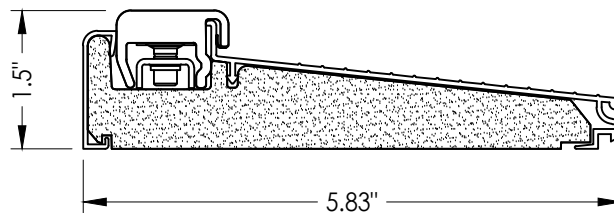


44 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

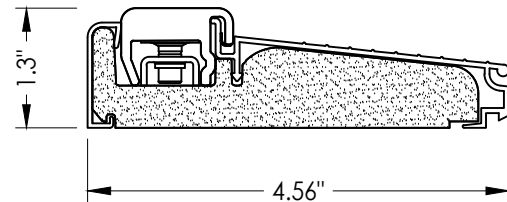


46 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

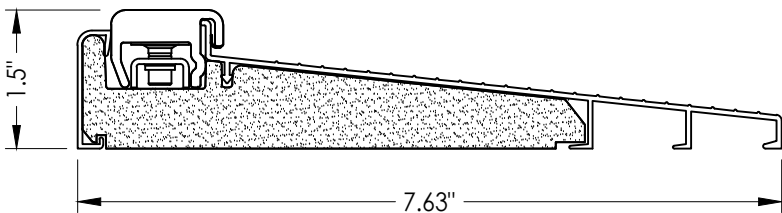

45 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

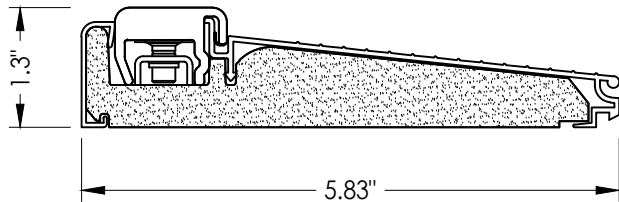

47 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

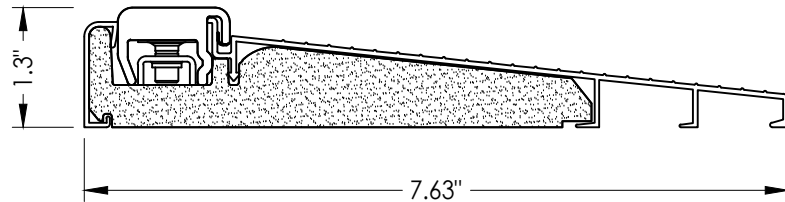

48 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS
3	7/25/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	7/22/20	UPDATE TO 7th ED (2020) FBC LFS
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC JK

DATE: 5/26/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.: FL-20470.17

SHEET 10 OF 11

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R4\FL-20470.17-19.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD
B	2X BUCK (SG >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL
1	JAMB (FINGER JOINT PINE)	WOOD
6	WEATHERSTRIP (MEDIUM REACH)	FOAM
7	WEATHERSTRIP (LONG REACH)	FOAM
8	SWEEP	VINYL
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL
15	PUBLIC ACCESS THRESHOLD	ALUM
16	OUTSWING THRESHOLD	ALUM/COMP
17	OUTSWING THRESHOLD	ALUM/COMP
18	OUTSWING THRESHOLD	ALUM/COMP
19	COASTAL OUTSWING THRESHOLD	ALUM/ WOOD
22	#8 x 3/4" PFH WOOD SCREW	STEEL
23	#10 x 3/4" PFH WOOD SCREW	STEEL
24	#10 x 1" PFH WOOD SCREW	STEEL

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
26	#8 x 5/8" PFH WOOD SCREW	STEEL
27	LATCH STRIKE PLATE	STEEL
28	DEADBOLT STRIKE PLATE (STANDARD)	STEEL
28A	DEADBOLT SUB STRIKE PLATE	STEEL
28B	DEADBOLT STRIKE PLATE (SECURITY)	STEEL
29	4" X 4" HINGE	STEEL
30	LATCH & DEADBOLT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
31	MULTIPOINT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
32	INSWING THRESHOLD	ALUM/COMP
33	INSWING THRESHOLD	ALUM/COMP
36	INSWING THRESHOLD	ALUM/COMP
37	INSWING THRESHOLD	ALUM/COMP
38	INSWING THRESHOLD	ALUM/COMP
39	INSWING THRESHOLD	ALUM/COMP
40	DOOR PANEL (BOOK)	-
41	DOOR PANEL (HYBRID)	-
42	DOOR PANEL (U1)	-
43	INSWING THRESHOLD	ALUM/COMP
44	INSWING THRESHOLD	ALUM/COMP
45	INSWING THRESHOLD	ALUM/COMP
46	INSWING THRESHOLD	ALUM/COMP
47	INSWING THRESHOLD	ALUM/COMP
48	INSWING THRESHOLD	ALUM/COMP


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

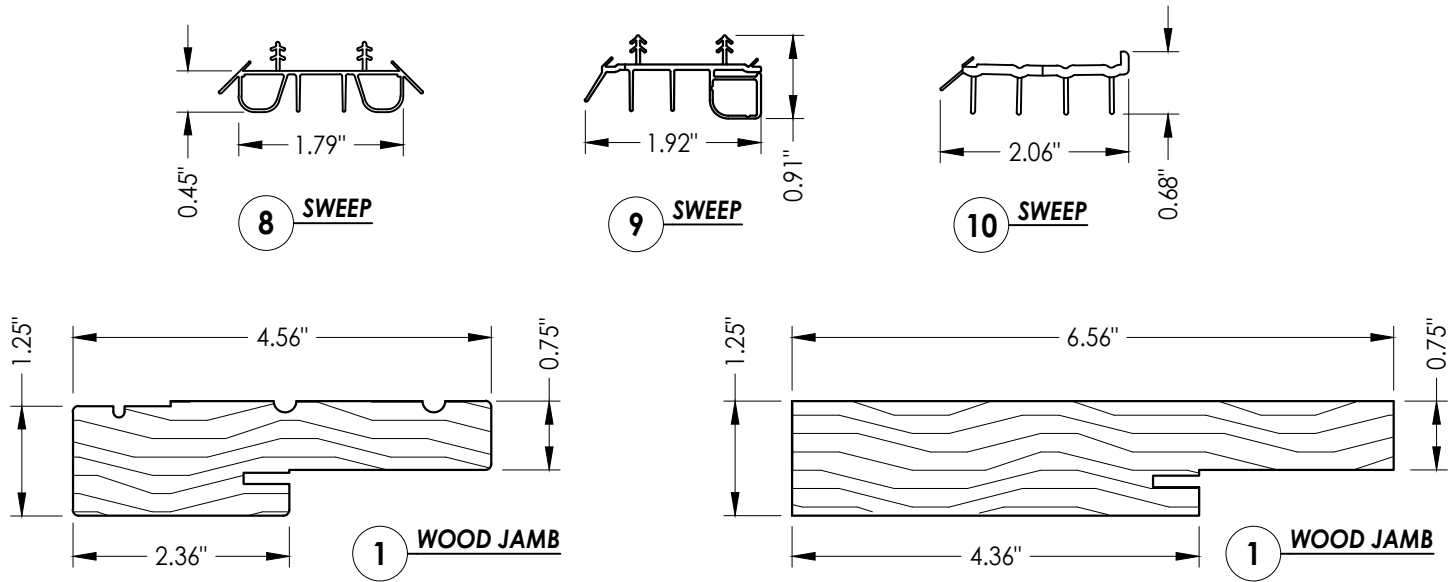

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
COMPONENTS
& BILL OF MATERIALS

NO.	DATE	REVISIONS
3	7/25/23	UPDATE TO 8TH ED. (2023) FBC
2	7/22/20	UPDATE TO 7th ED (2020) FBC
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC

DATE: 5/26/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-20470.17

SHEET 11 OF 11