




Fiber-Classic® & Smooth-Star®

COMPOSITE EDGE
GLAZED FIBERGLASS SINGLE DOOR
INSWING/OUTSWING
"IMPACT"

GENERAL NOTES

1. This product evaluation drawing has been developed in compliance with the 9th Edition (2026) Florida Building Code (FBC) including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the FBC and does not require an impact resistant covering.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. This product meets the water infiltration requirements for the "HVHZ".
8. Outswing configurations using Coastal Sill (item #19) & Composite Sill (item #16) under active doors meet water infiltration requirements for "HVHZ". All other configurations do not meet the water infiltration requirements for the "HVHZ" and shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.

TABLE OF CONTENTS			
SHEET#	DESCRIPTION	SHEET#	
1	Typical Elevations, Design Pressures & General Notes	7	Vertical Cross Sections (Thresholds)
2	Door Panel Details	8	Buck & Frame Anchoring
3	Elevations	9	Hardware Details
4	Horizontal & Vertical Cross Sections (2X Buck)	10	Glazing Details
5	Horizontal & Vertical Cross Sections (1X Buck)	11	Components
6	Horizontal & Vertical Cross Sections (Direct to Masonry)	12	Components & Bill of Materials

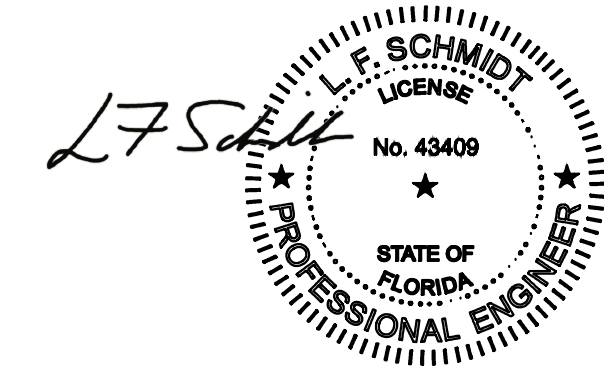


Digitally signed by
Lyndon F Schmidt
Date: 2026.08.06
10:50:00 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.

Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

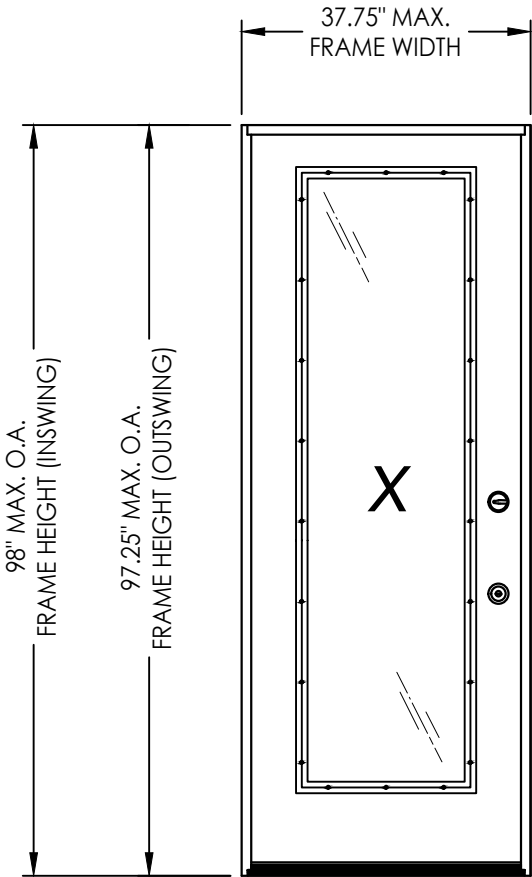

CONFIGURATION	LOCK HARDWARE	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	Latch & Deadbolt	+50.0	-55.0	+50.0	-50.0
X	Multipoint	+50.0	-55.0	+55.0	-55.0

See Sheet 3 for Hardware Specifications

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

DATE: 08/02/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.: FL-20470.10

SHEET 1 OF 12

© 2016 R.W. BUILDING CONSULTANTS INC.





© 2016 R.W. BUILDING CONSULTANTS INC.

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

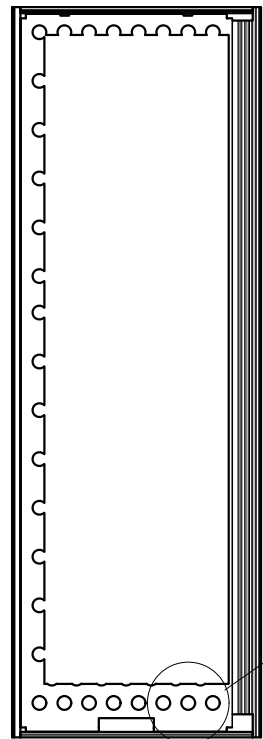

DETAIL A-A
PANEL REINFORCEMENT
(0.023" Thick Steel)


* #8 X 2.5" PFH WS (TYP. @ EACH DOOR CORNER)

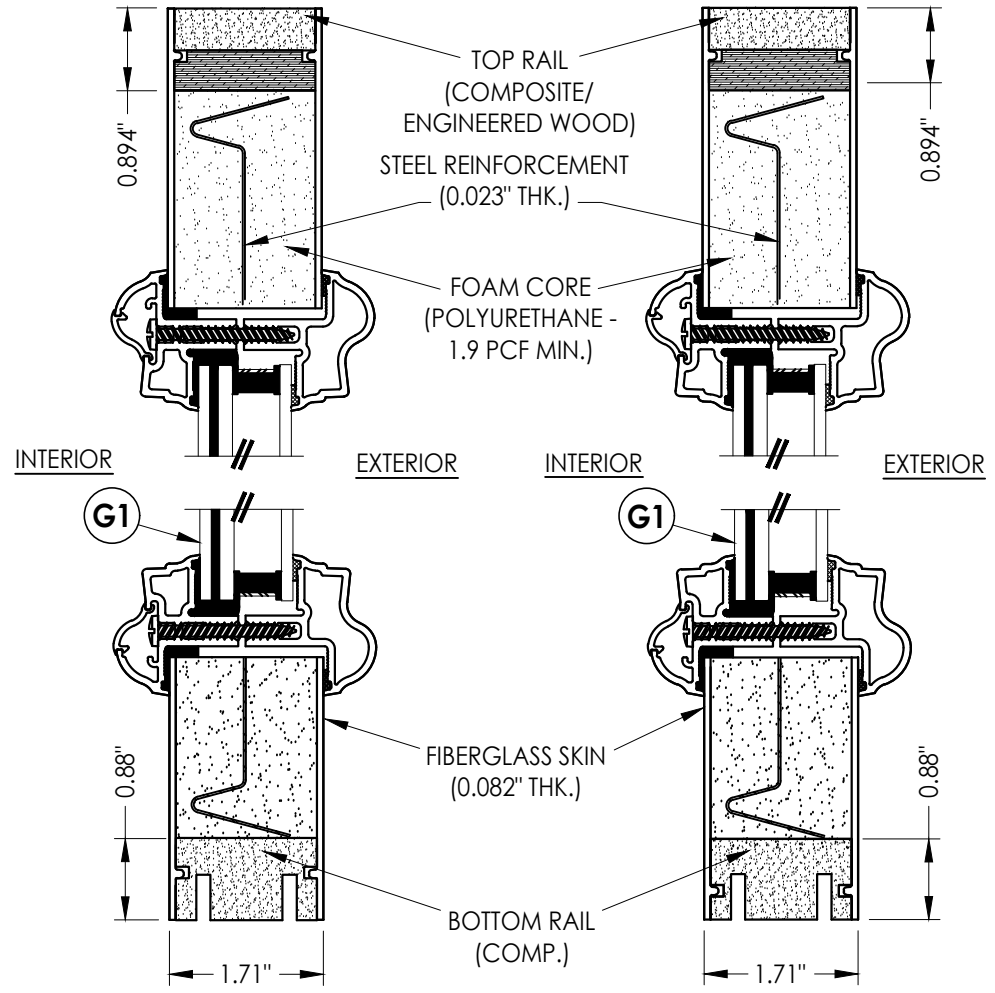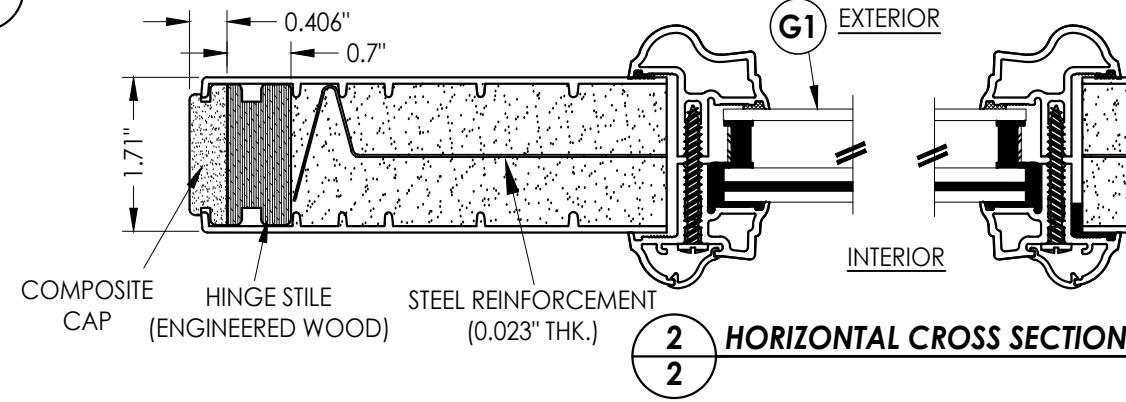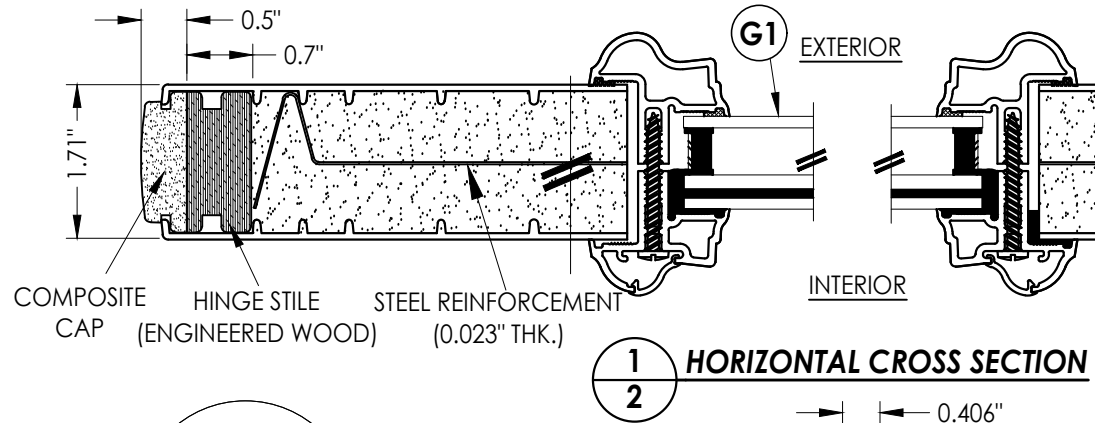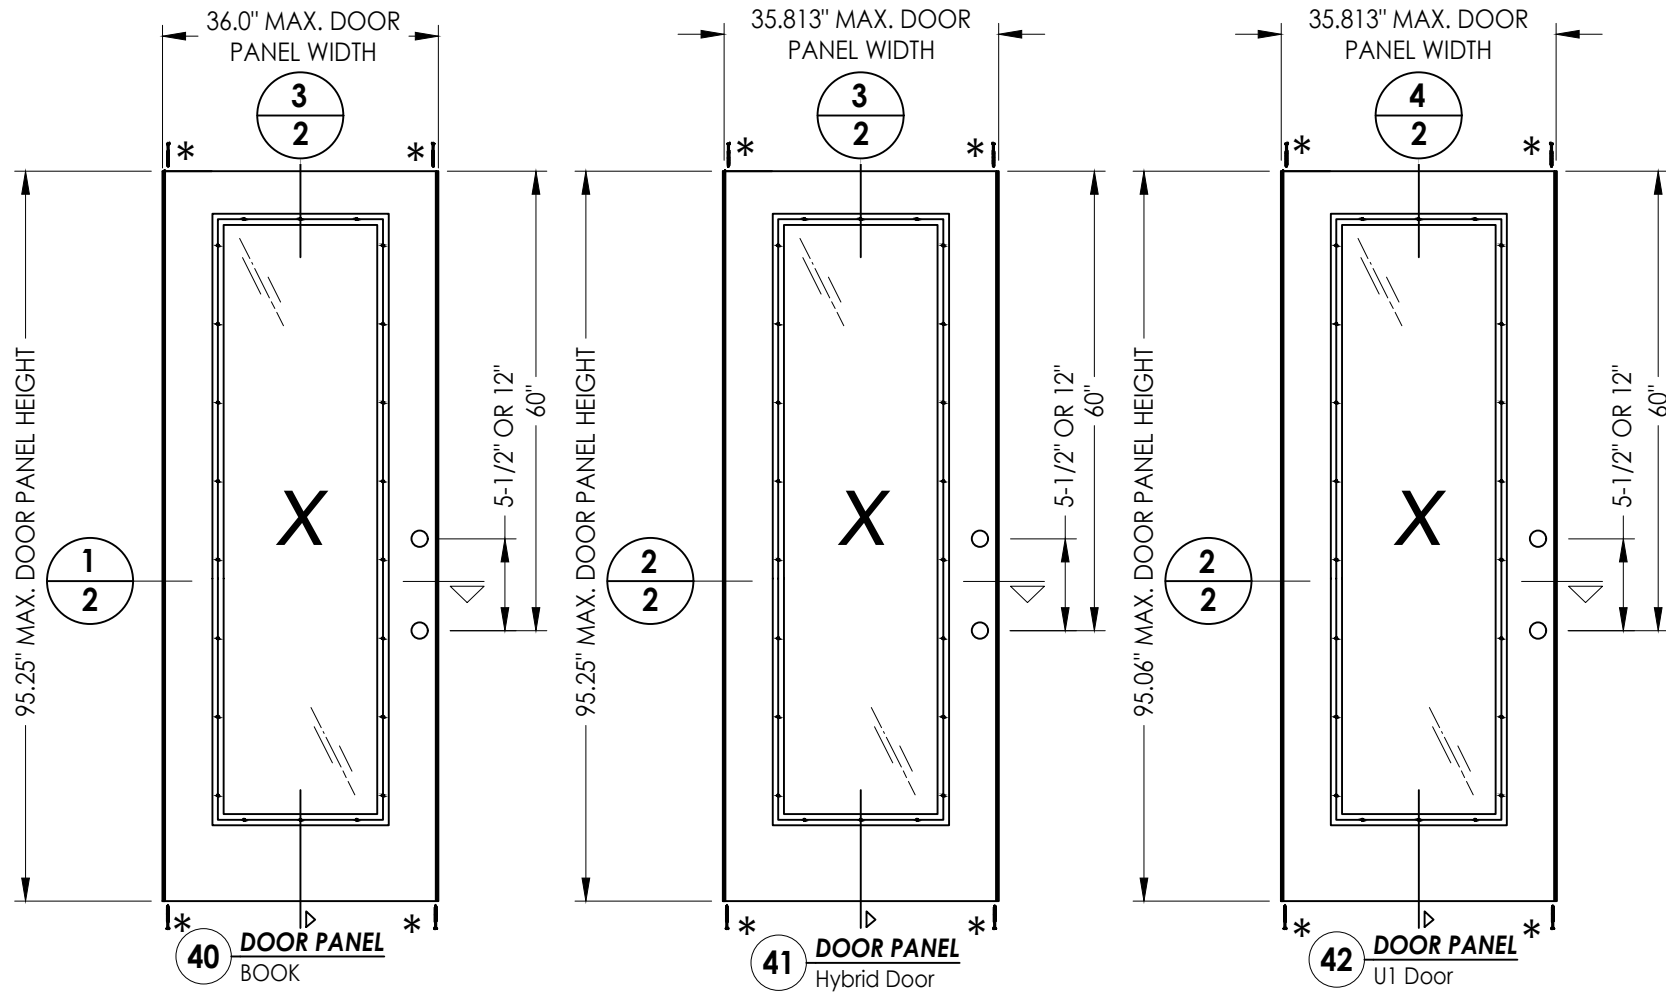

4 VERTICAL CROSS SECTION


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: DOOR PANEL DETAILS	
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
4	7/25/23	UPDATE TO 8TH ED. (2023) FBC	LFS
3	7/22/20	UPDATE TO 7th ED. (2020) FBC	LFS
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING	LFS
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC	JK
NO. DATE		REVISIONS	
DATE: 08/02/16			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-20470.10			
SHEET 2 OF 12			

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

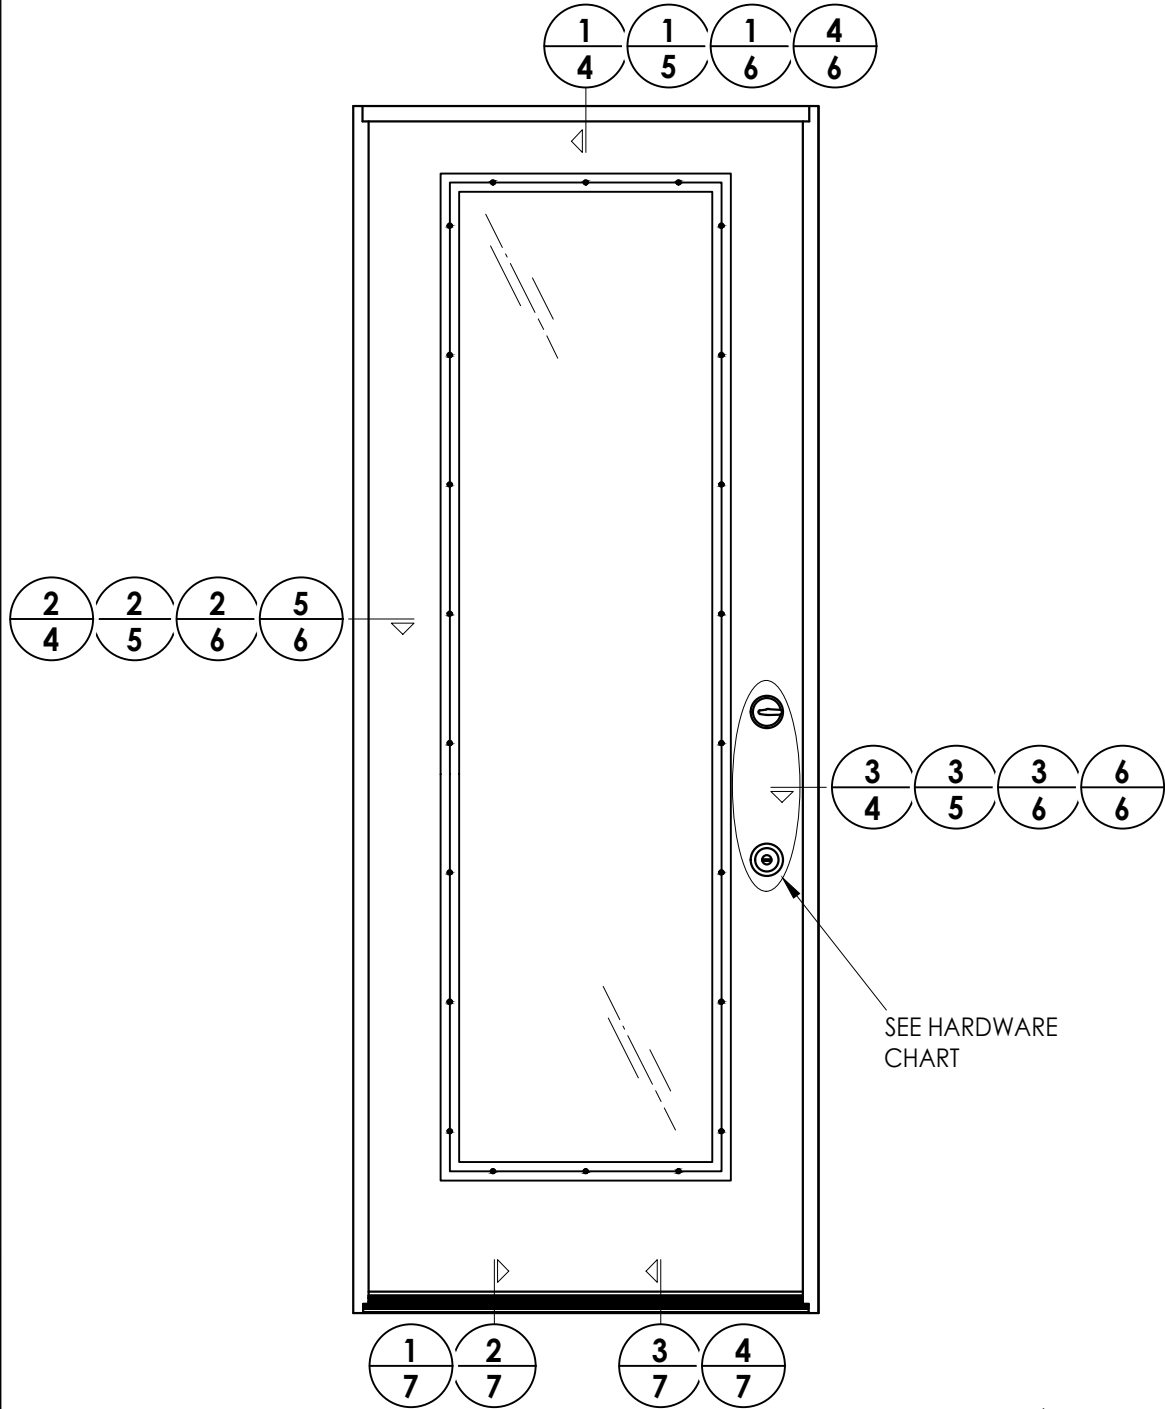

SEE HARDWARE
CHART


HARDWARE TABLE		
MANUFACTURER	MODEL	
SCHLAGE	KNOB:	F51
	DEADBOLT:	B60
KWIKSET	KNOB:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)
HOPPE (THERMA-TRU)	MULTIPOINT : MPDGART (3 pt. Manual Tongue)	

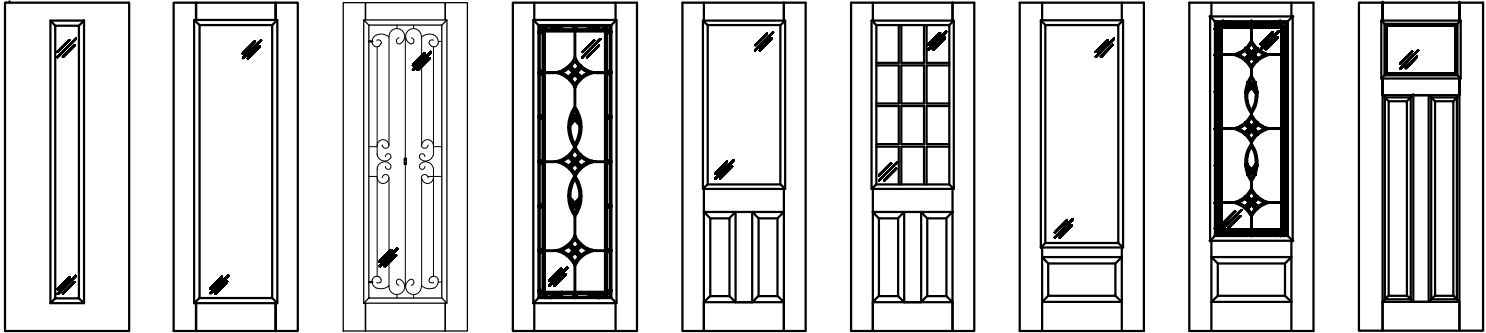


Fiber-Classic/Smooth-Star Door Panel Options
Panel options shown are for illustration and are representative only
(similar glazed panel configurations are allowed)

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				RW BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: THERMA-TRU FIBERGLASS DOOR				PART OR ASSEMBLY: ELEVATIONS			
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC				LFS
4	7/25/23	UPDATE TO 8TH ED. (2023)	FBC				LFS
3	7/22/20	UPDATE TO 7th ED (2020)	FBC				LFS
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING					LFS
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC				JK
NO.	DATE						BY
				REVISIONS			
DATE: 08/02/16							
SCALE: N.T.S.							
DWG. BY: JK							
CHK. BY: LFS							
DRAWING NO.: FL-20470.10							
SHEET 3 OF 12							


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

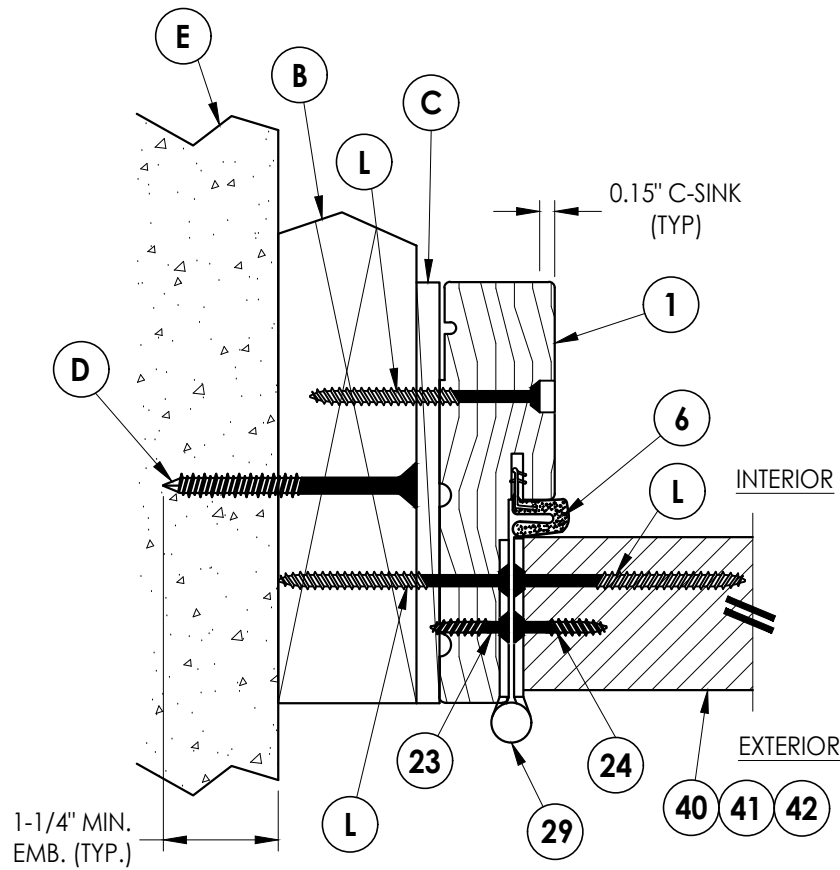

2 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

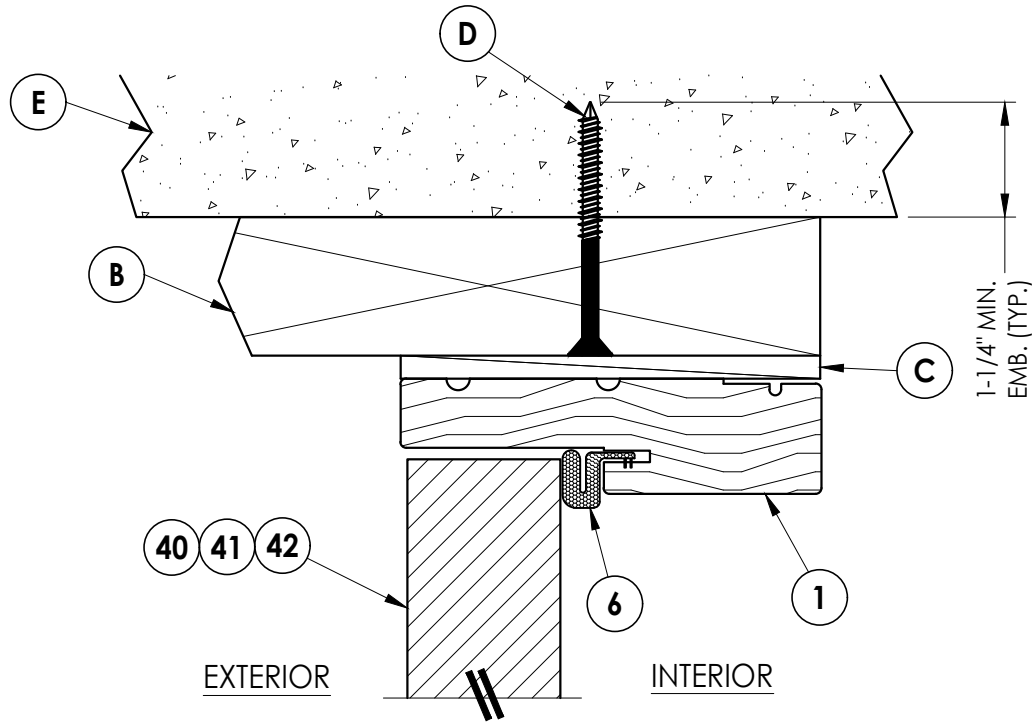

1 VERTICAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

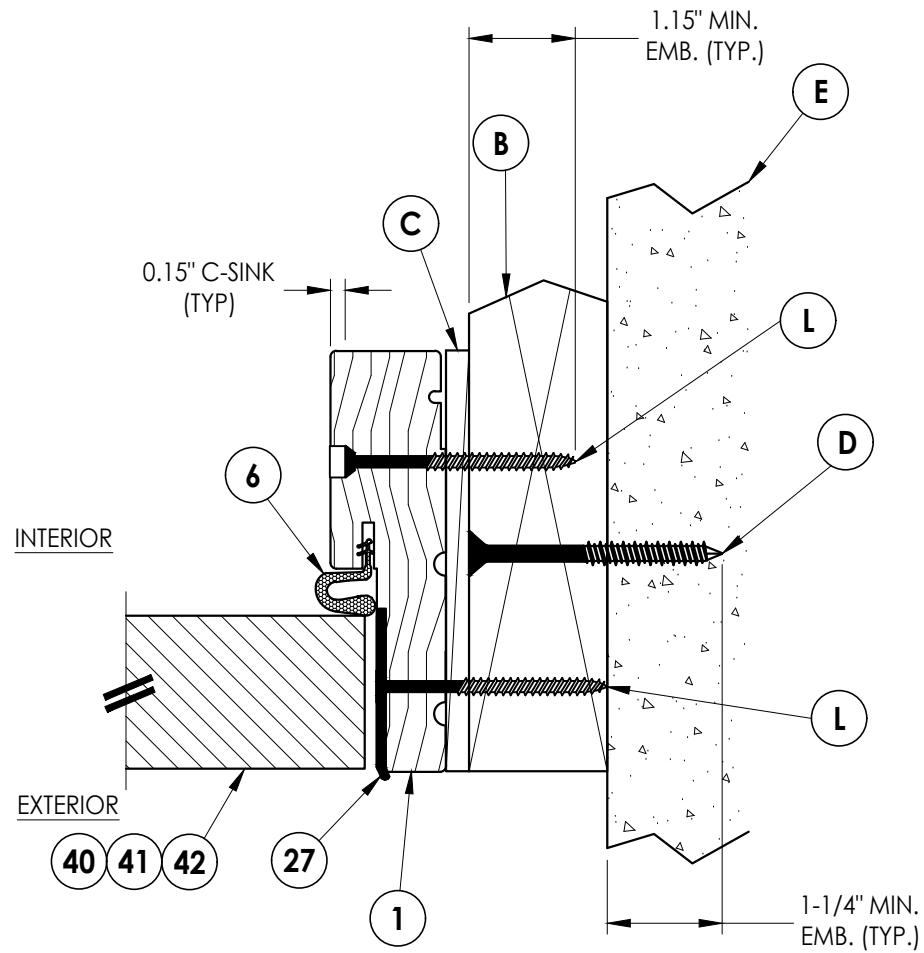

3 HORIZONTAL CROSS SECTION
4 Shown w/ 2X Buck
Outswing shown (Inswing similar)

NO.	DATE	REVISIONS			
		NO.	DATE	BY	
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
4	7/25/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
3	7/22/20	UPDATE TO 7th ED (2020)	FBC	LFS	
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING		LFS	
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC	JK	


DATE:	08/02/16
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-20470.10
SHEET	4 OF 12

PRODUCT:	Therma-Tru FIBERGLASS DOOR
	PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

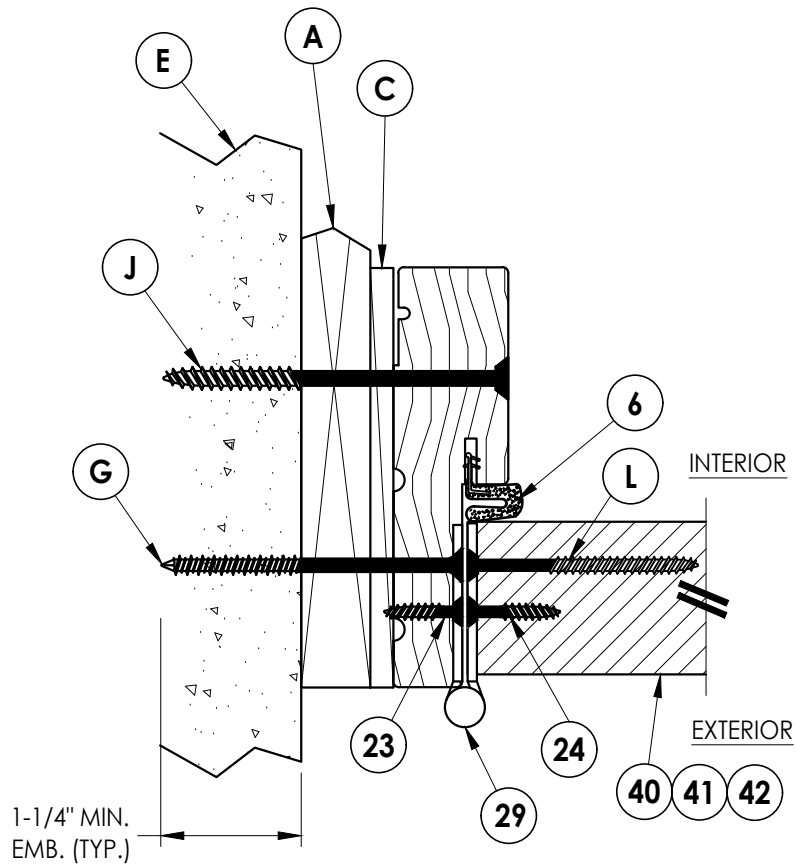

2 HORIZONTAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

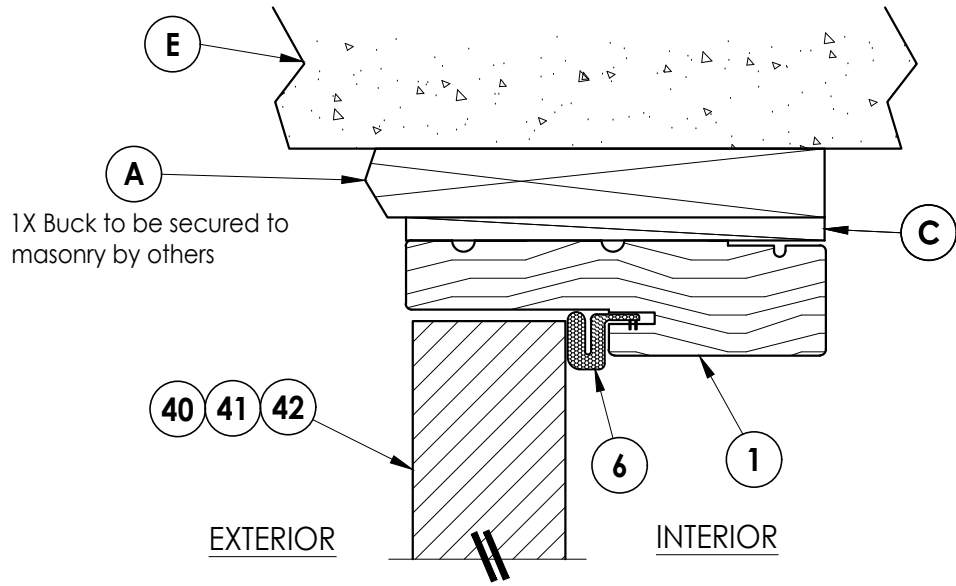

1 VERTICAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

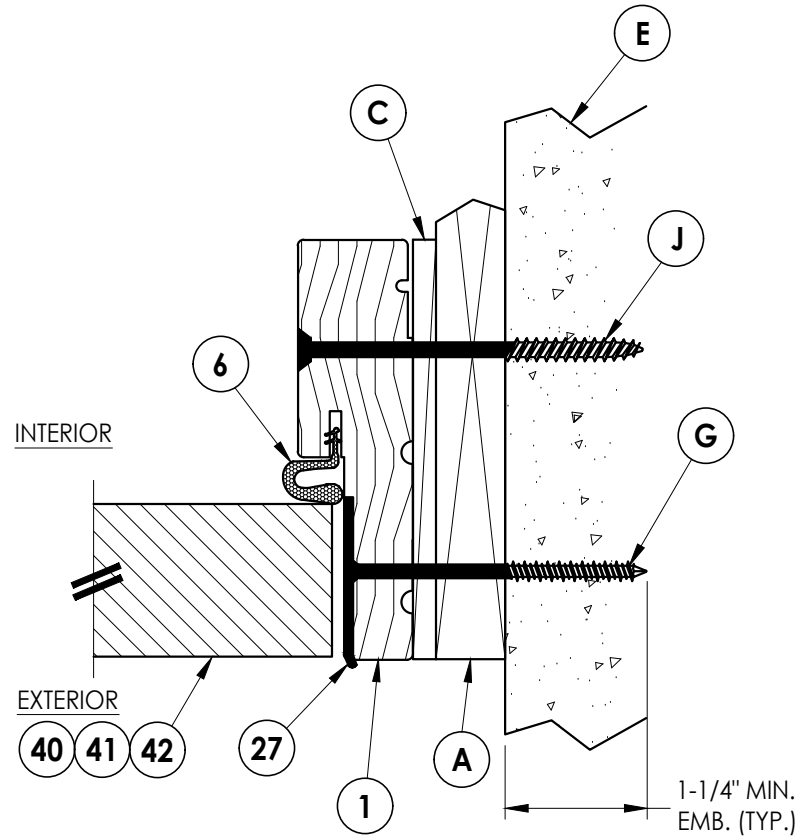

3 HORIZONTAL CROSS SECTION
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)

NO.	DATE	REVISIONS
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	7/25/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	7/22/20	UPDATE TO 7TH ED. (2020) FBC LFS
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING LFS
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC JK

DATE: 08/02/16

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:


FL-20470.10

SHEET 5 OF 12

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

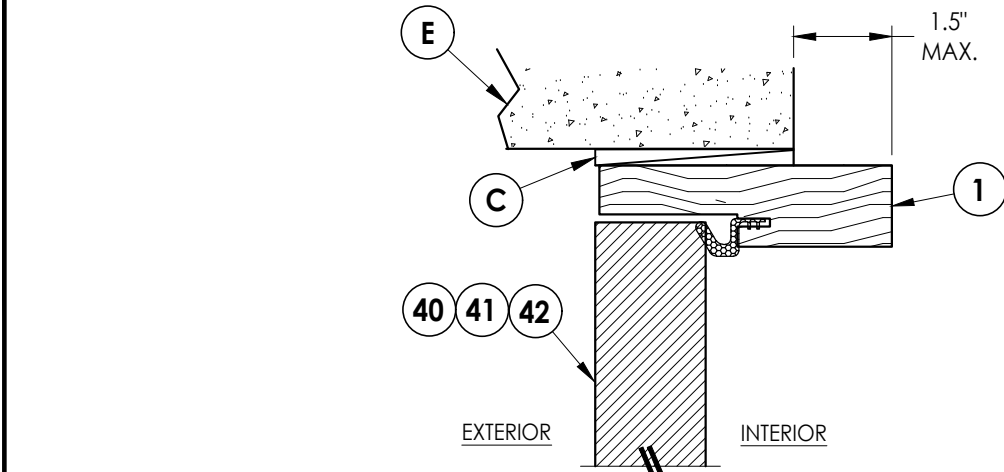


1/6 VERTICAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

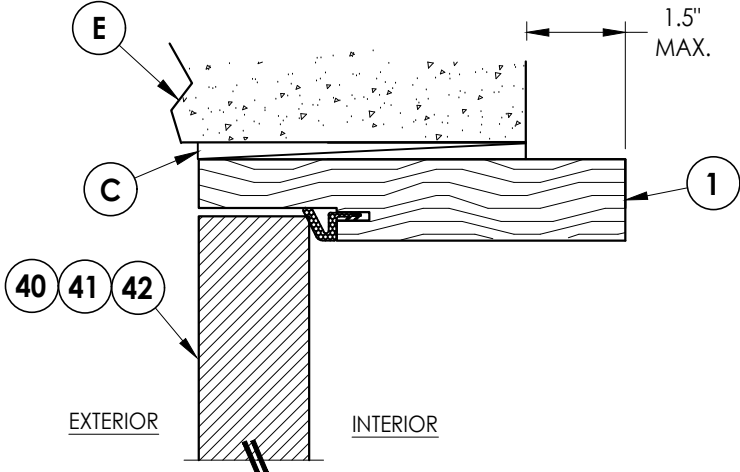


4/6 VERTICAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb


DIRECT TO MASONRY MAX. DESIGN PRESSURE:
w/ STANDARD STRIKE = ± 47 PSF
w/ SECURITY STRIKE = ± 55 PSF

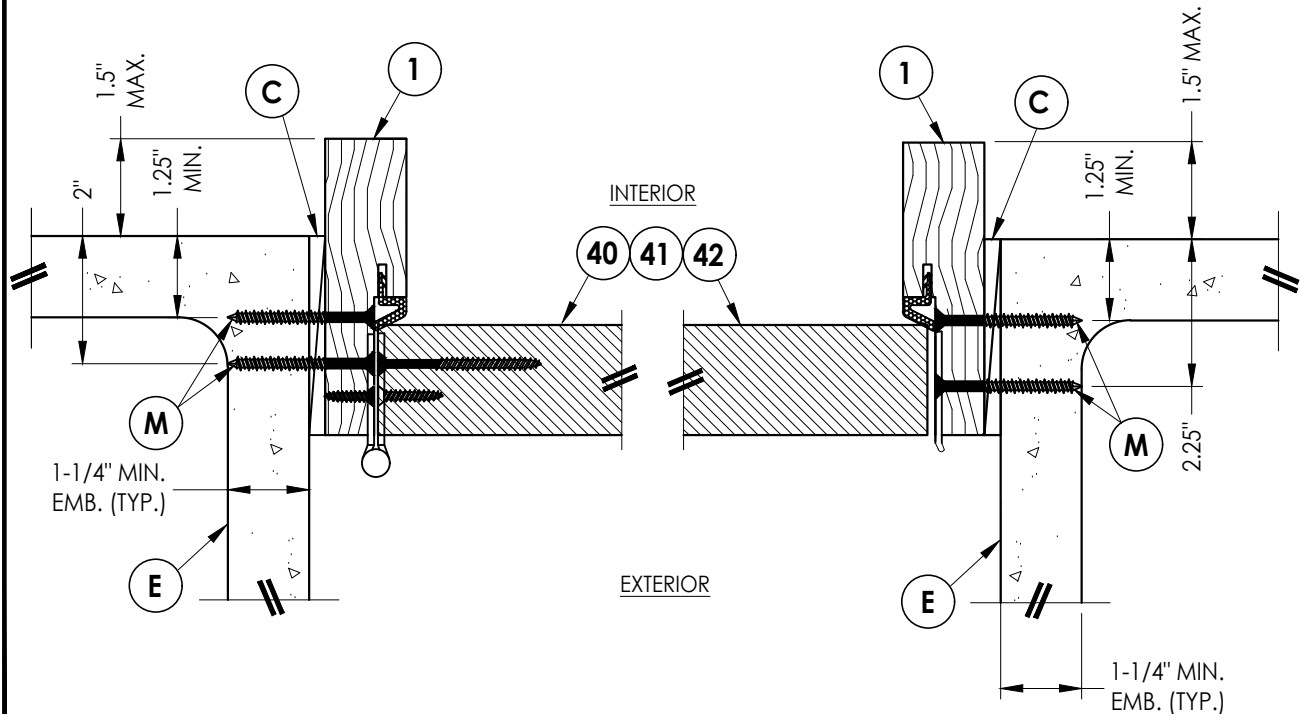


2/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

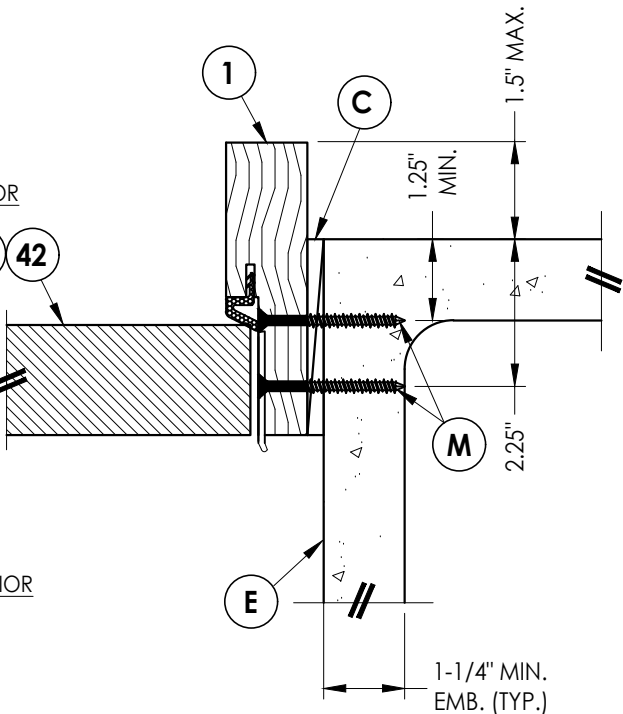

3/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 4-9/16" jamb

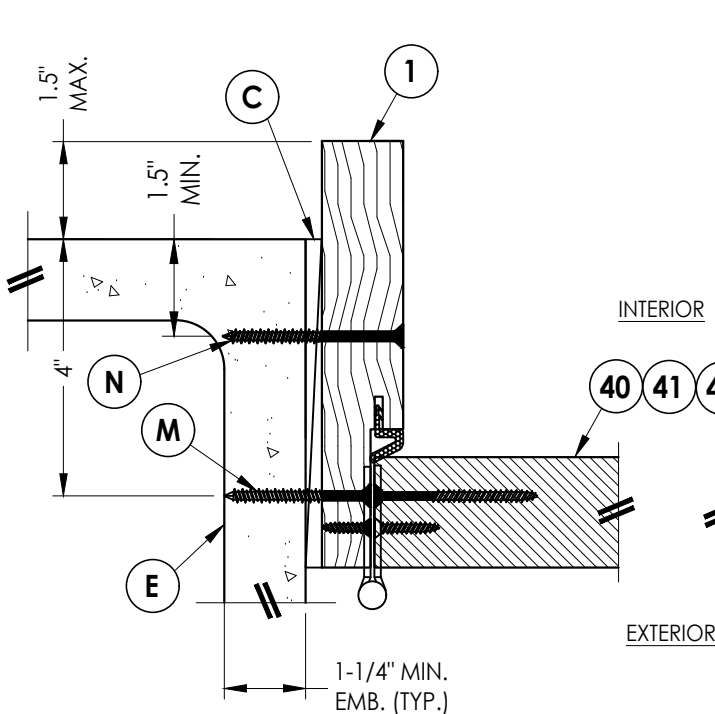

5/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

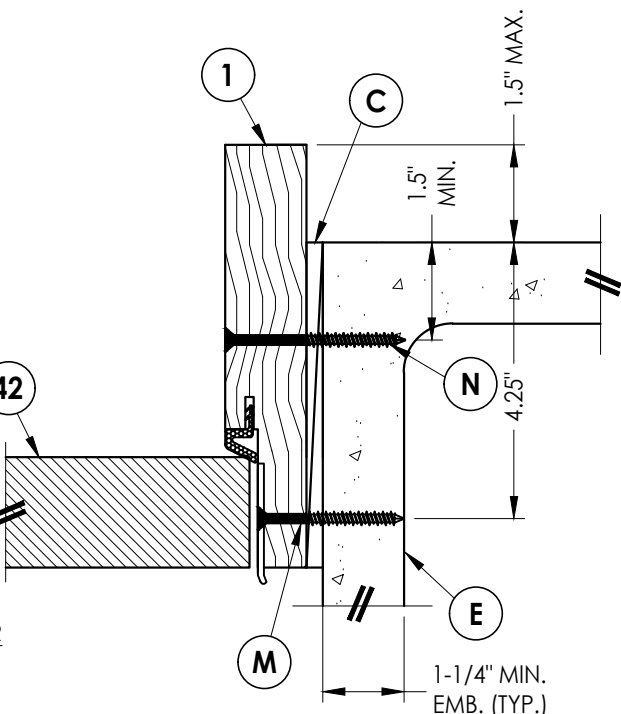

6/6 HORIZONTAL CROSS SECTION
Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
4	7/25/23	UPDATE TO 8TH ED. (2023) FBC LFS
3	7/22/20	UPDATE TO 7th ED (2020) FBC LFS
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING LFS
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC JK

DATE: 08/02/16

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-20470.10


SHEET 6 OF 12

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg


- Notes:
1. Sill Item #'s 16, 32, 36, 37, 38, 39, 43, 44, 45, 46, 47 & 48 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws at each end.
- Sill Item #'s 17, 18 & 19 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
- Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph SMS at each end.

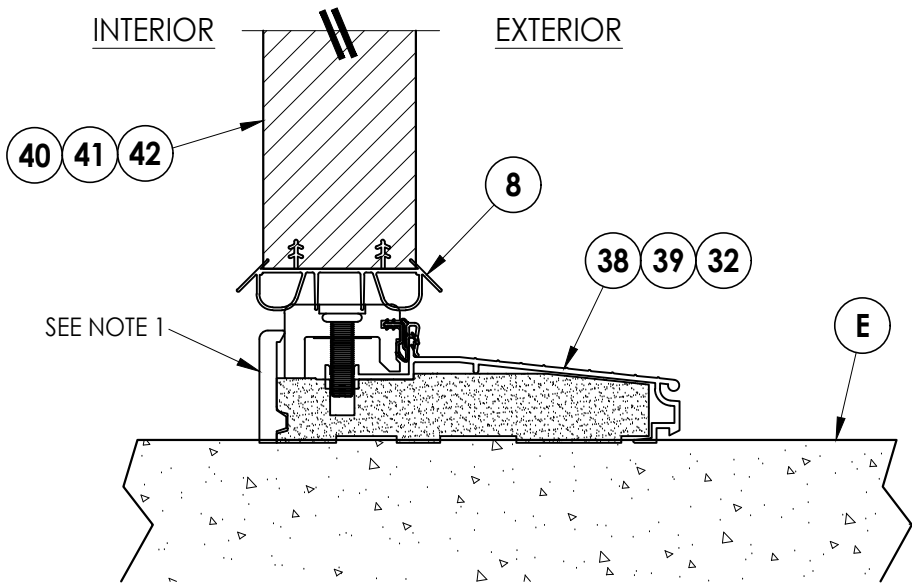


1 **VERTICAL CROSS SECTION**
7 Inswing Sill

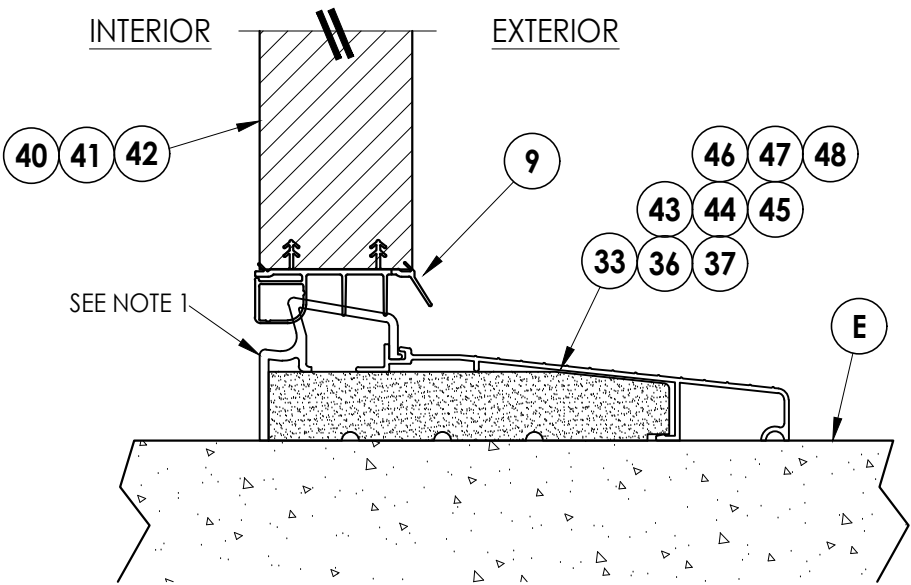

2 **VERTICAL CROSS SECTION**
7 Inswing Sill

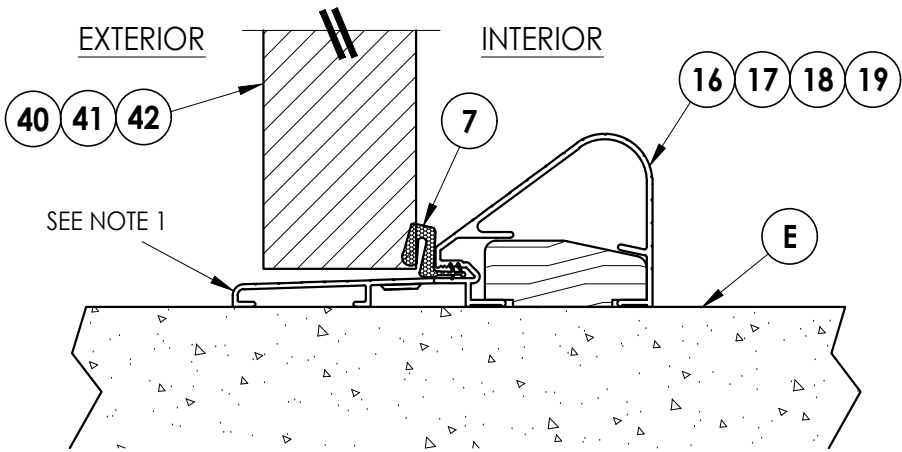

3 **VERTICAL CROSS SECTION**
7 Outswing Sill (Coastal Sill Shown)

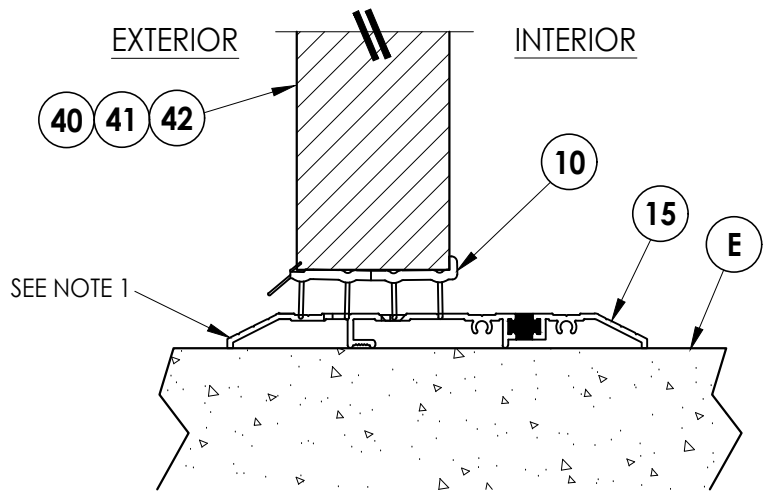

4 **VERTICAL CROSS SECTION**
7 Public Access Sill

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R²W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

NO.	DATE	REVISIONS				
		DATE	BY	CHK.	APP.	DESCRIPTION
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS		
4	7/25/23	UPDATE TO 8TH ED. (2023)	FBC	LFS		
3	7/22/20	UPDATE TO 7th ED (2020)	FBC	LFS		
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING	LFS			
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC	JK		

DATE: 08/02/16

SCALE: N.T.S.

DWG. BY: JK




CHK. BY: LFS

DRAWING NO.:

FL-20470.10

SHEET 7 OF 12

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

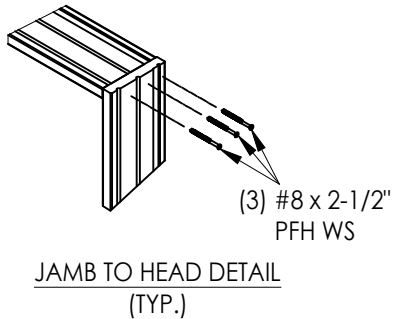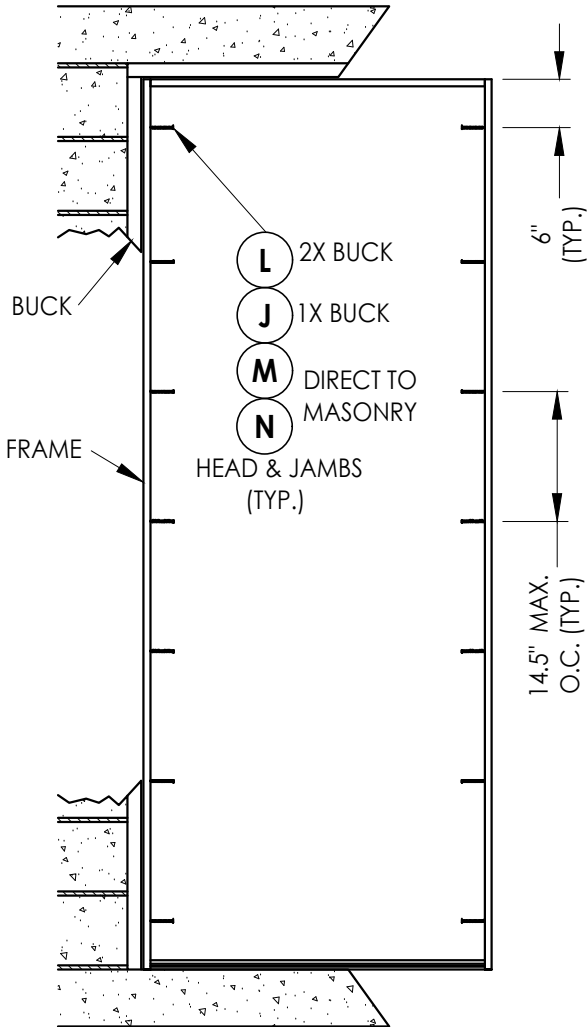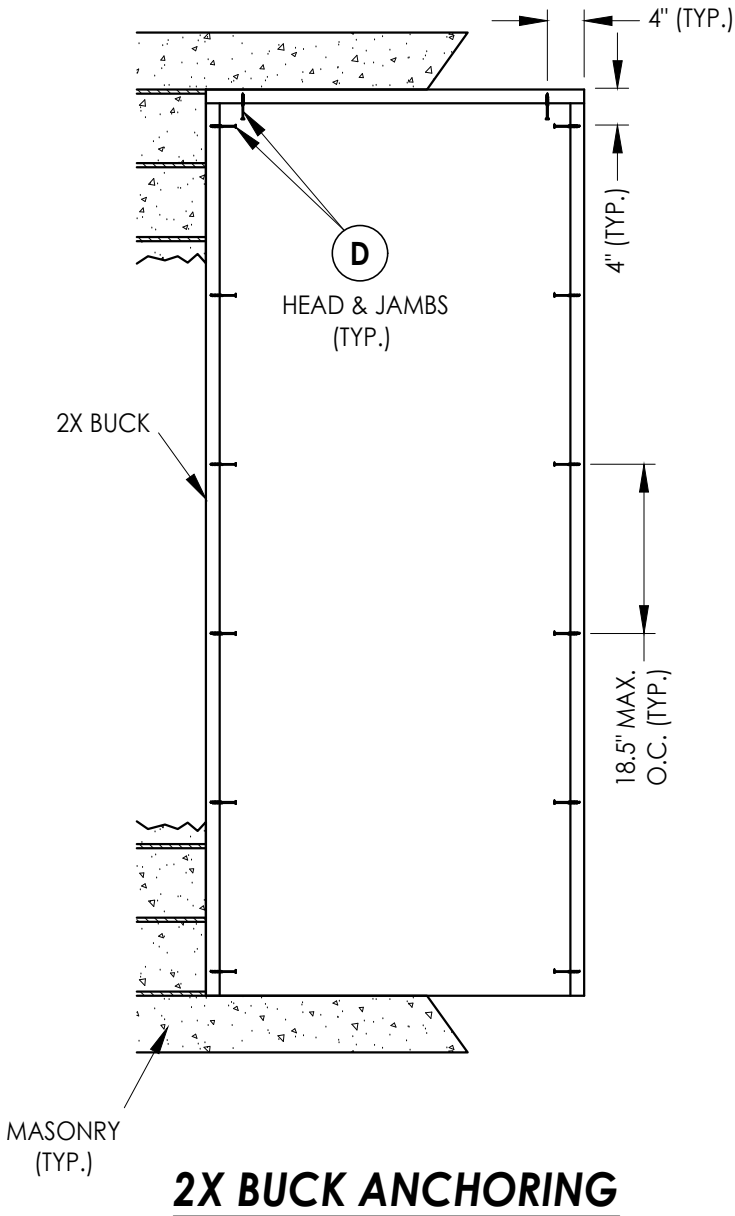

5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
4	7/25/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
3	7/22/20	UPDATE TO 7th ED. (2020)	FBC	LFS
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING	FBC	LFS
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC	JK
NO.	DATE			BY
REVISIONS				

DATE: 08/02/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-20470.10


SHEET 8 OF 12

PRODUCT:	THERMA-TRU FIBERGLASS DOOR
PART OR ASSEMBLY:	BUCK AND FRAME ANCHORING

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

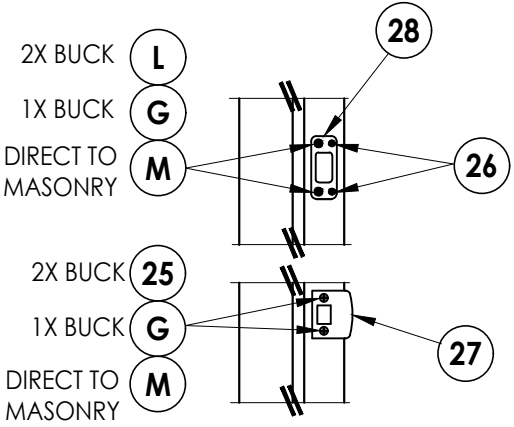

LATCH & DEADBOLT DETAIL


Kwikset

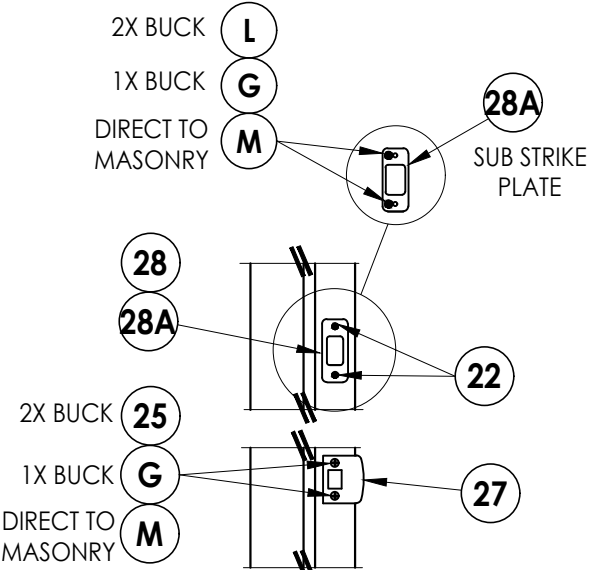

LATCH & DEADBOLT DETAIL

Schlage

LATCH & DEADBOLT STRIKE DETAILS

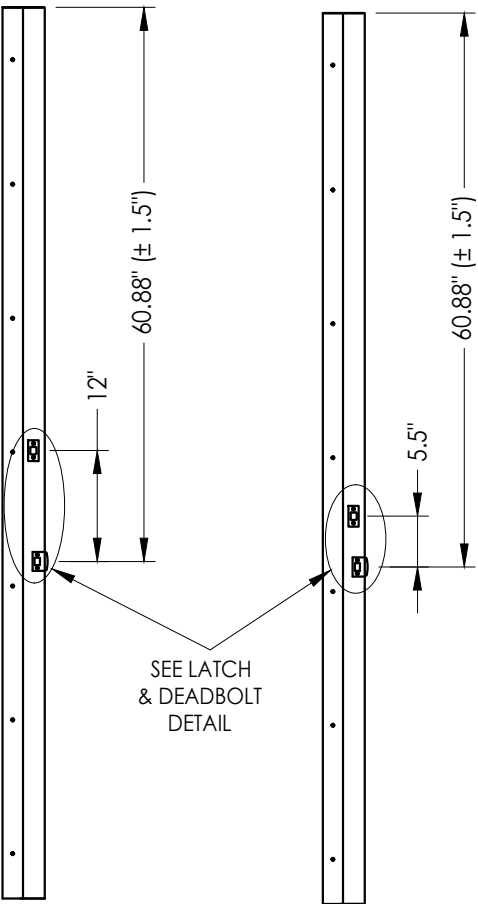


STRIKE JAMB

Latch & Deadbolt
(12" o.c. spacing)


STRIKE JAMB

Latch & Deadbolt
(5-1/2" o.c. spacing)

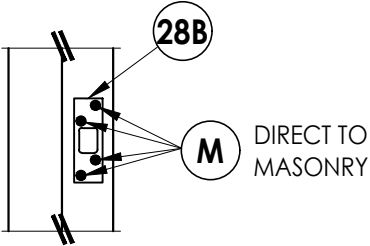


DEADBOLT STRIKE DETAILS


(Security Deadbolt Strike Plate)

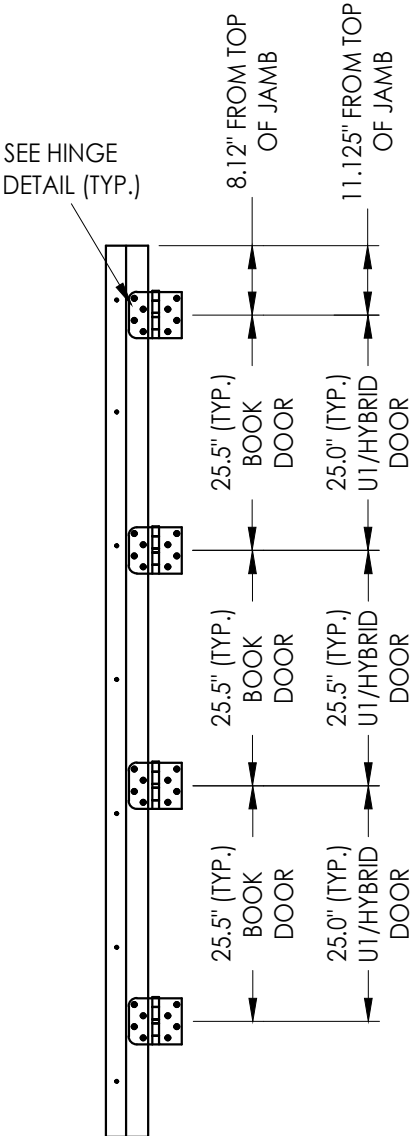

HINGE JAMB

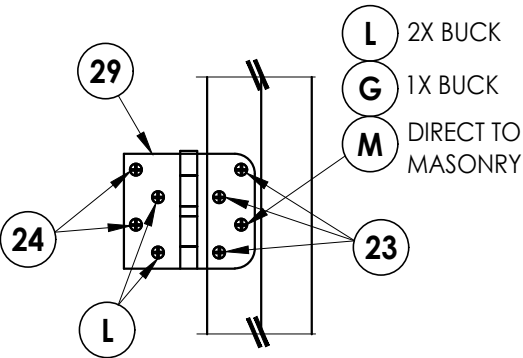


HINGE DETAIL

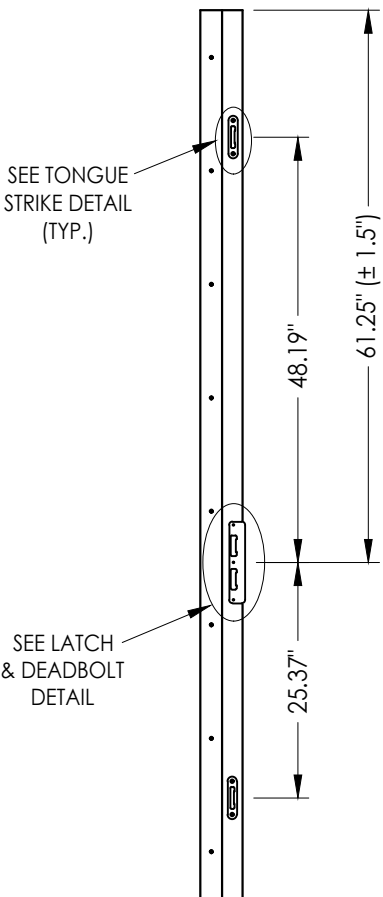


STRIKE JAMB

Multipoint Lock

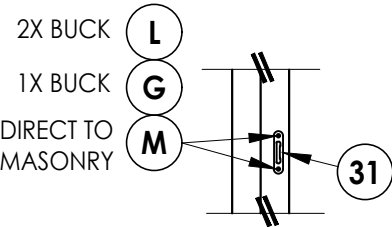

TONGUE STRIKE DETAIL

Multipoint Lock

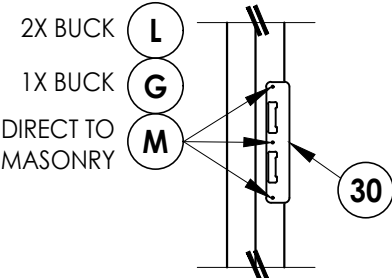


LATCH & DEADBOLT DETAIL

Multipoint Lock


MULTIPOINT LOCK STRIKE DETAILS

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: HARDWARE DETAILS	
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC
4	7/25/23	UPDATE TO 8TH ED. (2023)	FBC
3	7/22/20	UPDATE TO 7th ED (2020)	FBC
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING	LFS
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC
NO.	DATE	REVISIONS	
DATE: 08/02/16			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-20470.10			
SHEET 9 OF 12			



Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

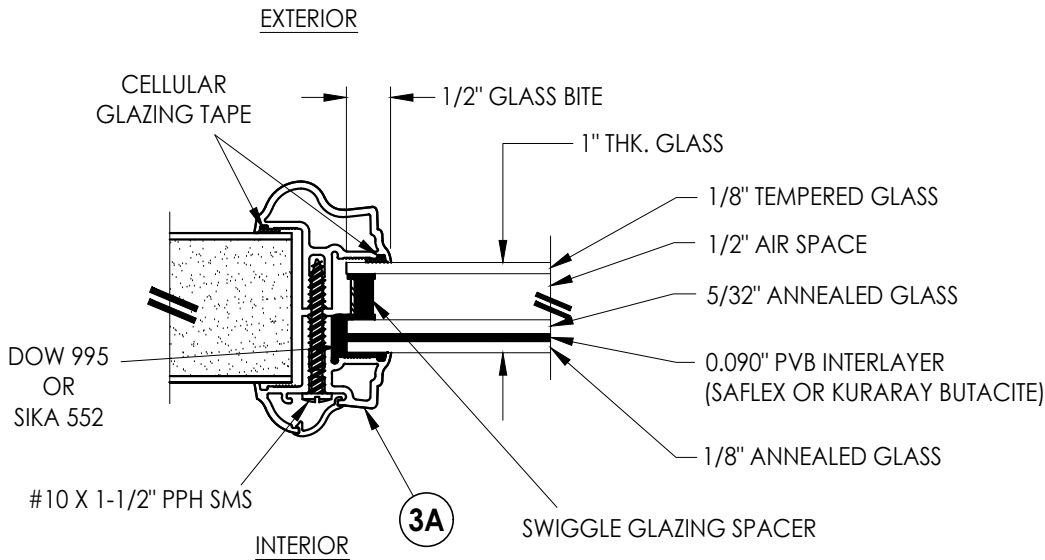

G1 GLAZING DETAIL
Aluminum Impact Lite Frame
Door Panels & Sidelites

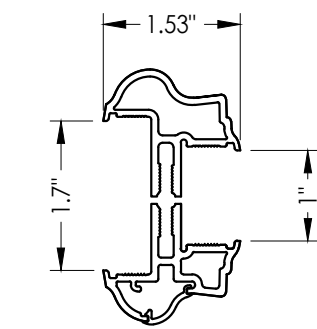


3A ALUMINUM FRAME
Aluminum Impact Lite Frame
Door Panels & Sidelites

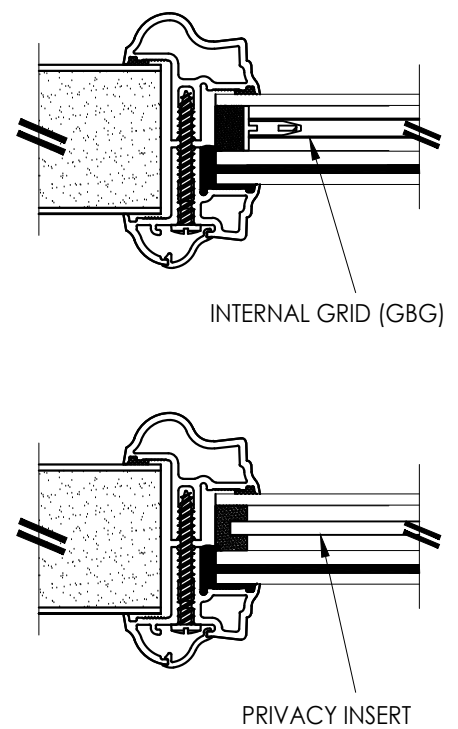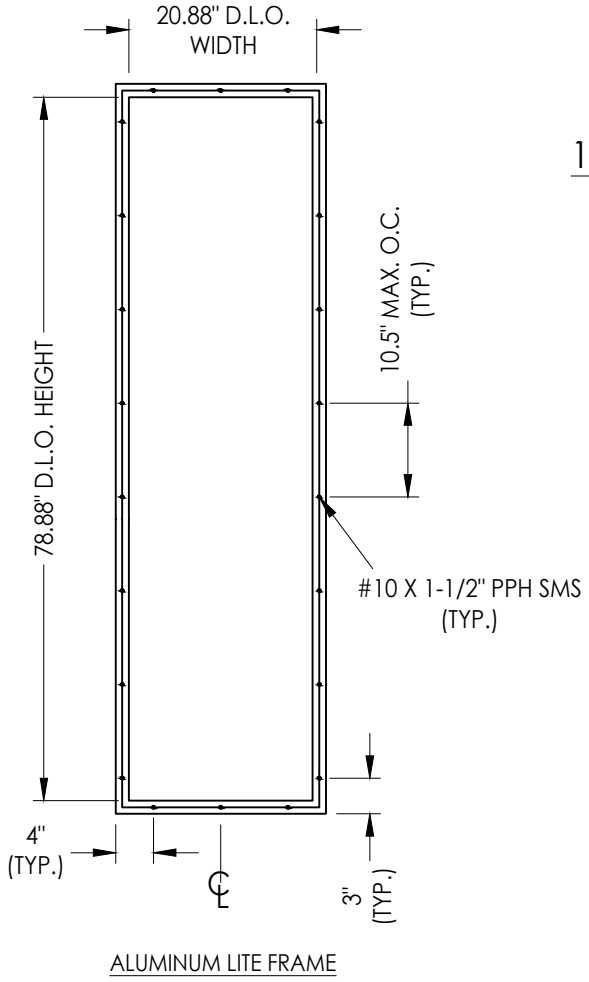

1" LAMINATED INSULATED IMPACT GLASS INSERT OPTIONS


Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: GLAZING DETAILS	
5	7/02/26	UPDATE TO 9TH ED. (2026)	FBC
4	7/25/23	UPDATE TO 8TH ED. (2023)	FBC
3	7/22/20	UPDATE TO 7th ED (2020)	FBC
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING	LFS
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC
NO.	DATE		BY
REVISIONS			
DATE: 8/02/16			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-20470.10			
SHEET 10 OF 12			

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

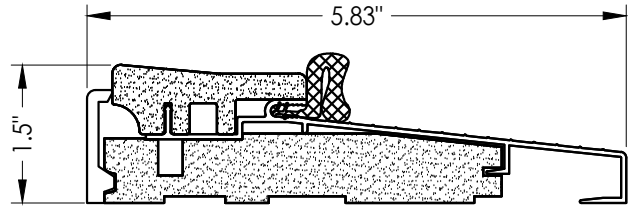


16 OUTSWING THRESHOLD
Composite Sill


MAX. +55 PSF
(where water infiltration is required)

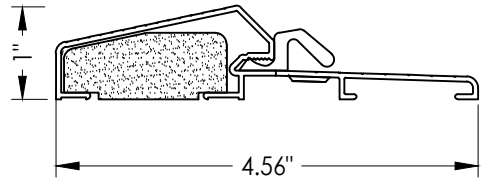


17 OUTSWING THRESHOLD
Composite / Aluminum Sill

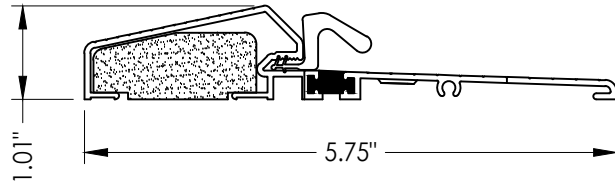


18 OUTSWING THRESHOLD
Composite / Aluminum Sill
(Thermal Break)

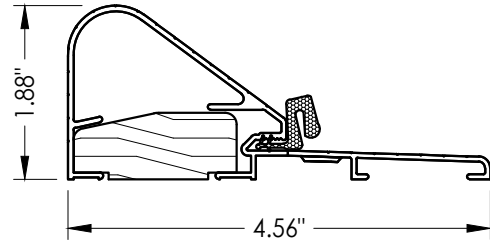


19 COASTAL OUTSWING THRESHOLD
Wood / Aluminum Sill

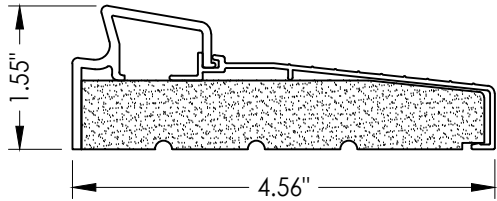


33 INSWING THRESHOLD
Inswing Basic Fixed Sill

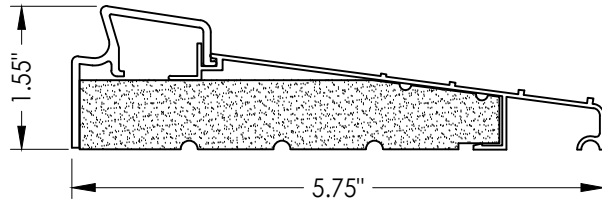


36 INSWING THRESHOLD
Inswing Basic Fixed 5-3/4" Sill

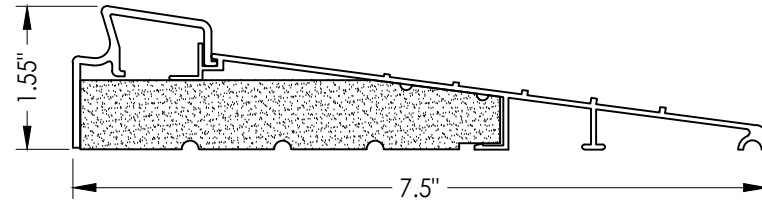


37 INSWING THRESHOLD
Inswing Basic Fixed 7-1/2" Sill

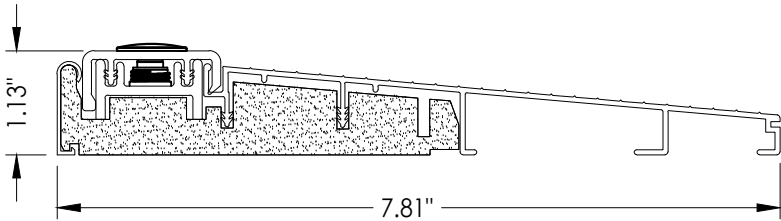


32 INSWING THRESHOLD
Inswing Composite Adjustable 7-3/4" Sill

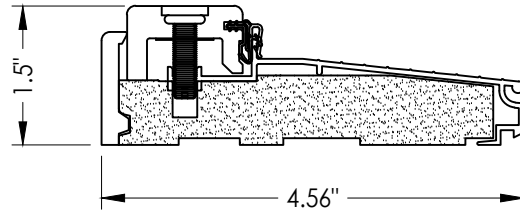


38 INSWING THRESHOLD
Inswing Composite Adjustable Sill

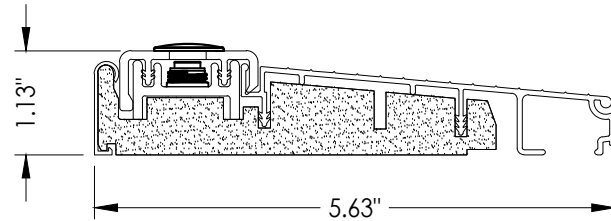


39 INSWING THRESHOLD
Inswing Composite Adjustable Sill

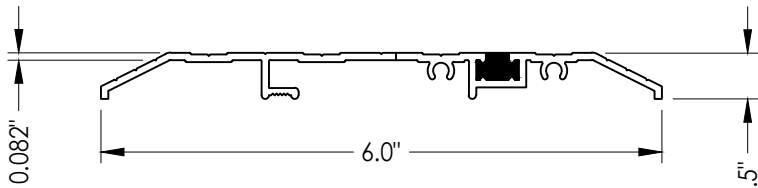


15 PUBLIC ACCESS THRESHOLD

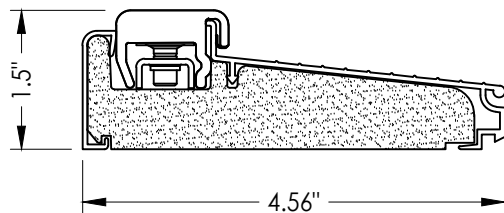


43 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

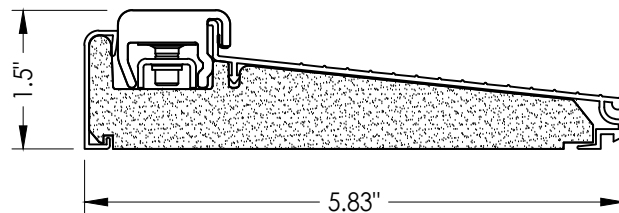


44 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

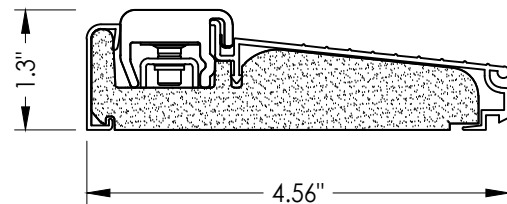


46 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

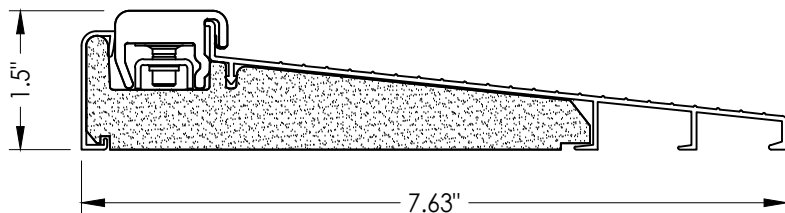

45 INSWING THRESHOLD
Inswing Composite Adjustable Sill
Book, Hybrid

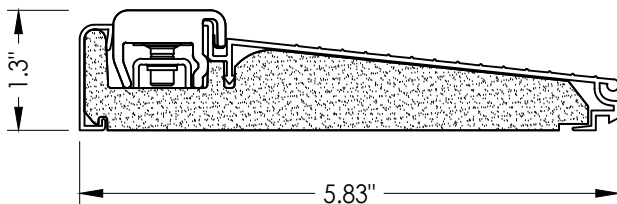

47 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

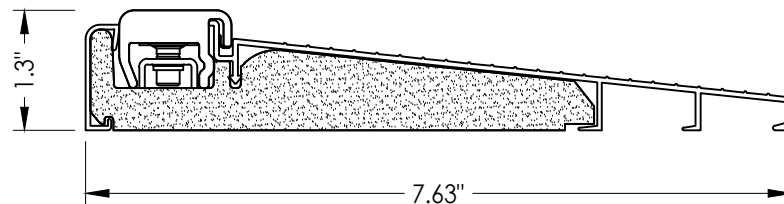

48 INSWING THRESHOLD
Inswing Composite Adjustable Sill
U1

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:

COMPONENTS

NO.	DATE	REVISIONS				
		BY	JK	LFS	FBC	LFS
5	7/02/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS	
4	7/25/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS	
3	7/22/20	UPDATE TO 7TH ED.	(2020)	FBC	LFS	
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING		FBC	LFS	
1	7/14/17	UPDATE TO 6TH ED.	(2017)	FBC	JK	

DATE: 08/02/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.: FL-20470.10
SHEET 11 OF 12


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.10-12.dwg

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE (STANDARD)	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	28A	DEADBOLT SUB STRIKE PLATE	STEEL
			28B	DEADBOLT STRIKE PLATE (SECURITY)	STEEL
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	29	4" X 4" HINGE	STEEL
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	30	LATCH & DEADBOLT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	31	MULTIPOINT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL	32	INSWING THRESHOLD	ALUM/COMP
N	3/16" X 2-3/4" ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	36	INSWING THRESHOLD	ALUM/COMP
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	37	INSWING THRESHOLD	ALUM/COMP
7	WEATHERSTRIP (LONG REACH)	FOAM	38	INSWING THRESHOLD	ALUM/COMP
8	SWEEP	VINYL	39	INSWING THRESHOLD	ALUM/COMP
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL	40	DOOR PANEL (BOOK)	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	41	DOOR PANEL (HYBRID)	-
15	PUBLIC ACCESS THRESHOLD	ALUM	42	DOOR PANEL (U1)	-
16	OUTSWING THRESHOLD	ALUM/COMP	43	INSWING THRESHOLD	ALUM/COMP
17	OUTSWING THRESHOLD	ALUM/COMP	44	INSWING THRESHOLD	ALUM/COMP
18	OUTSWING THRESHOLD	ALUM/COMP	45	INSWING THRESHOLD	ALUM/COMP
19	COASTAL OUTSWING THRESHOLD	ALUM/WOOD	46	INSWING THRESHOLD	ALUM/COMP
22	#8 x 3/4" PFH WOOD SCREW	STEEL	47	INSWING THRESHOLD	ALUM/COMP
23	#10 x 3/4" PFH WOOD SCREW	STEEL	48	INSWING THRESHOLD	ALUM/COMP
24	#10 x 1" PFH WOOD SCREW	STEEL			

- CONCRETE ANCHOR NOTES:
- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
 - Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
 - Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA CON+®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

- WOOD SCREW INSTALLATION NOTES:
- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

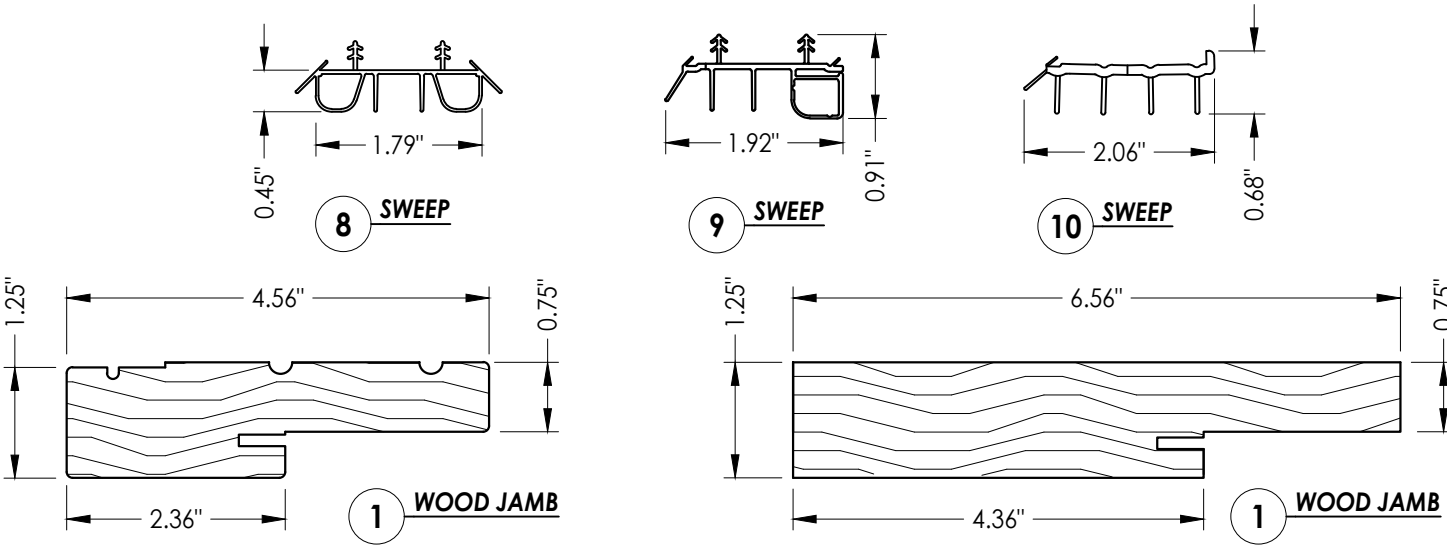

CORROSION RESISTANCE - SALTWATER ENVIRONMENTS
Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: THERMA-TRU FIBERGLASS DOOR		PART OR ASSEMBLY: COMPONENTS & BILL of MATERIALS	
5	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
4	7/25/23	UPDATE TO 8TH ED. (2023) FBC	LFS
3	7/22/20	UPDATE TO 7th ED (2020) FBC	LFS
2	4/06/19	ADD 5-1/2" LATCH/DB SPACING	LFS
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC	JK
NO.	DATE		BY
REVISIONS			
DATE: 08/02/16			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-20470.10			
SHEET 12 OF 12			