

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg




Fiber-Classic® & Smooth-Star®

COMPOSITE EDGE
OPAQUE FIBERGLASS SINGLE DOOR
INSWING/OUTSWING
"IMPACT" DOOR w/ "NON-IMPACT" SIDELITES

GENERAL NOTES


1. This product evaluation drawing has been developed in compliance with the 9th Edition (2026) Florida Building Code (FBC) including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with FBC Section 1626 and does not require an impact resistant covering. The non-impact sidelite(s) must be protected with an impact resistant covering complying with FBC Section 1626.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996. The non-impact sidelite(s) must be protected with an impact resistant covering complying with FBC Sections 1609.1.2 & R301.2.1.2.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. Outswing configurations using Coastal Sill (item #19) & Composite Sill (item #16) under active doors and all sills used under sidelites meet water infiltration requirements for "HVHZ". All other configurations do not meet the water infiltration requirements for the "HVHZ" and shall be installed only in non-habitable areas or at habitable locations protected by an overhang or canopy such that the angle between the edge of canopy or overhang to sill is less than 45 degrees.
8. Fiber-Classic & Smooth-Star Sidelite panels require the use of "J" part numbers and must be stained or painted within six months of installation.

TABLE OF CONTENTS			
SHEET #	DESCRIPTION	SHEET #	DESCRIPTION
1	Typical Elevations, Design Pressures & General Notes	8	Vertical Cross Sections (Thresholds)
2	Door Panel Details	9	Buck Anchoring
3	Sidelite Panel Details	10	Frame Anchoring
4	Elevations	11	Hardware Details
5	Horizontal & Vertical Cross Sections (2X Buck)	12	Glazing Details
6	Horizontal & Vertical Cross Sections (1X Buck)	13	Components
7	Horizontal & Vertical Cross Sections (Direct to Masonry)	14	Bill of Materials

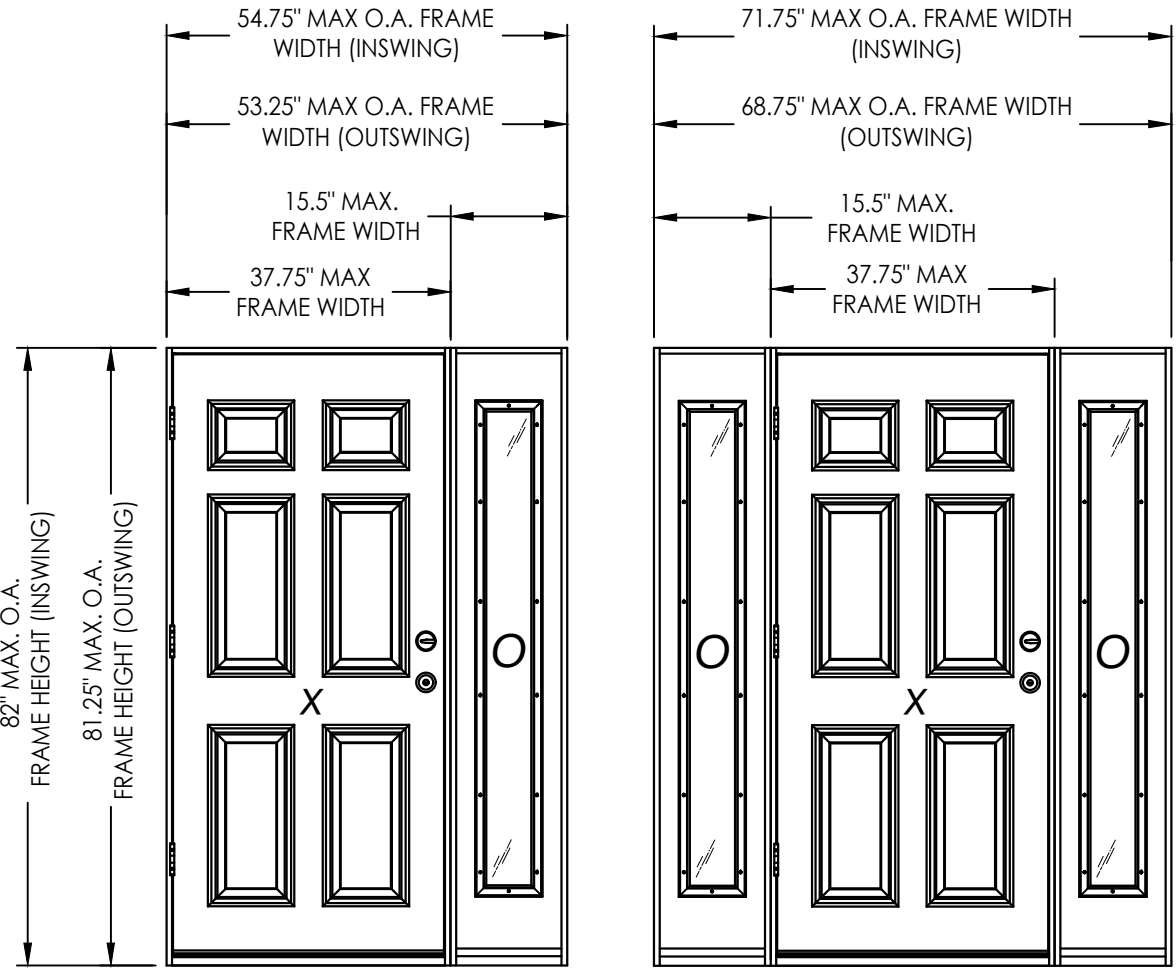

CONFIGURATION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
	POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
XO, OX, OXO	+60.0	-60.0	+60.0	-60.0

See Sheet 4 for Hardware Specifications

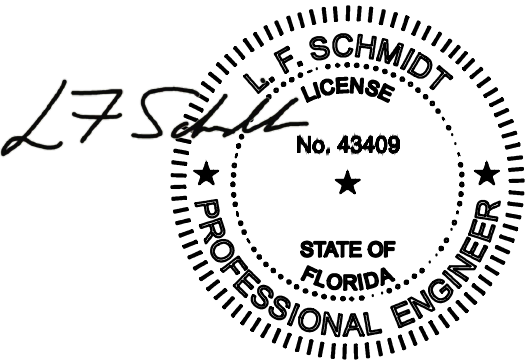

Digitally signed by Lyndon F Schmidt
Date: 2026.08.06 11:24:42
-04'00'

This item has been digitally signed and sealed by L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
THERMA TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES

4	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
3	7/25/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
2	7/22/20	UPDATE TO 7th ED (2020)	FBC	LFS
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC	JK
NO.	DATE			BY

REVISIONS

DATE: 8/10/16

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.: FL-20470.13

SHEET 1 OF 14

© 2016 R.W. BUILDING CONSULTANTS INC.


RWBUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

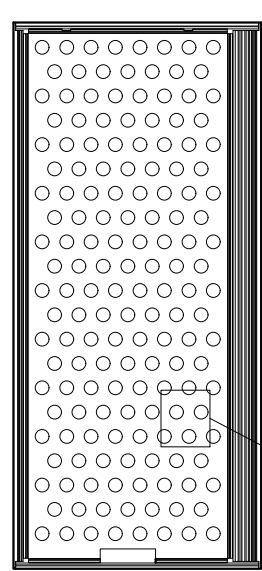


DETAIL A-A
PANEL REINFORCEMENT
(0.023" Thick Steel)

STEEL REINFORCEMENT
28.86% OPEN
AREA MAX.


* #8 X 2.5" PFH WS (TYP. @ EACH DOOR CORNER)

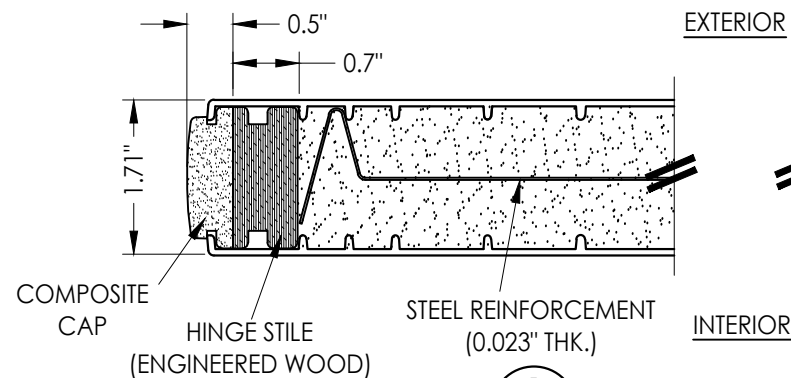


1 2 HORIZONTAL CROSS SECTION

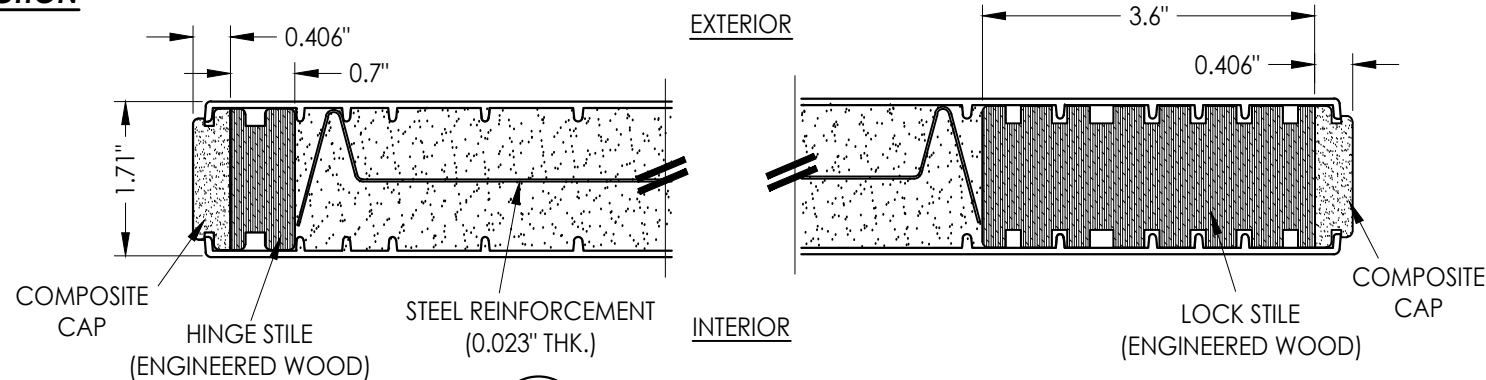


2 2 HORIZONTAL CROSS SECTION

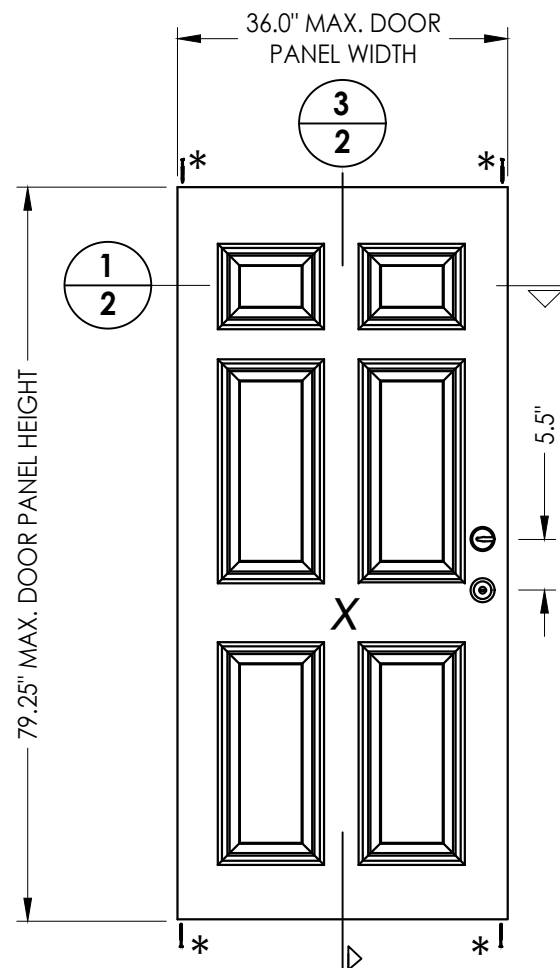


40 DOOR PANEL BOOK

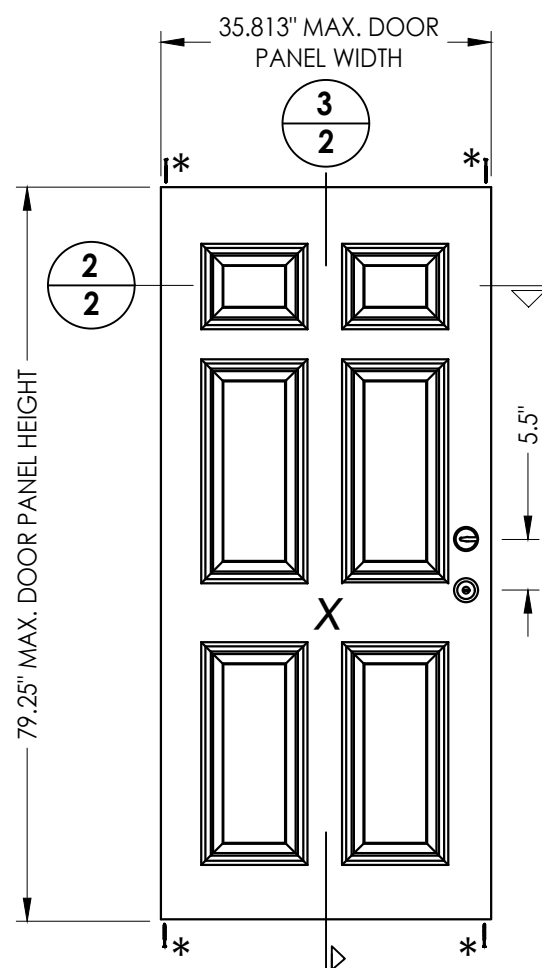

41 DOOR PANEL Hybrid Door

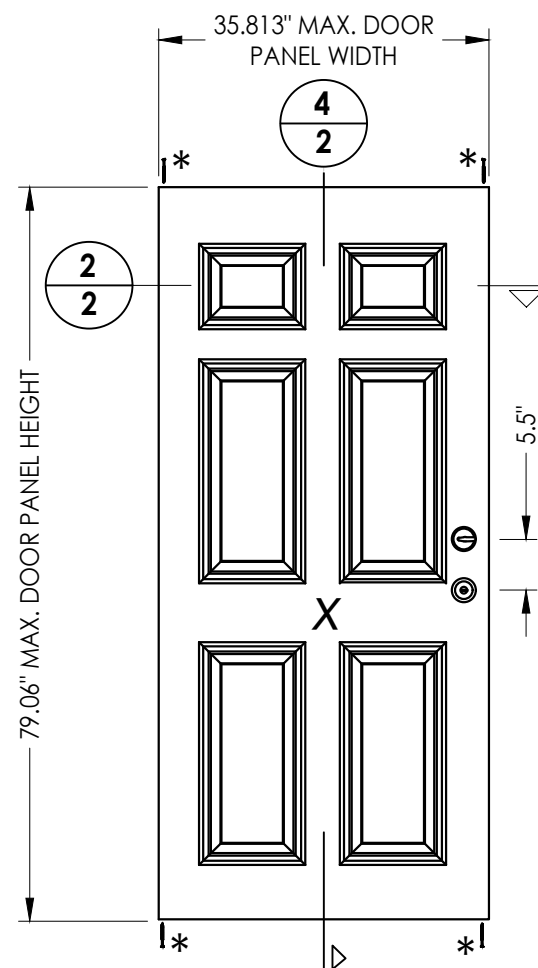

42 DOOR PANEL U1 Door

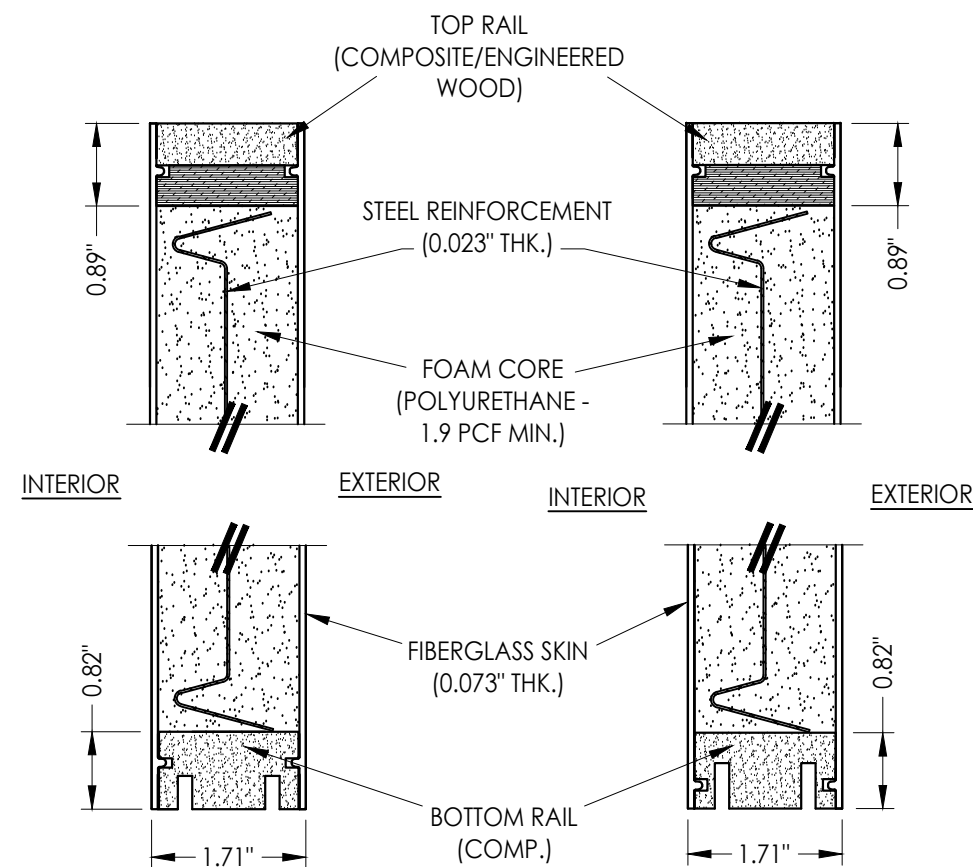

3 2 VERTICAL CROSS SECTION

4 2 VERTICAL CROSS SECTION

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

PRODUCT:
14 FIBERGLASS DOOR

PART OR ASSEMBLY:
DOOR PANEL DETAILS

NO.	DATE	REVISIONS			
		BY	CHK	DATE	DESCRIPTION
4	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
3	7/25/23	UPDATE TO 8TH ED. (2023)	FBC	LFS	
2	7/22/20	UPDATE TO 7TH ED. (2020)	FBC	LFS	
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC	JK	

DATE: 8/10/16

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:
FL-20470.13

SHEET 2 OF 14


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg

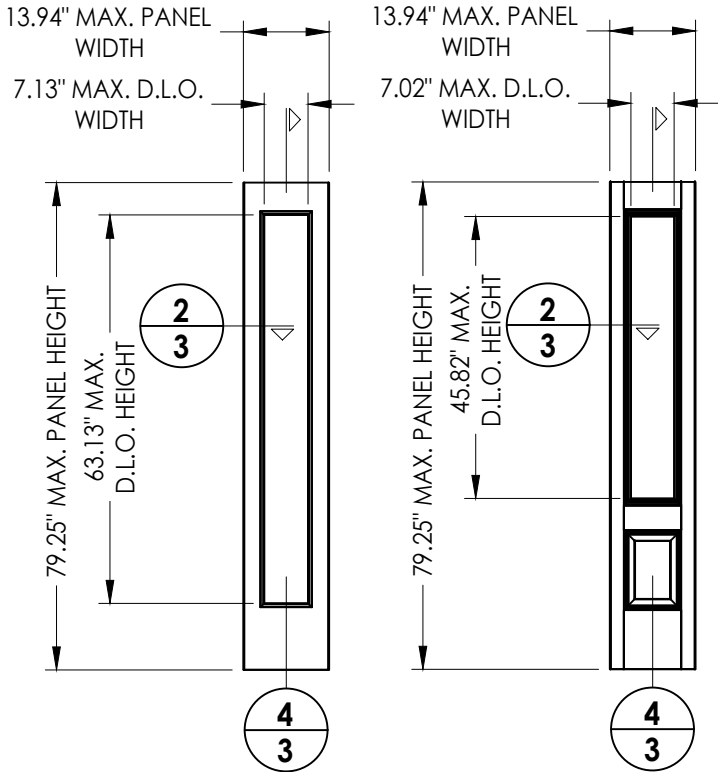


60 SIDELITE PANEL
Full Lite
Flush Glazed

60 SIDELITE PANEL
3/4 Lite
Flush Glazed

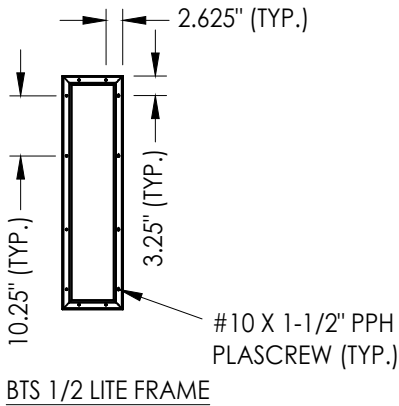


BTS 1/2 LITE FRAME

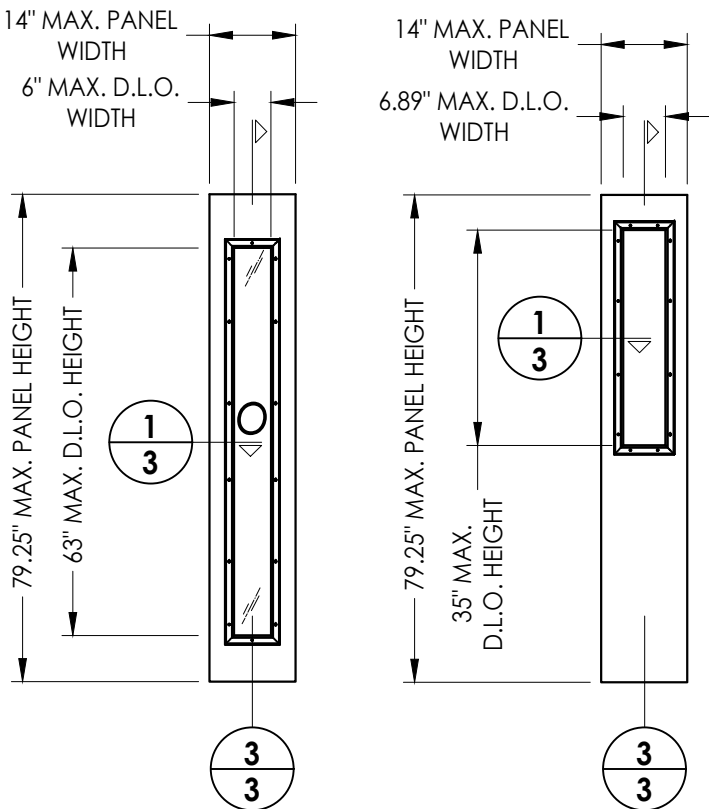


50 SIDELITE PANEL
Full Lite
Lip Lite


50 SIDELITE PANEL
Half Lite
Lip Lite

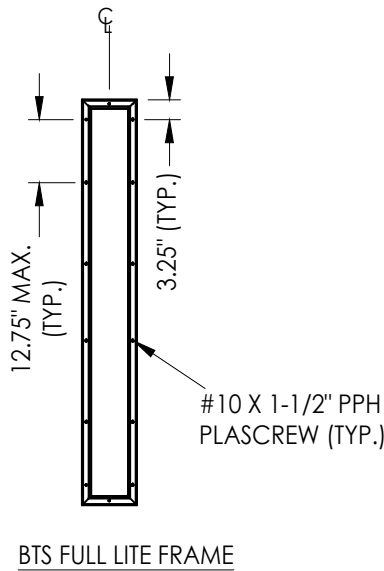


BTS FULL LITE FRAME

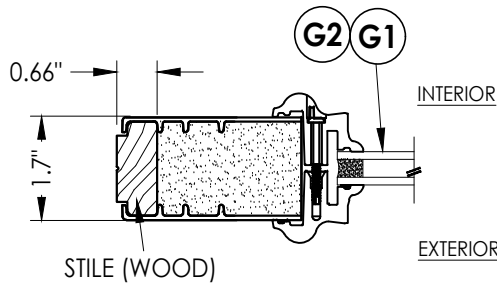


1 HORIZONTAL CROSS SECTION
Lip Lite Glazing

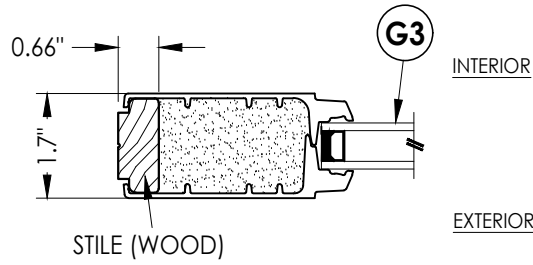

2 HORIZONTAL CROSS SECTION
Flush Glazing

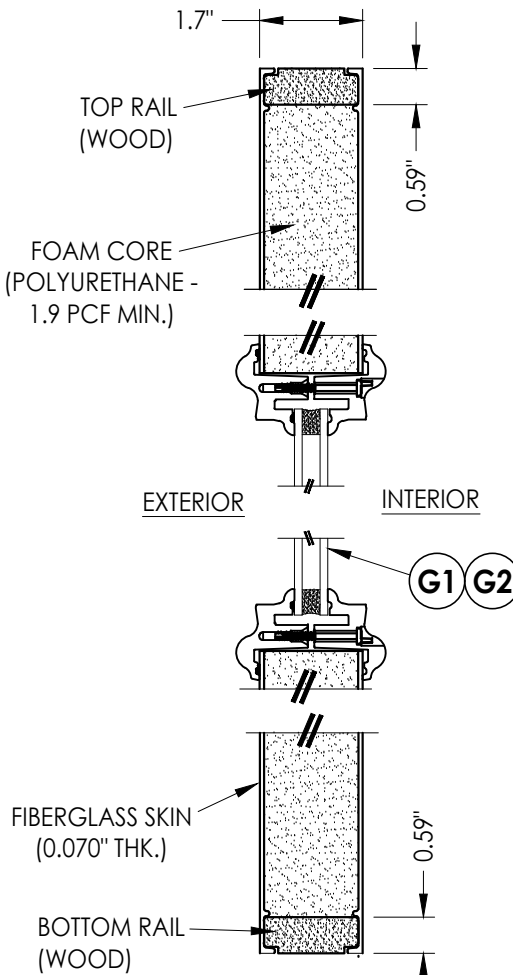

3 VERTICAL CROSS SECTION
Lip Lite Glazing Shown

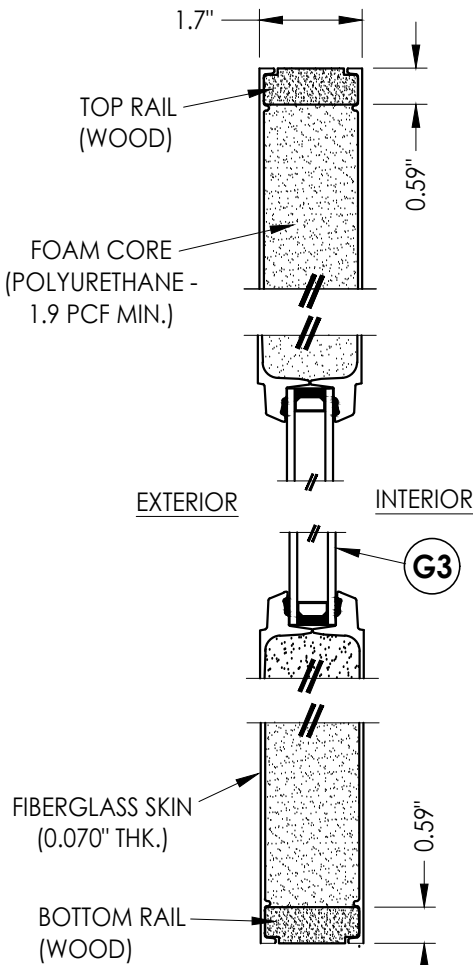


4 VERTICAL CROSS SECTION
Flush Glazing Shown

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:		THERMA TRU FIBERGLASS DOOR		PART OR ASSEMBLY:		SIDELITE PANEL DETAILS	


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg

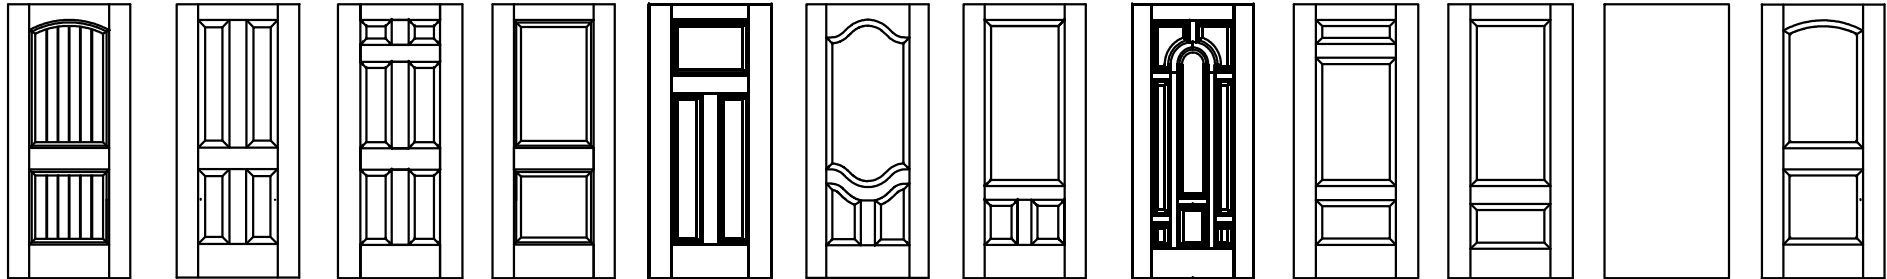

Fiber-Classic/Smooth-Star Door Panel Options
Panel options shown are for illustration and are representative only
(similar opaque panel configurations are allowed)

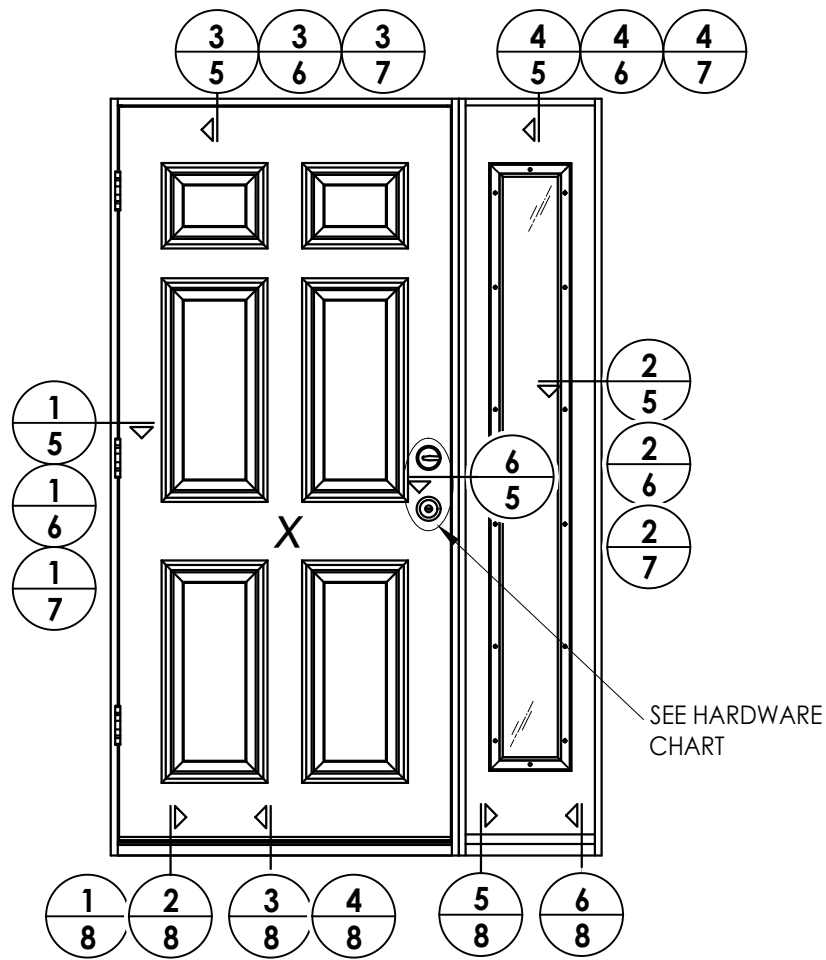

ELEVATION
XO

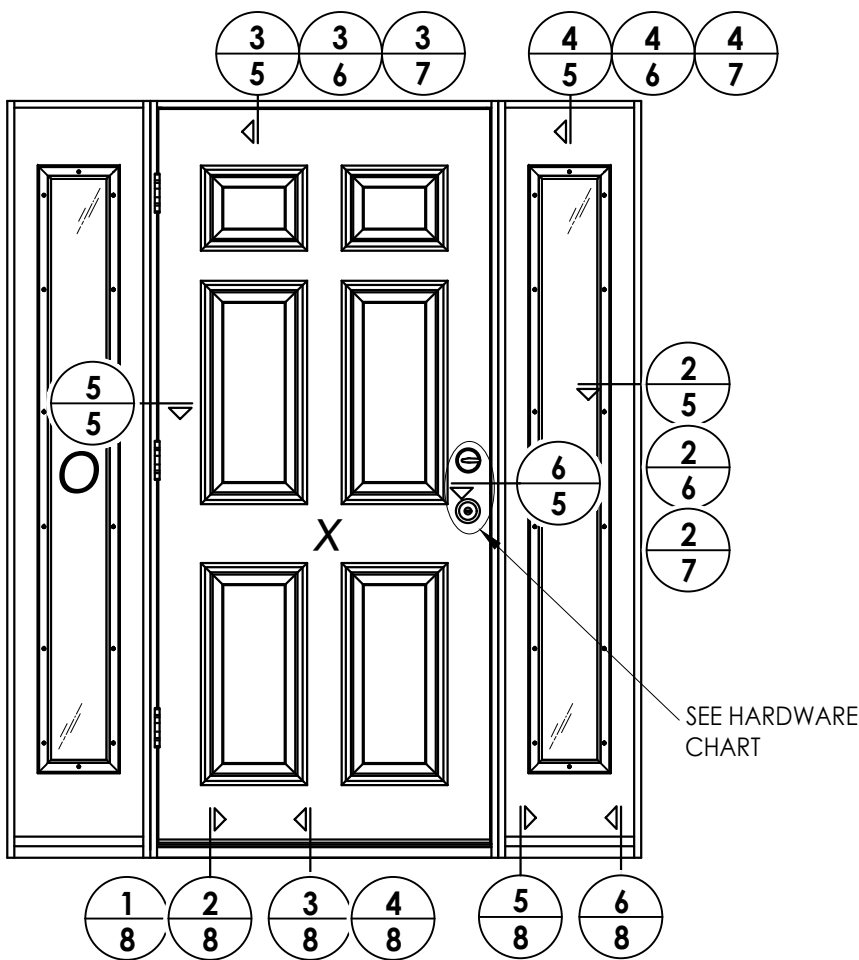

ELEVATION
OXO

HARDWARE TABLE	
MANUFACTURER	MODEL
SCHLAGE	KNOB: F51
	DEADBOLT: B60
KWIKSET	KNOB: SIGNATURE SERIES
	DEADBOLT: SIGNATURE SERIES (980)
HOPPE (THERMA-TRU)	MULTIPOINT : MPDGART (3 pt. Manual Tongue)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
ELEVATIONS

						REVISIONS	
						NO.	DATE
			4	7/02/26	UPDATE TO 9TH ED. (2026)	FBC	LFS
			3	7/25/23	UPDATE TO 8TH ED. (2023)	FBC	LFS
			2	7/22/20	UPDATE TO 7th ED. (2020)	FBC	LFS
			1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC	JK
							BY

DATE: 8/10/16

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-20470.13

SHEET 4 OF 14

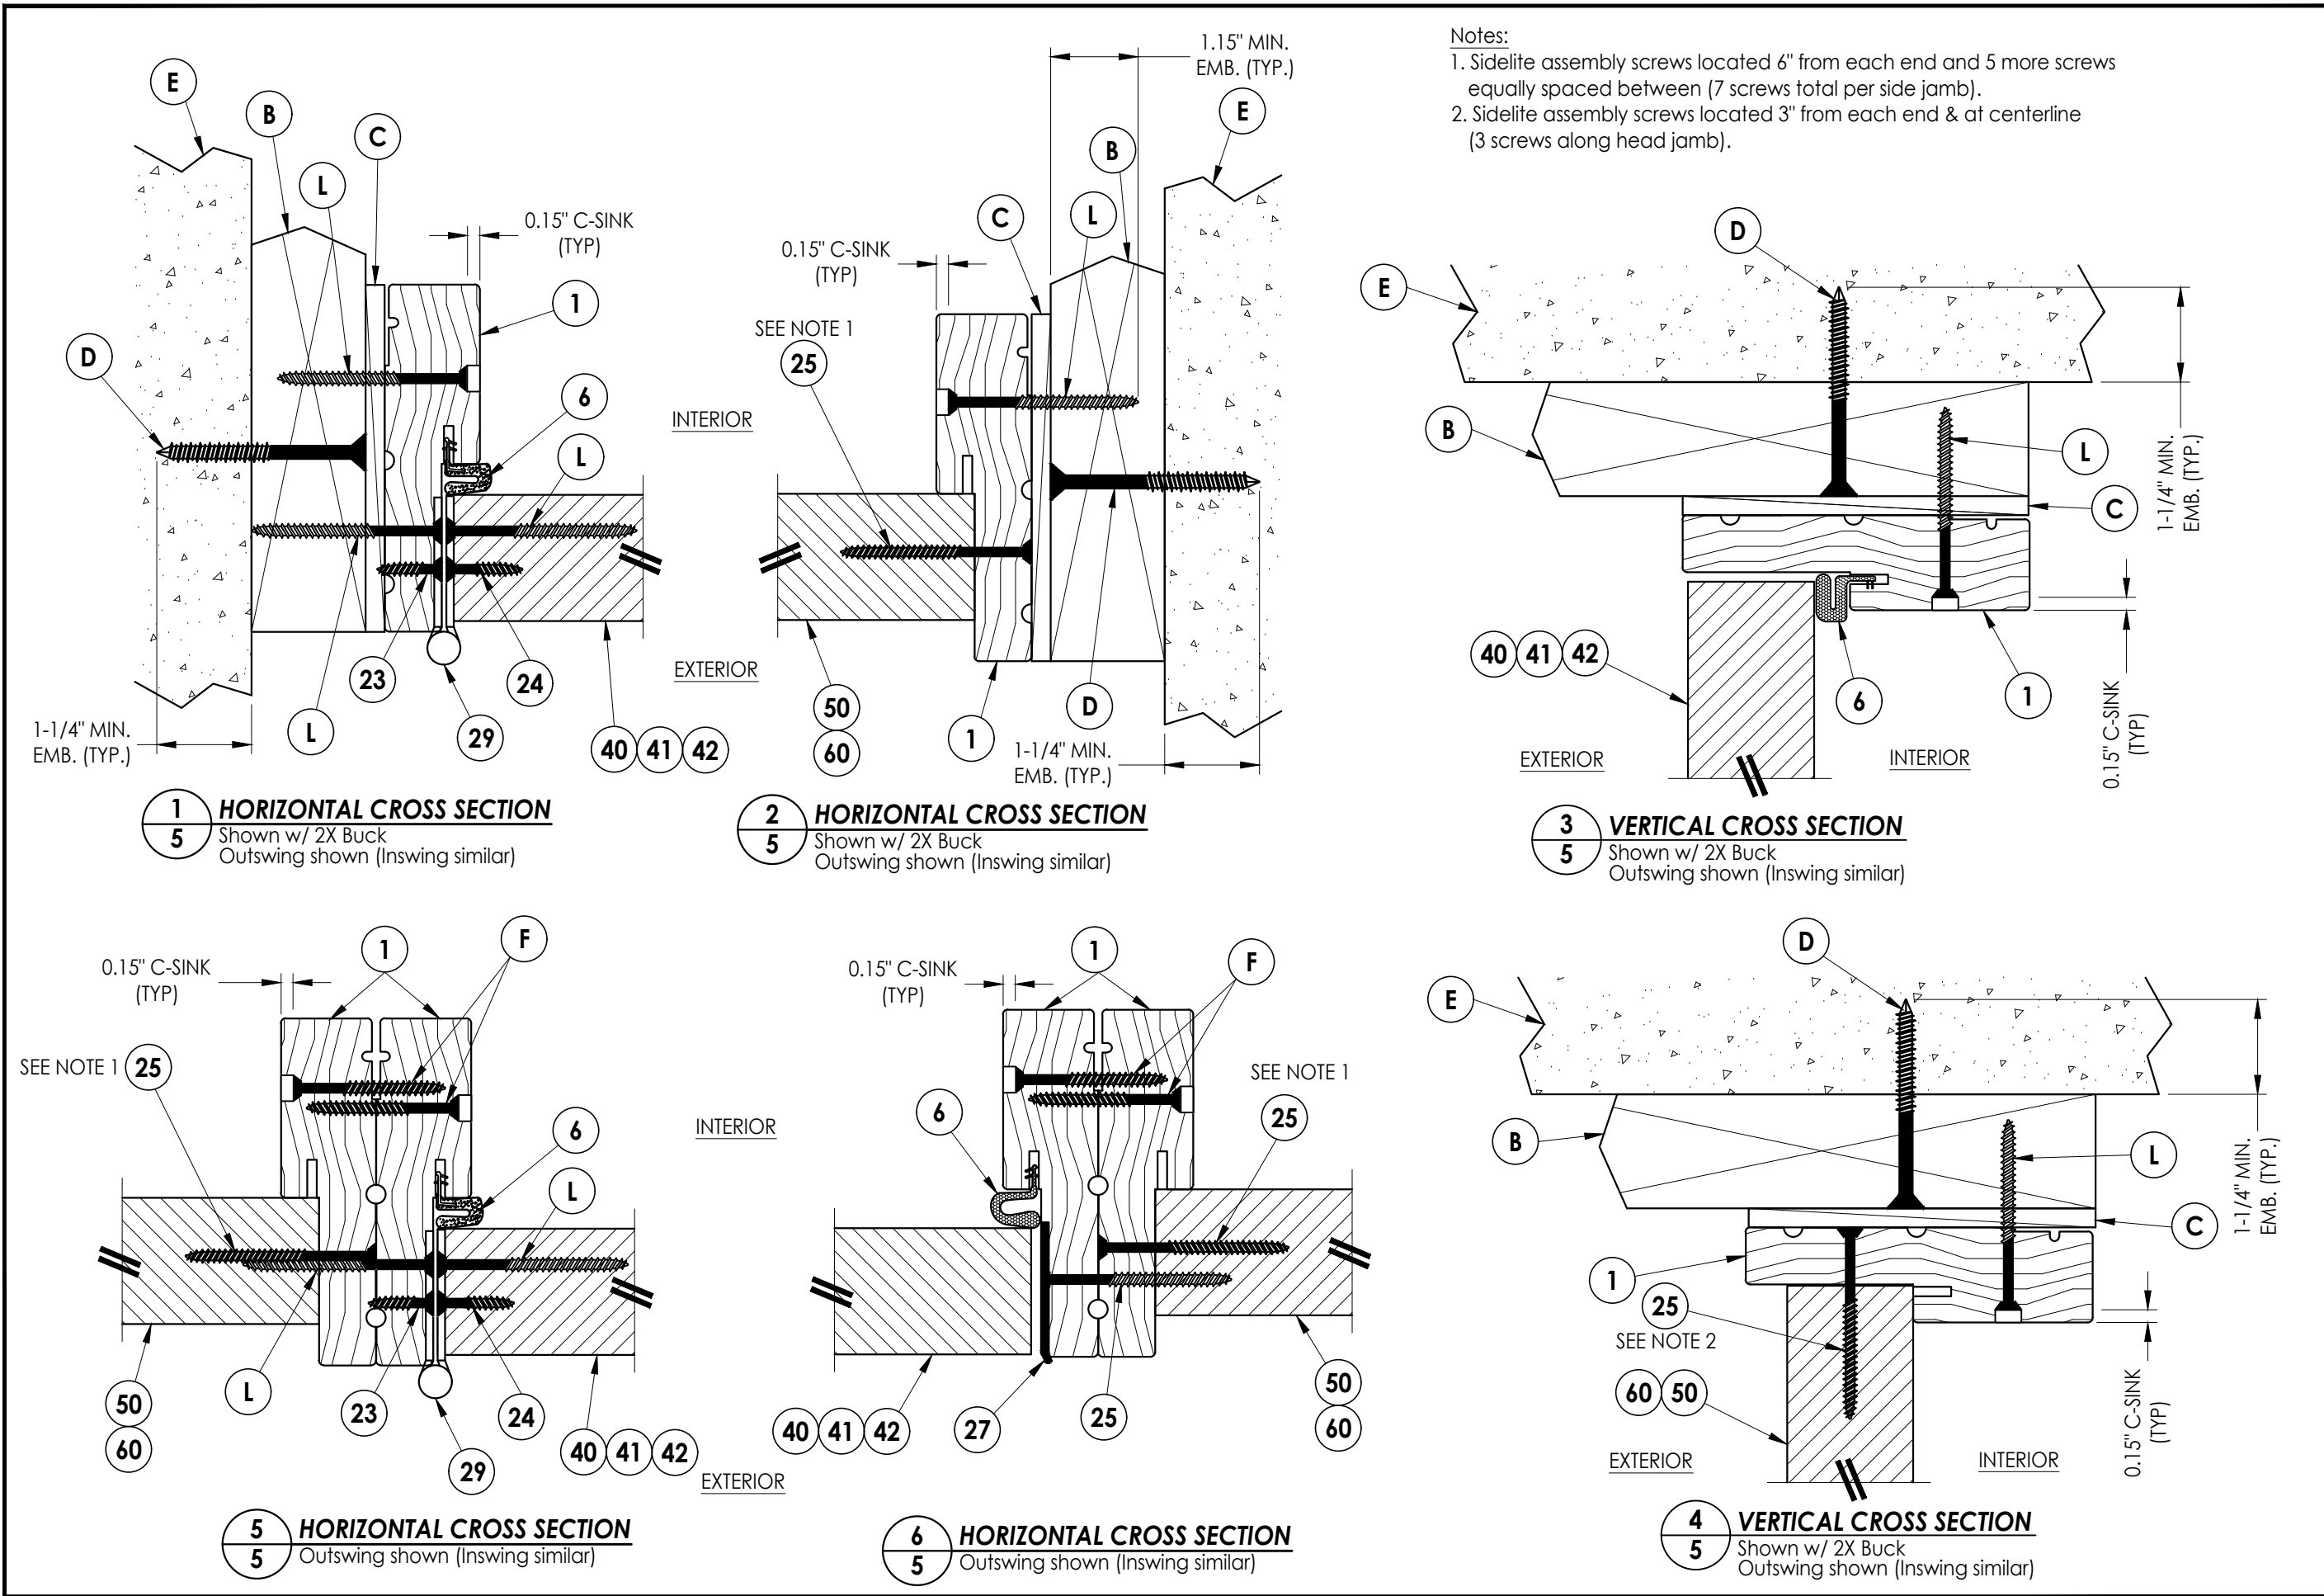

- Notes:
1. Sidelite assembly screws located 6" from each end and 5 more screws equally spaced between (7 screws total per side jamb).
 2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33487
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: THERMA TRU
FIBERGLASS DOOR


PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

[illegible]


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg

Notes:


1. Sidelite assembly screws located 6" from each end and 5 more screws equally spaced between (7 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).

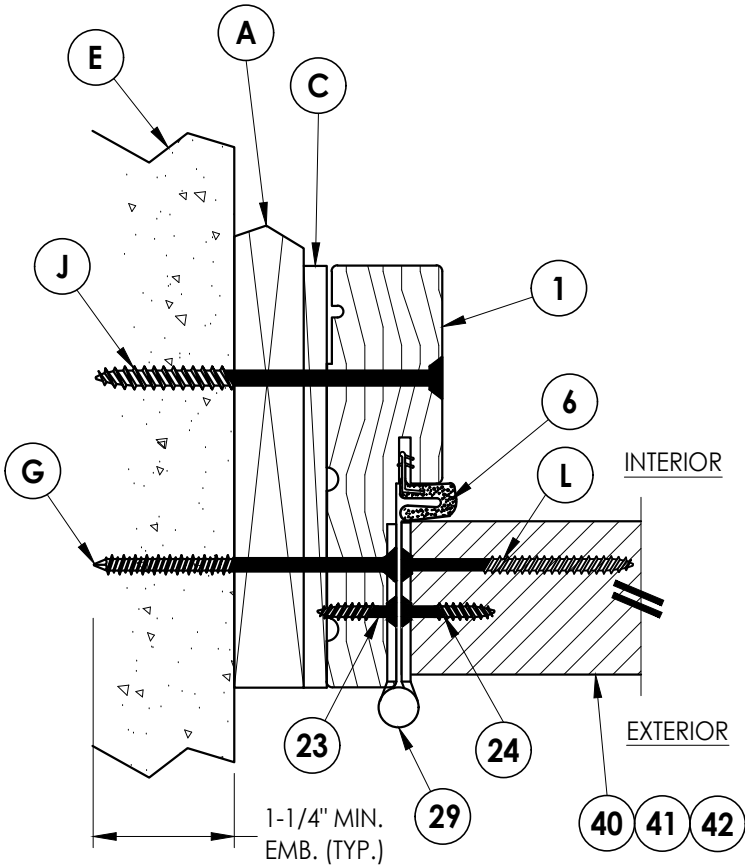


1
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

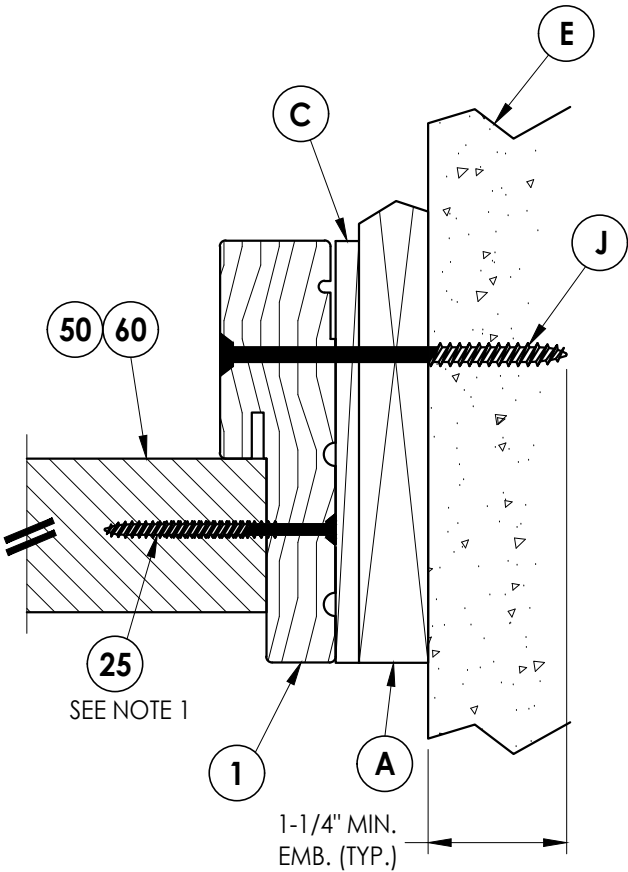

2
6 **HORIZONTAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

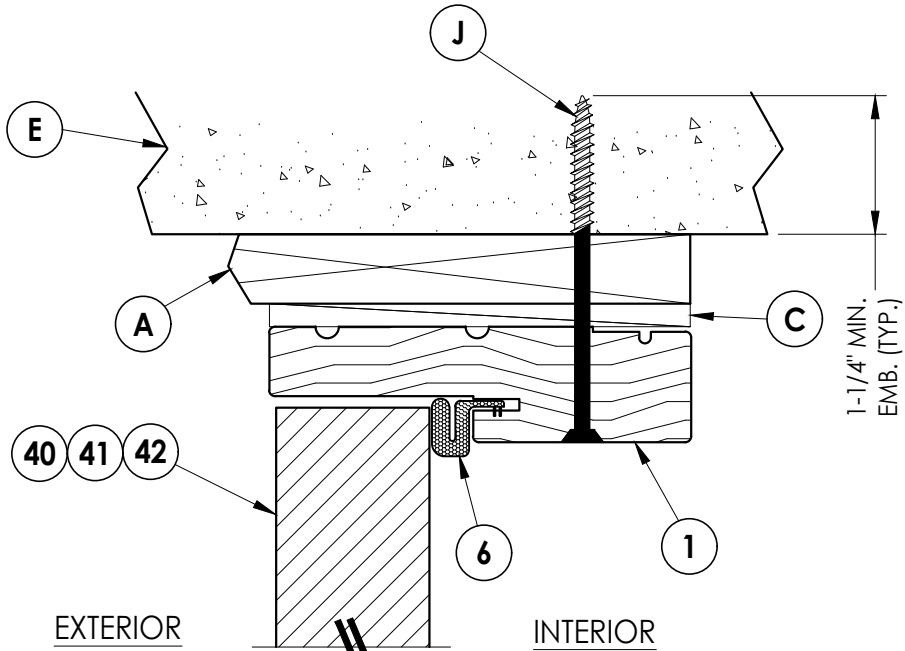

3
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

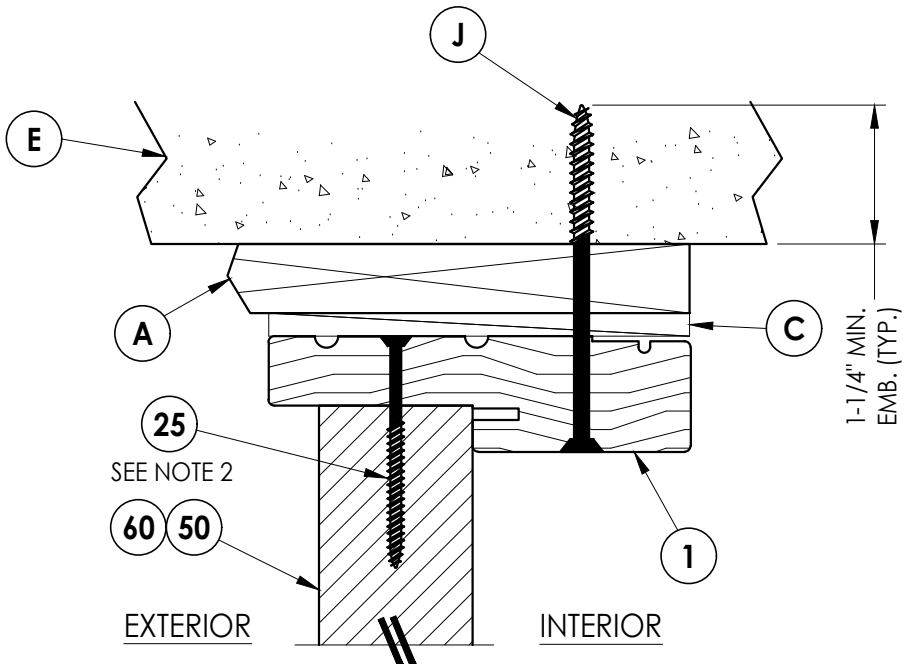

4
6 **VERTICAL CROSS SECTION**
Shown w/ 1X sub-buck
Outswing shown (Inswing similar)

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


PRODUCT: THERMA TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (1X BUCK)


NO.	DATE	REVISIONS
4	7/02/26	UPDATE TO 9TH ED. (2026) FBC LFS
3	7/25/23	UPDATE TO 8TH ED. (2023) FBC LFS
2	7/22/20	UPDATE TO 7th ED. (2020) FBC LFS
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC JK

DATE: 8/10/16
SCALE: N.T.S.
DWG. BY: JK
CHK. BY: LFS
DRAWING NO.:
FL-20470.13
SHEET 6 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg

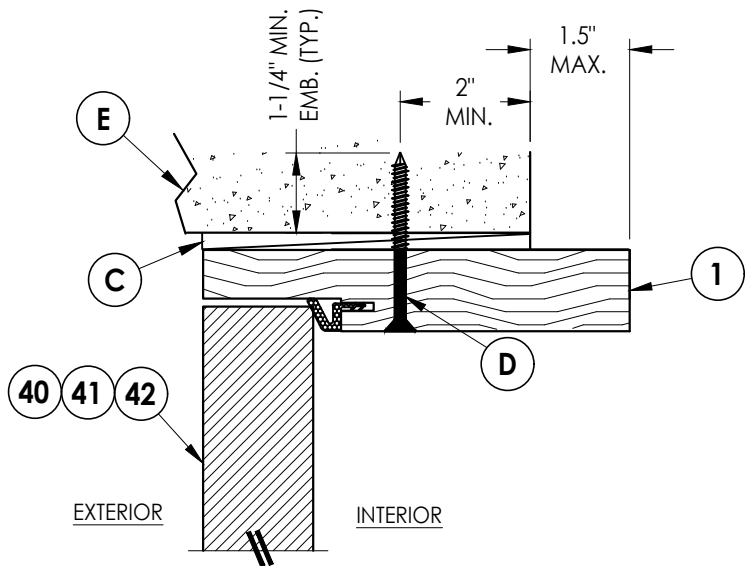


3 HORIZONTAL CROSS SECTION
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

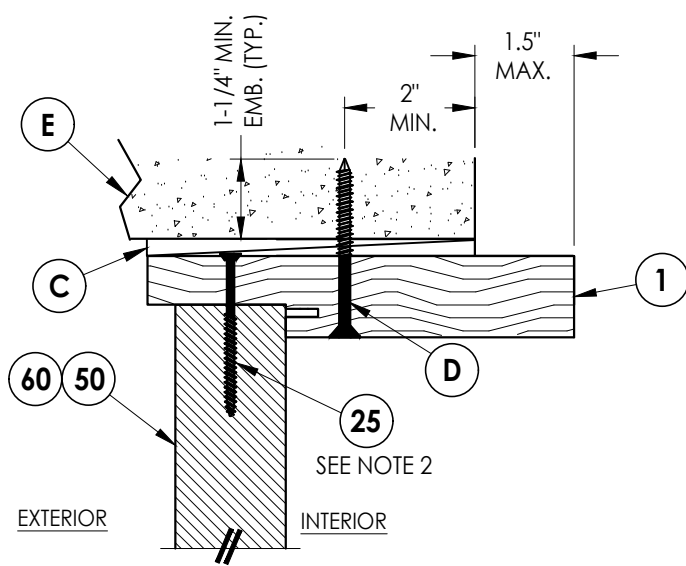


4 HORIZONTAL CROSS SECTION
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Notes:

1. Sidelite assembly screws located 6" from each end plus 5 more equally spaced between (7 screws total per side jamb).
2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along head jamb).

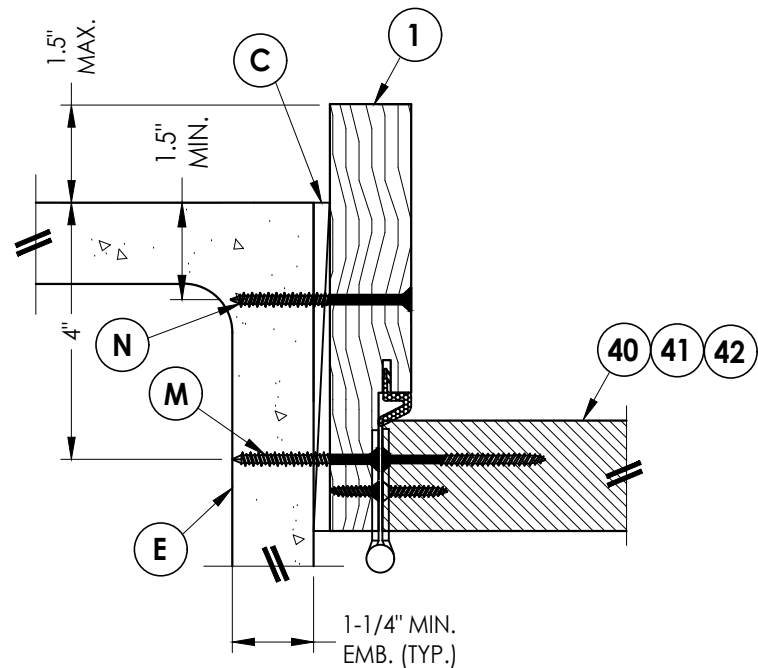

1 HORIZONTAL CROSS SECTION
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

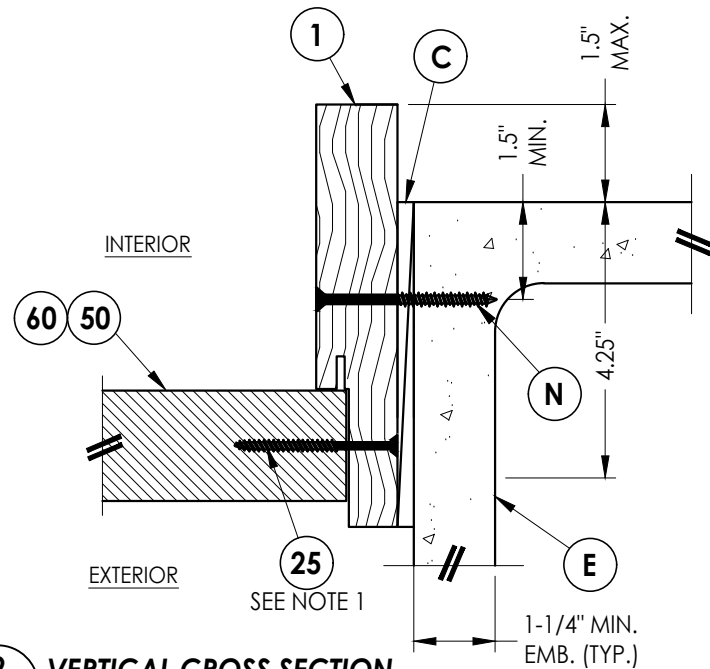

2 HORIZONTAL CROSS SECTION
7 Shown Direct to Masonry
Outswing only w/ 6-9/16" jamb

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
SECTIONS (DIRECT TO MASONRY)

NO.	DATE	REVISIONS
4	7/02/26	UPDATE TO 9TH ED. (2026) FBC
3	7/25/23	UPDATE TO 8TH ED. (2023) FBC
2	7/22/20	UPDATE TO 7th ED (2020) FBC
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC
		BY

DATE: 8/10/16

SCALE: N.T.S.

DWG. BY: JK







CHK. BY: LFS

DRAWING NO.:
FL-20470.13

SHEET 7 OF 14

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg

- Notes:
1. Sill Item #'s 16, 32, 33, 36, 37, 38 & 39 are attached to jambs w/ (3) #8 X 2-1/2" pfh screws at each end.
Sill Item #'s 17, 18 & 19 are attached to jambs w/ (2) #8 X 2-1/2" pfh screws at each end.
Sill Item #15 is attached to jambs utilizing (2) #10 X 2" pph SMS at each end.
2. Sidelite assembly screws located 3" from each end & at centerline (3 screws along sill).

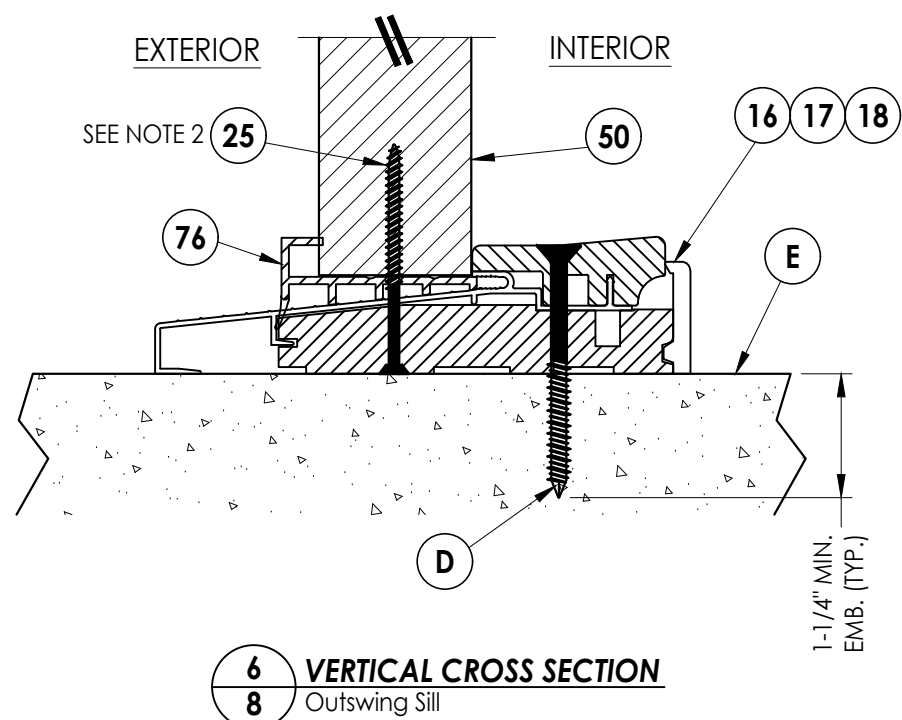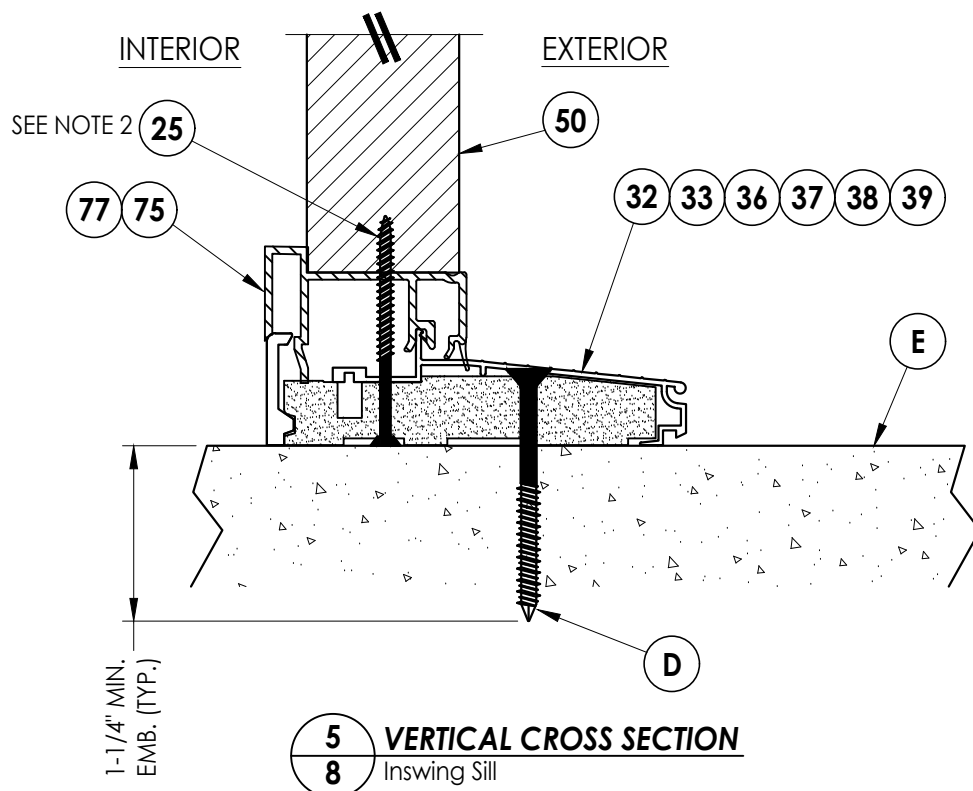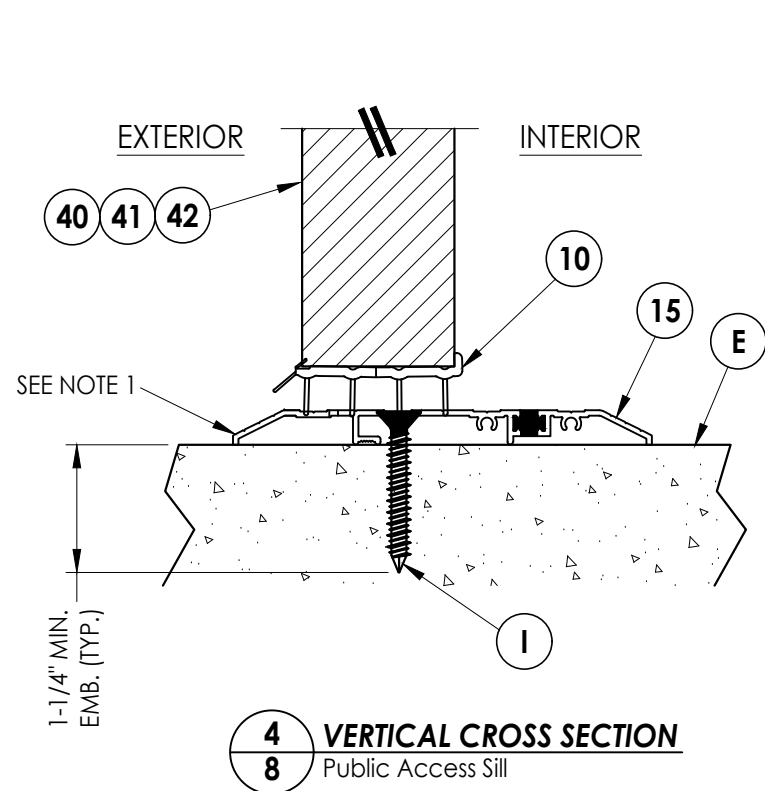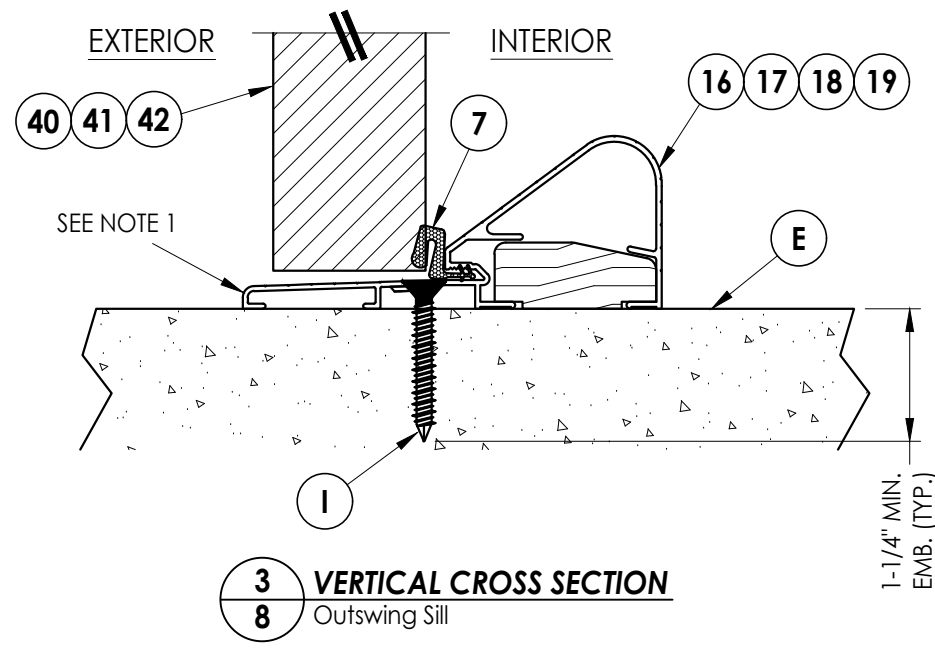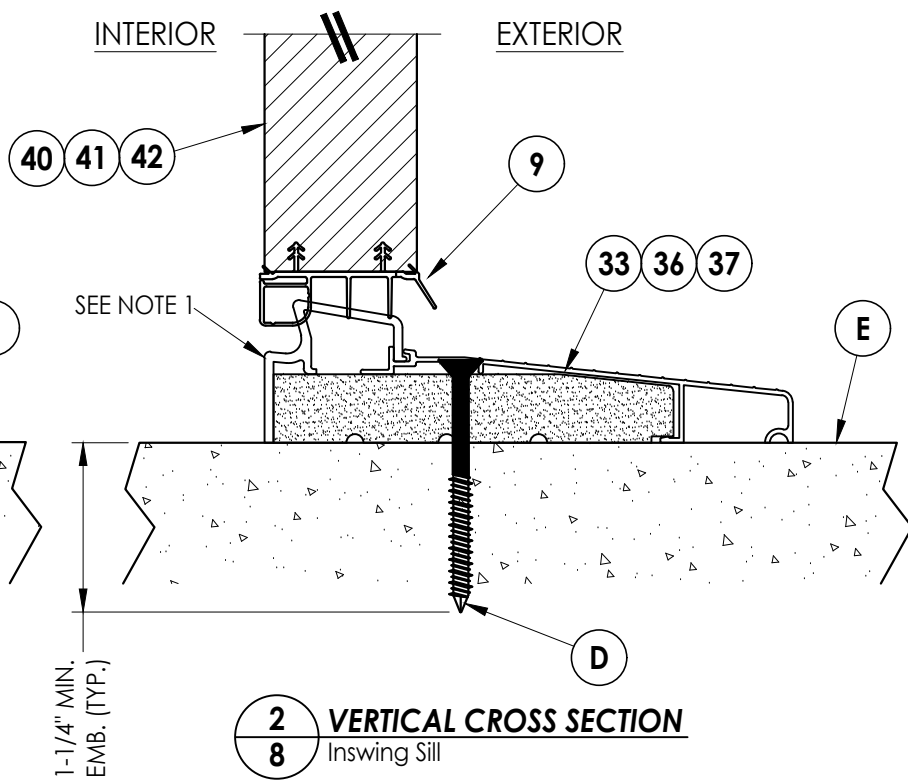
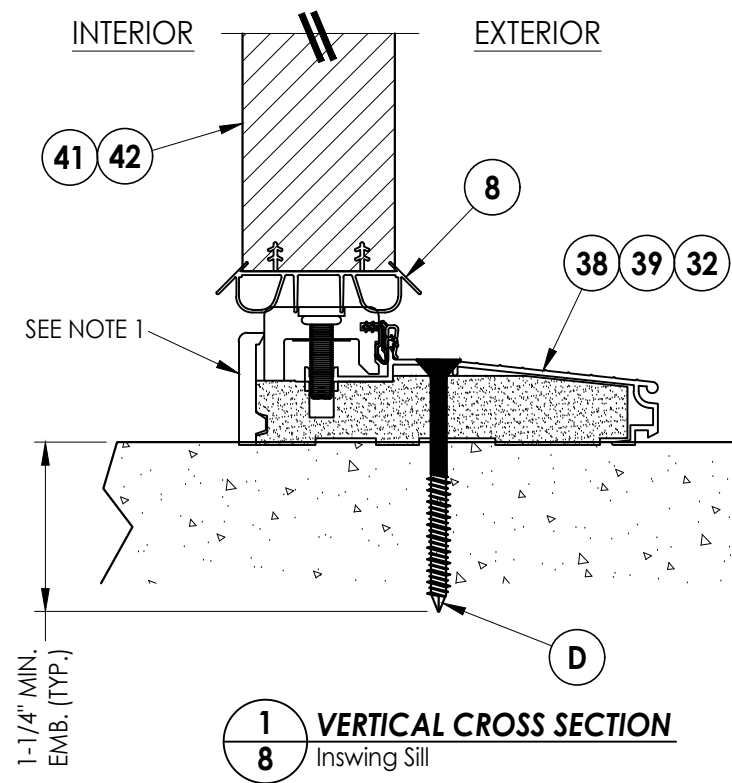


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:		THERMA TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:		VERTICAL CROSS SECTIONS (THRESHOLDS)	
NO.	DATE	REVISIONS	
		BY	JK
4	7/02/26	UPDATE TO 9TH ED. (2026)	FBC
3	7/25/23	UPDATE TO 8TH ED. (2023)	FBC
2	7/22/20	UPDATE TO 7th ED. (2020)	FBC
1	7/14/17	UPDATE TO 6TH ED. (2017)	FBC
DATE: 8/10/16			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-20470.13			
SHEET 8 OF 14			

Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg

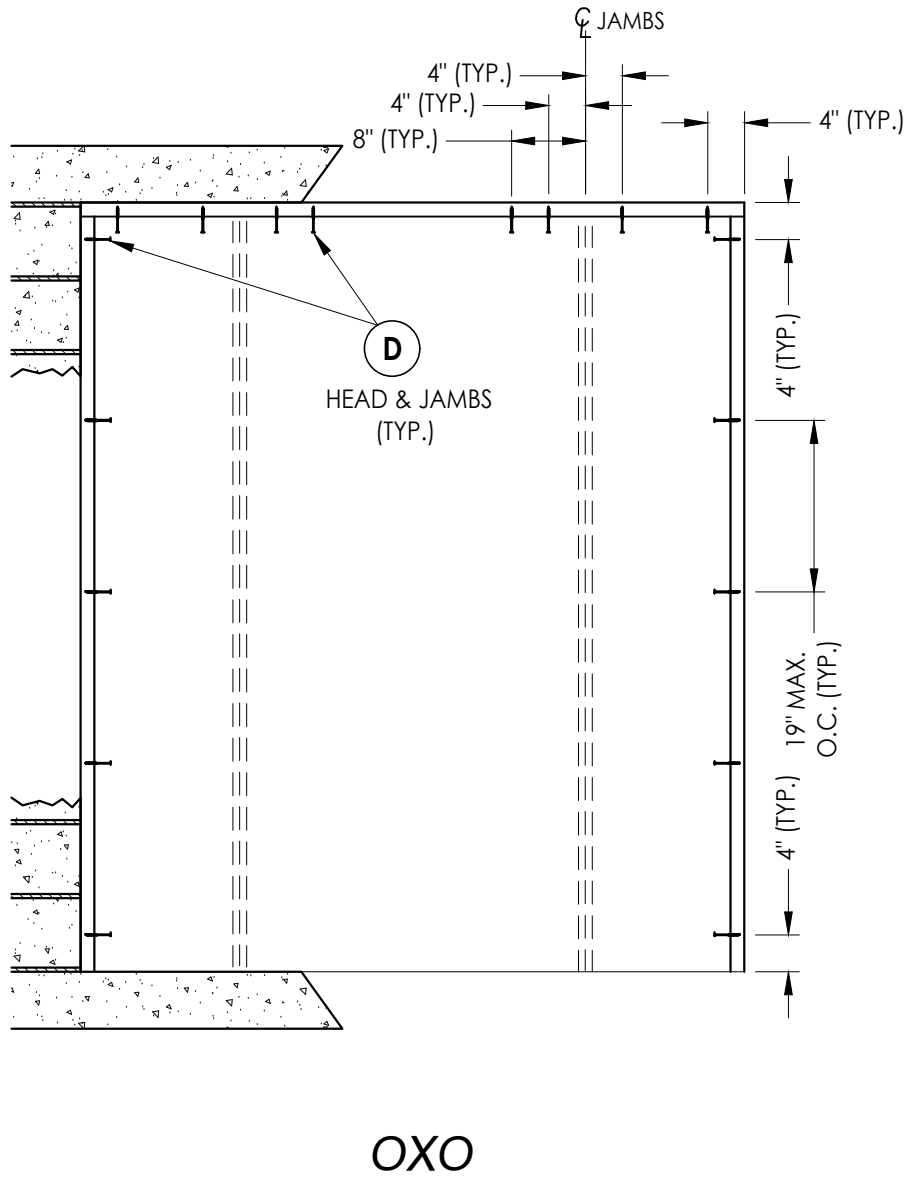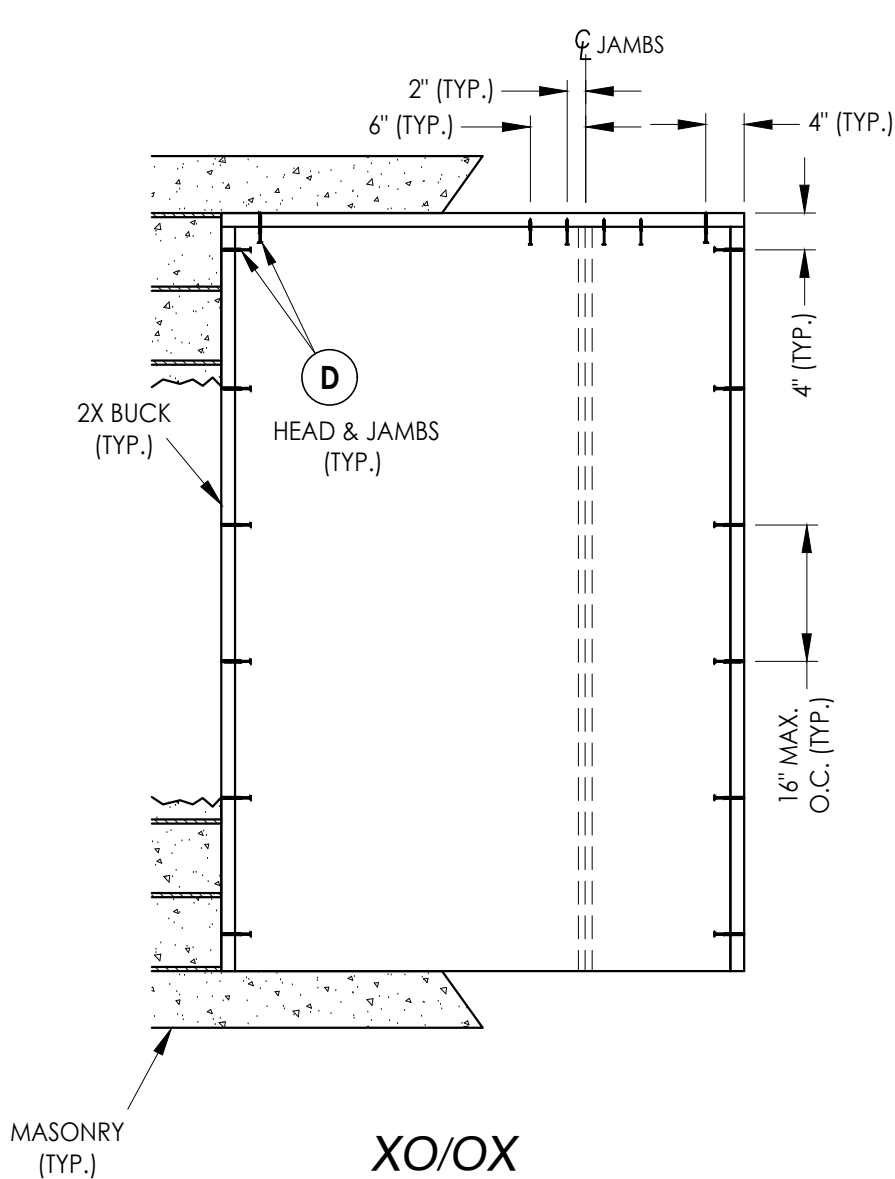

2X BUCK ANCHORING

DATE: 8/10/16	
SCALE: N.T.S.	
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.: FL-20470.13	
SHEET	9 OF 14

NO.	DATE	REVISIONS
4	7/02/26	UPDATE TO 9TH ED. (2026) FBC
3	7/25/23	UPDATE TO 8TH ED. (2023) FBC
2	7/22/20	UPDATE TO 7th ED (2020) FBC
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC
		JK
		BY


PRODUCT:	Therma Tru FIBERGLASS DOOR
	PART OR ASSEMBLY: BUCK ANCHORING

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409


RW

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg

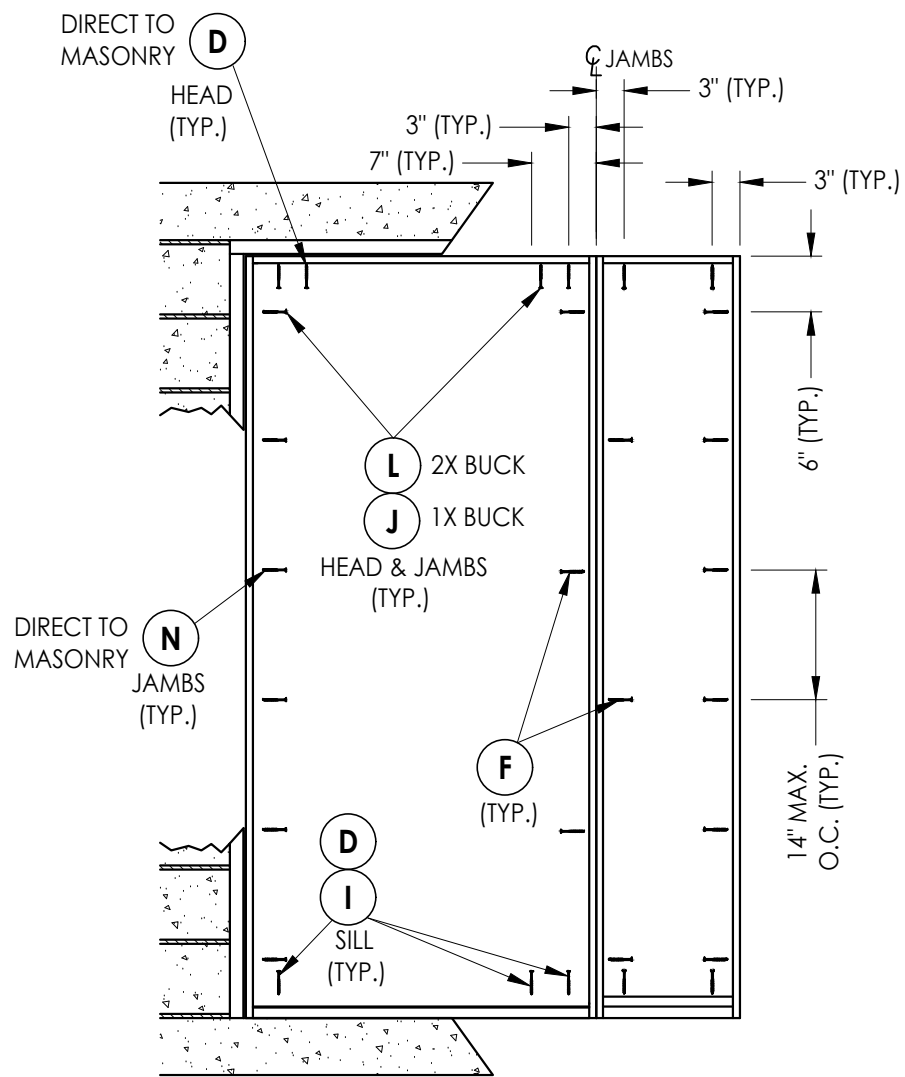

XO/OX

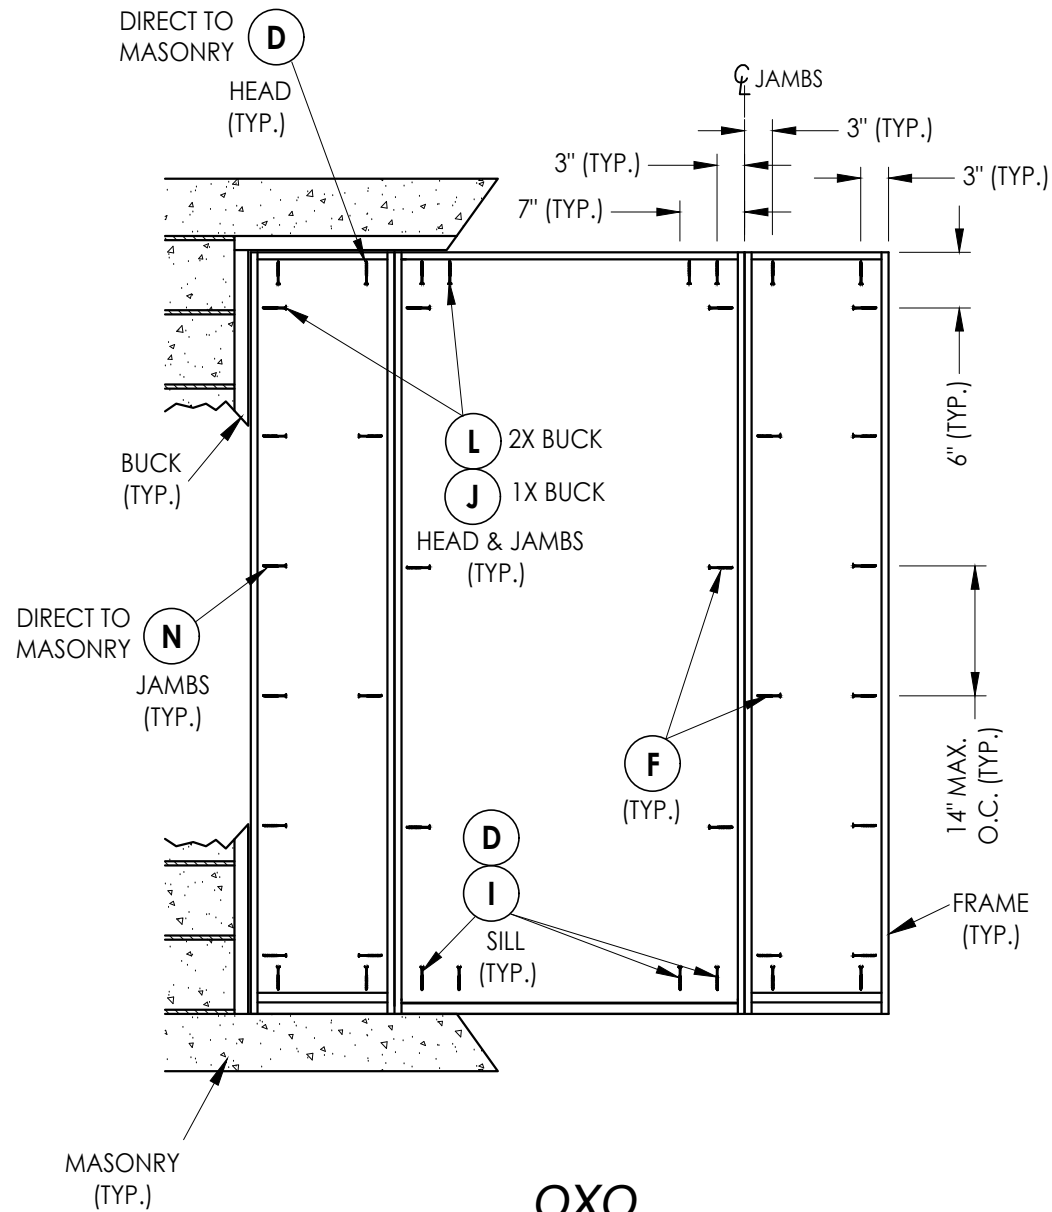

OXO

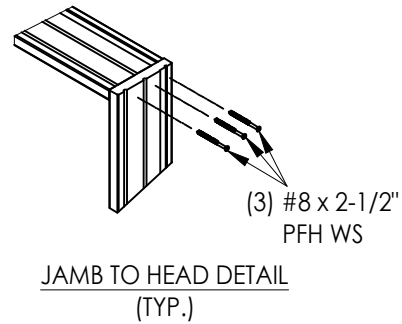

FRAME ANCHORING

PRODUCT:		THERMA TRU FIBERGLASS DOOR	
PART OR ASSEMBLY:		FRAME ANCHORING	
NO.	DATE	REVISIONS	
		DESCRIPTION	BY
4	7/02/26	UPDATE TO 9TH ED. (2026) FBC	LFS
3	7/25/23	UPDATE TO 8TH ED. (2023) FBC	LFS
2	7/22/20	UPDATE TO 7TH ED. (2020) FBC	LFS
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC	JK

DATE: 8/10/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS


DRAWING NO.:
FL-20470.13

SHEET 10 OF 14


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg

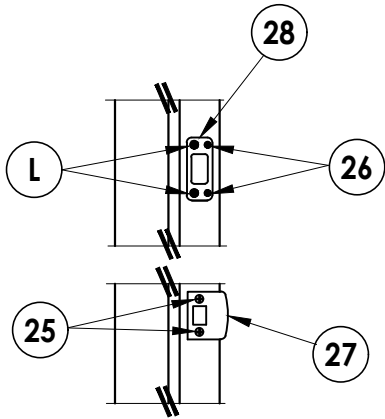


LATCH & DEADBOLT DETAIL
Kwikset

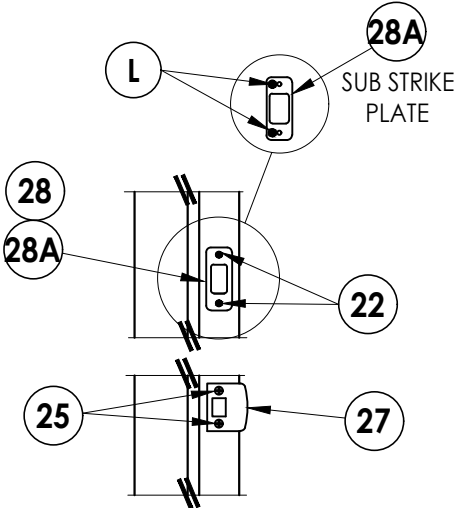


LATCH & DEADBOLT DETAIL
Schlage

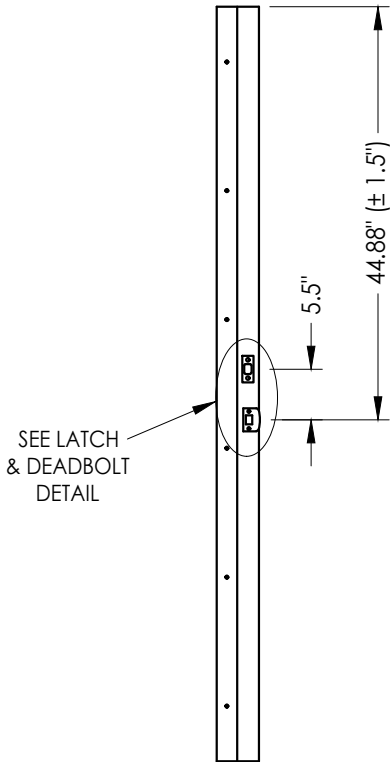


STRIKE JAMB
Latch and Deadbolt

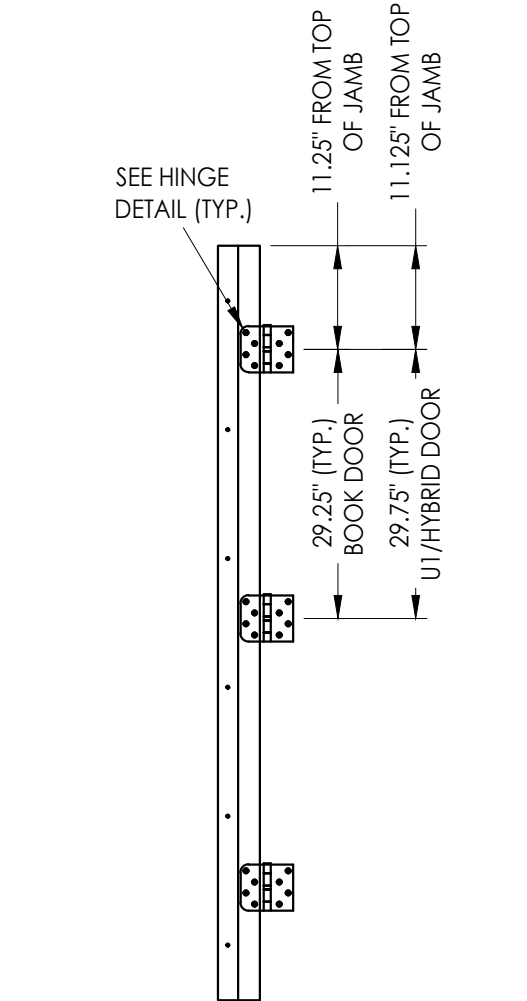


HINGE JAMB

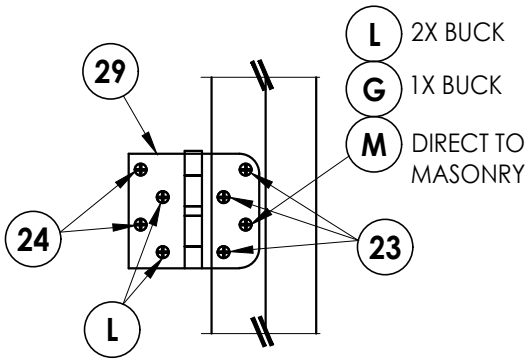


HINGE DETAIL

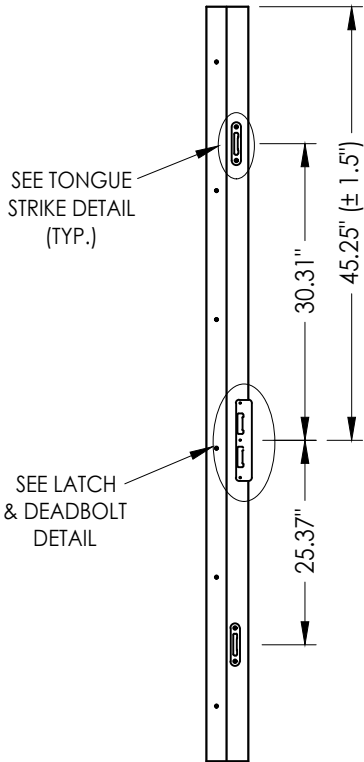

STRIKE JAMB
Multipoint Lock



TONGUE STRIKE DETAIL
Multipoint Lock

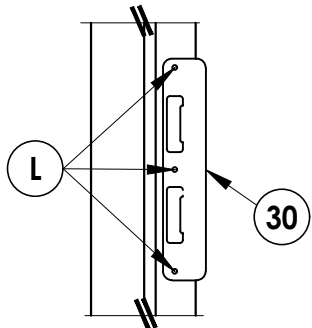

LATCH & DEADBOLT DETAIL
Multipoint Lock

LATCH & DEADBOLT STRIKE DETAILS

MULTIPOINT LOCK STRIKE DETAILS

NO.	DATE	REVISIONS			
		BY	JK	LFS	FBC
4	7/02/26	UPDATE TO 9TH ED.	(2026)	FBC	LFS
3	7/25/23	UPDATE TO 8TH ED.	(2023)	FBC	LFS
2	7/22/20	UPDATE TO 7th ED	(2020)	FBC	LFS
1	7/14/17	UPDATE TO 6TH ED.	(2017)	FBC	JK

DATE: 5/26/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:


FL-20470.13

SHEET 11 OF 14


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Therma-Tru\FL-20470 R5\FL-20470.13-16.dwg

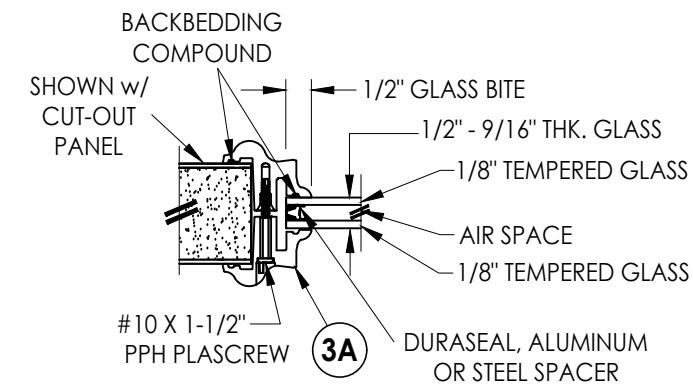


G1 GLAZING DETAIL
BTS Lite Frame
Sidelites

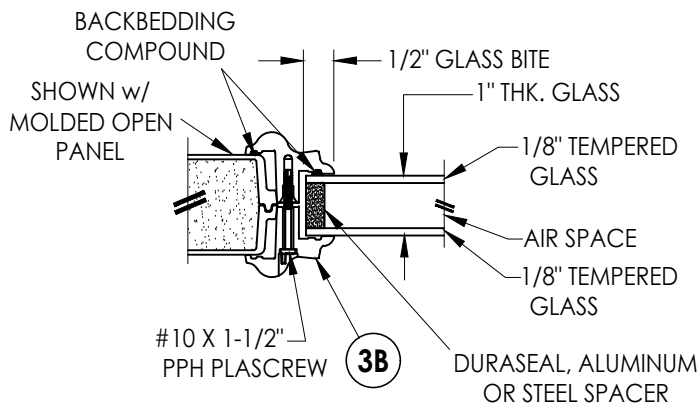


G2 GLAZING DETAIL
BTS Lite Frame
Sidelites

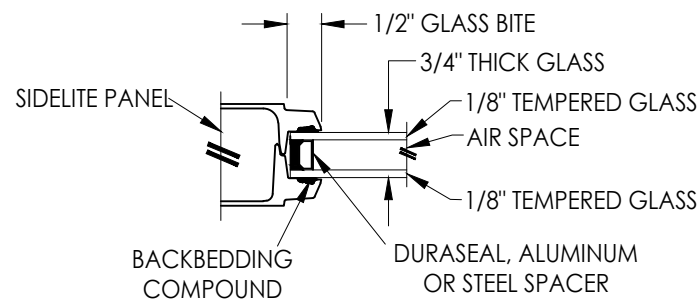

G3 GLAZING DETAIL
Flush Glazing
Sidelites




INTERNAL GRID (GBG)

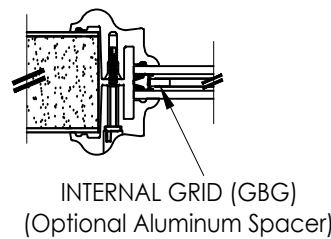


INTERNAL GRID (GBG)
(Optional Aluminum Spacer)


9/16" INSULATED GLASS INSERT OPTIONS




DECORATIVE INSERT




PRIVACY INSERT




WROUGHT IRON INSERT



INTERNAL GRID (GBG)




INTERNAL GRID (GBG)
(Optional Aluminum Spacer)




MINI BLIND
(Aluminum Spacer)


1" INSULATED GLASS INSERT OPTIONS




INTERNAL GRID (GBG)



INTERNAL GRID (GBG)




DECORATIVE INSERT




PRIVACY INSERT

3/4" INSULATED GLASS INSERT OPTIONS



3A BTS LITE FRAME
1/2" & 9/16" Glazing



3B BTS LITE FRAME
1" Glazing

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
THERMA-TRU
FIBERGLASS DOOR

PART OR ASSEMBLY:
GLAZING DETAILS

NO.	DATE	REVISIONS
4	7/02/26	UPDATE TO 9TH ED. (2026) FBC
3	7/25/23	UPDATE TO 8TH ED. (2023) FBC
2	7/22/20	UPDATE TO 7th ED. (2020) FBC
1	7/14/17	UPDATE TO 6TH ED. (2017) FBC
		JK
		BY

DATE: 8/10/16

SCALE: N.T.S.

DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:

FL-20470.13

SHEET 12 OF 14

Technical drawing of a mechanical part, likely a bracket or support. The drawing shows a cross-section with a vertical dimension of 1.32 inches and a horizontal dimension of 5.77 inches. The part features a complex internal structure with a central rectangular cavity and a sloped section on the right side.

Technical drawing of a mechanical part with the following dimensions:

- Overall height: 1.25"
- Overall width: 4.56"
- Right side thickness: 0.75"
- Bottom left width: 2.36"

0.45"

1.79"

SWEEP

10 SWEEP

2.06"

0.68"

2.13"

0.08"

0.68"

76 **SIDELITE SPAC**
Outswing

77 **SIDELITE SPACER**
Inswing
Moderate Climate Threshold

[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R²W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33593

P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2016 R.W. BUILDING CONSULTANTS INC.

BILL OF MATERIALS			BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL	ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (SG >= 0.42)	WOOD	25	#8 x 2-1/2" PFH WOOD SCREW	STEEL
B	2X BUCK (SG >= 0.42)	WOOD	26	#8 x 5/8" PFH WOOD SCREW	STEEL
C	1/4" MAX. SHIM SPACE	-	27	LATCH STRIKE PLATE	STEEL
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	28	DEADBOLT STRIKE PLATE	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE	28A	DEADBOLT SUB STRIKE PLATE	STEEL
			29	4" X 4" HINGE	STEEL
F	#10 X 2" PFH WOOD SCREW	STEEL	30	LATCH & DEADBOLT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
G	3/16" X 3-1/4" ITW CONCRETE SCREW	STEEL	31	MULTIPOINT STRIKE PLATE (TONGUE SYSTEM)	ALUM/COMP
I	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	32	INSWING THRESHOLD	ALUM/COMP
J	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL	33	INSWING THRESHOLD	ALUM/COMP
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL	36	INSWING THRESHOLD	ALUM/COMP
M	3/16" X 2-1/4" ITW CONCRETE SCREW	STEEL	37	INSWING THRESHOLD	ALUM/COMP
1	JAMB (FINGER JOINT PINE)	WOOD	38	INSWING THRESHOLD	ALUM/COMP
6	WEATHERSTRIP (MEDIUM REACH)	FOAM	39	INSWING THRESHOLD	ALUM/COMP
7	WEATHERSTRIP (LONG REACH)	FOAM	40	DOOR PANEL (BOOK)	-
8	SWEEP	VINYL	41	DOOR PANEL (HYBRID)	-
9	SWEEP (USE w/ MODERATE CLIMATE THRESHOLD)	VINYL	42	DOOR PANEL (U1)	-
10	SWEEP (USE w/ PUBLIC ACCESS THRESHOLD)	VINYL	50	SIDELITE (FULL LITE)	-
15	ADA THRESHOLD	ALUM	60	SIDELITE (HALF LITE)	-
16	OUTSWING THRESHOLD	ALUM/COMP	75	SIDELITE SPACER (INSWING)	-
17	OUTSWING THRESHOLD	ALUM/COMP	76	SIDELITE SPACER (OUTSWING)	-
18	OUTSWING THRESHOLD	ALUM/COMP	77	SIDELITE SPACER (INSWING) - MODERATE CLIMATE SILL	-
19	COASTAL OUTSWING THRESHOLD	ALUM/ WOOD			
22	#8 x 3/4" PFH WOOD SCREW	STEEL			
23	#10 x 3/4" PFH WOOD SCREW	STEEL			
24	#10 x 1" PFH WOOD SCREW	STEEL			

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRA-CON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	AS SHOWN	1-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

CORROSION RESISTANCE - SALTWATER ENVIRONMENTS
Fasteners & connectors in areas within 3000 ft (914 m) of a saltwater coastline shall comply with FBC Sections 1711.1 or R332.1.

DATE: 8/10/16		DRAWING NO.: FL-20470.13		SHEET 14 OF 14	
SCALE: N.T.S.		CHK. BY: LFS		DWG. BY: JK	
NO.		DATE		BY	
4		7/02/26		UPDATE TO 9TH ED. (2026) FBC	
3		7/25/23		UPDATE TO 8TH ED. (2023) FBC	
2		7/22/20		UPDATE TO 7th ED (2020) FBC	
1		7/14/17		UPDATE TO 6TH ED. (2017) FBC	
PRODUCT:		THERMA TRU FIBERGLASS DOOR		PART OR ASSEMBLY: BILL OF MATERIALS	
Documents Prepared By:		Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	